

**SIEMENS**



# SINAMICS drives

## SINAMICS DCM

DC Converter. Control Module.

List Manual

Edition

06/2013

Answers for industry.



# SIEMENS

## SINAMICS

## SINAMICS DCM

### List Manual

#### Valid for

#### Drive

**SINAMICS DCM**

#### Firmware version

**1.4 (based on 4.6)**

---

Preface

---

Parameters

---

Function diagrams

---

Faults and alarms

---

Appendix

---

List of abbreviations

---

Index

---

**1**

**2**

**3**

**A**

**B**

**C**

**6RX1800-0ED76**

**06/2013**

C98130-A7066-A3-4-7619

## Safety notices

This manual contains information that you should observe to ensure your own personal safety as well as to avoid material damage. The notes referring to your personal safety are highlighted by a warning triangle; notes that only relate to material damage have no warning triangle. The notes shown below are graded according to the level of hazard (from most to least hazardous):



---

### Danger

Indicates that death or serious injury **will** result if proper precautions are not taken.

---



---

### Warning

Indicates that death or serious injury **may** result if proper precautions are not taken.

---



---

### Caution

With a warning triangle, indicates that minor injury **may** result if proper precautions are not taken.

---

---

### Caution

Without a warning triangle, indicates that material damage may result if proper precautions are not taken.

---

---

### Notice

Indicates that an undesirable result or condition may occur if the corresponding note is not observed.

---

If more than one level of danger is simultaneously applicable, the warning notice for the highest level is used. A warning note in a warning triangle indicating possible personal injury may also include a warning note relating to material damage.

## Qualified personnel

The associated device/system may only be installed and operated in conjunction with this documentation. The device/system may only be commissioned and operated by **qualified personnel**. For the purpose of the safety information in this documentation, a "qualified person" is someone who is authorized to commission, ground, and tag equipment, systems, and circuits in accordance with established safety procedures.

## Proper use of Siemens products

Please observe the following:



---

### Warning

Siemens products are only permitted to be used for the applications listed in the catalog and in the associated technical documentation. If third-party products and components are used, then they must be recommended or approved by Siemens. These products can only function correctly and safely if they are transported, stored, set up, mounted, installed, commissioned, operated and maintained correctly. The permissible ambient conditions must be adhered to. Information in the associated documentation must be observed.

---

## Trademarks

All names identified with ® are registered trademarks of Siemens AG. Any other names used in this publication may be trademarks whose use by third parties for their own purposes could violate the rights of the owner.

### Copyright Siemens AG 2009 - 2013 All Rights Reserved

The reproduction, transmission, or use of this document or its contents is not permitted without express written permission. Offenders are liable to the payment of damages. All rights reserved, especially those relating to granting patents or GM registration.

Siemens AG  
Industry Sector  
P.O. Box 4848  
90327 NUREMBERG  
GERMANY

### Liability Disclaimer

We have checked that the contents of this document correspond to the hardware and software described. Nevertheless, we cannot assume responsibility for any deviations that may occur. The data in this document is regularly checked and any necessary corrections included in subsequent editions.

© Siemens AG 2009 - 2013  
Subject to technical changes without prior notice.

# Preface

## Information about documentation for SINAMICS

The SINAMICS documentation is structured according to the following categories:

- General documentation / catalogs
- Manufacturer / service documentation

This documentation is part of the Technical Customer Documentation developed for SINAMICS.

In the interests of clarity, this documentation does not contain all the detailed information for all product types and cannot take into account every possible aspect of installation, operation, or maintenance.

The contents of this documentation are not part of an earlier or existing agreement, a promise, or a legal agreement, nor do they change this. All obligations on the part of Siemens can be found in the respective sales contract, which also contains the complete and sole warranty provisions. These contractual warranty provisions are neither extended nor restricted as a result of the statements made in this documentation.

## Target group

This documentation addresses commissioning engineers and service personnel who use SINAMICS.

## Objective

This manual contains information about all parameters, function diagrams, faults, and alarms required to commission and service the system.

This manual should be used in addition to the other manuals and tools provided for the product.

## Search tools

The following guides are provided to help you locate information in this manual:

1. Table of contents
  - General table of contents for the complete manual (after the preface).
  - Table of contents for function diagrams (Chapter 2.1).
2. List of abbreviations
3. Index

## **Technical Support**

Country-specific telephone numbers for technical support are provided on the Internet at:

<http://www.siemens.com/automation/service&support>

## **SINAMICS**

You can find information on SINAMICS at:

<http://www.siemens.com/sinamics>

# Table of contents

<b>1</b>	<b>Parameters</b>	<b>1-9</b>
1.1	Overview of parameters	1-10
1.1.1	Explanation of the list of parameters	1-10
1.1.2	Number ranges of parameters	1-22
1.2	List of parameters	1-25
1.3	Parameters for data sets	1-645
1.3.1	Parameters for command data sets (CDS)	1-645
1.3.2	Parameters for drive data sets (DDS)	1-647
1.3.3	Parameters for encoder data sets (EDS)	1-653
1.4	Parameters for write protection and know-how protection	1-655
1.4.1	Parameters with "WRITE_NO_LOCK"	1-655
1.4.2	Parameters with "KHP_WRITE_NO_LOCK"	1-657
1.4.3	Parameters with "KHP_ACTIVE_READ"	1-658
<b>2</b>	<b>Function diagrams</b>	<b>2-659</b>
2.1	Table of contents	2-660
2.2	Explanation of the function diagrams	2-666
2.3	Overviews	2-671
2.4	CUD input/output terminals	2-679
2.5	PROFIdrive	2-690
2.6	Internal control/status words	2-715
2.7	Sequence control	2-722
2.8	Brake control	2-727
2.9	Setpoint channel	2-729
2.10	Encoder evaluation	2-743
2.11	Armature circuit closed-loop control	2-751
2.12	Field circuit closed-loop control	2-774
2.13	Power unit	2-783
2.14	Technology controller	2-792
2.15	Signals and monitoring functions	2-794
2.16	Faults and alarms	2-811
2.17	Data sets	2-816
2.18	Communication between devices	2-820
2.19	Terminal Module 15 for SINAMICS (TM15DI/DO)	2-826
2.20	Terminal Module 31 (TM31)	2-830

2.21	Terminal Module 150 (TM150) . . . . .	2-841
2.22	Basic Operator Panel 20 (BOP20) . . . . .	2-845
<b>3</b>	<b>Faults and alarms</b> . . . . .	<b>3-847</b>
3.1	Overview of faults and alarms . . . . .	3-848
3.1.1	General information on faults and alarms . . . . .	3-848
3.1.2	Explanation of the list of faults and alarms . . . . .	3-852
3.1.3	Number ranges of faults and alarms . . . . .	3-855
3.2	List of faults and alarms . . . . .	3-857
<b>A</b>	<b>Appendix</b> . . . . .	<b>A-1141</b>
A.1	ASCII table (excerpt) . . . . .	A-1142
<b>B</b>	<b>List of abbreviations</b> . . . . .	<b>B-1143</b>
<b>C</b>	<b>Index</b> . . . . .	<b>C-1153</b>



# Parameters

# 1

## Content

1.1	Overview of parameters	1-10
1.2	List of parameters	1-25
1.3	Parameters for data sets	1-645
1.4	Parameters for write protection and know-how protection	1-655

## 1.1 Overview of parameters




### 1.1.1 Explanation of the list of parameters

#### Basic structure of the parameter descriptions

The data in the following example have been chosen at random. The description of a parameter includes as a maximum, the information listed below. Some of the information is optional.

The parameter list (See Chapter 1.2) is structured as follows:

----- **Start of the example** -----

pxxxx[0...n]	BICO: Full parameter name / abbreviated name			
Drive object (function module)	<b>Can be changed:</b> C1(x), C2(x), U, T <b>Data type:</b> Unsigned32 / Integer16 <b>P group:</b> Closed-loop control <b>Not for motor type:</b> FEM <b>Min</b> 0.00 [Nm]	<b>Calculated:</b> CALC_MOD_REG <b>Dynamic index:</b> CDS, p0170 <b>Unit group:</b> 7_1 <b>Normalizing:</b> p2000 <b>Max</b> 10.00 [Nm]	<b>Access level:</b> 2 <b>Function diagram:</b> 2080 <b>Unit selection:</b> p0505 <b>Expert list:</b> 1 <b>Factory setting</b> 0.00 [Arms]	
<b>Description:</b>	Text			
<b>Values:</b>	0:      Name and meaning of value 0 1:      Name and meaning of value 1 2:      Name and meaning of value 2 etc.			
<b>Recommend.:</b>	Text			
<b>Index:</b>	[0] = Name and meaning of index 0 [1] = Name and meaning of index 1 [2] = Name and meaning of index 2 etc.			
<b>Bit array:</b>	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>
	00	Name and meaning of bit 0	Yes	No
	01	Name and meaning of bit 1	Yes	No
	02	Name and meaning of bit 2	Yes	No
	etc.			
<b>Dependency:</b>	Text See also: pxxxx, rxxxx See also: Fxxxxx, Axxxxx			
<b>Danger:</b>	<b>Warning:</b>	<b>Caution:</b>	Safety notices with a warning triangle	
				
<b>Caution:</b>	<b>Notice:</b>	Safety notices without a warning triangle		
<b>Note:</b>	Information that might be useful.			

----- **End of the example** -----

**pxxxx[0...n]    Parameter number**

The parameter number is made up of a “p” or “r”, followed by the parameter number and the index (optional).

Examples of the representation in the parameter list:

- p...                      Adjustable parameters (read and write parameters)
- r...                      Display parameters (read-only)
- p0918                    Adjustable parameter 918
- p0099[0...3]           Adjustable parameter 99, indices 0 to 3
- p1001[0...n]           Adjustable parameter 1001, indices 0 to n (n = configurable)
- r0944                    Display parameter 944
- r2129.0...15           Display parameter 2129 with bit array from bit 0 (smallest bit) to bit 15 (largest bit)

Other examples of the notation used in the documentation:

- p1070[1]                Adjustable parameter 1070, index 1
- p2098[1].3             Adjustable parameter 2098, index 1 bit 3
- r0945[2](3)            Display parameter 945, index 2 of drive object 3
- p0795.4                Adjustable parameter 795, bit 4

The following applies to adjustable parameters:

The parameter value “when shipped” is specified under “Factory setting” with the relevant unit in square parentheses. The value can be adjusted within the range defined by “Min” and “Max”.

The term "linked parameterization" is used in cases where changes to adjustable parameters affect the settings of other parameters.

Linked parameterization can occur, for example, as a result of the following actions and parameters:

- Executing macros  
p0015, p0700, p1000, p1500
- Setting a PROFIBUS telegram (BICO interconnections)  
p0922
- Setting component lists  
p0400
- Automatically calculating and preassigning  
p0112, p0340, p3900
- Restore factory settings  
p0970

The following applies to display parameters:

The fields “Min”, “Max” and “Factory setting” are specified with a dash “-” and the relevant unit in square parentheses.

---

**Note:**

The parameter list can contain parameters that are not visible in the expert lists of the respective commissioning software (e.g. parameters for trace functions).

---

**BICO: Full parameter name / abbreviated name**

The following abbreviations can appear in front of the parameter name:

- BI: Binector Input  
This parameter is used for selecting the source of a digital signal.
- BO: Binector Output  
This parameter is available as a digital signal for interconnection with other parameters.
- CI: Connector Input  
This parameter is used for selecting the source of an “analog” signal.
- CO: Connector Output  
This parameter is available as an “analog” signal for interconnection with other parameters.
- CO/BO: Connector/Binector Output  
This parameter is available as an “analog” and digital signal for interconnection with other parameters.

---

**Note:**

A connector input (CI) cannot be just interconnected with any connector output (CO, signal source).

When interconnecting a connector input using the commissioning software, only the corresponding possible signal sources are listed.

---

**Drive object (function module)**

A drive object (DO) is an independent, “self-contained” functional unit that has its own parameters and, in some cases, faults and alarms.

When carrying out commissioning using the commissioning software, you can select/deselect additional functions and their parameters by activating/deactivating function modules accordingly.

The parameter list specifies the associated drive object and function module for each individual parameter.

Example:

- r61000: PROFINET Name of Station  
CU\_DC (PROFINET)  
The parameter is only available in the case of the CU\_DC drive object with the "PROFINET" function module.

A parameter can belong to a single, multiple, or all drive objects.

The following information relating to "Drive object" and "Function module" can be displayed under the parameter number:

Table 1-1 Data in the "Drive object (function module)" field

Drive object (function module)	Type	Meaning
All objects	-	This parameter is used by all drive objects.
CU_DC	6	Advanced Control Unit SINAMICS DCM (CUD) is to the left.
CU_DC_R	6	Advanced Control Unit SINAMICS DCM (CUD) is to the right.
CU_DC_S	6	Standard Control Unit SINAMICS DCM (CUD) is to the left.
CU_DC_R_S	6	Standard Control Unit SINAMICS DCM (CUD) is to the right.
CU_DC (PROFINET)	-	Control Unit SINAMICS DCM with "PROFINET" function module
DC_CTRL	17	DC closed loop control general or DC closed loop control on the Advanced CUD left.
DC_CTRL_R	17	DC closed loop control extended on the Advanced CUD right.
DC_CTRL_S	17	DC closed loop control on the standard CUD right.
DC_CTRL_R_S	17	DC closed loop control extended on the standard CUD right.
DC_CTRL (PROFINET)	-	DC closed loop control with "PROFINET" function module.
TM31	200	Terminal Module 31.
TM31 (PROFINET)	-	Terminal Module 31 with "PROFINET" function module.
TM15DI_DO	204	Terminal Module 15 (for SINAMICS).
TM15DI_DO (PROFINET)	-	Terminal Module 15 (for SINAMICS) with "PROFINET" function module.
TM150	208	Terminal Module 150.
TM150 (PROFINET)	-	Terminal Module 150 with "PROFINET" function module.

**Note:**

The drive object type is used to identify the drive objects in the drive system (e.g. r0107, r0975[1]).

**Can be changed**

The “-” sign indicates that the parameter can be changed in any object state and that the change will be effective immediately.

The information “C1(x), C2(x), T, U” ((x): optional) means that the parameter can be changed only in the specified drive object state and that the change will not take effect until the object switches to another state. This can be one or more states.

The following states exist:

- C1(x) Device commissioning                      C1: **Commissioning 1**  
     Device commissioning is in progress (p0009 > 0).  
     Pulses cannot be enabled.  
     The parameter can only be changed for the following device commissioning settings (p0009 > 0):
  - C1: Can be changed for all settings p0009 > 0.
  - C1(x): Can be changed only when p0009 = x.
     A modified parameter value does not take effect until device commissioning mode is exited with p0009 = 0.
- C2(x) Drive object commissioning                      C2: **Commissioning 2**  
     Drive commissioning is in progress (p0009 = 0 and p0010 > 0).  
     Pulses cannot be enabled.  
     The parameter can only be changed in the following drive commissioning settings (p0010 > 0):
  - C2: Can be changed for all settings p0010 > 0.
  - C2(x): Can only be changed for the settings p0010 = x.
     A modified parameter value does not take effect until drive commissioning mode is exited with p0010 = 0.
- U      Operation    U: **Run**  
     Pulses are enabled.
- T      Ready    T: **Ready to run**  
     The pulses are not enabled and the “C1(x)” or “C2(x)” state is not active.

---

**Note:**

Parameter p0009 is CU-specific (belongs to the Control Unit).

Parameter p0010 is drive-specific (belongs to each drive object).

The operating state of individual drive objects is displayed in r0002.

---

**Calculated**

Specifies whether the parameter is influenced by automatic calculations.

The calculation attribute defines which activities influence the parameter.

The following attributes exist:

- CALC\_MOD\_ALL
  - p0340 = 1
- CALC\_MOD\_CON
  - p0340 = 1
- CALC\_MOD\_EQU
  - p0340 = 1
- CALC\_MOD\_LIM\_REF
  - p0340 = 1, 5
- CALC\_MOD\_REG
  - p0340 = 1, 3

---

**Note:**

For p3900 > 0, p0340 = 1 is also called automatically.

---

**Access level**

Specifies the access level required to be able to display and change this parameter. The required access level can be set using p0003.

The system uses the following access levels:

- 1: Standard
- 2: Extended
- 3: Expert
- 4: Service
  - Parameters with this access level are password protected.

---

**Note:**

Parameter p0003 is CU-specific (belongs to the Control Unit).

---

## Data type

The information on the data type can consist of the following two items (separated by a slash):

- First item  
Data type of the parameter
- Second item (for binector or connector input only)  
Data type of the signal source to be interconnected (binector/connector output).

Parameters can have the following data types:

- I8 Integer8 8-bit integer number
- I16 Integer16 16-bit integer number
- I32 Integer32 32-bit integer number
- U8 Unsigned8 8 bits without sign
- U16 Unsigned16 16 bits without sign
- U32 Unsigned32 32 bits without sign
- Float FloatingPoint32 32-bit floating point number

Depending on the data type of the BICO input parameters (signal sink) and BICO output parameter (signal source), the following combinations are possible when BICO interconnections are established:

Table 1-2 Possible combinations of BICO interconnections

	BICO input parameter			
	CI parameter			BI parameter
BICO output parameter	Unsigned32 / Integer16	Unsigned32 / Integer32	Unsigned32 / FloatingPoint32	Unsigned32 / Binary
CO: Unsigned8	x	x	–	–
CO: Unsigned16	x	x	–	–
CO: Integer16	x	x	–	–
CO: Unsigned32	x	x	–	–
CO: Integer32	x	x	–	–
CO: FloatingPoint32	x	x	x <sup>1</sup>	–
BO: Unsigned8	–	–	–	x
BO: Unsigned16	–	–	–	x
Legend: x: BICO interconnection permitted –: BICO interconnection not permitted				
1 Exception: BICO input parameters with data type "Unsigned32/FloatingPoint32" can also be interconnected with the following BICO output parameters, although these are not of the "FloatingPoint32" data type: CO: r8850, CO: r8860, CO: r2050, CO: r2060				



Table 1-2 Possible combinations of BICO interconnections, continued

	BICO input parameter			
	CI parameter			BI parameter
BICO output parameter	Unsigned32 / Integer16	Unsigned32 / Integer32	Unsigned32 / FloatingPoint32	Unsigned32 / Binary
BO: Integer16	–	–	–	x
BO: Unsigned32	–	–	–	x
BO: Integer32	–	–	–	x
BO: FloatingPoint32	–	–	–	–
Legend: x: BICO interconnection permitted –: BICO interconnection not permitted				
1 Exception: BICO input parameters with data type "Unsigned32/FloatingPoint32" can also be interconnected with the following BICO output parameters, although these are not of the "FloatingPoint32" data type: CO: r8850, CO: r8860, CO: r2050, CO: r2060				

### Dynamic index

For parameters with a dynamic index [0 to n], the following information is specified here:

- Data set (if this is available).
- Parameter for the number of indices ( $n = \text{number} - 1$ ).

The following information can be contained in this field:

- "CDS, p0170" (Command Data Set, CDS count)

Example:

p1070[0] → main setpoint [command data set 0]

p1070[1] → main setpoint [command data set 1], etc.

- "DDS, p0180" (Drive Data Set, DDS count)
- "EDS, p0140" (Encoder Data Set, EDS count)

#### Note:

Information on the data sets can be taken from the following references:

References: SINAMICS DC MASTER operating instructions  
 "Data sets" Chapter

**Function diagram**

The parameter is included in this function diagram. The structure of the parameter function and its relationship with other parameters is shown in the specified function diagram.

**Example:**

Function diagram: 3060.3	3060:	Function diagram number
	3:	Signal path (optional)

**P group (refers only to access via BOP (Basic Operator Panel))**

Specifies the functional group to which this parameter belongs. The required parameter group can be set via p0004.

---

**Note:**

Parameter p0004 is CU-specific (belongs to the Control Unit).

---

**Unit, unit group and unit selection**

The standard unit of a parameter is specified in square parentheses after the values for "Min", "Max", and "Factory setting".

---

**Note:**

The units cannot be switched over for SINAMICS DCM.

The information under Unit Group and Unit Selection has no relevance.

---

**Parameter values**

Min	Minimum value of the parameter [unit]
Max	Maximum value of the parameter [unit]
Factory setting	Value when delivered [unit]

In the case of a binector/connector input, the signal source of the default BICO interconnection is specified. A non-indexed connector output is assigned the index [0].

**Not for motor type**

This information is of no relevance for SINAMICS DC MASTER.

**Normalizing**

Specification of the reference variable with which a signal value is automatically converted for a BICO interconnection.

The following reference variables are possible:

- p2000 ... p2007: Reference speed, reference voltage, etc.
- PERCENT: 1.0 = 100 %
- 4000H: 4000 hex = 100 %

**Expert list**

Specifies whether this parameter is available in the expert list of the specified drive objects in the commissioning software.

1: Parameter does exist in the expert list.

0: Parameter does not exist in the expert list.

---

**Notice:**

Users are responsible for using parameters that are marked "Expert list: 0" (parameter not included in the expert list).

These parameters and their functionalities have not been tested and no further user documentation is available for them (e.g. description of functions). Moreover, "Technical Support" (hotline) does not provide any support for these parameters.

---

**Description**

Explanation of a parameter function.

**Values**

List of the possible values of a parameter.

**Recommendation**

Information about recommended settings.

## Index

The name and meaning of each individual index is specified for indexed parameters.

The following applies to the values (Min, Max, Factory setting) of indexed adjustable parameters:

- Min, Max:

The adjustment range and unit apply to all indices.

- Factory setting:

When all indices have the same factory setting, index 0 is specified with the unit to represent all indices.

When the indices have different factory settings, they are all listed individually with the unit.

## Bit array

For parameters with bit arrays, the following information is provided about each bit:

- Bit number and signal name
- Meaning for signal states 0 and 1
- Function diagram (optional)

The signal is shown in this function diagram.

## Dependency

Conditions that must be fulfilled in conjunction with this parameter. Also includes special effects that can occur between this parameter and others.

See also: List of other additional parameters to be considered.

**Safety notices**

Important information that must be observed to avoid the risk of physical injury or material damage.

Information that must be observed to avoid any problems.

Information that the user may find useful.

**Danger**

The description of this safety notice can be found at the beginning of this manual (see **Safety notices**).

**Warning**

The description of this safety notice can be found at the beginning of this manual (see **Safety notices**).

**Caution**

The description of this safety notice can be found at the beginning of this manual (see **Safety notices**).

**Caution**

The description of this safety notice can be found at the beginning of this manual (see **Safety notices**).

**Notice**

The description of this safety notice can be found at the beginning of this manual (see **Safety notices**).

**Note**

Information that the user may find useful.

## 1.1.2 Number ranges of parameters

### Number ranges for SINAMICS in general

**Note:**

The following number ranges represent an overview of all parameters associated with the SINAMICS drive range.

The parameters for the product described in this List Manual are described in detail in Chapter 1.2.

Parameters are grouped into the following number ranges:

Table 1-3 Number ranges for SINAMICS

Range		Description
from	to	
0000	0099	Display and operation
0100	0199	Commissioning
0200	0299	Power unit
0300	0399	Motor
0400	0499	Encoder
0500	0599	Technology and units, motor-specific data, probes
0600	0699	Thermal monitoring, maximum current, operating hours, motor data, central probe
0700	0799	Control Unit terminals, measuring sockets
0800	0839	CDS, DDS data sets, motor changeover
0840	0879	Sequence control (e.g. signal source for ON/OFF1)
0880	0899	ESR, parking, control and status words
0900	0999	PROFIBUS/PROFIdrive
1000	1199	Setpoint channel (e.g. ramp-function generator)
1200	1299	Functions (e.g. motor holding brake)
1300	1399	V/f control
1400	1799	Closed-loop control
1800	1899	Gating unit
1900	1999	Power unit and motor identification
2000	2009	Reference values
2010	2099	Communication (fieldbus)
2100	2139	Faults and alarms
2140	2199	Signals and monitoring
2200	2359	Technology controller

Table 1-3 Number ranges for SINAMICS, continued

Range		Description
from	to	
2360	2399	Staging, hibernation
2500	2699	Position control (LR) and basic positioning (EPOS)
2700	2719	Reference values, display
2720	2729	Load gearbox
2800	2819	Logic operations
2900	2930	Fixed values (e.g. percentage, torque)
3000	3099	Motor identification results
3100	3109	Real time clock (RTC)
3110	3199	Faults and alarms
3200	3299	Signals and monitoring
3400	3659	Infeed closed-loop control
3660	3699	Voltage Sensing Module (VSM), Braking Module internal
3700	3779	Advanced Positioning Control (APC)
3780	3819	Synchronization
3820	3849	Friction characteristic
3850	3899	Functions (e.g. long stator)
3900	3999	Administration
4000	4599	Terminal Board, Terminal Module (e.g. TB30, TM31)
4600	4699	Sensor Module
4700	4799	Trace
4800	4849	Function generator
4950	4999	OA application
5000	5169	Spindle diagnostics
5200	5230	Current setpoint filter 5 ... 10 (r0108.21)
5400	5499	Line droop control (e.g. shaft generator)
5500	5599	Dynamic grid support (solar)
5600	5613	PROFenergy
5900	6999	SINAMICS GM/SM/GL/SL
7000	7499	Parallel connection of power units
7500	7599	SINAMICS SM120
7700	7729	External messages
7770	7789	NVRAM, system parameters
7800	7839	EEPROM read/write parameters
7840	8399	Internal system parameters

Table 1-3 Number ranges for SINAMICS, continued

Range		Description
from	to	
8400	8449	Real time clock (RTC)
8500	8599	Data and macro management
8600	8799	CAN bus
8800	8899	Communication Board Ethernet (CBE), PROFIdrive
8900	8999	Industrial Ethernet, PROFINET, CBE20
9000	9299	Topology
9300	9399	Safety Integrated
9400	9499	Parameter consistency and storage
9500	9899	Safety Integrated
9900	9949	Topology
9950	9999	Diagnostics, internal
10000	10199	Safety Integrated
11000	11299	Free technology controller 0, 1, 2
20000	20999	Free function blocks (FBLOCKS)
21000	25999	Drive Control Chart (DCC)
50000	53999	SINAMICS DC MASTER (DC closed-loop control)
61000	61001	PROFINET



## 1.2 List of parameters

Product: SINAMICS DC MASTER, Version: 4601800, Language: eng  
 Objects: CU\_DC, CU\_DC\_R, CU\_DC\_R\_S, CU\_DC\_S, DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
 Product: SINAMICS DC MASTER OA, Version: 1400800, Language: eng  
 Objects: DC\_CTRL

<b>r0002 Control Unit operating display / CU op_display</b>			
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2651
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 99	<b>Factory setting</b> -
<b>Description:</b>	Operating display for the Control Unit (CU).		
<b>Value:</b>	0: Operation 10: Ready 20: Wait for run-up 25: Wait for automatic FW update of DRIVE-CLiQ components 31: Commissioning software download active 33: Remove/acknowledge topology error 34: Exit commissioning mode 35: Carry out first commissioning 70: Initialization 80: Reset active 99: Internal software error		
<b>Notice:</b>	For several missing enable signals, the corresponding value with the highest number is displayed.		

<b>r0002 Drive operating display / Drv op_display</b>			
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2651
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 129	<b>Factory setting</b> -
<b>Description:</b>	Operating display for the drive.		
<b>Value:</b>	0: o0.0 No torque direction switched on 1: o0.1 Torque direction I switched on 2: o0.2 Torque direction II switched on 9: o0.9 Wait for enable from master 10: o1.0 Wait time for brake opening time running 11: o1.1 Wait for operating enable at terminal 13 12: o1.2 Wait for operating enable (signal source acc. to p0852) 13: o1.3 Wait time after withdrawing a jog command running 14: o1.4 Wait until the field has been reversed 15: o1.5 Wait for operating enable from the optimization run 16: o1.6 Wait for withdrawal of the immediate pulse inhibit 17: o1.7 Wait for SINAMICS DCM connected in parallel in status o0.0 18: o1.8 Operating state o1.8 19: o1.9 Operating state o1.9 20: o2.0 Wait for setpoint 21: o2.1 Operating state o2.1 22: o2.2 Operating state o2.2 30: o3.0 Wait for the thyristor check to be completed 31: o3.1 Wait for line supply symmetry 32: o3.2 Wait for a DC contactor to pick up 33: o3.3 Wait for the feedback signal "main contactor" 34: o3.4 Operating state o3.4 35: o3.5 Operating state o3.5		

40:	o4.0 Wait for voltage at 1U1, 1V1, 1W1
41:	o4.1 Wait until fuse monitoring signals OK
42:	o4.2 Operating state o4.2
43:	o4.3 Operating state o4.3
44:	o4.4 Operating state o4.4
45:	o4.5 Wait until CCP pre-charged
50:	o5.0 Wait for field current actual value
51:	o5.1 Wait for voltage at 3U1, 3W1
52:	o5.2 Operating state o5.2
53:	o5.3 Operating state o5.3
60:	o6.0 Wait until auxiliaries have been switched on
61:	o6.1 Wait for small setpoint
62:	o6.2 Operating state o6.2
63:	o6.3 Operating state o6.3
70:	o7.0 Wait for power-on via terminal 12
71:	o7.1 Wait for power-on (signal source according to p0840)
72:	o7.2 Stopping saved
73:	o7.3 Wait for parallel master to power up
74:	o7.4 Start of an optimization run
75:	o7.5 Parameter download
76:	o7.6 Operating state o7.6
77:	o7.7 Operating state o7.7
78:	o7.8 Operating state o7.8
79:	o7.9 Operating state o7.9
80:	o8.0 Switching on inhibited
81:	o8.1 Simulation mode active
82:	o8.2 Operating state o8.2
83:	o8.3 Operating state o8.3
90:	o9.0 Operating state o9.0
91:	o9.1 Quick stop (OFF3) (signal source acc. to p0848) present
92:	o9.2 Quick stop (OFF3) (signal source acc. to p0849) present
93:	o9.3 Quick stop (OFF3) saved
94:	o9.4 SS1 command (Safe Stop 1) present
95:	o9.5 Operating state o9.5
96:	o9.6 Operating state o9.6
97:	o9.7 Operating state o9.7
98:	o9.8 Operating state o9.8
99:	o9.9 Operating state o9.9
100:	o10.0 Operating state o10.0
101:	o10.1 Voltage disconnect (OFF2) (signal source acc. to p0844)
102:	o10.2 Voltage disconnect (OFF2) (signal source acc. to p0845)
103:	o10.3 E stop (safety shutdown) (terminal 105/106)
104:	o10.4 STO command (Safe Torque Off) present
105:	o10.5 Operating state o10.5
106:	o10.6 CUD right
107:	o10.7 Operating state o10.7
108:	o10.8 Operating state o10.8
109:	o10.9 Operating state o10.9
110:	o11.0 Fault present
120:	o12.0 Initializ. of line voltage sensing for field in progress
121:	o12.1 Initializ. of line voltage sensing for armature in progr.
122:	o12.2 Operating state o12.2
123:	o12.3 Reading out data of the gating modules
124:	o12.4 Offset calibr. of curr. act. val. sensing being performed
125:	o12.5 Read out data from the power unit
126:	o12.6 Initializing the second processor (TMS320)
127:	o12.7 Operating state o12.7
128:	o12.8 Operating state o12.8
129:	o12.9 Operating state o12.9

**Dependency:** Refer to: r0046

**Notice:** For several missing enable signals, the corresponding value with the highest number is displayed.

**Note:** OC: Operating condition  
RFG: Ramp-function generator  
COMM: Commissioning

---

**r0002 TM150 operating display / TM150 op\_display**


---

TM150	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	250	-

**Description:** Operating display for Terminal Module 150 (TM150)

**Value:** 0: Module in cyclic operation  
40: Module not in cyclic operation  
50: Alarm  
60: Fault  
70: Initialization  
120: Module de-activated  
200: Wait for booting/partial booting  
250: Device signals a topology error

**Notice:** For several missing enable signals, the corresponding value with the highest number is displayed.

---

**r0002 TM15DI/DO operating display / TM15D op\_display**


---

TM15DI_DO	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	250	-

**Description:** Operating display for Terminal Module 15 (TM15).

**Value:** 0: Module in cyclic operation  
40: Module not in cyclic operation  
50: Alarm  
60: Fault  
70: Initialization  
120: Module de-activated  
200: Wait for booting/partial booting  
250: Device signals a topology error

**Notice:** For several missing enable signals, the corresponding value with the highest number is displayed.

---

**r0002 TM31 operating display / TM31 op\_display**


---

TM31	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	250	-

**Description:** Operating display for Terminal Module 31 (TM31).

**Value:** 0: Module in cyclic operation  
40: Module not in cyclic operation  
50: Alarm  
60: Fault  
70: Initialization  
120: Module de-activated  
200: Wait for booting/partial booting  
250: Device signals a topology error

**Notice:** For several missing enable signals, the corresponding value with the highest number is displayed.

<b>p0003</b>	<b>BOP access level / BOP acc_level</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> C1, U, T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 1	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 4	<b>Access level:</b> 1 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Sets the access level for reading and writing parameters via the Basic Operator Panel (BOP).		
<b>Value:</b>	1: Standard 2: Extended 3: Expert 4: Service		
<b>Note:</b>	A higher set access level also includes the lower one. Access level 1 (standard): Parameters for simplest possible operations. Access level 2 (extended): Parameters to operate the basic functions of the drive unit. Access level 3 (experts): Expert know-how is required for these parameters (e.g. BICO parameterization). Access level 4 (service): For these parameters, it is necessary that authorized service personnel enter the appropriate password (p3950).		

<b>p0004</b>	<b>BOP display filter / BOP disp_filter</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> C2(1), U, T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 99	<b>Access level:</b> 1 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the display filter for parameters with the Basic Operator Panel (BOP).		
<b>Value:</b>	0: All parameters 1: Displays, signals 2: Power unit 3: Motor 4: Encoder/pos enc 5: Technology/units 7: Digital inputs/outputs, commands, sequence control 12: Functions 14: Control 15: Data sets 20: Communication 21: Faults, alarms, monitoring functions 28: Free function blocks 47: Trace and function generator 50: OA parameters 90: Topology 98: Command Data Sets (CDS) 99: Drive Data Sets (DDS)		
<b>Dependency:</b>	Refer to: p0003		
<b>Notice:</b>	The display filter via p0004 provides precise filtering and displays the corresponding parameters only when p0009 and p0010 = 0.		

**Note:** The set access level via p0003 is also relevant for the display filter via p0004.  
Examples (assumption: p0009 = p0010 = 0):  
p0003 = 1, p0004 = 3  
--> Only the parameters for the motor with access level 1 are displayed.  
p0003 = 2, p0004 = 3  
--> Only the parameters for the motor with access levels 1 and 2 are displayed.

<b>p0005[0...1] BOP operating display selection / BOP op_disp sel</b>			
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	65535	[0] 2 [1] 0
<b>Description:</b>	Sets the parameter number and parameter index for display for p0006 = 4 for the Basic Operator Panel (BOP).		
<b>Index:</b>	[0] = Parameter number [1] = Parameter index		
<b>Dependency:</b>	Refer to: p0006		
<b>Note:</b>	Procedure: 1. The parameter number to be displayed should be set in index 0. Only the monitoring parameters (read-only parameters) can be set that actually exist for the actual drive object. If the set parameter number is not indexed, or if there is an index in index 1 that lies outside the valid range of the set parameter, then index 1 is automatically set to 0. 2. The index that belongs to the parameter set in index 0 should be set in index 1. The permissible changes in index 1 always depend on the parameter number set in index 0.		

<b>p0005[0...1] BOP operating display selection / BOP op_disp sel</b>			
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	65535	[0] 50000 [1] 0
<b>Description:</b>	Sets the parameter number and parameter index for display for p0006 = 4 for the Basic Operator Panel (BOP).		
<b>Index:</b>	[0] = Parameter number [1] = Parameter index		
<b>Dependency:</b>	Refer to: p0006		
<b>Note:</b>	Procedure: 1. The parameter number to be displayed should be set in index 0. Only the monitoring parameters (read-only parameters) can be set that actually exist for the actual drive object. If the set parameter number is not indexed, or if there is an index in index 1 that lies outside the valid range of the set parameter, then index 1 is automatically set to 0. 2. The index that belongs to the parameter set in index 0 should be set in index 1. The permissible changes in index 1 always depend on the parameter number set in index 0.		

<b>p0005[0...1]</b>	<b>BOP operating display selection / BOP op_disp sel</b>		
TM150, TM15DI_DO, TM31	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 65535	<b>Access level:</b> 2 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> [0] 2 [1] 0
<b>Description:</b>	Sets the parameter number and parameter index for display for p0006 = 2, 4 for the Basic Operator Panel (BOP). Examples for the SERVO drive object: p0005[0] = 21, p0005[1] = 0: Actual speed smoothed (r0021) p0005[0] = 25, p0005[1] = 0: Output voltage smoothed (r0025)		
<b>Index:</b>	[0] = Parameter number [1] = Parameter index		
<b>Dependency:</b>	Refer to: p0006		
<b>Note:</b>	Procedure: 1. The parameter number to be displayed should be set in index 0. Only the monitoring parameters (read-only parameters) can be set that actually exist for the actual drive object. If the set parameter number is not indexed, or if there is an index in index 1 that lies outside the valid range of the set parameter, then index 1 is automatically set to 0. 2. The index that belongs to the parameter set in index 0 should be set in index 1. The permissible changes in index 1 always depend on the parameter number set in index 0.		
<b>p0006</b>	<b>BOP operating display mode / BOP op_disp mode</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S, DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> U, T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 4	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 4	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 4
<b>Description:</b>	Sets the mode of the operating display for the Basic Operator Panel (BOP) in the operating states "ready for operation" and "operation".		
<b>Value:</b>	4: p0005		
<b>Dependency:</b>	Refer to: p0005		
<b>Note:</b>	Mode 4 is available for all drive objects.		
<b>p0006</b>	<b>BOP operating display mode / BOP op_disp mode</b>		
TM150, TM15DI_DO, TM31	<b>Can be changed:</b> U, T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 4	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 4	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 4
<b>Description:</b>	Sets the mode of the operating display for the Basic Operator Panel (BOP) in the operating states "ready for operation" and "operation".		
<b>Value:</b>	4: p0005		
<b>Dependency:</b>	Refer to: p0005		
<b>Note:</b>	Mode 0 ... 3 can only be selected if also r0020, r0021 are available on the drive object. Mode 4 is available for all drive objects.		

<b>p0007</b>	<b>BOP background lighting / BOP lighting</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0 [s]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 2000 [s]	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0 [s]
<b>Description:</b>	Sets the delay time until the background lighting of the Basic Operator Panel (BOP) is switched off. If no keys are actuated, then the background lighting automatically switches itself off after this time has expired.		
<b>Note:</b>	p0007 = 0: Background lighting is always switched on (factory setting).		
<b>p0008</b>	<b>BOP drive object after booting / BOP DO after boot</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 1	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 65535	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 2
<b>Description:</b>	Sets the required drive object that is active at the Basic Operator Panel (BOP) after booting.		
<b>Note:</b>	The value from p0008 initializes the display on the Basic Operator Panel (BOP) at the top left after booting. The drive object Control Unit is selected using the value 1.		
<b>p0009</b>	<b>Device commissioning parameter filter / Dev comm par_filt</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> C1, T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 55	<b>Access level:</b> 1 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Sets the device and basic drive commissioning. By appropriately setting this parameter, those parameters are filtered that can be written into in the various commissioning steps.		
<b>Value:</b>	0: Ready 1: Device configuration 2: Defining the drive type/function module 3: Drive base configuration 4: Data set base configuration 29: Device download 30: Parameter reset 50: OA application configuration 55: OA application installation		
<b>Notice:</b>	For p0009 = 10000 the following applies: After the value has been modified, no further parameter modifications can be made and the status is shown in r3996. Modifications can be made again when r3996 = 0.		
<b>Note:</b>	The drives can only be powered up outside the device commissioning (the drive enabled). In this case, p0009 must be 0 (Ready) and the individual drive objects must have already gone into operation (p0010). p0009 = 1: Device configuration At the first commissioning of the device, after booting, the device is in the "device configuration" state. To start the internal automatic first commissioning of the drive unit, p0009 should be set to 0 (Ready) after the ID for the actual topology (r0098) was transferred into the ID for the target topology (p0099). To do this, it is sufficient to set a single index value of p0099[x] the same as r0098[x]. Before the device has been completely commissioned, no other parameter can be changed. After the first commissioning was carried out, in this state, when required, other basic device configuration parameters can be adapted (e.g. the basic sampling time in p0110).		

p0009 = 2: Defines the drive type / function module

In this state, the drive object types and/or the function modules can be changed or selected for the individual drive objects. To do this, the drive object type can be set using p0107[0...15] and the function can be set using p0108[0...15] (refer to p0101[0...15]).

p0009 = 3: Drive basic configuration

In this state, after the device has been commissioned for the first time, basic changes can be made for the individual drive objects (e.g. sampling times in p0111, p0112, p0115 and the number of data sets in p0120, p0130, p0140, p0170, p0180).

p0009 = 4: Data set basic configuration

In this state, after the device has been commissioned for the first time, for the individual drive objects changes can be made regarding the assignment of the components (p0121, p0131, p0141, p0151, p0161) to the individual data sets and the assignment of the power unit, motor and encoder to the drive data sets (p0185, ...).

p0009 = 29: Device download

If a download is made using the commissioning software, the device is automatically brought into this state. After the download has been completed, p0009 is automatically set to 0 (ready). It is not possible to manually set p0009 to this value.

p0009 = 30: Parameter reset

In order to bring the complete unit into the "first commissioning" state or to load the parameters saved using p0977, to start, p0009 must be set to this value. p0976 can then be changed to the required value.

p0009 = 50: OA application configuration

In this state, after the device has been commissioned for the first time, changes can be made for the individual drive objects regarding the activity (p4956) of the OA applications.

p0009 = 55: OA application installation

OA applications can be installed and/or uninstalled in this state.

p0010		Drive commissioning parameter filter / Drv comm. par_filt		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(1), T		<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Integer16		<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -		<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -		<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 30	<b>Factory setting</b> 1	
<b>Description:</b>	Sets the parameter filter to commission a drive. Setting this parameter filters out the parameters that can be written into in the various commissioning steps.			
<b>Value:</b>	0:      Ready 1:      Quick commissioning 4:      Encoder commissioning 15:     Data sets 29:     Only Siemens int 30:     Reserved			
<b>Note:</b>	The drive can only be powered up outside the drive commissioning (drive enable). To realize this, this parameter must be set to 0.  By setting p3900 to a value other than 0, the quick commissioning is completed, and this parameter is automatically reset to 0.			

p0010		TM150 commissioning parameter filter / TM150 com par_filt	
TM150	Can be changed: C2(1), T	Calculated: -	Access level: 1
	Data type: Integer16	Dyn. index: -	Func. diagram: -
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min 0	Max 30	Factory setting 0
Description:	Sets the parameter filter for commissioning a Terminal Module 150 (TM150). Setting this parameter filters out the parameters that can be written into in the various commissioning steps. For the BOP, this setting also causes the read access operations to be filtered.		



**Value:** 0: Ready  
29: Only Siemens int  
30: Parameter reset

**Dependency:** Refer to: p0970

**Note:** Only the following values are possible: p0010 = 0, 30  
Procedure for "Reset parameter": Set p0010 to 30 and p0970 to 1.

---

### **p0010 TM15DI/DO commissioning the parameterizing filter / TM15D com par\_filt**

TM15DI_DO	<b>Can be changed:</b> C2(1), T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	30	0

**Description:** Sets the parameter filter for commissioning a Terminal Module 15 (TM15).  
Setting this parameter filters out the parameters that can be written into in the various commissioning steps.  
For the BOP, this setting also causes the read access operations to be filtered.

**Value:** 0: Ready  
29: Only Siemens int  
30: Parameter reset

**Dependency:** Refer to: p0970

**Note:** Only the following values are possible: p0010 = 0, 30  
Procedure for "Reset parameter": Set p0010 to 30 and p0970 to 1.

---

### **p0010 TM31 commissioning parameter filter / TM31 comm par\_filt**

TM31	<b>Can be changed:</b> C2(1), T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	30	0

**Description:** Sets the parameter filter for commissioning a Terminal Module 31 (TM31).  
Setting this parameter filters out the parameters that can be written into in the various commissioning steps.  
For the BOP, this setting also causes the read access operations to be filtered.

**Value:** 0: Ready  
29: Only Siemens int  
30: Parameter reset

**Dependency:** Refer to: p0970

**Note:** Only the following values are possible: p0010 = 0, 30  
Procedure for "Reset parameter": Set p0010 to 30 and p0970 to 1.

---

### **p0011 BOP password entry (p0013) / BOP passw ent p13**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Functions	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	65535	0

**Description:** Sets the password for the Basic Operator Panel (BOP).

**Dependency:** Refer to: p0012, p0013

<b>p0012</b>	<b>BOP password acknowledgement (p0013) / BOP passw ackn p13</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned16 <b>P-Group:</b> Functions <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 65535	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Acknowledges the password for the Basic Operator Panel (BOP).		
<b>Dependency:</b>	Refer to: p0011, p0013		
<b>p0013[0...49]</b>	<b>BOP user-defined list / BOP list</b>		
All objects	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned16 <b>P-Group:</b> Functions <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 65535	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the required parameters to read and write via the Basic Operator Panel (BOP). Activation: 1. p0003 = 3 (expert). 2. p0013[0...49] = requested parameter number 3. If required, enter p0011 = password in order to prevent non-authorized de-activation. 4. p0016 = 1 --> activates the selected user-defined list. De-activation/change: 1. p0003 = 3 (expert). 2. If required, p0012 = p0011, in order to be authorized to change or de-activate the list. 3. If required p0013[0...49] = required parameter number. 4. p0016 = 1 --> activates the modified user-defined list. 5. p0003 = 0 --> de-activates the user-defined list.		
<b>Dependency:</b>	Refer to: p0009, p0011, p0012, p0976		
<b>Note:</b>	The following parameters can be read and written on the Control Unit drive object: - p0003 (access stage) - p0009 (device commissioning, parameter filter) - p0012 (BOP password acknowledgement (p0013)) The following applies for the user-defined list: - password protection is only available on the drive object Control Unit and is valid for all of the drive objects. - p0013 cannot be included in the user-defined list for all drive objects. - p0003, p0009, p0011, p0012, p0976 cannot, for the drive object Control Unit, be included in the user-defined list. - the user-defined list can be cleared and de-activated "restore factory setting". A value of 0 means: Entry is empty.		
<b>p0015</b>	<b>Macro drive unit / Macro drv unit</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> C1 <b>Data type:</b> Unsigned32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 999999	<b>Access level:</b> 1 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Runs the corresponding macro files. The selected macro file must be available on the memory card/device memory. Example: p0015 = 6 --> the macro file PM000006.ACX is run.		

**Dependency:** Refer to: p0700, p1000, p1500, r8570

**Notice:** After the value has been modified, no further parameter modifications can be made and the status is shown in r3996. Modifications can be made again when r3996 = 0.

When executing a specific macro, the corresponding programmed settings are made and become active.

**Note:** The macros in the specified directory are displayed in r8570. r8570 is not in the expert list of the commissioning software.

Macros available as standard are described in the technical documentation of the particular product.

The parameter is not influenced by setting the factory setting.

---

**p0015 Macro drive object / Macro DO**

DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150, TM15DI_DO, TM31	<b>Can be changed:</b> C2(1) <b>Data type:</b> Unsigned32 <b>P-Group:</b> Commands <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 1 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 999999	<b>Factory setting</b> 0

**Description:** Runs the corresponding macro files.  
The selected macro file must be available on the memory card/device memory.  
Example:  
p0015 = 6 --> the macro file PM000006.ACX is run.

**Dependency:** Refer to: p0700, p1000, p1500, r8570

**Notice:** After the value has been modified, no further parameter modifications can be made and the status is shown in r3996. Modifications can be made again when r3996 = 0.

When executing a specific macro, the corresponding programmed settings are made and become active.

No errors were issued during quick commissioning (p3900 = 1) when writing to parameters of the QUICK\_IBN group!

**Note:** The macros in the specified directory are displayed in r8570. r8570 is not in the expert list of the commissioning software.

Macros available as standard are described in the technical documentation of the particular product.

The parameter is not influenced by setting the factory setting.

---

**p0016 Activate BOP user-defined list / BOP user list act**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> C1, U, T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 1	<b>Factory setting</b> 0

**Description:** Setting for activating/de-activating the user-defined list for the Basic Operator Panel (BOP).  
If p0016 = 1, then it is only possible to access parameters in the parameter list (p0013).

**Value:** 0: BOP user-defined list de-activated  
1: BOP user-defined list activated

**Dependency:** Refer to: p0011, p0012, p0013

**Note:** The user-defined list can only be de-activated with p0011 = p0012

---

**r0018 Control Unit basic firmware version / CU Basic FW Vers**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> - <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 1 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 4294967295	<b>Factory setting</b> -

**Description:** Displays the basic firmware version of the Control Unit.

The version of existing firmware on the device memory is displayed in r7844.

**Dependency:** Refer to: r0148, r0158, r0197, r0198, r7844

**Note:** Example:  
The value 1010100 should be interpreted as V01.01.01.00.

---

### r0019.0...14 CO/BO: Control word BOP / STW BOP

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9912
	<b>P-Group:</b> Displays, signals	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the control word for the Basic Operator Panel (BOP).

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	ON / OFF (OFF1)	ON	OFF (OFF1)	-
	01	No coast-down / coast-down (OFF2)	No coast down	Coast down (OFF2)	-
	02	No Quick Stop / Quick Stop (OFF3)	No Quick Stop	Quick Stop (OFF3)	-
	07	Acknowledge fault (0 -> 1)	Yes	No	-
	13	Motorized potentiometer raise	Yes	No	-
	14	Motorized potentiometer lower	Yes	No	-

---

### r0020 Speed setpoint smoothed / n\_set smth

DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 3155
	<b>P-Group:</b> Displays, signals	<b>Units group:</b> 3_1	<b>Unit selection:</b> p0505
	<b>Not for motor type:</b> -	<b>Scaling:</b> p2000	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [rpm]	- [rpm]	- [rpm]

**Description:** Displays the actual smoothed speed setpoint at the speed controller input.

**Dependency:** Refer to: r0060

**Note:** Smoothing time constant = 100 ms  
The signal is not suitable as a process quantity and may only be used as a display quantity.  
The speed setpoint is available smoothed (r0020) and unsmoothed (r0060).

---

### r0021 CO: Actual speed smoothed / n\_act smooth

DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6810
	<b>P-Group:</b> Displays, signals	<b>Units group:</b> 3_1	<b>Unit selection:</b> p0505
	<b>Not for motor type:</b> -	<b>Scaling:</b> p2000	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [rpm]	- [rpm]	- [rpm]

**Description:** Displays the smoothed actual value of the motor speed.

**Dependency:** Refer to: r0022, p0045, r0063

**Note:** Smoothing time constant = 100 ms  
The signal is not suitable as a process quantity and may only be used as a display quantity.  
The speed actual value is available smoothed (r0021, r0022, r0063[1] with p0045) and unsmoothed (r0063[0]).

<b>r0022</b>	<b>Speed actual value rpm smoothed / n_act rpm smooth</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Displays, signals <b>Not for motor type:</b> - <b>Min</b> - [rpm]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> p2000 <b>Max</b> - [rpm]	<b>Access level:</b> 2 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [rpm]
<b>Description:</b>	Displays the smoothed actual value of the motor speed. r0022 is identical to r0021, however, it always has units of rpm and contrary to r0021 cannot be changed over.		
<b>Dependency:</b>	Refer to: r0021, p0045, r0063		
<b>Note:</b>	Smoothing time constant = 100 ms The signal is not suitable as a process quantity and may only be used as a display quantity. The speed actual value is available smoothed (r0021, r0022, r0063[1] with p0045) and unsmoothed (r0063[0]).		
<b>r0027</b>	<b>CO: Absolute actual current smoothed / I_act abs val smth</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Displays, signals <b>Not for motor type:</b> - <b>Min</b> - [A]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> p2002 <b>Max</b> - [A]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6850 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [A]
<b>Description:</b>	Displays the smoothed absolute actual current value.		
<b>Dependency:</b>	Refer to: p0045, r0068		
<b>Notice:</b>	This smoothed signal is not suitable for diagnostics or evaluation of dynamic operations. In this case, the unsmoothed value should be used.		
<b>Note:</b>	Smoothing time constant = 100 ms The signal is not suitable as a process quantity and may only be used as a display quantity. The absolute value of the current actual value is available smoothed (r0027, r0068[1] with p0045) and unsmoothed (r0068[0]).		
<b>r0031</b>	<b>Actual torque smoothed / M_act smooth</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Displays, signals <b>Not for motor type:</b> - <b>Min</b> - [Nm]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> 7_1 <b>Scaling:</b> p2003 <b>Max</b> - [Nm]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6850 <b>Unit selection:</b> p0505 <b>Expert list:</b> 1 <b>Factory setting</b> - [Nm]
<b>Description:</b>	Displays the smoothed torque actual value.		
<b>Dependency:</b>	Refer to: p0045, r0080		
<b>Note:</b>	Smoothing time constant = 100 ms The signal is not suitable as a process quantity and may only be used as a display quantity. The torque actual value is available smoothed (r0031, r0080[1] with p0045) and unsmoothed (r0080[0]).		
<b>r0032</b>	<b>CO: Active power actual value smoothed / P_actv_act smth</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Displays, signals <b>Not for motor type:</b> - <b>Min</b> - [kW]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> 14_10 <b>Scaling:</b> r2004 <b>Max</b> - [kW]	<b>Access level:</b> 2 <b>Func. diagram:</b> 2450 <b>Unit selection:</b> p0505 <b>Expert list:</b> 1 <b>Factory setting</b> - [kW]
<b>Description:</b>	Displays the smoothed actual value of the active power.		

**Notice:** This smoothed signal is not suitable for diagnostics or evaluation of dynamic operations. In this case, the unsmoothed value should be used.

**Note:** Smoothing time constant = 100 ms  
The active power is available smoothed (r0032, r0082[1] with p0045) and unsmoothed (r0082[0]).

<b>r0035</b>	<b>CO: Motor temperature / Mot temp</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 7008, 8017
	<b>P-Group:</b> Displays, signals	<b>Units group:</b> 21_1	<b>Unit selection:</b> p0505
	<b>Not for motor type:</b> -	<b>Scaling:</b> p2006	<b>Expert list:</b> 1
	<b>Min</b> - [°C]	<b>Max</b> - [°C]	<b>Factory setting</b> - [°C]
<b>Description:</b>	Displays the actual temperature in the motor.		
<b>Note:</b>	For r0035 not equal to -200.0 °C, the following applies: - this temperature display is valid. - a KTY sensor is connected. For r0035 equal to -200.0 °C, the following applies: - this temperature display is not valid (temperature sensor error). - A PTC sensor or bimetallic NC contact is connected.		

<b>p0045</b>	<b>Display values smoothing time constant / Disp_val T_smooth</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6810, 6850
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0.00 [ms]	<b>Max</b> 10000.00 [ms]	<b>Factory setting</b> 1.00 [ms]
<b>Description:</b>	Sets the smoothing time constant for the following display values: r0063[1], r0068[1], r0080[1], r0082[1]		

<b>r0046.0...31</b>	<b>CO/BO: Missing enable sig / Missing enable sig</b>				
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1		
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2655		
	<b>P-Group:</b> Displays, signals	<b>Units group:</b> -	<b>Unit selection:</b> -		
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1		
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>		
	-	-	-		
<b>Description:</b>	Displays missing enable signals that are preventing the closed-loop drive control from being commissioned.				
<b>Bit field:</b>	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>	<b>FP</b>
	00	OFF1 enable missing	Yes	No	-
	01	OFF2 enable missing	Yes	No	-
	02	OFF3 enable missing	Yes	No	-
	03	Operation enable missing	Yes	No	-
	10	Ramp-function generator enable missing	Yes	No	-
	11	Ramp-function generator start missing	Yes	No	-
	12	Setpoint enable missing	Yes	No	-
	16	OFF1 enable internal missing	Yes	No	-
	17	OFF2 enable internal missing	Yes	No	-
	18	OFF3 enable internal missing	Yes	No	-
	19	Pulse enable internal missing	Yes	No	-
	26	Drive inactive or not operational	Yes	No	-
	28	Brake open missing	Yes	No	-
	30	Speed controller inhibited	Yes	No	-
	31	Jog setpoint active	Yes	No	-
<b>Dependency:</b>	Refer to: r0002				

**Note:** The value r0046 = 0 indicates that all enable signals are present.  
 Bit 00 = 1 (enable signal missing), if:  
 - the signal source in p0840 is a 0 signal.  
 - there is a "switching on inhibited".  
 Bit 01 = 1 (enable signal missing), if:  
 - the signal source in p0844 or p0845 is a 0 signal.  
 Bit 03 = 1 (enable signal missing), if:  
 - the signal source in p0852 is a 0 signal.  
 Bit 16 = 1 (enable signal missing), if:  
 - there is an OFF1 fault response. The system is only enabled if the fault is removed and was acknowledged and the "switching on inhibited" withdrawn with OFF1 = 0.  
 Bit 17 = 1 (enable signal missing), if:  
 - the commissioning mode is selected (p0009 > 0 or p0010 > 0) or there is an OFF2 fault response or the OFF1 signal source (p0840) is changed.

<b>r0049[0...3]</b>	<b>Encoder data set effective / EDS effective</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned8	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8565
	<b>P-Group:</b> Displays, signals	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays the effective Encoder Data Sets (EDS).		
<b>Index:</b>	[0] = Reserved [1] = Encoder 1 Encoder Data Set EDS effective [2] = Encoder 2 Encoder Data Set EDS effective [3] = -		
<b>Dependency:</b>	Refer to: p0187, p0188		
<b>Note:</b>	Value 99 means the following: No encoder assigned (not configured).		

<b>r0050.0</b>	<b>CO/BO: Command Data Set CDS effective / CDS effective</b>			
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2	
	<b>Data type:</b> Unsigned8	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8560	
	<b>P-Group:</b> Displays, signals	<b>Units group:</b> -	<b>Unit selection:</b> -	
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1	
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>	
	-	-	-	
<b>Description:</b>	Displays the effective Command Data Set (CDS).			
<b>Bit field:</b>	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>
	00	CDS eff. bit 0	ON	OFF
				<b>FP</b>
				-
<b>Dependency:</b>	Refer to: p0810, r0836			
<b>Note:</b>	The Command Data Set selected using a binector input (e.g. p0810) is displayed using r0836.			

<b>r0051.0...1</b>	<b>CO/BO: Drive Data Set DDS effective / DDS effective</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned8	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8565
	<b>P-Group:</b> Displays, signals	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays the effective Drive Data Set (DDS).		

<b>Bit field:</b>	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>	<b>FP</b>
	00	DDS eff. bit 0	ON	OFF	-
	01	DDS eff. bit 1	ON	OFF	-
<b>Dependency:</b>	Refer to: p0820, p0821, r0837				

<b>r0056.13</b>	<b>CO/BO: Status word, closed-loop control / ZSW cl-loop ctrl</b>				
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -		<b>Calculated:</b> -		<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16		<b>Dyn. index:</b> -		<b>Func. diagram:</b> 2526
	<b>P-Group:</b> Displays, signals		<b>Units group:</b> -		<b>Unit selection:</b> -
	<b>Not for motor type:</b> -		<b>Scaling:</b> -		<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>		
	-	-	-		
<b>Description:</b>	Displays the status word of the closed-loop control.				
<b>Bit field:</b>	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>	<b>FP</b>
	13	Current/torque limiting	Active	Inactive	6060

<b>r0060</b>	<b>CO: Speed setpoint before the setpoint filter / n_set before filt.</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Displays, signals <b>Not for motor type:</b> - <b>Min</b> - [rpm]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> 3_1 <b>Scaling:</b> p2000 <b>Max</b> - [rpm]	<b>Access level:</b> 3 <b>Func. diagram:</b> 3155 <b>Unit selection:</b> p0505 <b>Expert list:</b> 1 <b>Factory setting</b> - [rpm]
<b>Description:</b>	Displays the actual speed setpoint at the speed controller input.		
<b>Dependency:</b>	Refer to: r0020		
<b>Note:</b>	The speed setpoint is available smoothed (r0020) and unsmoothed (r0060).		

<b>r0061[0...1]</b>	<b>CO: Actual speed unsmoothed / n_act unsmoothed</b>		
DC_CTRL,	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
DC_CTRL_R,	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 1580, 4710, 6810
DC_CTRL_R_S,	<b>P-Group:</b> Displays, signals	<b>Units group:</b> 3_1	<b>Unit selection:</b> p0505
DC_CTRL_S	<b>Not for motor type:</b> -	<b>Scaling:</b> p2000	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [rpm]	- [rpm]	- [rpm]
<b>Description:</b>	Displays the unsmoothed actual speed values sensed by the encoders.		
<b>Index:</b>	[0] = Encoder 1 [1] = Encoder 2		

<b>r0063[0...1]</b>	<b>CO: Speed actual value / n_act</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Displays, signals <b>Not for motor type:</b> - <b>Min</b> - [rpm]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> 3_1 <b>Scaling:</b> p2000 <b>Max</b> - [rpm]	<b>Access level:</b> 3 <b>Func. diagram:</b> 6810 <b>Unit selection:</b> p0505 <b>Expert list:</b> 1 <b>Factory setting</b> - [rpm]
<b>Description:</b>	Displays the actual speed actual value for speed control.		
<b>Index:</b>	[0] = Unsmoothed [1] = Smoothed with p0045		
<b>Dependency:</b>	Refer to: r0021, r0022, p0045, r0061		
<b>Note:</b>	The speed actual value is available smoothed (r0021 with 100 ms, r0022 with 100 ms, r0063 with p0045) and unsmoothed (r0063[0], r0061).		



<b>r0068[0...1]</b>			
<b>CO: Absolute current actual value / I_act abs val</b>			
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Displays, signals <b>Not for motor type:</b> - <b>Min</b> - [A]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> p2002 <b>Max</b> - [A]	<b>Access level:</b> 3 <b>Func. diagram:</b> 6850 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [A]
<b>Description:</b>	Displays actual absolute current.		
<b>Index:</b>	[0] = Unsmoothed [1] = Smoothed with p0045		
<b>Dependency:</b>	Refer to: r0027, p0045		
<b>Note:</b>	The absolute value of the current actual value is available smoothed (r0027 with 100 ms, r0068[1] with p0045) and unsmoothed (r0068[0]).		
<hr/>			
<b>r0080[0...1]</b>			
<b>CO: Torque actual value / M_act</b>			
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Displays, signals <b>Not for motor type:</b> - <b>Min</b> - [Nm]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> 7_1 <b>Scaling:</b> p2003 <b>Max</b> - [Nm]	<b>Access level:</b> 3 <b>Func. diagram:</b> 6850 <b>Unit selection:</b> p0505 <b>Expert list:</b> 1 <b>Factory setting</b> - [Nm]
<b>Description:</b>	Display and connector output for actual torque value.		
<b>Index:</b>	[0] = Unsmoothed [1] = Smoothed with p0045		
<b>Dependency:</b>	Refer to: r0031, p0045		
<b>Note:</b>	The value is available smoothed (r0031 with 100 ms, r0080[1] with p0045) and unsmoothed (r0080[0]).		
<hr/>			
<b>r0082[0...1]</b>			
<b>CO: Active power actual value / P_act</b>			
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Displays, signals <b>Not for motor type:</b> - <b>Min</b> - [kW]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> 14_5 <b>Scaling:</b> r2004 <b>Max</b> - [kW]	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> p0505 <b>Expert list:</b> 1 <b>Factory setting</b> - [kW]
<b>Description:</b>	Displays the instantaneous active power.		
<b>Index:</b>	[0] = Unsmoothed [1] = Smoothed with p0045		
<b>Dependency:</b>	Refer to: r0032		
<b>Note:</b>	The active power is available smoothed (r0032 with 100 ms, r0082[1] with p0045) and unsmoothed (r0082[0]).		
<hr/>			
<b>p0097</b>			
<b>Select drive object type / Select DO type</b>			
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> C1(1) <b>Data type:</b> Integer16 <b>P-Group:</b> Topology <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 15	<b>Access level:</b> 1 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Executes an automatic device configuration. In so doing, p0099, p0107 and p0108 are appropriately set.		
<b>Value:</b>	0: No selection 15: Drive object type DC_CTRL		
<b>Dependency:</b>	Refer to: r0098, p0099		

**Note:** For p0097 = 0, p0099 is automatically set to the factory setting.

r0098[0...5] Actual device topology / Device_act topo			
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Topology	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> -
<b>Description:</b>	Displays the automatically detected actual device topology in coded form.		
<b>Index:</b>	[0] = DRIVE-CLiQ socket X100 [1] = DRIVE-CLiQ socket X101 [2...5] = Reserved		
<b>Dependency:</b>	Refer to: p0097, p0099		
<b>Note:</b>	Topology coding: abcd efgh hex a = 0 b = 0 c = 0 d = no. of motor encoders e = no. of additional encoders f = number of Terminal Modules g = number of Terminal Boards h = reserved if the value 0 is displayed in all indices, then components are not detected via DRIVE-CLiQ. If a value F hex occurs at a position of the coding (abcd efgh hex), then an overflow has occurred.		
p0099[0...5] Device target topology / Device_target topo			
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> C1(1)	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Topology	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0000 hex	<b>Max</b> FFFF FFFF hex	<b>Factory setting</b> 0000 hex
<b>Description:</b>	Sets the device target topology in coded form (refer to r0098). The setting is made during commissioning. De-activated or non-available components are also counted		
<b>Index:</b>	[0] = DRIVE-CLiQ socket X100 [1] = DRIVE-CLiQ socket X101 [2...5] = Reserved		
<b>Dependency:</b>	The parameter can only be written into for p0097 = 0.  To perform an automatic device configuration run, an index of the device target topology must be set to the value of the device actual topology in r0098 for acknowledgement. An index of the device actual topology with a value other than 0 must be selected.  Refer to: p0097, r0098		
<b>Note:</b>	The parameter can only be set to the values 0, the value of the actual device topology, the value of the actual device target topology and FFFFFFFF hex.  If the value 0 is displayed in all of the indices, then the system has still not been commissioned.  The value FFFFFFFF hex indicates that the topology was not generated by the automatic device configuration but was commissioned using the commissioning software (e.g. using parameter download).		

<b>p0101[0...23]</b>			
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> C1(1) <b>Data type:</b> Unsigned16 <b>P-Group:</b> Topology <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 62	<b>Access level:</b> 2 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	The parameter contains the object number via which every drive object can be addressed. The number of an existing drive object is entered into each index. Value = 0: No drive object is defined.		
<b>Index:</b>	[0] = Drive object number Control Unit [1] = Drive object number object 1 [2] = Drive object number object 2 [3] = Drive object number object 3 [4] = Drive object number object 4 [5] = Drive object number object 5 [6] = Drive object number object 6 [7] = Drive object number object 7 [8] = Drive object number object 8 [9] = Drive object number object 9 [10] = Drive object number object 10 [11] = Drive object number object 11 [12] = Drive object number object 12 [13] = Drive object number object 13 [14] = Drive object number object 14 [15] = Drive object number object 15 [16] = Drive object number object 16 [17] = Drive object number object 17 [18] = Drive object number object 18 [19] = Drive object number object 19 [20] = Drive object number object 20 [21] = Drive object number object 21 [22] = Drive object number object 22 [23] = Drive object number object 23		
<b>Note:</b>	The numbers are automatically allocated. For the commissioning software, this object number cannot be entered using the expert list, but is automatically assigned when inserting an object.		

<b>r0102[0...1]</b>			
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned16 <b>P-Group:</b> Topology <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the number of existing or existing and prepared drive objects.		
<b>Index:</b>	[0] = Existing drive objects [1] = Existing and prepared drive objects		
<b>Dependency:</b>	Refer to: p0101		
<b>Note:</b>	The numbers of the drive objects are in p0101. Index 0: Displays the number of drive objects that have already been set up. Index 1: Displays the number of drive objects that have already been set up and, in addition, the drive objects that still have to be set up.		

**p0103[0...23]      Application-specific view / Appl\_spec view**CU\_DC, CU\_DC\_R,  
CU\_DC\_R\_S,  
CU\_DC\_S**Can be changed:** C1(2)**Data type:** Unsigned16**P-Group:** -**Not for motor type:** -**Min**

0

**Calculated:** -**Dyn. index:** -**Units group:** -**Scaling:** -**Max**

999

**Access level:** 2**Func. diagram:** -**Unit selection:** -**Expert list:** 1**Factory setting**

0

**Description:** The application-specific view of an existing drive object is entered into each index.  
The parameter cannot be changed.**Dependency:** Refer to: p0107, r0107**Note:** The application-specific views are defined in files on the memory card with the following structure:

PDxxxyyy.ACX

xxx: Application-specific view (p0103)

yyy: Type of drive object (p0107)

Example:

PD052017.ACX

--&gt; "017" stands for the drive object of type DC\_CTRL

--&gt; "052" is the number of the view for this drive object

---

**r0103      Application-specific view / Appl\_spec view**DC\_CTRL,  
DC\_CTRL\_R,  
DC\_CTRL\_R\_S,  
DC\_CTRL\_S**Can be changed:** -**Data type:** Unsigned16**P-Group:** Closed-loop control**Not for motor type:** -**Min**

0

**Calculated:** -**Dyn. index:** -**Units group:** -**Scaling:** -**Max**

65535

**Access level:** 2**Func. diagram:** -**Unit selection:** -**Expert list:** 1**Factory setting**

-

**Description:** Displays the application-specific view of the individual drive object.**Dependency:** Refer to: p0107, r0107

---

**p0105      Activate/de-activate drive object / DO act/deact**CU\_DC, CU\_DC\_R,  
CU\_DC\_R\_S,  
CU\_DC\_S**Can be changed:** U, T**Data type:** Integer16**P-Group:** Closed-loop control**Not for motor type:** -**Min**

0

**Calculated:** -**Dyn. index:** -**Units group:** -**Scaling:** -**Max**

1

**Access level:** 2**Func. diagram:** -**Unit selection:** -**Expert list:** 1**Factory setting**

1

**Description:** Setting to activate/de-activate a drive object.**Value:** 0: De-activate drive object  
1: Activate drive object**Dependency:** Refer to: r0106**Notice:** The following applies when activating:

If components are inserted for the first time and the appropriate drive object is activated, then the drive system is automatically booted. To do this, the pulses of all of the drive objects must be suppressed.

---

**p0105      Activate/de-activate drive object / DO act/deact**DC\_CTRL,  
DC\_CTRL\_R,  
DC\_CTRL\_R\_S,  
DC\_CTRL\_S**Can be changed:** T**Data type:** Integer16**P-Group:** Closed-loop control**Not for motor type:** -**Min**

0

**Calculated:** -**Dyn. index:** -**Units group:** -**Scaling:** -**Max**

2

**Access level:** 2**Func. diagram:** -**Unit selection:** -**Expert list:** 1**Factory setting**

1

**Description:** Setting to activate/de-activate a drive object.

<b>Value:</b>	0: De-activate drive object 1: Activate drive object 2: Drive object de-activate and not present
<b>Recommend.:</b>	After inserting all of the components of a drive object, before activating, first wait for Alarm A01316.
<b>Dependency:</b>	Refer to: r0106
<b>Notice:</b>	The following applies when activating: If components are inserted for the first time and the appropriate drive object is activated, then the drive system is automatically booted. To do this, the pulses of all of the drive objects must be suppressed.

---

**p0105      Activate/de-activate drive object / DO act/deact**

TM150, TM15DI_DO	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Closed-loop control	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	2	1
<b>Description:</b>	Setting to activate/de-activate a drive object.		
<b>Value:</b>	0: De-activate drive object 1: Activate drive object 2: Drive object de-activate and not present		
<b>Recommend.:</b>	After inserting all of the components of a drive object, before activating, first wait for Alarm A01316.		
<b>Dependency:</b>	Refer to: r0106		
<b>Caution:</b>	When activating drive objects with the safety functions enabled, the following applies: After reactivating, a warm restart (p0009 = 30, p0976 = 2, 3) or POWER ON should be carried out.		
<b>Notice:</b>	The following applies when activating: If components are inserted for the first time and the appropriate drive object is activated, then the drive system is automatically booted. To do this, the pulses of all of the drive objects must be suppressed.		
<b>Note:</b>	Re value = 0, 2: When a drive object is deactivated it no longer outputs any errors. If value = 0: All components of the drive object were completely commissioned and are deactivated using this value. They can be removed from the DRIVE-CLiQ without any error. If value = 1: All components of the drive object must be available for error-free operation. If value = 2: Components of a drive object in a project generated offline and set to this value must never be inserted in the actual topology from the very start. This means that the components are marked to be bypassed in the DRIVE-CLiQ line. For components that comprise several individual components (e.g. Double Motor Modules), it is not permissible to set just one subset to this value.		

---

**p0105      Activate/de-activate drive object / DO act/deact**

TM31	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Closed-loop control	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	2	1
<b>Description:</b>	Setting to activate/de-activate a drive object.		
<b>Value:</b>	0: De-activate drive object 1: Activate drive object 2: Drive object de-activate and not present		
<b>Recommend.:</b>	After inserting all of the components of a drive object, before activating, first wait for Alarm A01316.		
<b>Dependency:</b>	Refer to: r0106		

**Warning:**

A drive that is moved by simulating the inputs of a Terminal Module is brought to a standstill while this parameter is being changed over.

**Notice:**

The following applies when activating:

If components are inserted for the first time and the appropriate drive object is activated, then the drive system is automatically booted. To do this, the pulses of all of the drive objects must be suppressed.

**Note:**

Re value = 0, 2:

When a drive object is deactivated it no longer outputs any errors.

If value = 0:

All components of the drive object were completely commissioned and are deactivated using this value. They can be removed from the DRIVE-CLiQ without any error.

If value = 1:

All components of the drive object must be available for error-free operation.

If value = 2:

Components of a drive object in a project generated offline and set to this value must never be inserted in the actual topology from the very start. This means that the components are marked to be bypassed in the DRIVE-CLiQ line.

For components that comprise several individual components (e.g. Double Motor Modules), it is not permissible to set just one subset to this value.

**r0106****Drive object active/inactive / DO act/inact**

All objects

**Can be changed:** -

**Calculated:** -

**Access level:** 2

**Data type:** Integer16

**Dyn. index:** -

**Func. diagram:** -

**P-Group:** Closed-loop control

**Units group:** -

**Unit selection:** -

**Not for motor type:** -

**Scaling:** -

**Expert list:** 1

**Min**

**Max**

**Factory setting**

0

1

-

**Description:**

Displays the "active/inactive" state of a drive object.

**Value:**

0: Drive object inactive

1: Drive object active

**Dependency:**

Refer to: p0105

**p0107[0...23]****Drive object type / DO type**

CU\_DC, CU\_DC\_R,  
CU\_DC\_R\_S,  
CU\_DC\_S

**Can be changed:** C1(2)

**Calculated:** -

**Access level:** 2

**Data type:** Integer16

**Dyn. index:** -

**Func. diagram:** -

**P-Group:** -

**Units group:** -

**Unit selection:** -

**Not for motor type:** -

**Scaling:** -

**Expert list:** 1

**Min**

**Max**

**Factory setting**

0

600

0

**Description:**

The type of an existing drive object is entered into each index.

**Value:**

0: -

1: SINAMICS S

2: SINAMICS G

3: SINAMICS I

4: SINAMICS NX/CX32

6: SINAMICS DC

9: SINAMICS S110

10: ACTIVE INFEED CONTROL

11: SERVO

12: VECTOR

13: VECTORMV

14: VECTORGL

15: VECTOR3P

16: VECTORSL

17: DC\_CTRL

18: VECTORM2C

19: VECTORDM

20: SMART INFEED CONTROL  
30: BASIC INFEED CONTROL  
35: BRAKE MODULE M2C  
40: ACTIVE INFEED CONTROLMV  
41: BASIC INFEED CONTROLMV  
42: ACTIVE INFEED CONTROLM2C  
51: SINAMICS G120 230 (SingleDO-Drive which combines Device+Vector)  
52: SINAMICSG120 240\_2 (SingleDO-Drive which combines Device+Vector)  
53: SINAMICS\_G120\_CU250S\_V (SingleDO Drive combines Device+Vector)  
54: SINAMICSG120 G120D(SingleDO-Drive which combines Device+Vector)  
55: SINAMICS\_G120\_CU250S\_S (SingleDO Drive combines Device+Servo)  
56: SINAMICSG110M (SingleDO-Drive which combines Device+Vector)  
70: HLA  
100: TB30 (Terminal Board)  
102: SINAMICS MV  
150: DRIVE-CLiQ Hub Module  
200: TM31 (Terminal Module)  
201: TM41 (Terminal Module)  
202: TM17 High Feature (Terminal Module)  
203: TM15 (Terminal Module)  
204: TM15 (Terminal Module for SINAMICS)  
205: TM54F - Master (Terminal Module)  
206: TM54F - Slave (Terminal Module)  
207: TM120 (Terminal Module)  
208: TM150 (Terminal Module)  
254: CU-LINK  
300: ENCODER  
600: SINAMICS V60-G2 V80-G2

**Index:**

[0] = Drive object type Control Unit  
[1] = Drive object type object 1  
[2] = Drive object type object 2  
[3] = Drive object type object 3  
[4] = Drive object type object 4  
[5] = Drive object type object 5  
[6] = Drive object type object 6  
[7] = Drive object type object 7  
[8] = Drive object type object 8  
[9] = Drive object type object 9  
[10] = Drive object type object 10  
[11] = Drive object type object 11  
[12] = Drive object type object 12  
[13] = Drive object type object 13  
[14] = Drive object type object 14  
[15] = Drive object type object 15  
[16] = Drive object type object 16  
[17] = Drive object type object 17  
[18] = Drive object type object 18  
[19] = Drive object type object 19  
[20] = Drive object type object 20  
[21] = Drive object type object 21  
[22] = Drive object type object 22  
[23] = Drive object type object 23

**Dependency:**

Refer to: p0103, r0103

**Caution:**



If you change this parameter and exit the device commissioning mode, then the complete software will be set up again and all of the previous drive parameter settings are deleted.

**Note:**

The number (p0101) and the associated drive object type are in the same index.

<b>r0107 Drive object type / DO type</b>			
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150, TM15DI_DO, TM31	<b>Can be changed:</b> - <b>Data type:</b> Integer16 <b>P-Group:</b> Closed-loop control <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 600	<b>Factory setting</b> -
<b>Description:</b>	Displays the type of each drive object.		
<b>Value:</b>	0: - 1: SINAMICS S 2: SINAMICS G 3: SINAMICS I 4: SINAMICS NX/CX32 6: SINAMICS DC 9: SINAMICS S110 10: ACTIVE INFEED CONTROL 11: SERVO 12: VECTOR 13: VECTORMV 14: VECTORGL 15: VECTOR3P 16: VECTORSL 17: DC_CTRL 18: VECTORM2C 19: VECTORDM 20: SMART INFEED CONTROL 30: BASIC INFEED CONTROL 35: BRAKE MODULE M2C 40: ACTIVE INFEED CONTROLMV 41: BASIC INFEED CONTROLMV 42: ACTIVE INFEED CONTROLM2C 51: SINAMICS G120 230 (SingleDO-Drive which combines Device+Vector) 52: SINAMICSG120 240_2 (SingleDO-Drive which combines Device+Vector) 53: SINAMICS_G120_CU250S_V (SingleDO Drive combines Device+Vector) 54: SINAMICSG120 G120D(SingleDO-Drive which combines Device+Vector) 55: SINAMICS_G120_CU250S_S (SingleDO Drive combines Device+Servo) 56: SINAMICSG110M (SingleDO-Drive which combines Device+Vector) 70: HLA 100: TB30 (Terminal Board) 102: SINAMICS MV 150: DRIVE-CLiQ Hub Module 200: TM31 (Terminal Module) 201: TM41 (Terminal Module) 202: TM17 High Feature (Terminal Module) 203: TM15 (Terminal Module) 204: TM15 (Terminal Module for SINAMICS) 205: TM54F - Master (Terminal Module) 206: TM54F - Slave (Terminal Module) 207: TM120 (Terminal Module) 208: TM150 (Terminal Module) 254: CU-LINK 300: ENCODER 600: SINAMICS V60-G2 V80-G2		
<b>Dependency:</b>	Refer to: p0103, r0103		



<b>p0108[0...23]</b>	<b>Drive objects function module / DO function module</b>				
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> C1(2) <b>Data type:</b> Unsigned32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0000 0000 0000 0000 0000 0000 0000 0000 bin		
<b>Description:</b>	The function module of an existing drive object is entered into each index (also refer to p0101, p0107). The following bits are available for the Control Unit (Index 0): Bit 18: Free function blocks Bit 31: PROFINET For all other drive objects (Index > 0), the significance of the bits should be taken from the display parameters r0108 of the drive object.				
<b>Index:</b>	[0] = Function module Control Unit [1] = Function module object 1 [2] = Function module object 2 [3] = Function module object 3 [4] = Function module object 4 [5] = Function module object 5 [6] = Function module object 6 [7] = Function module object 7 [8] = Function module object 8 [9] = Function module object 9 [10] = Function module object 10 [11] = Function module object 11 [12] = Function module object 12 [13] = Function module object 13 [14] = Function module object 14 [15] = Function module object 15 [16] = Function module object 16 [17] = Function module object 17 [18] = Function module object 18 [19] = Function module object 19 [20] = Function module object 20 [21] = Function module object 21 [22] = Function module object 22 [23] = Function module object 23				
<b>Bit field:</b>	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>	<b>FP</b>
	18	Bit 18	ON	OFF	-
	31	Bit 31	ON	OFF	-
<b>Note:</b>	A "function module" is a functional expansion of a drive object that can be activated when commissioning.				

<b>r0108</b>	<b>Drive objects function module / DO function module</b>				
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> Closed-loop control <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -		
<b>Description:</b>	Displays the activated function module for the particular drive object.				
<b>Bit field:</b>	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>	<b>FP</b>
	16	Technology controller / Tech_ctrl	Activated	Not activated	-
	18	Free function blocks / FBLOCKS	Activated	Not activated	-
	31	PROFINET / PROFINET	Activated	Not activated	-
<b>Note:</b>	A "function module" is a functional expansion of a drive object that can be activated when commissioning.				

**r0108 Drive objects function module / DO function module**

TM150, TM15DI_DO, TM31	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Closed-loop control	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the activated function module for the particular drive object.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	18	Free function blocks / FBLOCKS	Activated	Not activated	-
	31	PROFINET / PROFINET	Activated	Not activated	-

**Note:** A "function module" is a functional expansion of a drive object that can be activated when commissioning.

**r0110[0...2] Basic sampling times / t\_basis**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Closed-loop control	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0.00 [µs]	10000.00 [µs]	- [µs]

**Description:** Displays the basic sampling times.

The sampling times are set using p0112 and p0115. The values for the basic sampling times are determined as a result of these settings.

**Index:**  
[0] = Basic sampling time 0  
[1] = Basic sampling time 1  
[2] = Basic sampling time 2

**r0111 Basic sampling time selection / t\_basis sel**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S, DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Closed-loop control	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	2	-

**Description:** Displays the selected basic sampling time for this drive object.

**Dependency:** Refer to: r0110

**r0111 Basic sampling time selection / t\_basis sel**

TM15DI_DO, TM31	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Closed-loop control	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	2	-

**Description:** Displays the selected basic sampling time for this drive object.

**Dependency:** Refer to: r0110

**Note:** For TB30 and the Terminal Module, this parameter has no significance.  
For TB30 and certain Terminal Modules, the sampling times can be set using p4099 (see description of p4099 for the Module in question).

<b>p0112</b>			
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Sampling times pre-setting p0115 / t_sample for p0115</b>		
	<b>Can be changed:</b> C1(3)	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Closed-loop control	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 3	<b>Factory setting</b> 3
<b>Description:</b> Pre-assignment of the sampling times in p0115. The clock cycles for the current controller / speed controller / - / setpoint channel / - / - / technology controller are defined as follows: p0112 = 3: 1000 / 2000 / - / 4000 / - / - / 4000 µs			
<b>Value:</b> 0: Expert 3: Standard			
<b>Note:</b> For p0112 = 0 (expert) the individual sampling times in p0115 can be adjusted.			
<hr/>			
<b>p0115[0]</b>			
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Sampling time for supplementary functions / t_samp suppl_fct</b>		
	<b>Can be changed:</b> C1(3)	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Closed-loop control	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0.00 [µs]	<b>Max</b> 16000.00 [µs]	<b>Factory setting</b> 4000.00 [µs]
<b>Description:</b> Sets the basic sampling time for supplementary functions (DCC, free function blocks) on this object. Only setting values that are an integer multiple of 125 µs are permissible.			
<b>Index:</b> [0] = Basic sampl. time			
<hr/>			
<b>p0115[0...6]</b>			
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Sampling times for internal control loops / t_sample int ctrl</b>		
	<b>Can be changed:</b> C1(3)	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Closed-loop control	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 1000.00 [µs]	<b>Max</b> 16000.00 [µs]	<b>Factory setting</b> [0] 1000.00 [µs] [1] 2000.00 [µs] [2] 8000.00 [µs] [3] 4000.00 [µs] [4] 8000.00 [µs] [5] 8000.00 [µs] [6] 8000.00 [µs]
<b>Description:</b> Sets the sampling times for the control loops. The default setting is made using p0112 and can only be individually changed for p0112 = 0 (expert).			
<b>Index:</b> [0] = Current controller [1] = Speed controller [2] = - [3] = Setpoint channel [4] = - [5] = - [6] = Technology controller			
<b>Dependency:</b> The sampling times can only be separately set if p0112 is 0 (expert). If a sampling time is modified in the expert mode, then all of the sampling times with higher indices are automatically changed in the same ratio as the sampling time itself was changed. Slower time slices are only taken if the calculated sampling time is also permitted. Upper limit is 8 ms.			


Higher-level controls must be calculated in integral ratios to lower-level controls (e.g.  $p0115[1] = N * p0115[0]$ ; where N is an integer number). The sampling time of the speed controller ( $p0115[1]$ ) can have as a maximum a value of 800% of the current controller sampling time ( $p0115[0]$ ).

Refer to: r0110, r0111, p0112

**Note:** For function modules that can be activated (e.g. technology controller), the parameters values are pre-assigned. The current controller sampling time ( $p0115[0]$ ) is permanently set to 1 ms and cannot be changed.

<b>p0115[0]</b>	<b>Sampling time for supplementary functions / t_samp suppl_fct</b>		
TM150, TM15DI_DO, TM31	<b>Can be changed:</b> C1(3) <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Closed-loop control <b>Not for motor type:</b> - <b>Min</b> 0.00 [µs]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 16000.00 [µs]	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 4000.00 [µs]
<b>Description:</b>	Sets the sampling times for supplementary functions (DCC, free function blocks) on this object. Only setting values that are an integer multiple of 125 µs are permissible.		
<b>Index:</b>	[0] = Basic sampl. time		
<b>Note:</b>	This parameter only applies to set the sampling times of possible supplementary functions. The sampling times for inputs/outputs must be set in p4099.		
<b>r0116[0...1]</b>	<b>Drive object clock cycle recommended / DO_clock recom</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S, DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM15DI_DO, TM31	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Closed-loop control <b>Not for motor type:</b> - <b>Min</b> - [µs]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> - [µs]	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [µs]
<b>Description:</b>	Displays the recommended sampling time for the drive objects. $r00116[0]$ = recommended sampling time: Recommended value which would then make the complete system operational. $r00116[1]$ = recommended sampling time: Recommended value, which after changing other clock cycles on the DRIVE-CLiQ line, would result in an operational system.		
<b>Index:</b>	[0] = Change only for the actual drive object [1] = Changing all objects on the DRIVE-CLiQ line		
<b>Dependency:</b>	Refer to: p0115		
<b>p0121[0...n]</b>	<b>Power unit component number / PU comp_no</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C1(4) <b>Data type:</b> Unsigned8 <b>P-Group:</b> Data sets <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> PDS <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 199	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	The power unit data set is assigned to a power unit using this parameter. This unique component number is assigned when parameterizing the topology. Only component numbers can be entered into this parameter that correspond to a power unit.		
<b>Dependency:</b>	Refer to: p0107, r0107		

<b>p0124[0...23]</b>			
<b>Main component detection using LED / M_comp detect LED</b>			
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned8 <b>P-Group:</b> Converter <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Detection of the main components of the drive object selected via the index.		

<b>p0125[0...n]</b>			
<b>Activate/de-activate power unit components / PU_comp act/deact</b>			
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C1(4), T <b>Data type:</b> Integer16 <b>P-Group:</b> Data sets <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> PDS <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 2	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Setting to activate/de-activate a power unit component.		
<b>Value:</b>	0: De-activate component 1: Activate component 2: Component de-activate and not present		
<b>Recommend.:</b>	After inserting a component, before activating, first wait for Alarm A01317.		
<b>Caution:</b>	For a parallel connection, the following applies:		
	When deactivating individual power units using p0125, it is not permissible that the power units of the parallel connection involved are connected. Infeed units should be disconnected from the line supply (for example, using a contactor). Motor feeder cables should be disconnected. In addition, defective power units should be disconnected from the DC link.		
<b>Caution:</b>	It is not permissible to de-activate drive objects with safety functions enabled.		
<b>Note:</b>	The activation of a component can be rejected if the component was inserted for the first time. In this case, it is only possible to activate the component when the pulses for all of the drive objects are inhibited. For units connected in parallel, when one of the power units is de-activated, then the enable in p7001 is withdrawn. Re value = 0, 2: When a component is deactivated it no longer outputs any errors. If value = 0: The component was completely commissioned and is deactivated using this value. It can be removed from the DRIVE-CLiQ without any error. If value = 1: The component must be available for error-free operation. If value = 2: A component in a project generated offline and set to this value must never be inserted in the actual topology from the very start. This means that the component is marked to be bypassed in the DRIVE-CLiQ line. For components that comprise several individual components (e.g. Double Motor Modules), it is not permissible to set just one subset to this value.		

<b>p0140</b>			
<b>Number of Encoder Data Sets (EDS) / EDS count</b>			
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C1(3) <b>Data type:</b> Unsigned8 <b>P-Group:</b> Data sets <b>Not for motor type:</b> - <b>Min</b> 1	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 16	<b>Access level:</b> 2 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Sets the number of Encoder Data Sets (EDS).		
<b>Note:</b>	When parameterizing the drive with "no encoder" there must be at least one encoder data set (p0140 >= 1).		

<b>p0141[0...n]</b>	<b>Encoder interface (Sensor Module) component number / Enc_interf comp_no</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C1(4)	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned8	<b>Dyn. index:</b> EDS, p0140	<b>Func. diagram:</b> 4704, 8570
	<b>P-Group:</b> Data sets	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 199	<b>Factory setting</b> 0
<b>Description:</b>	This parameter is used to assign the encoder data set to an encoder evaluation (e.g. SMC). This unique component number is assigned when parameterizing the topology. Only component numbers can be entered into this parameter that correspond to an encoder evaluation.		
<b>Note:</b>	If the encoder evaluation and encoder are integrated (motor with DRIVE-CLiQ), then their component numbers are identical. For an SMC, different component numbers are assigned for the SMC (p0141) and the (actual) encoder (p0142).		
<b>p0142[0...n]</b>	<b>Encoder component number / Encoder comp_no</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C1(4)	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned8	<b>Dyn. index:</b> EDS, p0140	<b>Func. diagram:</b> 4704
	<b>P-Group:</b> Data sets	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 199	<b>Factory setting</b> 0
<b>Description:</b>	This parameter is used to assign the encoder data set to an encoder. This assignment is made using the unique component number that was assigned when parameterizing the topology. Only component numbers can be entered into this parameter that correspond to an encoder.		
<b>Note:</b>	If the encoder evaluation and encoder are integrated (motor with DRIVE-CLiQ), then their component numbers are identical. For an SMC, different component numbers are assigned for the SMC (p0141) and the (actual) encoder (p0142).		
<b>p0144[0...n]</b>	<b>Sensor Module detection via LED / SM detection LED</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned8	<b>Dyn. index:</b> EDS, p0140	<b>Func. diagram:</b> -
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 1	<b>Factory setting</b> 0
<b>Description:</b>	Detects the Sensor Module assigned to this drive and data set.		
<b>Note:</b>	While p0144 = 1, the READY LED flashes green/orange or red/orange with 2 Hz at the appropriate Sensor Module.		
<b>p0145[0...n]</b>	<b>Activate/de-activate encoder interface / Enc_intf act/deact</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C1(4), U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> EDS, p0140	<b>Func. diagram:</b> -
	<b>P-Group:</b> Data sets	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 2	<b>Factory setting</b> 1
<b>Description:</b>	Setting to activate/de-activate an encoder interface (Sensor Module).		
<b>Value:</b>	0: De-activate component 1: Activate component 2: Component de-activate and not present		
<b>Recommend.:</b>	After inserting a component, before activating, first wait for Alarm A01317.		
<b>Dependency:</b>	Refer to: r0146		

**Note:** The de-activation of an encoder interface corresponds to the "parking encoder" function and has the same effect. The activation of a component can be rejected if the component was inserted for the first time. In this case, it is only possible to activate the component when the pulses for all of the drive objects are inhibited. With the encoder interface for encoder 1 (motor encoder), the relevant drive object for writing the parameter must be in the "Ready for operation" state. With the encoder interface for encoders 2 and 3, the parameter can also be written during operation.

Re value = 0, 2:  
When a component is deactivated it no longer outputs any errors.

If value = 0:  
The component was completely commissioned and is deactivated using this value. It can be removed from the DRIVE-CLiQ without any error.

If value = 1:  
The component must be available for error-free operation.

If value = 2:  
A component in a project generated offline and set to this value must never be inserted in the actual topology from the very start.

For components that comprise several individual components (e.g. Double Motor Modules), it is not permissible to set just one subset to this value.

<b>r0146[0...n]</b>	<b>Encoder interface active/inactive / Enc_intf act/inact</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> Integer16 <b>P-Group:</b> Data sets <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> EDS, p0140 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1	<b>Access level:</b> 2 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the "active" or "inactive" state of an encoder interface (Sensor Module).		
<b>Value:</b>	0: Component inactive 1: Component active		
<b>Dependency:</b>	Refer to: p0105, p0145, p0480		

<b>r0147[0...n]</b>	<b>Sensor Module EEPROM data version / SM EEPROM version</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> Encoder <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> EDS, p0140 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the version of the EEPROM data of the Sensor Module.		
<b>Dependency:</b>	Refer to: r0157		
<b>Note:</b>	Example: The value 1010100 should be interpreted as V01.01.01.00.		

<b>r0148[0...n]</b>	<b>Sensor Module firmware version / SM FW version</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> Encoder <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> EDS, p0140 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the firmware version of the Sensor Module.		
<b>Dependency:</b>	Refer to: r0018, r0158, r0197, r0198		

**Note:** Example:  
The value 1010100 should be interpreted as V01.01.01.00.

---

**p0151 Terminal Module component number / TM comp\_no**

TM150, TM15DI_DO, TM31	<b>Can be changed:</b> C1(4)	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned8	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Data sets	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 199	<b>Factory setting</b> 0

**Description:** Sets the component number for the Terminal Module.  
This unique component number is assigned when parameterizing the topology.  
Only component numbers can be entered into this parameter that correspond to a Terminal Module.

---

**p0154 Terminal Module detection via LED / TM detection LED**

TM150, TM15DI_DO, TM31	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned8	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Terminals	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 1	<b>Factory setting</b> 0

**Description:** Detects the Terminal Module assigned to this drive and data set.

**Note:** While p0154 = 1, the READY LED flashes green/orange or red/orange with 2 Hz at the appropriate Terminal Module.

---

**r0157 Terminal Module EPROM data version / TM EPROM version**

TM150, TM15DI_DO, TM31	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Terminals	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> -

**Description:** Displays the version of the EPROM data of the Terminal Module.

**Dependency:** Refer to: r0147

**Note:** Example:  
The value 1010100 should be interpreted as V01.01.01.00.

---

**r0158 Terminal Module firmware version / TM FW version**

TM150, TM15DI_DO, TM31	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Terminals	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> -

**Description:** Displays the firmware version of the Terminal Module.

**Dependency:** Refer to: r0018, r0148, r0197, r0198

**Note:** Example:  
The value 1010100 should be interpreted as V01.01.01.00.



<b>p0170</b>			
<b>Number of Command Data Sets (CDS) / CDS count</b>			
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C1(3) <b>Data type:</b> Unsigned8 <b>P-Group:</b> Commands <b>Not for motor type:</b> - <b>Min</b> 2	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 2	<b>Access level:</b> 2 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 2
<b>Description:</b>		Sets the number of Command Data Sets (CDS).	
<b>Note:</b>		It is possible to toggle between command parameters (BICO parameters) using this data set changeover.	
<hr/>			
<b>p0180</b>			
<b>Number of Drive Data Sets (DDS) / DDS count</b>			
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C1(3) <b>Data type:</b> Unsigned8 <b>P-Group:</b> Data sets <b>Not for motor type:</b> - <b>Min</b> 4	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 4	<b>Access level:</b> 2 <b>Func. diagram:</b> 8565 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 4
<b>Description:</b>		Sets the number of Drive Data Sets (DDS).	
<hr/>			
<b>p0187[0...n]</b>			
<b>Encoder 1 encoder data set number / Enc 1 EDS number</b>			
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C1(4) <b>Data type:</b> Unsigned8 <b>P-Group:</b> Data sets <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 99	<b>Access level:</b> 3 <b>Func. diagram:</b> 8570 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 99
<b>Description:</b>		Assign a drive data set (= index) the corresponding encoder data set (EDS) for encoder 1. The value corresponds to the number of the assigned encoder data set. Example: Encoder data set 0 should be assigned to encoder 1 in drive data set 2. --> p0187[2] = 0	
<b>Note:</b>		A value of 99 means that no encoder has been assigned to this drive data set (not configured).	
<hr/>			
<b>p0188[0...n]</b>			
<b>Encoder 2 encoder data set number / Enc 2 EDS number</b>			
DC_CTRL, DC_CTRL_R	<b>Can be changed:</b> C1(4) <b>Data type:</b> Unsigned8 <b>P-Group:</b> Data sets <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 99	<b>Access level:</b> 3 <b>Func. diagram:</b> 8570 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 99
<b>Description:</b>		Assign a drive data set (= index) the corresponding encoder data set (EDS) for encoder 2. The value corresponds to the number of the assigned encoder data set. Example: Encoder data set 1 should be assigned to encoder 2 in drive data set 2. --> p0188[2] = 1	
<b>Note:</b>		A value of 99 means that no encoder has been assigned to this drive data set (not configured).	

**r0196[0...255] DRIVE-CLiQ component status / DQ comp status**CU\_DC, CU\_DC\_R,  
CU\_DC\_R\_S,  
CU\_DC\_S**Can be changed:** -**Calculated:** -**Access level:** 3**Data type:** Unsigned32**Dyn. index:** -**Func. diagram:** -**P-Group:** -**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** -**Expert list:** 1**Min****Max****Factory setting**

-

-

-

**Description:**

Displays the status of DRIVE-CLiQ components.

r0196[0...1]: Not used

r0196[2]: Status of DRIVE-CLiQ component with component number 2

...

r0196[255]: Status of DRIVE-CLiQ component with component number 255

**Note:**

Structure of status value: Bits 31 ... 08, 07, 06 ... 04, 03 ... 00

Re Bit 31 ... 08: Reserved

Re Bit 07: 1: Part of target topology, 0: Only in actual topology

Re Bit 06 ... 04: 1: Active, 0: Inactive or parked

Re bit 03 ... 00:

0: Component data not available.

1: Power-up, acyclic DRIVE-CLiQ communication (LED = orange).

2: Ready for operation, cyclic DRIVE-CLiQ communication (LED = green).

3: Alarm (LED = green).

4: Fault (LED = red).

5: Detection via LED and ready for operation (LED = green/orange).

6: Detection via LED and alarm (LED = green/orange).

7: Detection via LED and fault (LED = red/orange).

8: Downloading firmware (LED = green/red at 0.5 Hz).

9: Firmware downloading completed, Waiting for POWER ON (LED = green/red at 2.0 Hz).

**r0197[0...1] Bootloader version / Bootloader vers**CU\_DC, CU\_DC\_R,  
CU\_DC\_R\_S,  
CU\_DC\_S**Can be changed:** -**Calculated:** -**Access level:** 4**Data type:** Unsigned32**Dyn. index:** -**Func. diagram:** -**P-Group:** Closed-loop control**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** -**Expert list:** 1**Min****Max****Factory setting**

-

-

-

**Description:**

Displays the bootloader version.

Index 0:

Displays the bootloader version.

Index 1:

Displays the bootloader version 3 (for CU320-2 and CU310-2)

Value 0 means that boot loader 3 is not available.

**Dependency:**

Refer to: r0018, r0148, r0158, r0198

**Note:**

Example:

The value 1010100 should be interpreted as V01.01.01.00.

<b>r0198[0...1]</b>	<b>BIOS/EEPROM data version / BIOS/EEPROM vers</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> Closed-loop control <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the BIOS and EEPROM data version. r0198[0]: BIOS version r0198[1]: EEPROM data version		
<b>Dependency:</b>	Refer to: r0018, r0148, r0158, r0197		
<b>Note:</b>	Example: The value 1010100 should be interpreted as V01.01.01.00.		
<b>p0199[0...24]</b>	<b>Drive object name / DO name</b>		
All objects	<b>Can be changed:</b> C1 <b>Data type:</b> Unsigned16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 65535	<b>Access level:</b> 2 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Freely assignable name for a drive object. In the commissioning software, this name cannot be entered using the expert list, but is specified in the configuration assistant. The object name can be subsequently modified in the Project Navigator using standard Windows resources.		
<b>Note:</b>	The parameter is not influenced by setting the factory setting.		
<b>r0200[0...n]</b>	<b>Power unit code number actual / PU code no. act</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned16 <b>P-Group:</b> Converter <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> PDS <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the unique code number of the power unit.		
<b>Note:</b>	r0200 = 0: No power unit found		
<b>p0201[0...n]</b>	<b>Power unit code number / PU code no</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2 <b>Data type:</b> Unsigned16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> PDS <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 65535	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Code number of the power unit. Each time the system boots, the code number is transferred from the data of the power unit to r0200 and to p0201.		

**r0203[0...15]      Firmware package name / FW pkg name**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Unsigned8	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the name of the firmware package on the memory card/device memory.  
r0203[0]: Name character 1

...

r0203[15]: Name character 16

For the commissioning software, the ASCII characters are displayed uncoded.

**Notice:** An ASCII table (excerpt) can be found, for example, in the appendix to the List Manual.

**p0340[0...n]      Automatic calculation motor/control parameters / Calc auto par**

DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(3), T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> -
	<b>P-Group:</b> Motor	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	1	0

**Description:** Setting to automatically calculate motor parameters and closed-loop control parameters from rating plate data.

**Value:** 0: No calculation  
1: Complete calculation

**Notice:** After the value has been modified, no further parameter modifications can be made and the status is shown in r3996. Modifications can be made again when r3996 = 0.

**p0400[0...n]      Encoder type selection / Enc\_tpy sel**

DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(1, 4)	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> EDS, p0140	<b>Func. diagram:</b> 1580, 4704
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	20000	0

**Description:** Selects the encoder from the list of encoder types supported.

**Value:** 0: No encoder  
3001: 1024 HTL A/B R  
3002: 1024 TTL A/B R  
3003: 2048 HTL A/B R  
3005: 1024 HTL A/B  
3006: 1024 TTL A/B  
3007: 2048 HTL A/B  
3008: 2048 TTL A/B  
3009: 1024 HTL A/B unipolar  
3011: 2048 HTL A/B unipolar  
3020: 2048 TTL A/B R, with sense  
3081: SSI, Singleturn, 24 V  
3082: SSI, Multiturn 4096, 24 V  
3090: 4096, HTL, A/B, SSI, Singleturn  
9999: User-defined  
20000: Encoder from OEM encoder list

**Caution:** An encoder type with p0400 < 9999 defines an encoder for which there is an encoder parameter list. When selecting a catalog encoder (p0400 < 9999) the parameters from the encoder parameter list cannot be changed (write protection). To remove write protection, the encoder type should be set to a third-party encoder (p0400 = 9999).

**Note:** The connected encoder can be identified by p0400 = 10000. This assumes that the encoder supports this method, which is possible in the following cases: Motor with DRIVE-CLiQ, encoder with EnDat interface, DRIVE-CLiQ encoder.

The encoder data (e.g. pulse number p0408) can only be changed when p0400 = 9999.

When using an encoder with track A/B and zero pulse, as standard, fine synchronization is not set using a zero mark. If, for a synchronous motor, fine synchronization is to be realized using a zero mark, then the following must be executed:

- set p0400 to 9999
- set p0404.15 to 1

Prerequisite:

Coarse synchronization must be selected (e.g. pole position identification) and the zero pulse of the encoder must be either mechanically or electronically (p0431) adjusted to the pole position.

For p0400 = 10000 the following applies:

If an identification is not possible, then p0400 is set to 0.

p0401[0...n]	Encoder type OEM selection / Enc type OEM sel		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(1, 4)	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> EDS, p0140	<b>Func. diagram:</b> -
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	32767	0
<b>Description:</b>	Selects the encoder from the list of encoder types that the OEM supports.		
<b>Note:</b>	The connected encoder can be identified by p0400 = 10000. This means that the encoder must support this and is possible in the following cases: Motor with DRIVE-CLiQ, encoder with EnDat interface.		
	If an identification is not possible, then p0400 is set to 0.		
	The encoder data (e.g. pulse number p0408) can only be changed when p0400 = 9999.		
	Using p0400 = 20000, the encoder type can be selected from the list of OEM encoders using p0401.		

p0402[0...n]	Gearbox type selection / Gearbox type sel		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(1, 4)	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> EDS, p0140	<b>Func. diagram:</b> -
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	1	10100	9999
<b>Description:</b>	Selects the gearbox type to pre-set the inversion and the gearbox factor.		
	Measuring gear factor = motor or load revolutions / encoder revolutions.		
<b>Value:</b>	1: Gearbox 1:1 not inverted 2: Gearbox 2:7 inverted 3: Gearbox 4:17 inverted 4: Gearbox 2:10 inverted 9999: Gearbox user-defined 10000: Identify gearbox 10100: Identify gearbox		
<b>Dependency:</b>	Refer to: p0410, p0432, p0433		
<b>Note:</b>	Re p0402 = 1: Automatic setting of p0410 = 0000 bin, p0432 = 1, p0433 = 1. Re p0402 = 2: Automatic setting of p0410 = 0011 bin, p0432 = 7, p0433 = 2. Re p0402 = 3: Automatic setting of p0410 = 0011 bin, p0432 = 17, p0433 = 4. Re p0402 = 4: Automatic setting of p0410 = 0011 bin, p0432 = 10, p0433 = 2.		

Re p0402 = 9999:

No automatic setting of p0410, p0432, p0433. The parameters should be manually set.

Re p0402 = 10000:

It is only possible to identify the gearbox type for a motor with DRIVE-CLiQ. Parameters p0410, p0432 and p0433 are set corresponding to the identified gearbox. If an identification is not possible, then p0402 is set to 9999.

p0404[0...n]	Encoder configuration effective / Enc_config eff		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4)	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> EDS, p0140	<b>Func. diagram:</b> 4704
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> 0000 0000 0000 0000 0000 0000 0000 0000 bin

**Description:** Settings for the basic encoder properties.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Linear encoder	Yes	No	-
	01	Absolute encoder	Yes	No	-
	02	Multiturn encoder	Yes	No	-
	03	Track A/B sq-wave	Yes	No	-
	04	Track A/B sine	Yes	No	-
	05	Track C/D	Yes	No	-
	06	Hall sensor	Yes	No	-
	08	EnDat encoder	Yes	No	-
	09	SSI encoder	Yes	No	-
	10	DRIVE-CLiQ encoder	Yes	No	-
	11	Digital encoder	Yes	No	-
	12	Equidistant zero mark	Yes	No	-
	13	Irregular zero mark	Yes	No	-
	14	Distance-coded zero mark	Yes	No	-
	15	Commutation with zero mark (not ASM)	Yes	No	-
	16	Acceleration	Yes	No	-
	17	Track A/B analog	Yes	No	-
	20	Voltage level 5 V	Yes	No	-
	21	Voltage level 24 V	Yes	No	-
	22	Remote sense (only SMC30)	Yes	No	-
	23	Resolver excit.	Yes	No	-

**Caution:** This parameter is automatically pre-set for encoders from the encoder list (p0400).  
When selecting a catalog encoder, this parameter cannot be changed (write protection). Information in p0400 should be carefully observed when removing write protection.

**Note:** ZM: Zero mark  
SMC: Sensor Module Cabinet  
If a technique to determine the commutation information/data has not been selected (e.g. track C/D, Hall sensor), and the encoder pulse number is an integer multiple of the pole number, then the following applies:  
The track A/B is adjusted to match the magnetic position of the motor.  
Re bit 01, 02 (absolute encoder, multiturn encoder):  
These bits can only be selected for EnDat encoders, SSI encoders or DRIVE-CLiQ encoders.  
Re bit 10 (DRIVE-CLiQ encoder):  
This bit is only used for the large-scale integrated DRIVE-CLiQ encoders that provide their encoder data directly in DRIVE-CLiQ format without converting this data. This bit is not, therefore, set for first-generation DRIVE-CLiQ encoders.  
Re bit 12 (equidistant zero mark):  
The zero marks occur at regular intervals (e.g. rotary encoder with 1 zero mark per revolution or linear encoder with constant zero mark distance).  
The bit activates monitoring of the zero mark distance (p0424/p0425, linear/rotary) or in the case of the linear encoder with 1 zero mark and p0424 = 0 zero mark monitoring is activated.

Re bit 13 (irregular zero mark):

The zero marks occur at irregular intervals (e.g. a linear scale with only 1 zero mark in the traversing range). The zero mark distance is not monitored.

Re bit 14 (distance-coded zero mark):

The distance (clearance) between two or several consecutive zero marks allows the absolute position to be calculated.

Re bit 15 (commutation with zero mark):

Only applicable for synchronous motors.

The function can be de-selected by priority via p0430.23.

For distance-coded zero marks, the following applies:

The phase sequence of the C/D track (if available) must be the same as the phase sequence of the encoder (A/B track).

The phase sequence of the Hall signal (if available) must be the same as the phase sequence of the motor. Further, the position of the Hall sensor must be mechanically adjusted to the motor EMF.


The fine synchronization is only started after two zero marks have been passed.

p0405[0...n] Square-wave encoder track A/B / Sq-wave enc A/B					
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4)		<b>Calculated:</b> -	<b>Access level:</b> 3	
	<b>Data type:</b> Unsigned32		<b>Dyn. index:</b> EDS, p0140	<b>Func. diagram:</b> 4704	
	<b>P-Group:</b> Encoder		<b>Units group:</b> -	<b>Unit selection:</b> -	
	<b>Not for motor type:</b> -		<b>Scaling:</b> -	<b>Expert list:</b> 1	
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> 0000 1111 bin		
<b>Description:</b> Settings for the track A/B in a square-wave encoder. For square-wave encoders, p0404.3 must also be 1.					
<b>Bit field:</b>	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>	<b>FP</b>
	00	Signal	Bipolar	Unipolar	-
	01	Level	TTL	HTL	-
	02	Track monitoring	A/B <> -A/B	None	-
	03	Zero pulse	Same as A/B track	24 V unipolar	-
	04	Switching threshold	High	Low	-
	05	Pulse/direction	Active	Inactive	-
<b>Caution:</b> This parameter is automatically pre-set for encoders from the encoder list (p0400). When selecting a catalog encoder, this parameter cannot be changed (write protection). Information in p0400 should be carefully observed when removing write protection.					
<b>Note:</b> Re bit 02: When the function is activated, track monitoring can be de-activated by setting p0437.26. Re bit 05: When the function is activated, a frequency setpoint and a direction for traveling can be entered via an encoder interface.					

p0407[0...n] Linear encoder grid division / Enc grid div			
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4)	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> EDS, p0140	<b>Func. diagram:</b> 4704
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0 [nm]	<b>Max</b> 250000000 [nm]	<b>Factory setting</b> 16000 [nm]
<b>Description:</b>	Sets the grid division for a linear encoder.		
<b>Caution:</b>	This parameter is automatically pre-set for encoders from the encoder list (p0400). When selecting a catalog encoder, this parameter cannot be changed (write protection). Information in p0400 should be carefully observed when removing write protection.		
<b>Note:</b>	The lowest permissible value is 250 nm.		

<b>p0408[0...n]</b>					<b>Rotary encoder pulse number / Rot enc pulse No.</b>						
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S					<b>Can be changed:</b> C2(4)		<b>Calculated:</b> -		<b>Access level:</b> 3		
					<b>Data type:</b> Unsigned32		<b>Dyn. index:</b> EDS, p0140		<b>Func. diagram:</b> 4704		
					<b>P-Group:</b> Encoder		<b>Units group:</b> -		<b>Unit selection:</b> -		
					<b>Not for motor type:</b> -		<b>Scaling:</b> -		<b>Expert list:</b> 1		
					<b>Min</b> 0		<b>Max</b> 16777215		<b>Factory setting</b> 2048		
<b>Description:</b>					Sets the number of pulses for a rotary encoder.						
<b>Caution:</b>					This parameter is automatically pre-set for encoders from the encoder list (p0400). When selecting a catalog encoder, this parameter cannot be changed (write protection). Information in p0400 should be carefully observed when removing write protection.						
<b>Note:</b>					The number of pole pairs for a resolver is entered here. The smallest permissible value is 1 pulse.						
<hr/>											
<b>p0410[0...n]</b>					<b>Encoder inversion actual value / Enc inv act value</b>						
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S					<b>Can be changed:</b> C2(4)		<b>Calculated:</b> -		<b>Access level:</b> 3		
					<b>Data type:</b> Unsigned16		<b>Dyn. index:</b> EDS, p0140		<b>Func. diagram:</b> 4710, 4704		
					<b>P-Group:</b> Encoder		<b>Units group:</b> -		<b>Unit selection:</b> -		
					<b>Not for motor type:</b> -		<b>Scaling:</b> -		<b>Expert list:</b> 1		
					<b>Min</b> -		<b>Max</b> -		<b>Factory setting</b> 0000 bin		
<b>Description:</b>					Setting to invert actual values.						
<b>Bit field:</b>					<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>		<b>0 signal</b>	<b>FP</b>	
					00	Invert speed actual value	Yes		No	4710	
					01	Invert position actual value	Yes		No	4704	
<b>Note:</b>					The inversion influences the following parameters: Bit 00: r0061, r0094 Bit 01: r0482, r0483						
<hr/>											
<b>p0411[0...n]</b>					<b>Measuring gear configuration / Meas gear config</b>						
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S					<b>Can be changed:</b> C2(4)		<b>Calculated:</b> -		<b>Access level:</b> 1		
					<b>Data type:</b> Unsigned32		<b>Dyn. index:</b> EDS, p0140		<b>Func. diagram:</b> 4704		
					<b>P-Group:</b> Encoder		<b>Units group:</b> -		<b>Unit selection:</b> -		
					<b>Not for motor type:</b> -		<b>Scaling:</b> -		<b>Expert list:</b> 1		
					<b>Min</b> -		<b>Max</b> -		<b>Factory setting</b> 0000 bin		
<b>Description:</b>					Sets the configuration for position tracking of a measuring gear.						
<b>Bit field:</b>					<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>		<b>0 signal</b>	<b>FP</b>	
					00	Measuring gear activate position tracking	Yes		No	-	
					01	Axis type	Linear axis		Rotary axis	-	
					02	Measuring gear reset position	Yes		No	-	
					03	Meas. gearbox, activate pos. tracking for incremental encoders	Yes		No	-	
<b>Notice:</b>					For p0411.3 = 1 the following applies: If position tracking is activated for incremental encoders, only the position actual value is stored. Axis or encoder motion is not detected when de-activated! Any tolerance window entered in p0413 has no effect.						
<b>Note:</b>					For the following events, the non-volatile, saved position values are automatically reset: - when an encoder replacement has been identified. - when changing the configuration of the Encoder Data Set (EDS).						



<b>p0412[0...n]</b>	<b>Measuring gear absolute encoder rotary revolutions virtual / Abs rot rev</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4) <b>Data type:</b> Unsigned32 <b>P-Group:</b> Encoder <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> EDS, p0140 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 4194303	<b>Access level:</b> 1 <b>Func. diagram:</b> 4704 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the number of rotations that can be resolved for a rotary encoder with activated position tracking of the measuring gear.		
<b>Dependency:</b>	This parameter is only of significance for an absolute encoder (p0404.1 = 1) with activated position tracking (p0411.0 = 1) and for an incremental encoder with activated position tracking (p0411.3 = 1).		
<b>Note:</b>	<p>The resolution that is set must be able to be represented using r0483.</p> <p>For rotary axes/modulo axes, the following applies:</p> <p>p0411.0 = 1: This parameter is pre-set with p0421 and can be changed.</p> <p>p0411.3 = 1: The parameter value is pre-set to the highest possible value. The highest possible value depends on the pulse number (p0408) and the fine resolution (p0419).</p> <p>For linear axes, the following applies:</p> <p>p0411.0 = 1: This parameter is pre-assigned with p0421, expanded by 6 bits for multiturn information (maximum number of overflows) and cannot be changed.</p> <p>p0411.3 = 1: The parameter value is pre-set to the highest possible value. The highest possible value depends on the pulse number (p0408) and the fine resolution (p0419).</p>		
<b>p0413[0...n]</b>	<b>Measuring gear position tracking tolerance window / Pos track window</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4) <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Encoder <b>Not for motor type:</b> - <b>Min</b> 0.00	<b>Calculated:</b> - <b>Dyn. index:</b> EDS, p0140 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 4294967300.00	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.00
<b>Description:</b>	<p>Sets a tolerance window for position tracking.</p> <p>After the system is powered up, the difference between the saved position and the actual position is determined, and depending on this, the following is initiated:</p> <p>Difference within the tolerance window --&gt; The position is reproduced as a result of the encoder actual value.</p> <p>Difference outside the tolerance window --&gt; An appropriate message is output.</p> <p>Rotation, e.g. through a complete encoder range is not detected.</p>		
<b>Caution:</b>			
			
<b>Note:</b>	<p>The value is entered in integer (complete) encoder pulses.</p> <p>For p0411.0 = 1, the value is automatically pre-assigned quarter of the encoder range.</p> <p>Example: Quarter of the encoder range = (p0408 * p0421) / 4</p> <p>It is possible that the tolerance window may not be able to be precisely set due to the data type (floating point number with 23 bit mantissa).</p>		

<b>p0414[0...n]</b>	<b>Redundant coarse position value relevant bits (identified) / Relevant bits</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4)	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> EDS, p0140	<b>Func. diagram:</b> -
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 16	<b>Factory setting</b> 16
<b>Description:</b>	Sets the number of relevant bits for the redundant coarse position value.		
<b>p0415[0...n]</b>	<b>Gx_XIST1 Coarse position safe most significant bit (identified) / Gx_XIST1 safe MSB</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4)	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> EDS, p0140	<b>Func. diagram:</b> -
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 31	<b>Factory setting</b> 14
<b>Description:</b>	Sets the bit number for the safe most significant bit (MSB) of the Gx_XIST1 coarse position.		
<b>Note:</b>	MSB: Most Significant Bit		
<b>p0416[0...n]</b>	<b>Non safety-relevant meas. steps position value pos1 (detected) / nsrPos1</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4)	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> EDS, p0140	<b>Func. diagram:</b> -
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 4294967295	<b>Factory setting</b> 22000
<b>Description:</b>	Sets the non safety-relevant measuring steps of POS1.		
<b>Dependency:</b>	Refer to: r0473		
<b>p0417[0...n]</b>	<b>Encoder safety comparison algorithm (detected) / Safety comp_algo</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4)	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> EDS, p0140	<b>Func. diagram:</b> -
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 255	<b>Factory setting</b> 255
<b>Description:</b>	Sets the comparison algorithm for the encoder position monitoring functions.		
<b>Value:</b>	0: SMx20 safety algorithm 10: DQL binary safety algorithm 11: DQL linear non-binary safety algorithm 12: SMC30 safety algorithm 255: Safety algorithm unknown		
<b>p0418[0...n]</b>	<b>Fine resolution Gx_XIST1 (in bits) / Enc fine Gx_XIST1</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4)	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned8	<b>Dyn. index:</b> EDS, p0140	<b>Func. diagram:</b> 1580, 4704
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 2	<b>Max</b> 18	<b>Factory setting</b> 11
<b>Description:</b>	Sets the fine resolution in bits of the incremental position actual values.		

**Note:** The parameter applies for the following process data:  
 - Gx\_XIST1  
 - Gx\_XIST2 for reference mark or flying measurement  
 The fine resolution specifies the fraction between two encoder pulses. Depending on the physical measurement principle, an encoder pulse can be broken down into a different number of fractions (e.g. squarewave encoder: 2 bit = resolution 4, sin/cos encoder: Typical 11 bit = resolution 2048).  
 For a squarewave encoder, with the factory setting, the least significant bits have the value zero, i.e. they do not supply any useful information.  
 For especially high quality measuring systems, the fine resolution must be increased corresponding to the available accuracy.

p0419[0...n]	Fine resolution absolute value Gx_XIST2 (in bits) / Enc fine Gx_XIST2		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4) <b>Data type:</b> Unsigned8 <b>P-Group:</b> Encoder <b>Not for motor type:</b> - <b>Min</b> 2	<b>Calculated:</b> - <b>Dyn. index:</b> EDS, p0140 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 18	<b>Access level:</b> 3 <b>Func. diagram:</b> 1580, 4704 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 9
<b>Description:</b>	Sets the fine resolution in bits of the absolute position actual values.		
<b>Dependency:</b>	Refer to: p0418		
<b>Note:</b>	This parameter applies to process data Gx_XIST2 when reading the absolute value.		

p0420[0...n]	Encoder connection / Enc_connection			
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4) <b>Data type:</b> Unsigned16 <b>P-Group:</b> Encoder <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> EDS, p0140 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0000 bin	
<b>Description:</b>	Selecting the encoder connection.			
<b>Bit field:</b>	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>
	00	SUB-D	Yes	No
	01	Terminal	Yes	No
				<b>FP</b>
				-
				-

p0421[0...n]	Absolute encoder rotary multiturn resolution / Enc abs multiturn		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4) <b>Data type:</b> Unsigned16 <b>P-Group:</b> Encoder <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> EDS, p0140 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 65535	<b>Access level:</b> 3 <b>Func. diagram:</b> 4704 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 4096
<b>Description:</b>	Sets the number of rotations that can be resolved for a rotary absolute encoder.		
<b>Caution:</b>	This parameter is automatically pre-set for encoders from the encoder list (p0400). When selecting a catalog encoder, this parameter cannot be changed (write protection). Information in p0400 should be carefully observed when removing write protection.		

<b>p0422[0...n]</b>	<b>Absolute encoder linear measuring step resolution / Enc abs meas step</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4)	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> EDS, p0140	<b>Func. diagram:</b> 4704
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0 [nm]	<b>Max</b> 4294967295 [nm]	<b>Factory setting</b> 100 [nm]
<b>Description:</b>	Sets the resolution of the absolute position for a linear absolute encoder.		
<b>Caution:</b>	This parameter is automatically pre-set for encoders from the encoder list (p0400). When selecting a catalog encoder, this parameter cannot be changed (write protection). Information in p0400 should be carefully observed when removing write protection.		
<b>Note:</b>	The serial protocol of an absolute encoder provides the position with a certain resolution , e.g. 100 nm. This value must be entered here.		
<b>p0423[0...n]</b>	<b>Absolute encoder rotary singleturn resolution / Enc abs singleturn</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4)	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> EDS, p0140	<b>Func. diagram:</b> 4704
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 1073741823	<b>Factory setting</b> 8192
<b>Description:</b>	Sets the number of measuring steps per revolution for a rotary absolute encoder. The resolution refers to the absolute position.		
<b>Caution:</b>	This parameter is automatically pre-set for encoders from the encoder list (p0400). When selecting a catalog encoder, this parameter cannot be changed (write protection). Information in p0400 should be carefully observed when removing write protection.		
<b>p0424[0...n]</b>	<b>Encoder linear zero mark distance / Enc lin ZM_dist</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4)	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> EDS, p0140	<b>Func. diagram:</b> -
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0 [mm]	<b>Max</b> 65535 [mm]	<b>Factory setting</b> 20 [mm]
<b>Description:</b>	Sets the distance between two zero marks for a linear encoder. This information is used for zero mark monitoring.		
<b>Caution:</b>	This parameter is automatically pre-set for encoders from the encoder list (p0400). When selecting a catalog encoder, this parameter cannot be changed (write protection). Information in p0400 should be carefully observed when removing write protection.		
<b>Note:</b>	For distance-coded zero marks, this means the basic distance.		
<b>p0425[0...n]</b>	<b>Encoder rotary zero mark distance / Enc rot dist ZM</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4)	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> EDS, p0140	<b>Func. diagram:</b> 4704, 8570
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 16777215	<b>Factory setting</b> 2048
<b>Description:</b>	Sets the distance in pulses between two zero marks for a rotary encoder. This information is used for zero mark monitoring.		
<b>Caution:</b>	This parameter is automatically pre-set for encoders from the encoder list (p0400). When selecting a catalog encoder, this parameter cannot be changed (write protection). Information in p0400 should be carefully observed when removing write protection.		
<b>Note:</b>	For distance-coded zero marks, this means the basic distance.		

<b>p0426[0...n]</b>		<b>Encoder zero mark differential distance / Enc ZM Dif_dist</b>				
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4) <b>Data type:</b> Unsigned16 <b>P-Group:</b> Encoder <b>Not for motor type:</b> - <b>Min</b> 1	<b>Calculated:</b> - <b>Dyn. index:</b> EDS, p0140 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 65535	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1			
<b>Description:</b>		Sets the differential distance with distance-coded zero marks [signal periods]. The value corresponds to jump displacement of "zero mark with interference".				
<b>Caution:</b>		This parameter is automatically pre-set for encoders from the encoder list (p0400). When selecting a catalog encoder, this parameter cannot be changed (write protection). Information in p0400 should be carefully observed when removing write protection.				
<b>p0427[0...n]</b>		<b>Encoder SSI baud rate / Enc SSI baud rate</b>				
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4) <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Encoder <b>Not for motor type:</b> - <b>Min</b> 0 [kHz]	<b>Calculated:</b> - <b>Dyn. index:</b> EDS, p0140 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 65535 [kHz]	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 100 [kHz]			
<b>Description:</b>		Sets the baud rate for an SSI encoder.				
<b>Notice:</b>		This parameter is automatically pre-set for encoders from the encoder list (p0400). When selecting a catalog encoder, this parameter cannot be changed (write protection). Information in p0400 should be carefully observed when removing write protection.				
<b>Note:</b>		SSI: Synchronous Serial Interface				
<b>p0428[0...n]</b>		<b>Encoder SSI monoflop time / Enc SSI t_monoflop</b>				
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4) <b>Data type:</b> Unsigned16 <b>P-Group:</b> Encoder <b>Not for motor type:</b> - <b>Min</b> 0 [µs]	<b>Calculated:</b> - <b>Dyn. index:</b> EDS, p0140 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 65535 [µs]	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 30 [µs]			
<b>Description:</b>		Sets the minimum delay time between two data transfers of the absolute value for an SSI encoder.				
<b>Notice:</b>		This parameter is automatically pre-set for encoders from the encoder list (p0400). When selecting a catalog encoder, this parameter cannot be changed (write protection). Information in p0400 should be carefully observed when removing write protection.				
<b>p0429[0...n]</b>		<b>Encoder SSI configuration / Enc SSI config</b>				
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4) <b>Data type:</b> Unsigned16 <b>P-Group:</b> Encoder <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> EDS, p0140 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0000 0000 bin			
<b>Description:</b>		Sets the configuration for an SSI encoder.				
<b>Bit field:</b>		<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>	<b>FP</b>
		00	Transfer code	Binary code	Gray code	-
		02	Transfer absolute value twice	Yes	No	-
		06	Data line during the monoflop time	High level	Low level	-
<b>Caution:</b>		This parameter is automatically pre-set for encoders from the encoder list (p0400). When selecting a catalog encoder, this parameter cannot be changed (write protection). Information in p0400 should be carefully observed when removing write protection.				

**Note:** Re bit 06:  
The quiescent signal level of the data line corresponds to the inverted, set level.

p0430[0...n]	Sensor Module configuration / SM config		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4)	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> EDS, p0140	<b>Func. diagram:</b> -
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	1110 0000 0000 1000 0000 0000 0000 0000 bin

**Description:** Sets the configuration of the Sensor Module.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	17	Burst oversampling	Yes	No	-
	18	Continuous oversampling (reserved)	Yes	No	-
	19	Safety position actual value sensing	Yes	No	-
	20	Speed calculation mode (only SMC30)	Incremental diff	Flank time meas	-
	21	Zero mark tolerance	Yes	No	-
	22	Rot pos adapt	Yes	No	-
	23	De-select commutation with zero mark	Yes	No	-
	24	Commutation with selected zero mark	Yes	No	-
	25	Switch off encoder voltage supply during parking	Yes	No	-
	27	Extrapolate position values	Yes	No	-
	28	Cubic correction	Yes	No	-
	29	Phase correction	Yes	No	-
	30	Amplitude correction	Yes	No	-
	31	Offset correction	Yes	No	-

**Notice:** A bit-wise configuration is only possible if the corresponding property is also present in r0458.

**Note:** Re bit 17 (burst oversampling):  
- if bit = 1, burst oversampling is switched on.

Re bit 18 (continuous oversampling):  
- if bit = 1, continuous oversampling is switched on.

Re bit 19 (Safety position actual value sensing):  
- if bit = 1, the Safety position actual value is transferred in the cyclic telegram.

Re bit 20 (speed calculation mode):  
- if bit = 1, the speed is calculated via incremental difference without extrapolation.  
- if bit = 0, the speed is calculated via edge time measurement with extrapolation. p0453 is effective in this mode.

Re bit 21 (zero mark tolerance):  
- if bit = 1, a one-off zero mark distance error is tolerated. In the event of a defect, the fault F3x100/F3x101 does not appear, but alarm A3x400/A3x401 does.

Re bit 22 (rotor position adaptation):  
- if bit = 1, the rotor position is corrected automatically. The correction speed is +/-1/4 encoder pulse per zero mark distance.

Re bit 23 (de-select commutation with zero mark):  
- The bit should only be set for encoders that have not been adjusted.

Re bit 24 (commutation with selected zero mark):  
- if bit = 1, the commutation position is corrected via a selected zero mark.

Re bit 25 (disconnect the encoder power supply on parking):  
- if bit = 1, the encoder power supply is switched off on parking (0 V).  
- if bit = 0, the encoder power supply is not switched off on parking, it is reduced from 24 V to 5 V.

Re bit 27 (extrapolate position values):  
- if bit = 1, the extrapolation of the position values is activated.

Re bit 28 (cubic correction):  
- if bit = 1, the cubic correction for track A/B sine is activated.

Re bit 29 (phase correction):

- if bit = 1, the phase correction for track A/B sine is activated.

Re bit 30 (amplitude correction):

- if bit = 1, the amplitude correction for track A/B sine is activated.

Re bit 31 (offset correction):

- if bit = 1, the offset correction for track A/B sine is activated.

<b>p0431[0...n]</b>	<b>Angular commutation offset / Ang_com offset</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4)	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> EDS, p0140	<b>Func. diagram:</b> -
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> -180.00 [°]	<b>Max</b> 180.00 [°]	<b>Factory setting</b> 0.00 [°]
<b>Description:</b>	Sets the angular commutation offset.		
<b>Notice:</b>	The angular commutation offset cannot be generally taken from other drive systems.		
<b>Note:</b>	Angular commutation offset, angular difference between electrical position of encoder and flux position. For p0404.5 = 1 (track C/D) the following applies: The angular offset in p0431 acts on track A/B, the zero mark on track C/D. For p0404.6 = 1 (Hall sensor) the following applies: The angular offset in p0431 acts on track A/B and the zero mark.		
<b>p0432[0...n]</b>	<b>Gearbox factor encoder revolutions / Grbx_fact enc_rev</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4)	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> EDS, p0140	<b>Func. diagram:</b> 4704, 4710, 4711
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 1	<b>Max</b> 10000	<b>Factory setting</b> 1
<b>Description:</b>	Sets the encoder revolutions for the gearbox factor of the encoder evaluation. The gearbox factor specifies the ratio between the encoder shaft and motor shaft (for motor encoders) or between the encoder shaft and the load.		
<b>Dependency:</b>	This parameter can only be set for p0402 = 9999. Refer to: p0402, p0410, p0433		
<b>Note:</b>	Negative gearbox factors should be implemented with p0410.		
<b>p0433[0...n]</b>	<b>Gearbox factor motor/load revolutions / Grbx_fact mot_rev</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4)	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> EDS, p0140	<b>Func. diagram:</b> 4704, 4710, 4711
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 1	<b>Max</b> 10000	<b>Factory setting</b> 1
<b>Description:</b>	Sets the motor and load revolutions for the gearbox factor of the encoder evaluation. The gearbox factor specifies the ratio between the encoder shaft and motor shaft (for motor encoders) or between the encoder shaft and the load.		
<b>Dependency:</b>	This parameter can only be set for p0402 = 9999. Refer to: p0402, p0410, p0432		
<b>Note:</b>	Negative gearbox factors should be implemented with p0410.		

<b>p0434[0...n]</b>	<b>Encoder SSI error bit / Enc SSI error bit</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4)	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> EDS, p0140	<b>Func. diagram:</b> -
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 65535	<b>Factory setting</b> 0
<b>Description:</b>	Sets the position and level of the error bit in the SSI protocol.		
<b>Notice:</b>	The bit may only be positioned before (p0446) or after (p0448) the absolute value in the SSI protocol.		
<b>Note:</b>	Value = dcba ba: Position of the error bit in the protocol (0 ... 63). c: Level (0: Low level, 1: High level). d: Status of the evaluation (0: Off, 1: On with 1 error bit, 2: On with 2 error bits ... 9: On with 9 error bits). For several error error bits, the following applies: - the position specified under ba and the additional bits are assigned increasing consecutively. - the level set under c applies to all error bits. Example: p0434 = 1013 --> The evaluation is switched in and the error bit is at position 13 with a low level. p0434 = 1113 --> The evaluation is switched in and the error bit is at position 13 with a high level.		

<b>p0435[0...n]</b>	<b>Encoder SSI alarm bit / Enc SSI alarm bit</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4)	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> EDS, p0140	<b>Func. diagram:</b> -
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 65535	<b>Factory setting</b> 0
<b>Description:</b>	Sets the position and level of the alarm bit in the SSI protocol.		
<b>Notice:</b>	The bit may only be positioned before (p0446) or after (p0448) the absolute value in the SSI protocol.		
<b>Note:</b>	Value = dcba ba: Position of the alarm bit in protocol (0 ... 63). c: Level (0: Low level, 1: High level). d: State of the evaluation (0: Off, 1: On). Example: p0435 = 1014 --> The evaluation is switched in and the alarm bit is at position 14 with a low level. p0435 = 1114 --> The evaluation is switched in and the alarm bit is at position 14 with a high level.		

<b>p0436[0...n]</b>	<b>Encoder SSI parity bit / Enc SSI parity bit</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4)	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> EDS, p0140	<b>Func. diagram:</b> -
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 65535	<b>Factory setting</b> 0
<b>Description:</b>	Sets the position and parity of the parity bit in the SSI protocol.		
<b>Notice:</b>	The bit may only be positioned before (p0446) or after (p0448) the absolute value in the SSI protocol.		



**Note:** Value = dcba  
ba: Position of the parity bit in the protocol (0 ... 63).  
c: Parity (0: even, 1: uneven).  
d: State of the evaluation (0: Off, 1: On).  
Example:  
p0436 = 1015  
--> The evaluation is switched in and the parity bit is at position 15 with even parity.  
p0436 = 1115  
--> The evaluation is switched in and the parity bit is at position 15 with uneven parity.

p0437[0...n]	Sensor Module configuration extended / SM config ext		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4) <b>Data type:</b> Unsigned32 <b>P-Group:</b> Encoder <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> EDS, p0140 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0011 0000 0000 0000 0000 1000 0000 0000 bin

**Description:** Sets the extended configuration of the Sensor Module.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Data logger	Yes	No	-
	01	Zero mark edge detection	Yes	No	-
	02	Correction position actual value XIST1	Yes	No	-
	04	Edge evaluation bit 0	Yes	No	-
	05	Edge evaluation bit 1	Yes	No	-
	06	Freeze the speed actual value for dn/dt errors	Yes	No	-
	07	Accumulate uncorrected encoder pulses	Yes	No	-
	11	Fault handling after PROFIdrive	Yes	No	-
	12	Activate additional messages	Yes	No	-
	13	Support absolute position for incremental encoder	Yes	No	4750
	25	Deselect monitoring multiturn representation in Gx_XIST2	Yes	No	-
	26	Deselect track monitoring	Yes	No	-
	28	EnDat linear encoder monitoring incremental/absolute	Yes	No	-
	29	EnDat encoder initialization with high accuracy	Yes	No	-
	31	Analog unipolar track monitoring	Yes	No	-

**Dependency:** Refer to: p0430, r0459

**Note:** A value of zero is displayed if an encoder is not present.  
Re bit 00:  
When the data logger (trace) is activated, in the case of a fault, data before and after the event are recorded (traced) and saved in files on the non-volatile memory medium. Experts can then evaluate this data.  
Re bit 01:  
If bit = 0, the zero mark is evaluated by ANDing tracks A and B and the zero mark.  
For bit = 1, the zero mark is evaluated depending on the direction of rotation detected. For a positive direction of rotation, the positive edge of the zero mark is considered and for a negative direction of rotation, the negative edge of the zero mark.  
Re bit 02:  
If the bit is set, in the event of a deviation less than the tolerance window for the zero mark (p4681, p4682), the pulses per revolution are corrected. If the bit is not set, encoder fault F3x131 is triggered.

Re Bit 04 and Bit 05:

The actual hardware only supports 1x or 4x signal evaluation.

Bit 5/4 = 0/0: Signal evaluation per period, 4x.

Bit 5/4 = 1/0: Illegal setting.

Bit 5/4 = 0/1: Signal evaluation per period, 1x.

Bit 5/4 = 1/1: Illegal setting.

Re bit 06:

If the function is active, when dn/dt monitoring responds, the speed actual value is internally frozen for a time equivalent to two current controller clock cycles. The rotor position continues to be integrated. The actual value is then re-enabled after this time has expired.

Re bit 07:

If the bit is set, the encoder pulses which have not been corrected are added to p4688 at the zero mark.

Re bit 11:

If the bit is set, the Sensor Module checks within a certain time grid whether the fault cause is still present. This enables the Sensor Module to switch from the fault state to the operating state and provide valid actual values automatically. The faults are displayed until the user acknowledges them.

Re bit 12:

Additional fault messages can be activated for extended fault diagnostics.

Re bit 13:

When the bit is set, for an incremental encoder with zero mark, the absolute value in Gn\_XIST2 can be requested via Gn\_STW.13.

Re bit 26:

Track monitoring is de-activated for the square-wave encoders when the bit is set, even if the monitoring function is selected in p0405.2.

Re bit 28:

Monitoring of the difference between incremental and absolute position in the case of linear encoders.

Re bit 29:

When the bit is set, the EnDat encoder is initialized under a certain speed and, therefore, with high accuracy. If initialization at a higher speed is requested, fault F31151, F32151, or F33151 is output.

Re bit 31:

When monitoring is active, the levels of the individual track signals and the corresponding inverted track signals are monitored separately.

<b>p0438[0...n] Squarewave encoder filter time / Enc t_filt</b>			
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4) <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Encoder <b>Not for motor type:</b> - <b>Min</b> 0.00 [µs] <b>Max</b> 100.00 [µs]	<b>Calculated:</b> - <b>Dyn. index:</b> EDS, p0140 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 100.00 [µs]	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.64 [µs]
<b>Description:</b>	Sets the filter time for a squarewave encoder. The hardware of the squarewave encoder only supports the following values: 0: No filtering 0.04 µs 0.64 µs 2.56 µs 10.24 µs 20.48 µs		
<b>Dependency:</b>	Refer to: r0452		
<b>Notice:</b>	If the filter time is too long, the track signals A/B/R may be suppressed and the appropriate messages output.		
<b>Note:</b>	The most suitable filter time depends on the number of pulses and maximum speed of the square-wave encoder. The filter time is automatically corrected to the next value when entering a non-specified value. In this case, no message is output. The effective filter time is displayed in r0452.		

<b>p0439[0...n]</b>	<b>Encoder ramp-up time / Enc ramp-up time</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4) <b>Data type:</b> Unsigned16 <b>P-Group:</b> Encoder <b>Not for motor type:</b> - <b>Min</b> 0 [ms]	<b>Calculated:</b> - <b>Dyn. index:</b> EDS, p0140 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 65535 [ms]	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0 [ms]
<b>Description:</b>	Sets the ramp-up time for the encoder. The encoder supplies stable track signals once this time has elapsed.		
<b>Notice:</b>	This parameter is automatically pre-set for encoders from the encoder list (p0400).		
<b>p0440[0...n]</b>	<b>Copy encoder serial number / Copy enc ser_no</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4) <b>Data type:</b> Integer16 <b>P-Group:</b> Encoder <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> EDS, p0140 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Copies the actual serial number of the encoder belonging to this Encoder Data Set (EDS) to p0441 ... p0445. Example: For p0440[0] = 1, the serial number of the encoder belonging EDS0 is copied to p0441[0] ... p0445[0].		
<b>Value:</b>	0: No action 1: Transfer serial number		
<b>Dependency:</b>	Refer to: p0441, p0442, p0443, p0444, p0445, r0460, r0461, r0462, r0463, r0464		
<b>Note:</b>	For encoders with serial number, encoder replacement is monitored in order to request angular commutation calibration (adjustment) for motor encoders and absolute calibration for direct measuring systems with absolute value data. The serial number, which from then onwards is used for monitoring purposes, can be transferred using p0440. In the following cases, copying is automatically started in the following cases: 1.) When commissioning 1FT6, 1FK6, 1FK7 motors. 2.) When writing into p0431. 3.) For p1990 = 1. p0440 is automatically set to 0 when the copying has been completed. In order to permanently accept the copied values, it is necessary to save in a non-volatile fashion (p0977).		
<b>p0441[0...n]</b>	<b>Encoder commissioning serial number part 1 / Enc comm ser_no 1</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4) <b>Data type:</b> Unsigned32 <b>P-Group:</b> Encoder <b>Not for motor type:</b> - <b>Min</b> 0000 hex	<b>Calculated:</b> CALC_MOD_ALL <b>Dyn. index:</b> EDS, p0140 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> FFFF FFFF hex	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0000 hex
<b>Description:</b>	Serial number part 1 of the encoder for the commissioning.		
<b>Dependency:</b>	Refer to: p0440, p0442, p0443, p0444, p0445, r0460, r0461, r0462, r0463, r0464		
<b>Note:</b>	A value of zero is displayed if an encoder is not present.		

<b>p0442[0...n]</b>	<b>Encoder commissioning serial number part 2 / Enc comm ser_no 2</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4)	<b>Calculated:</b> CALC_MOD_ALL	<b>Access level:</b> 4
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> EDS, p0140	<b>Func. diagram:</b> -
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0000 hex	<b>Max</b> FFFF FFFF hex	<b>Factory setting</b> 0000 hex
<b>Description:</b>	Serial number part 2 of the encoder for the commissioning.		
<b>Dependency:</b>	Refer to: p0440, p0441, p0443, p0444, p0445, r0460, r0461, r0462, r0463, r0464		
<b>Note:</b>	A value of zero is displayed if an encoder is not present.		
<b>p0443[0...n]</b>	<b>Encoder commissioning serial number part 3 / Enc comm ser_no 3</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4)	<b>Calculated:</b> CALC_MOD_ALL	<b>Access level:</b> 4
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> EDS, p0140	<b>Func. diagram:</b> -
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0000 hex	<b>Max</b> FFFF FFFF hex	<b>Factory setting</b> 0000 hex
<b>Description:</b>	Serial number part 3 of the encoder for the commissioning.		
<b>Dependency:</b>	Refer to: p0440, p0441, p0442, p0444, p0445, r0460, r0461, r0462, r0463, r0464		
<b>Note:</b>	A value of zero is displayed if an encoder is not present.		
<b>p0444[0...n]</b>	<b>Encoder commissioning serial number part 4 / Enc comm ser_no 4</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4)	<b>Calculated:</b> CALC_MOD_ALL	<b>Access level:</b> 4
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> EDS, p0140	<b>Func. diagram:</b> -
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0000 hex	<b>Max</b> FFFF FFFF hex	<b>Factory setting</b> 0000 hex
<b>Description:</b>	Serial number part 4 of the encoder for the commissioning.		
<b>Dependency:</b>	Refer to: p0440, p0441, p0442, p0443, p0445, r0460, r0461, r0462, r0463, r0464		
<b>Note:</b>	A value of zero is displayed if an encoder is not present.		
<b>p0445[0...n]</b>	<b>Encoder commissioning serial number part 5 / Enc comm ser_no 5</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4)	<b>Calculated:</b> CALC_MOD_ALL	<b>Access level:</b> 4
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> EDS, p0140	<b>Func. diagram:</b> -
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0000 hex	<b>Max</b> FFFF FFFF hex	<b>Factory setting</b> 0000 hex
<b>Description:</b>	Serial number part 5 of the encoder for the commissioning.		
<b>Dependency:</b>	Refer to: p0440, p0441, p0442, p0443, p0444, r0460, r0461, r0462, r0463, r0464		
<b>Note:</b>	A value of zero is displayed if an encoder is not present.		

© Siemens AG 2009 - 2013 All Rights Reserved  
SINAMICS DCM List Manual (LH8), 06/2013, 6RX1800-0ED76

15	Commutation with zero mark (not ASM)	Yes	No	-
16	Acceleration	Yes	No	-
17	Track A/B analog	Yes	No	-
20	Voltage level 5 V	Yes	No	-
21	Voltage level 24 V	Yes	No	-
22	Remote sense (only SMC30)	Yes	No	-
23	Resolver excit.	Yes	No	-

**Dependency:** Refer to: p0404

**Note:** ZM: Zero mark

This parameter is only used for diagnostics.

A value of zero is displayed if an encoder is not present.

Re bit 20, 21 (voltage level 5 V, voltage level 24 V):

The voltage level cannot be detected. Therefore, these bits are always set to 0.

---

### r0456[0...2] Encoder configuration supported / Enc\_config supp

DC\_CTRL,  
DC\_CTRL\_R,  
DC\_CTRL\_R\_S,  
DC\_CTRL\_S

**Can be changed:** -

**Calculated:** -

**Access level:** 3

**Data type:** Unsigned32

**Dyn. index:** -

**Func. diagram:** -

**P-Group:** Encoder

**Units group:** -

**Unit selection:** -

**Not for motor type:** -

**Scaling:** -

**Expert list:** 1

**Min**

**Max**

**Factory setting**

-

-

-

**Description:** Displays the encoder configuration supported by the Sensor Module.

**Index:**  
[0] = Encoder 1  
[1] = Encoder 2  
[2] = -

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Linear encoder	Yes	No	-
	01	Absolute encoder	Yes	No	-
	02	Multiturn encoder	Yes	No	-
	03	Track A/B sq-wave	Yes	No	-
	04	Track A/B sine	Yes	No	-
	05	Track C/D	Yes	No	-
	06	Hall sensor	Yes	No	-
	08	EnDat encoder	Yes	No	-
	09	SSI encoder	Yes	No	-
	10	DRIVE-CLiQ encoder	Yes	No	-
	11	Digital encoder	Yes	No	-
	12	Equidistant zero mark	Yes	No	-
	13	Irregular zero mark	Yes	No	-
	14	Distance-coded zero mark	Yes	No	-
	15	Commutation with zero mark (not ASM)	Yes	No	-
	16	Acceleration	Yes	No	-
	17	Track A/B analog	Yes	No	-
	20	Voltage level 5 V	Yes	No	-
	21	Voltage level 24 V	Yes	No	-
	22	Remote sense (only SMC30)	Yes	No	-
	23	Resolver excit.	Yes	No	-

**Dependency:** Refer to: p0404

**Note:** ZM: Zero mark

This parameter is only used for diagnostics.

A value of zero is displayed if an encoder is not present.

r0458[0...2]		Sensor Module properties / SM properties			
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -		<b>Calculated:</b> -		<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32		<b>Dyn. index:</b> -		<b>Func. diagram:</b> 4704
	<b>P-Group:</b> Encoder		<b>Units group:</b> -		<b>Unit selection:</b> -
	<b>Not for motor type:</b> -		<b>Scaling:</b> -		<b>Expert list:</b> 1
	<b>Min</b>		<b>Max</b>		<b>Factory setting</b>
	-		-		-
<b>Description:</b>	Sets the Sensor Module configuration.				
<b>Index:</b>	[0] = Encoder 1 [1] = Encoder 2 [2] = -				
<b>Bit field:</b>	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>	<b>FP</b>
	00	Encoder data available	Yes	No	-
	01	Motor data available	Yes	No	-
	02	Temperature sensor connection available	Yes	No	-
	03	Connection for PTC for motor with DRIVE-CLiQ also available	Yes	No	-
	04	Module temperature available	Yes	No	-
	05	Absolute encoder p0408/p0421 no power of 2	Yes	No	-
	06	Sensor Module permits parking/unparking	Yes	No	-
	07	Hall sensor can be combined with actual value inversion	Yes	No	-
	08	Evaluation through several temperature channels possible	Yes	No	-
	09	Encoder fault and its associated information available	Yes	No	-
	10	Speed diagnostics in the Sensor Module	Yes	No	-
	11	Configuring without park state possible	Yes	No	-
	12	Extended functions available	Yes	No	-
	13	Extended encoder fault handling	Yes	No	-
	14	Extended singleturn/multiturn information available	Yes	No	-
	15	Valuation figures available	Yes	No	-
	16	Pole position identification	Yes	No	-
	17	Burst oversampling	Yes	No	-
	18	Continuous oversampling	Yes	No	-
	19	Safety position actual value sensing	Yes	No	-
	20	Extended speed calculation being used (only SMC30)	Yes	No	-
	21	Zero mark tolerance	Yes	No	-
	22	Rot pos adapt	Yes	No	-
	23	Commutation with zero mark can be de-selected	Yes	No	-
	24	Commutation with selected zero mark	Yes	No	-
	25	Disconnection of encoder power supply on parking supported	Yes	No	-
	26	Parking with temperature evaluation	Yes	No	-
	27	SSI position value extrapolation	Yes	No	-
	28	Cubic correction	Yes	No	-
	29	Phase correction	Yes	No	-
	30	Amplitude correction	Yes	No	-
	31	Offset correction	Yes	No	-
<b>Dependency:</b>	Refer to: p0437, p0601				
<b>Note:</b>	A value of zero is displayed if an encoder is not present. Re bit 11: When the property is set, the following parameters can be changed without the actual value in the encoder interface becoming invalid (state r0481.14 = 1 "parking encoder active"): p0314, p0315, p0430, p0431, p0441, p0442, p0443, p0444, p0445				

Re bit 12:

The extended functions can be configured using p0437.

Re bit 13:

Encoder faults can be acknowledged via Gn\_STW.15.

Re bit 14:

Only for internal Siemens use.

Re bit 23:

When the property is set, commutation with zero mark can be de-selected using p0430.23.

Re bit 24:

If the property is set, commutation to the selected zero mark can be carried out.

r0459[0...2]		Sensor Module properties extended / SM prop ext				
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -		<b>Calculated:</b> -		<b>Access level:</b> 3	
	<b>Data type:</b> Unsigned32		<b>Dyn. index:</b> -		<b>Func. diagram:</b> -	
	<b>P-Group:</b> Encoder		<b>Units group:</b> -		<b>Unit selection:</b> -	
	<b>Not for motor type:</b> -		<b>Scaling:</b> -		<b>Expert list:</b> 1	
	<b>Min</b>		<b>Max</b>		<b>Factory setting</b>	
	-		-		-	
<b>Description:</b>		Displays the extended properties supported by the Sensor Module.				
<b>Index:</b>		[0] = Encoder 1 [1] = Encoder 2 [2] = -				
<b>Bit field:</b>		<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>	<b>FP</b>
	00	Data logger	Yes	No	-	
	01	Zero mark edge detection	Yes	No	-	
	02	Correction position actual value XIST1	Yes	No	-	
	04	Edge evaluation bit 0	Yes	No	-	
	05	Edge evaluation bit 1	Yes	No	-	
	06	Freeze the speed actual value for dn/dt errors	Yes	No	-	
	07	Accumulate uncorrected encoder pulses	Yes	No	-	
	09	Function p0426, p0439 supported	Yes	No	-	
	10	Pulse/direction interface	Yes	No	-	
	11	Fault handling after PROFIdrive	Yes	No	-	
	12	Activate additional messages	Yes	No	-	
	13	Absolute position for incremental encoder supported	Yes	No	-	
	14	Spindle functionality	Yes	No	-	
	15	Additional temperature sensor available	Yes	No	-	
	16	Internal encoder temperature available	Yes	No	-	
	25	Deselect monitoring multiturn representation in Gx_XIST2	Yes	No	-	
	26	Track monitoring de-selection	Yes	No	-	
	28	EnDat linear encoder monitoring incremental/absolute	Yes	No	-	
	29	EnDat encoder initialization with high accuracy	Yes	No	-	
	31	Analog unipolar track monitoring	Yes	No	-	
<b>Dependency:</b>		Refer to: p0437				
<b>Note:</b>		A value of zero is displayed if an encoder is not present.				
		Re bit 09:				
		Parameter p0426 or p0439 has been modified. These functions are not supported by the connected Sensor Module.				



<b>r0460[0...2]</b>	<b>Encoder serial number part 1 / Enc ser_no 1</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> Encoder <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the actual serial number part 1 of the appropriate encoder.		
<b>Index:</b>	[0] = Encoder 1 [1] = Encoder 2 [2] = -		
<b>Dependency:</b>	Refer to: p0441, p0442, p0443, p0444, p0445, r0461, r0462, r0463, r0464		
<b>r0461[0...2]</b>	<b>Encoder serial number part 2 / Enc ser_no 2</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> Encoder <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the actual serial number part 2 of the appropriate encoder.		
<b>Index:</b>	[0] = Encoder 1 [1] = Encoder 2 [2] = -		
<b>Dependency:</b>	Refer to: p0441, p0442, p0443, p0444, p0445, r0460, r0462, r0463, r0464		
<b>r0462[0...2]</b>	<b>Encoder serial number part 3 / Enc ser_no 3</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> Encoder <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the actual serial number part 3 of the appropriate encoder.		
<b>Index:</b>	[0] = Encoder 1 [1] = Encoder 2 [2] = -		
<b>Dependency:</b>	Refer to: p0441, p0442, p0443, p0444, p0445, r0460, r0461, r0463, r0464		
<b>r0463[0...2]</b>	<b>Encoder serial number part 4 / Enc ser_no 4</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> Encoder <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the actual serial number part 4 of the appropriate encoder.		
<b>Index:</b>	[0] = Encoder 1 [1] = Encoder 2 [2] = -		
<b>Dependency:</b>	Refer to: p0441, p0442, p0443, p0444, p0445, r0460, r0461, r0462, r0464		

**r0464[0...2] Encoder serial number part 5 / Enc ser\_no 5**

DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the actual serial number part 5 of the appropriate encoder.

**Index:**  
[0] = Encoder 1  
[1] = Encoder 2  
[2] = -

**Dependency:** Refer to: p0441, p0442, p0443, p0444, p0445, r0460, r0461, r0462, r0463

**r0465[0...27] Encoder 1 identification number/serial number / Enc1 ID\_no/Ser\_no**

DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned8	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the identification/serial number of encoder 1.

Index 0 = first character of the identification number

...

Index x = 20 hex (blank) --> separation between the identification number of serial number

Index x + 1 = 2F hex (slash) --> separation between the identification number of serial number

Index x + 2 = 20 hex (blank) --> separation between the identification number of serial number

Index x + 3 = first character of the serial number

...

Index y with contents = last character of the serial number

**Dependency:** Refer to: r0460, r0461, r0462, r0463, r0464

**Notice:** An ASCII table (excerpt) can be found, for example, in the appendix to the List Manual.

**Note:** The individual characters of the identification number/serial number are available coded as ASCII characters.

**r0466[0...27] Encoder 2 identification number/serial number / Enc2 ID\_no/Ser\_no**

DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned8	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the identification/serial number of encoder 2.

Index 0 = first character of the identification number

...

Index x = 20 hex (blank) --> separation between the identification number of serial number

Index x + 1 = 2F hex (slash) --> separation between the identification number of serial number

Index x + 2 = 20 hex (blank) --> separation between the identification number of serial number

Index x + 3 = first character of the serial number

...

Index y with contents = last character of the serial number

**Dependency:** Refer to: r0460, r0461, r0462, r0463, r0464

**Notice:** An ASCII table (excerpt) can be found, for example, in the appendix to the List Manual.

**Note:** The individual characters of the identification number/serial number are available coded as ASCII characters.

<b>r0469[0...2]</b>	<b>Absolute encoder linear measuring step / Enc lin meas step</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> Encoder <b>Not for motor type:</b> - <b>Min</b> - [nm]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> - [nm]	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [nm]
<b>Description:</b>	Displays the resolution of the absolute position for a linear absolute encoder.		
<b>Index:</b>	[0] = Encoder 1 [1] = Encoder 2 [2] = Encoder 3		
<b>Dependency:</b>	Refer to: p0422		

<b>r0470[0...2]</b>	<b>Redundant coarse position value valid bits / Valid bits</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned16 <b>P-Group:</b> Encoder <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the valid bits of the redundant coarse position value.		
<b>Index:</b>	[0] = Encoder 1 [1] = Encoder 2 [2] = -		

<b>r0471[0...2]</b>	<b>Redundant coarse position value fine resolution bits / Fine bit</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> Integer16 <b>P-Group:</b> Encoder <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the number of valid bits for the fine resolution of the redundant coarse position value.		
<b>Index:</b>	[0] = Encoder 1 [1] = Encoder 2 [2] = -		

<b>r0472[0...2]</b>	<b>Redundant coarse position value relevant bits / Relevant bits</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned16 <b>P-Group:</b> Encoder <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the number of relevant bits for the redundant coarse position value.		
<b>Index:</b>	[0] = Encoder 1 [1] = Encoder 2 [2] = -		

<b>r0473[0...2]</b>	<b>Non safety-relevant measuring steps position value pos1 / nsrPos1</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays the non safety-relevant measuring steps of POS1.		
<b>Index:</b>	[0] = Encoder 1 [1] = Encoder 2 [2] = Encoder 3		
<b>Dependency:</b>	Refer to: p0416		

<b>r0474[0...2]</b>	<b>Redundant coarse position value configuration / Red pos config</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays the encoder configuration for the redundant coarse position value.		
<b>Index:</b>	[0] = Encoder 1 [1] = Encoder 2 [2] = -		
<b>Bit field:</b>	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>
	00	Incrementer	Yes
	01	Encoder CRC least significant byte first	Yes
	02	Redundant coarse position val. most significant bit left-aligned	Yes
	04	Binary comparison not possible	Yes
			<b>0 signal</b>
			No
			<b>FP</b>
			-

<b>r0475[0...2]</b>	<b>Gx_XIST1 coarse position safe most significant bit / Gx_XIST1 safe MSB</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays the bit number for the safe most significant bit (MSB) of the Gx_XIST1 coarse position.		
<b>Index:</b>	[0] = Encoder 1 [1] = Encoder 2 [2] = -		
<b>Note:</b>	MSB: Most Significant Bit		

<b>r0477[0...2]</b>	<b>CO: Measuring gear position difference / Meas gear pos diff</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Integer32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays the position difference before the measuring gear between powering down and powering up.		

**Index:** [0] = Encoder 1  
[1] = Encoder 2  
[2] = -

**Note:** The increments are displayed in the format the same as r0483. The position difference should be read in encoder increments.


---

**r0479[0...2] CO: Diagnostics encoder position actual value Gn\_XIST1 / Diag Gn\_XIST1**

DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> Integer32 <b>P-Group:</b> Encoder <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 4704 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
---	---	---	--

**Description:** Displays the encoder actual position value Gn\_XIST1 according to PROFIdrive for diagnostics. In contrast to r0482, the value is updated in each DRIVE-CLiQ basic clock cycle and displayed with sign.

**Index:** [0] = Encoder 1  
[1] = Encoder 2  
[2] = -

**Caution:**  Following ramping-up or after a data set changeover, the new value is present at connector inputs which are inter-connected to connector output r0479 and under certain circumstances take 100 ms to become available.  
Reason:  
These interconnections are updated in the background, unlike interconnections involving other connector outputs (e.g. CO: r0482).  
The value is immediately available when non-cyclically reading r0479 (e.g. via the expert list).

---

**p0480[0...2] CI: Encoder control word Gn\_STW signal source / Enc Gn\_STW S\_src**

DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / Integer16 <b>P-Group:</b> Encoder <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 1580, 4720, 4750 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
---	--	---	--

**Description:** Sets the signal source for the encoder control word Gn\_STW according to PROFIdrive.

**Index:** [0] = Encoder 1  
[1] = Encoder 2  
[2] = -

**Note:** When the function module "basic positioner" (r0108.4 = 1) is activated, the following BICO interconnection is established:  
CI: p0480[0] = r2520[0], CI: p0480[1] = r2520[1] and CI: p0480[2] = r2520[2]

---

**r0481[0...2] CO: Encoder status word Gn\_ZSW / Enc Gn\_ZSW**

DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned16 <b>P-Group:</b> Encoder <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 4704, 4730 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
---	--	---	--

**Description:** Displays the encoder status word Gn\_ZSW according to PROFIdrive.

**Index:** [0] = Encoder 1  
[1] = Encoder 2  
[2] = Encoder 3

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Function 1 active	Yes	No	-
	01	Function 2 active	Yes	No	-
	02	Function 3 active	Yes	No	-
	03	Function 4 active	Yes	No	-
	04	Value 1	Displayed in r0483	Not present	-
	05	Value 2	Displayed in r0483	Not present	-
	06	Value 3	Displayed in r0483	Not present	-
	07	Value 4	Displayed in r0483	Not present	-
	08	Measuring probe 1 deflected	Yes	No	-
	09	Measuring probe 2 deflected	Yes	No	-
	11	Encoder fault acknowledge active	Yes	No	9676
	13	Absolute value cyclically	Displayed in r0483	No	-
	14	Parking encoder active	Yes	No	-
	15	Encoder fault	Displayed in r0483	None	-

**Note:** Re bit 14:  
Displays the acknowledgement for "activate parking encoder" (Gn\_STW.14 = 1) or encoder position actual value (Gn\_XIST1) invalid.  
Re bit 14, 15:  
r0481.14 = 1 and r0481.15 = 0 can have one of the following causes:  
- the encoder is parked.  
- the encoder is de-activated.  
- the encoder is being commissioned.  
- no parameterized encoder available.  
- encoder data set is being changed over.  
r0481.14 = 1 and r0481.15 = 1 has the following significance:  
An encoder error has occurred and the encoder position actual value (Gn\_XIST1) is invalid.

<b>r0482[0...2]</b>	<b>CO: Encoder actual position value Gn_XIST1 / Enc Gn_XIST1</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 1580, 4704, 4735
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays the encoder actual position value Gn_XIST1 according to PROFIdrive.		
<b>Index:</b>	[0] = Encoder 1 [1] = Encoder 2 [2] = -		
<b>Note:</b>	- this value is reset if necessary when the "parking encoder" (r0481.14) function is de-selected. - in this value, the measuring gear (p0432, p0433) is only taken into account when the position tracking is activated (p0411.0 = 1). - The update time for the position control (EPOS) corresponds to the position controller clock cycle p0115[4]. - The update time in isochronous operation corresponds to the bus cycle time r2064[1]. - The update time in isochronous operation and with position control (EPOS) corresponds to the position controller clock cycle p0115[4]. - The update time in non-isochronous operation or without position control (EPOS) comprises the following: Update time = 4 * least common multiple (LCM) of all current controller clock cycles (p0115[0]) in the drive group (infeed + drives). The minimum update time is 1 ms. Example 1: infeed, servo Update time = 4 * LCM(250 µs, 125 µs) = 4 * 250 µs = 1 ms Example 2: infeed, servo, vector Update time = 4 * LCM(250 µs, 125 µs, 500 µs) = 4 * 500 µs = 2 ms		

<b>r0483[0...2]</b>	<b>CO: Encoder actual position value Gn_XIST2 / Enc Gn_XIST2</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> Encoder <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 1580, 4704 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the encoder actual position value Gn_XIST2 according to PROFIdrive.		
<b>Recommend.:</b>	Possible causes: Re Error code = 4097, 4098: Defective Control Unit hardware. Re Error codes = 4099, 4100: Too many measuring pulses have occurred.		
<b>Index:</b>	[0] = Encoder 1 [1] = Encoder 2 [2] = -		
<b>Notice:</b>	The encoder position actual value must be requested using the encoder control word Gn_STW.13.		
<b>Note:</b>	- in this value, the measuring gear (p0432, p0433) is only taken into account when the position tracking is activated (p0411.0 = 1). - if GxZSW.15 = 1 (r0481), then an error code with the following significance is located in Gx_XIST2 (r0483): 1: Encoder fault. 2: Possible position shift in Gx_XIST1. 3: Encoder parking not possible. 4: Cancellation, reference block search (e.g. reference mark not available or input terminal for external zero mark not set). 5: Cancellation, fetch reference value (e.g. illegal change from reference mark search to flying measurement). 6: Cancellation, flying measurement (e.g. input terminal for probe not set). 7: Cancellation, fetch measured value (e.g. illegal change from flying measurement to reference mark search). 8: Abort, absolute value transfer. 3841: Function not supported. 4097: Abort, reference mark search due to an initialization error. 4098: Abort, flying measurement due to an initialization error. 4099: Abort, reference mark search due to a measuring error. 4100: Abort, flying measurement due to a measuring error.		
<b>r0484[0...2]</b>	<b>CO: Redundant coarse encoder position + CRC / Enc red pos+CRC</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> Encoder <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the redundant coarse encoder position including CRC (Cyclic Redundancy Check). Upper 16 bits: CRC over the redundant coarse encoder position. Lower 16 bits: Redundant coarse encoder position. On an SMx Sensor Module, the encoder coarse position count direction is opposite to r0482 (encoder actual value Gn_XIST1). The value contains 2 bit fine resolution. With a DRIVE-CLiQ encoder, the encoder coarse position count direction is the same as r0482.		
<b>Index:</b>	[0] = Encoder 1 [1] = Encoder 2 [2] = -		
<b>Dependency:</b>	The values are valid when the safety position actual value sensing is activated (p0430.19 = 1). Refer to: p0430		


**Note:** This absolute value does not change, contrary to r0482, when de-selecting the function "parking axis".

<b>r0485[0...2] CO: Measuring gear encoder raw value incremental / Enc raw val incr</b>			
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> -
<b>Description:</b> Displays the raw value of the incremental encoder actual value before the measuring gear.			
<b>Index:</b> [0] = Encoder 1 [1] = Encoder 2 [2] = -			

<b>r0486[0...2] CO: Measuring gear encoder raw value absolute / Enc raw val abs</b>			
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> -
<b>Description:</b> Displays the raw value of the absolute encoder actual value before the measuring gear.			
<b>Index:</b> [0] = Encoder 1 [1] = Encoder 2 [2] = -			

r0487[0...2] Diagnostic encoder control word Gn_STW / Enc Gn_STW					
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -		<b>Calculated:</b> -	<b>Access level:</b> 3	
	<b>Data type:</b> Unsigned16		<b>Dyn. index:</b> -	<b>Func. diagram:</b> 1580, 4704, 4720, 4735	
	<b>P-Group:</b> Encoder		<b>Units group:</b> -	<b>Unit selection:</b> -	
	<b>Not for motor type:</b> -		<b>Scaling:</b> -	<b>Expert list:</b> 1	
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> -		
<b>Description:</b> Displays the encoder control word Gn_STW according to PROFIdrive for diagnostics.					
<b>Index:</b> [0] = Encoder 1 [1] = Encoder 2 [2] = -					
<b>Bit field:</b>	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>	<b>FP</b>
	00	Request function 1	Yes	No	-
	01	Request function 2	Yes	No	-
	02	Request function 3	Yes	No	-
	03	Request function 4	Yes	No	-
	04	Request command bit 0	Yes	No	-
	05	Request command bit 1	Yes	No	-
	06	Request command bit 2	Yes	No	-
	07	Flying measurement mode/search for reference mark	Flying measurement	Reference marks	-
	13	Request absolute value cyclic	Yes	No	-
	14	Request parking encoder	Yes	No	-
	15	Request acknowledge encoder fault	Yes	No	-
<b>Notice:</b> Information on Gn_STW/Gn_ZSW should be taken from the corresponding product documentation.					
<b>Note:</b> The signal source for the encoder control word is set with p0480.					



<b>p0491</b>	<b>Motor encoder fault response ENCODER / Fault resp ENCODER</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> Encoder <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 5	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the behavior for the ENCODER fault response (motor encoder). This means, for example, if an encoder fault occurs, encoderless operation can be automatically selected with a shutdown behavior that can be selected.		
<b>Value:</b>	0: Encoder fault results in OFF2 1: Enc fault results in encoderless oper. and oper. continues 2: Encoder fault results in encoderless operation and OFF1 3: Encoder fault results in encoderless operation and OFF3 4: Encoder fault results in an armature short-cct int/DC braking 5: Enc fault results in encoderless op, operation continues, alarm		
<b>Dependency:</b>	The following parameters are relevant for encoderless operation.		
<b>Caution:</b> 	For a value = 1, 2, 3, 5 the following applies: - encoderless operation must have been started. - if, for synchronous motors, an encoder fault occurs below the switchover speed p1755, when switching over to encoderless operation, the motor can stall. For a value = 1, 5 the following applies: - in spite of the motor encoder fault that has occurred, the motor continues to operate.		
<b>Note:</b>	For a value = 1, 2, 3, 5 the following applies: - Refer to the status signal "encoderless operation due to a fault" (BO: r1407.13). - If, when setting r1407.13, a different drive data set is selected (e.g. interconnection from p0820), then the open-loop or closed-loop control type p1300 of this data set must match that of the original data set (e.g. p1300 = 21). Encoderless closed-loop controlled operation is kept when changing over. For a value = 4, the following applies: - The value can only be set for all motor data sets when p1231 = 3, 4. - For synchronous motors, an armature short circuit is initiated on an encoder fault. - For induction motors, DC braking is initiated on an encoder fault. DC braking must be commissioned (p1232, p1233, p1234). For a value = 5, the following applies: Same function as for value = 1. However, encoder faults are output as alarm and the message bit "Fault active" (r2139.3) is not set. The encoder fault has to be acknowledged via the encoder interface in order to resume operation with encoder.		
<b>p0492</b>	<b>Square-wave encoder maximum speed difference per sampling cycle / n_dif max/samp_cyc</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Encoder <b>Not for motor type:</b> - <b>Min</b> 0.00 [rpm]	<b>Calculated:</b> CALC_MOD_REG <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 210000.00 [rpm]	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.00 [rpm]
<b>Description:</b>	Sets the maximum permissible speed difference within the current controller sampling time for squarewave encoders. When the value is exceeded, depending on p0491, either encoderless closed-loop speed/torque control is selected or the drive is powered down.		
<b>Note:</b>	For a value of 0.0, the speed change monitoring is disabled. if the set maximum speed difference is only exceeded for one sampling time of the current controller, then an appropriate alarm is output. However, if the maximum speed difference is exceeded over several sampling times, then a corresponding fault is output.		

<b>p0496[0...2] Encoder diagnostic signal selection / Enc diag select</b>			
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> U, T <b>Data type:</b> Integer16 <b>P-Group:</b> Encoder <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 86	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Selects the trace signal to be output in r0497, r0498 and r0499 for encoder diagnostics.		
<b>Value:</b>	0: Inactive 1: r0497: Mechanical revolution 10: r0498: Raw value track A, r0499: Raw value track B 11: r0498: Fine position X (-A/2), r0499: Fine position Y (-B/2) 12: r0498: Fine position Phi, r0499: - 13: r0498: Offset correction X, r0499: Offset correction Y 14: r0498: Phase correction X, r0499: Amplitude correction Y 15: r0498: Cubic correction X, r0499: Fine position X 16: r0498: oversampling channel A, r0499: oversampling channel B 17: r0498: fan-out amount, r0499: fan-out number 18: r0498: Oversampling angle, r0499: Oversampling amount 20: r0498: Raw value track C, r0499: Raw value track D 21: r0498: CD position X (-D/2), r0499: CD position Y (C/2) 22: r0498: CD position Phi, r0499: CD pos. Phi - mech. revolution 23: r0497: Zero mark status 24: r0498: Raw value track R, r0499: Zero mark status 25: r0498: Raw value track A, r0499: Raw value track R 30: r0497: Absolute position serial 31: r0497: Absolute position incremental 32: r0497: Zero mark position 33: r0497: Correction absolute position difference 40: r0498: Raw temperature, r0499: Temperature in 0.1 °C 41: r0498: Resistance in 0.1 Ohm, r0499: Temperature in 0.1 °C 42: r0497: Resistance 2500 Ohm 51: r0497: Absolute speed difference (dn/dt) 52: r0497: Xact1 corrected quadrants 60: Analog sensor: r0498: raw val chann. A, r0499: raw val chann. B 61: Analog sensor: r0498: fine pos chann. A, r0499: fine pos chann. B 62: Analog sensor: r0498: Fine pos before characteristic, r0499: - 70: Resolver: r0498: Transformation ratio, r0499: phase 80: Spindle: r0498: Sensor S1 (raw), r0499: Sensor S4 (raw) 81: Spindle: r0498: Sensor S5 (raw), r0499: - 85: Spindle: r0498: Sensor S1 (cal), r0499: Sensor S4 (cal) 86: Spindle: r0498: Sensor S5 (cal), r0499: -		
<b>Index:</b>	[0] = Encoder 1 [1] = Encoder 2 [2] = -		
<b>Dependency:</b>	Refer to: r0497, r0498, r0499		
<b>Notice:</b>	The setting option depends on the following properties: Sensor Module type, hardware version, firmware version (Sensor Module and Control Units), order number (last digit). Not all combinations are supported.		
<b>Note:</b>	Re p0496 = 1: 360 ° <--> 2^32 Re p0496 = 10 (resolver): 2900 mV <--> 26214 dec Re p0496 = 10, 20 (sin/cos 1 Vpp, EnDat): 500 mV <--> 21299 dec Re p0496 = 11 (resolver): 2900 mV <--> 13107 dec, internal processor offset is corrected Re p0496 = 11, 21 (sin/cos 1 Vpp, EnDat): 500 mV <--> 10650 dec, internal processor offset is corrected Re p0496 = 12: 180 ° fine position <--> 32768 dec Re p0496 = 13 (resolver): 2900 mV <--> 13107 dec Re p0496 = 13 (sin/cos 1 Vpp, EnDat): 500 mV <--> 10650 dec		

Re p0496 = 14: 1 ° <--> 286 dec, 100% <--> 16384 dec  
 Re p0496 = 15: 100 % <--> 16384 dec  
 Re p0496 = 16: (resolver): channel A: 2900 mV <--> 26214 dec, channel B: 2900 mV <--> 26214 dec  
 Re p0496 = 16: (sin/cos 1 Vpp, EnDat) channel A: 500 mV <--> 21299 dec, channel B: 500 mV <--> 21299 dec  
 Re p0496 = 17 (resolver): absolute value: 2900 mV <--> 13107 dec, number: 1 ... 8  
 Re p0496 = 17 (sin/cos 1 Vpp, EnDat): absolute value 500 mV <--> 10650 dec, number: 1 ... 8  
 Re p0496 = 18 (resolver): angle: signal period <--> 2^16, absolute value: 2900 mV <--> 13107 dec  
 Re p0496 = 18 (sin/cos 1 Vpp, EnDat): angle: signal period <--> 2^16, absolute value: 500 mV <--> 10650 dec  
 Re p0496 = 22: 180 ° <--> 32768 dec  
 Re p0496 = 23, 24: r0497.31 (r0499.15) set for at least 1 current controller cycle when encoder zero mark detected  
 Re p0496 = 24, 25: 500 mV <--> 21299 dec  
 Re p0496 = 30: Rotary: 1 singleturn measuring step <--> 1 dec, linear: 1 measuring step <--> 1 dec  
 Re p0496 = 31: Absolute position, incremental in 1/4 encoder pulses  
 Re p0496 = 32: Zero mark position in 1/4 encoder pulses  
 Re p0496 = 33: counter offset absolute value in 1/4 encoder pulses  
 Re p0496 = 40: r0498 <--> (R\_KTY/1 kOhm - 0.9) \* 32768  
 Re p0496 = 42: 2500 Ohm <--> 2^32  
 Re p0496 = 51: 1 rpm <--> 1000 dec  
 Re p0496 = 52: In 1/4 encoder pulses  
 Re p0496 = 60: voltage, channel A in mV, voltage, channel B in mV  
 Re p0496 = 61: Channel A: encoder periods <--> 2^16, channel B: encoder periods <--> 2^16  
 Re p0496 = 62: encoder periods <--> 2^16  
 Re p0496 = 70: r: 100% <--> 10000 dec, phase: 180 ° <--> 18000 dec  
 Re p0496 = 80, 81, 85, 86: 1V <--> 1000 inc

r0497[0...2]		CO: Encoder diagnostic signal double word / Enc diag DW	
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	Can be changed: -	Calculated: -	Access level: 4
	Data type: Unsigned32	Dyn. index: -	Func. diagram: -
	P-Group: Encoder	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min -	Max -	Factory setting -
Description:	Displays the trace signal for encoder diagnostics (double word). The signal to be output is selected in p0496.		
Index:	[0] = Encoder 1 [1] = Encoder 2 [2] = -		
Dependency:	Refer to: p0496, r0498, r0499		

r0498[0...2]		CO: Encoder diagnostic signal low word / Enc diag low word		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	Can be changed: -	Calculated: -	Access level: 4	
	Data type: Integer16	Dyn. index: -	Func. diagram: -	
	P-Group: Encoder	Units group: -	Unit selection: -	
	Not for motor type: -	Scaling: -	Expert list: 1	
	Min -	Max -	Factory setting -	
Description:	Displays the trace signal for encoder diagnostics (low component). The signal to be output is selected in p0496.			
Index:	[0] = Encoder 1 [1] = Encoder 2 [2] = -			
Dependency:	Refer to: p0496, r0497, r0499			

<b>r0499[0...2]</b>	<b>CO: Encoder diagnostic signal high word / Enc diag high word</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the trace signal for encoder diagnostics (high component).  
The signal to be output is selected in p0496.

**Index:** [0] = Encoder 1  
[1] = Encoder 2  
[2] = -

**Dependency:** Refer to: p0496, r0497, r0498

<b>p0595</b>	<b>Technological unit selection / Tech unit select</b>		
DC_CTRL (Tech_ctrl), DC_CTRL_R (Tech_ctrl), DC_CTRL_R_S (Tech_ctrl), DC_CTRL_S (Tech_ctrl)	<b>Can be changed:</b> C2(5)	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Applications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	1	32	1

**Description:** Selects the units for the parameters of the technology controller.  
For p0595 = 1, 2, the reference quantity set in p0596 is not active.

**Value:**

- 1: %
- 2: 1 referred no dimensions
- 3: bar
- 4: °C
- 5: Pa
- 6: ltr/s
- 7: m³/s
- 8: ltr/min
- 9: m³/min
- 10: ltr/h
- 11: m³/h
- 12: kg/s
- 13: kg/min
- 14: kg/h
- 15: t/min
- 16: t/h
- 17: N
- 18: kN
- 19: Nm
- 20: psi
- 21: °F
- 22: gallon/s
- 23: inch³/s
- 24: gallon/min
- 25: inch³/min
- 26: gallon/h
- 27: inch³/h
- 28: lb/s
- 29: lb/min
- 30: lb/h
- 31: lbf
- 32: lbf ft

**Dependency:** Only the unit of the technology controller parameters are switched over (unit group 9\_1).

Refer to: p0596

**Note:** When switching over from % into another unit, the following sequence applies:

- set p0596

- set p0595 to the required unit

### p0596 Technological unit reference quantity / Tech unit ref qty

DC_CTRL (Tech_ctrl), DC_CTRL_R (Tech_ctrl), DC_CTRL_R_S (Tech_ctrl), DC_CTRL_S (Tech_ctrl)	<b>Can be changed:</b> T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 1 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1
---	--	--	--

<b>Min</b> 0.01	<b>Max</b> 340.28235E36	<b>Factory setting</b> 1.00
--------------------	----------------------------	--------------------------------

**Description:** Sets the reference quantity for the technological units.

When changing over using changeover parameter p0595 to absolute units, all of the parameters involved refer to the reference quantity.

**Dependency:** Refer to: p0595

**Notice:** When changing over from one technological unit into another, or when changing the reference parameter, a changeover is not made.

### p0601[0...n] Motor temperature sensor type / Mot\_temp\_sens type

DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(3), U, T <b>Data type:</b> Integer16 <b>P-Group:</b> Motor <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> MDS <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1
---	--	--	--

<b>Min</b> 0	<b>Max</b> 2	<b>Factory setting</b> 0
-----------------	-----------------	-----------------------------

**Description:** Sets the sensor type for the motor temperature monitoring.

**Value:**  
0: No sensor  
2: KTY84

**Dependency:** Refer to: r0458

### p0700[0...n] Macro Binector Input (BI) / Macro BI

DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(1), T <b>Data type:</b> Unsigned32 <b>P-Group:</b> Commands <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 1 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1
---	---	---	--

<b>Min</b> 0	<b>Max</b> 999999	<b>Factory setting</b> 0
-----------------	----------------------	-----------------------------

**Description:** Runs the corresponding macro files.

The binector inputs of the corresponding command data set are appropriately interconnected.

The selected macro file must be available on the memory card/device memory.

Example:

p0700 = 6 --> macro file PM000006.ACX is run.

**Dependency:** Refer to: p0015, p1000, p1500, r8571

**Caution:** When executing a specific macro, the corresponding programmed settings are made and become active.

**Notice:** No errors were issued during quick commissioning (p3900 = 1) when writing to parameters of the QUICK\_IBN group!

**Note:** The macros in the specified directory are displayed in r8571. r8571 is not in the expert list of the commissioning software.  
 Macros available as standard are described in the technical documentation of the particular product.  
 BI: Binector Input  
 CDS: Command Data Set

---

**p0700 Macro Binector Input (BI) for TMs / Macro BI TM**

TM15DI_DO, TM31	<b>Can be changed:</b> C2(1), T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	999999	0

**Description:** Runs the corresponding macro files.  
 The selected macro file must be available on the memory card/device memory.  
 Example:  
 p0700 = 6 --> macro file PM000006.ACX is run.

**Dependency:** Refer to: r8571

**Caution:** When executing a specific macro, the corresponding programmed settings are made and become active.

**Notice:** No errors were issued during quick commissioning (p3900 = 1) when writing to parameters of the QUICK\_IBN group!

**Note:** The macros in the specified directory are displayed in r8571. r8571 is not in the expert list of the commissioning software.  
 Macros available as standard are described in the technical documentation of the particular product.  
 BI: Binector Input  
 CDS: Command Data Set

---

**p0802 Data transfer: memory card as source/target / mem\_card src/targ**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	100	0

**Description:** Sets the number for data transfer of a parameter backup from/to memory card.  
 Transfer from memory card to device memory (p0804 = 1):  
 - Sets the source of parameter backup (e.g. p0802 = 48 --> PS048xxx.ACX is the source).  
 Transfer from non-volatile device memory to memory card (p0804 = 2):  
 - Sets the target of parameter backup (e.g. p0802 = 23 --> PS023xxx.ACX is the target).

**Dependency:** Refer to: p0803, p0804

**Notice:** If the data between the volatile and non-volatile device memories differ, then it may be necessary to save the data on the memory card in a non-volatile fashion prior to the transfer (e.g. p0971 = 1).

---

**p0803 Data transfer: device memory as source/target / Dev\_mem src/targ**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	20	0

**Description:** Sets the number for data transfer of a parameter backup from/to device memory.  
 Transfer from memory card to device memory (p0804 = 1):  
 - Sets the target of the parameter backup (e.g. p0803 = 10 --> PS010xxx.ACX is the target).

Transfer from non-volatile device memory to memory card (p0804 = 2):

- Sets the source of the parameter backup (e.g. p0803 = 11 --> PS011xxx.ACX is the source).

**Value:**  
0: Source/target standard  
10: Source/target with setting 10  
11: Source/target with setting 11  
12: Source/target with setting 12  
20: Source/target with setting 20

**Dependency:** Refer to: p0802, p0804

**Notice:** If the data between the volatile and non-volatile device memories differ, then it may be necessary to save the data on the memory card in a non-volatile fashion prior to the transfer (e.g. p0971 = 1).

---

#### p0804 Data transfer start / Data transf start

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 1100	<b>Factory setting</b> 0

**Description:** Sets the transfer direction and start of data transfer between the memory card and non-volatile device memory.

Example 1:  
The parameter backup is to be transferred from the device memory to the memory card with setting 0. The parameter backup is to be stored on the memory card with setting 22.  
p0802 = 22 (parameter backup stored on memory card as target with setting 22)  
p0803 = 0 (parameter backup stored in device memory as source with setting 0)  
p0804 = 2 (start data transfer from device memory to memory card)  
--> PS000xxx.ACX is transferred from device memory to memory card and stored as PS022xxx.ACX.

Example 2:  
The parameter backup is to be transferred from the memory card to the device memory with setting 22. The parameter backup is to be stored in the device memory as setting 0.  
p0802 = 22 (parameter backup stored on memory card as source with setting 22)  
p0803 = 0 (parameter backup stored in device memory as target with setting 0)  
p0804 = 1 (start data transfer from memory card to device memory)  
--> PS022xxx.ACX is transferred from memory card to device memory and stored as PS000xxx.ACX.

**Value:**  
0: Inactive  
1: Memory card to device memory  
2: Device memory to memory card  
1001: File on memory card cannot be opened  
1002: File in device memory cannot be opened  
1003: Memory card not found  
1100: File cannot be transferred

**Dependency:** Refer to: p0802, p0803

**Notice:** The memory card must not be removed while data is being transferred.

**Note:** If a parameter backup with setting 0 is detected on the memory card when the Control Unit is switched on (PS000xxx.ACX), this is transferred automatically to the device memory.

When the memory card is inserted, a parameter backup with setting 0 (PS000xxx.ACX) is automatically written to the memory card when the parameters are saved in a non-volatile memory (e.g. by means of "Copy RAM to ROM").

Once the data has been successfully transferred, this parameter is automatically reset to 0. If an error occurs, the parameter is set to a value > 1000. Possible fault causes:

p0804 = 1001:  
The parameter backup set in p0802 as the source on the memory card does not exist or there is not sufficient memory space available on the memory card.

p0804 = 1002:  
The parameter backup set in p0803 as the source in the device memory does not exist or there is not sufficient memory space available in the device memory.

p0804 = 1003:  
No memory card has been inserted.

<b>p0806</b>				
<b>BI: Inhibit master control / PcCtrl inhibit</b>				
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3	
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -	
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -	
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1	
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> 0	
<b>Description:</b> Sets the signal source to block the master control.				
<b>Dependency:</b> Refer to: r0807				
<b>Note:</b> The commissioning software (drive control panel) uses the master control, for example.				
<hr/>				
<b>r0807.0</b>				
<b>BO: Master control active / PcCtrl active</b>				
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2	
	<b>Data type:</b> Unsigned8	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2580, 3113, 3130	
	<b>P-Group:</b> Displays, signals	<b>Units group:</b> -	<b>Unit selection:</b> -	
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1	
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> -	
<b>Description:</b> Displays what has the master control. The drive can be controlled via the BICO interconnection or from external (e.g. the commissioning software).				
<b>Bit field:</b>	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>
	00	Master control active	Yes	No
				<b>FP</b> 5030, 6031
<b>Dependency:</b> Refer to: p0806				
<b>Notice:</b> The master control only influences control word 1 and speed setpoint 1. Other control words/setpoints can be transferred from another automation device.				
<b>Note:</b> Bit 0 = 0: BICO interconnection active Bit 0 = 1: Master control for PC/AOP The commissioning software (drive control panel) uses the master control, for example.				
<hr/>				
<b>p0809[0...2]</b>				
<b>Copy Command Data Set CDS / Copy CDS</b>				
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2	
	<b>Data type:</b> Unsigned8	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8560	
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -	
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1	
	<b>Min</b> 0	<b>Max</b> 15	<b>Factory setting</b> 0	
<b>Description:</b> Copies one Command Data Set (CDS) into another.				
<b>Index:</b> [0] = Source Command Data Set [1] = Target Command Data Set [2] = Start copying procedure				
<b>Note:</b> Procedure: 1. In Index 0, enter which command data set should be copied. 2. In Index 1, enter the command data set that is to be copied into. 3. Start copying: Set index 2 from 0 to 1. p0809[2] is automatically set to 0 when copying is completed.				



<b>p0810</b>	<b>BI: Command data set selection CDS bit 0 / CDS select bit 0</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> Commands <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 8560 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the signal source to select the Command Data Set bit 0 (CDS bit 0).		
<b>Dependency:</b>	Refer to: r0050, r0836		
<b>Notice:</b>	The parameter may be protected as a result of p0922 or p2079 and cannot be changed.		
<b>Note:</b>	The Command Data Set selected using the binector inputs is displayed in r0836. The currently effective command data set is displayed in r0050. A Command Data Set can be copied using p0809.		
<b>p0819[0...2]</b>	<b>Copy Drive Data Set DDS / Copy DDS</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(15) <b>Data type:</b> Unsigned8 <b>P-Group:</b> Data sets <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 31	<b>Access level:</b> 2 <b>Func. diagram:</b> 8565 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Copies one Drive Data Set (DDS) into another.		
<b>Index:</b>	[0] = Source Drive Data Set [1] = Target Drive Data Set [2] = Start copying procedure		
<b>Note:</b>	Procedure: 1. In Index 0, enter which drive data set is to be copied. 2. In Index 1, enter the drive data set data that is to be copied into. 3. Start copying: Set index 2 from 0 to 1. p0819[2] is automatically set to 0 when copying is completed.		
<b>p0820[0...n]</b>	<b>BI: Drive Data Set selection DDS bit 0 / DDS select bit 0</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(15), T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> Data sets <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 8565, 8570 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the signal source to select the Drive Data Set, bit 0 (DDS, bit 0).		
<b>Dependency:</b>	Refer to: r0051, r0837		
<b>Notice:</b>	The parameter may be protected as a result of p0922 or p2079 and cannot be changed.		
<b>p0821[0...n]</b>	<b>BI: Drive Data Set selection DDS bit 1 / DDS select bit 1</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(15), T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> Data sets <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 8565 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the signal source to select the Drive Data Set, bit 1 (DDS, bit 1).		
<b>Dependency:</b>	Refer to: r0051, r0837		
<b>Notice:</b>	The parameter may be protected as a result of p0922 or p2079 and cannot be changed.		

**r0835.2 CO/BO: Data set changeover status word / DDS\_ZSW**

DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8575
	<b>P-Group:</b> Displays, signals	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the status word for the drive data set changeover.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	02	Internal parameter calculation active	Yes	No	-

**Note:** Re bit 02:

A data set changeover is delayed by the time required for the internal parameter calculation.

**r0836.0 CO/BO: Command Data Set CDS selected / CDS selected**

DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned8	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8560
	<b>P-Group:</b> Displays, signals	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the command data set (CDS) selected via the binector input.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	CDS selection bit 0	ON	OFF	-

**Dependency:** Refer to: r0050, p0810

**Note:** Command data sets are selected via binector input p0810.  
The currently effective command data set is displayed in r0050.

**r0837.0...1 CO/BO: Drive Data Set DDS selected / DDS selected**

DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned8	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8565
	<b>P-Group:</b> Displays, signals	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the drive data set (DDS) selected via the binector input.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	DDS selection bit 0	ON	OFF	-
	01	DDS selection bit 1	ON	OFF	-

**Dependency:** Refer to: r0051, p0820, p0821

**Note:** Drive data sets are selected via binector input p0820 and following.  
The currently effective drive data set is displayed in r0051.

**p0840[0...n] BI: ON / OFF (OFF1) / ON / OFF (OFF1)**

DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> CDS, p0170	<b>Func. diagram:</b> 2580
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	1

**Description:** Sets the signal source for the command "ON/OFF (OFF1)".

For the PROFIdrive profile, this command corresponds to control word 1 bit 0 (STW1.0).

**Recommend.:** When the setting for this binector input is changed, the motor can only be switched on by means of an appropriate signal change of the source.

**Dependency:** Refer to: p1055, p1056

**Caution:** When "master control from PC" is activated, this binector input is ineffective.



**Notice:** For binector input p0840 = 0 signal, the motor can be moved, jogging using binector input p1055 or p1056.  
The command "ON/OFF (OFF1)" can be issued using binector input p0840 or p1055/p1056.  
For binector input p0840 = 0 signal, the switch-on inhibit is acknowledged.  
Only the signal source that originally powered up can also power down again.  
The parameter may be protected as a result of p0922 or p2079 and cannot be changed.

**Note:** For drives with closed-loop speed control (p50084 = 1), the following applies:  
- BI: p0840 = 0 signal: OFF1 (braking with the ramp-function generator, then pulse suppression and switch-on inhibit)  
For drives with closed-loop torque control (p50084 = 2), the following applies:  
- BI: p0840 = 0 signal: immediate pulse suppression  
For drives with closed-loop speed/torque control, the following applies:  
- BI: p0840 = 0/1 signal: ON (pulses can be enabled)

p0844[0...n]	BI: No coast-down / coast-down (OFF2) signal source 1 / OFF2 S_src 1		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> CDS, p0170	<b>Func. diagram:</b> 2580
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	1

**Description:** Sets the first signal source for the command "No coast down/coast down (OFF2)".  
The following signals are AND'ed:  
- BI: p0844 "No coast-down / coast-down (OFF2) signal source 1"  
- BI: p0845 "No coast-down / coast-down (OFF2) signal source 2"  
For the PROFIdrive profile, the result of the AND logic operation corresponds to control word 1 bit 1 (STW1.1).  
BI: p0844 = 0 signal or BI: p0845 = 0 signal  
- OFF2 (immediate pulse suppression and switch on inhibit)  
BI: p0844 = 1 signal and BI: p0845 = 1 signal  
- No OFF2 (enable is possible)

**Caution:** When "master control from PC" is activated, this binector input is ineffective.



**Notice:** The parameter may be protected as a result of p0922 or p2079 and cannot be changed.

p0845[0...n]	BI: No coast-down / coast-down (OFF2) signal source 2 / OFF2 S_src 2		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> CDS, p0170	<b>Func. diagram:</b> 2580
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	1

**Description:** Sets the second signal source for the command "No coast down/coast down (OFF2)".  
The following signals are AND'ed:  
- BI: p0844 "No coast-down / coast-down (OFF2) signal source 1"  
- BI: p0845 "No coast-down / coast-down (OFF2) signal source 2"  
For the PROFIdrive profile, the result of the AND logic operation corresponds to control word 1 bit 1 (STW1.1).

BI: p0844 = 0 signal or BI: p0845 = 0 signal

- OFF2 (immediate pulse suppression and switch on inhibit)

BI: p0844 = 1 signal and BI: p0845 = 1 signal

- No OFF2 (enable is possible)

**Caution:**



When "master control from PC" is activated, this binector input is effective.

#### p0848[0...n]

#### BI: No Quick Stop / Quick Stop (OFF3) signal source 1 / OFF3 S\_src 1

DC\_CTRL,  
DC\_CTRL\_R,  
DC\_CTRL\_R\_S,  
DC\_CTRL\_S

**Can be changed:** T

**Data type:** Unsigned32 / Binary

**P-Group:** Commands

**Not for motor type:** -

**Min**

-

**Calculated:** -

**Dyn. index:** CDS, p0170

**Units group:** -

**Scaling:** -

**Max**

-

**Access level:** 3

**Func. diagram:** 2580

**Unit selection:** -

**Expert list:** 1

**Factory setting**

1

**Description:**

Sets the first signal source for the command "No quick stop/quick stop (OFF3)".

The following signals are AND'ed:

- BI: p0848 "No quick stop / quick stop (OFF3) signal source 1"

- BI: p0849 "No quick stop / quick stop (OFF3) signal source 2"

For the PROFIdrive profile, the result of the AND logic operation corresponds to control word 1 bit 2 (STW1.2).

BI: p0848 = 0 signal or BI: p0849 = 0 signal

- OFF3 (braking along the OFF3 ramp (p50296), then pulse suppression and switch on inhibit)

BI: p0848 = 1 signal and BI: p0849 = 1 signal

- No OFF3 (enable is possible)

**Caution:**



When "master control from PC" is activated, this binector input is ineffective.

**Notice:**

The parameter may be protected as a result of p0922 or p2079 and cannot be changed.

#### p0849[0...n]

#### BI: No Quick Stop / Quick Stop (OFF3) signal source 2 / OFF3 S\_src 2

DC\_CTRL,  
DC\_CTRL\_R,  
DC\_CTRL\_R\_S,  
DC\_CTRL\_S

**Can be changed:** T

**Data type:** Unsigned32 / Binary

**P-Group:** Commands

**Not for motor type:** -

**Min**

-

**Calculated:** -

**Dyn. index:** CDS, p0170

**Units group:** -

**Scaling:** -

**Max**

-

**Access level:** 3

**Func. diagram:** 2580

**Unit selection:** -

**Expert list:** 1

**Factory setting**

1

**Description:**

Sets the second signal source for the command "No quick stop/quick stop (OFF3)".

The following signals are AND'ed:

- BI: p0848 "No quick stop / quick stop (OFF3) signal source 1"

- BI: p0849 "No quick stop / quick stop (OFF3) signal source 2"

For the PROFIdrive profile, the result of the AND logic operation corresponds to control word 1 bit 2 (STW1.2).

BI: p0848 = 0 signal or BI: p0849 = 0 signal

- OFF3 (braking along the OFF3 ramp (p50296), then pulse suppression and switch on inhibit)

BI: p0848 = 1 signal and BI: p0849 = 1 signal

- No OFF3 (enable is possible)

**Caution:**



When "master control from PC" is activated, this binector input is effective.

---

**p0852[0...n]      BI: Enable operation/inhibit operation / Operation enable**

DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> CDS, p0170	<b>Func. diagram:</b> 2580
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	1

**Description:** Sets the signal source for the command "enable operation/inhibit operation".  
For the PROFIdrive profile, this command corresponds to control word 1 bit 3 (STW1.3).  
BI: p0852 = 0 signal  
Inhibit operation (suppress pulses).  
BI: p0852 = 1 signal  
Enable operation (pulses can be enabled).  
When "master control from PC" is activated, this binector input is ineffective.

**Caution:**



**Notice:** The parameter may be protected as a result of p0922 or p2079 and cannot be changed.

---

**p0854[0...n]      BI: Control by PLC/no control by PLC / Master ctrl by PLC**

DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> CDS, p0170	<b>Func. diagram:</b> 2580
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	1

**Description:** Sets the signal source for the command "control by PLC/no control by PLC".  
For the PROFIdrive profile, this command corresponds to control word 1 bit 10 (STW1.10).  
BI: p0854 = 0 signal  
No control by PLC  
BI: p0854 = 1 signal  
Master ctrl by PLC.

When "master control from PC" is activated, this binector input is ineffective.

**Caution:**



**Notice:** The parameter may be protected as a result of p0922 or p2079 and cannot be changed.

**Note:** This bit is used to initiate a response for the drives when the control fails (F07220). If there is no control available, then binector input p0854 should be set to 1.

If a control is available, then STW1.10 must be set to 1 (PZD1) so that the received data is updated. This applies regardless of the setting in p0854 and even in the case of free telegram configuration (p0922 = 999).

---

**p0855[0...n]      BI: Unconditionally open holding brake / Uncond open brake**

DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> CDS, p0170	<b>Func. diagram:</b> 2580
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Sets the signal source for the command "unconditionally open holding brake".

**Dependency:** Refer to: p0858

**Notice:** The parameter may be protected as a result of p0922 or p2079 and cannot be changed.

**Note:** The signal via BI: p0858 (unconditionally close holding brake) has a higher priority than via BI: p0855 (unconditionally open holding brake).

<b>p0856[0...n]</b>					
<b>BI: Speed controller enable / n_ctrl enable</b>					
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3		
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> CDS, p0170	<b>Func. diagram:</b> 2580		
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -		
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1		
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>		
	-	-	1		
<b>Description:</b>	Sets the signal source for the command "enable speed controller" (r0898.12). 0 signal: Set the I component and speed controller output to zero. 1 signal: Enable speed controller.				
<b>Dependency:</b>	Refer to: r0898				
<b>Note:</b>	If "enable speed controller" is withdrawn, then an existing brake will be closed. If "speed controller enable" is withdrawn, the pulses are not suppressed.				
<b>p0858[0...n]</b>					
<b>BI: Unconditionally close holding brake / Uncond close brake</b>					
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2		
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> CDS, p0170	<b>Func. diagram:</b> 2580		
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -		
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1		
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>		
	-	-	0		
<b>Description:</b>	Sets the signal source for the command "unconditionally close holding brake".				
<b>Dependency:</b>	Refer to: p0855				
<b>Note:</b>	The signal via BI: p0858 (unconditionally close holding brake) has a higher priority than via BI: p0855 (unconditionally open holding brake). For a 1 signal via BI: p0858, the command "unconditionally close the holding brake" is executed and internally a zero setpoint is entered.				
<b>r0898.0...14</b>					
<b>CO/BO: Control word sequence control / STW seq_ctrl</b>					
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2		
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2580		
	<b>P-Group:</b> Displays, signals	<b>Units group:</b> -	<b>Unit selection:</b> -		
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1		
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>		
	-	-	-		
<b>Description:</b>	Displays the control word of the sequence control.				
<b>Bit field:</b>	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>	<b>FP</b>
	00	ON/OFF1	Yes	No	-
	01	OC / OFF2	Yes	No	-
	02	OC / OFF3	Yes	No	-
	03	Operation enable	Yes	No	-
	04	Ramp-function generator enable	Yes	No	-
	05	Continue ramp-function generator	Yes	No	-
	06	Speed setpoint enable	Yes	No	-
	07	Command open brake	Yes	No	-
	08	Jog 1	Yes	No	-
	09	Jog 2	Yes	No	-
	10	Master ctrl by PLC	Yes	No	-
	12	Speed controller enable	Yes	No	-
	14	Command close brake	Yes	No	-
<b>Note:</b>	OC: Operating condition				

<b>r0899.0...15</b>	<b>CO/BO: Status word sequence control / ZSW seq_ctrl</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2585, 2750, 3150, 3151, 3152, 6810, 6830
	<b>P-Group:</b> Displays, signals	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the status word of the sequence control.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Rdy for switch on	Yes	No	-
	01	Ready	Yes	No	-
	02	Operation enabled	Yes	No	-
	03	Jog active	Yes	No	-
	04	No coasting active	OFF2 inactive	OFF2 active	-
	05	No Quick Stop active	OFF3 inactive	OFF3 active	-
	06	Switching on inhibited active	Yes	No	-
	07	Drive ready	Yes	No	-
	08	Controller enable	Yes	No	-
	09	Control request	Yes	No	-
	11	Pulses enabled	Yes	No	-
	12	Open holding brake	Yes	No	-
	13	Command close holding brake	Yes	No	-
	14	Pulse enable from the brake control	Yes	No	-
	15	Setpoint enable from the brake control	Yes	No	-

**Note:** Re bits 00, 01, 02, 04, 05, 06, 09:  
For PROFIdrive, these signals are used for status word 1.

<b>p0918</b>	<b>PROFIBUS address / PB address</b>		
CU_DC_R, CU_DC_R_S	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 1520, 2410
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	1	126	125

**Description:** Sets the PROFIBUS address for PROFIBUS interface (X126) on the Control Unit.  
The address can be set as follows:  
Via p0918  
--> The address is saved in a non-volatile fashion using the function "copy from RAM to ROM".  
--> A change only becomes effective after a POWER ON.

**Note:** Permissible PROFIBUS addresses: 1 ... 126  
Address 126 is used for commissioning.  
Every PROFIBUS address change only becomes effective after a POWER ON.

<b>p0918</b>	<b>PROFIBUS address / PB address</b>		
CU_DC, CU_DC_S	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 1520, 2410
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	1	126	126

**Description:** Sets the PROFIBUS address for PROFIBUS interface (X126) on the Control Unit.  
The address can be set as follows:

Via p0918

--&gt; The address is saved in a non-volatile fashion using the function "copy from RAM to ROM".

--&gt; A change only becomes effective after a POWER ON.

**Note:**

Permissible PROFIBUS addresses: 1 ... 126

Address 126 is used for commissioning.

Every PROFIBUS address change only becomes effective after a POWER ON.

**p0922****IF1 PROFIdrive PZD telegram selection / IF1 PZD telegr**CU\_DC, CU\_DC\_R,  
CU\_DC\_R\_S,  
CU\_DC\_S**Can be changed:** C2(1), T**Data type:** Unsigned16**P-Group:** Communications**Not for motor type:** -**Min**

390

**Calculated:** -**Dyn. index:** -**Units group:** -**Scaling:** -**Max**

999

**Access level:** 1**Func. diagram:** 1520, 2420**Unit selection:** -**Expert list:** 1**Factory setting**

999

**Description:**

Sets the send and receive telegram.

**Value:**

390: SIEMENS telegram 390, PZD-2/2

999: Free telegram configuration with BICO

**p0922****IF1 PROFIdrive PZD telegram selection / IF1 PZD telegr**DC\_CTRL,  
DC\_CTRL\_R,  
DC\_CTRL\_R\_S,  
DC\_CTRL\_S**Can be changed:** C2(1), T**Data type:** Unsigned16**P-Group:** Communications**Not for motor type:** -**Min**

1

**Calculated:** -**Dyn. index:** -**Units group:** -**Scaling:** -**Max**

999

**Access level:** 1**Func. diagram:** 1520, 2420**Unit selection:** -**Expert list:** 1**Factory setting**

999

**Description:**

Sets the send and receive telegram.

**Value:**

1: Standard telegram 1, PZD-2/2

3: Standard telegram 3, PZD-5/9

4: Standard telegram 4, PZD-6/14

20: Standard telegram 20, PZD-2/6

220: SIEMENS telegram 220, PZD-10/10

352: SIEMENS telegram 352, PZD-6/6

999: Free telegram configuration with BICO

**Note:**

If a value is not equal to 999, a telegram is set and the automatically set interconnections in the telegram are inhibited.

The inhibited interconnections can only be changed again after setting value 999.

**r0924[0...1]****ZSW bit pulses enabled / ZSW pulse enab**DC\_CTRL,  
DC\_CTRL\_R,  
DC\_CTRL\_R\_S,  
DC\_CTRL\_S**Can be changed:** -**Data type:** Unsigned16**P-Group:** Communications**Not for motor type:** -**Min**

-

**Calculated:** -**Dyn. index:** -**Units group:** -**Scaling:** -**Max**

-

**Access level:** 3**Func. diagram:** -**Unit selection:** -**Expert list:** 1**Factory setting**

-

**Description:**

Displays the position of the "Pulses enabled" status signal in the PROFIdrive telegram.

**Index:**

[0] = Signal number

[1] = Bit position



---

## **r0944 CO: Counter for fault buffer changes / Fault buff change**

All objects	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8060
	<b>P-Group:</b> Messages	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays fault buffer changes. This counter is incremented every time the fault buffer changes.		
<b>Recommend.:</b>	Used to check whether the fault buffer has been read out consistently.		
<b>Dependency:</b>	Refer to: r0945, r0947, r0948, r0949, r2109		

---

## **r0945[0...63] Fault code / Fault code**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S, DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8060
	<b>P-Group:</b> Messages	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays the numbers of faults that have occurred.		
<b>Dependency:</b>	Refer to: r0947, r0948, r0949, r2109, r2130, r2133, r2136, r3120, r3122		
<b>Notice:</b>	The properties of the fault buffer should be taken from the corresponding product documentation.		
<b>Note:</b>	<p>The buffer parameters are cyclically updated in the background (refer to status signal in r2139).</p> <p>Fault buffer structure (general principle):</p> <p>r0945[0], r0949[0], r0948[0], r2109[0], r3115[0] --&gt; actual fault case, fault 1</p> <p>...</p> <p>r0945[7], r0949[7], r0948[7], r2109[7], r3115[7] --&gt; actual fault case, fault 8</p> <p>r0945[8], r0949[8], r0948[8], r2109[8], r3115[8] --&gt; 1st acknowledged fault case, fault 1</p> <p>...</p> <p>r0945[15], r0949[15], r0948[15], r2109[15], r3115[15] --&gt; 1st acknowledged fault case, fault 8</p> <p>...</p> <p>r0945[56], r0949[56], r0948[56], r2109[56], r3115[56] --&gt; 7th acknowledged fault case, fault 1</p> <p>...</p> <p>r0945[63], r0949[63], r0948[63], r2109[63], r3115[63] --&gt; 7th acknowledged fault case, fault 8</p>		

---

## **r0945[0...63] Fault code / Fault code**

TM150, TM15DI_DO, TM31	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 1750, 8060
	<b>P-Group:</b> Messages	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays the numbers of faults that have occurred.		
<b>Dependency:</b>	Refer to: r0947, r0948, r0949, r2109, r2130, r2133, r2136, r3120, r3122		
<b>Notice:</b>	The properties of the fault buffer should be taken from the corresponding product documentation.		
<b>Note:</b>	<p>The buffer parameters are cyclically updated in the background (refer to status signal in r2139).</p> <p>Fault buffer structure (general principle):</p> <p>r0945[0], r0949[0], r0948[0], r2109[0], r3115[0] --&gt; actual fault case, fault 1</p> <p>...</p> <p>r0945[7], r0949[7], r0948[7], r2109[7], r3115[7] --&gt; actual fault case, fault 8</p>		

r0945[8], r0949[8], r0948[8], r2109[8], r3115[8] --> 1st acknowledged fault case, fault 1

...

r0945[15], r0949[15], r0948[15], r2109[15], r3115[15] --> 1st acknowledged fault case, fault 8

...

r0945[56], r0949[56], r0948[56], r2109[56], r3115[56] --> 7th acknowledged fault case, fault 1

...

r0945[63], r0949[63], r0948[63], r2109[63], r3115[63] --> 7th acknowledged fault case, fault 8

---

**r0946[0...65534] Fault code list / Fault code list**

CU_DC, CU_DC_R,	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
CU_DC_R_S,	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
CU_DC_S,	<b>P-Group:</b> Messages	<b>Units group:</b> -	<b>Unit selection:</b> -
DC_CTRL,	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
DC_CTRL_R,			
DC_CTRL_R_S,			
DC_CTRL_S			

<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
-	-	-

**Description:** Lists the fault codes stored in the drive unit.  
The indices can only be accessed with a valid fault code.

**Dependency:** The parameter assigned to the fault code is entered in r0951 under the same index.

---

**r0946[0...65534] Fault code list / Fault code list**

TM150, TM15DI_DO,	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
TM31	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8060
	<b>P-Group:</b> Messages	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Lists the fault codes stored in the drive unit.  
The indices can only be accessed with a valid fault code.

**Dependency:** The parameter assigned to the fault code is entered in r0951 under the same index.

---

**r0947[0...63] Fault number / Fault number**

CU_DC, CU_DC_R,	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
CU_DC_R_S,	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
CU_DC_S,	<b>P-Group:</b> Messages	<b>Units group:</b> -	<b>Unit selection:</b> -
DC_CTRL,	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
DC_CTRL_R,			
DC_CTRL_R_S,			
DC_CTRL_S			

<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
-	-	-

**Description:** This parameter is identical to r0945.

---

**r0947[0...63] Fault number / Fault number**

TM150, TM15DI_DO,	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
TM31	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 1750, 8060
	<b>P-Group:</b> Messages	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** This parameter is identical to r0945.

**r0948[0...63]      Fault time received in milliseconds / t\_fault rcv ms**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S, DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> Messages <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> - [ms]	<b>Max</b> - [ms]	<b>Factory setting</b> - [ms]

**Description:** Displays the system runtime in milliseconds when the fault occurred.

**Dependency:** Refer to: r0945, r0947, r0949, r2109, r2114, r2130, r2133, r2136, r3115, r3120, r3122

**Notice:** The time comprises r2130 (days) and r0948 (milliseconds).

**Note:** The buffer parameters are cyclically updated in the background (refer to status signal in r2139).

The structure of the fault buffer and the assignment of the indices is shown in r0945.

When the parameter is read via PROFIdrive, the TimeDifference data type applies.

**r0948[0...63]      Fault time received in milliseconds / t\_fault rcv ms**

TM150, TM15DI_DO, TM31	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> Messages <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 1750, 8060 <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> - [ms]	<b>Max</b> - [ms]	<b>Factory setting</b> - [ms]

**Description:** Displays the system runtime in milliseconds when the fault occurred.

**Dependency:** Refer to: r0945, r0947, r0949, r2109, r2114, r2130, r2133, r2136, r3115, r3120, r3122

**Notice:** The time comprises r2130 (days) and r0948 (milliseconds).

**Note:** The buffer parameters are cyclically updated in the background (refer to status signal in r2139).

The structure of the fault buffer and the assignment of the indices is shown in r0945.

When the parameter is read via PROFIdrive, the TimeDifference data type applies.

**r0949[0...63]      Fault value / Fault value**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S, DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> Integer32 <b>P-Group:</b> Messages <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 8060 <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> -

**Description:** Displays additional information about the fault that occurred (as integer number).

**Dependency:** Refer to: r0945, r0947, r0948, r2109, r2130, r2133, r2136, r3115, r3120, r3122

**Note:** The buffer parameters are cyclically updated in the background (refer to status signal in r2139).

The structure of the fault buffer and the assignment of the indices is shown in r0945.

**r0949[0...63]      Fault value / Fault value**

TM150, TM15DI_DO, TM31	<b>Can be changed:</b> - <b>Data type:</b> Integer32 <b>P-Group:</b> Messages <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 1750, 8060 <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> -

**Description:** Displays additional information about the fault that occurred (as integer number).

**Dependency:** Refer to: r0945, r0947, r0948, r2109, r2130, r2133, r2136, r3115, r3120, r3122

**Note:** The buffer parameters are cyclically updated in the background (refer to status signal in r2139).  
The structure of the fault buffer and the assignment of the indices is shown in r0945.

<b>p0952</b>	<b>Fault cases counter / Fault cases qty</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S, DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned16 <b>P-Group:</b> Messages <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 8060 <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 65535	<b>Factory setting</b> 0
<b>Description:</b>	Number of fault situations that have occurred since the last reset.		
<b>Dependency:</b>	The fault buffer is deleted (cleared) by setting p0952 to 0. Refer to: r0945, r0947, r0948, r0949, r2109, r2130, r2133, r2136		

<b>p0952</b>	<b>Fault cases counter / Fault cases qty</b>		
TM150, TM15DI_DO, TM31	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned16 <b>P-Group:</b> Messages <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 1710, 8060 <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 65535	<b>Factory setting</b> 0
<b>Description:</b>	Number of fault situations that have occurred since the last reset.		
<b>Dependency:</b>	The fault buffer is deleted (cleared) by setting p0952 to 0. Refer to: r0945, r0947, r0948, r0949, r2109, r2130, r2133, r2136		

<b>r0963</b>	<b>PROFIBUS baud rate / PB baud rate</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned16 <b>P-Group:</b> Communications <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 255	<b>Factory setting</b> -
<b>Description:</b>	Displays the corresponding value for the PROFIBUS baud rate.		
<b>Value:</b>	0: 9.6 kbit/s 1: 19.2 kbit/s 2: 93.75 kbit/s 3: 187.5 kbit/s 4: 500 kbit/s 6: 1.5 Mbit/s 7: 3 Mbit/s 8: 6 Mbit/s 9: 12 Mbit/s 10: 31.25 kbit/s 11: 45.45 kbit/s 255: Unknown		

<b>r0964[0...6]</b>	<b>Device identification / Device ident.</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned16 <b>P-Group:</b> Communications <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the device identification.		
<b>Index:</b>	[0] = Company (Siemens = 42) [1] = Device type [2] = Firmware version [3] = Firmware date (year) [4] = Firmware date (day/month) [5] = Number of drive objects [6] = Firmware patch/hot fix		
<b>Note:</b>	Example: r0964[0] = 42 --> SIEMENS r0964[1] = 5490 --> SINAMICS DCM r0964[2] = 102 --> first part of the firmware version V01.02 (second part, refer to index 6) r0964[3] = 2010 --> year 2010 r0964[4] = 1401 --> 14th of January r0964[5] = 4 --> 4 drive objects r0964[6] = 600 --> second part, firmware version (complete version: V01.02.06.00)		
<b>r0965</b>	<b>PROFIdrive profile number / PD profile number</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned16 <b>P-Group:</b> Communications <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the PROFIdrive profile number and profile version. Constant value = 0329 hex. Byte 1: Profile number = 03 hex = PROFIdrive profile Byte 2: Profile version = 29 hex = Version 4.1		
<b>Note:</b>	When the parameter is read via PROFIdrive, the Octet String 2 data type applies.		
<b>p0969</b>	<b>System runtime relative / t_System relative</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 <b>P-Group:</b> Displays, signals <b>Not for motor type:</b> - <b>Min</b> 0 [ms]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 4294967295 [ms]	<b>Access level:</b> 3 <b>Func. diagram:</b> 8060 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0 [ms]
<b>Description:</b>	Displays the system runtime in ms since the last POWER ON.		
<b>Note:</b>	The value in p0969 can only be reset to 0. The value overflows after approx. 49 days. When the parameter is read via PROFIdrive, the TimeDifference data type applies.		

**p0970 TM150 reset parameters / TM150 par reset**

TM150	<b>Can be changed:</b> C2(30)	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Factory settings	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	100	0

**Description:** The parameter is used to initiate a reset of the parameters on Terminal Module 150 (TM150).

**Value:** 0: Inactive  
1: Start a parameter reset  
100: Start a BICO interconnection reset

**Dependency:** Refer to: p0010

**Notice:** After the value has been modified, no further parameter modifications can be made and the status is shown in r3996. Modifications can be made again when r3996 = 0.

**Note:** A factory setting run can only be started if p0010 was first set to 30 (parameter reset).  
At the end of the calculations, p0970 is automatically set to 0.

**p0970 TM15DI/DO reset parameter / TM15D par reset**

TM15DI_DO	<b>Can be changed:</b> C2(30)	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Factory settings	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	100	0

**Description:** The parameter is used to initiate a reset of the parameters on Terminal Module 15 (TM15).

The sampling time p4099 is not reset if in so doing a conflict occurs with the basic clock cycle.

Parameter p0151 is not reset. It is only reset if the entire drive unit is reset to the factory settings (p0976).

**Value:** 0: Inactive  
1: Start a parameter reset  
100: Start a BICO interconnection reset

**Dependency:** Refer to: p0010

**Notice:** After the value has been modified, no further parameter modifications can be made and the status is shown in r3996. Modifications can be made again when r3996 = 0.

**Note:** A factory setting run can only be started if p0010 was first set to 30 (parameter reset).  
At the end of the calculations, p0970 is automatically set to 0.

**p0970 TM31 reset parameters / TM31 par reset**

TM31	<b>Can be changed:</b> C2(30)	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Factory settings	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	100	0

**Description:** The parameter is used to initiate a reset of the parameters on Terminal Module 31 (TM31).

The sampling time p4099 is not reset if in so doing a conflict occurs with the basic clock cycle.


Parameter p0151 is not reset. It is only reset if the entire drive unit is reset to the factory settings (p0976).

**Value:** 0: Inactive  
1: Start a parameter reset  
100: Start a BICO interconnection reset


**Dependency:** Refer to: p0010

**Notice:** After the value has been modified, no further parameter modifications can be made and the status is shown in r3996. Modifications can be made again when r3996 = 0.

**Note:** A factory setting run can only be started if p0010 was first set to 30 (parameter reset).  
At the end of the calculations, p0970 is automatically set to 0.

p0971 Save drive object parameters / Drv_obj par save			
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S, DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Factory settings	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 1	<b>Factory setting</b> 0
<b>Description:</b>	Setting to save the parameter of the particular drive object in the non-volatile memory. When saving, only the adjustable parameters intended to be saved are taken into account.		
<b>Value:</b>	0: Inactive 1: Save drive object		
<b>Dependency:</b>	Refer to: p0977, r3996		
<b>Caution:</b>	If a memory card (optional) is inserted, the following applies: The parameters are also saved on the card and therefore overwrite any existing data!		
			
<b>Notice:</b>	The Control Unit power supply may only be powered down after data has been saved (i.e. after data save has been started, wait until the parameter again has the value 0). Writing to parameters is inhibited while saving. The progress while saving is displayed in r3996.		
<b>Note:</b>	Starting from the particular drive object, the following parameters are saved: CU3xx: Device-specific parameters and PROFIBUS device parameters. Other objects: Parameters of the actual object and PROFIBUS device parameters. Prerequisite: In order that the parameter of a drive object, saved with p0971 = 1, is read the next time that the Control Unit is booted, then all parameters must, as a minimum, have first been saved once with p0977 = 1.		

p0971 Save drive object parameters / Drv_obj par save			
TM150, TM15DI_DO, TM31	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Factory settings	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 1	<b>Factory setting</b> 0
<b>Description:</b>	Setting to save the parameter of the particular drive object in the non-volatile memory. When saving, only the adjustable parameters intended to be saved are taken into account.		
<b>Value:</b>	0: Inactive 1: Save drive object		
<b>Dependency:</b>	Refer to: p0977, r3996		
<b>Notice:</b>	The Control Unit power supply may only be powered down after data has been saved (i.e. after data save has been started, wait until the parameter again has the value 0). Writing to parameters is inhibited while saving. The progress while saving is displayed in r3996.		
<b>Note:</b>	Starting from the particular drive object, the following parameters are saved: CU3xx: Device-specific parameters and PROFIBUS device parameters. Other objects: Parameters of the actual object and PROFIBUS device parameters. Prerequisite: In order that the parameter of a drive object, saved with p0971 = 1, is read the next time that the Control Unit is booted, then all parameters must, as a minimum, have first been saved once with p0977 = 1.		

<b>p0972</b>			
<b>Drive unit reset / Drv_unit reset</b>			
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	3	0
<b>Description:</b>	Sets the required procedure to execute a hardware reset for the drive unit.		
<b>Value:</b>	0: Inactive 1: Hardware-Reset immediate 2: Hardware reset preparation 3: Hardware reset after cyclic communication has failed		
<b>Danger:</b>	It must be absolutely ensured that the system is in a safe condition.		
	The memory card/device memory of the Control Unit must not be accessed.		
<b>Note:</b>	If value = 1: Reset is immediately executed and communications interrupted. After communications have been established, check the reset operation (refer below). If value = 2: Help to check the reset operation. Firstly, set p0972 = 2 and then read back. Secondly, set p0972 = 1 (it is possible that this request is possibly no longer acknowledged). The communication is then interrupted. After communications have been established, check the reset operation (refer below). If value = 3: The reset is executed after interrupting cyclic communication. This setting is used to implement a synchronized reset by a control for several drive units. If cyclic communication is not active, then the reset is immediately executed. If the cyclic communication is active for both PROFIdrive interfaces, then the reset is executed after completing both cycle communications. After communications have been established, check the reset operation (refer below). To check the reset operation: After the drive unit has been restarted and communications have been established, read p0972 and check the following: p0972 = 0? --> The reset was successfully executed. p0972 > 0? --> The reset was not executed.		

<b>r0975[0...10]</b>			
<b>Drive object identification / DO identification</b>			
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S, TM150, TM15DI_DO, TM31	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays the identification of the drive object.		
<b>Index:</b>	[0] = Company (Siemens = 42) [1] = Drive object type [2] = Firmware version [3] = Firmware date (year) [4] = Firmware date (day/month) [5] = PROFIdrive drive object type class [6] = PROFIdrive drive object sub-type Class 1 [7] = Drive object number [8] = Reserved		



**Note:**

[9] = Reserved  
 [10] = Firmware patch/hot fix  
 Example:  
 r0975[0] = 42 --> SIEMENS  
 r0975[1] = 11 --> SERVO drive object type  
 r0975[2] = 102 --> first part, firmware version V01.02 (second part, refer to index 10)  
 r0975[3] = 2003 --> year 2003  
 r0975[4] = 1401 --> 14th of January  
 r0975[5] = 1 --> PROFIdrive drive object, type class  
 r0975[6] = 9 --> PROFIdrive drive object sub-type class 1  
 r0975[7] = 2 --> drive object number = 2  
 r0975[8] = 0 (reserved)  
 r0975[9] = 0 (reserved)  
 r0975[10] = 600 --> second part, firmware version (complete version: V01.02.06.00)

<b>r0975[0...10] Drive object identification / DO identification</b>			
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the identification of the drive object.

**Index:**

[0] = Company (Siemens = 42)  
 [1] = Drive object type  
 [2] = Firmware version  
 [3] = Firmware date (year)  
 [4] = Firmware date (day/month)  
 [5] = PROFIdrive drive object type class  
 [6] = PROFIdrive drive object sub-type Class 1  
 [7] = Drive object number  
 [8] = Reserved  
 [9] = Reserved  
 [10] = Firmware patch/hot fix

**Note:**

Example:  
 r0975[0] = 42 --> SIEMENS  
 r0975[1] = 17 --> DC\_CTRL drive object type  
 r0975[2] = 102 --> first part, firmware version V01.02 (second part, refer to index 10)  
 r0975[3] = 2003 --> year 2003  
 r0975[4] = 1401 --> 14th of January  
 r0975[5] = 1 --> PROFIdrive drive object, type class  
 r0975[6] = 9 --> PROFIdrive drive object sub-type class 1  
 r0975[7] = 2 --> drive object number = 2  
 r0975[8] = 0 (reserved)  
 r0975[9] = 0 (reserved)  
 r0975[10] = 600 --> second part, firmware version (complete version: V01.02.06.00)

<b>p0976 Reset and load all parameters / Reset load all par</b>			
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> C1(30)	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Factory settings	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	1013	0

**Description:** Resets or downloads all parameters of the drive system.

<b>Value:</b>	0: Inactive
	1: Start reset of all parameters to factory setting
	2: Start dnlod of param. saved in non-volatile mem w/ p0977=1
	3: Start download of volatile parameters from RAM
	10: Start dnlod of param. saved in non-volatile mem w/ p0977=10
	11: Start dnlod of param. saved in non-volatile mem w/ p0977=11
	12: Start dnlod of param. saved in non-volatile mem w/ p0977=12
	20: Start download Siemens internal setting 20
	100: Start resetting of all BICO interconnections
	200: Start deleting all user data
	1011: Start dnlod of param. saved in volatile mem w/ p0977=1011
	1012: Start dnlod of param. saved in volatile mem w/ p0977=1012
	1013: Start dnlod of param. saved in volatile mem w/ p0977=1013

**Notice:** After the value has been modified, no further parameter modifications can be made and the status is shown in r3996. Modifications can be made again when r3996 = 0.

After executing p0976 = 200, the Control Unit is powered on automatically.

**Note:** After all of the parameters have been reset to their factory setting, the system must be commissioned for the first time again.

Resetting or loading is realized in the non-volatile memory.

Procedure:

1. Set p0009 = 30 (parameter reset).
2. Set p0976 to "required value". The system is rebooted.  
p0976 is automatically set to 0 after execution.

---

### p0977 **Save all parameters / Save all par**

CU\_DC, CU\_DC\_R,  
CU\_DC\_R\_S,  
CU\_DC\_S

**Can be changed:** U, T

**Data type:** Unsigned16

**P-Group:** Factory settings

**Not for motor type:** -

**Min**

0

**Calculated:** -

**Dyn. index:** -

**Units group:** -

**Scaling:** -

**Max**

1013

**Access level:** 1

**Func. diagram:** -

**Unit selection:** -

**Expert list:** 1

**Factory setting**

0

**Description:** Saves all parameters of the drive system to the non-volatile memory.

When saving, only the adjustable parameters intended to be saved are taken into account.

<b>Value:</b>	0: Inactive
	1: Save in non-volatile memory - downloaded at POWER ON
	10: Save as opt. in non-vol. memory - downloaded w/ p0976=10
	11: Save as opt. in non-vol. memory - downloaded w/ p0976=11
	12: Save as opt. in non-vol. memory - downloaded w/ p0976=12
	20: Save in non-volatile memory as setting 20 (reserved)
	80: Save in non-volatile memory time-optimized (reserved)
	1011: Save in volatile memory, downloaded with p0976=1011
	1012: Save in volatile memory, downloaded with p0976=1012
	1013: Save in volatile memory, downloaded with p0976=1013

**Dependency:** Refer to: p0976, r3996

**Caution:** Memory card inserted:



The drive parameterization is also saved on the card. Any backed-up data is overwritten!

**Notice:** The Control Unit power supply may only be powered down after data has been saved (i.e. after data save has been started, wait until the parameter again has the value 0).

Writing to parameters is inhibited while saving.

The progress while saving is displayed in r3996.

**Note:** Parameters saved with p0977 = 10, 11 or 12 can be downloaded again with p0976 = 10, 11 or 12.

<b>p0978[0...24]</b>			
<b>List of drive objects / List of the DO</b>			
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> C1(1) <b>Data type:</b> Unsigned8 <b>P-Group:</b> Topology <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 255	<b>Access level:</b> 2 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> [0] 1 [1...24] 0
<b>Description:</b>	This parameter is an image of p0101 in conformance with PROFIdrive. Parameters p0101 and p0978 contain the following information: 1) The same number of drive objects 2) The same drive objects In this sense, they are consistent. Difference between p0101 and p0978: p0978 can be re-sorted and a zero inserted in order to identify those drive objects that participate in the process data exchange and to define their sequence in the process data exchange. Drive objects that are listed after the first zero, are excluded from the process data exchange. For p0978, in addition, the value 255 can be inserted a multiple number of times. p0978[n] = 255 means: The drive object is visible for the PROFIBUS master and is empty (without any actual process data exchange). This allows cyclic communications of a PROFIBUS master with unchanged configuring to the drive units with a lower number of drive objects.		
<b>Dependency:</b>	Refer to: p0101, p0971, p0977		
<b>Note:</b>	p0978 cannot be changed when the drive system is first commissioned. The reason for this is that at this time the actual topology has still not been acknowledged (p0099 is still not equal to r0098 and p0009 is set to 0).		
<hr/>			
<b>r0979[0...30]</b>			
<b>PROFIdrive encoder format / PD encoder format</b>			
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> Encoder <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 4704 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the actual position encoder used according to PROFIdrive.		
<b>Index:</b>	[0] = Header [1] = Type encoder 1 [2] = Resolution enc 1 [3] = Shift factor G1_XIST1 [4] = Shift factor G1_XIST2 [5] = Distinguishable revolutions encoder 1 [6...10] = Reserved [11] = Type encoder 2 [12] = Resolution enc 2 [13] = Shift factor G2_XIST1 [14] = Shift factor G2_XIST2 [15] = Distinguishable revolutions encoder 2 [16...20] = Reserved [21] = Type encoder 3 [22] = Resolution enc 3 [23] = Shift factor G3_XIST1 [24] = Shift factor G3_XIST2 [25] = Distinguishable revolutions encoder 3 [26...30] = Reserved		
<b>Note:</b>	Information about the individual indices can be taken from the following literature: PROFIdrive Profile Drive Technology		

---

**r0980[0...299] List of existing parameters 1 / List avail par 1**

All objects	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the parameters that exist for this drive.

**Dependency:** Refer to: r0981, r0989

**Note:** The existing parameters are displayed in indices 0 to 298. If an index contains the value 0, then the list ends here. In a long list, index 299 contains the parameter number at which position the list continues.

This list consists solely of the following parameters:

r0980[0...299], r0981[0...299] ... r0989[0...299]

The parameters in this list are not displayed in the expert list of the commissioning software. However, they can be read from a higher-level control system (e.g. PROFIBUS master).

---

**r0981[0...299] List of existing parameters 2 / List avail par 2**

All objects	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the parameters that exist for this drive.

**Dependency:** Refer to: r0980, r0989

**Note:** The existing parameters are displayed in indices 0 to 298. If an index contains the value 0, then the list ends here. In a long list, index 299 contains the parameter number at which position the list continues.

This list consists solely of the following parameters:

r0980[0...299], r0981[0...299] ... r0989[0...299]

The parameters in this list are not displayed in the expert list of the commissioning software. However, they can be read from a higher-level control system (e.g. PROFIBUS master).

---

**r0989[0...299] List of existing parameters 10 / List avail par 10**

All objects	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the parameters that exist for this drive.

**Dependency:** Refer to: r0980, r0981

**Note:** The existing parameters are displayed in indices 0 to 298. If an index contains the value 0, then the list ends here.

This list consists solely of the following parameters:

r0980[0...299], r0981[0...299] ... r0989[0...299]

The parameters in this list are not displayed in the expert list of the commissioning software. However, they can be read from a higher-level control system (e.g. PROFIBUS master).

<b>r0990[0...99]</b>	<b>List of modified parameters 1 / List chang. par 1</b>		
All objects	<b>Can be changed:</b> - <b>Data type:</b> Unsigned16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0 <b>Factory setting</b> -
<b>Description:</b>	Displays those parameters with a value other than the factory setting for this drive.		
<b>Dependency:</b>	Refer to: r0991, r0999		
<b>Note:</b>	Modified parameters are displayed in indices 0 to 98. If an index contains the value 0, then the list ends here. In a long list, index 99 contains the parameter number at which position the list continues. This list consists solely of the following parameters: r0990[0...99], r0991[0...99] ... r0999[0...99] The parameters in this list are not displayed in the expert list of the commissioning software. However, they can be read from a higher-level control system (e.g. PROFIBUS master).		
<b>r0991[0...99]</b>	<b>List of modified parameters 2 / List chang. par 2</b>		
All objects	<b>Can be changed:</b> - <b>Data type:</b> Unsigned16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0 <b>Factory setting</b> -
<b>Description:</b>	Displays those parameters with a value other than the factory setting for this drive.		
<b>Dependency:</b>	Refer to: r0990, r0999		
<b>Note:</b>	Modified parameters are displayed in indices 0 to 98. If an index contains the value 0, then the list ends here. In a long list, index 99 contains the parameter number at which position the list continues. This list consists solely of the following parameters: r0990[0...99], r0991[0...99] ... r0999[0...99] The parameters in this list are not displayed in the expert list of the commissioning software. However, they can be read from a higher-level control system (e.g. PROFIBUS master).		
<b>r0999[0...99]</b>	<b>List of modified parameters 10 / List chang. par 10</b>		
All objects	<b>Can be changed:</b> - <b>Data type:</b> Unsigned16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0 <b>Factory setting</b> -
<b>Description:</b>	Displays those parameters with a value other than the factory setting for this drive.		
<b>Dependency:</b>	Refer to: r0990, r0991		
<b>Note:</b>	Modified parameters are displayed in indices 0 to 98. If an index contains the value 0, then the list ends here. This list consists solely of the following parameters: r0990[0...99], r0991[0...99] ... r0999[0...99] The parameters in this list are not displayed in the expert list of the commissioning software. However, they can be read from a higher-level control system (e.g. PROFIBUS master).		

<b>p1000[0...n]</b>	<b>Macro Connector Inputs (CI) for speed setpoints / Macro CI n_set</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(1), T <b>Data type:</b> Unsigned32 <b>P-Group:</b> Commands <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 999999	<b>Access level:</b> 1 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	<p>Runs the corresponding macro files.</p> <p>The Connector Inputs (CI) for the speed setpoints of the appropriate Command Data Set (CDS) are appropriately interconnected.</p> <p>The selected macro file must be available on the memory card/device memory.</p> <p>Example: p1000 = 6 --&gt; the macro file PM000006.ACX is run.</p>		
<b>Dependency:</b>	Refer to: p0015, p0700, p1500, r8572		
<b>Caution:</b>	When executing a specific macro, the corresponding programmed settings are made and become active.		
<b>Notice:</b>	No errors were issued during quick commissioning (p3900 = 1) when writing to parameters of the QUICK_IBN group!		
<b>Note:</b>	<p>The macros in the specified directory are displayed in r8572. r8572 is not in the expert list of the commissioning software.</p> <p>Macros available as standard are described in the technical documentation of the particular product.</p> <p>CI: Connector Input</p>		
<b>p1035[0...n]</b>	<b>BI: Motorized potentiometer setpoint raise / Mop raise</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> Setpoints <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	<p>Sets the signal source to continually increase the setpoint for the motorized potentiometer.</p> <p>The setpoint change (CO: r1050) depends on the set ramp-up time (p1047) and the duration of the signal that is present (BI: p1035).</p>		
<b>Dependency:</b>	Refer to: p1036		
<b>Notice:</b>	The parameter may be protected as a result of p0922 or p2079 and cannot be changed.		
<b>p1036[0...n]</b>	<b>BI: Motorized potentiometer lower setpoint / Mop lower</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> Setpoints <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	<p>Sets the signal source to continuously lower the setpoint for the motorized potentiometer.</p> <p>The setpoint change (CO: r1050) depends on the set ramp-down time (p1048) and the duration of the signal that is present (BI: p1036).</p>		
<b>Dependency:</b>	Refer to: p1035		
<b>Notice:</b>	The parameter may be protected as a result of p0922 or p2079 and cannot be changed.		

<b>p1055[0...n]</b>	<b>BI: Jog bit 0 / Jog bit 0</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> Setpoints <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 2580 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the signal source for jog 1.		
<b>Recommend.:</b>	When the setting for this binector input is changed, the motor can only be switched on by means of an appropriate signal change of the source.		
<b>Dependency:</b>	Refer to: p0840		
<b>Notice:</b>	The drive is enabled for jogging using BI: p1055 or BI: p1056. The command "ON/OFF1" can be issued using BI: p0840 or using BI: p1055/p1056. Only the signal source that was used to power up can also be used to power down again.		
<b>p1056[0...n]</b>	<b>BI: Jog bit 1 / Jog bit 1</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> Setpoints <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 2580 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the signal source for jog 2.		
<b>Recommend.:</b>	When the setting for this binector input is changed, the motor can only be switched on by means of an appropriate signal change of the source.		
<b>Dependency:</b>	Refer to: p0840		
<b>Notice:</b>	The drive is enabled for jogging using BI: p1055 or BI: p1056. The command "ON/OFF1" can be issued using BI: p0840 or using BI: p1055/p1056. Only the signal source that was used to power up can also be used to power down again.		
<b>p1070[0...n]</b>	<b>CI: Main setpoint / Main setpoint</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> Setpoints <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> p2000 <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 3113 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the signal source for the main setpoint.		
<b>Notice:</b>	The parameter may be protected as a result of p0922 or p2079 and cannot be changed.		
<b>p1113[0...n]</b>	<b>BI: Setpoint inversion / Setp inv</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> Setpoints <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 2442, 3113 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the signal source to invert the setpoint.		
<b>Notice:</b>	The parameter may be protected as a result of p0922 or p2079 and cannot be changed.		

**p1140[0...n] BI: Enable ramp-function generator/inhibit ramp-function generator / RFG enable**DC\_CTRL,  
DC\_CTRL\_R,  
DC\_CTRL\_R\_S,  
DC\_CTRL\_S**Can be changed:** T**Calculated:** -**Access level:** 3**Data type:** Unsigned32 / Binary**Dyn. index:** CDS, p0170**Func. diagram:** 2580**P-Group:** Setpoints**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** -**Expert list:** 1**Min****Max****Factory setting**

-

-

1

**Description:**

Sets the signal source for the command "enable ramp-function generator/inhibit ramp-function generator".  
For the PROFIdrive profile, this command corresponds to control word 1 bit 4 (STW1.4).

BI: p1140 = 0 signal:

Inhibits the ramp-function generator (the ramp-function generator output is set to zero).

BI: p1140 = 1 signal:

Ramp-function generator enable.

**Dependency:**

Refer to: p1141, p1142

**Caution:**

When "master control from PC" is activated, this binector input is ineffective.

**Notice:**

The parameter may be protected as a result of p0922 or p2079 and cannot be changed.

**p1141[0...n] BI: Continue ramp-function generator/freeze ramp-function generator / Continue RFG**DC\_CTRL,  
DC\_CTRL\_R,  
DC\_CTRL\_R\_S,  
DC\_CTRL\_S**Can be changed:** T**Calculated:** -**Access level:** 3**Data type:** Unsigned32 / Binary**Dyn. index:** CDS, p0170**Func. diagram:** 2580**P-Group:** Setpoints**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** -**Expert list:** 1**Min****Max****Factory setting**

-

-

1

**Description:**

Sets the signal source for the command "continue ramp-function generator/freeze ramp-function generator".  
For the PROFIdrive profile, this command corresponds to control word 1 bit 5 (STW1.5).

BI: p1141 = 0 signal:

Freezes the ramp-function generator.

BI: p1141 = 1 signal:

Continue ramp-function generator.

**Dependency:**

Refer to: p1140, p1142

**Caution:**

When "master control from PC" is activated, this binector input is ineffective.

**p1142[0...n] BI: Enable setpoint/inhibit setpoint / Setpoint enable**DC\_CTRL,  
DC\_CTRL\_R,  
DC\_CTRL\_R\_S,  
DC\_CTRL\_S**Can be changed:** T**Calculated:** -**Access level:** 3**Data type:** Unsigned32 / Binary**Dyn. index:** CDS, p0170**Func. diagram:** 2580**P-Group:** Setpoints**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** -**Expert list:** 1**Min****Max****Factory setting**

-

-

1

**Description:**

Sets the signal source for the command "enable setpoint/inhibit setpoint".

For the PROFIdrive profile, this command corresponds to control word 1 bit 6 (STW1.6).

BI: p1142 = 0 signal

Inhibits the setpoint (the ramp-function generator input is set to zero).

BI: p1142 = 1 signal

Setpoint enable.

**Dependency:**

Refer to: p1140, p1141



**Caution:**



When "master control from PC" is activated, this binector input is ineffective.

**Notice:**

The parameter may be protected as a result of p0922 or p2079 and cannot be changed.

**Note:**

When the function module "position control" (r0108.3 = 1) is activated, this binector input is interconnected as follows as standard:

BI: p1142 = 0 signal

**r1407.0...15**

**CO/BO: Status word speed controller / ZSW n\_ctrl**

DC\_CTRL,  
DC\_CTRL\_R,  
DC\_CTRL\_R\_S,  
DC\_CTRL\_S

**Can be changed:** -

**Calculated:** -

**Access level:** 3

**Data type:** Unsigned32

**Dyn. index:** -

**Func. diagram:** -

**P-Group:** Closed-loop control

**Units group:** -

**Unit selection:** -

**Not for motor type:** REL

**Scaling:** -

**Expert list:** 1

**Min**

**Max**

**Factory setting**

-

-

-

**Description:**

Displays the status word of the speed controller.

**Bit field:**

Bit	Signal name	1 signal	0 signal	FP
00	U/f control active	Yes	No	-
01	Encoderless operation active	Yes	No	-
02	Torque control active	Yes	No	6030, 6060, 8010
03	Speed control active	Yes	No	6040
05	Speed controller I component frozen	Yes	No	6040
06	Speed controller I component set	Yes	No	6040
07	Torque limit reached	Yes	No	6060
08	Upper torque limit active	Yes	No	6060
09	Lower torque limit active	Yes	No	6060
10	Droop enabled	Yes	No	6030
11	Speed setpoint limited	Yes	No	6030
12	Ramp-function generator set	Yes	No	-
13	Encoderless operation due to a fault	Yes	No	-
14	I/f control active	Yes	No	-
15	Torque limit reached (without pre-control)	Yes	No	6060

**p1441[0...n]**

**Actual speed smoothing time / n\_act T\_smooth**

DC\_CTRL,  
DC\_CTRL\_R,  
DC\_CTRL\_R\_S,  
DC\_CTRL\_S

**Can be changed:** U, T

**Calculated:** CALC\_MOD\_CON

**Access level:** 3

**Data type:** FloatingPoint32

**Dyn. index:** DDS, p0180

**Func. diagram:** 4711

**P-Group:** Closed-loop control

**Units group:** -

**Unit selection:** -

**Not for motor type:** REL

**Scaling:** -

**Expert list:** 1

**Min**

**Max**

**Factory setting**

0.00 [ms]

50.00 [ms]

0.00 [ms]

**Description:**

Sets the smoothing time constant (PT1) for the speed actual value.


**Dependency:**

Refer to: r0063

**Note:**

The speed actual value should be smoothed for encoders with a low pulse number or for resolvers.

After this parameter has been changed, we recommend that the speed controller is adjusted and/or the speed controller settings Kp (r50219) and Tn (r50218) checked.

<b>p1500[0...n]</b>			
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Macro Connector Inputs (CI) for torque setpoints / Macro CI M_set</b>		
	<b>Can be changed:</b> C2(1), T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> CDS, p0170	<b>Func. diagram:</b> -
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> REL	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 999999	<b>Factory setting</b> 0
<b>Description:</b>	Runs the corresponding macro files. The Connector Inputs (CI) for the torque setpoints of the appropriate Command Data Set (CDS) are appropriately interconnected. The selected macro file must be available on the memory card/device memory. Example: p1500 = 6 --> the macro file PM000006.ACX is run.		
<b>Dependency:</b>	Refer to: p0015, p0700, p1000, r8573		
<b>Caution:</b>	When executing a specific macro, the corresponding programmed settings are made and become active.		
			
<b>Notice:</b>	No errors were issued during quick commissioning (p3900 = 1) when writing to parameters of the QUICK_IBN group!		
<b>Note:</b>	The macros in the specified directory are displayed in r8573. r8573 is not in the expert list of the commissioning software. Macros available as standard are described in the technical documentation of the particular product. CI: Connector Input		

<b>p1821[0...n]</b>			
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Direction of rotation / Dir of rot</b>		
	<b>Can be changed:</b> C2(1, 4)	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 4704, 4710, 4711
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 1	<b>Factory setting</b> 0
<b>Description:</b>	Setting to change the direction of rotation. Changing the parameter reverses the direction of the encoder actual value.		
<b>Value:</b>	0: CW 1: CCW		
<b>Caution:</b>	Changing the direction using p1820 or p1821 is not recognized by the "Safe Direction without encoder". As a consequence, the limit provided by SDI (Safe Direction) from r9733 no longer functions.		
<b>Notice:</b>	An appropriate fault is output for a drive data set changeover where the direction of rotation changes and the pulses are enabled.		

<b>p2000</b>			
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Reference speed / n_ref</b>		
	<b>Can be changed:</b> T	<b>Calculated:</b> CALC_MOD_ALL	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 3113, 9566, 9568, 9572
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 6.00 [rpm]	<b>Max</b> 210000.00 [rpm]	<b>Factory setting</b> 210000.00 [rpm]
<b>Description:</b>	Sets the reference quantity for speed. The reference quantity corresponds to 100% or 4000 hex (word) or 4000 0000 hex (double word).		
<b>Dependency:</b>	Refer to: p2001, p2002, p2003, r2004		

<b>p2001</b>	<b>Reference voltage / Reference voltage</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Communications <b>Not for motor type:</b> - <b>Min</b> 10 [Vrms]	<b>Calculated:</b> CALC_MOD_ALL <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 100000 [Vrms]	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1000 [Vrms]
<b>Description:</b>	Sets the reference quantity for voltages. The reference quantity corresponds to 100% or 4000 hex (word) or 4000 0000 hex (double word).		
<b>Note:</b>	For the automatic calculation (p0340 = 1, p3900 > 0) an appropriate pre-assignment is only made if the parameter is not inhibited from being overwritten using p0573 = 1. If a BICO interconnection is established between different physical quantities, then the particular reference quantities are used as internal conversion factor. For infeed units, the parameterized device supply voltage (p0210) is pre-assigned as the reference quantity. Example: The actual value of the DC link voltage (r0070) is connected to a test socket (e.g. p0771[0]). The actual voltage value is cyclically converted into a percentage of the reference voltage (p2001) and output according to the parameterized scaling.		
<b>p2002</b>	<b>Reference current / I_ref</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Communications <b>Not for motor type:</b> - <b>Min</b> 0.10 [Arms]	<b>Calculated:</b> CALC_MOD_ALL <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 100000.00 [Arms]	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 100.00 [Arms]
<b>Description:</b>	Sets the reference quantity for current. The reference quantity corresponds to 100% or 4000 hex (word) or 4000 0000 hex (double word).		
<b>p2003</b>	<b>Reference torque / M_ref</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Communications <b>Not for motor type:</b> - <b>Min</b> 0.01 [Nm]	<b>Calculated:</b> CALC_MOD_ALL <b>Dyn. index:</b> - <b>Units group:</b> 7_2 <b>Scaling:</b> - <b>Max</b> 20000000.00 [Nm]	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> p0505 <b>Expert list:</b> 1 <b>Factory setting</b> 1.00 [Nm]
<b>Description:</b>	Sets the reference quantity for torque. The reference quantity corresponds to 100% or 4000 hex (word) or 4000 0000 hex (double word).		
<b>r2004</b>	<b>Reference power / P_ref</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Communications <b>Not for motor type:</b> - <b>Min</b> - [kW]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> 14_10 <b>Scaling:</b> - <b>Max</b> - [kW]	<b>Access level:</b> 3 <b>Func. diagram:</b> 9566, 9568, 9572 <b>Unit selection:</b> p0505 <b>Expert list:</b> 1 <b>Factory setting</b> - [kW]
<b>Description:</b>	Displays the reference quantity for power. The reference quantity corresponds to 100% or 4000 hex (word) or 4000 0000 hex (double word).		
<b>Dependency:</b>	This value is calculated as follows: Closed-loop control: Calculated from torque times speed. Refer to: p2000, p2001, p2002, p2003		

**Note:** If a BICO interconnection is established between different physical quantities, then the particular reference quantities are used as internal conversion factor.  
The reference power is calculated as follows:  
-  $2 * \pi * \text{reference speed} / 60 * \text{reference torque (motor)}$

<b>p2005</b>	<b>Reference angle / Reference angle</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> T	<b>Calculated:</b> CALC_MOD_ALL	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 90.00 [°]	<b>Max</b> 180.00 [°]	<b>Factory setting</b> 90.00 [°]
<b>Description:</b>	Sets the reference quantity for angle. The reference quantity corresponds to 100% or 4000 hex (word) or 4000 0000 hex (double word).		

<b>p2006</b>	<b>Reference temp / Ref temp</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150, TM31	<b>Can be changed:</b> T	<b>Calculated:</b> CALC_MOD_ALL	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 50.00 [°C]	<b>Max</b> 300.00 [°C]	<b>Factory setting</b> 100.00 [°C]
<b>Description:</b>	Sets the reference quantity for temperature. All temperatures specified as relative value are referred to this reference quantity. The reference quantity corresponds to 100% or 4000 hex (word) or 4000 0000 hex (double word).		

<b>p2007</b>	<b>Reference acceleration / a_ref</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> T	<b>Calculated:</b> CALC_MOD_ALL	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0.01 [rev/s²]	<b>Max</b> 500000.00 [rev/s²]	<b>Factory setting</b> 0.01 [rev/s²]
<b>Description:</b>	Sets the reference quantity for acceleration. The reference quantity corresponds to 100% or 4000 hex (word) or 4000 0000 hex (double word).		

<b>p2011</b>	<b>Comm IF address / Comm add</b>		
CU_DC_R, CU_DC_R_S	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 1	<b>Max</b> 127	<b>Factory setting</b> 5
<b>Description:</b>	Sets the address for the commissioning interface (PPI).		
<b>Note:</b>	Only odd-numbered addresses can be set. Changes only become effective after POWER ON. The parameter is not influenced by setting the factory setting.		

<b>p2011</b>	<b>Comm IF address / Comm add</b>		
CU_DC, CU_DC_S	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 1	<b>Max</b> 127	<b>Factory setting</b> 3
<b>Description:</b>	Sets the address for the commissioning interface (PPI).		
<b>Note:</b>	Only odd-numbered addresses can be set. Changes only become effective after POWER ON. The parameter is not influenced by setting the factory setting.		

<b>r2019[0...7]</b>	<b>Comm IF error statistics / Comm err</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> -
<b>Description:</b>	Displays the receive errors at the commissioning interface (RS232).		
<b>Index:</b>	[0] = Number of error-free telegrams [1] = Number of rejected telegrams [2] = Number of framing errors [3] = Number of overrun errors [4] = Number of parity errors [5] = Number of starting character errors [6] = Number of checksum errors [7] = Number of length errors		

<b>p2020</b>	<b>Field bus interface baud rate / Field bus baud</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 4	<b>Max</b> 13	<b>Factory setting</b> 8
<b>Description:</b>	Sets the baud rate for the fieldbus interface USS.		
<b>Value:</b>	4: 2400 baud 5: 4800 baud 6: 9600 baud 7: 19200 baud 8: 38400 baud 9: 57600 baud 10: 76800 baud 11: 93750 baud 12: 115200 baud 13: 187500 baud		
<b>Note:</b>	Fieldbus IF: Fieldbus interface Changes only become effective after POWER ON. The parameter is not influenced by setting the factory setting. The parameter is set to the factory setting when the protocol is reselected.		

<b>p2021</b>	<b>Field bus interface address / Field bus address</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 31	<b>Factory setting</b> 0

**Description:** Sets the address for the fieldbus interface USS.

**Dependency:** Refer to: p2030

**Note:** Changes only become effective after POWER ON.  
The parameter is not influenced by setting the factory setting.  
The parameter is set to the factory setting when the protocol is reselected.

<b>p2022</b>	<b>Field bus int USS PZD no. / Field bus USS PZD</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 16	<b>Factory setting</b> 2

**Description:** Sets the number of 16-bit words in the PZD part of the USS telegram for the field bus interface.

**Dependency:** Refer to: p2030

**Note:** The parameter is not influenced by setting the factory setting.

<b>p2023</b>	<b>Field bus int USS PKW no. / Field bus USS PKW</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 127	<b>Factory setting</b> 127

**Description:** Sets the number of 16-bit words in the PKW part of the USS telegram for the field bus interface.

**Value:**  
0: PKW 0 words  
3: PKW 3 words  
4: PKW 4 words  
127: PKW variable

**Dependency:** Refer to: p2030

**Note:** The parameter is not influenced by setting the factory setting.

<b>r2029[0...7]</b>	<b>Field bus int error statistics / Field bus error</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> -

**Description:** Displays the receive errors on the field bus interface (USS).

**Index:**  
[0] = Number of error-free telegrams  
[1] = Number of rejected telegrams  
[2] = Number of framing errors  
[3] = Number of overrun errors  
[4] = Number of parity errors  
[5] = Number of starting character errors

[6] = Number of checksum errors  
[7] = Number of length errors

<b>p2030</b>					
<b>Field bus int protocol selection / Field bus protocol</b>					
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 1		
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -		
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -		
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1		
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>		
	0	3	3		
<b>Description:</b> Sets the communication protocol for the field bus interface.					
<b>Value:</b> 0: No protocol 1: USS 3: PROFIBUS					
<b>Note:</b> Changes only become effective after POWER ON. The parameter is not influenced by setting the factory setting.					
<hr/>					
<b>r2032</b>					
<b>Master control control word effective / PcCtrl STW eff</b>					
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2		
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -		
	<b>P-Group:</b> Displays, signals	<b>Units group:</b> -	<b>Unit selection:</b> -		
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1		
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>		
	-	-	-		
<b>Description:</b> Displays the effective control word 1 (STW1) of the drive for the master control.					
<b>Bit field:</b>					
	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>	<b>FP</b>
	00	ON/OFF1	Yes	No	-
	01	OC / OFF2	Yes	No	-
	02	OC / OFF3	Yes	No	-
	03	Operation enable	Yes	No	-
	04	Ramp-function generator enable	Yes	No	-
	05	Start ramp-function generator	Yes	No	-
	06	Speed setpoint enable	Yes	No	-
	07	Acknowledge fault	Yes	No	-
	08	Jog bit 0	Yes	No	3030
	09	Jog bit 1	Yes	No	3030
	10	Master ctrl by PLC	Yes	No	-
<b>Notice:</b> The master control only influences control word 1 and speed setpoint 1. Other control words/setpoints can be transferred from another automation device.					
<b>Note:</b> OC: Operating condition					
<hr/>					
<b>p2035</b>					
<b>Fieldbus interface USS PIV drive object number / Fieldbus USS DO_no</b>					
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2		
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -		
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -		
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1		
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>		
	1	62	2		
<b>Description:</b> Sets the drive object number for communication via the field bus interface (USS).					
<b>Dependency:</b> Refer to: p0978					
<b>Note:</b> p2035 defines the destination for USS parameter requests (PIV). p0978[0] defines the destination for USS process data (PZD). The parameter is available globally on all drive objects. The parameter is not influenced by setting the factory setting.					

<b>p2037</b>	<b>IF1 PROFIdrive STW1.10 = 0 mode / IF1 PD STW1.10=0</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> Communications <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 2	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the processing mode for PROFIdrive STW1.10 "master control by PLC". Generally, control world 1 is received with the first receive word (PZD1) (this is in conformance to the PROFIdrive profile). The behavior of STW1.10 = 0 corresponds to that of the PROFIdrive profile. For other applications that deviate from this, the behavior can be adapted using this particular parameter.		
<b>Value:</b>	0: Freeze setpoints and continue to process sign-of-life 1: Freeze setpoints and sign-of-life 2: Do not freeze setpoints		
<b>Recommend.:</b>	Do not change the setting p2037 = 0.		
<b>Note:</b>	If the STW1 is not transferred according to the PROFIdrive with PZD1 (with bit 10 "master control by PLC"), then p2037 should be set to 2.		
<b>p2038</b>	<b>IF1 PROFIdrive STW/ZSW interface mode / PD STW/ZSW IF mode</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> Communications <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 2	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the interface mode of the PROFIdrive control words and status words. When selecting a telegram via p0922 (p2079), this parameter influences the device-specific assignment of the bits in the control and status words.		
<b>Value:</b>	0: SINAMICS 2: VIK-NAMUR		
<b>Dependency:</b>	Refer to: p0922, p2079		
<b>Notice:</b>	The parameter may be protected as a result of p0922 or p2079 and cannot be changed.		
<b>p2039</b>	<b>Select debug monitor interface / Debug monit select</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned16 <b>P-Group:</b> Communications <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 3	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Sets the serial interface for the debug monitor. With p2039 = 1, the serial interface COM2 (X179) is set. Other values are not permitted.		
<b>p2040</b>	<b>Fieldbus interface monitoring time / Fieldbus t_monit</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Communications <b>Not for motor type:</b> - <b>Min</b> 0 [ms]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1999999 [ms]	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 100 [ms]
<b>Description:</b>	Sets the monitoring time to monitor the process data received via the fieldbus interface. If no process data is received within this time, then an appropriate message is output.		



**Note:** 0: The monitoring is de-activated.

<b>p2042</b>	<b>PROFIBUS Ident Number / PB Ident No.</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> Communications <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the PROFIBUS Ident Number (PNO-ID). SINAMICS can be operated with various identities on PROFIBUS. This allows the use of a PROFIBUS GSD that is independent of the device (e.g. PROFIdrive VIK-NAMUR with Ident Number 3AA0 hex).		
<b>Value:</b>	0: SINAMICS 1: VIK-NAMUR		
<b>Note:</b>	Every change only becomes effective after a POWER ON.		

<b>r2043.0...2</b>	<b>BO: IF1 PROFIdrive PZD state / IF1 PD PZD state</b>																		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned8 <b>P-Group:</b> Communications <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 2410 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -																
<b>Description:</b>	Displays the PROFIdrive PZD state.																		
<b>Bit field:</b>	<table> <tr> <th>Bit</th><th>Signal name</th><th>1 signal</th><th>0 signal</th><th>FP</th></tr> <tr> <td>00</td><td>Setpoint failure</td><td>Yes</td><td>No</td><td>-</td></tr> <tr> <td>02</td><td>Fieldbus oper</td><td>Yes</td><td>No</td><td>-</td></tr> </table>	Bit	Signal name	1 signal	0 signal	FP	00	Setpoint failure	Yes	No	-	02	Fieldbus oper	Yes	No	-			
Bit	Signal name	1 signal	0 signal	FP															
00	Setpoint failure	Yes	No	-															
02	Fieldbus oper	Yes	No	-															
<b>Dependency:</b>	Refer to: p2044																		
<b>Note:</b>	When using the "setpoint failure" signal, the bus can be monitored and an application-specific response triggered when the setpoint fails.																		

<b>p2044</b>	<b>IF1 PROFIdrive fault delay / IF1 PD fault delay</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Communications <b>Not for motor type:</b> - <b>Min</b> 0 [s]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 100 [s]	<b>Access level:</b> 3 <b>Func. diagram:</b> 2410 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0 [s]
<b>Description:</b>	Sets the delay time to initiate fault F01910 after a setpoint failure. The time until the fault is initiated can be used by the application. This means that it is possible to respond to the failure while the drive is still operational (e.g. emergency retraction).		
<b>Dependency:</b>	Refer to: r2043		

<b>p2047</b>	<b>PROFIBUS additional monitoring time / PB suppl t_monit</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Communications <b>Not for motor type:</b> - <b>Min</b> 0 [ms]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 20000 [ms]	<b>Access level:</b> 3 <b>Func. diagram:</b> 2410 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0 [ms]
<b>Description:</b>	Sets the additional monitoring time to monitor the process data received via PROFIBUS. The additional monitoring time enables short bus faults to be compensated. If no process data is received within this time, then an appropriate message is output.		

**Recommend.:** Do not set the additional monitoring time for clock-synchronous operation.

**Note:** For controller STOP, the additional monitoring time is not effective.

---

**p2048 IF1 PROFIdrive PZD sampling time / IF1 PZD t\_sample**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> C1(3)	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 1.00 [ms]	<b>Max</b> 16.00 [ms]	<b>Factory setting</b> 4.00 [ms]

**Description:** Sets the sampling time for the cyclic interface 1 (IF1).

**Note:** The system only permits certain sampling times and after writing to this parameter, displays the value that has actually been set.

For clock cycle synchronous operation, the specified bus cycle time applies (Tdp).

---

**r2050[0...19] CO: IF1 PROFIdrive PZD receive word / IF1 PZD rcv word**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> 4000H	<b>Expert list:</b> 1
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> -

**Description:** Connector output to interconnect PZD (setpoints) with word format received from the PROFIdrive controller.

**Index:**

- [0] = PZD 1
- [1] = PZD 2
- [2] = PZD 3
- [3] = PZD 4
- [4] = PZD 5
- [5] = PZD 6
- [6] = PZD 7
- [7] = PZD 8
- [8] = PZD 9
- [9] = PZD 10
- [10] = PZD 11
- [11] = PZD 12
- [12] = PZD 13
- [13] = PZD 14
- [14] = PZD 15
- [15] = PZD 16
- [16] = PZD 17
- [17] = PZD 18
- [18] = PZD 19
- [19] = PZD 20

**Note:** IF1: Interface 1

---

**r2050[0...63] CO: IF1 PROFIdrive PZD receive word / IF1 PZD rcv word**

DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2440
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> 4000H	<b>Expert list:</b> 1
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> -

**Description:** Connector output to interconnect PZD (setpoints) with word format received from the PROFIdrive controller.

**Index:**

- [0] = PZD 1
- [1] = PZD 2
- [2] = PZD 3

[3] = PZD 4  
[4] = PZD 5  
[5] = PZD 6  
[6] = PZD 7  
[7] = PZD 8  
[8] = PZD 9  
[9] = PZD 10  
[10] = PZD 11  
[11] = PZD 12  
[12] = PZD 13  
[13] = PZD 14  
[14] = PZD 15  
[15] = PZD 16  
[16] = PZD 17  
[17] = PZD 18  
[18] = PZD 19  
[19] = PZD 20  
[20] = PZD 21  
[21] = PZD 22  
[22] = PZD 23  
[23] = PZD 24  
[24] = PZD 25  
[25] = PZD 26  
[26] = PZD 27  
[27] = PZD 28  
[28] = PZD 29  
[29] = PZD 30  
[30] = PZD 31  
[31] = PZD 32  
[32] = PZD 33  
[33] = PZD 34  
[34] = PZD 35  
[35] = PZD 36  
[36] = PZD 37  
[37] = PZD 38  
[38] = PZD 39  
[39] = PZD 40  
[40] = PZD 41  
[41] = PZD 42  
[42] = PZD 43  
[43] = PZD 44  
[44] = PZD 45  
[45] = PZD 46  
[46] = PZD 47  
[47] = PZD 48  
[48] = PZD 49  
[49] = PZD 50  
[50] = PZD 51  
[51] = PZD 52  
[52] = PZD 53  
[53] = PZD 54  
[54] = PZD 55  
[55] = PZD 56  
[56] = PZD 57  
[57] = PZD 58  
[58] = PZD 59  
[59] = PZD 60  
[60] = PZD 61  
[61] = PZD 62  
[62] = PZD 63  
[63] = PZD 64

**Dependency:** Refer to: r2060

**Notice:** Where there is a multiple interconnection of a connector output, all the connector inputs must either have Integer or FloatingPoint data types.

A BICO interconnection for a single PZD can only take place either on r2050 or r2060.

**Note:** IF1: Interface 1

---

**r2050[0...4] CO: IF1 PROFIdrive PZD receive word / IF1 PZD rcv word**

TM150, TM15DI_DO, TM31	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> 4000H	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Connector output to interconnect PZD (setpoints) with word format received from the PROFIdrive controller.

**Index:**  
 [0] = PZD 1  
 [1] = PZD 2  
 [2] = PZD 3  
 [3] = PZD 4  
 [4] = PZD 5

**Note:** IF1: Interface 1

---

**p2051[0...24] CI: IF1 PROFIdrive PZD send word / IF1 PZD send word**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2450, 2483
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> 4000H	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Selects the PZD (actual values) with word format to be sent to the PROFIdrive controller.

**Index:**  
 [0] = PZD 1  
 [1] = PZD 2  
 [2] = PZD 3  
 [3] = PZD 4  
 [4] = PZD 5  
 [5] = PZD 6  
 [6] = PZD 7  
 [7] = PZD 8  
 [8] = PZD 9  
 [9] = PZD 10  
 [10] = PZD 11  
 [11] = PZD 12  
 [12] = PZD 13  
 [13] = PZD 14  
 [14] = PZD 15  
 [15] = PZD 16  
 [16] = PZD 17  
 [17] = PZD 18  
 [18] = PZD 19  
 [19] = PZD 20  
 [20] = PZD 21  
 [21] = PZD 22  
 [22] = PZD 23  
 [23] = PZD 24  
 [24] = PZD 25

**Notice:** The parameter may be protected as a result of p0922 or p2079 and cannot be changed.

**Note:** IF1: Interface 1

<b>p2051[0...63]</b>	<b>CI: IF1 PROFIdrive PZD send word / IF1 PZD send word</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2450, 2470, 2483
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> 4000H	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0
<b>Description:</b>	Selects the PZD (actual values) with word format to be sent to the PROFIdrive controller.		
<b>Index:</b>	[0] = PZD 1 [1] = PZD 2 [2] = PZD 3 [3] = PZD 4 [4] = PZD 5 [5] = PZD 6 [6] = PZD 7 [7] = PZD 8 [8] = PZD 9 [9] = PZD 10 [10] = PZD 11 [11] = PZD 12 [12] = PZD 13 [13] = PZD 14 [14] = PZD 15 [15] = PZD 16 [16] = PZD 17 [17] = PZD 18 [18] = PZD 19 [19] = PZD 20 [20] = PZD 21 [21] = PZD 22 [22] = PZD 23 [23] = PZD 24 [24] = PZD 25 [25] = PZD 26 [26] = PZD 27 [27] = PZD 28 [28] = PZD 29 [29] = PZD 30 [30] = PZD 31 [31] = PZD 32 [32] = PZD 33 [33] = PZD 34 [34] = PZD 35 [35] = PZD 36 [36] = PZD 37 [37] = PZD 38 [38] = PZD 39 [39] = PZD 40 [40] = PZD 41 [41] = PZD 42 [42] = PZD 43 [43] = PZD 44 [44] = PZD 45 [45] = PZD 46 [46] = PZD 47 [47] = PZD 48 [48] = PZD 49 [49] = PZD 50 [50] = PZD 51 [51] = PZD 52		

[52] = PZD 53  
 [53] = PZD 54  
 [54] = PZD 55  
 [55] = PZD 56  
 [56] = PZD 57  
 [57] = PZD 58  
 [58] = PZD 59  
 [59] = PZD 60  
 [60] = PZD 61  
 [61] = PZD 62  
 [62] = PZD 63  
 [63] = PZD 64

**Dependency:** Refer to: p2061

**Notice:** The parameter may be protected as a result of p0922 or p2079 and cannot be changed.

**Note:** IF1: Interface 1

---

### **p2051[0...4] CI: IF1 PROFIdrive PZD send word / IF1 PZD send word**

TM150, TM15DI_DO, TM31	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> 4000H	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Selects the PZD (actual values) with word format to be sent to the PROFIdrive controller.

**Index:**  
 [0] = PZD 1  
 [1] = PZD 2  
 [2] = PZD 3  
 [3] = PZD 4  
 [4] = PZD 5

**Notice:** The parameter may be protected as a result of p0922 or p2079 and cannot be changed.

**Note:** IF1: Interface 1

---

### **r2053[0...24] IF1 PROFIdrive diagnostics PZD send word / IF1 diag send word**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2483
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the PZD (actual values) with word format sent to the PROFIdrive controller.

**Index:**  
 [0] = PZD 1  
 [1] = PZD 2  
 [2] = PZD 3  
 [3] = PZD 4  
 [4] = PZD 5  
 [5] = PZD 6  
 [6] = PZD 7  
 [7] = PZD 8  
 [8] = PZD 9  
 [9] = PZD 10  
 [10] = PZD 11  
 [11] = PZD 12  
 [12] = PZD 13  
 [13] = PZD 14  
 [14] = PZD 15  
 [15] = PZD 16  
 [16] = PZD 17  
 [17] = PZD 18

[18] = PZD 19  
[19] = PZD 20  
[20] = PZD 21  
[21] = PZD 22  
[22] = PZD 23  
[23] = PZD 24  
[24] = PZD 25

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Bit 0	ON	OFF	-
	01	Bit 1	ON	OFF	-
	02	Bit 2	ON	OFF	-
	03	Bit 3	ON	OFF	-
	04	Bit 4	ON	OFF	-
	05	Bit 5	ON	OFF	-
	06	Bit 6	ON	OFF	-
	07	Bit 7	ON	OFF	-
	08	Bit 8	ON	OFF	-
	09	Bit 9	ON	OFF	-
	10	Bit 10	ON	OFF	-
	11	Bit 11	ON	OFF	-
	12	Bit 12	ON	OFF	-
	13	Bit 13	ON	OFF	-
	14	Bit 14	ON	OFF	-
	15	Bit 15	ON	OFF	-

**Note:** IF1: Interface 1

---

#### r2053[0...63] IF1 PROFIdrive diagnostics PZD send word / IF1 diag send word

DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2450, 2470
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the PZD (actual values) with word format sent to the PROFIdrive controller.

**Index:**

[0] = PZD 1  
[1] = PZD 2  
[2] = PZD 3  
[3] = PZD 4  
[4] = PZD 5  
[5] = PZD 6  
[6] = PZD 7  
[7] = PZD 8  
[8] = PZD 9  
[9] = PZD 10  
[10] = PZD 11  
[11] = PZD 12  
[12] = PZD 13  
[13] = PZD 14  
[14] = PZD 15  
[15] = PZD 16  
[16] = PZD 17  
[17] = PZD 18  
[18] = PZD 19  
[19] = PZD 20  
[20] = PZD 21  
[21] = PZD 22  
[22] = PZD 23  
[23] = PZD 24  
[24] = PZD 25  
[25] = PZD 26  
[26] = PZD 27

[27] = PZD 28  
 [28] = PZD 29  
 [29] = PZD 30  
 [30] = PZD 31  
 [31] = PZD 32  
 [32] = PZD 33  
 [33] = PZD 34  
 [34] = PZD 35  
 [35] = PZD 36  
 [36] = PZD 37  
 [37] = PZD 38  
 [38] = PZD 39  
 [39] = PZD 40  
 [40] = PZD 41  
 [41] = PZD 42  
 [42] = PZD 43  
 [43] = PZD 44  
 [44] = PZD 45  
 [45] = PZD 46  
 [46] = PZD 47  
 [47] = PZD 48  
 [48] = PZD 49  
 [49] = PZD 50  
 [50] = PZD 51  
 [51] = PZD 52  
 [52] = PZD 53  
 [53] = PZD 54  
 [54] = PZD 55  
 [55] = PZD 56  
 [56] = PZD 57  
 [57] = PZD 58  
 [58] = PZD 59  
 [59] = PZD 60  
 [60] = PZD 61  
 [61] = PZD 62  
 [62] = PZD 63  
 [63] = PZD 64

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Bit 0	ON	OFF	-
	01	Bit 1	ON	OFF	-
	02	Bit 2	ON	OFF	-
	03	Bit 3	ON	OFF	-
	04	Bit 4	ON	OFF	-
	05	Bit 5	ON	OFF	-
	06	Bit 6	ON	OFF	-
	07	Bit 7	ON	OFF	-
	08	Bit 8	ON	OFF	-
	09	Bit 9	ON	OFF	-
	10	Bit 10	ON	OFF	-
	11	Bit 11	ON	OFF	-
	12	Bit 12	ON	OFF	-
	13	Bit 13	ON	OFF	-
	14	Bit 14	ON	OFF	-
	15	Bit 15	ON	OFF	-

**Dependency:** Refer to: p2051, p2061

**Note:** IF1: Interface 1



**r2053[0...4] IF1 PROFIdrive diagnostics PZD send word / IF1 diag send word**

TM150, TM15DI_DO, TM31	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the PZD (actual values) with word format sent to the PROFIdrive controller.

**Index:**  
 [0] = PZD 1  
 [1] = PZD 2  
 [2] = PZD 3  
 [3] = PZD 4  
 [4] = PZD 5

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Bit 0	ON	OFF	-
	01	Bit 1	ON	OFF	-
	02	Bit 2	ON	OFF	-
	03	Bit 3	ON	OFF	-
	04	Bit 4	ON	OFF	-
	05	Bit 5	ON	OFF	-
	06	Bit 6	ON	OFF	-
	07	Bit 7	ON	OFF	-
	08	Bit 8	ON	OFF	-
	09	Bit 9	ON	OFF	-
	10	Bit 10	ON	OFF	-
	11	Bit 11	ON	OFF	-
	12	Bit 12	ON	OFF	-
	13	Bit 13	ON	OFF	-
	14	Bit 14	ON	OFF	-
	15	Bit 15	ON	OFF	-

**Note:** IF1: Interface 1

**r2054 PROFIBUS status / PB status**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2410
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	4	-

**Description:** Status display for the PROFIBUS interface.

**Value:**  
 0: OFF  
 1: No connection (search for baud rate)  
 2: Connection OK (baud rate found)  
 3: Cyclic connection with master (data exchange)  
 4: Cyclic data OK

**Note:** Re r2054 = 3:  
 In state 3 (the LED flashes green), a cyclic connection has been established to the PROFIBUS master; however, one of the following prerequisites is missing for cyclic operation:  
 - No setpoints are being received as the PROFIBUS master is in the STOP condition.  
 Only for clock-cycle synchronous operation, the following applies:  
 - The drive is not in synchronism as the global control (GC) has an error.  
 Re r2054 = 4:  
 In the status 4 (LED green), the cyclic connection to the PROFIBUS master has been established and setpoints are being received. The clock cycle synchronization is OK, the global control (GC) is error-free.  
 This state does not provide any statement regarding the quality of the clock cycle synchronous sign-of-life characters on the drive objects.

**r2055[0...2] PROFIBUS diagnostics standard / PB diag standard**CU\_DC, CU\_DC\_R,  
CU\_DC\_R\_S,  
CU\_DC\_S**Can be changed:** -**Data type:** Unsigned16**P-Group:** Communications**Not for motor type:** -**Min**

-

**Calculated:** -**Dyn. index:** -**Units group:** -**Scaling:** -**Max**

-

**Access level:** 3**Func. diagram:** 2410**Unit selection:** -**Expert list:** 1**Factory setting**

-

**Description:**

Diagnostics display for the PROFIBUS interface.

**Index:**

[0] = Master bus address

[1] = Master input total length bytes

[2] = Master output total length bytes

**r2060[0...62] CO: IF1 PROFIdrive PZD receive double word / IF1 PZD recv DW**DC\_CTRL,  
DC\_CTRL\_R,  
DC\_CTRL\_R\_S,  
DC\_CTRL\_S**Can be changed:** -**Data type:** Integer32**P-Group:** Communications**Not for motor type:** -**Min**

-

**Calculated:** -**Dyn. index:** -**Units group:** -**Scaling:** 4000H**Max**

-

**Access level:** 3**Func. diagram:** 2440, 2460**Unit selection:** -**Expert list:** 1**Factory setting**

-

**Description:**

Connector output to interconnect PZD (setpoints) with double word format received from the PROFIdrive controller.

**Index:**

[0] = PZD 1 + 2

[1] = PZD 2 + 3

[2] = PZD 3 + 4

[3] = PZD 4 + 5

[4] = PZD 5 + 6

[5] = PZD 6 + 7

[6] = PZD 7 + 8

[7] = PZD 8 + 9

[8] = PZD 9 + 10

[9] = PZD 10 + 11

[10] = PZD 11 + 12

[11] = PZD 12 + 13

[12] = PZD 13 + 14

[13] = PZD 14 + 15

[14] = PZD 15 + 16

[15] = PZD 16 + 17

[16] = PZD 17 + 18

[17] = PZD 18 + 19

[18] = PZD 19 + 20

[19] = PZD 20 + 21

[20] = PZD 21 + 22

[21] = PZD 22 + 23

[22] = PZD 23 + 24

[23] = PZD 24 + 25

[24] = PZD 25 + 26

[25] = PZD 26 + 27

[26] = PZD 27 + 28

[27] = PZD 28 + 29

[28] = PZD 29 + 30

[29] = PZD 30 + 31

[30] = PZD 31 + 32

[31] = PZD 32 + 33

[32] = PZD 33 + 34

[33] = PZD 34 + 35

[34] = PZD 35 + 36

[35] = PZD 36 + 37

[36] = PZD 37 + 38

[37] = PZD 38 + 39

[38] = PZD 39 + 40

[39] = PZD 40 + 41  
 [40] = PZD 41 + 42  
 [41] = PZD 42 + 43  
 [42] = PZD 43 + 44  
 [43] = PZD 44 + 45  
 [44] = PZD 45 + 46  
 [45] = PZD 46 + 47  
 [46] = PZD 47 + 48  
 [47] = PZD 48 + 49  
 [48] = PZD 49 + 50  
 [49] = PZD 50 + 51  
 [50] = PZD 51 + 52  
 [51] = PZD 52 + 53  
 [52] = PZD 53 + 54  
 [53] = PZD 54 + 55  
 [54] = PZD 55 + 56  
 [55] = PZD 56 + 57  
 [56] = PZD 57 + 58  
 [57] = PZD 58 + 59  
 [58] = PZD 59 + 60  
 [59] = PZD 60 + 61  
 [60] = PZD 61 + 62  
 [61] = PZD 62 + 63  
 [62] = PZD 63 + 64

**Dependency:** Refer to: r2050

**Notice:** Where there is a multiple interconnection of a connector output, all the connector inputs must either have Integer or FloatingPoint data types.  
 A BICO interconnection for a single PZD can only take place either on r2050 or r2060.  
 A maximum of 4 indices of the "trace" function can be used.

**Note:** IF1: Interface 1

---

**p2061[0...62] CI: IF1 PROFIdrive PZD send double word / IF1 PZD send DW**

DC\_CTRL,  
 DC\_CTRL\_R,  
 DC\_CTRL\_R\_S,  
 DC\_CTRL\_S

**Can be changed:** U, T

**Data type:** Unsigned32 / Integer32

**P-Group:** Communications

**Not for motor type:** -

**Min**

-

**Calculated:** -

**Dyn. index:** -

**Units group:** -

**Scaling:** 4000H

**Max**

-

**Access level:** 3

**Func. diagram:** 2450, 2470

**Unit selection:** -

**Expert list:** 1

**Factory setting**

0

**Description:** Selects the PZD (actual values) with double word format to be sent to the PROFIdrive controller.

**Index:** [0] = PZD 1 + 2  
 [1] = PZD 2 + 3  
 [2] = PZD 3 + 4  
 [3] = PZD 4 + 5  
 [4] = PZD 5 + 6  
 [5] = PZD 6 + 7  
 [6] = PZD 7 + 8  
 [7] = PZD 8 + 9  
 [8] = PZD 9 + 10  
 [9] = PZD 10 + 11  
 [10] = PZD 11 + 12  
 [11] = PZD 12 + 13  
 [12] = PZD 13 + 14  
 [13] = PZD 14 + 15  
 [14] = PZD 15 + 16  
 [15] = PZD 16 + 17  
 [16] = PZD 17 + 18  
 [17] = PZD 18 + 19  
 [18] = PZD 19 + 20  
 [19] = PZD 20 + 21  
 [20] = PZD 21 + 22

[21] = PZD 22 + 23  
 [22] = PZD 23 + 24  
 [23] = PZD 24 + 25  
 [24] = PZD 25 + 26  
 [25] = PZD 26 + 27  
 [26] = PZD 27 + 28  
 [27] = PZD 28 + 29  
 [28] = PZD 29 + 30  
 [29] = PZD 30 + 31  
 [30] = PZD 31 + 32  
 [31] = PZD 32 + 33  
 [32] = PZD 33 + 34  
 [33] = PZD 34 + 35  
 [34] = PZD 35 + 36  
 [35] = PZD 36 + 37  
 [36] = PZD 37 + 38  
 [37] = PZD 38 + 39  
 [38] = PZD 39 + 40  
 [39] = PZD 40 + 41  
 [40] = PZD 41 + 42  
 [41] = PZD 42 + 43  
 [42] = PZD 43 + 44  
 [43] = PZD 44 + 45  
 [44] = PZD 45 + 46  
 [45] = PZD 46 + 47  
 [46] = PZD 47 + 48  
 [47] = PZD 48 + 49  
 [48] = PZD 49 + 50  
 [49] = PZD 50 + 51  
 [50] = PZD 51 + 52  
 [51] = PZD 52 + 53  
 [52] = PZD 53 + 54  
 [53] = PZD 54 + 55  
 [54] = PZD 55 + 56  
 [55] = PZD 56 + 57  
 [56] = PZD 57 + 58  
 [57] = PZD 58 + 59  
 [58] = PZD 59 + 60  
 [59] = PZD 60 + 61  
 [60] = PZD 61 + 62  
 [61] = PZD 62 + 63  
 [62] = PZD 63 + 64

**Dependency:** Refer to: p2051

**Notice:** A BICO interconnection for a single PZD can only take place either on p2051 or p2061.

The parameter may be protected as a result of p0922 or p2079 and cannot be changed.

**Note:** IF1: Interface 1

r2063[0...62]		IF1 PROFIdrive diagnostics PZD send double word / IF1 diag send DW	
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	Can be changed: -	Calculated: -	Access level: 3
	Data type: Unsigned32	Dyn. index: -	Func. diagram: 2450, 2470
	P-Group: Communications	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min	Max	Factory setting
	-	-	-
Description:	Displays the PZD (actual values) with double word format sent to the PROFIdrive controller.		
Index:	[0] = PZD 1 + 2 [1] = PZD 2 + 3 [2] = PZD 3 + 4 [3] = PZD 4 + 5 [4] = PZD 5 + 6 [5] = PZD 6 + 7		

[6] = PZD 7 + 8  
 [7] = PZD 8 + 9  
 [8] = PZD 9 + 10  
 [9] = PZD 10 + 11  
 [10] = PZD 11 + 12  
 [11] = PZD 12 + 13  
 [12] = PZD 13 + 14  
 [13] = PZD 14 + 15  
 [14] = PZD 15 + 16  
 [15] = PZD 16 + 17  
 [16] = PZD 17 + 18  
 [17] = PZD 18 + 19  
 [18] = PZD 19 + 20  
 [19] = PZD 20 + 21  
 [20] = PZD 21 + 22  
 [21] = PZD 22 + 23  
 [22] = PZD 23 + 24  
 [23] = PZD 24 + 25  
 [24] = PZD 25 + 26  
 [25] = PZD 26 + 27  
 [26] = PZD 27 + 28  
 [27] = PZD 28 + 29  
 [28] = PZD 29 + 30  
 [29] = PZD 30 + 31  
 [30] = PZD 31 + 32  
 [31] = PZD 32 + 33  
 [32] = PZD 33 + 34  
 [33] = PZD 34 + 35  
 [34] = PZD 35 + 36  
 [35] = PZD 36 + 37  
 [36] = PZD 37 + 38  
 [37] = PZD 38 + 39  
 [38] = PZD 39 + 40  
 [39] = PZD 40 + 41  
 [40] = PZD 41 + 42  
 [41] = PZD 42 + 43  
 [42] = PZD 43 + 44  
 [43] = PZD 44 + 45  
 [44] = PZD 45 + 46  
 [45] = PZD 46 + 47  
 [46] = PZD 47 + 48  
 [47] = PZD 48 + 49  
 [48] = PZD 49 + 50  
 [49] = PZD 50 + 51  
 [50] = PZD 51 + 52  
 [51] = PZD 52 + 53  
 [52] = PZD 53 + 54  
 [53] = PZD 54 + 55  
 [54] = PZD 55 + 56  
 [55] = PZD 56 + 57  
 [56] = PZD 57 + 58  
 [57] = PZD 58 + 59  
 [58] = PZD 59 + 60  
 [59] = PZD 60 + 61  
 [60] = PZD 61 + 62  
 [61] = PZD 62 + 63  
 [62] = PZD 63 + 64

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Bit 0	ON	OFF	-
	01	Bit 1	ON	OFF	-
	02	Bit 2	ON	OFF	-
	03	Bit 3	ON	OFF	-
	04	Bit 4	ON	OFF	-

05	Bit 5	ON	OFF	-
06	Bit 6	ON	OFF	-
07	Bit 7	ON	OFF	-
08	Bit 8	ON	OFF	-
09	Bit 9	ON	OFF	-
10	Bit 10	ON	OFF	-
11	Bit 11	ON	OFF	-
12	Bit 12	ON	OFF	-
13	Bit 13	ON	OFF	-
14	Bit 14	ON	OFF	-
15	Bit 15	ON	OFF	-
16	Bit 16	ON	OFF	-
17	Bit 17	ON	OFF	-
18	Bit 18	ON	OFF	-
19	Bit 19	ON	OFF	-
20	Bit 20	ON	OFF	-
21	Bit 21	ON	OFF	-
22	Bit 22	ON	OFF	-
23	Bit 23	ON	OFF	-
24	Bit 24	ON	OFF	-
25	Bit 25	ON	OFF	-
26	Bit 26	ON	OFF	-
27	Bit 27	ON	OFF	-
28	Bit 28	ON	OFF	-
29	Bit 29	ON	OFF	-
30	Bit 30	ON	OFF	-
31	Bit 31	ON	OFF	-

**Notice:** A maximum of 4 indices of the "trace" function can be used.

**Note:** IF1: Interface 1

---

#### r2064[0...7] PB/PN diagnostics clock cycle synchronism / PB/PN diag clock

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Integer32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the last parameter received from the PROFIBUS/PROFINET controller for clock synchronism.  
The parameters for clock synchronism are created when configuring the bus and are transferred at the start of cyclic operation from the controller to the device.

**Index:** [0] = Clock synchronous mode activated  
[1] = Bus cycle time (Tdp) [μs]  
[2] = Master cycle time (Tmapc) [μs]  
[3] = Instant of actual value acquisition (Ti) [μs]  
[4] = Instant of setpoint acquisition (To) [μs]  
[5] = Data exchange interval (Tdx) [μs]  
[6] = PLL window (Tpll-w) [1/12 μs]  
[7] = PLL delay time (Tpll-d) [1/12 μs]

---

#### r2065 PB/PN controller sign of life diagnostics / PB/PN ctr SoL diag

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays how often the sign-of-life from the clock synchronous PROFIBUS/PROFINET controller last failed.

<b>r2067[0...1]</b>	<b>IF1 PZD maximum interconnected / IF1 PZDmaxIntercon</b>		
All objects	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Display for the maximum interconnected PZD in the receive/send direction Index 0: receive (r2050, r2060) Index 1: send (p2051, p2061)		

<b>r2074[0...19]</b>	<b>IF1 PROFIdrive diagnostics bus address PZD receive / IF1diag addr recv</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays the PROFIBUS address of the sender from which the process data (PZD) is received.		
<b>Index:</b>	[0] = PZD 1 [1] = PZD 2 [2] = PZD 3 [3] = PZD 4 [4] = PZD 5 [5] = PZD 6 [6] = PZD 7 [7] = PZD 8 [8] = PZD 9 [9] = PZD 10 [10] = PZD 11 [11] = PZD 12 [12] = PZD 13 [13] = PZD 14 [14] = PZD 15 [15] = PZD 16 [16] = PZD 17 [17] = PZD 18 [18] = PZD 19 [19] = PZD 20		
<b>Note:</b>	IF1: Interface 1 Value range: 0 - 125: Bus address of the sender 65535: not assigned		

<b>r2074[0...63]</b>	<b>IF1 PROFIdrive diagnostics bus address PZD receive / IF1diag addr recv</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays the PROFIBUS address of the sender from which the process data (PZD) is received.		
<b>Index:</b>	[0] = PZD 1 [1] = PZD 2 [2] = PZD 3		

[3] = PZD 4  
[4] = PZD 5  
[5] = PZD 6  
[6] = PZD 7  
[7] = PZD 8  
[8] = PZD 9  
[9] = PZD 10  
[10] = PZD 11  
[11] = PZD 12  
[12] = PZD 13  
[13] = PZD 14  
[14] = PZD 15  
[15] = PZD 16  
[16] = PZD 17  
[17] = PZD 18  
[18] = PZD 19  
[19] = PZD 20  
[20] = PZD 21  
[21] = PZD 22  
[22] = PZD 23  
[23] = PZD 24  
[24] = PZD 25  
[25] = PZD 26  
[26] = PZD 27  
[27] = PZD 28  
[28] = PZD 29  
[29] = PZD 30  
[30] = PZD 31  
[31] = PZD 32  
[32] = PZD 33  
[33] = PZD 34  
[34] = PZD 35  
[35] = PZD 36  
[36] = PZD 37  
[37] = PZD 38  
[38] = PZD 39  
[39] = PZD 40  
[40] = PZD 41  
[41] = PZD 42  
[42] = PZD 43  
[43] = PZD 44  
[44] = PZD 45  
[45] = PZD 46  
[46] = PZD 47  
[47] = PZD 48  
[48] = PZD 49  
[49] = PZD 50  
[50] = PZD 51  
[51] = PZD 52  
[52] = PZD 53  
[53] = PZD 54  
[54] = PZD 55  
[55] = PZD 56  
[56] = PZD 57  
[57] = PZD 58  
[58] = PZD 59  
[59] = PZD 60  
[60] = PZD 61  
[61] = PZD 62  
[62] = PZD 63  
[63] = PZD 64



**Note:** IF1: Interface 1  
Value range:  
0 - 125: Bus address of the sender  
65535: not assigned

---

**r2074[0...4] IF1 PROFIdrive diagnostics bus address PZD receive / IF1diag addr rcv**


---

TM150, TM15DI_DO, TM31	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the PROFIBUS address of the sender from which the process data (PZD) is received.

**Index:** [0] = PZD 1  
[1] = PZD 2  
[2] = PZD 3  
[3] = PZD 4  
[4] = PZD 5

**Note:** IF1: Interface 1  
Value range:  
0 - 125: Bus address of the sender  
65535: not assigned

---

**r2075[0...19] IF1 PROFIdrive diagnostics telegram offset PZD receive / IF1 diag offs rcv**


---

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2410
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the PZD byte offset in the PROFIdrive receive telegram (controller output).

**Index:** [0] = PZD 1  
[1] = PZD 2  
[2] = PZD 3  
[3] = PZD 4  
[4] = PZD 5  
[5] = PZD 6  
[6] = PZD 7  
[7] = PZD 8  
[8] = PZD 9  
[9] = PZD 10  
[10] = PZD 11  
[11] = PZD 12  
[12] = PZD 13  
[13] = PZD 14  
[14] = PZD 15  
[15] = PZD 16  
[16] = PZD 17  
[17] = PZD 18  
[18] = PZD 19  
[19] = PZD 20

**Note:** IF1: Interface 1  
Value range:  
0 - 242: Byte offset  
65535: not assigned

<b>r2075[0...63]</b>	<b>IF1 PROFIdrive diagnostics telegram offset PZD receive / IF1 diag offs recv</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2410
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays the PZD byte offset in the PROFIdrive receive telegram (controller output).		
<b>Index:</b>	[0] = PZD 1 [1] = PZD 2 [2] = PZD 3 [3] = PZD 4 [4] = PZD 5 [5] = PZD 6 [6] = PZD 7 [7] = PZD 8 [8] = PZD 9 [9] = PZD 10 [10] = PZD 11 [11] = PZD 12 [12] = PZD 13 [13] = PZD 14 [14] = PZD 15 [15] = PZD 16 [16] = PZD 17 [17] = PZD 18 [18] = PZD 19 [19] = PZD 20 [20] = PZD 21 [21] = PZD 22 [22] = PZD 23 [23] = PZD 24 [24] = PZD 25 [25] = PZD 26 [26] = PZD 27 [27] = PZD 28 [28] = PZD 29 [29] = PZD 30 [30] = PZD 31 [31] = PZD 32 [32] = PZD 33 [33] = PZD 34 [34] = PZD 35 [35] = PZD 36 [36] = PZD 37 [37] = PZD 38 [38] = PZD 39 [39] = PZD 40 [40] = PZD 41 [41] = PZD 42 [42] = PZD 43 [43] = PZD 44 [44] = PZD 45 [45] = PZD 46 [46] = PZD 47 [47] = PZD 48 [48] = PZD 49 [49] = PZD 50 [50] = PZD 51 [51] = PZD 52 [52] = PZD 53		

[53] = PZD 54  
[54] = PZD 55  
[55] = PZD 56  
[56] = PZD 57  
[57] = PZD 58  
[58] = PZD 59  
[59] = PZD 60  
[60] = PZD 61  
[61] = PZD 62  
[62] = PZD 63  
[63] = PZD 64

**Note:** IF1: Interface 1  
Value range:  
0 - 242: Byte offset  
65535: not assigned

---

#### **r2075[0...4] IF1 PROFIdrive diagnostics telegram offset PZD receive / IF1 diag offs recv**

TM150, TM15DI_DO, TM31	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the PZD byte offset in the PROFIdrive receive telegram (controller output).

**Index:** [0] = PZD 1  
[1] = PZD 2  
[2] = PZD 3  
[3] = PZD 4  
[4] = PZD 5

**Note:** IF1: Interface 1  
Value range:  
0 - 242: Byte offset  
65535: not assigned

---

#### **r2076[0...24] IF1 PROFIdrive diagnostics telegram offset PZD send / IF1 diag offs send**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2410
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the PZD byte offset in the PROFIdrive send telegram (controller input).

**Index:** [0] = PZD 1  
[1] = PZD 2  
[2] = PZD 3  
[3] = PZD 4  
[4] = PZD 5  
[5] = PZD 6  
[6] = PZD 7  
[7] = PZD 8  
[8] = PZD 9  
[9] = PZD 10  
[10] = PZD 11  
[11] = PZD 12  
[12] = PZD 13  
[13] = PZD 14  
[14] = PZD 15  
[15] = PZD 16

[16] = PZD 17  
 [17] = PZD 18  
 [18] = PZD 19  
 [19] = PZD 20  
 [20] = PZD 21  
 [21] = PZD 22  
 [22] = PZD 23  
 [23] = PZD 24  
 [24] = PZD 25

**Note:** IF1: Interface 1  
 Value range:  
 0 - 242: Byte offset  
 65535: not assigned

---

<b>r2076[0...63]</b>	<b>IF1 PROFIdrive diagnostics telegram offset PZD send / IF1 diag offs send</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2410
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the PZD byte offset in the PROFIdrive send telegram (controller input).

**Index:** [0] = PZD 1  
 [1] = PZD 2  
 [2] = PZD 3  
 [3] = PZD 4  
 [4] = PZD 5  
 [5] = PZD 6  
 [6] = PZD 7  
 [7] = PZD 8  
 [8] = PZD 9  
 [9] = PZD 10  
 [10] = PZD 11  
 [11] = PZD 12  
 [12] = PZD 13  
 [13] = PZD 14  
 [14] = PZD 15  
 [15] = PZD 16  
 [16] = PZD 17  
 [17] = PZD 18  
 [18] = PZD 19  
 [19] = PZD 20  
 [20] = PZD 21  
 [21] = PZD 22  
 [22] = PZD 23  
 [23] = PZD 24  
 [24] = PZD 25  
 [25] = PZD 26  
 [26] = PZD 27  
 [27] = PZD 28  
 [28] = PZD 29  
 [29] = PZD 30  
 [30] = PZD 31  
 [31] = PZD 32  
 [32] = PZD 33  
 [33] = PZD 34  
 [34] = PZD 35  
 [35] = PZD 36  
 [36] = PZD 37  
 [37] = PZD 38  
 [38] = PZD 39

[39] = PZD 40  
[40] = PZD 41  
[41] = PZD 42  
[42] = PZD 43  
[43] = PZD 44  
[44] = PZD 45  
[45] = PZD 46  
[46] = PZD 47  
[47] = PZD 48  
[48] = PZD 49  
[49] = PZD 50  
[50] = PZD 51  
[51] = PZD 52  
[52] = PZD 53  
[53] = PZD 54  
[54] = PZD 55  
[55] = PZD 56  
[56] = PZD 57  
[57] = PZD 58  
[58] = PZD 59  
[59] = PZD 60  
[60] = PZD 61  
[61] = PZD 62  
[62] = PZD 63  
[63] = PZD 64

**Note:** IF1: Interface 1  
Value range:  
0 - 242: Byte offset  
65535: not assigned

---

#### **r2076[0...4] IF1 PROFIdrive diagnostics telegram offset PZD send / IF1 diag offs send**

TM150, TM15DI_DO, TM31	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the PZD byte offset in the PROFIdrive send telegram (controller input).

**Index:** [0] = PZD 1  
[1] = PZD 2  
[2] = PZD 3  
[3] = PZD 4  
[4] = PZD 5

**Note:** IF1: Interface 1  
Value range:  
0 - 242: Byte offset  
65535: not assigned

---

#### **r2077[0...15] PROFIBUS diagnostics peer-to-peer data transfer addresses / PB diag peer addr**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned8	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the addresses of the slaves (peers) where peer-to-peer data transfer has been configured via PROFIBUS.

<b>p2079</b>	<b>IF1 PROFIdrive PZD telegram selection extended / IF1 PZD telegr ext</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> Communications <b>Not for motor type:</b> - <b>Min</b> 390	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 999	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 999
<b>Description:</b>	Sets the send and receive telegram. Contrary to p0922, a telegram can be selected using p2079 and subsequently expanded.		
<b>Value:</b>	390: SIEMENS telegram 390, PZD-2/2 999: Free telegram configuration with BICO		
<b>Note:</b>	For p0922 < 999 the following applies: p2079 has the same value and is inhibited. All of the interconnections and extensions contained in the telegram are inhibited. For p0922 = 999 the following applies: p2079 can be freely set. If p2079 is also set to 999, then all of the interconnections can be set. For p0922 = 999 and p2079 < 999 the following applies: The interconnections contained in the telegram are inhibited. However, the telegram can be extended.		
<b>p2079</b>	<b>IF1 PROFIdrive PZD telegram selection extended / IF1 PZD telegr ext</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> Communications <b>Not for motor type:</b> - <b>Min</b> 1	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 999	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 999
<b>Description:</b>	Sets the send and receive telegram. Contrary to p0922, a telegram can be selected using p2079 and subsequently expanded.		
<b>Value:</b>	1: Standard telegram 1, PZD-2/2 3: Standard telegram 3, PZD-5/9 4: Standard telegram 4, PZD-6/14 20: Standard telegram 20, PZD-2/6 220: SIEMENS telegram 220, PZD-10/10 352: SIEMENS telegram 352, PZD-6/6 999: Free telegram configuration with BICO		
<b>Dependency:</b>	Refer to: p0922		
<b>Note:</b>	For p0922 < 999 the following applies: p2079 has the same value and is inhibited. All of the interconnections and extensions contained in the telegram are inhibited. For p0922 = 999 the following applies: p2079 can be freely set. If p2079 is also set to 999, then all of the interconnections can be set. For p0922 = 999 and p2079 < 999 the following applies: The interconnections contained in the telegram are inhibited. However, the telegram can be extended.		
<b>p2080[0...15]</b>	<b>BI: Binector-connector converter status word 1 / Bin/con ZSW1</b>		
All objects	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> Communications <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 2472 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Selects bits to be sent to the PROFIdrive controller. The individual bits are combined to form status word 1.		

**Index:**

- [0] = Bit 0
- [1] = Bit 1
- [2] = Bit 2
- [3] = Bit 3
- [4] = Bit 4
- [5] = Bit 5
- [6] = Bit 6
- [7] = Bit 7
- [8] = Bit 8
- [9] = Bit 9
- [10] = Bit 10
- [11] = Bit 11
- [12] = Bit 12
- [13] = Bit 13
- [14] = Bit 14
- [15] = Bit 15

**Dependency:** Refer to: p2088, r2089

**Notice:** The parameter may be protected as a result of p0922 or p2079 and cannot be changed.

---

**p2081[0...15]    BI: Binector-connector converter status word 2 / Bin/con ZSW2**

All objects	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> Communications <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 2472 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
-------------	---	---	--

**Description:** Selects bits to be sent to the PROFIdrive controller.  
The individual bits are combined to form status word 2.

**Index:**

- [0] = Bit 0
- [1] = Bit 1
- [2] = Bit 2
- [3] = Bit 3
- [4] = Bit 4
- [5] = Bit 5
- [6] = Bit 6
- [7] = Bit 7
- [8] = Bit 8
- [9] = Bit 9
- [10] = Bit 10
- [11] = Bit 11
- [12] = Bit 12
- [13] = Bit 13
- [14] = Bit 14
- [15] = Bit 15

**Dependency:** Refer to: p2088, r2089

**Notice:** The parameter may be protected as a result of p0922 or p2079 and cannot be changed.

**Note:** For clock synchronous operation, bit 12 to 15 to transfer the sign-of-life are reserved in status word 2 - and may not be freely interconnected.

---

**p2082[0...15]    BI: Binector-connector converter status word 3 / Bin/con ZSW3**

All objects	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> Communications <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 2472 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
-------------	---	---	--

**Description:** Selects bits to be sent to the PROFIdrive controller.  
The individual bits are combined to form free status word 3.

**Index:**

- [0] = Bit 0
- [1] = Bit 1
- [2] = Bit 2
- [3] = Bit 3
- [4] = Bit 4
- [5] = Bit 5
- [6] = Bit 6
- [7] = Bit 7
- [8] = Bit 8
- [9] = Bit 9
- [10] = Bit 10
- [11] = Bit 11
- [12] = Bit 12
- [13] = Bit 13
- [14] = Bit 14
- [15] = Bit 15

**Dependency:** Refer to: p2088, r2089

**Notice:** The parameter may be protected as a result of p0922 or p2079 and cannot be changed.

---

### p2083[0...15] **BI: Binector-connector converter status word 4 / Bin/con ZSW4**

All objects	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2472
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Selects bits to be sent to the PROFIdrive controller.  
The individual bits are combined to form free status word 4.

**Index:**

- [0] = Bit 0
- [1] = Bit 1
- [2] = Bit 2
- [3] = Bit 3
- [4] = Bit 4
- [5] = Bit 5
- [6] = Bit 6
- [7] = Bit 7
- [8] = Bit 8
- [9] = Bit 9
- [10] = Bit 10
- [11] = Bit 11
- [12] = Bit 12
- [13] = Bit 13
- [14] = Bit 14
- [15] = Bit 15

**Dependency:** Refer to: p2088, r2089

---

### p2084[0...15] **BI: Binector-connector converter status word 5 / Bin/con ZSW5**

All objects	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2472
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Selects bits to be sent to the PROFIdrive controller.  
The individual bits are combined to form free status word 5.

**Index:**

- [0] = Bit 0
- [1] = Bit 1
- [2] = Bit 2



[3] = Bit 3  
 [4] = Bit 4  
 [5] = Bit 5  
 [6] = Bit 6  
 [7] = Bit 7  
 [8] = Bit 8  
 [9] = Bit 9  
 [10] = Bit 10  
 [11] = Bit 11  
 [12] = Bit 12  
 [13] = Bit 13  
 [14] = Bit 14  
 [15] = Bit 15

**Dependency:** Refer to: p2088, r2089

#### p2088[0...4] Invert binector-connector converter status word / Bin/con ZSW inv

All objects	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2472
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
-	-	0000 0000 0000 0000 bin	

**Description:** Setting to invert the individual binector inputs of the binector connector converter.

**Index:**  
 [0] = Status word 1  
 [1] = Status word 2  
 [2] = Free status word 3  
 [3] = Free status word 4  
 [4] = Free status word 5

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Bit 0	Inverted	Not inverted	-
	01	Bit 1	Inverted	Not inverted	-
	02	Bit 2	Inverted	Not inverted	-
	03	Bit 3	Inverted	Not inverted	-
	04	Bit 4	Inverted	Not inverted	-
	05	Bit 5	Inverted	Not inverted	-
	06	Bit 6	Inverted	Not inverted	-
	07	Bit 7	Inverted	Not inverted	-
	08	Bit 8	Inverted	Not inverted	-
	09	Bit 9	Inverted	Not inverted	-
	10	Bit 10	Inverted	Not inverted	-
	11	Bit 11	Inverted	Not inverted	-
	12	Bit 12	Inverted	Not inverted	-
	13	Bit 13	Inverted	Not inverted	-
	14	Bit 14	Inverted	Not inverted	-
	15	Bit 15	Inverted	Not inverted	-

**Dependency:** Refer to: p2080, p2081, p2082, p2083, r2089

#### r2089[0...4] CO: Send binector-connector converter status word / Bin/con ZSW send

All objects	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2472
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
-	-	-	

**Description:** Connector output to interconnect the status words to a PZD send word.

**Index:**  
 [0] = Status word 1  
 [1] = Status word 2  
 [2] = Free status word 3

[3] = Free status word 4

[4] = Free status word 5

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Bit 0	ON	OFF	-
	01	Bit 1	ON	OFF	-
	02	Bit 2	ON	OFF	-
	03	Bit 3	ON	OFF	-
	04	Bit 4	ON	OFF	-
	05	Bit 5	ON	OFF	-
	06	Bit 6	ON	OFF	-
	07	Bit 7	ON	OFF	-
	08	Bit 8	ON	OFF	-
	09	Bit 9	ON	OFF	-
	10	Bit 10	ON	OFF	-
	11	Bit 11	ON	OFF	-
	12	Bit 12	ON	OFF	-
	13	Bit 13	ON	OFF	-
	14	Bit 14	ON	OFF	-
	15	Bit 15	ON	OFF	-

**Dependency:** Refer to: p2051, p2080, p2081, p2082, p2083**Note:** r2089 together with p2080 to p2084 forms five binector-connector converters.

---

**r2090.0...15 BO: IF1 PROFIBUS PZD1 receive bit-serial / IF1 PZD1 recv bitw**

CU_DC, CU_DC_R,	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
CU_DC_R_S,	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2440, 2460,
CU_DC_S,			2481
DC_CTRL,	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
DC_CTRL_R,	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
DC_CTRL_R_S,			
DC_CTRL_S			

**Min****Max****Factory setting**

-

-

-

**Description:** Binector output for bit-serial interconnection of PZD1 (normally control word 1) received from the PROFIdrive controller.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Bit 0	ON	OFF	-
	01	Bit 1	ON	OFF	-
	02	Bit 2	ON	OFF	-
	03	Bit 3	ON	OFF	-
	04	Bit 4	ON	OFF	-
	05	Bit 5	ON	OFF	-
	06	Bit 6	ON	OFF	-
	07	Bit 7	ON	OFF	-
	08	Bit 8	ON	OFF	-
	09	Bit 9	ON	OFF	-
	10	Bit 10	ON	OFF	-
	11	Bit 11	ON	OFF	-
	12	Bit 12	ON	OFF	-
	13	Bit 13	ON	OFF	-
	14	Bit 14	ON	OFF	-
	15	Bit 15	ON	OFF	-

**Note:** IF1: Interface 1

**r2090.0...15 BO: IF1 PROFIBUS PZD1 receive bit-serial / IF1 PZD1 recv bitw**TM150, TM15DI\_DO,  
TM31**Can be changed:** -**Calculated:** -**Access level:** 3**Data type:** Unsigned16**Dyn. index:** -**Func. diagram:** 2468**P-Group:** Communications**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** -**Expert list:** 1**Min****Max****Factory setting**

-

-

-

**Description:**

Binector output for bit-serial interconnection of PZD1 (normally control word 1) received from the PROFIdrive controller.

**Bit field:**

Bit	Signal name	1 signal	0 signal	FP
00	Bit 0	ON	OFF	-
01	Bit 1	ON	OFF	-
02	Bit 2	ON	OFF	-
03	Bit 3	ON	OFF	-
04	Bit 4	ON	OFF	-
05	Bit 5	ON	OFF	-
06	Bit 6	ON	OFF	-
07	Bit 7	ON	OFF	-
08	Bit 8	ON	OFF	-
09	Bit 9	ON	OFF	-
10	Bit 10	ON	OFF	-
11	Bit 11	ON	OFF	-
12	Bit 12	ON	OFF	-
13	Bit 13	ON	OFF	-
14	Bit 14	ON	OFF	-
15	Bit 15	ON	OFF	-

**Note:**

IF1: Interface 1

**r2091.0...15 BO: IF1 PROFIdrive PZD2 receive bit-serial / IF1 PZD2 recv bitw**CU\_DC, CU\_DC\_R,  
CU\_DC\_R\_S,  
CU\_DC\_S,  
DC\_CTRL,  
DC\_CTRL\_R,  
DC\_CTRL\_R\_S,  
DC\_CTRL\_S**Can be changed:** -**Calculated:** -**Access level:** 3**Data type:** Unsigned16**Dyn. index:** -**Func. diagram:** 2460, 2481**P-Group:** Communications**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** -**Expert list:** 1**Min****Max****Factory setting**

-

-

-

**Description:**

Binector output for bit-serial interconnection of PZD2 received from the PROFIdrive controller.

**Bit field:**

Bit	Signal name	1 signal	0 signal	FP
00	Bit 0	ON	OFF	-
01	Bit 1	ON	OFF	-
02	Bit 2	ON	OFF	-
03	Bit 3	ON	OFF	-
04	Bit 4	ON	OFF	-
05	Bit 5	ON	OFF	-
06	Bit 6	ON	OFF	-
07	Bit 7	ON	OFF	-
08	Bit 8	ON	OFF	-
09	Bit 9	ON	OFF	-
10	Bit 10	ON	OFF	-
11	Bit 11	ON	OFF	-
12	Bit 12	ON	OFF	-
13	Bit 13	ON	OFF	-
14	Bit 14	ON	OFF	-
15	Bit 15	ON	OFF	-

**Note:**

IF1: Interface 1

**r2091.0...15 BO: IF1 PROFIdrive PZD2 receive bit-serial / IF1 PZD2 recv bitw**

TM150, TM15DI_DO, TM31	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2468
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Binector output for bit-serial interconnection of PZD2 received from the PROFIdrive controller.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Bit 0	ON	OFF	-
	01	Bit 1	ON	OFF	-
	02	Bit 2	ON	OFF	-
	03	Bit 3	ON	OFF	-
	04	Bit 4	ON	OFF	-
	05	Bit 5	ON	OFF	-
	06	Bit 6	ON	OFF	-
	07	Bit 7	ON	OFF	-
	08	Bit 8	ON	OFF	-
	09	Bit 9	ON	OFF	-
	10	Bit 10	ON	OFF	-
	11	Bit 11	ON	OFF	-
	12	Bit 12	ON	OFF	-
	13	Bit 13	ON	OFF	-
	14	Bit 14	ON	OFF	-
	15	Bit 15	ON	OFF	-

**Note:** IF1: Interface 1

**r2092.0...15 BO: IF1 PROFIdrive PZD3 receive bit-serial / IF1 PZD3 recv bitw**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2468
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Binector output for bit-serial interconnection of PZD3 received from the PROFIdrive controller.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Bit 0	ON	OFF	-
	01	Bit 1	ON	OFF	-
	02	Bit 2	ON	OFF	-
	03	Bit 3	ON	OFF	-
	04	Bit 4	ON	OFF	-
	05	Bit 5	ON	OFF	-
	06	Bit 6	ON	OFF	-
	07	Bit 7	ON	OFF	-
	08	Bit 8	ON	OFF	-
	09	Bit 9	ON	OFF	-
	10	Bit 10	ON	OFF	-
	11	Bit 11	ON	OFF	-
	12	Bit 12	ON	OFF	-
	13	Bit 13	ON	OFF	-
	14	Bit 14	ON	OFF	-
	15	Bit 15	ON	OFF	-

**Note:** IF1: Interface 1

**r2092.0...15****BO: IF1 PROFIdrive PZD3 receive bit-serial / IF1 PZD3 recv bitw**DC\_CTRL,  
DC\_CTRL\_R,  
DC\_CTRL\_R\_S,  
DC\_CTRL\_S**Can be changed:** -**Calculated:** -**Access level:** 3**Data type:** Unsigned16**Dyn. index:** -**Func. diagram:** 2460**P-Group:** Communications**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** -**Expert list:** 1**Min****Max****Factory setting**

-

-

-

**Description:**

Binector output for bit-serial interconnection of PZD3 received from the PROFIdrive controller.

**Bit field:**

Bit	Signal name	1 signal	0 signal	FP
00	Bit 0	ON	OFF	-
01	Bit 1	ON	OFF	-
02	Bit 2	ON	OFF	-
03	Bit 3	ON	OFF	-
04	Bit 4	ON	OFF	-
05	Bit 5	ON	OFF	-
06	Bit 6	ON	OFF	-
07	Bit 7	ON	OFF	-
08	Bit 8	ON	OFF	-
09	Bit 9	ON	OFF	-
10	Bit 10	ON	OFF	-
11	Bit 11	ON	OFF	-
12	Bit 12	ON	OFF	-
13	Bit 13	ON	OFF	-
14	Bit 14	ON	OFF	-
15	Bit 15	ON	OFF	-

**Note:**

IF1: Interface 1

**r2093.0...15****BO: IF1 PROFIdrive PZD4 receive bit-serial / IF1 PZD4 recv bitw**CU\_DC, CU\_DC\_R,  
CU\_DC\_R\_S,  
CU\_DC\_S**Can be changed:** -**Calculated:** -**Access level:** 3**Data type:** Unsigned16**Dyn. index:** -**Func. diagram:** 2468**P-Group:** Communications**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** -**Expert list:** 1**Min****Max****Factory setting**

-

-

-

**Description:**

Binector output for bit-serial interconnection of PZD4 (normally control word 2) received from the PROFIdrive controller.

**Bit field:**

Bit	Signal name	1 signal	0 signal	FP
00	Bit 0	ON	OFF	-
01	Bit 1	ON	OFF	-
02	Bit 2	ON	OFF	-
03	Bit 3	ON	OFF	-
04	Bit 4	ON	OFF	-
05	Bit 5	ON	OFF	-
06	Bit 6	ON	OFF	-
07	Bit 7	ON	OFF	-
08	Bit 8	ON	OFF	-
09	Bit 9	ON	OFF	-
10	Bit 10	ON	OFF	-
11	Bit 11	ON	OFF	-
12	Bit 12	ON	OFF	-
13	Bit 13	ON	OFF	-
14	Bit 14	ON	OFF	-
15	Bit 15	ON	OFF	-

**Note:**

IF1: Interface 1

**r2093.0...15****BO: IF1 PROFIdrive PZD4 receive bit-serial / IF1 PZD4 recv bitw**

DC\_CTRL,  
DC\_CTRL\_R,  
DC\_CTRL\_R\_S,  
DC\_CTRL\_S

**Can be changed:** -**Calculated:** -**Access level:** 3**Data type:** Unsigned16**Dyn. index:** -**Func. diagram:** 2460**P-Group:** Communications**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** -**Expert list:** 1**Min****Max****Factory setting**

-

-

-

**Description:**

Binector output for bit-serial interconnection of PZD4 (normally control word 2) received from the PROFIdrive controller.

**Bit field:**

Bit	Signal name	1 signal	0 signal	FP
00	Bit 0	ON	OFF	-
01	Bit 1	ON	OFF	-
02	Bit 2	ON	OFF	-
03	Bit 3	ON	OFF	-
04	Bit 4	ON	OFF	-
05	Bit 5	ON	OFF	-
06	Bit 6	ON	OFF	-
07	Bit 7	ON	OFF	-
08	Bit 8	ON	OFF	-
09	Bit 9	ON	OFF	-
10	Bit 10	ON	OFF	-
11	Bit 11	ON	OFF	-
12	Bit 12	ON	OFF	-
13	Bit 13	ON	OFF	-
14	Bit 14	ON	OFF	-
15	Bit 15	ON	OFF	-

**Note:**

IF1: Interface 1

**r2094.0...15****BO: Connector-binector converter binector output / Con/bin outp**

CU\_DC, CU\_DC\_R,  
CU\_DC\_R\_S,  
CU\_DC\_S,  
DC\_CTRL,  
DC\_CTRL\_R,  
DC\_CTRL\_R\_S,  
DC\_CTRL\_S

**Can be changed:** -**Calculated:** -**Access level:** 3**Data type:** Unsigned16**Dyn. index:** -**Func. diagram:** 2460, 2481**P-Group:** Communications**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** -**Expert list:** 1**Min****Max****Factory setting**

-

-

-

**Description:**

Binector output for bit-serial onward interconnection of a PZD word received from the PROFIdrive controller. The PZD is selected via p2099[0].

**Bit field:**

Bit	Signal name	1 signal	0 signal	FP
00	Bit 0	ON	OFF	-
01	Bit 1	ON	OFF	-
02	Bit 2	ON	OFF	-
03	Bit 3	ON	OFF	-
04	Bit 4	ON	OFF	-
05	Bit 5	ON	OFF	-
06	Bit 6	ON	OFF	-
07	Bit 7	ON	OFF	-
08	Bit 8	ON	OFF	-
09	Bit 9	ON	OFF	-
10	Bit 10	ON	OFF	-
11	Bit 11	ON	OFF	-
12	Bit 12	ON	OFF	-
13	Bit 13	ON	OFF	-
14	Bit 14	ON	OFF	-
15	Bit 15	ON	OFF	-

**Dependency:**

Refer to: p2099

**r2094.0...15 BO: Connector-binector converter binector output / Con/bin outp**

TM150, TM15DI_DO, TM31	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2468
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Binector output for bit-serial onward interconnection of a PZD word received from the PROFIdrive controller.  
The PZD is selected via p2099[0].

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Bit 0	ON	OFF	-
	01	Bit 1	ON	OFF	-
	02	Bit 2	ON	OFF	-
	03	Bit 3	ON	OFF	-
	04	Bit 4	ON	OFF	-
	05	Bit 5	ON	OFF	-
	06	Bit 6	ON	OFF	-
	07	Bit 7	ON	OFF	-
	08	Bit 8	ON	OFF	-
	09	Bit 9	ON	OFF	-
	10	Bit 10	ON	OFF	-
	11	Bit 11	ON	OFF	-
	12	Bit 12	ON	OFF	-
	13	Bit 13	ON	OFF	-
	14	Bit 14	ON	OFF	-
	15	Bit 15	ON	OFF	-

**Dependency:** Refer to: p2099

**r2095.0...15 BO: Connector-binector converter binector output / Con/bin outp**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S, DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2440, 2460, 2481
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Binector output for bit-serial interconnection of a PZD word received from the PROFIdrive controller.  
The PZD is selected via p2099[1].

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Bit 0	ON	OFF	-
	01	Bit 1	ON	OFF	-
	02	Bit 2	ON	OFF	-
	03	Bit 3	ON	OFF	-
	04	Bit 4	ON	OFF	-
	05	Bit 5	ON	OFF	-
	06	Bit 6	ON	OFF	-
	07	Bit 7	ON	OFF	-
	08	Bit 8	ON	OFF	-
	09	Bit 9	ON	OFF	-
	10	Bit 10	ON	OFF	-
	11	Bit 11	ON	OFF	-
	12	Bit 12	ON	OFF	-
	13	Bit 13	ON	OFF	-
	14	Bit 14	ON	OFF	-
	15	Bit 15	ON	OFF	-

**Dependency:** Refer to: p2099

**r2095.0...15 BO: Connector-binector converter binector output / Con/bin outp**

TM150, TM15DI_DO, TM31	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2468
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Binector output for bit-serial interconnection of a PZD word received from the PROFIdrive controller.  
The PZD is selected via p2099[1].

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Bit 0	ON	OFF	-
	01	Bit 1	ON	OFF	-
	02	Bit 2	ON	OFF	-
	03	Bit 3	ON	OFF	-
	04	Bit 4	ON	OFF	-
	05	Bit 5	ON	OFF	-
	06	Bit 6	ON	OFF	-
	07	Bit 7	ON	OFF	-
	08	Bit 8	ON	OFF	-
	09	Bit 9	ON	OFF	-
	10	Bit 10	ON	OFF	-
	11	Bit 11	ON	OFF	-
	12	Bit 12	ON	OFF	-
	13	Bit 13	ON	OFF	-
	14	Bit 14	ON	OFF	-
	15	Bit 15	ON	OFF	-

**Dependency:** Refer to: p2099

**p2098[0...1] Inverter connector-binector converter binector output / Con/bin outp inv**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S, DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2460, 2481
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0000 0000 0000 0000 bin

**Description:** Setting to invert the individual binector outputs of the connector-binector converter.  
Using p2098[0], the signals of CI: p2099[0] are influenced.  
Using p2098[1], the signals of CI: p2099[1] are influenced.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Bit 0	Inverted	Not inverted	-
	01	Bit 1	Inverted	Not inverted	-
	02	Bit 2	Inverted	Not inverted	-
	03	Bit 3	Inverted	Not inverted	-
	04	Bit 4	Inverted	Not inverted	-
	05	Bit 5	Inverted	Not inverted	-
	06	Bit 6	Inverted	Not inverted	-
	07	Bit 7	Inverted	Not inverted	-
	08	Bit 8	Inverted	Not inverted	-
	09	Bit 9	Inverted	Not inverted	-
	10	Bit 10	Inverted	Not inverted	-
	11	Bit 11	Inverted	Not inverted	-
	12	Bit 12	Inverted	Not inverted	-
	13	Bit 13	Inverted	Not inverted	-
	14	Bit 14	Inverted	Not inverted	-
	15	Bit 15	Inverted	Not inverted	-



**Dependency:** Refer to: r2094, r2095, p2099

<b>p2098[0...1]</b>	<b>Inverter connector-binector converter binector output / Con/bin outp inv</b>		
TM150, TM15DI_DO, TM31	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2468
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0000 0000 0000 0000 bin

**Description:** Setting to invert the individual binector outputs of the connector-binector converter.  
Using p2098[0], the signals of CI: p2099[0] are influenced.  
Using p2098[1], the signals of CI: p2099[1] are influenced.

<b>Bit field:</b>	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>	<b>FP</b>
	00	Bit 0	Inverted	Not inverted	-
	01	Bit 1	Inverted	Not inverted	-
	02	Bit 2	Inverted	Not inverted	-
	03	Bit 3	Inverted	Not inverted	-
	04	Bit 4	Inverted	Not inverted	-
	05	Bit 5	Inverted	Not inverted	-
	06	Bit 6	Inverted	Not inverted	-
	07	Bit 7	Inverted	Not inverted	-
	08	Bit 8	Inverted	Not inverted	-
	09	Bit 9	Inverted	Not inverted	-
	10	Bit 10	Inverted	Not inverted	-
	11	Bit 11	Inverted	Not inverted	-
	12	Bit 12	Inverted	Not inverted	-
	13	Bit 13	Inverted	Not inverted	-
	14	Bit 14	Inverted	Not inverted	-
	15	Bit 15	Inverted	Not inverted	-

**Dependency:** Refer to: r2094, r2095, p2099

<b>p2099[0...1]</b>	<b>CI: Connector-binector converter signal source / Con/bin S_src</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S, DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2460, 2481
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Sets the signal source for the connector-binector converter.  
A PZD receive word can be selected as signal source. The signals are available to be serially passed-on (interconnection).

**Dependency:** Refer to: r2094, r2095

**Note:** From the signal source set via the connector input, the corresponding lower 16 bits are converted.  
p2099[0...1] together with r2094.0...15 and r2095.0...15 forms two connector-binector converters:  
Connector input p2099[0] to binector output in r2094.0...15  
Connector input p2099[1] to binector output in r2095.0...15

<b>p2099[0...1]</b>	<b>CI: Connector-binector converter signal source / Con/bin S_src</b>		
TM150, TM15DI_DO, TM31	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 / Integer16 <b>P-Group:</b> Communications <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 2468 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the signal source for the connector-binector converter. A PZD receive word can be selected as signal source. The signals are available to be serially passed-on (interconnection).		
<b>Dependency:</b>	Refer to: r2094, r2095		
<b>Note:</b>	From the signal source set via the connector input, the corresponding lower 16 bits are converted. p2099[0...1] together with r2094.0...15 and r2095.0...15 forms two connector-binector converters: Connector input p2099[0] to binector output in r2094.0...15 Connector input p2099[1] to binector output in r2095.0...15		
<b>p2100[0...19]</b>	<b>Setting the fault number for fault response / F_no F response</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S, DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned16 <b>P-Group:</b> Messages <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 65535	<b>Access level:</b> 3 <b>Func. diagram:</b> 8075 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Selects the faults for which the fault response should be changed		
<b>Dependency:</b>	The fault is selected and the required response is set under the same index. Refer to: p2101		
<b>Notice:</b>	For the following cases, it is not possible to re-parameterize the fault response to a fault: - if there is no existing fault number. - the message type is not "fault" (F).		
<b>Note:</b>	Re-parameterization is also possible if a fault is present. The change only becomes effective after the fault has been resolved.		
<b>p2100[0...19]</b>	<b>Setting the fault number for fault response / F_no F response</b>		
TM150, TM15DI_DO, TM31	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned16 <b>P-Group:</b> Messages <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 65535	<b>Access level:</b> 3 <b>Func. diagram:</b> 1750, 8075 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Selects the faults for which the fault response should be changed		
<b>Dependency:</b>	The fault is selected and the required response is set under the same index. Refer to: p2101		
<b>Notice:</b>	For the following cases, it is not possible to re-parameterize the fault response to a fault: - if there is no existing fault number. - the message type is not "fault" (F).		
<b>Note:</b>	Re-parameterization is also possible if a fault is present. The change only becomes effective after the fault has been resolved.		

<b>p2101[0...19]</b>	<b>Setting the fault response / Fault response</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> Integer16 <b>P-Group:</b> Messages <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 0	<b>Access level:</b> 3 <b>Func. diagram:</b> 8075 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the fault response for the selected fault.		
<b>Value:</b>	0: NONE		
<b>Dependency:</b>	The fault is selected and the required response is set under the same index.		
<b>Note:</b>	Re-parameterization is also possible if a fault is present. The change only becomes effective after the fault has been resolved.		

---

<b>p2101[0...19]</b>	<b>Setting the fault response / Fault response</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> U, T <b>Data type:</b> Integer16 <b>P-Group:</b> Messages <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 7	<b>Access level:</b> 3 <b>Func. diagram:</b> 8075 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the fault response for the selected fault.		
<b>Value:</b>	0: NONE 1: OFF1 2: OFF2 3: OFF3 4: Reserved 5: Reserved 6: Reserved 7: Reserved		
<b>Dependency:</b>	The fault is selected and the required response is set under the same index. Refer to: p2100		
<b>Note:</b>	Re-parameterization is also possible if a fault is present. The change only becomes effective after the fault has been resolved. The fault response can only be changed for faults with the appropriate identification (see the List Manual, chapter "Faults and alarms"). Example: F12345 and fault response = OFF3 (OFF1, OFF2, NONE) --> The default fault response OFF3 can be changed to OFF1, OFF2 or NONE. Re value = 1 (OFF1): Braking along the ramp-function generator down ramp followed by a pulse inhibit. Re value = 2 (OFF2): Internal/external pulse inhibit. Re value = 3 (OFF3): Braking along the OFF3 down ramp followed by a pulse inhibit. Parameter values designated as "reserved", act just like the value = 2 (OFF2)		

**p2101[0...19]      Setting the fault response / Fault response**

TM150, TM15DI_DO, TM31	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 1750, 8075
	<b>P-Group:</b> Messages	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 0	<b>Factory setting</b> 0
<b>Description:</b>	Sets the fault response for the selected fault.		
<b>Value:</b>	0:    NONE		
<b>Dependency:</b>	The fault is selected and the required response is set under the same index.		
<b>Note:</b>	Re-parameterization is also possible if a fault is present. The change only becomes effective after the fault has been resolved.		

**p2102      BI: Acknowledge all faults / Ackn all faults**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2546, 8060
	<b>P-Group:</b> Messages	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> 0
<b>Description:</b>	Sets the signal source to acknowledge all faults at all drive objects of the drive system.		
<b>Note:</b>	A fault acknowledgement is triggered with a 0/1 signal.		

**p2103      BI: 1. Acknowledge faults / 1. Acknowledge**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S, TM150, TM15DI_DO, TM31	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Messages	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> 0
<b>Description:</b>	Sets the first signal source to acknowledge faults.		
<b>Notice:</b>	The parameter may be protected as a result of p0922 or p2079 and cannot be changed.		
<b>Note:</b>	A fault acknowledgement is triggered with a 0/1 signal.		

**p2103[0...n]      BI: 1. Acknowledge faults / 1. Acknowledge**

DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> CDS, p0170	<b>Func. diagram:</b> 2546
	<b>P-Group:</b> Messages	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> 0
<b>Description:</b>	Sets the first signal source to acknowledge faults.		
<b>Notice:</b>	The parameter may be protected as a result of p0922 or p2079 and cannot be changed.		
<b>Note:</b>	A fault acknowledgement is triggered with a 0/1 signal.		

<b>p2104</b>	<b>BI: 2. Acknowledge faults / 2. Acknowledge</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S, TM150, TM15DI_DO, TM31	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> Messages <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the second signal source to acknowledge faults.		
<b>Note:</b>	A fault acknowledgement is triggered with a 0/1 signal.		
<b>p2104[0...n]</b>	<b>BI: 2. Acknowledge faults / 2. Acknowledge</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> Messages <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 2546 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the second signal source to acknowledge faults.		
<b>Note:</b>	A fault acknowledgement is triggered with a 0/1 signal.		
<b>p2105</b>	<b>BI: 3. Acknowledge faults / 3. Acknowledge</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S, TM150, TM15DI_DO, TM31	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> Messages <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the third signal source to acknowledge faults.		
<b>Note:</b>	A fault acknowledgement is triggered with a 0/1 signal.		
<b>p2105[0...n]</b>	<b>BI: 3. Acknowledge faults / 3. Acknowledge</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> Messages <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 2546 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the third signal source to acknowledge faults.		
<b>Note:</b>	A fault acknowledgement is triggered with a 0/1 signal.		
<b>p2106</b>	<b>BI: External fault 1 / External fault 1</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S, TM150, TM15DI_DO, TM31	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> Messages <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Sets the signal source for external fault 1.		
<b>Note:</b>	An external fault is triggered with a 1/0 signal. If this fault is output at the Control Unit, then it is transferred to all existing drive objects.		

<b>p2106[0...n]</b>	<b>BI: External fault 1 / External fault 1</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> Messages <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 2546 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Sets the signal source for external fault 1.		
<b>Note:</b>	An external fault is triggered with a 1/0 signal. If this fault is output at the Control Unit, then it is transferred to all existing drive objects.		
<b>p2107</b>	<b>BI: External fault 2 / External fault 2</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S, TM150, TM15DI_DO, TM31	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> Messages <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Sets the signal source for external fault 2.		
<b>Note:</b>	An external fault is triggered with a 1/0 signal. If this fault is output at the Control Unit, then it is transferred to all existing drive objects.		
<b>p2107[0...n]</b>	<b>BI: External fault 2 / External fault 2</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> Messages <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 2546 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Sets the signal source for external fault 2.		
<b>Note:</b>	An external fault is triggered with a 1/0 signal. If this fault is output at the Control Unit, then it is transferred to all existing drive objects.		
<b>p2108</b>	<b>BI: External fault 3 / External fault 3</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S, TM150, TM15DI_DO, TM31	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> Messages <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Sets the signal source for external fault 3. External fault 3 is initiated by the following AND logic operation: - BI: p2108 negated - BI: p3111 - BI: p3112 negated		
<b>Dependency:</b>	Refer to: p3110, p3111, p3112		
<b>Note:</b>	An external fault is triggered with a 1/0 signal. If this fault is output at the Control Unit, then it is transferred to all existing drive objects.		

<b>p2108[0...n]</b>	<b>BI: External fault 3 / External fault 3</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> Messages <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 2546 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Sets the signal source for external fault 3. External fault 3 is initiated by the following AND logic operation: - BI: p2108 negated - BI: p3111 - BI: p3112 negated		
<b>Dependency:</b>	Refer to: p3110, p3111, p3112		
<b>Note:</b>	An external fault is triggered with a 1/0 signal. If this fault is output at the Control Unit, then it is transferred to all existing drive objects.		
<b>r2109[0...63]</b>	<b>Fault time removed in milliseconds / t_flt resolved ms</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S, TM150, TM15DI_DO, TM31	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> Messages <b>Not for motor type:</b> - <b>Min</b> - [ms]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> - [ms]	<b>Access level:</b> 3 <b>Func. diagram:</b> 1750, 8060 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [ms]
<b>Description:</b>	Displays the system runtime in milliseconds when the fault was removed.		
<b>Dependency:</b>	Refer to: r0945, r0947, r0948, r0949, r2114, r2130, r2133, r2136, r3115, r3120, r3122		
<b>Notice:</b>	The time comprises r2136 (days) and r2109 (milliseconds).		
<b>Note:</b>	The buffer parameters are cyclically updated in the background (refer to status signal in r2139). The structure of the fault buffer and the assignment of the indices is shown in r0945.		
<b>r2109[0...63]</b>	<b>Fault time removed in milliseconds / t_flt resolved ms</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> Messages <b>Not for motor type:</b> - <b>Min</b> - [ms]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> - [ms]	<b>Access level:</b> 3 <b>Func. diagram:</b> 8060 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [ms]
<b>Description:</b>	Displays the system runtime in milliseconds when the fault was removed.		
<b>Dependency:</b>	Refer to: r0945, r0947, r0948, r0949, r2114, r2130, r2133, r2136, r3115, r3120, r3122		
<b>Notice:</b>	The time comprises r2136 (days) and r2109 (milliseconds).		
<b>Note:</b>	The buffer parameters are cyclically updated in the background (refer to status signal in r2139). The structure of the fault buffer and the assignment of the indices is shown in r0945.		
<b>r2110[0...63]</b>	<b>Alarm number / Alarm number</b>		
All objects	<b>Can be changed:</b> - <b>Data type:</b> Unsigned16 <b>P-Group:</b> Messages <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> 8065 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	This parameter is identical to r2122.		

**p2111 Alarm counter / Alarm counter**CU\_DC, CU\_DC\_R,  
CU\_DC\_R\_S,  
CU\_DC\_S,  
DC\_CTRL,  
DC\_CTRL\_R,  
DC\_CTRL\_R\_S,  
DC\_CTRL\_S**Can be changed:** U, T  
**Data type:** Unsigned16  
**P-Group:** Messages  
**Not for motor type:** -**Calculated:** -  
**Dyn. index:** -  
**Units group:** -  
**Scaling:** -**Access level:** 3  
**Func. diagram:** 8065  
**Unit selection:** -  
**Expert list:** 1**Min**  
0**Max**  
65535**Factory setting**  
0**Description:** Number of alarms that have occurred after the last reset.**Dependency:** When p2111 is set to 0, the following is initiated:  
- all of the alarms of the alarm buffer that have gone [0...7] are transferred into the alarm history [8...63].  
- the alarm buffer [0...7] is deleted.

Refer to: r2110, r2122, r2123, r2124, r2125

**Note:** The parameter is reset to 0 at POWER ON.**p2111 Alarm counter / Alarm counter**TM150, TM15DI\_DO,  
TM31**Can be changed:** U, T  
**Data type:** Unsigned16  
**P-Group:** Messages  
**Not for motor type:** -**Calculated:** -  
**Dyn. index:** -  
**Units group:** -  
**Scaling:** -**Access level:** 3  
**Func. diagram:** 1750, 8065  
**Unit selection:** -  
**Expert list:** 1**Min**  
0**Max**  
65535**Factory setting**  
0**Description:** Number of alarms that have occurred after the last reset.**Dependency:** When p2111 is set to 0, the following is initiated:  
- all of the alarms of the alarm buffer that have gone [0...7] are transferred into the alarm history [8...63].  
- the alarm buffer [0...7] is deleted.

Refer to: r2110, r2122, r2123, r2124, r2125

**Note:** The parameter is reset to 0 at POWER ON.**p2112 BI: External alarm 1 / External alarm 1**CU\_DC, CU\_DC\_R,  
CU\_DC\_R\_S,  
CU\_DC\_S, TM150,  
TM15DI\_DO, TM31**Can be changed:** U, T  
**Data type:** Unsigned32 / Binary  
**P-Group:** Messages  
**Not for motor type:** -**Calculated:** -  
**Dyn. index:** -  
**Units group:** -  
**Scaling:** -**Access level:** 3  
**Func. diagram:** -  
**Unit selection:** -  
**Expert list:** 1**Min**  
-**Max**  
-**Factory setting**  
1**Description:** Sets the signal source for external alarm 1.**Note:** An external alarm is triggered with a 1/0 signal.**p2112[0...n] BI: External alarm 1 / External alarm 1**DC\_CTRL,  
DC\_CTRL\_R,  
DC\_CTRL\_R\_S,  
DC\_CTRL\_S**Can be changed:** U, T  
**Data type:** Unsigned32 / Binary  
**P-Group:** Messages  
**Not for motor type:** -**Calculated:** -  
**Dyn. index:** CDS, p0170  
**Units group:** -  
**Scaling:** -**Access level:** 3  
**Func. diagram:** 2546  
**Unit selection:** -  
**Expert list:** 1**Min**  
-**Max**  
-**Factory setting**  
1**Description:** Sets the signal source for external alarm 1.**Note:** An external alarm is triggered with a 1/0 signal.



**r2114[0...1]      System runtime total / Sys runtime tot**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Messages	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the total system runtime for the drive unit.  
The time comprises r2114[0] (milliseconds) and r2114[1] (days).  
After r2114[0] has reached a value of 86.400.000 ms (24 hours) this value is reset and r2114[1] is incremented.

**Index:** [0] = Milliseconds  
[1] = Days

**Dependency:** Refer to: r0948, r2109, r2123, r2125, r2130, r2136, r2145, r2146

**Note:** The time in r2114 is used to display the times for faults and alarms.  
When the electronic power supply is switched out, the counter values are saved.  
After the drive unit is powered up, the counter continues to run with the last value that was saved.

**p2116      BI: External alarm 2 / External alarm 2**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S, TM150, TM15DI_DO, TM31	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Messages	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	1

**Description:** Sets the signal source for external alarm 2.

**Note:** An external alarm is triggered with a 1/0 signal.

**p2116[0...n]      BI: External alarm 2 / External alarm 2**

DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> CDS, p0170	<b>Func. diagram:</b> 2546
	<b>P-Group:</b> Messages	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	1

**Description:** Sets the signal source for external alarm 2.

**Note:** An external alarm is triggered with a 1/0 signal.

**p2117      BI: External alarm 3 / External alarm 3**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S, TM150, TM15DI_DO, TM31	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Messages	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	1

**Description:** Sets the signal source for external alarm 3.

**Note:** An external alarm is triggered with a 1/0 signal.

**p2117[0...n] BI: External alarm 3 / External alarm 3**

DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> CDS, p0170	<b>Func. diagram:</b> 2546
	<b>P-Group:</b> Messages	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	1

**Description:** Sets the signal source for external alarm 3.

**Note:** An external alarm is triggered with a 1/0 signal.

**p2118[0...19] Sets the message number for message type. / Msg\_no Msg\_type**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S, TM150, TM15DI_DO, TM31	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 1750, 8075
	<b>P-Group:</b> Messages	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	65535	0

**Description:** Selects faults or alarms for which the message type should be changed.

**Dependency:** Selects the fault or alarm selection and sets the required type of message realized under the same index.  
Refer to: p2119

**Notice:** It is not possible to re-parameterize the message type in the following cases:  
- if there is no existing message number.

**Note:** Re-parameterization is also possible if a message is present. The change only becomes effective after the message has gone.

**p2118[0...19] Sets the message number for message type. / Msg\_no Msg\_type**

DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8075
	<b>P-Group:</b> Messages	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	65535	0

**Description:** Selects faults or alarms for which the message type should be changed.

**Dependency:** Selects the fault or alarm selection and sets the required type of message realized under the same index.  
Refer to: p2119

**Notice:** It is not possible to re-parameterize the message type in the following cases:  
- if there is no existing message number.

**Note:** Re-parameterization is also possible if a message is present. The change only becomes effective after the message has gone.

**p2119[0...19] Setting the message type / Message type**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S, DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8075
	<b>P-Group:</b> Messages	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	1	3	1

**Description:** Sets the message type for the selected fault or alarm.

<b>Value:</b>	1: Fault (F) 2: Alarm (A) 3: No message (N)
<b>Dependency:</b>	Selects the fault or alarm selection and sets the required type of message realized under the same index. Refer to: p2118
<b>Note:</b>	Re-parameterization is also possible if a message is present. The change only becomes effective after the message has gone. The message type can only be changed for messages with the appropriate identification. Example: F12345(A) --> Fault F12345 can be changed to alarm A12345. In this case, the message number that may be possibly entered in p2100[0...19] and p2126[0...19] is automatically removed.

<b>p2119[0...19]</b>	<b>Setting the message type / Message type</b>		
TM150, TM15DI_DO, TM31	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 1750, 8075
	<b>P-Group:</b> Messages	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	1	3	1
<b>Description:</b>	Sets the message type for the selected fault or alarm.		
<b>Value:</b>	1: Fault (F) 2: Alarm (A) 3: No message (N)		
<b>Dependency:</b>	Selects the fault or alarm selection and sets the required type of message realized under the same index. Refer to: p2118		
<b>Note:</b>	Re-parameterization is also possible if a message is present. The change only becomes effective after the message has gone. The message type can only be changed for messages with the appropriate identification. Example: F12345(A) --> Fault F12345 can be changed to alarm A12345. In this case, the message number that may be possibly entered in p2100[0...19] and p2126[0...19] is automatically removed.		

<b>r2120</b>	<b>CO: Sum of fault and alarm buffer changes / Sum buffer changed</b>		
All objects	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8065
	<b>P-Group:</b> Messages	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays the sum of all of the fault and alarm buffer changes in the drive unit.		
<b>Dependency:</b>	Refer to: r0944, r2121		

<b>r2121</b>	<b>CO: Counter alarm buffer changes / Alrm buff changed</b>		
All objects	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8065
	<b>P-Group:</b> Messages	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	This counter is incremented every time the alarm buffer changes.		
<b>Dependency:</b>	Refer to: r2110, r2122, r2123, r2124, r2125		

**r2122[0...63] Alarm code / Alarm code**CU\_DC, CU\_DC\_R,  
CU\_DC\_R\_S,  
CU\_DC\_S,  
DC\_CTRL,  
DC\_CTRL\_R,  
DC\_CTRL\_R\_S,  
DC\_CTRL\_S**Can be changed:** -  
**Data type:** Unsigned16  
**P-Group:** Messages  
**Not for motor type:** -**Calculated:** -  
**Dyn. index:** -  
**Units group:** -  
**Scaling:** -**Access level:** 2  
**Func. diagram:** 8065  
**Unit selection:** -  
**Expert list:** 1**Min****Max****Factory setting**

-

-

-

**Description:** Displays the number of alarms that have occurred.**Dependency:** Refer to: r2110, r2123, r2124, r2125, r2134, r2145, r2146, r3121, r3123**Notice:** The properties of the alarm buffer should be taken from the corresponding product documentation.**Note:** The buffer parameters are cyclically updated in the background (refer to status signal in r2139).

Alarm buffer structure (general principle):

r2122[0], r2124[0], r2123[0], r2125[0] --&gt; alarm 1 (the oldest)

...

r2122[7], r2124[7], r2123[7], r2125[7] --&gt; Alarm 8 (the latest)

When the alarm buffer is full, the alarms that have gone are entered into the alarm history:

r2122[8], r2124[8], r2123[8], r2125[8] --&gt; Alarm 1 (the latest)

...

r2122[63], r2124[63], r2123[63], r2125[63] --&gt; alarm 56 (the oldest)

**r2122[0...63] Alarm code / Alarm code**TM150, TM15DI\_DO,  
TM31**Can be changed:** -  
**Data type:** Unsigned16  
**P-Group:** Messages  
**Not for motor type:** -**Calculated:** -  
**Dyn. index:** -  
**Units group:** -  
**Scaling:** -**Access level:** 2  
**Func. diagram:** 1750, 8065  
**Unit selection:** -  
**Expert list:** 1**Min****Max****Factory setting**

-

-

-

**Description:** Displays the number of alarms that have occurred.**Dependency:** Refer to: r2110, r2123, r2124, r2125, r2134, r2145, r2146, r3121, r3123**Notice:** The properties of the alarm buffer should be taken from the corresponding product documentation.**Note:** The buffer parameters are cyclically updated in the background (refer to status signal in r2139).

Alarm buffer structure (general principle):

r2122[0], r2124[0], r2123[0], r2125[0] --&gt; alarm 1 (the oldest)

...

r2122[7], r2124[7], r2123[7], r2125[7] --&gt; Alarm 8 (the latest)

When the alarm buffer is full, the alarms that have gone are entered into the alarm history:

r2122[8], r2124[8], r2123[8], r2125[8] --&gt; Alarm 1 (the latest)

...

r2122[63], r2124[63], r2123[63], r2125[63] --&gt; alarm 56 (the oldest)

**r2123[0...63] Alarm time received in milliseconds / t\_alarm recv ms**CU\_DC, CU\_DC\_R,  
CU\_DC\_R\_S,  
CU\_DC\_S,  
DC\_CTRL,  
DC\_CTRL\_R,  
DC\_CTRL\_R\_S,  
DC\_CTRL\_S**Can be changed:** -  
**Data type:** Unsigned32  
**P-Group:** Messages  
**Not for motor type:** -**Calculated:** -  
**Dyn. index:** -  
**Units group:** -  
**Scaling:** -**Access level:** 3  
**Func. diagram:** 8065  
**Unit selection:** -  
**Expert list:** 1**Min****Max****Factory setting**

- [ms]

- [ms]

- [ms]

**Description:** Displays the system runtime in milliseconds when the alarm occurred.

**Dependency:** Refer to: r2110, r2114, r2122, r2124, r2125, r2134, r2145, r2146, r3121, r3123  
**Notice:** The time comprises r2145 (days) and r2123 (milliseconds).  
**Note:** The buffer parameters are cyclically updated in the background (refer to status signal in r2139).  
The structure of the alarm buffer and the assignment of the indices is shown in r2122.

---

**r2123[0...63] Alarm time received in milliseconds / t\_alarm recv ms**

TM150, TM15DI_DO, TM31	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 1750, 8065
	<b>P-Group:</b> Messages	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [ms]	- [ms]	- [ms]

**Description:** Displays the system runtime in milliseconds when the alarm occurred.

**Dependency:** Refer to: r2110, r2114, r2122, r2124, r2125, r2134, r2145, r2146, r3121, r3123

**Notice:** The time comprises r2145 (days) and r2123 (milliseconds).

**Note:** The buffer parameters are cyclically updated in the background (refer to status signal in r2139).  
The structure of the alarm buffer and the assignment of the indices is shown in r2122.

---

**r2124[0...63] Alarm value / Alarm value**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S, DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Integer32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8065
	<b>P-Group:</b> Messages	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays additional information about the active alarm (as integer number).

**Dependency:** Refer to: r2110, r2122, r2123, r2125, r2134, r2145, r2146, r3121, r3123

**Note:** The buffer parameters are cyclically updated in the background (refer to status signal in r2139).  
The structure of the alarm buffer and the assignment of the indices is shown in r2122.

---

**r2124[0...63] Alarm value / Alarm value**

TM150, TM15DI_DO, TM31	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Integer32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 1750, 8065
	<b>P-Group:</b> Messages	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays additional information about the active alarm (as integer number).

**Dependency:** Refer to: r2110, r2122, r2123, r2125, r2134, r2145, r2146, r3121, r3123

**Note:** The buffer parameters are cyclically updated in the background (refer to status signal in r2139).  
The structure of the alarm buffer and the assignment of the indices is shown in r2122.

**r2125[0...63] Alarm time removed in milliseconds / t\_alarm res ms**CU\_DC, CU\_DC\_R,  
CU\_DC\_R\_S,  
CU\_DC\_S,  
DC\_CTRL,  
DC\_CTRL\_R,  
DC\_CTRL\_R\_S,  
DC\_CTRL\_S**Can be changed:** -  
**Data type:** Unsigned32  
**P-Group:** Messages  
**Not for motor type:** -**Calculated:** -  
**Dyn. index:** -  
**Units group:** -  
**Scaling:** -**Access level:** 3  
**Func. diagram:** 8065  
**Unit selection:** -  
**Expert list:** 1**Min**  
- [ms]**Max**  
- [ms]**Factory setting**  
- [ms]**Description:** Displays the system runtime in milliseconds when the alarm was cleared.**Dependency:** Refer to: r2110, r2114, r2122, r2123, r2124, r2134, r2145, r2146, r3121, r3123**Notice:** The time comprises r2146 (days) and r2125 (milliseconds).**Note:** The buffer parameters are cyclically updated in the background (refer to status signal in r2139).  
The structure of the alarm buffer and the assignment of the indices is shown in r2122.**r2125[0...63] Alarm time removed in milliseconds / t\_alarm res ms**TM150, TM15DI\_DO,  
TM31**Can be changed:** -  
**Data type:** Unsigned32  
**P-Group:** Messages  
**Not for motor type:** -**Calculated:** -  
**Dyn. index:** -  
**Units group:** -  
**Scaling:** -**Access level:** 3  
**Func. diagram:** 1750, 8065  
**Unit selection:** -  
**Expert list:** 1**Min**  
- [ms]**Max**  
- [ms]**Factory setting**  
- [ms]**Description:** Displays the system runtime in milliseconds when the alarm was cleared.**Dependency:** Refer to: r2110, r2114, r2122, r2123, r2124, r2134, r2145, r2146, r3121, r3123**Notice:** The time comprises r2146 (days) and r2125 (milliseconds).**Note:** The buffer parameters are cyclically updated in the background (refer to status signal in r2139).  
The structure of the alarm buffer and the assignment of the indices is shown in r2122.**p2126[0...19] Setting fault number for acknowledge mode / Fault\_no ackn\_mode**CU\_DC, CU\_DC\_R,  
CU\_DC\_R\_S,  
CU\_DC\_S,  
DC\_CTRL,  
DC\_CTRL\_R,  
DC\_CTRL\_R\_S,  
DC\_CTRL\_S**Can be changed:** U, T  
**Data type:** Unsigned16  
**P-Group:** Messages  
**Not for motor type:** -**Calculated:** -  
**Dyn. index:** -  
**Units group:** -  
**Scaling:** -**Access level:** 3  
**Func. diagram:** 8075  
**Unit selection:** -  
**Expert list:** 1**Min**  
0**Max**  
65535**Factory setting**  
0**Description:** Selects the faults for which the acknowledge mode is to be changed**Dependency:** Selects the faults and sets the required acknowledge mode realized under the same index  
Refer to: p2127**Notice:** It is not possible to re-parameterize the acknowledge mode of a fault in the following cases:  
- Fault number does not exist.  
- Message type is not "fault" (F).**Note:** Re-parameterization is also possible if a fault is present. The change only becomes effective after the fault has been resolved.

<b>p2126[0...19]      Setting fault number for acknowledge mode / Fault_no ackn_mode</b>			
TM150, TM15DI_DO, TM31	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 1750, 8075
	<b>P-Group:</b> Messages	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 65535	<b>Factory setting</b> 0
<b>Description:</b>	Selects the faults for which the acknowledge mode is to be changed		
<b>Dependency:</b>	Selects the faults and sets the required acknowledge mode realized under the same index Refer to: p2127		
<b>Notice:</b>	It is not possible to re-parameterize the acknowledge mode of a fault in the following cases: - Fault number does not exist. - Message type is not "fault" (F).		
<b>Note:</b>	Re-parameterization is also possible if a fault is present. The change only becomes effective after the fault has been resolved.		

<b>p2127[0...19]      Sets acknowledgement mode / Acknowledge mode</b>			
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S, DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8075
	<b>P-Group:</b> Messages	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 1	<b>Max</b> 3	<b>Factory setting</b> 1
<b>Description:</b>	Sets the acknowledge mode for selected fault.		
<b>Value:</b>	1: Acknowledgment only using POWER ON 2: Ack IMMEDIATELY after the fault cause has been removed 3: Acknowledgement only for PULSE INHIBIT		
<b>Dependency:</b>	Selects the faults and sets the required acknowledge mode realized under the same index Refer to: p2126		
<b>Notice:</b>	It is not possible to re-parameterize the acknowledge mode of a fault in the following cases: - if there is no existing fault number. - the message type is not "fault" (F).		
<b>Note:</b>	Re-parameterization is also possible if a fault is present. The change only becomes effective after the fault has been resolved. The acknowledge mode can only be changed for faults with the appropriate identification. Example: F12345 and acknowledge mode = IMMEDIATELY (POWER ON) --> The acknowledge mode can be changed from IMMEDIATELY to POWER ON.		

<b>p2127[0...19]      Sets acknowledgement mode / Acknowledge mode</b>			
TM150, TM15DI_DO, TM31	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 1750, 8075
	<b>P-Group:</b> Messages	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 1	<b>Max</b> 3	<b>Factory setting</b> 1
<b>Description:</b>	Sets the acknowledge mode for selected fault.		
<b>Value:</b>	1: Acknowledgment only using POWER ON 2: Ack IMMEDIATELY after the fault cause has been removed 3: Acknowledgement only for PULSE INHIBIT		

- Dependency:** Selects the faults and sets the required acknowledge mode realized under the same index  
Refer to: p2126
- Notice:** It is not possible to re-parameterize the acknowledge mode of a fault in the following cases:  
- if there is no existing fault number.  
- the message type is not "fault" (F).
- Note:** Re-parameterization is also possible if a fault is present. The change only becomes effective after the fault has been resolved.  
The acknowledge mode can only be changed for faults with the appropriate identification.  
Example:  
F12345 and acknowledge mode = IMMEDIATELY (POWER ON)  
--> The acknowledge mode can be changed from IMMEDIATELY to POWER ON.

<b>p2128[0...15]    Selecting fault/alarm code for trigger / Message trigger</b>			
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S, DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8070
	<b>P-Group:</b> Messages	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 65535	<b>Factory setting</b> 0
<b>Description:</b> Selects faults or alarms which can be used as trigger.			
<b>Dependency:</b> Refer to: r2129			

<b>p2128[0...15]    Selecting fault/alarm code for trigger / Message trigger</b>			
TM150, TM15DI_DO, TM31	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 1750, 8070
	<b>P-Group:</b> Messages	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 65535	<b>Factory setting</b> 0
<b>Description:</b> Selects faults or alarms which can be used as trigger.			
<b>Dependency:</b> Refer to: r2129			

r2129.0...15		CO/BO: Trigger word for faults and alarms / Trigger word			
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S, DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	Can be changed: -	Calculated: -	Access level: 3		
	Data type: Unsigned16	Dyn. index: -	Func. diagram: 8070		
	P-Group: Messages	Units group: -	Unit selection: -		
	Not for motor type: -	Scaling: -	Expert list: 1		
	Min	Max	Factory setting		
	-	-	-		
	Description: Trigger signal for the selected faults and alarms				
Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Trigger signal p2128[0]	ON	OFF	-
	01	Trigger signal p2128[1]	ON	OFF	-
	02	Trigger signal p2128[2]	ON	OFF	-
	03	Trigger signal p2128[3]	ON	OFF	-
	04	Trigger signal p2128[4]	ON	OFF	-
	05	Trigger signal p2128[5]	ON	OFF	-
	06	Trigger signal p2128[6]	ON	OFF	-
	07	Trigger signal p2128[7]	ON	OFF	-
	08	Trigger signal p2128[8]	ON	OFF	-
	09	Trigger signal p2128[9]	ON	OFF	-



10	Trigger signal p2128[10]	ON	OFF	-
11	Trigger signal p2128[11]	ON	OFF	-
12	Trigger signal p2128[12]	ON	OFF	-
13	Trigger signal p2128[13]	ON	OFF	-
14	Trigger signal p2128[14]	ON	OFF	-
15	Trigger signal p2128[15]	ON	OFF	-

**Dependency:** If one of the faults or alarms selected in p2128[n] occurs, then the particular bit of this binector output is set.  
Refer to: p2128

**Note:** CO: r2129 = 0 --> None of the selected messages has occurred.  
CO: r2129 > 0 --> At least one of the selected messages has occurred.

### r2129.0...15 CO/BO: Trigger word for faults and alarms / Trigger word

TM150, TM15DI_DO, TM31	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 1530, 8070
	<b>P-Group:</b> Messages	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Trigger signal for the selected faults and alarms

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Trigger signal p2128[0]	ON	OFF	-
	01	Trigger signal p2128[1]	ON	OFF	-
	02	Trigger signal p2128[2]	ON	OFF	-
	03	Trigger signal p2128[3]	ON	OFF	-
	04	Trigger signal p2128[4]	ON	OFF	-
	05	Trigger signal p2128[5]	ON	OFF	-
	06	Trigger signal p2128[6]	ON	OFF	-
	07	Trigger signal p2128[7]	ON	OFF	-
	08	Trigger signal p2128[8]	ON	OFF	-
	09	Trigger signal p2128[9]	ON	OFF	-
	10	Trigger signal p2128[10]	ON	OFF	-
	11	Trigger signal p2128[11]	ON	OFF	-
	12	Trigger signal p2128[12]	ON	OFF	-
	13	Trigger signal p2128[13]	ON	OFF	-
	14	Trigger signal p2128[14]	ON	OFF	-
	15	Trigger signal p2128[15]	ON	OFF	-

**Dependency:** If one of the faults or alarms selected in p2128[n] occurs, then the particular bit of this binector output is set.  
Refer to: p2128

**Note:** CO: r2129 = 0 --> None of the selected messages has occurred.  
CO: r2129 > 0 --> At least one of the selected messages has occurred.

### r2130[0...63] Fault time received in days / t\_fault recv days

All objects	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8060
	<b>P-Group:</b> Messages	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the system runtime in days when the fault occurred.

**Dependency:** Refer to: r0945, r0947, r0948, r0949, r2109, r2114, r2133, r2136, r3115, r3120, r3122

**Notice:** The time comprises r2130 (days) and r0948 (milliseconds).

**Note:** The buffer parameters are cyclically updated in the background (refer to status signal in r2139).

**r2131 CO: Actual fault code / Actual fault code**

All objects

**Can be changed:** -**Calculated:** -**Access level:** 3**Data type:** Unsigned16**Dyn. index:** -**Func. diagram:** 8060**P-Group:** Messages**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** -**Expert list:** 1**Min****Max****Factory setting**

-

-

-

**Description:** Displays the code of the oldest active fault.**Dependency:** Refer to: r3131, r3132**Note:** 0: No fault present.**r2132 CO: Actual alarm code / Actual alarm code**

All objects

**Can be changed:** -**Calculated:** -**Access level:** 3**Data type:** Unsigned16**Dyn. index:** -**Func. diagram:** 8065**P-Group:** Messages**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** -**Expert list:** 1**Min****Max****Factory setting**

-

-

-

**Description:** Displays the code of the last alarm that occurred.**Note:** 0: No alarm present.**r2133[0...63] Fault value for float values / Fault val float**

All objects

**Can be changed:** -**Calculated:** -**Access level:** 3**Data type:** FloatingPoint32**Dyn. index:** -**Func. diagram:** 8060**P-Group:** Messages**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** -**Expert list:** 1**Min****Max****Factory setting**

-

-

-

**Description:** Displays additional information about the fault that occurred for float values.**Dependency:** Refer to: r0945, r0947, r0948, r0949, r2109, r2130, r2136, r3115**Note:** The buffer parameters are cyclically updated in the background (refer to status signal in r2139).**r2134[0...63] Alarm value for float values / Alarm value float**

All objects

**Can be changed:** -**Calculated:** -**Access level:** 3**Data type:** FloatingPoint32**Dyn. index:** -**Func. diagram:** 8065**P-Group:** Messages**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** -**Expert list:** 1**Min****Max****Factory setting**

-

-

-

**Description:** Displays additional information about the active alarm for float values.**Dependency:** Refer to: r2110, r2122, r2123, r2124, r2125, r2145, r2146, r3121, r3123**Note:** The buffer parameters are cyclically updated in the background (refer to status signal in r2139).**r2135.0...2 CO/BO: Status word faults/alarms 2 / ZSW fault/alarm 2**CU\_DC, CU\_DC\_R,  
CU\_DC\_R\_S,  
CU\_DC\_S**Can be changed:** -**Calculated:** -**Access level:** 2**Data type:** Unsigned16**Dyn. index:** -**Func. diagram:** 2548**P-Group:** Displays, signals**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** -**Expert list:** 1**Min****Max****Factory setting**

-

-

-

**Description:** Displays the second status word of faults and alarms.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Fault encoder 1	Yes	No	-
	01	Fault encoder 2	Yes	No	-
	02	Fault encoder 3	Yes	No	-

**r2135.0...15 CO/BO: Status word faults/alarms 2 / ZSW fault/alarm 2**

DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2548
	<b>P-Group:</b> Displays, signals	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the second status word of faults and alarms.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Fault encoder 1	Yes	No	-
	01	Fault encoder 2	Yes	No	-
	02	Fault encoder 3	Yes	No	-
	12	Fault motor overtemperature	Yes	No	-
	13	Fault power unit thermal overload	Yes	No	-
	14	Alarm motor overtemperature	Yes	No	-
	15	Alarm power unit thermal overload	Yes	No	-

**r2135.0...15 CO/BO: Status word faults/alarms 2 / ZSW fault/alarm 2**

TM150, TM15DI_DO, TM31	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 1530, 2548
	<b>P-Group:</b> Displays, signals	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the second status word of faults and alarms.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Fault encoder 1	Yes	No	-
	01	Fault encoder 2	Yes	No	-
	02	Fault encoder 3	Yes	No	-
	12	Fault motor overtemperature	Yes	No	-
	13	Fault power unit thermal overload	Yes	No	-
	14	Alarm motor overtemperature	Yes	No	-
	15	Alarm power unit thermal overload	Yes	No	-

**r2136[0...63] Fault time removed in days / t\_fit resolv. days**

All objects	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8060
	<b>P-Group:</b> Messages	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the system runtime in days when the fault was removed.

**Dependency:** Refer to: r0945, r0947, r0948, r0949, r2109, r2114, r2130, r2133, r3115, r3120, r3122

**Notice:** The time comprises r2136 (days) and r2109 (milliseconds).

**Note:** The buffer parameters are cyclically updated in the background (refer to status signal in r2139).

**r2138.7...15 CO/BO: Control word faults/alarms / STW fault/alarm**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S, DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned16 <b>P-Group:</b> Displays, signals <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> 2546, 8060, 8065 <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> -

**Description:** Displays the control word of the faults and alarms.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	07	Acknowledge fault	Yes	No	-
	10	External alarm 1 (A07850) effective	Yes	No	-
	11	External alarm 2 (A07851) effective	Yes	No	-
	12	External alarm 3 (A07852) effective	Yes	No	-
	13	External fault 1 (F07860) effective	Yes	No	-
	14	External fault 2 (F07861) effective	Yes	No	-
	15	External fault 3 (F07862) effective	Yes	No	-

**Dependency:** Refer to: p2103, p2104, p2105, p2106, p2107, p2108, p2112, p2116, p2117, p3110, p3111, p3112

**r2138.7...15 CO/BO: Control word faults/alarms / STW fault/alarm**

TM150, TM15DI_DO, TM31	<b>Can be changed:</b> - <b>Data type:</b> Unsigned16 <b>P-Group:</b> Displays, signals <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> 1530, 2546 <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> -

**Description:** Displays the control word of the faults and alarms.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	07	Acknowledge fault	Yes	No	-
	10	External alarm 1 (A07850) effective	Yes	No	-
	11	External alarm 2 (A07851) effective	Yes	No	-
	12	External alarm 3 (A07852) effective	Yes	No	-
	13	External fault 1 (F07860) effective	Yes	No	-
	14	External fault 2 (F07861) effective	Yes	No	-
	15	External fault 3 (F07862) effective	Yes	No	-

**Dependency:** Refer to: p2103, p2104, p2105, p2106, p2107, p2108, p2112, p2116, p2117, p3110, p3111, p3112

**r2139.0...12 CO/BO: Status word faults/alarms 1 / ZSW fault/alarm 1**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S, DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned16 <b>P-Group:</b> Displays, signals <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> 2548, 8060, 8065 <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> -

**Description:** Displays the first status word of faults and alarms.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Being acknowledged	Yes	No	-
	01	Acknowledgment required	Yes	No	-
	03	Fault present	Yes	No	-
	05	Safety message present	Yes	No	-
	06	Internal message 1 present	Yes	No	-
	07	Alarm present	Yes	No	-

08	Internal message 2 present	Yes	No	-
11	Alarm class bit 0	High	Low	-
12	Alarm class bit 1	High	Low	-

**Note:**

Re bit 03, 05, 07:

These bits are set if at least one fault/alarm occurs. Data is entered into the fault/alarm buffer with delay. This is the reason that the fault/alarm buffer should only be read if, after "fault present"/"alarm present" has occurred, a change in the buffer was also detected (r0944, r9744, r2121).

Re bit 06, 08:

These status bits are used for internal diagnostic purposes only.

Re bit 11, 12:

These status bits are used for the classification of internal alarm classes and are intended for diagnostic purposes only on certain automation systems with integrated SINAMICS functionality.

**r2139.0...12 CO/BO: Status word faults/alarms 1 / ZSW fault/alarm 1**

TM150, TM15DI_DO, TM31	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 1530, 2548
	<b>P-Group:</b> Displays, signals	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the first status word of faults and alarms.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Being acknowledged	Yes	No	-
	01	Acknowledgment required	Yes	No	-
	03	Fault present	Yes	No	-
	05	Safety message present	Yes	No	-
	06	Internal message 1 present	Yes	No	-
	07	Alarm present	Yes	No	-
	08	Internal message 2 present	Yes	No	-
	11	Alarm class bit 0	High	Low	-
	12	Alarm class bit 1	High	Low	-

**Note:**

Re bit 03, 05, 07:

These bits are set if at least one fault/alarm occurs. Data is entered into the fault/alarm buffer with delay. This is the reason that the fault/alarm buffer should only be read if, after "fault present"/"alarm present" has occurred, a change in the buffer was also detected (r0944, r9744, r2121).

Re bit 06, 08:

These status bits are used for internal diagnostic purposes only.

Re bit 11, 12:

These status bits are used for the classification of internal alarm classes and are intended for diagnostic purposes only on certain automation systems with integrated SINAMICS functionality.

**r2145[0...63] Alarm time received in days / t\_alarm recv days**

All objects	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8065
	<b>P-Group:</b> Messages	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the system runtime in days when the alarm occurred.

**Dependency:** Refer to: r2110, r2114, r2122, r2123, r2124, r2125, r2134, r2146, r3121, r3123

**Notice:** The time comprises r2145 (days) and r2123 (milliseconds).

**Note:** The buffer parameters are cyclically updated in the background (refer to status signal in r2139).

**r2146[0...63] Alarm time removed in days / t\_alarm res days**

All objects	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8065
	<b>P-Group:</b> Messages	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the system runtime in days when the alarm was cleared.

**Dependency:** Refer to: r2110, r2114, r2122, r2123, r2124, r2125, r2134, r2145, r3121, r3123

**Notice:** The time comprises r2146 (days) and r2125 (milliseconds).

**Note:** The buffer parameters are cyclically updated in the background (refer to status signal in r2139).

**p2147 Delete fault buffer of all drive objects / Del fault buffer**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8060
	<b>P-Group:</b> Displays, signals	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	1	0

**Description:** Setting to delete the fault buffer of all existing drive objects.

**Value:** 0: Inactive  
1: Start to delete the fault buffer of all drive objects

**Dependency:** Refer to: r0945, r0947, r0948, r0949, r2109, r2130, r2133, r2136

**Note:** p2147 is automatically set to 0 after execution.

**r2197.3...7 CO/BO: Status word monitoring 1 / ZSW monitor 1**

DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2534
	<b>P-Group:</b> Messages	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays the first status word for monitoring functions.		
<b>Bit field:</b>	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>
	03	n_act >= 0	Yes
	07	Speed setp - act val deviation in tolerance	Yes
		t_off	
		<b>0 signal</b>	<b>FP</b>
		No	8011
		No	8011

**r2199.1 CO/BO: Status word monitoring 3 / ZSW monitor 3**

DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2537
	<b>P-Group:</b> Messages	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays the third status word for monitoring functions.		
<b>Bit field:</b>	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>
	01	f or n comparison value reached or exceeded	Yes
		<b>0 signal</b>	<b>FP</b>
		No	8010

<b>p2200[0...n]</b>					
<b>BI: Technology controller enable / Tec_ctrl enable</b>					
DC_CTRL (Tech_ctrl), DC_CTRL_R (Tech_ctrl), DC_CTRL_R_S (Tech_ctrl), DC_CTRL_S (Tech_ctrl)	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2		
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> CDS, p0170	<b>Func. diagram:</b> 7958		
	<b>P-Group:</b> Technology	<b>Units group:</b> -	<b>Unit selection:</b> -		
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1		
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>		
	-	-	0		
<b>Description:</b> Sets the signal source to switch in/switch out the technology controller. The technology controller is switched in with a 1 signal.					
<hr/>					
<b>p2252</b>					
<b>Technology controller configuration / Tec_ctrl config</b>					
DC_CTRL (Tech_ctrl), DC_CTRL_R (Tech_ctrl), DC_CTRL_R_S (Tech_ctrl), DC_CTRL_S (Tech_ctrl)	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3		
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -		
	<b>P-Group:</b> Modulation	<b>Units group:</b> -	<b>Unit selection:</b> -		
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1		
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>		
	-	-	0111 bin		
<b>Description:</b> Sets the configuration of the technology controller.					
<b>Bit field:</b>					
	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>	<b>FP</b>
	00	Ramp-up/down time independent of set-point sign	Yes	No	-
	01	Integrator independent of Kp	Yes	No	-
	02	Output signal without ramp active	Yes	No	-
	03	Act val lim	Yes	No	-
<b>Dependency:</b> Refer to: p2257, p2258, p2267, p2268, p2280, p2285					
<b>Note:</b>					
Re bit 00 = 0: The ramp-down time (p2258) switches to the ramp-up time (p2257) when the sign for the output signal r2260 changes. When the sign changes, the output signal is kept at zero for one arithmetic cycle.					
Re bit 00 = 1: When r2260 exhibits a positive gradient, the ramp-up time (p2257) is active; when it exhibits a negative gradient, the ramp-down time (p2258) is active. The sign for r2260 does not have any effect on the ramp time.					
Re bit 01 = 0: The integration time of the PID controller is evaluated with the gain factor Kp (p2280) (p2285 = integral time).					
Re bit 01 = 1: The integration time of the PID controller is independent of the gain factor (p2285 = integration time) if p2280 > 0.					
Re bit 02 = 0: When the PID controller is de-activated via p2200, the output signal r2294 is reduced to zero via the ramp-down time p2293.					
Re bit 02 = 1: When the PID controller is de-activated via p2200, the output signal r2294 is set directly to zero.					
Re bit 03 = 0: The actual values are not limited by p2267 and p2268.					
Re bit 03 = 1: The actual values are limited by p2267 and p2268.					

<b>p2253[0...n]</b>	<b>CI: Technology controller setpoint 1 / Tec_ctrl setp 1</b>		
DC_CTRL (Tech_ctrl), DC_CTRL_R (Tech_ctrl), DC_CTRL_R_S (Tech_ctrl), DC_CTRL_S (Tech_ctrl)	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> Technology <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> PERCENT	<b>Access level:</b> 2 <b>Func. diagram:</b> 7958 <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> 0
<b>Description:</b>	Sets the signal source for the setpoint 1 of the technology controller.		
<b>Dependency:</b>	Refer to: p2254, p2255		
<b>p2254[0...n]</b>	<b>CI: Technology controller setpoint 2 / Tec_ctrl setp 2</b>		
DC_CTRL (Tech_ctrl), DC_CTRL_R (Tech_ctrl), DC_CTRL_R_S (Tech_ctrl), DC_CTRL_S (Tech_ctrl)	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> Technology <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> PERCENT	<b>Access level:</b> 3 <b>Func. diagram:</b> 7958 <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> 0
<b>Description:</b>	Sets the signal source for the setpoint 2 of the technology controller.		
<b>Dependency:</b>	Refer to: p2253, p2256		
<b>p2255</b>	<b>Technology controller setpoint 1 scaling / Tec_ctrl set1 scal</b>		
DC_CTRL (Tech_ctrl), DC_CTRL_R (Tech_ctrl), DC_CTRL_R_S (Tech_ctrl), DC_CTRL_S (Tech_ctrl)	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Technology <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 7958 <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> 0.00 [%]	<b>Max</b> 100.00 [%]	<b>Factory setting</b> 100.00 [%]
<b>Description:</b>	Sets the scaling for the setpoint 1 of the technology controller.		
<b>Dependency:</b>	Refer to: p2253		
<b>p2256</b>	<b>Technology controller setpoint 2 scaling / Tec_ctrl set2 scal</b>		
DC_CTRL (Tech_ctrl), DC_CTRL_R (Tech_ctrl), DC_CTRL_R_S (Tech_ctrl), DC_CTRL_S (Tech_ctrl)	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Technology <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 7958 <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> 0.00 [%]	<b>Max</b> 100.00 [%]	<b>Factory setting</b> 100.00 [%]
<b>Description:</b>	Sets the scaling for the setpoint 2 of the technology controller.		
<b>Dependency:</b>	Refer to: p2254		



**p2257 Technology controller ramp-up time / Tec\_ctrl t\_ramp-up**

DC_CTRL (Tech_ctrl), DC_CTRL_R (Tech_ctrl), DC_CTRL_R_S (Tech_ctrl), DC_CTRL_S (Tech_ctrl)	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Technology <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> 7958 <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> 0.00 [s]	<b>Max</b> 650.00 [s]	<b>Factory setting</b> 1.00 [s]
<b>Description:</b> Sets the ramp-up time of the technology controller.			
<b>Dependency:</b> Refer to: p2252, p2258			
<b>Note:</b> The ramp-up time is referred to 100 %.			

**p2258 Technology controller ramp-down time / Tec\_ctrl t\_ramp-dn**

DC_CTRL (Tech_ctrl), DC_CTRL_R (Tech_ctrl), DC_CTRL_R_S (Tech_ctrl), DC_CTRL_S (Tech_ctrl)	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Technology <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> 7958 <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> 0.00 [s]	<b>Max</b> 650.00 [s]	<b>Factory setting</b> 1.00 [s]
<b>Description:</b> Sets the ramp-down time of the technology controller.			
<b>Dependency:</b> Refer to: p2252, p2257			
<b>Note:</b> The ramp-down time is referred to 100 %.			

**r2260 CO: Technology controller setpoint after ramp-function generator / Tec\_ctr set aftRFG**

DC_CTRL (Tech_ctrl), DC_CTRL_R (Tech_ctrl), DC_CTRL_R_S (Tech_ctrl), DC_CTRL_S (Tech_ctrl)	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Technology <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> 9_1 <b>Scaling:</b> PERCENT	<b>Access level:</b> 2 <b>Func. diagram:</b> 7958 <b>Unit selection:</b> p0595 <b>Expert list:</b> 1
	<b>Min</b> - [%]	<b>Max</b> - [%]	<b>Factory setting</b> - [%]
<b>Description:</b> Sets the setpoint after the ramp-function generator of the technology controller.			

**p2261 Technology controller setpoint filter time constant / Tec\_ctrl set T**

DC_CTRL (Tech_ctrl), DC_CTRL_R (Tech_ctrl), DC_CTRL_R_S (Tech_ctrl), DC_CTRL_S (Tech_ctrl)	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Technology <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 7958 <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> 0.000 [s]	<b>Max</b> 60.000 [s]	<b>Factory setting</b> 0.000 [s]
<b>Description:</b> Sets the time constant for the setpoint filter (PT1) of the technology controller.			

<b>r2262</b>	<b>CO: Technology controller setpoint after filter / Tec_ctr set aftFlt</b>		
DC_CTRL (Tech_ctrl), DC_CTRL_R (Tech_ctrl), DC_CTRL_R_S (Tech_ctrl), DC_CTRL_S (Tech_ctrl)	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Technology <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> 9_1 <b>Scaling:</b> PERCENT	<b>Access level:</b> 3 <b>Func. diagram:</b> 7958 <b>Unit selection:</b> p0595 <b>Expert list:</b> 1
	<b>Min</b> - [%]	<b>Max</b> - [%]	<b>Factory setting</b> - [%]
<b>Description:</b>	Displays the smoothed setpoint after the setpoint filter (PT1) of the technology controller.		
<b>p2263</b>	<b>Technology controller type / Tec_ctrl type</b>		
DC_CTRL (Tech_ctrl), DC_CTRL_R (Tech_ctrl), DC_CTRL_R_S (Tech_ctrl), DC_CTRL_S (Tech_ctrl)	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> Technology <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 7958 <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 1	<b>Factory setting</b> 0
<b>Description:</b>	Sets the technology controller type.		
<b>Value:</b>	0: D component in the actual value signal 1: D component in the fault signal		
<b>p2264[0...n]</b>	<b>CI: Technology controller actual value / Tec_ctrl act val</b>		
DC_CTRL (Tech_ctrl), DC_CTRL_R (Tech_ctrl), DC_CTRL_R_S (Tech_ctrl), DC_CTRL_S (Tech_ctrl)	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> Technology <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> PERCENT	<b>Access level:</b> 2 <b>Func. diagram:</b> 7958 <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> 0
<b>Description:</b>	Sets the signal source for the actual value of the technology controller.		
<b>p2265</b>	<b>Technology controller actual value filter time constant / Tec_ctrl act T</b>		
DC_CTRL (Tech_ctrl), DC_CTRL_R (Tech_ctrl), DC_CTRL_R_S (Tech_ctrl), DC_CTRL_S (Tech_ctrl)	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Technology <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> 7958 <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> 0.000 [s]	<b>Max</b> 60.000 [s]	<b>Factory setting</b> 0.000 [s]
<b>Description:</b>	Sets the time constant for the actual value filter (PT1) of the technology controller.		

<b>r2266</b>	<b>CO: Technology controller actual value after filter / Tec_ctr act aftFlt</b>		
DC_CTRL (Tech_ctrl), DC_CTRL_R (Tech_ctrl), DC_CTRL_R_S (Tech_ctrl), DC_CTRL_S (Tech_ctrl)	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Technology <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> 9_1 <b>Scaling:</b> PERCENT	<b>Access level:</b> 2 <b>Func. diagram:</b> 7958 <b>Unit selection:</b> p0595 <b>Expert list:</b> 1
	<b>Min</b> - [%]	<b>Max</b> - [%]	<b>Factory setting</b> - [%]
<b>Description:</b>	Displays the smoothed actual value after the filter (PT1) of the technology controller		
<b>p2267</b>	<b>Technology controller upper limit actual value / Tec_ctrl u_lim act</b>		
DC_CTRL (Tech_ctrl), DC_CTRL_R (Tech_ctrl), DC_CTRL_R_S (Tech_ctrl), DC_CTRL_S (Tech_ctrl)	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Technology <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> 9_1 <b>Scaling:</b> PERCENT	<b>Access level:</b> 3 <b>Func. diagram:</b> 7958 <b>Unit selection:</b> p0595 <b>Expert list:</b> 1
	<b>Min</b> -200.00 [%]	<b>Max</b> 200.00 [%]	<b>Factory setting</b> 200.00 [%]
<b>Description:</b>	Sets the upper limit for the actual value signal of the technology controller.		
<b>Dependency:</b>	Refer to: p2252, p2264, p2265, p2271		
<b>Notice:</b>	If the actual value exceeds this upper limit, this results in fault F07426.		
<b>Note:</b>	Limiting only active for p2252.3 = 1.		
<b>p2268</b>	<b>Technology controller lower limit actual value / Tec_ctrl l_lim act</b>		
DC_CTRL (Tech_ctrl), DC_CTRL_R (Tech_ctrl), DC_CTRL_R_S (Tech_ctrl), DC_CTRL_S (Tech_ctrl)	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Technology <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> 9_1 <b>Scaling:</b> PERCENT	<b>Access level:</b> 3 <b>Func. diagram:</b> 7958 <b>Unit selection:</b> p0595 <b>Expert list:</b> 1
	<b>Min</b> -200.00 [%]	<b>Max</b> 200.00 [%]	<b>Factory setting</b> -200.00 [%]
<b>Description:</b>	Sets the lower limit for the actual value signal of the technology controller.		
<b>Dependency:</b>	Refer to: p2264, p2265, p2271		
<b>Notice:</b>	If the actual value falls below this lower limit, this results in fault F07426.		
<b>Note:</b>	Limiting only active for p2252.3 = 1.		
<b>p2269</b>	<b>Technology controller gain actual value / Tech_ctrl gain act</b>		
DC_CTRL (Tech_ctrl), DC_CTRL_R (Tech_ctrl), DC_CTRL_R_S (Tech_ctrl), DC_CTRL_S (Tech_ctrl)	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Technology <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 7958 <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> 0.00 [%]	<b>Max</b> 500.00 [%]	<b>Factory setting</b> 100.00 [%]
<b>Description:</b>	Sets the scaling factor for the actual value of the technology controller.		

**Dependency:** Refer to: p2264, p2265, p2267, p2268, p2271

**Note:** For 100%, the actual value is not changed.

**p2270****Technology controller actual value function / Tec\_ctr ActVal fct**

DC\_CTRL  
(Tech\_ctrl),  
DC\_CTRL\_R  
(Tech\_ctrl),  
DC\_CTRL\_R\_S  
(Tech\_ctrl),  
DC\_CTRL\_S  
(Tech\_ctrl)

**Can be changed:** U, T

**Data type:** Integer16

**P-Group:** Technology

**Not for motor type:** -

**Calculated:** -

**Dyn. index:** -

**Units group:** -

**Scaling:** -

**Access level:** 3

**Func. diagram:** 7958

**Unit selection:** -

**Expert list:** 1

**Min**

0

**Max**

3

**Factory setting**

0

**Description:** Setting to use an arithmetic function for the actual value signal of the technology controller.

**Value:**  
0: No function  
1: Root function (root from x)  
2: Square function ( $x * x$ )  
3: Cube function ( $x * x * x$ )

**Dependency:** Refer to: p2264, p2265, p2267, p2268, p2269, p2271

**p2271****Technology controller actual value inversion (sensor type) / Tech\_ctrl act inv**

DC\_CTRL  
(Tech\_ctrl),  
DC\_CTRL\_R  
(Tech\_ctrl),  
DC\_CTRL\_R\_S  
(Tech\_ctrl),  
DC\_CTRL\_S  
(Tech\_ctrl)

**Can be changed:** T

**Data type:** Integer16

**P-Group:** Technology

**Not for motor type:** -

**Calculated:** -

**Dyn. index:** -

**Units group:** -

**Scaling:** -

**Access level:** 3

**Func. diagram:** -

**Unit selection:** -

**Expert list:** 1

**Min**

0

**Max**

1

**Factory setting**

0

**Description:** Setting to invert the actual value signal of the technology controller.

The inversion depends on the sensor type for the actual value signal.

**Value:**  
0: No inversion  
1: Inversion actual value signal

**Caution:** If the actual value inversion is incorrectly selected, then the closed-loop control with the technology controller can become unstable and can oscillate!



**Note:** The correct setting can be determined as follows:

- inhibit the technology controller (p2200 = 0).
- increase the motor speed and in so doing, measure the actual value signal of the technology controller.
- > If the actual value increases as the motor speed increases, then p2271 should be set to 0 (no inversion).
- > If the actual value decreases as the motor speed increases, then p2271 should be set to 1 (the actual value signal is inverted).

<b>r2272</b>	<b>CO: Technology controller actual value scaled / Tech_ctrl act scal</b>		
DC_CTRL (Tech_ctrl), DC_CTRL_R (Tech_ctrl), DC_CTRL_R_S (Tech_ctrl), DC_CTRL_S (Tech_ctrl)	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Technology <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> 9_1 <b>Scaling:</b> PERCENT	<b>Access level:</b> 2 <b>Func. diagram:</b> 7958 <b>Unit selection:</b> p0595 <b>Expert list:</b> 1
	<b>Min</b> - [%]	<b>Max</b> - [%]	<b>Factory setting</b> - [%]
<b>Description:</b>	Displays the scaled actual value signal of the technology controller.		
<b>Dependency:</b>	Refer to: p2264, p2265, r2266, p2267, p2268, p2269, p2270, p2271		
<b>r2273</b>	<b>CO: Technology controller error / Tec_ctrl error</b>		
DC_CTRL (Tech_ctrl), DC_CTRL_R (Tech_ctrl), DC_CTRL_R_S (Tech_ctrl), DC_CTRL_S (Tech_ctrl)	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Technology <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> 9_1 <b>Scaling:</b> PERCENT	<b>Access level:</b> 2 <b>Func. diagram:</b> 7958 <b>Unit selection:</b> p0595 <b>Expert list:</b> 1
	<b>Min</b> - [%]	<b>Max</b> - [%]	<b>Factory setting</b> - [%]
<b>Description:</b>	Displays the error (system deviation) between the setpoint and actual value of the technology controller.		
<b>Dependency:</b>	Refer to: p2263		
<b>p2274</b>	<b>Technology controller differentiation time constant / Tec_ctrl D comp T</b>		
DC_CTRL (Tech_ctrl), DC_CTRL_R (Tech_ctrl), DC_CTRL_R_S (Tech_ctrl), DC_CTRL_S (Tech_ctrl)	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Technology <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> 7958 <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> 0.000 [s]	<b>Max</b> 60.000 [s]	<b>Factory setting</b> 0.000 [s]
<b>Description:</b>	Sets the time constant for the differentiation (D component) of the technology controller.		
<b>Note:</b>	p2274 = 0: Differentiation is disabled.		
<b>p2280</b>	<b>Technology controller proportional gain / Tec_ctrl Kp</b>		
DC_CTRL (Tech_ctrl), DC_CTRL_R (Tech_ctrl), DC_CTRL_R_S (Tech_ctrl), DC_CTRL_S (Tech_ctrl)	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Technology <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> 7958 <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> 0.000	<b>Max</b> 1000.000	<b>Factory setting</b> 1.000
<b>Description:</b>	Sets the proportional gain (P component) of the technology controller.		
<b>Dependency:</b>	Refer to: p2252		
<b>Note:</b>	p2280 = 0: The proportional gain is disabled.		

<b>p2285</b>	<b>Technology controller integral time / Tec_ctrl Tn</b>		
DC_CTRL (Tech_ctrl), DC_CTRL_R (Tech_ctrl), DC_CTRL_R_S (Tech_ctrl), DC_CTRL_S (Tech_ctrl)	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Technology <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> 7958 <b>Unit selection:</b> - <b>Expert list:</b> 1

<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
0.000 [s]	60.000 [s]	0.000 [s]

**Description:** Sets the integral time (I component, integrating time constant) of the technology controller.

**Dependency:** Refer to: p2252

**Note:** p2285 = 0: The integral time is disabled.

<b>p2286[0...n]</b>	<b>BI: Hold technology controller integrator / Tec_ctr integ stop</b>		
DC_CTRL (Tech_ctrl), DC_CTRL_R (Tech_ctrl), DC_CTRL_R_S (Tech_ctrl), DC_CTRL_S (Tech_ctrl)	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> Technology <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 7958 <b>Unit selection:</b> - <b>Expert list:</b> 1

<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
-	-	0

**Description:** Sets the signal source to hold the integrator for the technology controller.

<b>p2289[0...n]</b>	<b>CI: Technology controller pre-control signal / Tec_ctrl prectrl</b>		
DC_CTRL (Tech_ctrl), DC_CTRL_R (Tech_ctrl), DC_CTRL_R_S (Tech_ctrl), DC_CTRL_S (Tech_ctrl)	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> Technology <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> PERCENT	<b>Access level:</b> 2 <b>Func. diagram:</b> 7958 <b>Unit selection:</b> - <b>Expert list:</b> 1

<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
-	-	0

**Description:** Sets the signal source for the pre-control signal of the technology controller.

<b>p2291</b>	<b>CO: Technology controller maximum limiting / Tec_ctrl max_lim</b>		
DC_CTRL (Tech_ctrl), DC_CTRL_R (Tech_ctrl), DC_CTRL_R_S (Tech_ctrl), DC_CTRL_S (Tech_ctrl)	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Technology <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT	<b>Access level:</b> 2 <b>Func. diagram:</b> 7958 <b>Unit selection:</b> - <b>Expert list:</b> 1

<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
-200.00 [%]	200.00 [%]	100.00 [%]

**Description:** Sets the maximum limit of the technology controller.

**Dependency:** Refer to: p2292

**Caution:** The maximum limit must always be greater than the minimum limit (p2291 > p2292).



<b>p2292</b>	<b>CO: Technology controller minimum limiting / Tec_ctrl min_lim</b>		
DC_CTRL (Tech_ctrl), DC_CTRL_R (Tech_ctrl), DC_CTRL_R_S (Tech_ctrl), DC_CTRL_S (Tech_ctrl)	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Technology <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT	<b>Access level:</b> 2 <b>Func. diagram:</b> 7958 <b>Unit selection:</b> - <b>Expert list:</b> 1

<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
-200.00 [%]	200.00 [%]	0.00 [%]

**Description:** Sets the minimum limit of the technology controller.  
**Dependency:** Refer to: p2291  
**Caution:** The maximum limit must always be greater than the minimum limit (p2291 > p2292).



<b>p2293</b>	<b>Technology controller ramp-up/ramp-down time / Tec_ctr ramp up/dn</b>		
DC_CTRL (Tech_ctrl), DC_CTRL_R (Tech_ctrl), DC_CTRL_R_S (Tech_ctrl), DC_CTRL_S (Tech_ctrl)	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Technology <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 7958 <b>Unit selection:</b> - <b>Expert list:</b> 1

<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
0.00 [s]	100.00 [s]	1.00 [s]

**Description:** Sets the ramping time for the output signal of the technology controller.  
**Dependency:** Refer to: p2291, p2292  
**Note:** The time refers to the set maximum and minimum limits (p2291, p2292).

<b>r2294</b>	<b>CO: Technology controller output signal / Tec_ctrl outp_sig</b>		
DC_CTRL (Tech_ctrl), DC_CTRL_R (Tech_ctrl), DC_CTRL_R_S (Tech_ctrl), DC_CTRL_S (Tech_ctrl)	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Technology <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT	<b>Access level:</b> 2 <b>Func. diagram:</b> 7958 <b>Unit selection:</b> - <b>Expert list:</b> 1


<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
- [%]	- [%]	- [%]

**Description:** Displays the output signal of the technology controller.  
**Dependency:** Refer to: p2295

<b>p2295</b>	<b>CO: Technology controller output scaling / Tec_ctrl outp scal</b>		
DC_CTRL (Tech_ctrl), DC_CTRL_R (Tech_ctrl), DC_CTRL_R_S (Tech_ctrl), DC_CTRL_S (Tech_ctrl)	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Technology <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT	<b>Access level:</b> 3 <b>Func. diagram:</b> 7958 <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> -100.00 [%]	<b>Max</b> 100.00 [%]	<b>Factory setting</b> 100.00 [%]
<b>Description:</b>	Sets the scaling for the output signal of the technology controller.		
<b>p2296[0...n]</b>	<b>CI: Technology controller output scaling / Tec_ctrl outp scal</b>		
DC_CTRL (Tech_ctrl), DC_CTRL_R (Tech_ctrl), DC_CTRL_R_S (Tech_ctrl), DC_CTRL_S (Tech_ctrl)	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> Technology <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> PERCENT	<b>Access level:</b> 2 <b>Func. diagram:</b> 7958 <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> 2295[0]
<b>Description:</b>	Sets the signal source for the scaling value of the technology controller.		
<b>Dependency:</b>	Refer to: p2295		
<b>p2297[0...n]</b>	<b>CI: Technology controller maximum limit signal source / Tec_ctrMaxLimS_src</b>		
DC_CTRL (Tech_ctrl), DC_CTRL_R (Tech_ctrl), DC_CTRL_R_S (Tech_ctrl), DC_CTRL_S (Tech_ctrl)	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> Technology <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> PERCENT	<b>Access level:</b> 2 <b>Func. diagram:</b> 7958 <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> 2291[0]
<b>Description:</b>	Sets the signal source for the maximum limiting of the technology controller.		
<b>Dependency:</b>	Refer to: p2291		
<b>p2298[0...n]</b>	<b>CI: Technology controller minimum limit signal source / Tec_ctrl min_l s_s</b>		
DC_CTRL (Tech_ctrl), DC_CTRL_R (Tech_ctrl), DC_CTRL_R_S (Tech_ctrl), DC_CTRL_S (Tech_ctrl)	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> Technology <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> PERCENT	<b>Access level:</b> 2 <b>Func. diagram:</b> 7958 <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> 2292[0]
<b>Description:</b>	Sets the signal source for the minimum limiting of the technology controller.		
<b>Dependency:</b>	Refer to: p2292		



<b>p2299[0...n]</b>				
<b>CI: Technology controller limit offset / Tech_ctrl lim offs</b>				
DC_CTRL (Tech_ctrl), DC_CTRL_R (Tech_ctrl), DC_CTRL_R_S (Tech_ctrl), DC_CTRL_S (Tech_ctrl)	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> Technology <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> PERCENT	<b>Access level:</b> 2 <b>Func. diagram:</b> 7958 <b>Unit selection:</b> - <b>Expert list:</b> 1	
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> 0	
<b>Description:</b> Sets the signal source for the offset of the output limiting of the technology controller.				

<b>p2306</b>				
<b>Technology controller fault signal inversion / Tec_ctrl fault inv</b>				
DC_CTRL (Tech_ctrl), DC_CTRL_R (Tech_ctrl), DC_CTRL_R_S (Tech_ctrl), DC_CTRL_S (Tech_ctrl)	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> Technology <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1	
	<b>Min</b> 0	<b>Max</b> 1	<b>Factory setting</b> 0	
<b>Description:</b> Setting to invert the fault signal of the technology controller. The setting depends on the type of control loop.				
<b>Value:</b> 0: No inversion 1: Inversion				
<b>Caution:</b>  If the actual value inversion is incorrectly selected, then the closed-loop control with the technology controller can become unstable and can oscillate!				
<b>Note:</b> The correct setting can be determined as follows: - inhibit the technology controller (p2200 = 0). - increase the motor speed and in so doing, measure the actual value signal (of the technology controller). - if the actual value increases with increasing motor speed, then the inversion should be switched out. - if the actual value decreases with increasing motor speed, then the inversion should be set. If value = 0: The drive reduces the output speed when the actual value rises (e.g. for heating fans, intake pump, compressor). If value = 1: The drive increases the output speed when the actual value increases (e.g. for cooling fans, discharge pumps).				

<b>r2349.0...11</b>				
<b>CO/BO: Technology controller status word / Tec_ctrl status</b>				
DC_CTRL (Tech_ctrl), DC_CTRL_R (Tech_ctrl), DC_CTRL_R_S (Tech_ctrl), DC_CTRL_S (Tech_ctrl)	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> Technology <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 7958 <b>Unit selection:</b> - <b>Expert list:</b> 1	
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> -	
<b>Description:</b> Displays the status word of the technology controller.				
<b>Bit field:</b>				
<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>	<b>FP</b>
00	Technology controller de-activated	Yes	No	-
01	Technology controller limited	Yes	No	-

02	Technology controller motorized potentiometer limited max.	Yes	No	-
03	Technology controller motorized potentiometer limited min.	Yes	No	-
08	Technology controller actual value at the minimum	Yes	No	-
09	Technology controller actual value at the maximum	Yes	No	-
10	Technology controller output at the minimum	Yes	No	-
11	Technology controller output at the maximum	Yes	No	-

**p2398****Energy-saving mode / En\_save mode**

DC\_CTRL  
(Tech\_ctrl),  
DC\_CTRL\_R  
(Tech\_ctrl),  
DC\_CTRL\_R\_S  
(Tech\_ctrl),  
DC\_CTRL\_S  
(Tech\_ctrl)

**Can be changed:** T  
**Data type:** Integer16  
**P-Group:** Technology  
**Not for motor type:** -

**Calculated:** -  
**Dyn. index:** -  
**Units group:** -  
**Scaling:** -

**Access level:** 3  
**Func. diagram:** -  
**Unit selection:** -  
**Expert list:** 1

**Min**  
0

**Max**  
1

**Factory setting**  
0

**Description:**

Sets the operating mode for the energy-saving mode function.

**Value:**

0: Energy-saving mode inhibited  
1: Energy-saving mode activated

**Dependency:**

Refer to: p2200

**Caution:**

When this function is active, the motor can start again automatically.

**Note:**

When the energy-saving mode function (p2398 = 1) is activated, its behavior is defined as to whether the technology controller is additionally switched in (closed-loop) or switched out (open-loop).

The technology controller is enabled via binector input p2200 and its mode is set in p2251.

p2200 = 0, p2251 = 0, 1:

Energy-saving mode operates without technology controller (open-loop)

p2200 = 1, p2251 = 0:

Energy-saving mode operates with technology controller (closed-loop)

p2200 = 1, p2251 = 1:

Energy-saving mode operates without technology controller (open-loop) as its output is only used as supplementary setpoint and not as main setpoint.

**p2504[0...n]****LR motor/load motor revolutions / Mot/load motor rev**

DC\_CTRL,  
DC\_CTRL\_R,  
DC\_CTRL\_R\_S,  
DC\_CTRL\_S

**Can be changed:** C2(4)  
**Data type:** Unsigned32  
**P-Group:** Encoder  
**Not for motor type:** -

**Calculated:** -  
**Dyn. index:** DDS, p0180  
**Units group:** -  
**Scaling:** -

**Access level:** 1  
**Func. diagram:** 4704, 4711  
**Unit selection:** -  
**Expert list:** 1

**Min**  
1

**Max**  
1048576

**Factory setting**  
1

**Description:**

Sets the motor revolutions for the gearbox factor between the motor shaft and load shaft.

Gearbox factor = motor revolutions (p2504) / load revolutions (p2505)

**Dependency:**

Refer to: p0432, p0433, p2505

**Note:**

The gearbox factor between the encoder shaft and the motor shaft is set using p0432 and p0433.

<b>p2505[0...n]</b>	<b>LR motor/load load revolutions / Mot/load load rev</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4) <b>Data type:</b> Integer32 <b>P-Group:</b> Encoder <b>Not for motor type:</b> - <b>Min</b> -1048576	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1048576	<b>Access level:</b> 1 <b>Func. diagram:</b> 4704, 4711 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Sets the load revolutions for the gearbox factor between the motor shaft and load shaft. Gearbox factor = motor revolutions (p2504) / load revolutions (p2505)		
<b>Dependency:</b>	Refer to: p0432, p0433, p2504		
<b>Note:</b>	The gearbox factor between the encoder shaft and the motor shaft is set using p0432 and p0433.		
<b>r2700</b>	<b>CO: Reference speed / n_ref</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Connector output for reference speed p2000. All speeds specified as relative values refer to this reference quantity. The reference quantity corresponds to 100% or 4000 hex (word) or 4000 0000 hex (double word). This parameter has the unit rpm.		
<b>Dependency:</b>	Refer to: p2000		
<b>Note:</b>	This BICO parameter provides the numerical value of the reference quantity p2000 as a connector output for inter-connection with Drive Control Chart (DCC). The numerical value can be adopted unchanged from this connector output in DCC. This BICO parameter is not suitable for interconnecting for cyclic communication.		
<b>r2701</b>	<b>CO: Reference voltage / Reference voltage</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Connector output of the reference quantity for voltages p2001. The reference quantity corresponds to 100% or 4000 hex (word) or 4000 0000 hex (double word). This parameter has the unit [Vrms].		
<b>Dependency:</b>	Refer to: p2001		
<b>Note:</b>	This BICO parameter provides the numerical value of the reference quantity p2001 as a connector output for inter-connection with Drive Control Chart (DCC). The numerical value can be adopted unchanged from this connector output in DCC. This BICO parameter is not suitable for interconnecting for cyclic communication.		
<b>r2702</b>	<b>CO: Reference current / Reference current</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Connector output of the reference quantity for currents p2002. The reference quantity corresponds to 100% or 4000 hex (word) or 4000 0000 hex (double word).		

This parameter has the unit Arms.

**Dependency:**

Refer to: p2002

**Note:**

This BICO parameter provides the numerical value of the reference quantity p2002 as a connector output for interconnection with Drive Control Chart (DCC). The numerical value can be adopted unchanged from this connector output in DCC. This BICO parameter is not suitable for interconnecting for cyclic communication.

**r2703****CO: Reference torque / Reference torque**

DC\_CTRL,  
DC\_CTRL\_R,  
DC\_CTRL\_R\_S,  
DC\_CTRL\_S

**Can be changed:** -

**Calculated:** -

**Access level:** 3

**Data type:** FloatingPoint32

**Dyn. index:** -

**Func. diagram:** -

**P-Group:** -

**Units group:** -

**Unit selection:** -

**Not for motor type:** -

**Scaling:** -

**Expert list:** 1

**Min**

**Max**

**Factory setting**

-

-

-

**Description:**

Connector output of the reference quantity p2003 for torque (r0108.12 = 0) or force (r0108.12 = 1).  
The reference quantity corresponds to 100% or 4000 hex (word) or 4000 0000 hex (double word).  
The unit of this parameter is the same as the unit selected for p2003.

**Dependency:**

p0505, r0108.12

Refer to: p2003

**Note:**

This BICO parameter provides the numerical value of the reference quantity p2003 in the currently selected unit as a connector output for interconnection with Drive Control Chart (DCC). The numerical value can be adopted unchanged from this connector output in DCC. This BICO parameter is not suitable for interconnecting for cyclic communication.

**r2704****CO: Reference power / Reference power**

DC\_CTRL,  
DC\_CTRL\_R,  
DC\_CTRL\_R\_S,  
DC\_CTRL\_S

**Can be changed:** -

**Calculated:** -

**Access level:** 3

**Data type:** FloatingPoint32

**Dyn. index:** -

**Func. diagram:** -

**P-Group:** -

**Units group:** -

**Unit selection:** -

**Not for motor type:** -

**Scaling:** -

**Expert list:** 1

**Min**

**Max**

**Factory setting**

-

-

-

**Description:**

Connector output of the reference quantity for powers p2004.  
The reference quantity corresponds to 100% or 4000 hex (word) or 4000 0000 hex (double word).  
The unit of this parameter is the same as the unit selected for p2004.

**Dependency:**

This value is calculated as voltage x current for the infeed and as torque x speed for closed-loop controls.  
Refer to: r2004

**Note:**

This BICO parameter provides the numerical value of the reference quantity p2004 in the currently selected unit as a connector output for interconnection with Drive Control Chart (DCC). The numerical value can be adopted unchanged from this connector output in DCC. This BICO parameter is not suitable for interconnecting for cyclic communication.

The reference power is calculated as follows:

-  $2 * \pi * \text{reference speed} / 60 * \text{reference torque (motor)}$

-  $\text{reference voltage} * \text{reference current} * \text{root}(3) \text{ (infeed)}$

**r2705****CO: Reference angle / Reference angle**

DC\_CTRL,  
DC\_CTRL\_R,  
DC\_CTRL\_R\_S,  
DC\_CTRL\_S

**Can be changed:** -

**Calculated:** -

**Access level:** 3

**Data type:** FloatingPoint32

**Dyn. index:** -

**Func. diagram:** -

**P-Group:** -

**Units group:** -

**Unit selection:** -

**Not for motor type:** -

**Scaling:** -

**Expert list:** 1

**Min**

**Max**

**Factory setting**

-

-

-

**Description:**

Connector output of the reference quantity for angles p2005.  
The reference quantity corresponds to 100% or 4000 hex (word) or 4000 0000 hex (double word).  
This parameter has the unit degree.

**Dependency:**

Refer to: p2005

**Note:** This BICO parameter provides the numerical value of the reference quantity p2005 as a connector output for interconnection with Drive Control Chart (DCC). The numerical value can be adopted unchanged from this connector output in DCC. This BICO parameter is not suitable for interconnecting for cyclic communication.

<b>r2706</b>	<b>CO: Reference temp / Reference temp</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Connector output of the reference quantity for temperatures.  
The reference quantity corresponds to 100% or 4000 hex (word) or 4000 0000 hex (double word).  
This parameter has the unit degree Celsius.

**Note:** This BICO parameter provides the numerical value of the reference quantity for the temperature as a connector output for interconnection with Drive Control Chart (DCC). The numerical value can be adopted unchanged from this connector output in DCC. This BICO parameter is not suitable for interconnecting for cyclic communication.

<b>r2706</b>	<b>CO: Reference temp / Reference temp</b>		
TM150, TM31	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Connector output of the reference quantity for temperatures.  
All temperatures specified as relative value are referred to this reference quantity.  
The reference quantity corresponds to 100% or 4000 hex (word) or 4000 0000 hex (double word).  
This parameter has the unit degree Celsius.

**Note:** This BICO parameter provides the numerical value of the reference quantity for the temperature as a connector output for interconnection with Drive Control Chart (DCC). The numerical value can be adopted unchanged from this connector output in DCC. This BICO parameter is not suitable for interconnecting for cyclic communication.

<b>r2707</b>	<b>CO: Reference acceleration / Ref accel</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Connector output of the reference quantity for accelerations p2007.  
The reference quantity corresponds to 100% or 4000 hex (word) or 4000 0000 hex (double word).  
The unit of this parameter is the same as the unit selected for p2007.

**Dependency:** r0108.12, p0505  
Refer to: p2007

**Note:** This BICO parameter provides the numerical value of the reference quantity p2007 as a connector output for interconnection with Drive Control Chart (DCC). The numerical value in the currently selected unit can be adopted unchanged from this connector output in DCC. This BICO parameter is not suitable for interconnecting for cyclic communication.

<b>p2720[0...n]</b>	<b>Load gear configuration / Load gear config</b>				
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(1, 4)	<b>Calculated:</b> -	<b>Access level:</b> 1		
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 4704		
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -		
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1		
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>		
	-	-	0000 bin		
<b>Description:</b>	Sets the configuration for position tracking of a load gear.				
<b>Bit field:</b>	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>	<b>FP</b>
	00	Load gear activate position tracking	Yes	No	-
	01	Axis type	Linear axis	Rotary axis	-
	02	Load gear reset position	Yes	No	-
<b>Note:</b>	For the following events, the non-volatile, saved position values are automatically reset: - when an encoder replacement has been identified. - when changing the configuration of the Encoder Data Set (EDS). - when adjusting the absolute encoder again				

<b>p2721[0...n]</b>	<b>Load gear rotary absolute encoder revolutions virtual / Abs rot rev</b>				
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(1, 4)	<b>Calculated:</b> -	<b>Access level:</b> 1		
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 4704		
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -		
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1		
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>		
	0	4194303	0		
<b>Description:</b>	Sets the number of rotations that can be resolved for a rotary absolute encoder with activated position tracking of the load gear.				
<b>Dependency:</b>	This parameter is only of significance for an absolute encoder (p0404.1 = 1) with activated position tracking of the load gear (p2720.0 = 1).				
<b>Note:</b>	The resolution that is set must be able to be represented using r2723. For rotary axes/modulo axes, the following applies: This parameter is pre-set with p0421 and can be changed. For linear axes, the following applies: This parameter is pre-assigned with p0421, expanded by 6 bits for multiturn information (maximum number of overflows) and cannot be changed.				

<b>p2722[0...n]</b>	<b>Load gear position tracking tolerance window / Pos track tol</b>				
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(1, 4)	<b>Calculated:</b> -	<b>Access level:</b> 3		
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> -		
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -		
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1		
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>		
	0.00	4294967300.00	0.00		
<b>Description:</b>	Sets a tolerance window for position tracking. After the system is powered up, the difference between the saved position and the actual position is determined, and depending on this, the following is initiated: Difference within the tolerance window --> The position is reproduced as a result of the encoder actual value. Difference outside the tolerance window --> An appropriate message is output.				
<b>Caution:</b>	Rotation, e.g. through a complete encoder range is not detected.				



**Note:** The value is entered in integer (complete) encoder pulses.  
 For p2720.0 = 1, the value is automatically pre-assigned quarter of the encoder range.  
 Example:  
 Quarter of the encoder range = (p0408 \* p0421) / 4  
 It is possible that the tolerance window may not be able to be precisely set due to the data type (floating point number with 23 bit mantissa).

<b>r2723[0...n]</b>	<b>CO: Load gear absolute value / Load gear abs_val</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 4704
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the absolute value after the load gear.

**Notice:** The encoder position actual value must be requested using the encoder control word Gn\_STW.13.

**Note:** The increments are displayed in the format the same as r0483.

<b>r2724[0...n]</b>	<b>CO: Load gear position difference / Load gear pos diff</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Integer32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> -
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the position difference before the load gear between powering down and powering up.

**Note:** The increments are displayed in the same format as for r0483/r2723.

If the measuring gear of the motor encoder is not activated, the position difference should be read in encoder increments.

If the measuring gear of the motor encoder is activated, the position difference is converted using the measuring gear factor.

<b>p2810[0...1]</b>	<b>BI: AND logic operation inputs / AND inputs</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2634
	<b>P-Group:</b> Functions	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Sets the signal sources for the inputs of the AND logic operation.

**Dependency:** Refer to: r2811

**Note:** [0]: AND logic operation, input 1 --> the result is displayed in r2811.0.  
 [1]: AND logic operation, input 2 --> the result is displayed in r2811.0.

<b>r2811.0</b>	<b>CO/BO: AND logic operation result / AND result</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2634
	<b>P-Group:</b> Functions	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the result of the AND logic operation

<b>Bit field:</b>	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>	<b>FP</b>
	00	AND logic operation result	Yes	No	-
<b>Dependency:</b>	Refer to: p2810				
<b>p2816[0...1]</b>					
<b>BI: OR logic operation inputs / OR inputs</b>					
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> T		<b>Calculated:</b> -	<b>Access level:</b> 2	
	<b>Data type:</b> Unsigned32 / Binary		<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2634	
	<b>P-Group:</b> Functions		<b>Units group:</b> -	<b>Unit selection:</b> -	
	<b>Not for motor type:</b> -		<b>Scaling:</b> -	<b>Expert list:</b> 1	
	<b>Min</b>		<b>Max</b>	<b>Factory setting</b>	
	-		-	0	
<b>Description:</b>	Sets the signal sources for the inputs of the OR logic operation.				
<b>Dependency:</b>	Refer to: r2817				
<b>Note:</b>	[0]: OR logic operation, input 1 --> the result is displayed in r2817.0. [1]: OR logic operation, input 2 --> the result is displayed in r2817.0.				
<b>r2817.0</b>					
<b>CO/BO: OR logic operation result / OR result</b>					
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -		<b>Calculated:</b> -	<b>Access level:</b> 2	
	<b>Data type:</b> Unsigned32		<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2634	
	<b>P-Group:</b> Functions		<b>Units group:</b> -	<b>Unit selection:</b> -	
	<b>Not for motor type:</b> -		<b>Scaling:</b> -	<b>Expert list:</b> 1	
	<b>Min</b>		<b>Max</b>	<b>Factory setting</b>	
	-		-	-	
<b>Description:</b>	Displays the result of the OR logic operation.				
<b>Bit field:</b>	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>	<b>FP</b>
	00	OR logic operation result	Yes	No	-
<b>Dependency:</b>	Refer to: p2816				
<b>p2900[0...n]</b>					
<b>CO: Fixed value 1 [%] / Fixed value 1 [%]</b>					
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> U, T		<b>Calculated:</b> -	<b>Access level:</b> 3	
	<b>Data type:</b> FloatingPoint32		<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> -	
	<b>P-Group:</b> Free function blocks		<b>Units group:</b> -	<b>Unit selection:</b> -	
	<b>Not for motor type:</b> -		<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1	
	<b>Min</b>		<b>Max</b>	<b>Factory setting</b>	
	-10000.00 [%]		10000.00 [%]	0.00 [%]	
<b>Description:</b>	Sets a fixed percentage.				
<b>Dependency:</b>	Refer to: p2901, p2930				
<b>Notice:</b>	A BICO interconnection to a parameter that belongs to a drive data set always acts on the effective data set.				
<b>Note:</b>	The value can be used to interconnect a scaling function (e.g. scaling of the main setpoint)				
<b>p2901[0...n]</b>					
<b>CO: Fixed value 2 [%] / Fixed value 2 [%]</b>					
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> U, T		<b>Calculated:</b> -	<b>Access level:</b> 3	
	<b>Data type:</b> FloatingPoint32		<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> -	
	<b>P-Group:</b> Free function blocks		<b>Units group:</b> -	<b>Unit selection:</b> -	
	<b>Not for motor type:</b> -		<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1	
	<b>Min</b>		<b>Max</b>	<b>Factory setting</b>	
	-10000.00 [%]		10000.00 [%]	0.00 [%]	
<b>Description:</b>	Sets a fixed percentage.				
<b>Dependency:</b>	Refer to: p2900, p2930				
<b>Notice:</b>	A BICO interconnection to a parameter that belongs to a drive data set always acts on the effective data set.				
<b>Note:</b>	The value can be used to interconnect a scaling function (e.g. scaling of the supplementary setpoint)				



<b>r2902[0...14]</b>			
<b>CO: Fixed values [%] / Fixed values [%]</b>			
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Free function blocks <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 1 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Signal sources for frequently used percentage values.		
<b>Index:</b>	[0] = Fixed value +0 % [1] = Fixed value +5 % [2] = Fixed value +10 % [3] = Fixed value +20 % [4] = Fixed value +50 % [5] = Fixed value +100 % [6] = Fixed value +150 % [7] = Fixed value +200 % [8] = Fixed value -5 % [9] = Fixed value -10 % [10] = Fixed value -20 % [11] = Fixed value -50 % [12] = Fixed value -100 % [13] = Fixed value -150 % [14] = Fixed value -200 %		
<b>Dependency:</b>	Refer to: p2900, p2901, p2930		
<b>Note:</b>	The signal sources can, for example, be used to interconnect scalings.		

<b>p2930[0...n]</b>			
<b>CO: Fixed value M [Nm] / Fixed value M [Nm]</b>			
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Free function blocks <b>Not for motor type:</b> REL <b>Min</b> -100000.00 [Nm]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> 7_1 <b>Scaling:</b> p2003 <b>Max</b> 100000.00 [Nm]	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> p0505 <b>Expert list:</b> 1 <b>Factory setting</b> 0.00 [Nm]
<b>Description:</b>	Sets a fixed value for torque.		
<b>Dependency:</b>	Refer to: p2900, p2901		
<b>Notice:</b>	A BICO interconnection to a parameter that belongs to a drive data set always acts on the effective data set.		
<b>Note:</b>	The value can, for example, be used to interconnect a supplementary torque.		

<b>p3100</b>			
<b>RTC time stamp mode / RTC t_stamp mode</b>			
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the mode for the time stamp p3100 = 0: Time stamp, operating hours p3100 = 1: Time stamp, UTC format		
<b>Notice:</b>	The realtime format (p3100 = 1), once selected, remains until the next time that the system is switched off. Switching back to operating hours (p3100 = 0) is prevented.		
<b>Note:</b>	RTC: Real-time clock UTC: Universal Time Coordinates The UTC time started, according to the definition on 01.01.1970 at 00:00:00 and is output in days and milliseconds.		

**p3101[0...1]      RTC set UTC time / RTC set UTC**CU\_DC, CU\_DC\_R,  
CU\_DC\_R\_S,  
CU\_DC\_S**Can be changed:** U, T**Data type:** Unsigned32**P-Group:** -**Not for motor type:** -**Min**

0

**Calculated:** -**Dyn. index:** -**Units group:** -**Scaling:** -**Max**

4294967295

**Access level:** 3**Func. diagram:** -**Unit selection:** -**Expert list:** 0**Factory setting**

0

**Description:**

Setting the UTC time.

This means that the drive system is synchronized to the time specified by the time master.

To start p3101[1] must be written to followed by p3101[0]. After writing to p3101[0], the UTC time is accepted.

p3101[0]: Milliseconds

p3101[1]: Days

**r3102[0...1]      RTC read UTC time / RTC read UTC**CU\_DC, CU\_DC\_R,  
CU\_DC\_R\_S,  
CU\_DC\_S**Can be changed:** -**Data type:** Unsigned32**P-Group:** -**Not for motor type:** -**Min**

-

**Calculated:** -**Dyn. index:** -**Units group:** -**Scaling:** -**Max**

-

**Access level:** 3**Func. diagram:** -**Unit selection:** -**Expert list:** 1**Factory setting**

-

**Description:**

Displays the actual UTC time in the drive system.

p3102[0]: Milliseconds

p3102[1]: Days

**p3103      RTC synchronization source / RTC sync\_source**CU\_DC, CU\_DC\_R,  
CU\_DC\_R\_S,  
CU\_DC\_S**Can be changed:** U, T**Data type:** Integer16**P-Group:** -**Not for motor type:** -**Min**

0

**Calculated:** -**Dyn. index:** -**Units group:** -**Scaling:** -**Max**

3

**Access level:** 3**Func. diagram:** -**Unit selection:** -**Expert list:** 1**Factory setting**

0

**Description:**

Sets the synchronization source/technique.

**Value:**

0: PROFIBUS

1: PROFINET

2: PPI

3: PROFINET PTP

**p3104      BI: RTC real time synchronization PING / RTC PING**CU\_DC, CU\_DC\_R,  
CU\_DC\_R\_S,  
CU\_DC\_S**Can be changed:** U, T**Data type:** Unsigned32 / Binary**P-Group:** -**Not for motor type:** -**Min**

-

**Calculated:** -**Dyn. index:** -**Units group:** -**Scaling:** -**Max**

-

**Access level:** 3**Func. diagram:** -**Unit selection:** -**Expert list:** 1**Factory setting**

0

**Description:**

Sets the signal source for the PING event to set the UTC time.

**Notice:**

The parameter may be protected as a result of p0922 or p2079 and cannot be changed.

<b>r3107[0...3]</b>	<b>RTC synchronizing time / RTC t_sync</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the last synchronizing event in the drive system.  
 3107[0, 1]: synchronizing event after synchronization  
 r3107[0]: milliseconds  
 r3107[1]: days  
 3107[2, 3]: synchronizing event before synchronization  
 r3107[2]: milliseconds  
 r3107[3]: days

<b>r3108[0...1]</b>	<b>RTC last synchronization deviation / RTC sync_dev</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the absolute value of the last synchronization deviation that was determined.  
 r3108[0]: Milliseconds  
 r3108[1]: Days

<b>p3109</b>	<b>RTC real time synchronization tolerance window / RTC sync tol</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0 [ms]	1000 [ms]	100 [ms]

**Description:** Sets the tolerance window for time synchronization.  
 When this tolerance window is exceeded, an appropriate alarm is output.

<b>p3110</b>	<b>External fault 3 power-up delay / Ext fault 3 t_on</b>		
All objects	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2546
	<b>P-Group:</b> Messages	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0 [ms]	1000 [ms]	0 [ms]

**Description:** Sets the delay time for external fault 3.  
**Dependency:** Refer to: p2108, p3111, p3112

<b>p3111</b>	<b>BI: External fault 3 enable / Ext fault 3 enab</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S, TM150, TM15DI_DO, TM31	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> Messages <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 2546 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Sets the signal source for the enable signal of external fault 3. External fault 3 is initiated by the following AND logic operation: - BI: p2108 negated - BI: p3111 - BI: p3112 negated		
<b>Dependency:</b>	Refer to: p2108, p3110, p3112		
<b>p3111[0...n]</b>	<b>BI: External fault 3 enable / Ext fault 3 enab</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> Messages <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Sets the signal source for the enable signal of external fault 3. External fault 3 is initiated by the following AND logic operation: - BI: p2108 negated - BI: p3111 - BI: p3112 negated		
<b>Dependency:</b>	Refer to: p2108, p3110, p3112		
<b>p3112</b>	<b>BI: External fault 3 enable negated / Ext flt 3 enab neg</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S, TM150, TM15DI_DO, TM31	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> Messages <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 2546 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the signal source for the negated enable signal of external fault 3. External fault 3 is initiated by the following AND logic operation: - BI: p2108 negated - BI: p3111 - BI: p3112 negated		
<b>Dependency:</b>	Refer to: p2108, p3110, p3111		
<b>p3112[0...n]</b>	<b>BI: External fault 3 enable negated / Ext flt 3 enab neg</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> Messages <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the signal source for the negated enable signal of external fault 3.		

External fault 3 is initiated by the following AND logic operation:

- BI: p2108 negated
- BI: p3111
- BI: p3112 negated

**Dependency:** Refer to: p2108, p3110, p3111

---

### r3113.0...15 CO/BO: NAMUR message bit bar / NAMUR bit bar

All objects	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Messages	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the status of NAMUR signal bit bar.  
The faults or alarms are assigned to the appropriate signaling/message classes and influence a specific message bit.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Fault converter information electronics/SW_error	Yes	No	-
	01	Network fault	Yes	No	-
	02	DC link overvoltage	Yes	No	-
	03	Fault drive converter power electronics	Yes	No	-
	04	Drive converter overtemperature	Yes	No	-
	05	Ground fault	Yes	No	-
	06	Motor overload	Yes	No	-
	07	Bus error	Yes	No	-
	08	External safety-relevant shutdown	Yes	No	-
	09	Mot encoder fault	Yes	No	-
	10	Error communication internal	Yes	No	-
	11	Fault infeed	Yes	No	-
	15	Other faults	Yes	No	-

---

### r3114.9...11 CO/BO: Messages status word global / Msg ZSW global

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Displays, signals	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the global status word for messages.  
The appropriate bit is set if at least one message is present at the drive objects.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	09	Group alarm present	Yes	No	8065
	10	Group fault present	Yes	No	8060
	11	Safety group message present	Yes	No	-

**Note:** The status bits are displayed with delay.

**r3115[0...63]      Fault drive object initiating / F DO initiating**CU\_DC, CU\_DC\_R,  
CU\_DC\_R\_S,  
CU\_DC\_S,  
DC\_CTRL,  
DC\_CTRL\_R,  
DC\_CTRL\_R\_S,  
DC\_CTRL\_S**Can be changed:** -  
**Data type:** Integer32  
**P-Group:** Messages  
**Not for motor type:** -**Calculated:** -  
**Dyn. index:** -  
**Units group:** -  
**Scaling:** -**Access level:** 3  
**Func. diagram:** -  
**Unit selection:** -  
**Expert list:** 1**Min****Max****Factory setting**

-

-

-

**Description:** Displays the drive object number of the initiating drive object for this fault as integer number.  
Value = 63:

The fault was initiated by the drive object itself.

**Dependency:** Refer to: r0945, r0947, r0948, r0949, r2109, r2130, r2133, r2136, r3120, r3122**Note:** The buffer parameters are cyclically updated in the background (refer to status signal in r2139).  
The structure of the fault buffer and the assignment of the indices is shown in r0945.

---

**r3115[0...63]      Fault drive object initiating / F DO initiating**TM150, TM15DI\_DO,  
TM31**Can be changed:** -  
**Data type:** Integer32  
**P-Group:** Messages  
**Not for motor type:** -**Calculated:** -  
**Dyn. index:** -  
**Units group:** -  
**Scaling:** -**Access level:** 3  
**Func. diagram:** 1750, 8060  
**Unit selection:** -  
**Expert list:** 1**Min****Max****Factory setting**

-

-

-

**Description:** Displays the drive object number of the initiating drive object for this fault as integer number.  
Value = 63:

The fault was initiated by the drive object itself.

**Dependency:** Refer to: r0945, r0947, r0948, r0949, r2109, r2130, r2133, r2136, r3120, r3122**Note:** The buffer parameters are cyclically updated in the background (refer to status signal in r2139).  
The structure of the fault buffer and the assignment of the indices is shown in r0945.

---

**p3116      BI: Acknowledgement automatically suppressed / Ackn suppress**CU\_DC, CU\_DC\_R,  
CU\_DC\_R\_S,  
CU\_DC\_S**Can be changed:** U, T  
**Data type:** Unsigned32 / Binary  
**P-Group:** Messages  
**Not for motor type:** -**Calculated:** -  
**Dyn. index:** -  
**Units group:** -  
**Scaling:** -**Access level:** 3  
**Func. diagram:** 8060  
**Unit selection:** -  
**Expert list:** 1**Min****Max****Factory setting**

-

-

0

**Description:** Sets the signal source for the automatic acknowledgement on the device drive object.  
BI: p3116 = 0 signal  
Faults present are automatically acknowledged on the device drive object. Local device faults are forwarded to the first active drive object.

BI: p3116 = 1 signal

Faults present are not automatically acknowledged on the device drive object. Local device faults are not forwarded.

**Dependency:** Refer to: p2102, p2103, p2104, p2105, p3981**Note:** When selecting a standard telegram, the BICO interconnection for control signal STW1.10 (master control by PLC) is automatically established.

<b>r3120[0...63]</b>		<b>Component number fault / Comp_no flt</b>				
All objects	<b>Can be changed:</b> -		<b>Calculated:</b> -		<b>Access level:</b> 3	
	<b>Data type:</b> Unsigned32		<b>Dyn. index:</b> -		<b>Func. diagram:</b> 8060	
	<b>P-Group:</b> Messages		<b>Units group:</b> -		<b>Unit selection:</b> -	
	<b>Not for motor type:</b> -		<b>Scaling:</b> -		<b>Expert list:</b> 1	
	<b>Min</b>		<b>Max</b>		<b>Factory setting</b>	
	-		-		-	
<b>Description:</b>		Displays the component number of the fault which has occurred.				
<b>Dependency:</b>		Refer to: r0945, r0947, r0948, r0949, r2109, r2130, r2133, r2136, r3122				
<b>Note:</b>		Value = 0: Assignment to a component not possible. The buffer parameters are cyclically updated in the background (refer to status signal in r2139). The structure of the fault buffer and the assignment of the indices is shown in r0945.				
<b>r3121[0...63]</b>		<b>Component number alarm / Comp_no alarm</b>				
All objects	<b>Can be changed:</b> -		<b>Calculated:</b> -		<b>Access level:</b> 3	
	<b>Data type:</b> Unsigned32		<b>Dyn. index:</b> -		<b>Func. diagram:</b> 8065	
	<b>P-Group:</b> Messages		<b>Units group:</b> -		<b>Unit selection:</b> -	
	<b>Not for motor type:</b> -		<b>Scaling:</b> -		<b>Expert list:</b> 1	
	<b>Min</b>		<b>Max</b>		<b>Factory setting</b>	
	-		-		-	
<b>Description:</b>		Displays the component number of the alarm which has occurred.				
<b>Dependency:</b>		Refer to: r2110, r2122, r2123, r2124, r2125, r2134, r2145, r2146, r3123				
<b>Note:</b>		Value = 0: Assignment to a component not possible. The buffer parameters are cyclically updated in the background (refer to status signal in r2139). The structure of the alarm buffer and the assignment of the indices is shown in r2122.				
<b>r3122[0...63]</b>		<b>Diagnostic attribute fault / Diag_attr fault</b>				
All objects	<b>Can be changed:</b> -		<b>Calculated:</b> -		<b>Access level:</b> 3	
	<b>Data type:</b> Unsigned32		<b>Dyn. index:</b> -		<b>Func. diagram:</b> 8060	
	<b>P-Group:</b> Messages		<b>Units group:</b> -		<b>Unit selection:</b> -	
	<b>Not for motor type:</b> -		<b>Scaling:</b> -		<b>Expert list:</b> 1	
	<b>Min</b>		<b>Max</b>		<b>Factory setting</b>	
	-		-		-	
<b>Description:</b>		Displays the diagnostic attribute of the fault which has occurred.				
<b>Bit field:</b>		<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>	<b>FP</b>
		00	Hardware replacement recommended	Yes	No	-
<b>Dependency:</b>		Refer to: r0945, r0947, r0948, r0949, r2109, r2130, r2133, r2136, r3120				
<b>Note:</b>		The buffer parameters are cyclically updated in the background (refer to status signal in r2139). The structure of the fault buffer and the assignment of the indices is shown in r0945.				
<b>r3123[0...63]</b>		<b>Diagnostic attribute alarm / Diag_attr alarm</b>				
All objects	<b>Can be changed:</b> -		<b>Calculated:</b> -		<b>Access level:</b> 3	
	<b>Data type:</b> Unsigned32		<b>Dyn. index:</b> -		<b>Func. diagram:</b> 8065	
	<b>P-Group:</b> Messages		<b>Units group:</b> -		<b>Unit selection:</b> -	
	<b>Not for motor type:</b> -		<b>Scaling:</b> -		<b>Expert list:</b> 1	
	<b>Min</b>		<b>Max</b>		<b>Factory setting</b>	
	-		-		-	
<b>Description:</b>		Displays the diagnostic attribute of the alarm which has occurred.				
<b>Bit field:</b>		<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>	<b>FP</b>
		00	Hardware replacement recommended	Yes	No	-
<b>Dependency:</b>		Refer to: r2110, r2122, r2123, r2124, r2125, r2134, r2145, r2146, r3121				

**Note:** The buffer parameters are cyclically updated in the background (refer to status signal in r2139).  
The structure of the alarm buffer and the assignment of the indices is shown in r2122.

---

**r3131 CO: Actual flt value / Actual flt value**

All objects	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Integer32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8060
	<b>P-Group:</b> Messages	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
-	-	-	

**Description:** Displays the fault value of the oldest active fault.

**Dependency:** Refer to: r2131, r3132

---

**r3132 CO: Actual component number / Act comp\_no.**

All objects	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Integer32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8060
	<b>P-Group:</b> Messages	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
-	-	-	

**Description:** Displays the component number of the oldest fault that is still active.

**Dependency:** Refer to: r2131, r3131

---

**p3135 Suppress active fault / Supp act flt**

DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8060
	<b>P-Group:</b> Messages	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
-	-	0000 0000 0000 0000 bin	

**Description:** Sets the suppression of r2139.3 "Fault present" for certain fault responses.

<b>Bit field:</b>	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>	<b>FP</b>
	08	Suppression of fault response ENCODER	ON	OFF	-
	10	Suppression of fault response NONE	ON	OFF	-

**Dependency:** Refer to: p0491, r2139

**Note:** Depending on the suppression of a fault reaction in this parameter, r2139.1 "Acknowledgement required" is set when at least one fault occurs.

Re bit 08:

The suppression is only effective if p0491 = 1.

---

**r3770 CO: Load speed / n\_load**

DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 1580, 4711
	<b>P-Group:</b> Setpoints	<b>Units group:</b> 3_1	<b>Unit selection:</b> p0505
	<b>Not for motor type:</b> -	<b>Scaling:</b> p2000	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
- [rpm]	- [rpm]	- [rpm]	

**Description:** Display and connector output for the load speed for APC (Advanced Positioning Control).

**Dependency:** Refer to: r3771



<b>r3771[0...1]</b>	<b>CO: Load speed smoothed / n_load smooth</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Setpoints <b>Not for motor type:</b> - <b>Min</b> - [rpm]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> 3_1 <b>Scaling:</b> p2000 <b>Max</b> - [rpm]	<b>Access level:</b> 3 <b>Func. diagram:</b> 1580, 4711 <b>Unit selection:</b> p0505 <b>Expert list:</b> 1 <b>Factory setting</b> - [rpm]
<b>Description:</b>	Display and connector output for the speed actual values for APC (Advanced Positioning Control). Index 0: Displays the smoothed load speed. Index 1: Displays the load/motor speed actual value weighted with p3702 for p3700.8=1.		
<b>Index:</b>	[0] = Load actual value speed smoothed [1] = Load/motor actual speed weighted		
<b>Dependency:</b>	Refer to: p1441, r3770		
<b>p3900</b>	<b>Completion of quick commissioning / Compl quick_comm</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(1) <b>Data type:</b> Integer16 <b>P-Group:</b> Displays, signals <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 3	<b>Access level:</b> 1 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Exits quick commissioning (p0010 = 1) with automatic calculation of all parameters of all existing drive data sets that depend on the entries made during quick commissioning. p3900 = 3 only includes the calculations associated with the motor, open-loop and closed-loop control parameters corresponding to p0340 = 1.		
<b>Value:</b>	0: No quick parameterization 3: Quick parameterization for motor parameters (only)		
<b>Notice:</b>	After the value has been modified, no further parameter modifications can be made and the status is shown in r3996. Modifications can be made again when r3996 = 0.		
<b>Note:</b>	When the calculations have been completed, p3900 and p0010 are automatically reset to a value of zero.		
<b>p3950</b>	<b>Service parameter / Serv. par.</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> C1, U, T <b>Data type:</b> Unsigned16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	For service personnel only.		
<b>r3974</b>	<b>Drive unit status word / Drv_unit ZSW</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 1 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the status word for the drive unit.		

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Software reset active	Yes	No	-
	01	Writing of parameters disabled as parameter save in progress	Yes	No	-
	02	Writing of parameters disabled as macro is running	Yes	No	-

<b>r3977</b>	<b>BICO counter topology / BICO counter topo</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> Commands <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the BICO interconnections that have been parameterized in the complete (overall) topology. The counter is incremented by one for each modified BICO interconnection.		
<b>Dependency:</b>	Refer to: r3978, r3979		

<b>r3978</b>	<b>BICO CounterDevice / BICO CounterDevice</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> Commands <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the counter reading for modified BICO interconnections on this device. The counter is incremented by one for each modified BICO interconnection.		

<b>r3979</b>	<b>BICO counter drive object / BICO counter DO</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150, TM15DI_DO, TM31	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> Commands <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> -
<b>Description:</b>	Displays the counter reading for modified BICO interconnections on this drive object. The counter is incremented by one for each modified BICO interconnection.		

<b>p3981</b>	<b>Faults acknowledge drive object / Faults ackn DO</b>		
All objects	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned8	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8060
	<b>P-Group:</b> Messages	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	1	0
<b>Description:</b>	Setting to acknowledge all active faults of a drive object.		
<b>Notice:</b>	Safety messages cannot be acknowledged using this parameter.		
<b>Note:</b>	Parameter should be set from 0 to 1 to acknowledge.		
	After acknowledgement, the parameter is automatically reset to 0.		

---

**p3985 Master control mode selection / PcCtrl mode select**

DC\_CTRL,  
DC\_CTRL\_R,  
DC\_CTRL\_R\_S,  
DC\_CTRL\_S

**Can be changed:** U, T

**Data type:** Integer16

**P-Group:** Setpoints

**Not for motor type:** -

**Min**

0

**Calculated:** -

**Dyn. index:** -

**Units group:** -

**Scaling:** -

**Max**

1

**Access level:** 3

**Func. diagram:** -

**Unit selection:** -

**Expert list:** 1

**Factory setting**

0

**Description:**

Sets the mode to change over the master control / LOCAL mode.

**Value:**

0: Change master control for STW1.0 = 0

1: Change master control in operation

**Danger:**

When changing the master control in operation, the drive can manifest undesirable behavior - e.g. it can accelerate up to another setpoint.




---

**r3986 Parameter count / Parameter No.**

All objects

**Can be changed:** -

**Data type:** Unsigned16

**P-Group:** -

**Not for motor type:** -

**Min**

-

**Calculated:** -

**Dyn. index:** -

**Units group:** -

**Scaling:** -

**Max**

-

**Access level:** 3

**Func. diagram:** -

**Unit selection:** -

**Expert list:** 1

**Factory setting**

-

**Description:**

Displays the number of parameters for this drive unit.

The number comprises the device-specific and the drive-specific parameters.

**Dependency:**

Refer to: r0980, r0981, r0989

---

**r3988[0...1] Boot state / Boot\_state**

CU\_DC, CU\_DC\_R,  
CU\_DC\_R\_S,  
CU\_DC\_S

**Can be changed:** -

**Data type:** Integer16

**P-Group:** -

**Not for motor type:** -

**Min**

0

**Calculated:** -

**Dyn. index:** -

**Units group:** -

**Scaling:** -

**Max**

10800

**Access level:** 3

**Func. diagram:** -

**Unit selection:** -

**Expert list:** 1

**Factory setting**

-

**Description:**

Index 0:

Displays the boot state.

Index 1:

Displays the partial boot state

**Value:**

0: Not active

1: Fatal fault

10: Fault

20: Reset all parameters

30: Drive object modified

40: Download using commissioning software

50: Parameter download using commissioning software

90: Reset Control Unit and delete drive objects

100: Start initialization

110: Instantiate Control Unit basis

150: Wait until actual topology determined

160: Evaluate topology

170: Instantiate Control Unit reset

180: Initialization YDB configuration information

200: First commissioning

210: Create drive packages

250: Wait for topology acknowledge

325: Wait for input of drive type

350: Determine drive type  
 360: Write into topology-dependent parameters  
 370: Wait until p0009 = 0 is set  
 380: Check topology  
 550: Call conversion functions for parameter  
 625: Wait non-cyclic starting DRIVE-CLiQ  
 650: Start cyclic operation  
 660: Evaluate drive commissioning status  
 670: Autom. FW update DRIVE-CLiQ components  
 680: Wait for CU LINK slaves  
 690: Wait non-cyclic starting DRIVE-CLiQ  
 700: Save parameters  
 725: Wait until DRIVE-CLiQ cyclic  
 740: Check the ability to operate  
 745: Start of the time slices  
 750: Interrupt enable  
 800: Initialization finished  
 10050: Wait for synchronization  
 10100: Wait for CU LINK slaves  
 10150: Wait until actual topology determined  
 10200: Evaluation component status  
 10250: Call conversion functions for parameter  
 10300: Preparation cyclic operation  
 10350: Autom. FW update DRIVE-CLiQ components  
 10400: Wait for slave properties  
 10450: Check CX/NX status  
 10500: Wait until DRIVE-CLiQ cyclic  
 10550: Carry out warm start  
 10600: Evaluate, encoder status  
 10800: Partial boot completed

**Index:**  
 [0] = System  
 [1] = Partial boot

---

**r3996[0...1]      Parameter write inhibit status / Par\_write inhib st**

All objects	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned8	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays whether writing to parameters is inhibited.  
 r3996[0] = 0:  
 Parameter write not inhibited.  
 0 < r3996[0] < 100:  
 Parameter write inhibited. The value shows how the calculations are progressing.

**Index:**  
 [0] = Progress calculations  
 [1] = Cause

**Note:** Re index 1:  
 Only for internal Siemens troubleshooting.

r4021 TM15DI/DO digital inputs terminal actual value / TM15D DI act val					
TM15DI_DO	Can be changed: -		Calculated: -	Access level: 2	
	Data type: Unsigned32		Dyn. index: -	Func. diagram: 9400, 9401, 9402	
	P-Group: Commands		Units group: -	Unit selection: -	
	Not for motor type: -		Scaling: -	Expert list: 1	
	Min	Max	Factory setting		
-	-	-	-		
<b>Description:</b>					
Displays the actual value at the digital inputs.					
This means that the actual input signal can be checked at terminal DI x or DI/DO x prior to switching from the simulation mode (p4095.x = 1) to terminal mode (p4095.x = 0).					
<b>Bit field:</b>					
	Bit	Signal name	1 signal	0 signal	FP
	00	DI/DO 0 (X520.2)	High	Low	-
	01	DI/DO 1 (X520.3)	High	Low	-
	02	DI/DO 2 (X520.4)	High	Low	-
	03	DI/DO 3 (X520.5)	High	Low	-
	04	DI/DO 4 (X520.6)	High	Low	-
	05	DI/DO 5 (X520.7)	High	Low	-
	06	DI/DO 6 (X520.8)	High	Low	-
	07	DI/DO 7 (X520.9)	High	Low	-
	08	DI/DO 8 (X521.2)	High	Low	-
	09	DI/DO 9 (X521.3)	High	Low	-
	10	DI/DO 10 (X521.4)	High	Low	-
	11	DI/DO 11 (X521.5)	High	Low	-
	12	DI/DO 12 (X521.6)	High	Low	-
	13	DI/DO 13 (X521.7)	High	Low	-
	14	DI/DO 14 (X521.8)	High	Low	-
	15	DI/DO 15 (X521.9)	High	Low	-
	16	DI/DO 16 (X522.2)	High	Low	-
	17	DI/DO 17 (X522.3)	High	Low	-
	18	DI/DO 18 (X522.4)	High	Low	-
	19	DI/DO 19 (X522.5)	High	Low	-
	20	DI/DO 20 (X522.6)	High	Low	-
	21	DI/DO 21 (X522.7)	High	Low	-
	22	DI/DO 22 (X522.8)	High	Low	-
	23	DI/DO 23 (X522.9)	High	Low	-
<b>Note:</b>					
If a DI/DO is parameterized as output (p4028.x = 1), then r4021.x = 0 is displayed.					
DI/DO: Bidirectional Digital Input/Output					

<b>r4021</b>	<b>TM31 digital inputs terminal actual value / TM31 DI act value</b>				
TM31	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2		
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 1840, 9550, 9552, 9560, 9562		
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -		
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1		
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>		
	-	-	-		
<b>Description:</b>	Displays the actual value at the digital inputs. This means that the actual input signal can be checked at terminal DI x or DI/DO x prior to switching from the simulation mode (p4095.x = 1) to terminal mode (p4095.x = 0).				
<b>Bit field:</b>	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>	<b>FP</b>
	00	DI 0 (X520.1)	High	Low	-
	01	DI 1 (X520.2)	High	Low	-
	02	DI 2 (X520.3)	High	Low	-
	03	DI 3 (X520.4)	High	Low	-
	04	DI 4 (X530.1)	High	Low	-
	05	DI 5 (X530.2)	High	Low	-

06	DI 6 (X530.3)	High	Low	-
07	DI 7 (X530.4)	High	Low	-
08	DI/DO 8 (X541.2)	High	Low	-
09	DI/DO 9 (X541.3)	High	Low	-
10	DI/DO 10 (X541.4)	High	Low	-
11	DI/DO 11 (X541.5)	High	Low	-

**Note:** If a DI/DO is parameterized as output (p4028.x = 1), then r4021.x = 0 is displayed.

DI: Digital Input

DI/DO: Bidirectional Digital Input/Output

#### r4022.0...23 CO/BO: TM15DI/DO digital inputs status / TM15D DI status

TM15DI_DO	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 1781, 9400, 9401, 9402
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the status of the digital inputs of Terminal Module 15 (TM15).

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	DI/DO 0 (X520.2)	High	Low	-
	01	DI/DO 1 (X520.3)	High	Low	-
	02	DI/DO 2 (X520.4)	High	Low	-
	03	DI/DO 3 (X520.5)	High	Low	-
	04	DI/DO 4 (X520.6)	High	Low	-
	05	DI/DO 5 (X520.7)	High	Low	-
	06	DI/DO 6 (X520.8)	High	Low	-
	07	DI/DO 7 (X520.9)	High	Low	-
	08	DI/DO 8 (X521.2)	High	Low	-
	09	DI/DO 9 (X521.3)	High	Low	-
	10	DI/DO 10 (X521.4)	High	Low	-
	11	DI/DO 11 (X521.5)	High	Low	-
	12	DI/DO 12 (X521.6)	High	Low	-
	13	DI/DO 13 (X521.7)	High	Low	-
	14	DI/DO 14 (X521.8)	High	Low	-
	15	DI/DO 15 (X521.9)	High	Low	-
	16	DI/DO 16 (X522.2)	High	Low	-
	17	DI/DO 17 (X522.3)	High	Low	-
	18	DI/DO 18 (X522.4)	High	Low	-
	19	DI/DO 19 (X522.5)	High	Low	-
	20	DI/DO 20 (X522.6)	High	Low	-
	21	DI/DO 21 (X522.7)	High	Low	-
	22	DI/DO 22 (X522.8)	High	Low	-
	23	DI/DO 23 (X522.9)	High	Low	-

**Dependency:** Refer to: r4023, r4024, r4025

**Notice:** For the BICO interconnection of the connector output (CO) only bit 00 ... 15 are transferred.

**Note:** DI/DO: Bidirectional Digital Input/Output

#### r4022.0...11 CO/BO: TM31 digital inputs status / TM31 DI status

TM31	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 1840, 9550, 9552, 9560, 9562
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the status of the digital inputs of Terminal Module 31 (TM31).

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	DI 0 (X520.1)	High	Low	-
	01	DI 1 (X520.2)	High	Low	-
	02	DI 2 (X520.3)	High	Low	-
	03	DI 3 (X520.4)	High	Low	-
	04	DI 4 (X530.1)	High	Low	-
	05	DI 5 (X530.2)	High	Low	-
	06	DI 6 (X530.3)	High	Low	-
	07	DI 7 (X530.4)	High	Low	-
	08	DI/DO 8 (X541.2)	High	Low	-
	09	DI/DO 9 (X541.3)	High	Low	-
	10	DI/DO 10 (X541.4)	High	Low	-
	11	DI/DO 11 (X541.5)	High	Low	-

**Dependency:** Refer to: r4023

**Note:** DI: Digital Input  
DI/DO: Bidirectional Digital Input/Output

<b>r4023.0...23</b>	<b>CO/BO: TM15DI/DO digital inputs status inverted / TM15D DI stat inv</b>		
TM15DI_DO	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 1781, 9400, 9401, 9402
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the inverted status of the digital inputs of Terminal Module 15 (TM15).

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	DI/DO 0 (X520.2)	High	Low	-
	01	DI/DO 1 (X520.3)	High	Low	-
	02	DI/DO 2 (X520.4)	High	Low	-
	03	DI/DO 3 (X520.5)	High	Low	-
	04	DI/DO 4 (X520.6)	High	Low	-
	05	DI/DO 5 (X520.7)	High	Low	-
	06	DI/DO 6 (X520.8)	High	Low	-
	07	DI/DO 7 (X520.9)	High	Low	-
	08	DI/DO 8 (X521.2)	High	Low	-
	09	DI/DO 9 (X521.3)	High	Low	-
	10	DI/DO 10 (X521.4)	High	Low	-
	11	DI/DO 11 (X521.5)	High	Low	-
	12	DI/DO 12 (X521.6)	High	Low	-
	13	DI/DO 13 (X521.7)	High	Low	-
	14	DI/DO 14 (X521.8)	High	Low	-
	15	DI/DO 15 (X521.9)	High	Low	-
	16	DI/DO 16 (X522.2)	High	Low	-
	17	DI/DO 17 (X522.3)	High	Low	-
	18	DI/DO 18 (X522.4)	High	Low	-
	19	DI/DO 19 (X522.5)	High	Low	-
	20	DI/DO 20 (X522.6)	High	Low	-
	21	DI/DO 21 (X522.7)	High	Low	-
	22	DI/DO 22 (X522.8)	High	Low	-
	23	DI/DO 23 (X522.9)	High	Low	-

**Dependency:** Refer to: r4022, r4024, r4025

**Notice:** For the BICO interconnection of the connector output (CO) only bit 00 ... 15 are transferred.

**Note:** DI/DO: Bidirectional Digital Input/Output

<b>r4023.0...11</b>	<b>CO/BO: TM31 digital inputs status inverted / TM31 DI status inv</b>				
TM31	<b>Can be changed:</b> -		<b>Calculated:</b> -		<b>Access level:</b> 1
	<b>Data type:</b> Unsigned32		<b>Dyn. index:</b> -		<b>Func. diagram:</b> 1840, 9550, 9552, 9560, 9562
	<b>P-Group:</b> Commands		<b>Units group:</b> -		<b>Unit selection:</b> -
	<b>Not for motor type:</b> -		<b>Scaling:</b> -		<b>Expert list:</b> 1
	<b>Min</b>		<b>Max</b>		<b>Factory setting</b>
	-		-		-
<b>Description:</b>	Displays the inverted status of the digital inputs of Terminal Module 31 (TM31).				
<b>Bit field:</b>	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>	<b>FP</b>
	00	DI 0 (X520.1)	High	Low	-
	01	DI 1 (X520.2)	High	Low	-
	02	DI 2 (X520.3)	High	Low	-
	03	DI 3 (X520.4)	High	Low	-
	04	DI 4 (X530.1)	High	Low	-
	05	DI 5 (X530.2)	High	Low	-
	06	DI 6 (X530.3)	High	Low	-
	07	DI 7 (X530.4)	High	Low	-
	08	DI/DO 8 (X541.2)	High	Low	-
	09	DI/DO 9 (X541.3)	High	Low	-
	10	DI/DO 10 (X541.4)	High	Low	-
	11	DI/DO 11 (X541.5)	High	Low	-
<b>Dependency:</b>	Refer to: r4022				
<b>Note:</b>	DI: Digital Input				
	DI/DO: Bidirectional Digital Input/Output				

<b>r4024</b>	<b>CO: TM15DI/DO digital inputs 16 ... 23 status / TM15D DI 16-23 St</b>				
TM15DI_DO	<b>Can be changed:</b> -		<b>Calculated:</b> -	<b>Access level:</b> 1	
	<b>Data type:</b> Unsigned16		<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9402	
	<b>P-Group:</b> Commands		<b>Units group:</b> -	<b>Unit selection:</b> -	
	<b>Not for motor type:</b> -		<b>Scaling:</b> -	<b>Expert list:</b> 1	
	<b>Min</b>		<b>Max</b>	<b>Factory setting</b>	
	-		-	-	
<b>Description:</b>	Displays the status of digital inputs 16 ... 23 of Terminal Module 15 (TM15).				
<b>Bit field:</b>	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>	<b>FP</b>
	00	DI/DO 16 (X522.2)	ON	OFF	-
	01	DI/DO 17 (X522.3)	ON	OFF	-
	02	DI/DO 18 (X522.4)	ON	OFF	-
	03	DI/DO 19 (X522.5)	ON	OFF	-
	04	DI/DO 20 (X522.6)	ON	OFF	-
	05	DI/DO 21 (X522.7)	ON	OFF	-
	06	DI/DO 22 (X522.8)	ON	OFF	-
	07	DI/DO 23 (X522.9)	ON	OFF	-
<b>Dependency:</b>	Refer to: r4022, r4023, r4025				
<b>Note:</b>	DI: Digital Input				

<b>r4025</b>	<b>CO: TM15DI/DO digital inputs 16 ... 23 status inverted / TM15D DI 16-23 inv</b>		
TM15DI_DO	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9402
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays the inverted status of digital inputs 16 ... 23 of Terminal Module 15 (TM15).		



Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	DI/DO 16 (X522.2)	ON	OFF	-
	01	DI/DO 17 (X522.3)	ON	OFF	-
	02	DI/DO 18 (X522.4)	ON	OFF	-
	03	DI/DO 19 (X522.5)	ON	OFF	-
	04	DI/DO 20 (X522.6)	ON	OFF	-
	05	DI/DO 21 (X522.7)	ON	OFF	-
	06	DI/DO 22 (X522.8)	ON	OFF	-
	07	DI/DO 23 (X522.9)	ON	OFF	-

**Dependency:** Refer to: r4022, r4023, r4024

**Note:** DI: Digital Input

#### p4028 TM15DI/DO set input or output / TM15D DI or DO

TM15DI_DO	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 1781, 9400, 9401, 9402
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0000 0000 0000 0000 0000 0000 0000 0000 bin

**Description:** Sets the bidirectional digital inputs/outputs on the Terminal Module 15 (TM15) as input or output.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	DI/DO 0 (X520.2)	Output	Input	-
	01	DI/DO 1 (X520.3)	Output	Input	-
	02	DI/DO 2 (X520.4)	Output	Input	-
	03	DI/DO 3 (X520.5)	Output	Input	-
	04	DI/DO 4 (X520.6)	Output	Input	-
	05	DI/DO 5 (X520.7)	Output	Input	-
	06	DI/DO 6 (X520.8)	Output	Input	-
	07	DI/DO 7 (X520.9)	Output	Input	-
	08	DI/DO 8 (X521.2)	Output	Input	-
	09	DI/DO 9 (X521.3)	Output	Input	-
	10	DI/DO 10 (X521.4)	Output	Input	-
	11	DI/DO 11 (X521.5)	Output	Input	-
	12	DI/DO 12 (X521.6)	Output	Input	-
	13	DI/DO 13 (X521.7)	Output	Input	-
	14	DI/DO 14 (X521.8)	Output	Input	-
	15	DI/DO 15 (X521.9)	Output	Input	-
	16	DI/DO 16 (X522.2)	Output	Input	-
	17	DI/DO 17 (X522.3)	Output	Input	-
	18	DI/DO 18 (X522.4)	Output	Input	-
	19	DI/DO 19 (X522.5)	Output	Input	-
	20	DI/DO 20 (X522.6)	Output	Input	-
	21	DI/DO 21 (X522.7)	Output	Input	-
	22	DI/DO 22 (X522.8)	Output	Input	-
	23	DI/DO 23 (X522.9)	Output	Input	-

**Note:** DI/DO: Bidirectional Digital Input/Output

#### p4028 TM31 set input or output / TM31 DI or DO

TM31	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 1840, 9560, 9562
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0000 0000 0000 0000 bin

**Description:** Sets the bidirectional digital inputs/outputs as input or output on the Terminal Module 31 (TM31).

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	08	DI/DO 8 (X541.2)	Output	Input	-
	09	DI/DO 9 (X541.3)	Output	Input	-
	10	DI/DO 10 (X541.4)	Output	Input	-
	11	DI/DO 11 (X541.5)	Output	Input	-

**Note:** DI/DO: Bidirectional Digital Input/Output

---

**p4030 BI: TM15DI/DO signal source for terminal DI/DO 0 / TM15D S\_src DI/DO0**

TM15DI_DO	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 1781, 9400
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Sets the signal source for terminal DI/DO 0 (X520.2) of Terminal Module 15 (TM15).

**Note:** Prerequisite: The DI/DO must be set as an output (p4028.0 = 1).

DI/DO: Bidirectional Digital Input/Output

---

**p4030 BI: TM31 signal source for terminal DO 0 / TM31 s s DO 0**

TM31	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 1840, 9556
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Sets the signal source for the digital output DO 0 (X542.1, X542.2, X542.3) of Terminal Module 31 (TM31).  
Digital output 0 of TM31 is a relay output.

If the signal at the binector input p4030 is low, then terminal COM 0 (X542.2) is connected to NC 0 (X542.1). This connection also matches the mechanical quiescent setting of the relay.

If the signal at the binector input p4030 is high, then terminal COM 0 (X542.2) is connected to NO 0 (X542.3).

**Note:** DO: Digital Output

NC: Normally Closed contact

NO: Normally Open contact

---

**p4031 BI: TM15DI/DO signal source for terminal DI/DO 1 / TM15D S\_src DI/DO1**

TM15DI_DO	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9400
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Sets the signal source for terminal DI/DO 1 (X520.3) of Terminal Module 15 (TM15).

**Note:** Prerequisite: The DI/DO must be set as an output (p4028.1 = 1).

DI/DO: Bidirectional Digital Input/Output

---

**p4031 BI: TM31 signal source for terminal DO 1 / TM31 s s DO 1**

TM31	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 1840, 9556
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Sets the signal source for the digital output DO 1 (X542.4, X542.5, X542.6) of Terminal Module 31 (TM31).

Digital output 1 of TM31 is a relay output.

If the signal at the binector input p4031 is low, then terminal COM 1 (X542.5) is connected to NC 1 (X542.4). This connection also matches the mechanical quiescent setting of the relay.

If the signal at the binector input p4031 is high, then terminal COM 1 (X542.5) is connected to NO 1 (X542.6).

**Note:**

DO: Digital Output

NC: Normally Closed contact

NO: Normally Open contact

<b>p4032</b>	<b>BI: TM15DI/DO signal source for terminal DI/DO 2 / TM15D S_src DI/DO2</b>		
TM15DI_DO	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9400
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0
<b>Description:</b>	Sets the signal source for terminal DI/DO 2 (X520.4) of Terminal Module 15 (TM15).		
<b>Note:</b>	Prerequisite: The DI/DO must be set as an output (p4028.2 = 1). DI/DO: Bidirectional Digital Input/Output		

<b>p4033</b>	<b>BI: TM15DI/DO signal source for terminal DI/DO 3 / TM15D S_src DI/DO3</b>		
TM15DI_DO	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9400
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0
<b>Description:</b>	Sets the signal source for terminal DI/DO 3 (X520.5) of Terminal Module 15 (TM15).		
<b>Note:</b>	Prerequisite: The DI/DO must be set as an output (p4028.3 = 1). DI/DO: Bidirectional Digital Input/Output		

<b>p4034</b>	<b>BI: TM15DI/DO signal source for terminal DI/DO 4 / TM15D S_src DI/DO4</b>		
TM15DI_DO	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9400
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0
<b>Description:</b>	Sets the signal source for terminal DI/DO 4 (X520.6) of Terminal Module 15 (TM15).		
<b>Note:</b>	Prerequisite: The DI/DO must be set as an output (p4028.4 = 1). DI/DO: Bidirectional Digital Input/Output		

<b>p4035</b>	<b>BI: TM15DI/DO signal source for terminal DI/DO 5 / TM15D S_src DI/DO5</b>		
TM15DI_DO	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9400
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0
<b>Description:</b>	Sets the signal source for terminal DI/DO 5 (X520.7) of Terminal Module 15 (TM15).		
<b>Note:</b>	Prerequisite: The DI/DO must be set as an output (p4028.5 = 1). DI/DO: Bidirectional Digital Input/Output		

<b>p4036</b>	<b>BI: TM15DI/DO signal source for terminal DI/DO 6 / TM15D S_src DI/DO6</b>		
TM15DI_DO	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> Commands <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 1 <b>Func. diagram:</b> 9400 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the signal source for terminal DI/DO 6 (X520.8) of Terminal Module 15 (TM15).		
<b>Note:</b>	Prerequisite: The DI/DO must be set as an output (p4028.6 = 1). DI/DO: Bidirectional Digital Input/Output		
<b>p4037</b>	<b>BI: TM15DI/DO signal source for terminal DI/DO 7 / TM15D S_src DI/DO7</b>		
TM15DI_DO	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> Commands <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 1 <b>Func. diagram:</b> 9400 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the signal source for terminal DI/DO 7 (X520.9) of Terminal Module 15 (TM15).		
<b>Note:</b>	Prerequisite: The DI/DO must be set as an output (p4028.7 = 1). DI/DO: Bidirectional Digital Input/Output		
<b>p4038</b>	<b>BI: TM15DI/DO signal source for terminal DI/DO 8 / TM15D S_src DI/DO8</b>		
TM15DI_DO	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> Commands <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 1 <b>Func. diagram:</b> 9401 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the signal source for terminal DI/DO 8 (X521.2) of terminal module 15 (TM15).		
<b>Note:</b>	Prerequisite: The DI/DO must be set as an output (p4028.8 = 1). DI/DO: Bidirectional Digital Input/Output		
<b>p4038</b>	<b>BI: TM31 signal source for terminal DI/DO 8 / TM31 S_src DI/DO8</b>		
TM31	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> Commands <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 1 <b>Func. diagram:</b> 1840, 9560 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the signal source for terminal DI/DO 8 (X541.2) of Terminal Module 31 (TM31).		
<b>Note:</b>	Prerequisite: The DI/DO must be set as an output (p4028.8 = 1). DI/DO: Bidirectional Digital Input/Output		

<b>p4039</b>	<b>BI: TM15DI/DO signal source for terminal DI/DO 9 / TM15D S_src DI/DO9</b>		
TM15DI_DO	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9401
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0
<b>Description:</b>	Sets the signal source for terminal DI/DO 9 (X521.3) of Terminal Module 15 (TM15).		
<b>Note:</b>	Prerequisite: The DI/DO must be set as an output (p4028.9 = 1). DI/DO: Bidirectional Digital Input/Output		

<b>p4039</b>	<b>BI: TM31 signal source for terminal DI/DO 9 / TM31 S_src DI/DO9</b>		
TM31	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9560
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0
<b>Description:</b>	Sets the signal source for terminal DI/DO 9 (X541.3) of Terminal Module 31 (TM31).		
<b>Note:</b>	Prerequisite: The DI/DO must be set as an output (p4028.9 = 1). DI/DO: Bidirectional Digital Input/Output		


<b>p4040</b>	<b>BI: TM15DI/DO signal source for terminal DI/DO 10 / TM15D S_srcDI/DO10</b>		
TM15DI_DO	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9401
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0
<b>Description:</b>	Sets the signal source for terminal DI/DO 10 (X521.4) of Terminal Module 15 (TM15).		
<b>Note:</b>	Prerequisite: The DI/DO must be set as an output (p4028.10 = 1). DI/DO: Bidirectional Digital Input/Output		

<b>p4040</b>	<b>BI: TM31 signal source for terminal DI/DO 10 / TM31 S_src DI/DO10</b>		
TM31	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9562
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0
<b>Description:</b>	Sets the signal source for terminal DI/DO 10 (X541.4) of Terminal Module 31 (TM31).		
<b>Note:</b>	Prerequisite: The DI/DO must be set as an output (p4028.10 = 1). DI/DO: Bidirectional Digital Input/Output		

<b>p4041</b>	<b>BI: TM15DI/DO signal source for terminal DI/DO 11 / TM15D S_srcDI/DO11</b>		
TM15DI_DO	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9401
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0
<b>Description:</b>	Sets the signal source for terminal DI/DO 11 (X521.5) of Terminal Module 15 (TM15).		
<b>Note:</b>	Prerequisite: The DI/DO must be set as an output (p4028.11 = 1). DI/DO: Bidirectional Digital Input/Output		
<b>p4041</b>	<b>BI: TM31 signal source for terminal DI/DO 11 / TM31 S_src DI/DO11</b>		
TM31	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 1840, 9562
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0
<b>Description:</b>	Sets the signal source for terminal DI/DO 11 (X541.5) of Terminal Module 31 (TM31).		
<b>Note:</b>	Prerequisite: The DI/DO must be set as an output (p4028.11 = 1). DI/DO: Bidirectional Digital Input/Output		
<b>p4042</b>	<b>BI: TM15DI/DO signal source for terminal DI/DO 12 / TM15D S_srcDI/DO12</b>		
TM15DI_DO	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9401
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0
<b>Description:</b>	Sets the signal source for terminal DI/DO 12 (X521.6) of Terminal Module 15 (TM15).		
<b>Note:</b>	Prerequisite: The DI/DO must be set as an output (p4028.12 = 1). DI/DO: Bidirectional Digital Input/Output		
<b>p4043</b>	<b>BI: TM15DI/DO signal source for terminal DI/DO 13 / TM15D S_srcDI/DO13</b>		
TM15DI_DO	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9401
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0
<b>Description:</b>	Sets the signal source for terminal DI/DO 13 (X521.7) of Terminal Module 15 (TM15).		
<b>Note:</b>	Prerequisite: The DI/DO must be set as an output (p4028.13 = 1). DI/DO: Bidirectional Digital Input/Output		

<b>p4044</b>	<b>BI: TM15DI/DO signal source for terminal DI/DO 14 / TM15D S_srcDI/DO14</b>			
TM15DI_DO	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 1	
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9401	
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -	
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1	
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>	
	-	-	0	
<b>Description:</b>	Sets the signal source for terminal DI/DO 14 (X521.8) of Terminal Module 15 (TM15).			
<b>Note:</b>	Prerequisite: The DI/DO must be set as an output (p4028.14 = 1). DI/DO: Bidirectional Digital Input/Output			

<b>p4045</b>	<b>BI: TM15DI/DO signal source for terminal DI/DO 15 / TM15D S_srcDI/DO15</b>			
TM15DI_DO	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 1	
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9401	
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -	
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1	
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>	
	-	-	0	
<b>Description:</b>	Sets the signal source for terminal DI/DO 15 (X521.9) of Terminal Module 15 (TM15).			
<b>Note:</b>	Prerequisite: The DI/DO must be set as an output (p4028.15 = 1). DI/DO: Bidirectional Digital Input/Output			

<b>p4046</b>	<b>TM31 digital outputs limit current / TM31 DO limit curr</b>			
TM31	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2	
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9560	
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -	
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1	
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>	
	0	1	0	
<b>Description:</b>	Sets the limit for the total output voltage of terminals X541.1, X541.2, X541.3 and X541.4 (DI/DO 8 ... 11) of Terminal Module 31 (TM31).			
<b>Value:</b>	0: 0.1 A total current limit DI/DO 8 ... 11 1: 1.0 A total current limit DI/DO 8 ... 11			
<b>Dependency:</b>	Refer to: p4028			
<b>Warning:</b>	Since the sum of the output currents at terminals X541.1, X541.2, X541.3 and X541.4 is limited, an overcurrent or short circuit at one output terminal can cause a dip in the signal at the other terminals.			
				

<b>r4047</b>	<b>TM15DI/DO digital outputs status / TM15D DO status</b>				
TM15DI_DO	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1		
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9400, 9401, 9402		
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -		
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1		
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>		
	-	-	-		
<b>Description:</b>	Displays the status of the digital outputs of Terminal Module 15 (TM15).				
<b>Bit field:</b>	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>	<b>FP</b>
	00	DI/DO 0 (X520.2)	High	Low	-
	01	DI/DO 1 (X520.3)	High	Low	-
	02	DI/DO 2 (X520.4)	High	Low	-
	03	DI/DO 3 (X520.5)	High	Low	-

04	DI/DO 4 (X520.6)	High	Low	-
05	DI/DO 5 (X520.7)	High	Low	-
06	DI/DO 6 (X520.8)	High	Low	-
07	DI/DO 7 (X520.9)	High	Low	-
08	DI/DO 8 (X521.2)	High	Low	-
09	DI/DO 9 (X521.3)	High	Low	-
10	DI/DO 10 (X521.4)	High	Low	-
11	DI/DO 11 (X521.5)	High	Low	-
12	DI/DO 12 (X521.6)	High	Low	-
13	DI/DO 13 (X521.7)	High	Low	-
14	DI/DO 14 (X521.8)	High	Low	-
15	DI/DO 15 (X521.9)	High	Low	-
16	DI/DO 16 (X522.2)	High	Low	-
17	DI/DO 17 (X522.3)	High	Low	-
18	DI/DO 18 (X522.4)	High	Low	-
19	DI/DO 19 (X522.5)	High	Low	-
20	DI/DO 20 (X522.6)	High	Low	-
21	DI/DO 21 (X522.7)	High	Low	-
22	DI/DO 22 (X522.8)	High	Low	-
23	DI/DO 23 (X522.9)	High	Low	-

**Note:** Inversion using p4048 has been taken into account.  
The setting of the DI/DO as either input or output is of no significance (p4028).  
DI/DO: Bidirectional Digital Input/Output

---

**r4047 TM31 digital outputs status / TM31 DO status**

TM31	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9556, 9560, 9562
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the status of the digital outputs of Terminal Module 31 (TM31).

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	DO 0 (X542.1 - 3)	High	Low	-
	01	DO 1 (X542.4 - 6)	High	Low	-
	08	DI/DO 8 (X541.2)	High	Low	-
	09	DI/DO 9 (X541.3)	High	Low	-
	10	DI/DO 10 (X541.4)	High	Low	-
	11	DI/DO 11 (X541.5)	High	Low	-

**Note:** Inversion using p4048 has been taken into account.  
The setting of the DI/DO as either input or output is of no significance (p4028).  
DO: Digital Output  
DI/DO: Bidirectional Digital Input/Output

---

**p4048 TM15DI/DO invert digital outputs / TM15D DO inv**

TM15DI_DO	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9400, 9401, 9402
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0000 0000 0000 0000 0000 0000 0000 bin

**Description:** Setting to invert the signals at the digital outputs of Terminal Module 15 (TM15).



Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	DI/DO 0 (X520.2)	Inverted	Not inverted	-
	01	DI/DO 1 (X520.3)	Inverted	Not inverted	-
	02	DI/DO 2 (X520.4)	Inverted	Not inverted	-
	03	DI/DO 3 (X520.5)	Inverted	Not inverted	-
	04	DI/DO 4 (X520.6)	Inverted	Not inverted	-
	05	DI/DO 5 (X520.7)	Inverted	Not inverted	-
	06	DI/DO 6 (X520.8)	Inverted	Not inverted	-
	07	DI/DO 7 (X520.9)	Inverted	Not inverted	-
	08	DI/DO 8 (X521.2)	Inverted	Not inverted	-
	09	DI/DO 9 (X521.3)	Inverted	Not inverted	-
	10	DI/DO 10 (X521.4)	Inverted	Not inverted	-
	11	DI/DO 11 (X521.5)	Inverted	Not inverted	-
	12	DI/DO 12 (X521.6)	Inverted	Not inverted	-
	13	DI/DO 13 (X521.7)	Inverted	Not inverted	-
	14	DI/DO 14 (X521.8)	Inverted	Not inverted	-
	15	DI/DO 15 (X521.9)	Inverted	Not inverted	-
	16	DI/DO 16 (X522.2)	Inverted	Not inverted	-
	17	DI/DO 17 (X522.3)	Inverted	Not inverted	-
	18	DI/DO 18 (X522.4)	Inverted	Not inverted	-
	19	DI/DO 19 (X522.5)	Inverted	Not inverted	-
	20	DI/DO 20 (X522.6)	Inverted	Not inverted	-
	21	DI/DO 21 (X522.7)	Inverted	Not inverted	-
	22	DI/DO 22 (X522.8)	Inverted	Not inverted	-
	23	DI/DO 23 (X522.9)	Inverted	Not inverted	-

**Note:** DI/DO: Bidirectional Digital Input/Output

#### p4048 TM31 invert digital outputs / TM31 DO inv

TM31	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9556, 9560, 9562
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0000 0000 0000 0000 bin

**Description:** Setting to invert the signals at the digital outputs of Terminal Module 31 (TM31).

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	DO 0 (X542.1 - 3)	Inverted	Not inverted	-
	01	DO 1 (X542.4 - 6)	Inverted	Not inverted	-
	08	DI/DO 8 (X541.2)	Inverted	Not inverted	-
	09	DI/DO 9 (X541.3)	Inverted	Not inverted	-
	10	DI/DO 10 (X541.4)	Inverted	Not inverted	-
	11	DI/DO 11 (X541.5)	Inverted	Not inverted	-

**Note:** DO: Digital Output  
DI/DO: Bidirectional Digital Input/Output

#### r4052[0...1] CO: TM31 analog inputs current input voltage/current / TM31 AI U/I\_inp

TM31	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9566, 9568
	<b>P-Group:</b> Terminals	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the actual input voltage in V when set as voltage input.  
Displays the actual input current in mA when set as current input and with the load resistor switched in.

**Index:** [0] = AI 0 (X521.1/X521.2, S5.0)  
[1] = AI 1 (X521.3/X521.4, S5.1)

**Dependency:** The type of analog input AI x (voltage or current input) is set using p4056.

Refer to: p4056

**Note:** AI: Analog Input

<b>p4053[0...1]</b>		<b>TM31 analog inputs smoothing time constant / TM31 AI T_smooth</b>	
TM31	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9566, 9568
	<b>P-Group:</b> Terminals	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0.0 [ms]	<b>Max</b> 1000.0 [ms]	<b>Factory setting</b> 0.0 [ms]
<b>Description:</b> Sets the smoothing time constant of the 1st-order low pass filter for the analog inputs of Terminal Module 31 (TM31).			
<b>Index:</b> [0] = AI 0 (X521.1/X521.2, S5.0) [1] = AI 1 (X521.3/X521.4, S5.1)			
<b>Note:</b> AI: Analog Input			

<b>r4055[0...1]</b>		<b>CO: TM31 analog inputs actual value in percent / TM31 AI value in %</b>	
TM31	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 1840, 9566, 9568
	<b>P-Group:</b> Terminals	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> - [%]	<b>Max</b> - [%]	<b>Factory setting</b> - [%]
<b>Description:</b> Displays the currently referred input value of the analog inputs of Terminal Module 31 (TM31). When interconnected, the signals are referred to the reference quantities p200x and p205x.			
<b>Index:</b> [0] = AI 0 (X521.1/X521.2, S5.0) [1] = AI 1 (X521.3/X521.4, S5.1)			
<b>Note:</b> AI: Analog Input			

<b>p4056[0...1]</b>		<b>TM31 analog inputs type / TM31 AI type</b>	
TM31	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9566, 9568
	<b>P-Group:</b> Terminals	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 5	<b>Factory setting</b> 4
<b>Description:</b> Sets the type of analog inputs of Terminal Module 31 (TM31). p4056[x] = 0, 4 correspond to a voltage input (r4052, p4057, p4059 are displayed in V). p4056[x] = 2, 3, 5 correspond to a current input (r4052, p4057, p4059 are displayed in mA). In addition, the associated switch S5 must be appropriately set. AI 0: S5.0 = V --> voltage input, S5.0 = I --> current input (burden resistor = 250 Ohm) AI 1: S5.1 = V --> voltage input, S5.1 = I --> current input (burden resistor = 250 Ohm)			
<b>Value:</b> 0: Unipolar voltage input (0 V ... +10 V) 2: Unipolar current input (0 mA ... +20 mA) 3: Unipolar current input monitored (+4 mA to +20 mA) 4: Bipolar voltage input (-10 V ... +10 V) 5: Bipolar current input (-20 mA to +20 mA)			
<b>Index:</b> [0] = AI 0 (X521.1/X521.2, S5.0) [1] = AI 1 (X521.3/X521.4, S5.1)			

**Warning:**



The maximum voltage difference between the analog input terminals AI+, AI- and the ground of the TM31 (X520.6, X530.3) may not exceed 35 V.

**Notice:**

For operation with the load resistor switched in, the voltage between the differential inputs AI+ and AI- may not exceed 15 V or the impressed current of 60 mA; if this is not carefully observed, the input will be damaged.

**Note:**

For operation as a voltage input/current input, switch S5.0 or S5.1 must be appropriately set.  
When changing p4056, the parameters of the scaling characteristic (p4057, p4058, p4059, p4060) are overwritten with the following default values:

For p4056 = 0, 4, p4057 is set to 0.0 V, p4058 to 0.0 %, p4059 to 10.0 V and p4060 to 100.0 %.

For p4056 = 2, 5, p4057 is set to 0.0 mA, p4058 to 0.0 %, p4059 to 20.0 mA and p4060 to 100.0 %.

For p4056 = 3, p4057 is set to 4.0 mA, p4058 to 0.0 %, p4059 to 20.0 mA and p4060 to 100.0 %.

<b>p4057[0...1] TM31 analog inputs characteristic value x1 / TM31 AI char x1</b>			
TM31	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9566, 9568
	<b>P-Group:</b> Terminals	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> -20.000	<b>Max</b> 20.000	<b>Factory setting</b> 0.000
<b>Description:</b>	Sets the scaling characteristic for the analog inputs of Terminal Module 31 (TM31). The scaling characteristic for the analog inputs is defined using 2 points. This parameter specifies the x coordinate (input voltage in V or input current in mA) of the 1st value pair of the characteristic.		
<b>Index:</b>	[0] = AI 0 (X521.1/X521.2, S5.0) [1] = AI 1 (X521.3/X521.4, S5.1)		
<b>Dependency:</b>	The unit of this parameter (V or mA) depends on the analog input type. Refer to: p4056		
<b>Notice:</b>	This parameter is automatically overwritten when the analog input type (p4056) is modified.		
<b>Note:</b>	The parameters for the characteristic do not have a limiting effect.		

<b>p4058[0...1] TM31 analog inputs characteristic value y1 / TM31 AI char y1</b>			
TM31	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9566, 9568
	<b>P-Group:</b> Terminals	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> -1000.00 [%]	<b>Max</b> 1000.00 [%]	<b>Factory setting</b> 0.00 [%]
<b>Description:</b>	Sets the scaling characteristic for the analog inputs of Terminal Module 31 (TM31). The scaling characteristic for the analog inputs is defined using 2 points. This parameter specifies the y coordinate (percentage) of the 1st value pair of the characteristic.		
<b>Index:</b>	[0] = AI 0 (X521.1/X521.2, S5.0) [1] = AI 1 (X521.3/X521.4, S5.1)		
<b>Notice:</b>	This parameter is automatically overwritten when the analog input type (p4056) is modified.		
<b>Note:</b>	The parameters for the characteristic do not have a limiting effect.		

<b>p4059[0...1] TM31 analog inputs characteristic value x2 / TM31 AI char x2</b>			
TM31	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9566, 9568
	<b>P-Group:</b> Terminals	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> -20.000	<b>Max</b> 20.000	<b>Factory setting</b> 10.000
<b>Description:</b>	Sets the scaling characteristic for the analog inputs of Terminal Module 31 (TM31). The scaling characteristic for the analog inputs is defined using 2 points.		

	This parameter specifies the x coordinate (input voltage in V or input current in mA) of the 2nd value pair of the characteristic.		
<b>Index:</b>	[0] = AI 0 (X521.1/X521.2, S5.0) [1] = AI 1 (X521.3/X521.4, S5.1)		
<b>Dependency:</b>	The unit of this parameter (V or mA) depends on the analog input type. Refer to: p4056		
<b>Notice:</b>	This parameter is automatically overwritten when the analog input type (p4056) is modified.		
<b>Note:</b>	The parameters for the characteristic do not have a limiting effect.		

---

**p4060[0...1] TM31 analog inputs characteristic value y2 / TM31 AI char y2**

TM31	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9566, 9568
	<b>P-Group:</b> Terminals	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> -1000.00 [%]	<b>Max</b> 1000.00 [%]	<b>Factory setting</b> 100.00 [%]
<b>Description:</b>	Sets the scaling characteristic for the analog inputs of Terminal Module 31 (TM31). The scaling characteristic for the analog inputs is defined using 2 points. This parameter specifies the y coordinate (percentage) of the 2nd value pair of the characteristic.		
<b>Index:</b>	[0] = AI 0 (X521.1/X521.2, S5.0) [1] = AI 1 (X521.3/X521.4, S5.1)		
<b>Notice:</b>	This parameter is automatically overwritten when the analog input type (p4056) is modified.		
<b>Note:</b>	The parameters for the characteristic do not have a limiting effect.		

---

**p4061[0...1] TM31 analog inputs wire breakage monitoring response threshold / TM31 WireBrkThresh**

TM31	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9566, 9568
	<b>P-Group:</b> Terminals	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0.00 [mA]	<b>Max</b> 20.00 [mA]	<b>Factory setting</b> 2.00 [mA]
<b>Description:</b>	Sets the response threshold for wire-breakage monitoring of the analog inputs of Terminal Module 31 (TM31).		
<b>Index:</b>	[0] = AI 0 (X521.1/X521.2, S5.0) [1] = AI 1 (X521.3/X521.4, S5.1)		
<b>Dependency:</b>	For the following analog input type, the wire breakage monitoring is active: p4056[x] = 3 (unipolar current input monitored (+4 mA ... +20 mA)) Refer to: p4056		

---

**p4062[0...1] TM31 analog inputs wire breakage monitoring delay time / TM31 wirebrk t\_del**

TM31	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9566, 9568
	<b>P-Group:</b> Terminals	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0 [ms]	<b>Max</b> 1000 [ms]	<b>Factory setting</b> 100 [ms]
<b>Description:</b>	Sets the delay time for wire-breakage monitoring of the analog inputs on Terminal Module 31 (TM31).		
<b>Index:</b>	[0] = AI 0 (X521.1/X521.2, S5.0) [1] = AI 1 (X521.3/X521.4, S5.1)		

<b>p4063[0...1]      TM31 analog inputs offset / TM31 AI offset</b>			
TM31	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Terminals <b>Not for motor type:</b> - <b>Min</b> -20.000	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 20.000	<b>Access level:</b> 2 <b>Func. diagram:</b> 9566, 9568 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.000
<b>Description:</b>	Sets the offset for the analog inputs of Terminal Module 31 (TM31). The offset is added to the input signal before the scaling characteristic.		
<b>Index:</b>	[0] = AI 0 (X521.1/X521.2, S5.0) [1] = AI 1 (X521.3/X521.4, S5.1)		
<b>p4066[0...1]      TM31 analog inputs activate absolute value generation / TM31 AI absVal act</b>			
TM31	<b>Can be changed:</b> U, T <b>Data type:</b> Integer16 <b>P-Group:</b> Terminals <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1	<b>Access level:</b> 3 <b>Func. diagram:</b> 9566, 9568 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Activates the absolute value generation for the analog input signals of Terminal Module 31 (TM31).		
<b>Value:</b>	0:      No absolute value generation 1:      Absolute value generation switched in		
<b>Index:</b>	[0] = AI 0 (X521.1/X521.2, S5.0) [1] = AI 1 (X521.3/X521.4, S5.1)		
<b>p4067[0...1]      BI: TM31 analog inputs invert signal source / TM31 AI inv s s</b>			
TM31	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> Terminals <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 9566, 9568 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the signal source to invert the analog inputs signals of Terminal Module 31 (TM31).		
<b>Index:</b>	[0] = AI 0 (X521.1/X521.2, S5.0) [1] = AI 1 (X521.3/X521.4, S5.1)		
<b>p4068[0...1]      TM31 analog inputs window to suppress noise / TM31 AI window</b>			
TM31	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Terminals <b>Not for motor type:</b> - <b>Min</b> 0.00 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 20.00 [%]	<b>Access level:</b> 3 <b>Func. diagram:</b> 9566, 9568 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.00 [%]
<b>Description:</b>	Sets the noise suppression window of the analog inputs for Terminal Module31 (TM31). Changes less than the window are suppressed.		
<b>Index:</b>	[0] = AI 0 (X521.1/X521.2, S5.0) [1] = AI 1 (X521.3/X521.4, S5.1)		
<b>Note:</b>	AI: Analog Input		

<b>p4069[0...1] BI: TM31 analog inputs signal source for enable / TM31 AI enable</b>			
TM31	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> Terminals <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 9566, 9568 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b> Sets the signal source for the enable signal of the analog inputs of Terminal Module 31 (TM31).			
<b>Index:</b> [0] = AI 0 (X521.1/X521.2, S5.0) [1] = AI 1 (X521.3/X521.4, S5.1)			
<b>p4071[0...1] CI: TM31 analog outputs signal source / TM31 AO s s</b>			
TM31	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> Terminals <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> -	<b>Access level:</b> 1 <b>Func. diagram:</b> 1840, 9572 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b> Sets the signal source for the analog outputs of Terminal Module 31 (TM31).			
<b>Index:</b> [0] = AO 0 (X522.1, X522.2, X522.3) [1] = AO 1 (X522.4, X522.5, X522.6)			
<b>Note:</b> AO: Analog Output			
<b>r4072[0...1] TM31 analog outputs output value currently referred / TM31 AO outp_val</b>			
TM31	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Terminals <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> - [%]	<b>Access level:</b> 1 <b>Func. diagram:</b> 9572 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b> Displays the actual referred output value of the analog outputs of Terminal Module 31 (TM31).			
<b>Index:</b> [0] = AO 0 (X522.1, X522.2, X522.3) [1] = AO 1 (X522.4, X522.5, X522.6)			
<b>p4073[0...1] TM31 analog outputs smoothing time constant / TM31 AO T_smooth</b>			
TM31	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Terminals <b>Not for motor type:</b> - <b>Min</b> 0.0 [ms]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1000.0 [ms]	<b>Access level:</b> 1 <b>Func. diagram:</b> 9572 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.0 [ms]
<b>Description:</b> Sets the smoothing time constant of the 1st-order low pass filter for the analog outputs of Terminal Module 31 (TM31).			
<b>Index:</b> [0] = AO 0 (X522.1, X522.2, X522.3) [1] = AO 1 (X522.4, X522.5, X522.6)			

<b>r4074[0...1]</b>			
<b>TM31 analog outputs current output voltage/current / TM31 AO U/I_outp</b>			
TM31	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Terminals <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> p2001 <b>Max</b> -	<b>Access level:</b> 1 <b>Func. diagram:</b> 9572 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the actual output voltage in V when set as voltage output. Displays the actual output voltage in mA when set as current output.		
<b>Index:</b>	[0] = AO 0 (X522.1, X522.2, X522.3) [1] = AO 1 (X522.4, X522.5, X522.6)		
<b>Dependency:</b>	The type of the analog output AO x (voltage or current output) is set using p4076. Refer to: p4076		
<b>Note:</b>	AO: Analog Output		
<hr/>			
<b>p4075[0...1]</b>			
<b>TM31 analog outputs activate absolute value generation / TM31 AO absVal act</b>			
TM31	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> Terminals <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1	<b>Access level:</b> 3 <b>Func. diagram:</b> 9572 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Activates the absolute value generation for the analog outputs of Terminal Module 31 (TM31).		
<b>Value:</b>	0: No absolute value generation 1: Absolute value generation switched in		
<b>Index:</b>	[0] = AO 0 (X522.1, X522.2, X522.3) [1] = AO 1 (X522.4, X522.5, X522.6)		
<hr/>			
<b>p4076[0...1]</b>			
<b>TM31 analog outputs type / TM31 AO type</b>			
TM31	<b>Can be changed:</b> U, T <b>Data type:</b> Integer16 <b>P-Group:</b> Terminals <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 4	<b>Access level:</b> 1 <b>Func. diagram:</b> 9572 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 4
<b>Description:</b>	Sets the type of analog outputs of Terminal Module 31 (TM31). p4076[x] = 1, 4 correspond to a voltage output (p4074, p4078, p4080, p4083 are displayed in V). p4076[x] = 0, 2, 3 correspond to a current output (p4074, p4078, p4080, p4083 are displayed in mA).		
<b>Value:</b>	0: Current output (0 mA ... +20 mA) 1: Voltage output (0 V ... +10 V) 2: Current output (+4 mA ... +20 mA) 3: Current output (-20 mA ... +20 mA) 4: Voltage output (-10 V ... +10 V)		
<b>Index:</b>	[0] = AO 0 (X522.1, X522.2, X522.3) [1] = AO 1 (X522.4, X522.5, X522.6)		
<b>Dependency:</b>	Refer to: p4077, p4078, p4079, p4080		
<b>Note:</b>	When changing p4076, the parameters of the scaling characteristic (p4077, p4078, p4079, p4080) are overwritten with the following default values: For p4076 = 0, 3, p4077 is set to 0.0 %, p4078 to 0.0 mA, p4079 to 100.0 % and p4080 to 20.0 mA. For p4076 = 1, 4, p4077 is set to 0.0 %, p4078 to 0.0 V, p4079 to 100.0 % and p4080 to 10.0 V. For p4076 = 2, p4077 is set to 0.0 %, p4078 to 4.0 mA, p4079 to 100.0 % and p4080 to 20.0 mA.		

**p4077[0...1] TM31 analog outputs characteristic value x1 / TM31 AO char x1**

TM31	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9572
	<b>P-Group:</b> Terminals	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> -1000.00 [%]	<b>Max</b> 1000.00 [%]	<b>Factory setting</b> 0.00 [%]
<b>Description:</b>	Sets the scaling characteristic for the analog outputs of Terminal Module 31 (TM31). The scaling characteristic for the analog outputs is defined using 2 points. This parameter specifies the x coordinate (percentage) of the 1st value pair of the characteristic.		
<b>Index:</b>	[0] = AO 0 (X522.1, X522.2, X522.3) [1] = AO 1 (X522.4, X522.5, X522.6)		
<b>Dependency:</b>	Refer to: p4076		
<b>Notice:</b>	This parameter is automatically overwritten when changing p4076 (type of analog outputs).		
<b>Note:</b>	The parameters for the characteristic do not have a limiting effect.		

**p4078[0...1] TM31 analog outputs characteristic value y1 / TM31 AO char y1**

TM31	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9572
	<b>P-Group:</b> Terminals	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> -20.000 [V]	<b>Max</b> 20.000 [V]	<b>Factory setting</b> 0.000 [V]
<b>Description:</b>	Sets the scaling characteristic for the analog outputs of Terminal Module 31 (TM31). The scaling characteristic for the analog outputs is defined using 2 points. This parameter specifies the y coordinate (output voltage in V or output current in mA) of the 1st value pair of the characteristic.		
<b>Index:</b>	[0] = AO 0 (X522.1, X522.2, X522.3) [1] = AO 1 (X522.4, X522.5, X522.6)		
<b>Dependency:</b>	The unit of this parameter (V or mA) depends on the analog output type. Refer to: p4076		
<b>Notice:</b>	This parameter is automatically overwritten when changing p4076 (type of analog outputs).		
<b>Note:</b>	The parameters for the characteristic do not have a limiting effect.		

**p4079[0...1] TM31 analog outputs characteristic value x2 / TM31 AO char x2**

TM31	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9572
	<b>P-Group:</b> Terminals	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> -1000.00 [%]	<b>Max</b> 1000.00 [%]	<b>Factory setting</b> 100.00 [%]
<b>Description:</b>	Sets the scaling characteristic for the analog outputs of Terminal Module 31 (TM31). The scaling characteristic for the analog outputs is defined using 2 points. This parameter specifies the x coordinate (percentage) of the 2nd value pair of the characteristic.		
<b>Index:</b>	[0] = AO 0 (X522.1, X522.2, X522.3) [1] = AO 1 (X522.4, X522.5, X522.6)		
<b>Dependency:</b>	Refer to: p4076		
<b>Notice:</b>	This parameter is automatically overwritten when changing p4076 (type of analog outputs).		
<b>Note:</b>	The parameters for the characteristic do not have a limiting effect.		



<b>p4080[0...1] TM31 analog outputs characteristic value y2 / TM31 AO char y2</b>			
TM31	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Terminals <b>Not for motor type:</b> - <b>Min</b> -20.000 [V]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 20.000 [V]	<b>Access level:</b> 2 <b>Func. diagram:</b> 9572 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 10.000 [V]
<b>Description:</b>	Sets the scaling characteristic for the analog outputs of Terminal Module 31 (TM31). The scaling characteristic for the analog outputs is defined using 2 points. This parameter specifies the y coordinate (output voltage in V or output current in mA) of the 2nd value pair of the characteristic.		
<b>Index:</b>	[0] = AO 0 (X522.1, X522.2, X522.3) [1] = AO 1 (X522.4, X522.5, X522.6)		
<b>Dependency:</b>	The unit of this parameter (V or mA) depends on the analog output type. Refer to: p4076		
<b>Notice:</b>	This parameter is automatically overwritten when changing p4076 (type of analog outputs).		
<b>Note:</b>	The parameters for the characteristic do not have a limiting effect.		
<hr/>			
<b>p4082[0...1] BI: TM31 analog outputs invert signal source / TM31 AO inv s s</b>			
TM31	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> Terminals <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 9572 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the signal source to invert the analog output signals of Terminal Module 31 (TM31).		
<b>Index:</b>	[0] = AO 0 (X522.1, X522.2, X522.3) [1] = AO 1 (X522.4, X522.5, X522.6)		
<hr/>			
<b>p4083[0...1] TM31 analog outputs offset / TM31 AO offset</b>			
TM31	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Terminals <b>Not for motor type:</b> - <b>Min</b> -20.000	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 20.000	<b>Access level:</b> 1 <b>Func. diagram:</b> 9572 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.000
<b>Description:</b>	Sets the offset for the analog outputs of Terminal Module 31 (TM31). The offset is added to the output signal after the scaling characteristic.		
<b>Index:</b>	[0] = AO 0 (X522.1, X522.2, X522.3) [1] = AO 1 (X522.4, X522.5, X522.6)		
<b>Dependency:</b>	The unit of this parameter (V or mA) depends on the analog input type. Refer to: p4076		
<b>Note:</b>	This means, for example, the offset of a downstream isolating amplifier can be compensated.		
<hr/>			
<b>p4086 BI: TM15DI/DO signal source for terminal DI/DO 16 / TM15D S_srcDI/DO16</b>			
TM15DI_DO	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> Commands <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 1 <b>Func. diagram:</b> 9402 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the signal source for terminal DI/DO 16 (X522.2) of Terminal Module 15 (TM15).		

**Note:** Prerequisite: The DI/DO must be set as an output (p4028.16 = 1).  
DI/DO: Bidirectional Digital Input/Output

---

<b>p4087</b>	<b>BI: TM15DI/DO signal source for terminal DI/DO 17 / TM15D S_srcDI/DO17</b>		
TM15DI_DO	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9402
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Sets the signal source for terminal DI/DO 17 (X522.3) of Terminal Module 15 (TM15).

**Note:** Prerequisite: The DI/DO must be set as an output (p4028.17 = 1).  
DI/DO: Bidirectional Digital Input/Output

---

<b>p4088</b>	<b>BI: TM15DI/DO signal source for terminal DI/DO 18 / TM15D S_srcDI/DO18</b>		
TM15DI_DO	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9402
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Sets the signal source for terminal DI/DO 18 (X522.4) of Terminal Module 15 (TM15).

**Note:** Prerequisite: The DI/DO must be set as an output (p4028.18 = 1).  
DI/DO: Bidirectional Digital Input/Output

---

<b>p4089</b>	<b>BI: TM15DI/DO signal source for terminal DI/DO 19 / TM15D S_srcDI/DO19</b>		
TM15DI_DO	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9402
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Sets the signal source for terminal DI/DO 19 (X522.5) of Terminal Module 15 (TM15).

**Note:** Prerequisite: The DI/DO must be set as an output (p4028.19 = 1).  
DI/DO: Bidirectional Digital Input/Output

---

<b>p4090</b>	<b>BI: TM15DI/DO signal source for terminal DI/DO 20 / TM15D S_srcDI/DO20</b>		
TM15DI_DO	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9402
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Sets the signal source for terminal DI/DO 20 (X522.6) of Terminal Module 15 (TM15).

**Note:** Prerequisite: The DI/DO must be set as an output (p4028.20 = 1).  
DI/DO: Bidirectional Digital Input/Output

<b>p4091</b>	<b>BI: TM15DI/DO signal source for terminal DI/DO 21 / TM15D S_srcDI/DO21</b>		
TM15DI_DO	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9402
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0
<b>Description:</b>	Sets the signal source for terminal DI/DO 21 (X522.7) of Terminal Module 15 (TM15).		
<b>Note:</b>	Prerequisite: The DI/DO must be set as an output (p4028.21 = 1). DI/DO: Bidirectional Digital Input/Output		

<b>p4092</b>	<b>BI: TM15DI/DO signal source for terminal DI/DO 22 / TM15D S_srcDI/DO22</b>		
TM15DI_DO	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9402
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0
<b>Description:</b>	Sets the signal source for terminal DI/DO 22 (X522.8) of Terminal Module 15 (TM15).		
<b>Note:</b>	Prerequisite: The DI/DO must be set as an output (p4028.22 = 1). DI/DO: Bidirectional Digital Input/Output		

<b>p4093</b>	<b>BI: TM15DI/DO signal source for terminal DI/DO 23 / TM15D S_srcDI/DO23</b>		
TM15DI_DO	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9402
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0
<b>Description:</b>	Sets the signal source for terminal DI/DO 23 (X522.9) of Terminal Module 15 (TM15).		
<b>Note:</b>	Prerequisite: The DI/DO must be set as an output (p4028.23 = 1). DI/DO: Bidirectional Digital Input/Output		

<b>r4094.0...23</b>	<b>BO: TM15 digital inputs status inverted raw data internal / TM15 DI st raw dat</b>		
TM15DI_DO	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the inverted status of the raw data of the digital inputs of the Terminal Module 15 (TM15).

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	DI/DO 0 (X520.2)	High	Low	-
	01	DI/DO 1 (X520.3)	High	Low	-
	02	DI/DO 2 (X520.4)	High	Low	-
	03	DI/DO 3 (X520.5)	High	Low	-
	04	DI/DO 4 (X520.6)	High	Low	-
	05	DI/DO 5 (X520.7)	High	Low	-
	06	DI/DO 6 (X520.8)	High	Low	-
	07	DI/DO 7 (X520.9)	High	Low	-
	08	DI/DO 8 (X521.2)	High	Low	-
	09	DI/DO 9 (X521.3)	High	Low	-
	10	DI/DO 10 (X521.4)	High	Low	-

11	DI/DO 11 (X521.5)	High	Low	-
12	DI/DO 12 (X521.6)	High	Low	-
13	DI/DO 13 (X521.7)	High	Low	-
14	DI/DO 14 (X521.8)	High	Low	-
15	DI/DO 15 (X521.9)	High	Low	-
16	DI/DO 16 (X522.2)	High	Low	-
17	DI/DO 17 (X522.3)	High	Low	-
18	DI/DO 18 (X522.4)	High	Low	-
19	DI/DO 19 (X522.5)	High	Low	-
20	DI/DO 20 (X522.6)	High	Low	-
21	DI/DO 21 (X522.7)	High	Low	-
22	DI/DO 22 (X522.8)	High	Low	-
23	DI/DO 23 (X522.9)	High	Low	-

**Notice:** The raw data of the digital inputs is directly displayed (e.g. without any debounce).

**Note:** Should only used for internal Siemens purposes (alternative r4022, r4023).

**p4095****TM15DI/DO digital inputs simulation mode / TM15D DI sim\_mode**

TM15DI\_DO

**Can be changed:** U, T**Calculated:** -**Access level:** 2**Data type:** Unsigned32**Dyn. index:** -**Func. diagram:** 9400, 9401, 9402**P-Group:** Terminals**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** -**Expert list:** 1**Min****Max**
**Factory setting**  
 0000 0000 0000 0000 0000  
 0000 0000 0000 bin

**Description:** Sets the simulation mode for the digital inputs of Terminal Module 15 (TM15).

**Bit field:**

Bit	Signal name	1 signal	0 signal	FP
00	DI/DO 0 (X520.2)	Simulation	Terminal eval	-
01	DI/DO 1 (X520.3)	Simulation	Terminal eval	-
02	DI/DO 2 (X520.4)	Simulation	Terminal eval	-
03	DI/DO 3 (X520.5)	Simulation	Terminal eval	-
04	DI/DO 4 (X520.6)	Simulation	Terminal eval	-
05	DI/DO 5 (X520.7)	Simulation	Terminal eval	-
06	DI/DO 6 (X520.8)	Simulation	Terminal eval	-
07	DI/DO 7 (X520.9)	Simulation	Terminal eval	-
08	DI/DO 8 (X521.2)	Simulation	Terminal eval	-
09	DI/DO 9 (X521.3)	Simulation	Terminal eval	-
10	DI/DO 10 (X521.4)	Simulation	Terminal eval	-
11	DI/DO 11 (X521.5)	Simulation	Terminal eval	-
12	DI/DO 12 (X521.6)	Simulation	Terminal eval	-
13	DI/DO 13 (X521.7)	Simulation	Terminal eval	-
14	DI/DO 14 (X521.8)	Simulation	Terminal eval	-
15	DI/DO 15 (X521.9)	Simulation	Terminal eval	-
16	DI/DO 16 (X522.2)	Simulation	Terminal eval	-
17	DI/DO 17 (X522.3)	Simulation	Terminal eval	-
18	DI/DO 18 (X522.4)	Simulation	Terminal eval	-
19	DI/DO 19 (X522.5)	Simulation	Terminal eval	-
20	DI/DO 20 (X522.6)	Simulation	Terminal eval	-
21	DI/DO 21 (X522.7)	Simulation	Terminal eval	-
22	DI/DO 22 (X522.8)	Simulation	Terminal eval	-
23	DI/DO 23 (X522.9)	Simulation	Terminal eval	-

**Dependency:** The setpoint for the input signals is specified using p4096.

Refer to: p4096

**Warning:**

A drive that is moved by simulating the inputs of a Terminal Module is brought to a standstill while the Terminal Module is being activated or de-activated.

**Note:**

This parameter is not saved when data is backed-up (p0971, p0977).

DI/DO: Bidirectional Digital Input/Output

**p4095 TM31 digital inputs simulation mode / TM31 DI sim\_mode**

TM31	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 1840, 9550, 9552, 9560, 9562
	<b>P-Group:</b> Terminals	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0000 0000 0000 0000 bin

**Description:** Sets the simulation mode for the digital inputs of Terminal Module 31 (TM31).

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	DI 0 (X520.1)	Simulation	Terminal eval	-
	01	DI 1 (X520.2)	Simulation	Terminal eval	-
	02	DI 2 (X520.3)	Simulation	Terminal eval	-
	03	DI 3 (X520.4)	Simulation	Terminal eval	-
	04	DI 4 (X530.1)	Simulation	Terminal eval	-
	05	DI 5 (X530.2)	Simulation	Terminal eval	-
	06	DI 6 (X530.3)	Simulation	Terminal eval	-
	07	DI 7 (X530.4)	Simulation	Terminal eval	-
	08	DI/DO 8 (X541.2)	Simulation	Terminal eval	-
	09	DI/DO 9 (X541.3)	Simulation	Terminal eval	-
	10	DI/DO 10 (X541.4)	Simulation	Terminal eval	-
	11	DI/DO 11 (X541.5)	Simulation	Terminal eval	-

**Dependency:** The setpoint for the input signals is specified using p4096.

Refer to: p4096

**Warning:**

A drive that is moved by simulating the inputs of a Terminal Module is brought to a standstill while the Terminal Module is being activated or de-activated.

**Note:**

This parameter is not saved when data is backed-up (p0971, p0977).

DI: Digital Input

DI/DO: Bidirectional Digital Input/Output

**p4096 TM15DI/DO digital inputs simulation mode, setpoint / TM15D DI sim setp**

TM15DI_DO	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9400, 9401, 9402
	<b>P-Group:</b> Terminals	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0000 0000 0000 0000 0000 0000 0000 bin

**Description:** Sets the setpoint for the input signals in the simulation mode of the digital inputs of Terminal Module 15 (TM15).

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	DI/DO 0 (X520.2)	High	Low	-
	01	DI/DO 1 (X520.3)	High	Low	-
	02	DI/DO 2 (X520.4)	High	Low	-
	03	DI/DO 3 (X520.5)	High	Low	-
	04	DI/DO 4 (X520.6)	High	Low	-
	05	DI/DO 5 (X520.7)	High	Low	-
	06	DI/DO 6 (X520.8)	High	Low	-
	07	DI/DO 7 (X520.9)	High	Low	-
	08	DI/DO 8 (X521.2)	High	Low	-
	09	DI/DO 9 (X521.3)	High	Low	-
	10	DI/DO 10 (X521.4)	High	Low	-
	11	DI/DO 11 (X521.5)	High	Low	-
	12	DI/DO 12 (X521.6)	High	Low	-
	13	DI/DO 13 (X521.7)	High	Low	-

14	DI/DO 14 (X521.8)	High	Low	-
15	DI/DO 15 (X521.9)	High	Low	-
16	DI/DO 16 (X522.2)	High	Low	-
17	DI/DO 17 (X522.3)	High	Low	-
18	DI/DO 18 (X522.4)	High	Low	-
19	DI/DO 19 (X522.5)	High	Low	-
20	DI/DO 20 (X522.6)	High	Low	-
21	DI/DO 21 (X522.7)	High	Low	-
22	DI/DO 22 (X522.8)	High	Low	-
23	DI/DO 23 (X522.9)	High	Low	-

**Dependency:** The simulation of a digital input is selected using p4095.  
Refer to: p4095

**Note:** This parameter is not saved when data is backed-up (p0971, p0977).  
DI/DO: Bidirectional Digital Input/Output

#### p4096 TM31 digital inputs simulation mode setpoint / TM31 DI sim setp

TM31	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 1840, 9550, 9552, 9560, 9562
	<b>P-Group:</b> Terminals	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0000 0000 0000 0000 bin

**Description:** Sets the setpoint for the input signals in the simulation mode of the digital inputs of Terminal Module 31 (TM31).

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	DI 0 (X520.1)	High	Low	-
	01	DI 1 (X520.2)	High	Low	-
	02	DI 2 (X520.3)	High	Low	-
	03	DI 3 (X520.4)	High	Low	-
	04	DI 4 (X530.1)	High	Low	-
	05	DI 5 (X530.2)	High	Low	-
	06	DI 6 (X530.3)	High	Low	-
	07	DI 7 (X530.4)	High	Low	-
	08	DI/DO 8 (X541.2)	High	Low	-
	09	DI/DO 9 (X541.3)	High	Low	-
	10	DI/DO 10 (X541.4)	High	Low	-
	11	DI/DO 11 (X541.5)	High	Low	-

**Dependency:** The simulation of a digital input is selected using p4095.  
Refer to: p4095

**Note:** This parameter is not saved when data is backed-up (p0971, p0977).  
DI: Digital Input  
DI/DO: Bidirectional Digital Input/Output

#### p4097[0...1] TM31 analog inputs simulation mode / TM31 AI sim\_mode

TM31	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9566, 9568
	<b>P-Group:</b> Terminals	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	1	0

**Description:** Sets the simulation mode for the analog inputs of Terminal Module 31 (TM31).

**Value:** 0: Terminal evaluation for analog input x  
1: Simulation for analog input x

**Index:** [0] = AI 0 (X521.1/X521.2, S5.0)  
[1] = AI 1 (X521.3/X521.4, S5.1)

**Dependency:** The setpoint for the input voltage is specified via p4098.  
Refer to: p4098

**Note:** This parameter is not saved when data is backed-up (p0971, p0977).  
AI: Analog Input

<b>p4098[0...1]</b>		<b>TM31 analog inputs simulation mode setpoint / TM31 AI sim setp</b>		
TM31	<b>Can be changed:</b>	U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b>	FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9566, 9568
	<b>P-Group:</b>	Terminals	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b>	-	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	-20.000	<b>Max</b>	<b>Factory setting</b>
			20.000	0.000
<b>Description:</b>	Sets the setpoint for the input value in simulation mode of the analog inputs of Terminal Module 31 (TM31).			
<b>Index:</b>	[0] = AI 0 (X521.1/X521.2, S5.0) [1] = AI 1 (X521.3/X521.4, S5.1)			
<b>Dependency:</b>	The simulation of an analog input is selected using p4097. If AI x is parameterized as voltage input (p4056), then the setpoint is a voltage in V. If AI x is parameterized as current input (p4056), then the setpoint is a current in mA. Refer to: p4056, p4097			
<b>Note:</b>	This parameter is not saved when data is backed-up (p0971, p0977). AI: Analog Input			

<b>p4099</b>		<b>TM15DI/DO inputs/outputs sampling time / TM15D I/O t_sample</b>		
TM15DI_DO	<b>Can be changed:</b>	C1(3)	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b>	FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 1781, 9400
	<b>P-Group:</b>	Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b>	-	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	0.00 [µs]	<b>Max</b>	<b>Factory setting</b>
			5000.00 [µs]	4000.00 [µs]
<b>Description:</b>	Sets the sampling time for the inputs and outputs of Terminal Module 15 (TM15).			
<b>Dependency:</b>	The parameter can only be modified for p0009 = 3, 29. The following applies for the sampling time: The sampling times at a DRIVE-CLiQ line must be integral multiples of one another. The sampling times of this TM must be an integral multiple of a servo or vector drive that exists in the system. The minimum permissible sampling time is 125 µs. Refer to: p0009, r0110, r0111			
<b>Note:</b>	The changed sampling time is immediately effective after a completed sub-boot (p0009 -> 0). Parameter p4099[0] must never be equal to zero.			

<b>p4099[0...2]</b>		<b>TM31 inputs/outputs sampling time / TM31 I/O t_sample</b>		
TM31	<b>Can be changed:</b>	C1(3)	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b>	FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 1840, 9550
	<b>P-Group:</b>	Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b>	-	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	0.00 [µs]	<b>Max</b>	<b>Factory setting</b>
			5000.00 [µs]	4000.00 [µs]
<b>Description:</b>	Sets the sampling time for the inputs and outputs of Terminal Module 31 (TM31).			
<b>Index:</b>	[0] = Digital inputs/outputs (DI/DO) [1] = Analog inputs (AI) [2] = Analog outputs (AO)			

- Dependency:** The parameter can only be modified for p0009 = 3, 29.  
The following applies for the sampling time:  
The sampling times at a DRIVE-CLiQ line must be integral multiples of one another.  
The sampling times of this TM must be an integral multiple of a servo or vector drive that exists in the system.  
The minimum permissible sampling time is 125 µs.  
The sampling times entered in index 0 (digital inputs/outputs) and index 2 (analog outputs) must always be greater than or equal to the sampling time in index 1 (analog inputs).  
Refer to: p0009, r0110, r0111
- Notice:** The sampling times entered in index 0 (digital inputs/outputs) and index 2 (analog outputs) must always be greater than or equal to the sampling time in index 1 (analog inputs).
- Note:** The changed sampling time is immediately effective after a completed sub-boot (p0009 → 0).  
Parameter p4099[0] must never be equal to zero.

---

<b>p4100[0...11]</b>	<b>TM150 sensor type / TM150 sensor type</b>		
TM150	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 6	<b>Access level:</b> 1 <b>Func. diagram:</b> 9626, 9627 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 5
<b>Description:</b>	Sets the sensor type for Terminal Module 150 (TM150) This means that the temperature sensor type is selected and the evaluation is switched in.		
<b>Value:</b>	0: Evaluation disabled 1: PTC thermistor 2: KTY84 4: Bimetallic NC contact 5: PT100 6: PT1000		
<b>Index:</b>	[0] = Temperature channel 0 [1] = Temperature channel 1 [2] = Temperature channel 2 [3] = Temperature channel 3 [4] = Temperature channel 4 [5] = Temperature channel 5 [6] = Temperature channel 6 [7] = Temperature channel 7 [8] = Temperature channel 8 [9] = Temperature channel 9 [10] = Temperature channel 10 [11] = Temperature channel 11		
<b>Notice:</b>	For p4102[0...23] = 251 °C, evaluation of the corresponding threshold is deactivated. For sensor type "PTC thermistor" and "Bimetallic NC contact" (p4100[0...11] = 1, 4), the following applies: To activate the corresponding alarm or fault, p4102[0...23] must be set ≤ 250 °C.		
<b>Note:</b>	The temperature sensors are connected to the following terminals: X531 = channel 0 (for 2x2 wire evaluation, additionally channel 6) X532 = channel 1 (for 2x2 wire evaluation, additionally channel 7) X533 = channel 2 (for 2x2 wire evaluation, additionally channel 8) X534 = channel 3 (for 2x2 wire evaluation, additionally channel 9) X535 = channel 4 (for 2x2 wire evaluation, additionally channel 10) X536 = channel 5 (for 2x2 wire evaluation, additionally channel 11) Details on the wiring are included in the parameter description for p4108.		



<b>p4100</b>			
<b>TM31 sensor type / TM31 sensor type</b>			
TM31	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9576
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	2	0
<b>Description:</b>	Sets the sensor type for Terminal Module 31 (TM31) This means that the temperature sensor type is selected and the evaluation is switched in.		
<b>Value:</b>	0: Evaluation disabled 1: PTC thermistor 2: KTY84		
<b>Notice:</b>	For p4102[0...1] = 251 °C, evaluation of the corresponding threshold is deactivated. For sensor type "PTC thermistor" (p4100 = 1), the following applies: To activate the corresponding alarm or fault, p4102[0...1] must be set <= 250 °C.		
<b>Note:</b>	The temperature sensor is connected at terminals X522.7(+) and X522.8(-).		
<hr/>			
<b>r4101[0...11]</b>			
<b>TM150 sensor resistance / TM150 R_sensor</b>			
TM150	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9626, 9627
	<b>P-Group:</b> Terminals	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [ohm]	- [ohm]	- [ohm]
<b>Description:</b>	Displays the actual resistance value of the temperature sensor connected at the Terminal Module.		
<b>Index:</b>	[0] = Temperature channel 0 [1] = Temperature channel 1 [2] = Temperature channel 2 [3] = Temperature channel 3 [4] = Temperature channel 4 [5] = Temperature channel 5 [6] = Temperature channel 6 [7] = Temperature channel 7 [8] = Temperature channel 8 [9] = Temperature channel 9 [10] = Temperature channel 10 [11] = Temperature channel 11		
<b>Note:</b>	The maximum measurable resistance value is approx. 2500 Ohm. For 1x2 and 2x2 wire evaluation: The actual sensor resistance is displayed in this parameter(i.e. the wire resistance (p4110) is taken into account). The temperature sensors are connected to the following terminals: X531 = channel 0 (for 2x2 wire evaluation, additionally channel 6) X532 = channel 1 (for 2x2 wire evaluation, additionally channel 7) X533 = channel 2 (for 2x2 wire evaluation, additionally channel 8) X534 = channel 3 (for 2x2 wire evaluation, additionally channel 9) X535 = channel 4 (for 2x2 wire evaluation, additionally channel 10) X536 = channel 5 (for 2x2 wire evaluation, additionally channel 11) Details on the wiring are included in the parameter description for p4108.		

<b>r4101</b>	<b>TM31 sensor resistance / TM31 R_sensor</b>		
TM31	<b>Can be changed:</b> - <b>Data type:</b> Unsigned16 <b>P-Group:</b> Terminals <b>Not for motor type:</b> - <b>Min</b> - [ohm]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [ohm]	<b>Access level:</b> 3 <b>Func. diagram:</b> 9576 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [ohm]
<b>Description:</b>	Displays the actual resistance value of the temperature sensor connected at the Terminal Module.		
<b>Note:</b>	The maximum measurable resistance value is approx. 2170 Ohm. The temperature sensor is connected at terminals X522.7(+) and X522.8(-).		
<b>p4102[0...23]</b>	<b>TM150 fault threshold/alarm threshold / TM150 F/A_thresh</b>		
TM150	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -99 [°C]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 251 [°C]	<b>Access level:</b> 1 <b>Func. diagram:</b> 9626, 9627 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 251 [°C]
<b>Description:</b>	Sets the fault threshold/alarm threshold for Terminal Module 150 (TM150). For alarms (even indices [0, 2, 4 ... 22]), the following applies: - The corresponding alarm is initiated, if the temperature actual value associated with a temperature channel exceeds the associated alarm threshold (r4105[x] > p4102[2x]). In addition, the timer is started (p4103[x]). - The alarm remains until the temperature actual value (r4105[x]) reaches or falls below the threshold value (p4102[2x] - hysteresis (p4118[x])). For faults (uneven indices [1, 3, 5 ... 23]), the following applies: - The corresponding fault is initiated, if the temperature actual value associated with a temperature channel exceeds the associated fault threshold (r4105[x] > p4102[2x+1] or the associated timer (p4103[x]) has expired. - The fault remains until the temperature actual value (r4105[x]) reaches or falls below the threshold value (p4102[2x+1]) - hysteresis (p4118[x]) and the fault has been acknowledged.		
<b>Index:</b>	[0] = Channel 0 alarm threshold (A35211) [1] = Channel 0 fault threshold (F35207) [2] = Channel 1 alarm threshold (A35212) [3] = Channel 1 fault threshold (F35208) [4] = Channel 2 alarm threshold (A35213) [5] = Channel 2 fault threshold (F35209) [6] = Channel 3 alarm threshold (A35214) [7] = Channel 3 fault threshold (F35210) [8] = Channel 4 alarm threshold (A35410) [9] = Channel 4 fault threshold (F35400) [10] = Channel 5 alarm threshold (A35411) [11] = Channel 5 fault threshold (F35401) [12] = Channel 6 alarm threshold (A35412) [13] = Channel 6 fault threshold (F35402) [14] = Channel 7 alarm threshold (A35413) [15] = Channel 7 fault threshold (F35403) [16] = Channel 8 alarm threshold (A35414) [17] = Channel 8 fault threshold (F35404) [18] = Channel 9 alarm threshold (A35415) [19] = Channel 9 fault threshold (F35405) [20] = Channel 10 alarm threshold (A35416) [21] = Channel 10 fault threshold (F35406) [22] = Channel 11 alarm threshold (A35417) [23] = Channel 11 fault threshold (F35407)		
<b>Dependency:</b>	Refer to: p4103, r4104, r4105, p4118		

**Caution:** Faults F35207 ... F35210 and F35400 ... F35407 only result in the drive being shut down if at least one BICO inter-connection exists between the drive and the TM150.  
For p4102[0...23] = 251 °C, evaluation of the corresponding threshold is deactivated.  
For sensor type "PTC thermistor" (p4100[0...11] = 1), the following applies:  
To activate the corresponding alarm or fault, p4102[0...23] must be set ≤ 250 °C.

**Note:** The hysteresis can be set in p4118[0...11].

p4102[0...1]	TM31 fault threshold/alarm threshold / TM31 F/A_thresh		
TM31	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -48 [°C]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 251 [°C]	<b>Access level:</b> 1 <b>Func. diagram:</b> 9576 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> [0] 100 [°C] [1] 120 [°C]
<b>Description:</b>	Sets the fault threshold/alarm threshold for Terminal Module 31 (TM31). A35211 is initiated, if the temperature actual value r4105[0] > p4102[0] F35207 is initiated if the temperature actual value r4105[0] > p4102[1] or timer p4103[0] has expired For alarm A35211 the following applies: - Remains until the temperature actual value (r4105) reaches or falls below the value (p4102[0] - hysteresis). For fault F35207 the following applies: - Remains until the temperature actual value (r4105) reaches or falls below the value (p4102[1] - hysteresis) and the fault has been acknowledged. - The hysteresis value is 5 K and cannot be changed by the user.		
<b>Index:</b>	[0] = Alarm threshold [1] = Fault threshold		
<b>Dependency:</b>	Refer to: r4104		
<b>Caution:</b>	Fault F35207 only causes the drive to be shut down if there is at least one BICO interconnection between the drive and TM31. For p4102[0...1] = 251 °C, evaluation of the corresponding threshold is deactivated. For sensor type "PTC thermistor" (p4100 = 1), the following applies: To activate the alarm or fault, p4102[0...1] must be set ≤ 250 °C.		

p4103[0...11]	TM150 delay time / TM150 t_delay		
TM150	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Motor <b>Not for motor type:</b> - <b>Min</b> 0.0 [s]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 600.0 [s]	<b>Access level:</b> 1 <b>Func. diagram:</b> 9626, 9627 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.0 [s]
<b>Description:</b>	Sets the delay time for the output of the fault for the Terminal Module 150 (TM150). The timer is started when the alarm threshold (e.g. p4102[0]) is exceeded. If the delay time has expired and the alarm threshold has, in the meantime, not been fallen below, then the corresponding fault is output. The fault can be acknowledged, if, after the delay time has expired, the alarm threshold is again fallen below. For sensor type "KTY84", "PT100", "PT1000" (p4100[0...11] = 2, 5, 6) the following applies: - If the fault threshold (e.g. p4102[1]) is exceeded before the delay time has expired, then the corresponding fault is immediately output. For sensor type "PTC thermistor", "Bimetallic NC contact" (p4100[0...11] = 1, 4), the following applies: - Alarm and fault threshold simultaneously respond. The fault is only issued after the delay time has expired.		
<b>Index:</b>	[0] = Temperature channel 0 [1] = Temperature channel 1 [2] = Temperature channel 2 [3] = Temperature channel 3		

[4] = Temperature channel 4  
 [5] = Temperature channel 5  
 [6] = Temperature channel 6  
 [7] = Temperature channel 7  
 [8] = Temperature channel 8  
 [9] = Temperature channel 9  
 [10] = Temperature channel 10  
 [11] = Temperature channel 11

**Dependency:**

Refer to: p4102, r4104, r4105, p4118

**Warning:**

The fault F35207 ... F35210 and F35400 ... 35407 only results in the drive being shut down if at least one BICO interconnection exists between the drive and the TM150.

**Note:**

For p4103 = 0 s and sensor type "KTY84", "PT100", "PT1000" (p4100[0...11] = 2, 5, 6) the following applies:

- The corresponding fault can only be initiated via the fault threshold (output of the timer is always a logical 0).

For p4103 = 0 s and sensor type "PTC thermistor", "Bimetallic NC contact" (p4100[0...11] = 1, 4), the following applies:

- The corresponding alarm and fault are simultaneously output (delay time = 0 s).

**p4103****TM31 temperature evaluation delay time / TM31 temp t\_delay**

TM31

**Can be changed:** U, T**Calculated:** -**Access level:** 1**Data type:** FloatingPoint32**Dyn. index:** -**Func. diagram:** 9576**P-Group:** Motor**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** -**Expert list:** 1**Min****Max****Factory setting**

0.000 [ms]

600000.000 [ms]

0.000 [ms]

**Description:**

Sets the delay time for the output of the fault for the Terminal Module 31 (TM31).

The timer is started when the alarm threshold (p4102[0]) is exceeded.

If the delay time has expired and the alarm threshold has, in the meantime, not been fallen below, then fault F35207 is output.

The fault can be acknowledged, if, after the delay time has expired, the alarm threshold is again fallen below.

For sensor type "KTY84" (p4100 = 2), the following applies:

If the fault threshold (p4102[1]) is exceeded before the delay time has expired, then fault F35207 is immediately output.

For sensor type "PTC thermistor" (p4100 = 1), the following applies:

- Alarm and fault threshold simultaneously respond. The fault is only issued after the delay time has expired.

**Dependency:**

Refer to: r4104

**Warning:**

Fault F35207 only causes the drive to be shut down if there is at least one BICO interconnection between the drive and TM31.

**Note:**

With p4103 = 0 ms, the timer is de-activated and only the fault threshold is effective.

**r4104.0...23****BO: TM150 temperature evaluation status / TM150 temp status**

TM150

**Can be changed:** -**Calculated:** -**Access level:** 1**Data type:** Unsigned32**Dyn. index:** -**Func. diagram:** 9626, 9627**P-Group:** Terminals**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** -**Expert list:** 1**Min****Max****Factory setting**

-

-

-

**Description:**

Display and binector output for the status for the Terminal Module 150 (TM150).

**Bit field:**

Bit	Signal name	1 signal	0 signal	FP
00	Channel 0 alarm present	Yes	No	9626
01	Channel 0 fault present	Yes	No	9626
02	Channel 1 alarm present	Yes	No	9626
03	Channel 1 fault present	Yes	No	9626

04	Channel 2 alarm present	Yes	No	9626
05	Channel 2 fault present	Yes	No	9626
06	Channel 3 alarm present	Yes	No	9626
07	Channel 3 fault present	Yes	No	9626
08	Channel 4 alarm present	Yes	No	9626
09	Channel 4 fault present	Yes	No	9626
10	Channel 5 alarm present	Yes	No	9626
11	Channel 5 fault present	Yes	No	9626
12	Channel 6 alarm present	Yes	No	9627
13	Channel 6 fault present	Yes	No	9627
14	Channel 7 alarm present	Yes	No	9627
15	Channel 7 fault present	Yes	No	9627
16	Channel 8 alarm present	Yes	No	9627
17	Channel 8 fault present	Yes	No	9627
18	Channel 9 alarm present	Yes	No	9627
19	Channel 9 fault present	Yes	No	9627
20	Channel 10 alarm present	Yes	No	9627
21	Channel 10 fault present	Yes	No	9627
22	Channel 11 alarm present	Yes	No	9627
23	Channel 11 fault present	Yes	No	9627

**Dependency:** Refer to: p4102, p4103, r4105, p4118

#### r4104.0...1 **BO: TM31 temperature evaluation status / TM31 temp status**

TM31	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 1840, 9576
	<b>P-Group:</b> Terminals	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Display and binector output for the status for the Terminal Module 31 (TM31).

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Alarm is present	Yes	No	-
	01	Fault is present	Yes	No	-

**Dependency:** Refer to: p4102

#### r4105[0...11] **CO: TM150 temperature actual value / TM150 temp\_act val**

TM150	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9626, 9627
	<b>P-Group:</b> Terminals	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> p2006	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [°C]	- [°C]	- [°C]

**Description:** Displays the temperature actual value for the Terminal Module 150 (TM150)

**Index:**

- [0] = Temperature channel 0
- [1] = Temperature channel 1
- [2] = Temperature channel 2
- [3] = Temperature channel 3
- [4] = Temperature channel 4
- [5] = Temperature channel 5
- [6] = Temperature channel 6
- [7] = Temperature channel 7
- [8] = Temperature channel 8
- [9] = Temperature channel 9
- [10] = Temperature channel 10
- [11] = Temperature channel 11

<b>Dependency:</b>	For sensor type "PTC thermistor" and "Bimetallic NC contact" (p4100[0...11] = 1, 4), the following applies: - below the nominal response temperature, r4105[0...11] = -50 °C. - above the nominal response temperature, r4105[0...11] = 250 °C. For sensor type "KTY84", "PT100", "PT1000" (p4100[0...11] = 2, 5, 6) the following applies: - the displayed value corresponds to the temperature actual value. Refer to: p4100, p4111, r4112, r4113, r4114
<b>Note:</b>	r4105[0...11] = -300 °C is displayed in the following cases: - temperature actual value invalid (F35920 ... F35931 output). - no sensor selected (p4100[0...11] = 0). The temperature actual values can be grouped using p4111[0...2] and the maximum value, minimum value as well as the average value for each group evaluated (r4112[0...2], r4113[0...2], r4114[0...2]).

<b>r4105</b>	<b>CO: TM31 temperature actual value / TM31 temp_act val</b>		
TM31	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Terminals <b>Not for motor type:</b> - <b>Min</b> - [°C]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> p2006 <b>Max</b> - [°C]	<b>Access level:</b> 1 <b>Func. diagram:</b> 1840, 9576 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [°C]
<b>Description:</b>	Displays the temperature actual value for the Terminal Module 31 (TM31)		
<b>Dependency:</b>	For sensor type "PTC thermistor" (p4100 = 1), the following applies: - below the nominal response temperature, r4105 = -50°C. - above the nominal response temperature, r4105 = 250 °C. For sensor type "KTY84" (p4100 = 2), the following applies: - the displayed value corresponds to the temperature actual value. Refer to: p4100		
<b>Note:</b>	r4105 = -300 °C is displayed in the following cases: - temperature actual value invalid (F35920 output). - no sensor selected (p4100 = 0). The temperature sensor is connected at terminals X522.7(+) and X522.8(-).		

<b>p4108[0...5]</b>	<b>TM150 terminal block measuring method / TM150 meas method</b>		
TM150	<b>Can be changed:</b> T <b>Data type:</b> Integer16  <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> -  <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 3	<b>Access level:</b> 1 <b>Func. diagram:</b> 9625, 9626, 9627 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Sets the measuring method for the terminal block X531 ... X536 for the Terminal Module 150 (TM150). Re p4108[0...5] = 0 (1x2 wire evaluation): - the temperature sensor is connected at terminals 1(+) and 2(-). Re p4108[0...5] = 1 (2x2 wire evaluation): - The first temperature sensor is connected at terminals 1(+) and 2(-). - The second temperature sensor is connected at terminals 3(+) and 4(-). Re p4108[0...5] = 2 (3 wire evaluation): - the temperature sensor is connected at terminals 3(+) and 4(-). - the measuring conductor is connected at terminal 1(+). - terminals 2(-) and 4(-) must be jumpered. Re p4108[0...5] = 3 (4 wire evaluation): - the temperature sensor is connected at terminals 3(+) and 4(-). - the measuring conductor is connected at terminals 1(+) and 2(-).		

<b>Value:</b>	0: 1x2 wire evaluation 1: 2x2 wire evaluation 2: 3 wire evaluation 3: 4 wire evaluation
<b>Index:</b>	[0] = X531 [1] = X532 [2] = X533 [3] = X534 [4] = X535 [5] = X536
<b>Note:</b>	The temperature sensors are connected to the following terminals: X531 = channel 0 (for 2x2 wire evaluation, additionally channel 6) X532 = channel 1 (for 2x2 wire evaluation, additionally channel 7) X533 = channel 2 (for 2x2 wire evaluation, additionally channel 8) X534 = channel 3 (for 2x2 wire evaluation, additionally channel 9) X535 = channel 4 (for 2x2 wire evaluation, additionally channel 10) X536 = channel 5 (for 2x2 wire evaluation, additionally channel 11) Re p4108[0...5] = 0, 2, 3 (1x2, 3, 4 wire evaluation): The temperature channel belonging to the terminal block with the higher number is automatically deactivated (e.g. for X531 with 3-wire evaluation, channel 6 is deactivated).

#### p4109[0...11] TM150 wire resistance measurement / TM150 R\_wire meas

TM150	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0 <b>Max</b> 1	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Factory setting</b> 0	<b>Access level:</b> 1 <b>Func. diagram:</b> 9626, 9627 <b>Unit selection:</b> - <b>Expert list:</b> 1
<b>Description:</b>	Setting to start the measurement of the wire resistance for a channel for the Terminal Module 150 (TM150). For a 2 wire evaluation, the total wire resistance is measured and saved. During the temperature evaluation, the temperature actual value is automatically calibrated using the measured wire resistance. Procedure: 1. Select the measuring method (1x2/2x2) for the corresponding terminal block (p4108[0...5] = 0, 1). 2. Set the required sensor type for the corresponding channel (p4100[x] = 1 ... 6, x = 0...5 or 0...11). 3. Jumper the sensor to be connected (short-circuit the sensor conductor close to the sensor). 4. Connect the sensor conductors to the appropriate terminals 1(+), 2(-) or 3(+), 4(-). 5. For the corresponding channel, start the measurement of the wire resistance (p4109[x] = 1). 6. After p4109[x] = 0, check the measured resistance value in p4110[x]. 7. Remove the jumper across the temperature sensor.		
<b>Value:</b>	0: Inactive 1: Start		
<b>Index:</b>	[0] = Temperature channel 0 [1] = Temperature channel 1 [2] = Temperature channel 2 [3] = Temperature channel 3 [4] = Temperature channel 4 [5] = Temperature channel 5 [6] = Temperature channel 6 [7] = Temperature channel 7 [8] = Temperature channel 8 [9] = Temperature channel 9 [10] = Temperature channel 10 [11] = Temperature channel 11		
<b>Dependency:</b>	Refer to: p4100, p4108, p4110		
<b>Notice:</b>	Wire resistance measurement is only possible for 1x2 or 2x2 wire evaluation (p4108[0...5] = 0, 1).		

**Note:** The wire resistance value can be also directly entered into p4110[0...11].  
The automatic conductor calibration for 1x2 and 2x2 wire evaluation is always performed with the value in p4110[0...11].

<b>p4110[0...11]</b>		<b>TM150 wire resistance value / TM150 R_wire value</b>		
TM150	<b>Can be changed:</b> T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.00 [ohm]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 3000.00 [ohm]	<b>Access level:</b> 1 <b>Func. diagram:</b> 9626, 9627 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.00 [ohm]	
<b>Description:</b>	Sets and displays the wire resistance for Terminal Module 150 (TM150). The value is used for the automatic conductor calibration. The value is automatically set by starting the wire resistance measurement (p4109[0...11]) of the corresponding channel.			
<b>Index:</b>	[0] = Temperature channel 0 [1] = Temperature channel 1 [2] = Temperature channel 2 [3] = Temperature channel 3 [4] = Temperature channel 4 [5] = Temperature channel 5 [6] = Temperature channel 6 [7] = Temperature channel 7 [8] = Temperature channel 8 [9] = Temperature channel 9 [10] = Temperature channel 10 [11] = Temperature channel 11			
<b>Dependency:</b>	Refer to: p4109			
<b>Notice:</b>	Wire resistance measurement is only possible for 1x2 or 2x2 wire evaluation (p4108[0...5] = 0, 1).			
<b>Note:</b>	Automatic conductor calibration is deactivated using p4110[0...11] = 0.			

<b>p4111[0...2]</b>		<b>TM150 group channel assignment / TM150 grp channel</b>																																																									
TM150	<b>Can be changed:</b> T <b>Data type:</b> Unsigned16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 1 <b>Func. diagram:</b> 9625 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0000 0000 0000 0000 bin																																																								
<b>Description:</b>	Assigns the temperature channels to groups for the Terminal Module 150 (TM150) For each group, the following calculated values are provided from the temperature actual values (r4105[0...11]): - Maximum value (r4112[0...2]) - Minimum value (r4113[0...2]) - average value (r4114[0...2])																																																										
<b>Index:</b>	[0] = Group 0 [1] = Group 1 [2] = Group 2																																																										
<b>Bit field:</b>	<table> <tr> <th>Bit</th><th>Signal name</th><th>1 signal</th><th>0 signal</th><th>FP</th></tr> <tr><td>00</td><td>Temperature channel 0</td><td>Yes</td><td>No</td><td>-</td></tr> <tr><td>01</td><td>Temperature channel 1</td><td>Yes</td><td>No</td><td>-</td></tr> <tr><td>02</td><td>Temperature channel 2</td><td>Yes</td><td>No</td><td>-</td></tr> <tr><td>03</td><td>Temperature channel 3</td><td>Yes</td><td>No</td><td>-</td></tr> <tr><td>04</td><td>Temperature channel 4</td><td>Yes</td><td>No</td><td>-</td></tr> <tr><td>05</td><td>Temperature channel 5</td><td>Yes</td><td>No</td><td>-</td></tr> <tr><td>06</td><td>Temperature channel 6</td><td>Yes</td><td>No</td><td>-</td></tr> <tr><td>07</td><td>Temperature channel 7</td><td>Yes</td><td>No</td><td>-</td></tr> <tr><td>08</td><td>Temperature channel 8</td><td>Yes</td><td>No</td><td>-</td></tr> <tr><td>09</td><td>Temperature channel 9</td><td>Yes</td><td>No</td><td>-</td></tr> </table>	Bit	Signal name	1 signal	0 signal	FP	00	Temperature channel 0	Yes	No	-	01	Temperature channel 1	Yes	No	-	02	Temperature channel 2	Yes	No	-	03	Temperature channel 3	Yes	No	-	04	Temperature channel 4	Yes	No	-	05	Temperature channel 5	Yes	No	-	06	Temperature channel 6	Yes	No	-	07	Temperature channel 7	Yes	No	-	08	Temperature channel 8	Yes	No	-	09	Temperature channel 9	Yes	No	-			
Bit	Signal name	1 signal	0 signal	FP																																																							
00	Temperature channel 0	Yes	No	-																																																							
01	Temperature channel 1	Yes	No	-																																																							
02	Temperature channel 2	Yes	No	-																																																							
03	Temperature channel 3	Yes	No	-																																																							
04	Temperature channel 4	Yes	No	-																																																							
05	Temperature channel 5	Yes	No	-																																																							
06	Temperature channel 6	Yes	No	-																																																							
07	Temperature channel 7	Yes	No	-																																																							
08	Temperature channel 8	Yes	No	-																																																							
09	Temperature channel 9	Yes	No	-																																																							



10	Temperature channel 10	Yes	No	-
11	Temperature channel 11	Yes	No	-

**Dependency:** Refer to: r4105, r4112, r4113, r4114

**Caution:** When forming groups, it must be ensured that in one particular group, only temperature channels with the following sensor types are included:

- "KTY84", "PT100", "PT1000" (p4100[0...11] = 2, 5, 6), real temperature actual value

or alternatively

- "PTC thermistor", "bimetallic NC contact" (p4100[0...11] = 1, 4), fictitious temperature actual value (-50 °C, 250 °C)

If these sensor types are combined within one group, then the calculated values for maximum, minimum and average value will be falsified.

**Note:** Active and inactive temperature channels can be included in one group. However, when calculating the values (r4112, r4113, r4114) only the active temperature channels with valid actual value are taken into account (r4105[0...11] not equal to -300 °C).

---

### **r4112[0...2] CO: TM150 group temperature actual value maximum value / TM150 grp temp max**

TM150	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9625
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [°C]	- [°C]	- [°C]

**Description:** Display and connector output for the maximum value of each group for the Terminal Module 150 (TM150). This value is calculated from the actual temperature values (r4105[0...11]) of each group.

**Recommend.:** The following connector inputs can use these connector outputs for interconnection:

- CI: p0603
- CI: p0608[0...3]
- CI: p0609[0...3]
- CI: p2051

**Index:** [0] = Group 0  
[1] = Group 1  
[2] = Group 2

**Dependency:** Refer to: r4105, p4111, r4113, r4114

---

### **r4113[0...2] CO: TM150 group temperature actual value minimum value / TM150 grp temp min**

TM150	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9625
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [°C]	- [°C]	- [°C]

**Description:** Display and connector output for the minimum value of each group for the Terminal Module 150 (TM150). This value is calculated from the actual temperature values (r4105[0...11]) of each group.

**Recommend.:** The following connector inputs can use these connector outputs for interconnection:

- CI: p0603
- CI: p0608[0...3]
- CI: p0609[0...3]
- CI: p2051

**Index:** [0] = Group 0  
[1] = Group 1  
[2] = Group 2

**Dependency:** Refer to: r4105, p4111, r4112, r4114

<b>r4114[0...2]</b>	<b>CO: TM150 group temperature average actual value / TM150 grp temp av</b>		
TM150	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [°C]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> - [°C]	<b>Access level:</b> 1 <b>Func. diagram:</b> 9625 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [°C]
<b>Description:</b>	Display and connector output for the average value of each group for the Terminal Module 150 (TM150). This value is calculated from the actual temperature values (r4105[0...11]) of each group.		
<b>Recommend.:</b>	The following connector inputs can use these connector outputs for interconnection: - Cl: p0603 - Cl: p0608[0...3] - Cl: p0609[0...3] - Cl: p2051		
<b>Index:</b>	[0] = Group 0 [1] = Group 1 [2] = Group 2		
<b>Dependency:</b>	Refer to: r4105, p4111, r4112, r4113		
<b>Note:</b>	If one group is assigned sensor type "PTC" or "bimetal NC contact", then the average value -300 °C is output.		
<b>p4117[0...2]</b>	<b>TM150 group sensor error effect / TM150 error effect</b>		
TM150	<b>Can be changed:</b> U, T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1	<b>Access level:</b> 1 <b>Func. diagram:</b> 9625 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the effect for an error of a sensor of a group for Terminal Module TM150 (TM150). For p4117 = 0, the following applies: The defective temperature sensor assigned to a group is not take into account when forming the group. For p4117 = 1, the following applies: For a sensor error, for the maximum value, minimum value and average value of the corresponding group, a value of -300 °C is output.		
<b>Value:</b>	0: Skip sensor 1: Output value = -300 °C		
<b>Index:</b>	[0] = Group 0 [1] = Group 1 [2] = Group 2		
<b>Dependency:</b>	Refer to: r4105, p4111, r4112, r4113, r4114		
<b>p4118[0...11]</b>	<b>TM150 fault threshold/alarm threshold hysteresis / TM150 thresh hyst</b>		
TM150	<b>Can be changed:</b> T <b>Data type:</b> Unsigned16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0 [K]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 50 [K]	<b>Access level:</b> 1 <b>Func. diagram:</b> 9626, 9627 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 5 [K]
<b>Description:</b>	Sets the hysteresis for the fault threshold/alarm threshold (p4102[0...23]) for the Terminal Module 150 (TM150).		
<b>Index:</b>	[0] = Temperature channel 0 [1] = Temperature channel 1 [2] = Temperature channel 2 [3] = Temperature channel 3 [4] = Temperature channel 4		

[5] = Temperature channel 5  
 [6] = Temperature channel 6  
 [7] = Temperature channel 7  
 [8] = Temperature channel 8  
 [9] = Temperature channel 9  
 [10] = Temperature channel 10  
 [11] = Temperature channel 11

**Dependency:** Refer to: p4102, p4103, r4104, r4105

**Note:** The following applies for a corresponding alarm:

- Remains until the temperature actual value (r4105[x]) reaches or falls below the threshold value (p4102[2x] - hysteresis (p4118[x]).

The following applies for a corresponding fault:

- Remains until the temperature actual value (r4105[x]) reaches or falls below the threshold value (p4102[2x+1]) - hysteresis (p4118[x]) and the fault has been acknowledged.

---

### p4119[0...11] TM150 activate/deactivate smoothing / TM150 smooth act

TM150	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9626, 9627
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	1	0

**Description:** Setting to activate/deactivate the filter to smooth the temperature signal for the Terminal Module 150 (TM150).  
 The smoothing is realized with a 1st order lowpass filter  
 The effective smoothing time constant depends on the number of channels that are simultaneously active and is displayed in r4120.

**Value:** 0: Filter deactivated  
 1: Filter activated

**Index:** [0] = Temperature channel 0  
 [1] = Temperature channel 1  
 [2] = Temperature channel 2  
 [3] = Temperature channel 3  
 [4] = Temperature channel 4  
 [5] = Temperature channel 5  
 [6] = Temperature channel 6  
 [7] = Temperature channel 7  
 [8] = Temperature channel 8  
 [9] = Temperature channel 9  
 [10] = Temperature channel 10  
 [11] = Temperature channel 11

**Dependency:** Refer to: r4120

---

### r4120 TM150 temperature filter time constant / TM150 temp\_filt T

TM150	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9626, 9627
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [ms]	- [ms]	- [ms]

**Description:** Displays the smoothing time constant for the temperature filter for Terminal Module 150 (TM150).

**Dependency:** Refer to: r4105, p4111, r4112, r4113

**Note:** The time constant lies in the range from 80 to 1000 ms and depends on the number of channels that are simultaneously active.

<b>p4121</b>	<b>TM150 filter rated line frequency / TM150 filt f_line</b>		
TM150	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1	<b>Access level:</b> 1 <b>Func. diagram:</b> 9626, 9627 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the rated line frequency for the filter to skip the line frequency for Terminal Module 150 (TM150).		
<b>Value:</b>	0: 50 Hz 1: 60 Hz		
<b>r4640[0...95]</b>	<b>Encoder diagnostics state machine / Enc diag stat_ma</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> Encoder <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the encoder diagnostics for the PROFIdrive interface.		
<b>p4650</b>	<b>Encoder functional reserve component number / Enc fct_res num</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned16 <b>P-Group:</b> Displays, signals <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 399	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the component number (p0141) of the encoder whose functional reserve is to be displayed (r4651).		
<b>Dependency:</b>	Refer to: r4651		
<b>r4651[0...3]</b>	<b>Encoder functional reserve / Enc fct_reserve</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Displays, signals <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> - [%]	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Displays the functional reserve of the encoder selected via p4650. 0 ... 25 %: The function limit has been reached. A service is recommended. 26 ... 100 %: The encoder is working in the specified range.		
<b>Index:</b>	[0] = Function reserve 1 [1] = Function reserve 2 [2] = Function reserve 3 [3] = Function reserve 4		
<b>Dependency:</b>	Refer to: p4650		
<b>Note:</b>	Value = 999 means: - the component specified in p4650 is not connected - the encoder does not support the display of the functional reserve		

<b>p4652[0...2] XIST1_ERW reset mode / XIST1_ERW res mode</b>				
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C1(3) <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 3	<b>Access level:</b> 3 <b>Func. diagram:</b> 4750 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0	
<b>Description:</b>	Sets the mode to reset the actual value in XIST_ERW (CO: r4653).			
<b>Value:</b>	0: Inactive 1: Reset with zero mark 2: Reset with BICO 3: Reset with selected zero mark			
<b>Index:</b>	[0] = Encoder 1 [1] = Encoder 2 [2] = -			
<b>Dependency:</b>	Refer to: r4653, r4654, p4655			
<b>Note:</b>	If value = 1: The value in XIST1_ERW is reset when passing every zero mark. If value = 2: The value in XIST1_ERW is reset with a 0/1 edge via binector input p4655. If value = 3: The value in XIST1_ERW is reset after a 0/1 edge via binector input p4655 when passing the next zero mark.			
<hr/>				
<b>r4653[0...2] CO: XIST1_ERW actual value / XIST1_ERW actual</b>				
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> Encoder <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 4750 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -	
<b>Description:</b>	Display and connector output for the actual value XIST1_ERW.			
<b>Index:</b>	[0] = Encoder 1 [1] = Encoder 2 [2] = -			
<b>Dependency:</b>	Refer to: p4652, r4654, p4655			
<hr/>				
<b>r4654.0...8 CO/BO: XIST1_ERW status / XIST1_ERW stat</b>				
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> Encoder <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 4750 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -	
<b>Description:</b>	Display and binector output to reset XIST1_ERW.			
<b>Bit field:</b>	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>
	00	Encoder 1 XIST1_ERW reset	High	Low
	08	Encoder 2 XIST1_ERW reset	High	Low
<b>Dependency:</b>	Refer to: p4652, r4653, p4655			
<b>Note:</b>	The reset of XIST1_ERW is initiated via binector input p4655. Binector output r4654 is reset with a 0 signal from binector input p4655.			

<b>p4655[0...2]</b>	<b>BI: XIST1_ERW reset signal source / XIST1_ERW resS_src</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 4750
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0
<b>Description:</b>	Sets the signal source to reset XIST1_ERW (CO: r4653).		
<b>Index:</b>	[0] = Encoder 1 [1] = Encoder 2 [2] = -		
<b>Dependency:</b>	Refer to: p4652, r4653, r4654		
<b>Note:</b>	The reset of XIST1_ERW depends on the selected mode (p4652).		
<b>p4660[0...2]</b>	<b>Sensor Module filter bandwidth / SM Filt_bandw</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4)	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0.00 [kHz]	20000.00 [kHz]	0.00 [kHz]
<b>Description:</b>	Sets the filter bandwidth for Sensor Module SMx10 (resolver) and SMx20 (sin/cos). The value set on the Sensor Module is displayed in r4661. The Sensor Module hardware only supports the following values: - 0: The Sensor Module's default is used. - 50 kHz - 170 kHz - 500 kHz - Unlimited: Only the bandwidth of the operational amplifier is effective.		
<b>Index:</b>	[0] = Encoder 1 [1] = Encoder 2 [2] = Reserved		
<b>Dependency:</b>	Refer to: r4661		
<b>Note:</b>	A value of zero is displayed if an encoder is not present.		
<b>r4661[0...2]</b>	<b>Sensor Module filter bandwidth display / SM Filt_bandw disp</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [kHz]	- [kHz]	- [kHz]
<b>Description:</b>	Display of the effective filter bandwidth for Sensor Module SMx10 (resolver) and SMx20 (sin/cos). The bandwidth of the filter is set using p4660.		
<b>Index:</b>	[0] = Encoder 1 [1] = Encoder 2 [2] = Reserved		
<b>Dependency:</b>	Refer to: p4660		
<b>Note:</b>	A value of zero is displayed if an encoder is not present.		

<b>p4678[0...n]</b>	<b>Analog sensor LVDT ratio / An_sens LVDT ratio</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4)	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> EDS, p0140	<b>Func. diagram:</b> -
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0.00 [%]	<b>Max</b> 200.00 [%]	<b>Factory setting</b> 50.00 [%]
<b>Description:</b>	Sets the ratio for the LVDT sensor.		
<b>p4679[0...n]</b>	<b>Analog sensor LVDT phase / An_sens LVDT ph</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4), T	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> EDS, p0140	<b>Func. diagram:</b> -
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> -360.00 [°]	<b>Max</b> 360.00 [°]	<b>Factory setting</b> 0.00 [°]
<b>Description:</b>	Sets the phase for the LVDT sensor.		
<b>p4680[0...n]</b>	<b>Zero mark monitoring tolerance permissible / ZM_monit tol perm</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4)	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> EDS, p0140	<b>Func. diagram:</b> -
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 1000	<b>Factory setting</b> 4
<b>Description:</b>	Sets the permissible tolerance in encoder pulses for the zero mark distance in the context of zero mark monitoring. Causes fault F3x100 to appear less frequently.		
<b>Dependency:</b>	Refer to: p0430		
<b>Note:</b>	The parameter is activated using p0430.21 = 1 (zero mark tolerance).		
<b>p4681[0...n]</b>	<b>Zero mark monitoring tolerance window limit 1 positive / ZM tol lim 1 pos</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4)	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> EDS, p0140	<b>Func. diagram:</b> -
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 1000	<b>Factory setting</b> 2
<b>Description:</b>	Sets the positive tolerance window in encoder pulses for limit 1 for the zero mark monitoring. If the deviation is less than this limit, then the pulse number is not corrected. If it is higher than this limit, fault F3x131 is triggered. If fault F3x131 is re-parameterized to alarm (A) or no message (N), the encoder pulses which have not been corrected are added to the accumulator (p4688). The accumulator can be de-activated using p0437.7.		
<b>Dependency:</b>	Refer to: p0437, p4688		
<b>Note:</b>	This monitoring is activated by setting p0437.2 = 1 (position actual value correction). The positive limit describes additional pulses due to EMC.		

<b>p4682[0...n]</b>	<b>Zero mark monitoring tolerance window limit 1 negative / ZM tol lim 1 neg</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4)	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Integer32	<b>Dyn. index:</b> EDS, p0140	<b>Func. diagram:</b> -
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> -1001	<b>Max</b> 0	<b>Factory setting</b> -1001
<b>Description:</b>	Sets the negative tolerance window in encoder pulses for limit 1 for the zero mark monitoring. If the deviation is less than this limit, the PPR is not corrected. If it is higher than this limit, fault F3x131 is triggered. If fault F3x131 is re-parameterized to alarm (A) or no message (N), the encoder pulses which have not been corrected are added to the accumulator (p4688). The accumulator can be de-activated using p0437.7.		
<b>Dependency:</b>	Refer to: p0437, p4681, p4688		
<b>Note:</b>	This monitoring is activated by setting p0437.2 = 1 (position actual value correction). For a set value = -1001, the negated value of p4681 is effective. The negative limit describes the pulses lost due to a covered glass panel in the incremental encoder.		
<b>p4683[0...n]</b>	<b>Zero mark monitoring tolerance window alarm threshold positive / ZM tol A_thr pos</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4)	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> EDS, p0140	<b>Func. diagram:</b> -
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 100000	<b>Factory setting</b> 0
<b>Description:</b>	Sets the positive tolerance window in encoder pulses for limit 2 for the zero mark monitoring. If the zero mark deviation is higher than the tolerance set in p4681 and p4682 and fault F3x131 is re-parameterized to alarm (A) or no message (N), the accumulator p4688 is compared with this parameter and, if applicable, alarm A3x422 is output for 5 seconds.		
<b>Dependency:</b>	Refer to: p0437, p4681, p4682, p4688		
<b>Note:</b>	Zero mark monitoring is activated by setting p0437.2 = 1 (position actual value correction).		
<b>p4684[0...n]</b>	<b>Zero mark monitoring tolerance window alarm threshold negative / ZM tol A_thr neg</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4)	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Integer32	<b>Dyn. index:</b> EDS, p0140	<b>Func. diagram:</b> -
	<b>P-Group:</b> Encoder	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> -100001	<b>Max</b> 0	<b>Factory setting</b> -100001
<b>Description:</b>	Sets the negative tolerance window in encoder pulses for limit 2 for the zero mark monitoring. If the zero mark deviation is higher than the tolerance set in p4681 and p4682 and fault F3x131 is re-parameterized to alarm (A) or no message (N), the accumulator p4688 is compared with this parameter and, if applicable, alarm A3x422 is output for 5 seconds.		
<b>Dependency:</b>	Refer to: p0437, p4683, p4688		
<b>Note:</b>	Zero mark monitoring is activated by setting p0437.2 = 1 (position actual value correction). For a set value = -100001, the negated value of p4683 is effective.		



<b>p4685[0...n]</b>	<b>Speed actual value mean value generation / n_act mean val</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4) <b>Data type:</b> Unsigned32 <b>P-Group:</b> Encoder <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> EDS, p0140 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 20	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the number of current controller clock cycles for mean value generation of the speed actual value.		
<b>Note:</b>	Value = 0, 1: No mean value generation. Higher values also mean higher dead times for the speed actual value.		
<b>p4686[0...n]</b>	<b>Zero mark minimum length / ZM min length</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> C2(4) <b>Data type:</b> Unsigned32 <b>P-Group:</b> Encoder <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> EDS, p0140 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 10	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Sets the minimum length for the zero mark.		
<b>Dependency:</b>	Refer to: p0425, p0437		
<b>Note:</b>	The value for the minimum length of the zero mark must be set less than p0425. The parameter is activated using p0437.1 = 1 (zero mark edge detection).		
<b>p4688[0...2]</b>	<b>CO: Zero mark monitoring differential pulse count / ZM diff_pulse qty</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> T <b>Data type:</b> Integer32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -2147483648	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 2147483647	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Displays the number of differential pulses for the zero mark monitoring that have accumulated. If fault F3x131 is re-parameterized to alarm (A) or no message (N), the encoder pulses which have not been corrected are added to the accumulator (p4688).		
<b>Index:</b>	[0] = Encoder 1 [1] = Encoder 2 [2] = -		
<b>Dependency:</b>	Refer to: p4681, p4682, p4683, p4684		
<b>Note:</b>	The display can only be reset to zero.		
<b>r4689[0...2]</b>	<b>CO: Squarewave encoder diagnostics / Sq-wave enc diag</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> Encoder <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the encoder status according to PROFIdrive for a squarewave encoder.		
<b>Index:</b>	[0] = Encoder 1 [1] = Encoder 2 [2] = -		
<b>Note:</b>	After alarm A3x422 is output, this parameter is set for 100 ms.		

<b>p4700[0...1]</b>		<b>Trace control / Trace control</b>												
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> Integer16 <b>P-Group:</b> Trace and function generator <b>Not for motor type:</b> - <b>Min</b> 0 <b>Max</b> 2	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0 <b>Factory setting</b> 0											
<b>Description:</b>	Setting to control the trace function.													
<b>Value:</b>	0: Stop trace 1: Start trace 2: Start trace and save values													
<b>Index:</b>	[0] = Trace 0 [1] = Trace 1													
<b>p4701</b>		<b>Measuring function control / Meas fct ctrl</b>												
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> Integer16 <b>P-Group:</b> Trace and function generator <b>Not for motor type:</b> - <b>Min</b> 0 <b>Max</b> 3	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0 <b>Factory setting</b> 0											
<b>Description:</b>	Setting to control the measurement function.													
<b>Value:</b>	0: Stop measuring function 1: Start measuring function 2: Measuring function check parameterization 3: Start measuring function without enable signals													
<b>p4703[0...1]</b>		<b>Trace options / Trace options</b>												
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> T <b>Data type:</b> Unsigned16 <b>P-Group:</b> Trace and function generator <b>Not for motor type:</b> - <b>Min</b> - <b>Max</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0 <b>Factory setting</b> 0000 bin											
<b>Description:</b>	Sets the options for the trace.													
<b>Index:</b>	[0] = Trace 0 [1] = Trace 1													
<b>Bit field:</b>	<table><tr><td><b>Bit</b></td><td><b>Signal name</b></td><td><b>1 signal</b></td><td><b>0 signal</b></td><td><b>FP</b></td></tr><tr><td>00</td><td>Automatically start trace with time slices</td><td>Yes</td><td>No</td><td>-</td></tr></table>	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>	<b>FP</b>	00	Automatically start trace with time slices	Yes	No	-			
<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>	<b>FP</b>										
00	Automatically start trace with time slices	Yes	No	-										
<b>Dependency:</b>	Refer to: p4700													
<b>Note:</b>	Re bit 00: 0: The trace starts with p4700 as before. 1: When powering up, the trace starts immediately with the saved parameter settings with the start of the time slices.													
<b>r4705[0...1]</b>		<b>Trace status / Trace status</b>												
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> - <b>Data type:</b> Integer16 <b>P-Group:</b> Trace and function generator <b>Not for motor type:</b> - <b>Min</b> 0 <b>Max</b> 4	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0 <b>Factory setting</b> -											
<b>Description:</b>	Displays the actual status of the trace.													

**Value:**

- 0: Trace inactive
- 1: Trace is recording presamples
- 2: Trace is waiting for trigger event
- 3: Trace is recording
- 4: Recording (trace) ended

**Index:**

- [0] = Trace 0
- [1] = Trace 1

---

**r4706 Measuring function status / Meas fct status**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	5	-

**Description:** Displays the actual status of the measuring function.

**Value:**

- 0: Measurement function inactive
- 1: Measuring function parameterization checked
- 2: Measuring function waits for stabilizing time
- 3: Measuring function recording (tracing)
- 4: Measuring function trace ended with error
- 5: Measuring function trace successfully completed

---

**p4707 Measurement function configuration / Meas fct config**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	1	0

**Description:** Setting to configure the measurement function.

**Value:**

- 0: Standard
- 1: Free meas fct

**Note:**

The parameter cannot be changed when the measurement function has been started (r4706 = 2, 3).

For value = 0:

The system injection point selected to inject the function generator signal is used.

For value = 1:

No system injection point is used.

When using the measuring function in the STARTER commissioning software, the following applies:

A change to a value only becomes effective after first closing and opening the measuring function screen form.

For value = 0:

The master control must be fetched.

There are two fixed and two freely selectable signals for recording.

For value = 1:

Master control does not have to be fetched.

There are four freely selectable signals for recording.

---

**r4708[0...1] Trace memory space required / Trace mem required**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the required memory in bytes for the actual parameterization.

**Index:** [0] = Trace 0  
[1] = Trace 1  
**Dependency:** Refer to: r4799

---

**r4709[0...1] Trace memory space required for measuring functions / Trace mem required**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the required memory in bytes for the actual parameterization.  
This applies, if the trace for the measurement functions is used.

**Index:** [0] = Trace 0  
[1] = Trace 1  
**Dependency:** Refer to: r4799

---

**p4710[0...1] Trace trigger condition / Trace Trig\_cond**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	1	7	2

**Description:** Sets the trigger condition for the trace.

**Value:**

- 1: Immediate trace start
- 2: Positive edge
- 3: Negative edge
- 4: Entry to hysteresis band
- 5: Leaving hysteresis band
- 6: Trigger at bit mask
- 7: Start with function generator

**Index:** [0] = Trace 0  
[1] = Trace 1

---

**p4711[0...5] Trace trigger signal / Trace trig\_signal**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Selects the trigger signal for the trace.

**Index:**

- [0] = Trace 0 parameter in BICO format
- [1] = Trace 1 parameter in BICO format
- [2] = Trace 0 PINx with DO Id and chart Id
- [3] = Trace 0 PINx with block Id and PIN Id
- [4] = Trace 1 PINy with DO Id and chart Id
- [5] = Trace 1 PINy with block Id and PIN Id

**Dependency:** Only effective when p4710 does not equal 1.

**Note:** It only makes sense to trace the PINs using the commissioning software.  
For index 2(4) and 3(5) equal to zero, index 0(1) can only be written and vice versa.  
Re index 0 ... 1:  
Here, the trigger signal for trace 0 or 1 is entered as parameter in the BICO format.  
For trace with a physical address (p4789), the data type of the trigger signal is set here.

Re index 2 ...3:

The triggering PIN for trace 0 is entered here.

Index 2 bit 31 ... 16: Number of the Drive Object (DO), bit 15 ... 0: Number of the chart

Index 3 bit 31 ... 16: Number of the block, bit 15 ... 0: Number of the PIN

Re index 4 ... 5:

The triggering PIN for trace 1 is entered here.

Index 4 bit 31 ... 16: Number of the Drive Object (DO), bit 15 ... 0: Number of the chart

Index 5 bit 31 ... 16: Number of the block, bit 15 ... 0: Number of the PIN

<b>p4712[0...1]</b>	<b>Trace trigger threshold / Trace trig_thresh</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b> -340.28235E36	<b>Max</b> 340.28235E36	<b>Factory setting</b> 0.00
<b>Description:</b>	Sets the trigger threshold for the trace.		
<b>Index:</b>	[0] = Trace 0 [1] = Trace 1		
<b>Dependency:</b>	Only effective when p4710 = 2, 3.		
<b>p4713[0...1]</b>	<b>Trace tolerance band trigger threshold 1 / Trace trig thr 1</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b> -340.28235E36	<b>Max</b> 340.28235E36	<b>Factory setting</b> 0.00
<b>Description:</b>	Sets the first trigger threshold for trigger via tolerance band.		
<b>Index:</b>	[0] = Trace 0 [1] = Trace 1		
<b>Dependency:</b>	Only effective when p4710 = 4, 5.		
<b>p4714[0...1]</b>	<b>Trace tolerance band trigger threshold 2 / Trace trig thr 2</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b> -340.28235E36	<b>Max</b> 340.28235E36	<b>Factory setting</b> 0.00
<b>Description:</b>	Sets the second trigger threshold for trigger via tolerance band		
<b>Index:</b>	[0] = Trace 0 [1] = Trace 1		
<b>Dependency:</b>	Only effective when p4710 = 4, 5.		
<b>p4715[0...1]</b>	<b>Trace bit mask trigger, bit mask / Trace trig mask</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b> 0	<b>Max</b> 4294967295	<b>Factory setting</b> 0
<b>Description:</b>	Sets the bit mask for the bit mask trigger.		

**Index:** [0] = Trace 0  
[1] = Trace 1

**Dependency:** Only effective when p4710 = 6.

---

**p4716[0...1] Trace bit mask trigger trigger condition / Trace Trig\_cond**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b> 0	<b>Max</b> 4294967295	<b>Factory setting</b> 0

**Description:** Sets the trigger condition for bit mask trigger.

**Index:** [0] = Trace 0  
[1] = Trace 1

**Dependency:** Only effective when p4710 = 6.

---

**r4719[0...1] Trace trigger index / Trace Trig\_index**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> -

**Description:** Displays the trigger index in the trace buffer. The trigger event occurred at this point.

**Index:** [0] = Trace 0  
[1] = Trace 1

**Dependency:** Only valid when p4705 = 4.

---

**p4720[0...1] Trace recording cycle / Trace record\_cyc**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b> 0.000 [ms]	<b>Max</b> 60000.000 [ms]	<b>Factory setting</b> 1.000 [ms]

**Description:** Sets the recording cycle for the trace.

**Index:** [0] = Trace 0  
[1] = Trace 1

---

**p4721[0...1] Trace recording time / Trace record\_time**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b> 0.000 [ms]	<b>Max</b> 3600000.000 [ms]	<b>Factory setting</b> 1000.000 [ms]

**Description:** Sets the recording time for the trace.

**Index:** [0] = Trace 0  
[1] = Trace 1

<b>p4722[0...1]</b>	<b>Trace trigger delay / Trace trig_delay</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Trace and function generator <b>Not for motor type:</b> - <b>Min</b> -3600000.000 [ms]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 3600000.000 [ms]	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0 <b>Factory setting</b> 0.000 [ms]
<b>Description:</b>	Sets the trigger delay for the trace. Trigger delay < 0: Pretrigger: Tracing (recording) starts the selected time before the trigger event actually occurs. Trigger delay > 0: Post trigger: Tracing does not start until the set time after the trigger event.		
<b>Index:</b>	[0] = Trace 0 [1] = Trace 1		
<b>p4723[0...1]</b>	<b>Trace time slice cycle / Trace cycle</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Trace and function generator <b>Not for motor type:</b> - <b>Min</b> 0.03125 [ms]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 4.00000 [ms]	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0 <b>Factory setting</b> 0.12500 [ms]
<b>Description:</b>	Sets the time slice cycle in which the trace is called.		
<b>Index:</b>	[0] = Trace 0 [1] = Trace 1		
<b>p4724[0...1]</b>	<b>Trace average in the time range / Trace average</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned8 <b>P-Group:</b> Trace and function generator <b>Not for motor type:</b> - <b>Min</b> 0000 bin	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 0001 bin	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0 <b>Factory setting</b> 0000 bin
<b>Description:</b>	Sets the averaging in the time range for the trace.		
<b>Index:</b>	[0] = Trace 0 [1] = Trace 1		
<b>r4725[0...1]</b>	<b>Trace data type 1 traced / Trace rec type 1</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> Trace and function generator <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0 <b>Factory setting</b> -
<b>Description:</b>	Displays the recorded data type 1 for the trace.		
<b>Index:</b>	[0] = Trace 0 [1] = Trace 1		

**r4726[0...1] Trace data type 2 traced / Trace rec type 2**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays the recorded data type 2 for the trace.		
<b>Index:</b>	[0] = Trace 0 [1] = Trace 1		

**r4727[0...1] Trace data type 3 traced / Trace rec type 3**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays the recorded data type 3 for the trace.		
<b>Index:</b>	[0] = Trace 0 [1] = Trace 1		

**r4728[0...1] Trace data type 4 traced / Trace rec type 4**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays the recorded data type 4 for the trace.		
<b>Index:</b>	[0] = Trace 0 [1] = Trace 1		

**r4729[0...1] Trace number of recorded values / Trace rec values**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays the number of traced values for each signal.		
<b>Index:</b>	[0] = Trace 0 [1] = Trace 1		
<b>Dependency:</b>	Only valid when p4705 = 4.		



<b>p4730[0...5]</b>	<b>Trace record signal 0 / Trace record sig 0</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 <b>P-Group:</b> Trace and function generator <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0 <b>Factory setting</b> 0
<b>Description:</b>	Selects the first signal to be traced.		
<b>Index:</b>	[0] = Trace 0 parameter in BICO format [1] = Trace 1 parameter in BICO format [2] = Trace 0 PINx with DO Id and chart Id [3] = Trace 0 PINx with block Id and PIN Id [4] = Trace 1 PINy with DO Id and chart Id [5] = Trace 1 PINy with block Id and PIN Id		
<b>p4731[0...5]</b>	<b>Trace record signal 1 / Trace record sig 1</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 <b>P-Group:</b> Trace and function generator <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0 <b>Factory setting</b> 0
<b>Description:</b>	Selects the second signal to be traced.		
<b>Index:</b>	[0] = Trace 0 parameter in BICO format [1] = Trace 1 parameter in BICO format [2] = Trace 0 PINx with DO Id and chart Id [3] = Trace 0 PINx with block Id and PIN Id [4] = Trace 1 PINy with DO Id and chart Id [5] = Trace 1 PINy with block Id and PIN Id		
<b>p4732[0...5]</b>	<b>Trace record signal 2 / Trace record sig 2</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 <b>P-Group:</b> Trace and function generator <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0 <b>Factory setting</b> 0
<b>Description:</b>	Selects the third signal to be traced.		
<b>Index:</b>	[0] = Trace 0 parameter in BICO format [1] = Trace 1 parameter in BICO format [2] = Trace 0 PINx with DO Id and chart Id [3] = Trace 0 PINx with block Id and PIN Id [4] = Trace 1 PINy with DO Id and chart Id [5] = Trace 1 PINy with block Id and PIN Id		
<b>p4733[0...5]</b>	<b>Trace record signal 3 / Trace record sig 3</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 <b>P-Group:</b> Trace and function generator <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0 <b>Factory setting</b> 0
<b>Description:</b>	Selects the fourth signal to be traced.		

**Index:**

- [0] = Trace 0 parameter in BICO format
- [1] = Trace 1 parameter in BICO format
- [2] = Trace 0 PINx with DO Id and chart Id
- [3] = Trace 0 PINx with block Id and PIN Id
- [4] = Trace 1 PINy with DO Id and chart Id
- [5] = Trace 1 PINy with block Id and PIN Id

---

**p4734[0...5] Trace record signal 4 / Trace record sig 4**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Selects the fifth signal to be traced.

**Index:**

- [0] = Trace 0 parameter in BICO format
- [1] = Trace 1 parameter in BICO format
- [2] = Trace 0 PINx with DO Id and chart Id
- [3] = Trace 0 PINx with block Id and PIN Id
- [4] = Trace 1 PINy with DO Id and chart Id
- [5] = Trace 1 PINy with block Id and PIN Id

---

**p4735[0...5] Trace record signal 5 / Trace record sig 5**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Selects the sixth signal to be traced.

**Index:**

- [0] = Trace 0 parameter in BICO format
- [1] = Trace 1 parameter in BICO format
- [2] = Trace 0 PINx with DO Id and chart Id
- [3] = Trace 0 PINx with block Id and PIN Id
- [4] = Trace 1 PINy with DO Id and chart Id
- [5] = Trace 1 PINy with block Id and PIN Id

---

**p4736[0...5] Trace record signal 6 / Trace record sig 6**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Selects the seventh signal to be traced.

**Index:**

- [0] = Trace 0 parameter in BICO format
- [1] = Trace 1 parameter in BICO format
- [2] = Trace 0 PINx with DO Id and chart Id
- [3] = Trace 0 PINx with block Id and PIN Id
- [4] = Trace 1 PINy with DO Id and chart Id
- [5] = Trace 1 PINy with block Id and PIN Id

**p4737[0...5] Trace record signal 7 / Trace record sig 7**CU\_DC, CU\_DC\_R,  
CU\_DC\_R\_S,  
CU\_DC\_S**Can be changed:** U, T**Data type:** Unsigned32**P-Group:** Trace and function generator**Not for motor type:** -**Min**

-

**Calculated:** -**Dyn. index:** -**Units group:** -**Scaling:** -**Max**

-

**Access level:** 3**Func. diagram:** -**Unit selection:** -**Expert list:** 0**Factory setting**  
0**Description:**

Selects the eighth signal to be traced.

**Index:**

[0] = Trace 0 parameter in BICO format  
 [1] = Trace 1 parameter in BICO format  
 [2] = Trace 0 PINx with DO Id and chart Id  
 [3] = Trace 0 PINx with block Id and PIN Id  
 [4] = Trace 1 PINy with DO Id and chart Id  
 [5] = Trace 1 PINy with block Id and PIN Id

**r4740[0...16383] Trace 0 trace buffer signal 0 floating point / Trace 0 tr sig 0**CU\_DC, CU\_DC\_R,  
CU\_DC\_R\_S,  
CU\_DC\_S**Can be changed:** -**Data type:** FloatingPoint32**P-Group:** Trace and function generator**Not for motor type:** -**Min**

-

**Calculated:** -**Dyn. index:** -**Units group:** -**Scaling:** -**Max**

-

**Access level:** 3**Func. diagram:** -**Unit selection:** -**Expert list:** 0**Factory setting**

-

**Description:**

Displays the trace buffer (record buffer) for trace 0 and signal 0.

The trace (record) buffer is sub-divided into memory banks, each containing 16384 values. Parameter p4795 can be used to toggle between the individual banks.

Example A:

The first 16384 values of signal 0, trace 0 are to be read out.

In this case, memory bank 0 is set with p4795 = 0. The first 16384 values can now be read out using r4740[0] to r4740[16383].

Example B:

The values 16385 to 32768 from signal 0, trace 0 are to be read out.

In this case, memory bank 1 is set with p4795 = 1. The values can now be read out in r4740[0] to r4740[16383].

**Dependency:**

Refer to: p4795

**r4741[0...16383] Trace 0 trace buffer signal 1 floating point / Trace 0 tr sig 1**CU\_DC, CU\_DC\_R,  
CU\_DC\_R\_S,  
CU\_DC\_S**Can be changed:** -**Data type:** FloatingPoint32**P-Group:** Trace and function generator**Not for motor type:** -**Min**

-

**Calculated:** -**Dyn. index:** -**Units group:** -**Scaling:** -**Max**

-

**Access level:** 3**Func. diagram:** -**Unit selection:** -**Expert list:** 0**Factory setting**

-

**Description:**

Displays the trace buffer (record buffer) for trace 0 and signal 1.

**Dependency:**

Refer to: r4740, p4795

**r4742[0...16383] Trace 0 trace buffer signal 2 floating point / Trace 0 tr sig 2**CU\_DC, CU\_DC\_R,  
CU\_DC\_R\_S,  
CU\_DC\_S**Can be changed:** -**Data type:** FloatingPoint32**P-Group:** Trace and function generator**Not for motor type:** -**Min**

-

**Calculated:** -**Dyn. index:** -**Units group:** -**Scaling:** -**Max**

-

**Access level:** 3**Func. diagram:** -**Unit selection:** -**Expert list:** 0**Factory setting**

-

**Description:**

Displays the trace buffer (record buffer) for trace 0 and signal 2.

**Dependency:**

Refer to: r4740, p4795

**r4743[0...16383] Trace 0 trace buffer signal 3 floating point / Trace 0 tr sig 3**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> -

**Description:** Displays the trace buffer (record buffer) for trace 0 and signal 3.**Dependency:** Refer to: r4740, p4795**r4744[0...16383] Trace 0 trace buffer signal 4 floating point / Trace 0 tr sig 4**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> -

**Description:** Displays the trace buffer (record buffer) for trace 0 and signal 4.**Dependency:** Refer to: r4740, p4795**r4745[0...16383] Trace 0 trace buffer signal 5 floating point / Trace 0 tr sig 5**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> -

**Description:** Displays the trace buffer (record buffer) for trace 0 and signal 5.**Dependency:** Refer to: r4740, p4795**r4746[0...16383] Trace 0 trace buffer signal 6 floating point / Trace 0 tr sig 6**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> -

**Description:** Displays the trace buffer (record buffer) for trace 0 and signal 6.**Dependency:** Refer to: r4740, p4795**r4747[0...16383] Trace 0 trace buffer signal 7 floating point / Trace 0 tr sig 7**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> -

**Description:** Displays the trace buffer (record buffer) for trace 0 and signal 7.**Dependency:** Refer to: r4740, p4795

**r4750[0...16383] Trace 1 trace buffer signal 0 floating point / Trace 1 trace sig0**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the trace buffer (record buffer) for trace 1 and signal 0.

**Dependency:** Refer to: r4740, p4795

**r4751[0...16383] Trace 1 trace buffer signal 1 floating point / Trace 1 tr sig 1**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the trace buffer (record buffer) for trace 1 and signal 1.

**Dependency:** Refer to: r4740, p4795

**r4752[0...16383] Trace 1 trace buffer signal 2 floating point / Trace 1 tr sig 2**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the trace buffer (record buffer) for trace 1 and signal 2.

**Dependency:** Refer to: r4740, p4795

**r4753[0...16383] Trace 1 trace buffer signal 3 floating point / Trace 1 tr sig 3**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the trace buffer (record buffer) for trace 1 and signal 3.

**Dependency:** Refer to: r4740, p4795

**r4754[0...16383] Trace 1 trace buffer signal 4 floating point / Trace 1 tr sig 4**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the trace buffer (record buffer) for trace 1 and signal 4.

**Dependency:** Refer to: r4740, p4795

**r4755[0...16383] Trace 1 trace buffer signal 5 floating point / Trace 1 tr sig 5**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the trace buffer (record buffer) for trace 1 and signal 5.

**Dependency:** Refer to: r4740, p4795

**r4756[0...16383] Trace 1 trace buffer signal 6 floating point / Trace 1 tr sig 6**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the trace buffer (record buffer) for trace 1 and signal 6.

**Dependency:** Refer to: r4740, p4795

**r4757[0...16383] Trace 1 trace buffer signal 7 floating point / Trace 1 tr sig 7**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the trace buffer (record buffer) for trace 1 and signal 7.

**Dependency:** Refer to: r4740, p4795

**r4760[0...16383] Trace 0 trace buffer signal 0 / Trace 0 tr sig 0**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the trace buffer (record buffer) for trace 0 and signal 0 as integer number.

**Note:** For signals, data type I32 or U32, the trace buffer is assigned as follows:

r4760[0] = value 0

r4760[1] = value 1

...

r4760[8191] = value 8191

For signals, data type I16 or U16, the trace buffer is assigned as follows:

r4760[0] = value 0 (bit 31 ... 16) and value 1 (bit 15 ... 0)

r4760[1] = value 2 (bit 31 ... 16) and value 3 (bit 15 ... 0)

...

r4760[8191] = value 16382 (bit 31 ... 16) and value 16383 (bit 15 ... 0)

For signals, data type I8 or U8, the trace buffer is assigned as follows:

r4760[0] = value 0 (bit 31 ... 24) value 1 (bit 23 ... 16) value 2 (bit 15 ... 8) value 3 (bit 7 ... 0)

r4760[1] = value 4 (bit 31 ... 24) value 5 (bit 23 ... 16) value 6 (bit 15 ... 8) value 7 (bit 7 ... 0)

...

r4760[8191] = value 32764 (bit 31 ... 24) value 32765 (bit 23 ... 16) value 32766 (bit 15 ... 8) value 32767 (bit 7 ... 0)

---

#### **r4761[0...16383] Trace 0 trace buffer signal 1 / Trace 0 tr sig 1**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the trace buffer (record buffer) for trace 0 and signal 1.

**Dependency:** Refer to: r4760

---

#### **r4762[0...16383] Trace 0 trace buffer signal 2 / Trace 0 tr sig 2**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the trace buffer (record buffer) for trace 0 and signal 2.

**Dependency:** Refer to: r4760

---

#### **r4763[0...16383] Trace 0 trace buffer signal 3 / Trace 0 tr sig 3**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the trace buffer (record buffer) for trace 0 and signal 3.

**Dependency:** Refer to: r4760

---

#### **r4764[0...16383] Trace 0 trace buffer signal 4 / Trace 0 tr sig 4**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the trace buffer (record buffer) for trace 0 and signal 4.

**Dependency:** Refer to: r4760

---

#### **r4765[0...16383] Trace 0 trace buffer signal 5 / Trace 0 tr sig 5**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the trace buffer (record buffer) for trace 0 and signal 5.

**Dependency:** Refer to: r4760

---

**r4766[0...16383] Trace 0 trace buffer signal 6 / Trace 0 tr sig 6**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the trace buffer (record buffer) for trace 0 and signal 6.

**Dependency:** Refer to: r4760

---

**r4767[0...16383] Trace 0 trace buffer signal 7 / Trace 0 tr sig 7**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the trace buffer (record buffer) for trace 0 and signal 7.

**Dependency:** Refer to: r4760

---

**r4770[0...16383] Trace 1 trace buffer signal 0 / Trace 1 trace sig0**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the trace buffer (record buffer) for trace 1 and signal 0.

**Dependency:** Refer to: r4760

---

**r4771[0...16383] Trace 1 trace buffer signal 1 / Trace 1 tr sig 1**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the trace buffer (record buffer) for trace 1 and signal 1.

**Dependency:** Refer to: r4760

---

**r4772[0...16383] Trace 1 trace buffer signal 2 / Trace 1 tr sig 2**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the trace buffer (record buffer) for trace 1 and signal 2.

**Dependency:** Refer to: r4760



---

**r4773[0...16383] Trace 1 trace buffer signal 3 / Trace 1 tr sig 3**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the trace buffer (record buffer) for trace 1 and signal 3.

**Dependency:** Refer to: r4760

---

**r4774[0...16383] Trace 1 trace buffer signal 4 / Trace 1 tr sig 4**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the trace buffer (record buffer) for trace 1 and signal 4.

**Dependency:** Refer to: r4760

---

**r4775[0...16383] Trace 1 trace buffer signal 5 / Trace 1 tr sig 5**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the trace buffer (record buffer) for trace 1 and signal 5.

**Dependency:** Refer to: r4760

---

**r4776[0...16383] Trace 1 trace buffer signal 6 / Trace 1 tr sig 6**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the trace buffer (record buffer) for trace 1 and signal 6.

**Dependency:** Refer to: r4760

---

**r4777[0...16383] Trace 1 trace buffer signal 7 / Trace 1 tr sig 7**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the trace buffer (record buffer) for trace 1 and signal 7.

**Dependency:** Refer to: r4760

<b>p4780[0...1]</b>	<b>Trace physical address signal 0 / Trace PhyAddr Sig0</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b> 0000 bin	<b>Max</b> 1111 1111 1111 1111 1111 1111 1111 1111 bin	<b>Factory setting</b> 0000 bin
<b>Description:</b>	Sets the physical address for the first signal to be traced. The data type is defined using p4730.		
<b>Index:</b>	[0] = Trace 0 [1] = Trace 1		

<b>p4781[0...1]</b>	<b>Trace physical address signal 1 / Trace PhyAddr Sig1</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b> 0000 bin	<b>Max</b> 1111 1111 1111 1111 1111 1111 1111 1111 bin	<b>Factory setting</b> 0000 bin
<b>Description:</b>	Sets the physical address for the second signal to be traced. The data type is defined using p4731.		
<b>Index:</b>	[0] = Trace 0 [1] = Trace 1		

<b>p4782[0...1]</b>	<b>Trace physical address signal 2 / Trace PhyAddr Sig2</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b> 0000 bin	<b>Max</b> 1111 1111 1111 1111 1111 1111 1111 1111 bin	<b>Factory setting</b> 0000 bin
<b>Description:</b>	Sets the physical address for the third signal to be traced. The data type is defined using p4732.		
<b>Index:</b>	[0] = Trace 0 [1] = Trace 1		

<b>p4783[0...1]</b>	<b>Trace physical address signal 3 / Trace PhyAddr Sig3</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b> 0000 bin	<b>Max</b> 1111 1111 1111 1111 1111 1111 1111 1111 bin	<b>Factory setting</b> 0000 bin
<b>Description:</b>	Sets the physical address for the fourth signal to be traced. The data type is defined using p4733.		
<b>Index:</b>	[0] = Trace 0 [1] = Trace 1		

<b>p4784[0...1]</b>	<b>Trace physical address signal 4 / Trace PhyAddr Sig4</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b> 0000 bin	<b>Max</b> 1111 1111 1111 1111 1111 1111 1111 1111 bin	<b>Factory setting</b> 0000 bin
<b>Description:</b>	Sets the physical address for the fifth signal to be traced. The data type is defined using p4734.		
<b>Index:</b>	[0] = Trace 0 [1] = Trace 1		

<b>p4785[0...1]</b>	<b>Trace physical address signal 5 / Trace PhyAddr Sig5</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b> 0000 bin	<b>Max</b> 1111 1111 1111 1111 1111 1111 1111 1111 bin	<b>Factory setting</b> 0000 bin
<b>Description:</b>	Sets the physical address for the sixth signal to be traced. The data type is defined using p4735.		
<b>Index:</b>	[0] = Trace 0 [1] = Trace 1		

<b>p4786[0...1]</b>	<b>Trace physical address signal 6 / Trace PhyAddr Sig6</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b> 0000 bin	<b>Max</b> 1111 1111 1111 1111 1111 1111 1111 1111 bin	<b>Factory setting</b> 0000 bin
<b>Description:</b>	Sets the physical address for the seventh signal to be traced. The data type is defined using p4736.		
<b>Index:</b>	[0] = Trace 0 [1] = Trace 1		

<b>p4787[0...1]</b>	<b>Trace physical address signal 7 / Trace PhyAddr Sig7</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b> 0000 bin	<b>Max</b> 1111 1111 1111 1111 1111 1111 1111 1111 bin	<b>Factory setting</b> 0000 bin
<b>Description:</b>	Sets the physical address for the eighth signal to be traced. The data type is defined using p4737.		
<b>Index:</b>	[0] = Trace 0 [1] = Trace 1		

<b>p4789[0...1]</b>	<b>Trace physical address trigger signal / Trace PhyAddr Trig</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 <b>P-Group:</b> Trace and function generator <b>Not for motor type:</b> - <b>Min</b> 0000 hex	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> FFFF FFFF hex	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0 <b>Factory setting</b> 0000 hex
<b>Description:</b>	Sets the physical address for the trigger signal. The data type is defined by making the appropriate selection in p4711.		
<b>Index:</b>	[0] = Trace 0 [1] = Trace 1		

<b>r4790[0...1]</b>	<b>Trace data type 5 traced / Trace rec type 5</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> Trace and function generator <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0 <b>Factory setting</b> -
<b>Description:</b>	Displays the recorded data type 5 for the trace.		
<b>Index:</b>	[0] = Trace 0 [1] = Trace 1		

<b>r4791[0...1]</b>	<b>Trace data type 6 traced / Trace rec type 6</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> Trace and function generator <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0 <b>Factory setting</b> -
<b>Description:</b>	Displays the recorded data type 6 for the trace.		
<b>Index:</b>	[0] = Trace 0 [1] = Trace 1		

<b>r4792[0...1]</b>	<b>Trace data type 7 traced / Trace rec type 7</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> Trace and function generator <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0 <b>Factory setting</b> -
<b>Description:</b>	Displays the recorded data type 7 for the trace.		
<b>Index:</b>	[0] = Trace 0 [1] = Trace 1		

<b>r4793[0...1]</b>	<b>Trace data type 8 traced / Trace rec type 8</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> Trace and function generator <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0 <b>Factory setting</b> -
<b>Description:</b>	Displays the recorded data type 8 for the trace.		

**Index:** [0] = Trace 0  
[1] = Trace 1

---

**p4795 Trace memory bank changeover / Trace mem changeov**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 <b>P-Group:</b> Trace and function generator <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 500	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0 <b>Factory setting</b> 0
--	--	---	---

**Description:** Changes over the memory bank to read out the contents of the trace buffer.

**Dependency:** Refer to: r4740, r4741, r4742, r4743, r4750, r4751, r4752, r4753

---

**r4797[0...1] Trace 0 trigger instant / Trace 0 t\_trigger**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> Trace and function generator <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0 <b>Factory setting</b> -
--	---	---	---

**Description:** Displays the instant in time for fulfilling the trigger condition for trace recorder 0.  
The time comprises milliseconds (index 0) and days (index 1).

**Index:** [0] = Milliseconds  
[1] = Days

**Dependency:** Refer to: r2114, r3102, r4719

**Notice:** The accuracy of the trigger instant depends on the accuracy of the underlying basis time.  
For clarification:

The trigger instant is calculated with a  $\mu$ s accuracy. If the underlying basis time is only available with ms accuracy, then as a result of rounding effects, an inaccuracy of 1 ms can occur.

When referred to r4719, the trigger instant can therefore deviate somewhat.

**Note:** If the time calculation of the drive can be synchronized with a higher-level control, then this time can be taken from the actual UTC time (r3102 ). Otherwise, the time is based on the system runtime (r2114).

---

**r4798[0...1] Trace 1 trigger instant / Trace 1 t\_trigger**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> Trace and function generator <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0 <b>Factory setting</b> -
--	---	---	---

**Description:** Displays the instant in time for fulfilling the trigger condition for trace recorder 1.  
The time comprises milliseconds (index 0) and days (index 1).

**Index:** [0] = Milliseconds  
[1] = Days

**Dependency:** Refer to: r2114, r3102, r4719

**Notice:** The accuracy of the trigger instant depends on the accuracy of the underlying basis time.  
For clarification:

The trigger instant is calculated with a  $\mu$ s accuracy. If the underlying basis time is only available with ms accuracy, then as a result of rounding effects, an inaccuracy of 1 ms can occur.

When referred to r4719, the trigger instant can therefore deviate somewhat.

**Note:** If the time calculation of the drive can be synchronized with a higher-level control, then this time can be taken from the actual UTC time (r3102 ). Otherwise, the time is based on the system runtime (r2114).

**r4799 Trace memory location free / Trace mem free**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the free memory for the trace in bytes.

**Dependency:** Refer to: r4708

**p4800 Function generator control / FG control**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	3	0

**Description:** The function generator is started with p4800 = 1.  
The signal is only generated for a 1 signal of binector input p4819.

**Value:**

- 0: Stop function generator
- 1: Start function generator
- 2: Check function generator parameterization
- 3: Start function generator without enable signals

**Dependency:** Refer to: p4819

**r4805 Function generator status / FG status**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	6	-

**Description:** Displays the actual status of the function generator.

**Value:**

- 0: Inactive
- 1: Generate accelerating ramp to offset
- 2: Generate parameterized signal shape
- 3: Generate braking ramp
- 4: Function generator stopped due to missing enable signals
- 5: Function generator waits for BI: p4819
- 6: Function generator parameterization has been checked

**Dependency:** Refer to: p4800, p4819

**r4806.0 BO: Function generator status signal / FG status signal**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the status of the function generator.

0 signal: Function generator inactive  
1 signal: Function generator running

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Bit 0	ON	OFF	-

<b>p4810</b>	<b>Function generator mode / FG operating mode</b>				
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3		
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -		
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -		
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0		
	<b>Min</b> 0	<b>Max</b> 99	<b>Factory setting</b> 0		
<b>Description:</b>	Sets the operating mode of the function generator.				
<b>Value:</b>	0: Connection at connector output r4818 1: Connection at current setpoint after filter and r4818 2: Connection as disturbing torque and r4818 3: Connection at speed setpoint after filter and r4818 4: Connection at current setpoint before filter and r4818 5: Connection at speed setpoint before filter and r4818 6: Connection for free measurement function r4818 and r4834 99: Connection at physical address and r4818				

<b>p4812</b>	<b>Function generator physical address / FG phys address</b>				
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3		
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -		
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -		
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0		
	<b>Min</b> 0	<b>Max</b> 4294967295	<b>Factory setting</b> 0		
<b>Description:</b>	Sets the physical address where the function generator is to be connected.				
<b>Dependency:</b>	Only effective when p4810 = 99.				

<b>p4813</b>	<b>Function generator physical address reference value / FG phys addr ref</b>				
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3		
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -		
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -		
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0		
	<b>Min</b> 1.00	<b>Max</b> 1000000.00	<b>Factory setting</b> 1.00		
<b>Description:</b>	Sets the reference value for 100 % for referred inputs.				
<b>Dependency:</b>	Only effective when p4810 = 99.				

<b>p4816</b>	<b>Function generator output signal integer number scaling / FG outp integ scal</b>				
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 4		
	<b>Data type:</b> Integer32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -		
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -		
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1		
	<b>Min</b> -2147483648	<b>Max</b> 2147483647	<b>Factory setting</b> 0		
<b>Description:</b>	Sets the scaling for the integer number of the output signal for the function generator.				
<b>Dependency:</b>	Refer to: r4805, r4817				
<b>Note:</b>	The parameter can only be changed in the following operating states: r4805 = 0, 4, 6				

<b>r4817</b>	<b>CO: Function generator output signal integer number / FG outp integ no.</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> - <b>Data type:</b> Integer32 <b>P-Group:</b> Trace and function generator <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0 <b>Factory setting</b> -
<b>Description:</b>	Display and connector output for the integer number of the output signal for the function generator.		
<b>Dependency:</b>	Refer to: p4816		
<b>Note:</b>	The value is output independent of the function generator operating mode.		
<b>r4818</b>	<b>CO: Function generator output signal / FG outp_sig</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Trace and function generator <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0 <b>Factory setting</b> - [%]
<b>Description:</b>	Displays the output signal for the function generator.		
<b>Dependency:</b>	Refer to: p4810		
<b>Note:</b>	The value is displayed independently of the function generator mode.		
<b>p4819</b>	<b>BI: Function generator control / FG control</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> Trace and function generator <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0 <b>Factory setting</b> 1
<b>Description:</b>	Sets the signal source to control the function generator. When the function generator is running, signal generation is stopped with a 0 signal from BI: p4819 and p4800 is set to 0.		
<b>Dependency:</b>	Refer to: p4800		
<b>p4820</b>	<b>Function generator signal shape / FG signal shape</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> Integer16 <b>P-Group:</b> Trace and function generator <b>Not for motor type:</b> - <b>Min</b> 1	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 5	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0 <b>Factory setting</b> 1
<b>Description:</b>	Sets the signal to be generated for the function generator.		
<b>Value:</b>	1: Square-wave 2: Staircase 3: Delta 4: Binary noise - PRBS (Pseudo Random Binary Signal) 5: Sine-wave		



<b>p4821</b>	<b>Function generator period / FG period duration</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Trace and function generator <b>Not for motor type:</b> - <b>Min</b> 0.00 [ms]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 60000.00 [ms]	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0 <b>Factory setting</b> 1000.00 [ms]
<b>Description:</b>	Sets the period of the signal to be generated for the function generator.		
<b>Dependency:</b>	Ineffective when p4820 = 4 (PRBS).		
<b>p4822</b>	<b>Function generator pulse width / FG pulse width</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Trace and function generator <b>Not for motor type:</b> - <b>Min</b> 0.00 [ms]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 60000.00 [ms]	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0 <b>Factory setting</b> 500.00 [ms]
<b>Description:</b>	Sets the pulse width for the signal to be generated for the function generator.		
<b>Dependency:</b>	Only effective when p4820 = 1 (square-wave).		
<b>p4823</b>	<b>Function generator bandwidth / FG bandwidth</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Trace and function generator <b>Not for motor type:</b> - <b>Min</b> 0.0025 [Hz]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 16000.0000 [Hz]	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0 <b>Factory setting</b> 4000.0000 [Hz]
<b>Description:</b>	Sets the bandwidth for the signal to be generated for the function generator.		
<b>Dependency:</b>	Only effective when p4820 = 4 (PRBS). Refer to: p4830		
<b>p4824</b>	<b>Function generator amplitude / FG amplitude</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Trace and function generator <b>Not for motor type:</b> - <b>Min</b> -1600.00 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1600.00 [%]	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0 <b>Factory setting</b> 5.00 [%]
<b>Description:</b>	Sets the amplitude for the signal to be generated for the function generator.		
<b>Dependency:</b>	Units are dependent on p4810. If p4810 = 1, 2, 4: The amplitude is referred to p2002 (reference current). If p4810 = 3, 5: The amplitude is referred to p2000 (reference speed).		
<b>p4825</b>	<b>Function generator 2nd amplitude / FG 2nd amplitude</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Trace and function generator <b>Not for motor type:</b> - <b>Min</b> -1600.00 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1600.00 [%]	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0 <b>Factory setting</b> 7.00 [%]
<b>Description:</b>	Sets the second amplitude for the signal to be generated for the function generator.		

**Dependency:** Only effective for p4820 = 2 (staircase).  
 Units are dependent on p4810.  
 If p4810 = 1, 2, 4: The amplitude is referred to p2002 (reference current).  
 If p4810 = 3, 5: The amplitude is referred to p2000 (reference speed).

---

**p4826 Function generator offset / FG offset**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b> -1600.00 [%]	<b>Max</b> 1600.00 [%]	<b>Factory setting</b> 0.00 [%]

**Description:** Sets the offset (DC component) of the signal to be generated for the function generator.

**Dependency:** Units are dependent on p4810.  
 If p4810 = 1, 2, 4: The offset is referred to p2002 (reference current).  
 If p4810 = 3, 5: The offset is referred to p2000 (reference speed).  
 If p4810 = 2: In order to avoid the undesirable effects of play (backlash), the offset does not act on the current setpoint, but instead on the speed setpoint.

---

**p4827 Function generator ramp-up time to offset / FG ramp-up offset**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b> 0.00 [ms]	<b>Max</b> 100000.00 [ms]	<b>Factory setting</b> 32.00 [ms]

**Description:** Sets the ramp-up time to the offset for the function generator.

---

**p4828 Function generator lower limit / FG lower limit**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b> -10000.00 [%]	<b>Max</b> 0.00 [%]	<b>Factory setting</b> -100.00 [%]

**Description:** Sets the lower limit for the function generator.

**Dependency:** For p4810 = 2 the limit only applies to the current setpoint, but not the speed setpoint (offset).

---

**p4829 Function generator upper limit / FG upper limit**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Trace and function generator	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b> 0.00 [%]	<b>Max</b> 10000.00 [%]	<b>Factory setting</b> 100.00 [%]

**Description:** Sets the upper limit for the function generator.

**Dependency:** For p4810 = 2 the limit only applies to the current setpoint, but not the speed setpoint (offset).

<b>p4830</b>	<b>Function generator time slice cycle / FG time slice</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Trace and function generator <b>Not for motor type:</b> - <b>Min</b> 0.03125 [ms]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 2.00000 [ms]	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0 <b>Factory setting</b> 0.12500 [ms]
<b>Description:</b>	Sets the time slice cycle in which the function generator is called.		
<b>p4831</b>	<b>Function generator amplitude scaling / FG amplitude scal</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Trace and function generator <b>Not for motor type:</b> - <b>Min</b> 0.00000 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 200.00000 [%]	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0 <b>Factory setting</b> 100.00000 [%]
<b>Description:</b>	Sets the scaling for the amplitude of the signal waveforms for all output channels. The value can be changed while the function generator is running.		
<b>p4832[0...2]</b>	<b>Function generator amplitude scaling / FG amplitude scal</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Trace and function generator <b>Not for motor type:</b> - <b>Min</b> -340.28235E36 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 340.28235E36 [%]	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0 <b>Factory setting</b> 100.00000 [%]
<b>Description:</b>	Sets the scaling for the amplitude of the signal waveforms separately for each output channel. The value cannot be changed while the function generator is running.		
<b>Index:</b>	[0] = First drive for connection [1] = Second drive for connection [2] = Third drive for connection		
<b>p4833[0...2]</b>	<b>Function generator offset scaling / FG offset scal</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Trace and function generator <b>Not for motor type:</b> - <b>Min</b> -340.28235E36 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 340.28235E36 [%]	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0 <b>Factory setting</b> 100.00000 [%]
<b>Description:</b>	Sets the scaling for the offset of the signal waveforms separately for each output channel. The value cannot be changed while the function generator is running.		
<b>Index:</b>	[0] = First drive for connection [1] = Second drive for connection [2] = Third drive for connection		

**r4834[0...4] CO: Function generator free measurement output signal / FG fr MeasFct outp**CU\_DC, CU\_DC\_R,  
CU\_DC\_R\_S,  
CU\_DC\_S**Can be changed:** -**Data type:** FloatingPoint32**P-Group:** Trace and function generator**Not for motor type:** -**Min**

- [%]

**Calculated:** -**Dyn. index:** -**Units group:** -**Scaling:** PERCENT**Max**

- [%]

**Access level:** 3**Func. diagram:** -**Unit selection:** -**Expert list:** 0**Factory setting**

- [%]

**Description:**

Displays the output signal for the free measurement function.

**Index:**[0] = Signal 1  
[1] = Signal 2  
[2] = Signal 3  
[3] = Signal 4  
[4] = Signal 5**Dependency:**

Refer to: p4810

**Note:**

The signals are only output in the "free measurement function" operating mode (p4810 = 6)

**p4835[0...4] Function generator free measurement function scaling / FG fr MeasFct scal**CU\_DC, CU\_DC\_R,  
CU\_DC\_R\_S,  
CU\_DC\_S**Can be changed:** U, T**Data type:** FloatingPoint32**P-Group:** -**Not for motor type:** -**Min**

-200.00000 [%]

**Calculated:** -**Dyn. index:** -**Units group:** -**Scaling:** -**Max**

200.00000 [%]

**Access level:** 3**Func. diagram:** -**Unit selection:** -**Expert list:** 1**Factory setting**

100.00000 [%]

**Description:**

Sets the scaling of the output signals for the free measurement function.

**Index:**[0] = Signal 1  
[1] = Signal 2  
[2] = Signal 3  
[3] = Signal 4  
[4] = Signal 5**Note:**

The parameter cannot be changed when the measurement function has been started (r4706 = 2, 3).

**p4840[0...1] MTrace cycle number setting / Cycle number**CU\_DC, CU\_DC\_R,  
CU\_DC\_R\_S,  
CU\_DC\_S**Can be changed:** U, T**Data type:** Unsigned32**P-Group:** Trace and function generator**Not for motor type:** -**Min**

0

**Calculated:** -**Dyn. index:** -**Units group:** -**Scaling:** -**Max**

4294967295

**Access level:** 3**Func. diagram:** -**Unit selection:** -**Expert list:** 0**Factory setting**

0

**Description:**

Sets the number of cycles of a multiple trace.

The multiple trace is de-activated with a value = 0.

**Index:**[0] = Trace 0  
[1] = Trace 1**Dependency:**

Refer to: r4841, p4844

**Notice:**

A multiple trace can have a negative impact on the total system performance.

From their inherent principle of operation, flash memory cards are subject to wear as a result of write operations. As a consequence, the lifetime of flash memory cards is reduced when using the multiple trace functionality.

<b>r4841[0...1]</b>	<b>MTrace cycle actual display / Cycle act display</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> Trace and function generator <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0 <b>Factory setting</b> -
<b>Description:</b>	Displays the currently running cycle (including deadtime) of the multiple trace.		
<b>Index:</b>	[0] = Trace 0 [1] = Trace 1		
<b>Dependency:</b>	Refer to: p4840, p4844		

<b>p4844[0...1]</b>	<b>MTrace ring buffer files number / Ring buff file qty</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> T <b>Data type:</b> Unsigned16 <b>P-Group:</b> Trace and function generator <b>Not for motor type:</b> - <b>Min</b> 5	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 5	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0 <b>Factory setting</b> 5
<b>Description:</b>	Sets the number of ring buffer files for the measurement results of the multiple trace.		
<b>Index:</b>	[0] = Trace 0 [1] = Trace 1		
<b>Dependency:</b>	Refer to: p4840, r4841		

<b>r4950</b>	<b>OA application count / OA no</b>		
All objects	<b>Can be changed:</b> - <b>Data type:</b> Unsigned16 <b>P-Group:</b> OEM range <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 10	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the number of OA applications installed on the memory card/device memory.		
<b>Dependency:</b>	Refer to: r4951, r4952, r4955, p4956, r4957, r4958, r4959, r4960		
<b>Note:</b>	OA: Open Architecture		

<b>r4951</b>	<b>OA application identifier total length / OA ID length</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S, DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150	<b>Can be changed:</b> - <b>Data type:</b> Unsigned16 <b>P-Group:</b> OEM range <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 90	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the total length of the IDs of all the OA applications installed on the memory card/device memory.		
<b>Dependency:</b>	Refer to: r4950, r4952, r4955, p4956, r4957, r4958, r4959, r4960		
<b>Note:</b>	The identifier of an OA application comprises a maximum of 8 characters plus separator.		

**r4951 OA application identifier total length / OA ID length**

TM15DI_DO, TM31	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> OEM range	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	90	-

**Description:** Displays the total length of the IDs of all the OA applications installed on the memory card/device memory.

**Dependency:** Refer to: r4950, r4952, r4955, p4956, r4957, r4958, r4959, r4960

**Note:** The identifier of an OA application comprises a maximum of 8 characters plus separator.

**r4952 OA application GUID total length / OA GUID length**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S, DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> OEM range	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	180	-

**Description:** Displays the total length of the GUIDs of all the OA applications installed on the memory card/device memory.

**Dependency:** Refer to: r4950, r4951, r4955, p4956, r4957, r4958, r4959, r4960

**Note:** The GUID of an OA application comprises 16 characters plus 1 character major information plus 1 character, minor information.

GUID: Globally Unique Identifier

**r4952 OA application GUID total length / OA GUID length**

TM15DI_DO, TM31	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> OEM range	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	180	-

**Description:** Displays the total length of the GUIDs of all the OA applications installed on the memory card/device memory.

**Dependency:** Refer to: r4950, r4951, r4955, p4956, r4957, r4958, r4959, r4960

**Note:** The GUID of an OA application comprises 16 characters plus 1 character major information plus 1 character, minor information.

GUID: Globally Unique Identifier

**r4955[0...n] OA application identifier / OA ID**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S, DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Unsigned8	<b>Dyn. index:</b> r4951	<b>Func. diagram:</b> -
	<b>P-Group:</b> OEM range	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the IDs of all the OA applications installed on the memory card/device memory.

r4955[0...8]: Identifier of OA application 1

r4955[9...17]: Identifier of OA applications 2, ...

**Dependency:** Refer to: r4950, r4951, r4952, p4956, r4957, r4958, r4959, r4960

**Notice:** If there is no OA application, then it is not possible to access an index.

<b>r4955[0...n] OA application identifier / OA ID</b>			
TM15DI_DO, TM31	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Unsigned8	<b>Dyn. index:</b> r4951	<b>Func. diagram:</b> -
	<b>P-Group:</b> OEM range	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> -
<b>Description:</b> Displays the IDs of all the OA applications installed on the memory card/device memory. r4955[0...8]: Identifier of OA application 1 r4955[9...17]: Identifier of OA applications 2, ...			
<b>Dependency:</b> Refer to: r4950, r4951, r4952, p4956, r4957, r4958, r4959, r4960			
<b>Notice:</b> If there is no OA application, then it is not possible to access an index.			

<b>p4956[0...n] OA application activation / OA act</b>			
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S, DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150	<b>Can be changed:</b> C1, T	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> r4950	<b>Func. diagram:</b> -
	<b>P-Group:</b> OEM range	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 1	<b>Factory setting</b> 0
<b>Description:</b> Setting to activate the OA applications installed on the memory card/device memory. r4956[0]: Activates OA application 1 r4956[1]: Activates OA application 2, ...			
<b>Value:</b> 0: OA application inactive 1: OA application active			
<b>Dependency:</b> Refer to: r4950, r4951, r4952, r4955, r4957, r4958, r4959, r4960			
<b>Notice:</b> If there is no OA application, then it is not possible to access an index.			

<b>p4956[0...n] OA application activation / OA act</b>			
TM15DI_DO, TM31	<b>Can be changed:</b> C1, T	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> r4950	<b>Func. diagram:</b> -
	<b>P-Group:</b> OEM range	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b> 0	<b>Max</b> 1	<b>Factory setting</b> 0
<b>Description:</b> Setting to activate the OA applications installed on the memory card/device memory. r4956[0]: Activates OA application 1 r4956[1]: Activates OA application 2, ...			
<b>Value:</b> 0: OA application inactive 1: OA application active			
<b>Dependency:</b> Refer to: r4950, r4951, r4952, r4955, r4957, r4958, r4959, r4960			
<b>Notice:</b> If there is no OA application, then it is not possible to access an index.			

<b>r4957[0...n]</b>	<b>OA application version / OA version</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S, DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> OEM range <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> r4950 <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 4294967295	<b>Factory setting</b> -
<b>Description:</b>	Displays the versions of the OA applications installed on the memory card/device memory. r4957[0]: Version of OA application 1 r4957[1]: Version of OA application 2, ...		
<b>Dependency:</b>	Refer to: r4950, r4951, r4952, r4955, p4956, r4958, r4959, r4960		
<b>Notice:</b>	If there is no OA application, then it is not possible to access an index.		
<b>Note:</b>	Example: The value 1010100 should be interpreted as V01.01.01.00.		

<b>r4957[0...n]</b>	<b>OA application version / OA version</b>		
TM15DI_DO, TM31	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> OEM range <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> r4950 <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0
	<b>Min</b> 0	<b>Max</b> 4294967295	<b>Factory setting</b> -
<b>Description:</b>	Displays the versions of the OA applications installed on the memory card/device memory. r4957[0]: Version of OA application 1 r4957[1]: Version of OA application 2, ...		
<b>Dependency:</b>	Refer to: r4950, r4951, r4952, r4955, p4956, r4958, r4959, r4960		
<b>Notice:</b>	If there is no OA application, then it is not possible to access an index.		
<b>Note:</b>	Example: The value 1010100 should be interpreted as V01.01.01.00.		

<b>r4958[0...n]</b>	<b>OA application interface version / OA int_version</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S, DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> OEM range <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> r4950 <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> -
<b>Description:</b>	Displays the interface versions of the OA applications installed on the memory card/device memory. r4958[0]: Interface version of OA application 1 r4958[1]: Interface version of OA applications 2, ...		
<b>Dependency:</b>	Refer to: r4950, r4951, r4952, r4955, p4956, r4957, r4959, r4960		
<b>Notice:</b>	If there is no OA application, then it is not possible to access an index.		
<b>Note:</b>	Example: The value 1010100 should be interpreted as V01.01.01.00.		



<b>r4958[0...n]</b>	<b>OA application interface version / OA int_version</b>		
TM15DI_DO, TM31	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> r4950	<b>Func. diagram:</b> -
	<b>P-Group:</b> OEM range	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays the interface versions of the OA applications installed on the memory card/device memory. r4958[0]: Interface version of OA application 1 r4958[1]: Interface version of OA applications 2, ...		
<b>Dependency:</b>	Refer to: r4950, r4951, r4952, r4955, p4956, r4957, r4959, r4960		
<b>Notice:</b>	If there is no OA application, then it is not possible to access an index.		
<b>Note:</b>	Example: The value 1010100 should be interpreted as V01.01.01.00.		

<b>r4959[0...n]</b>	<b>OA application GUID / OA GUID</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S, DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Unsigned8	<b>Dyn. index:</b> r4952	<b>Func. diagram:</b> -
	<b>P-Group:</b> OEM range	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays the GUIDs of the OA applications installed on the memory card/device memory. r4959[0...15]: GUID of OA application 1 r4960[16]: Major information of OA application 1 r4960[17]: Minor information of OA application 1 r4959[18...33]: GUID of OA application 2 r4960[34]: Major information of OA application 2 r4960[35]: Minor information of OA application 2, ...		
<b>Dependency:</b>	Refer to: r4950, r4951, r4952, r4955, p4956, r4957, r4958, r4960		
<b>Notice:</b>	If there is no OA application, then it is not possible to access an index.		

<b>r4959[0...n]</b>	<b>OA application GUID / OA GUID</b>		
TM15DI_DO, TM31	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Unsigned8	<b>Dyn. index:</b> r4952	<b>Func. diagram:</b> -
	<b>P-Group:</b> OEM range	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays the GUIDs of the OA applications installed on the memory card/device memory. r4959[0...15]: GUID of OA application 1 r4960[16]: Major information of OA application 1 r4960[17]: Minor information of OA application 1 r4959[18...33]: GUID of OA application 2 r4960[34]: Major information of OA application 2 r4960[35]: Minor information of OA application 2, ...		
<b>Dependency:</b>	Refer to: r4950, r4951, r4952, r4955, p4956, r4957, r4958, r4960		
<b>Notice:</b>	If there is no OA application, then it is not possible to access an index.		

**r4960[0...n]      OA application GUID drive object / OA GUID DO**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S, DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150	<b>Can be changed:</b> - <b>Data type:</b> Unsigned8 <b>P-Group:</b> OEM range <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> r4952 <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1
---	--	--	--

<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
-	-	-

**Description:** Displays the GUIDs of the drive object of the OA applications installed on the memory card/device memory.  
r4960[0...15]: GUID of this drive object of OA application 1  
r4960[16]: Major information of this drive object of OA application 1  
r4960[17]: Minor information of this drive object of OA application 1  
r4960[18...33]: GUID of this drive object of OA application 2  
r4960[34]: Major information of this drive object of OA application 2  
r4960[35]: Minor information of this drive object of OA application 2, ...

**Dependency:** Refer to: r4950, r4951, r4952, r4955, p4956, r4957, r4958, r4959

**Notice:** If there is no OA application, then it is not possible to access an index.

**r4960[0...n]      OA application GUID drive object / OA GUID DO**

TM15DI_DO, TM31	<b>Can be changed:</b> - <b>Data type:</b> Unsigned8 <b>P-Group:</b> OEM range <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> r4952 <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0
-----------------	--	--	--

<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
-	-	-

**Description:** Displays the GUIDs of the drive object of the OA applications installed on the memory card/device memory.  
r4960[0...15]: GUID of this drive object of OA application 1  
r4960[16]: Major information of this drive object of OA application 1  
r4960[17]: Minor information of this drive object of OA application 1  
r4960[18...33]: GUID of this drive object of OA application 2  
r4960[34]: Major information of this drive object of OA application 2  
r4960[35]: Minor information of this drive object of OA application 2, ...

**Dependency:** Refer to: r4950, r4951, r4952, r4955, p4956, r4957, r4958, r4959

**Notice:** If there is no OA application, then it is not possible to access an index.

**p4961[0...n]      OA application logbook module selection / OA logbook module**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S, DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 <b>P-Group:</b> OEM range <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> r4950 <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1
---	---	--	--

<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
0000 hex	FFFF FFFF hex	0000 hex

**Description:** Only for service purposes.

<b>p4961[0...n]</b>	<b>OA application logbook module selection / OA logbook module</b>		
TM15DI_DO, TM31	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 <b>P-Group:</b> OEM range <b>Not for motor type:</b> - <b>Min</b> 0000 hex	<b>Calculated:</b> - <b>Dyn. index:</b> r4950 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> FFFF FFFF hex	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0 <b>Factory setting</b> 0000 hex
<b>Description:</b>	Only for service purposes.		
<b>r4975</b>	<b>OA application invalid number / OA inv no.</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned16 <b>P-Group:</b> OEM range <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the number of invalid OA applications installed on the memory card/device memory.		
<b>Dependency:</b>	Refer to: r4976, r4978, r4979		
<b>Note:</b>	OA: Open Architecture		
<b>r4976</b>	<b>OA application invalid identifier total length / OA inv ID length</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned16 <b>P-Group:</b> OEM range <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the total length of the IDs of all the invalid OA applications installed on the memory card/device memory.		
<b>Dependency:</b>	Refer to: r4975, r4978, r4979		
<b>Note:</b>	The identifier of an invalid OA application comprises a maximum of 8 characters plus separator.		
<b>r4978[0...n]</b>	<b>OA application invalid identifier / OA inv ID</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned8 <b>P-Group:</b> OEM range <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> r4976 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the IDs of all the invalid OA applications installed on the memory card/device memory. r4978[0...8]: Identifier of invalid OA application 1 r4978[9...17]: Identifier of invalid OA application 2, ...		
<b>Dependency:</b>	Refer to: r4975, r4976, r4979		
<b>Notice:</b>	If there is no invalid OA application, then it is not possible to access an index.		

**r4979[0...n]      OA application invalid error code / OA inv error code**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> r4975	<b>Func. diagram:</b> -
	<b>P-Group:</b> OEM range	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the error code of the invalid OA applications installed on the memory card/device memory.  
r4979[0]: Fault value of OA application 1  
r4979[1]: Fault value of OA application 2, ...

**Dependency:** Refer to: r4975, r4976, r4978

**Notice:** If there is no invalid OA application, then it is not possible to access an index.

**Note:** The value in the error code must be interpreted in binary form. The bits have the following meaning:  
Bit 0: Incompatible OA interface version.  
Bit 1: OA application could not be loaded.  
Bit 2: Incorrect description files.  
Bit 3: OA application does not define a CPU type.  
Bit 4: OA application for this device not supported (incorrect CPU type).  
Bit 5: OA application for this device not supported (incorrect type ID).  
Bit 6: Incorrect description files (Const/Startup incompatible).

**r7758[0...19]      KHP Control Unit serial number / KHP CU ser\_no**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned8	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the actual serial number of the Control Unit.  
The individual characters of the serial number are displayed in the ASCII code in the indices.  
For the commissioning software, the ASCII characters are displayed uncoded.

**Dependency:** Refer to: p7765, p7766, p7767, p7768

**Notice:** An ASCII table (excerpt) can be found, for example, in the appendix to the List Manual.

**Note:** KHP: Know-How Protection

**p7759[0...19]      KHP Control Unit reference serial number / KHP CU ref ser\_no**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned8	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Sets the reference serial number for the Control Unit.  
Using this parameter, if a Control Unit and/or a memory card is replaced at the end customer, the OEM can again adapt the project to the modified hardware.

**Dependency:** Refer to: p7765, p7766, p7767, p7768

**Note:** KHP: Know-How Protection

- The OEM may only change this parameter for the use case "Sending encrypted SINAMICS data".  
- SINAMICS only evaluates this parameter when powering up from the encrypted "Load into file system..." output or when powering up from the encrypted PS files. The evaluation is only made when know-how protection and memory card copy protection have been activated.

<b>r7760</b>	<b>Write protection/know-how protection status / Wr_prot/KHP stat</b>				
All objects	<b>Can be changed:</b> -	<b>Calculated:</b> -		<b>Access level:</b> 3	
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -		<b>Func. diagram:</b> -	
	<b>P-Group:</b> -	<b>Units group:</b> -		<b>Unit selection:</b> -	
	<b>Not for motor type:</b> -	<b>Scaling:</b> -		<b>Expert list:</b> 1	
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>		
-	-	-			
<b>Description:</b>	Displays the status for the write protection and know-how protection.				
<b>Bit field:</b>	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>	<b>FP</b>
	00	Write protection active	Yes	No	-
	01	Know-how protection active	Yes	No	-
	02	Know-how protection temporarily withdrawn	Yes	No	-
	03	Know-how protection cannot be deactivated	Yes	No	-
	04	Memory card copy protection active	Yes	No	-
<b>Dependency:</b>	Refer to: p7761, p7765, p7766, p7767, p7768				
<b>Note:</b>	KHP: Know-How Protection				
	Re bit 00:				
	Write protection can be activated/deactivated via p7761 on the Control Unit.				
	Re bit 01:				
	The know-how protection can be activated by entering a password (p7766 ... p7768).				
	Re bit 02:				
	If it has already been activated, know-how protection can be temporarily deactivated by entering the valid password in p7766. In this case, bit 1 = 0 and bit 2 = 1 offset.				
	Re bit 03:				
	Know-how protection cannot be deactivated, as p7766 is not entered in the OEM exception list (only the factory setting is possible). This bit is only set if know-how protection is active (bit 1 = 1) and p7766 has not been entered in the OEM exception list.				
	Re bit 04:				
	When know-how protection has been activated, the contents of the memory card (parameter and DCC data) can be additionally protected against being used with other memory cards. This bit is only set if know-how protection is active and p7765 = 1.				

<b>p7761</b>	<b>Write protection / Write protection</b>				
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -		<b>Access level:</b> 3	
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -		<b>Func. diagram:</b> -	
	<b>P-Group:</b> -	<b>Units group:</b> -		<b>Unit selection:</b> -	
	<b>Not for motor type:</b> -	<b>Scaling:</b> -		<b>Expert list:</b> 1	
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>		
0	1	0			
<b>Description:</b>	Setting for activating/de-activating the write protection for adjustable parameters.				
<b>Value:</b>	0: Deactivate write protection 1: Activate write protection				
<b>Dependency:</b>	Refer to: r7760				
<b>Notice:</b>	While write protection is active, a download is prevented; however, it is still possible to restore the factory settings.				
<b>Note:</b>	Parameters with the "WRITE_NO_LOCK" attributes are excluded from the write protection. A product-specific list of these parameters is also available in the corresponding List Manual.				

<b>p7762</b>	<b>Write protection multi-master fieldbus system access behavior / Fieldbus acc_behav</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 1	<b>Factory setting</b> 0
<b>Description:</b>	Sets the behavior for write protection when accessing via multi-master fieldbus systems (e.g. CAN, BACnet).		
<b>Value:</b>	0: Write access independent of p7761 1: Write access dependent on p7761		
<b>Dependency:</b>	Refer to: r7760, p7761		

<b>p7763</b>	<b>KHP OEM exception list number of indices for p7764 / KHP OEM qty p7764</b>		
All objects	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 1	<b>Max</b> 500	<b>Factory setting</b> 1
<b>Description:</b>	Sets the number of parameters for the OEM exception list (p7764[0...n]). p7764[0...n], with n = p7763 - 1		
<b>Dependency:</b>	Refer to: p7764		
<b>Note:</b>	KHP: Know-How Protection Even if know-how protection is set, parameters in this list can be read and written to.		

<b>p7764[0...n]</b>	<b>KHP OEM exception list / KHP OEM excep list</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> p7763	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 65535	<b>Factory setting</b> [0] 7766 [1...499] 0
<b>Description:</b>	OEM exception list (p7764[0...n]) for setting parameters that should be excluded from know-how protection. p7764[0...n], with n = p7763 - 1		
<b>Dependency:</b>	The number of indices depends on p7763. Refer to: p7763		
<b>Note:</b>	KHP: Know-How Protection Even if know-how protection is set, parameters in this list can be read and written to.		

<b>p7764[0...n]</b>	<b>KHP OEM exception list / KHP OEM excep list</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150, TM15DI_DO, TM31	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> p7763	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 65535	<b>Factory setting</b> 0
<b>Description:</b>	OEM exception list (p7764[0...n]) for setting parameters that should be excluded from know-how protection. p7764[0...n], with n = p7763 - 1		
<b>Dependency:</b>	The number of indices depends on p7763. Refer to: p7763		

**Note:** KHP: Know-How Protection  
Even if know-how protection is set, parameters in this list can be read and written to.

<b>p7765 KHP memory card copy protection / KHP copy protect</b>			
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Setting for activating/de-activating copy protection for the memory card. This means that the OEM can define whether the parameters and DCC data encrypted on the memory card should be protected before using on other memory cards.		
<b>Value:</b>	0: Deactivating protection 1: Activating protection		
<b>Dependency:</b>	Refer to: p7766, p7767, p7768		
<b>Note:</b>	KHP: Know-How Protection The memory card copy protection is only effective when the know-how protection has been activated.		

<b>p7766[0...29] KHP password input / KHP passw input</b>			
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0 <b>Factory setting</b> -
<b>Description:</b>	Sets the password for know-how protection. Example of a password: 123aBc = 49 50 51 97 66 99 dec (ASCII characters) [0] = character 1 (e.g. 49 dec) [1] = character 2 (e.g. 50 dec) ... [5] = character 6 (e.g. 99 dec) [29] = 0 dec (completes the entry)		
<b>Dependency:</b>	Refer to: p7767, p7768		
<b>Notice:</b>	An ASCII table (excerpt) can be found, for example, in the appendix to the List Manual. When using the STARTER commissioning software, the password should be entered using the associated dialogs. The following rules apply when entering the password: - Password entry must start with p7766[0]. - No gaps are permissible in the password. - Entering a password is completed when writing to p7766[29] (p7766[29] = 0 for passwords less than 30 characters).		
<b>Note:</b>	KHP: Know-How Protection When reading, p7766[0...29] = 42 dec (ASCII character = "***") is displayed. Parameters with the "KHP_WRITE_NO_LOCK" attribute are not involved in the know-how protection. Parameters with the "KHP_ACTIVE_READ" attribute can be read even when know-how protection is activated. A product-specific list of these parameters is also available in the corresponding List Manual.		

<b>p7767[0...29]</b>	<b>KHP password new / KHP passw new</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0 <b>Factory setting</b> -
<b>Description:</b>	Sets the new password for know-how protection.		
<b>Dependency:</b>	Refer to: p7766, p7768		
<b>Note:</b>	KHP: Know-How Protection When reading, p7767[0...29] = 42 dec (ASCII character = "***") is displayed.		
<b>p7768[0...29]</b>	<b>KHP password confirmation / KHP passw confirm</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0 <b>Factory setting</b> -
<b>Description:</b>	Confirms the new password for know-how protection.		
<b>Dependency:</b>	Refer to: p7766, p7767		
<b>Note:</b>	KHP: Know-How Protection When reading, p7768[0...29] = 42 dec (ASCII character = "***") is displayed.		
<b>p7769[0...20]</b>	<b>KHP memory card reference serial number / KHP mem ref ser_no</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> T <b>Data type:</b> Unsigned8 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Sets the reference serial number for the memory card. Using this parameter, if a Control Unit and/or a memory card is replaced at the end customer, the OEM can again adapt the project to the modified hardware.		
<b>Dependency:</b>	Refer to: p7765, p7766, p7767, p7768		
<b>Note:</b>	KHP: Know-How Protection - The OEM may only change this parameter for the use case "Sending encrypted SINAMICS data". - SINAMICS only evaluates this parameter when powering up from the encrypted "Load into file system..." output or when powering up from the encrypted PS files. The evaluation is only made when know-how protection and memory card copy protection have been activated.		
<b>p7770</b>	<b>NVRAM action / NVRAM action</b>		
TM150, TM15DI_DO, TM31	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 3	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the action to be executed for NVRAM data. At the end of the action the value is automatically set to 0.		



<b>Value:</b>	0: Inactive 1: Load NVRAM data to parameters 2: Load parameters to NVRAM 3: Reset
<b>Notice:</b>	After action p7770 = 1 no more pulses may be enabled. After action p7770 = 2, it is essential that parameters are backed up (p0977 = 1) and that a warm restart is then performed (p0009 = 30, p0976 = 2, 3). This will apply the values written.
<b>Note:</b>	If value = 1: This action loads the NVRAM data to the parameters. If value = 2: This action loads the parameters to the NVRAM. If value = 3: This action sets parameters p7771 ... p7774 to the factory setting. It is recommended to avoid placing unnecessary load on the subsequent upload/download operation.

<b>p7775</b>	<b>NVRAM data backup/import/delete / NVRAM backup</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> C1, U, T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 17	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Setting to backup/import/delete NVRAM data. NVRAM data are non-volatile data in the device (e.g. fault buffer). For NVRAM data actions, the following data are excluded: - Crash diagnostics - CU operating hours counter - CU temperature - Safety logbook		
<b>Value:</b>	0: Inactive 1: NVRAM data backup to memory card 2: Import NVRAM data from the memory card 3: Delete NVRAM data in the device 10: Error when clearing 11: Error when backing up, memory card not available 12: Error when backing up, insufficient memory space 13: Error when backing up 14: Error when importing, memory card not available 15: Error when importing, checksum error 16: Error when importing, no NVRAM data available 17: Error when importing		
<b>Notice:</b>	Re value = 2, 3: These actions are only possible when pulses are inhibited.		
<b>Note:</b>	After the action has been successfully completed, the parameter is automatically set to zero. The actions importing and deleting NVRAM data immediately initiate a warm restart. If the procedure was not successfully completed, then an appropriate fault value is displayed (p7775 >= 10).		

<b>p7820</b>	<b>DRIVE-CLiQ component component number / DQ compo_no</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 65535	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the component number of the DRIVE-CLiQ component whose parameters are to be accessed.		

**Dependency:** Refer to: p7821, p7822, r7823

<b>p7821</b>	<b>DRIVE-CLiQ component parameter number / DQ para_no</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 65535	<b>Factory setting</b> 0
<b>Description:</b>	Sets the parameter number to access a parameter of a DRIVE-CLiQ component.		
<b>Dependency:</b>	Refer to: p7820, p7822, r7823		

<b>p7822</b>	<b>DRIVE-CLiQ component parameter index / DQ para_index</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 65535	<b>Factory setting</b> 0
<b>Description:</b>	Sets the parameter index to access a parameter of a DRIVE-CLiQ component.		
<b>Dependency:</b>	Refer to: p7820, p7821, r7823		

<b>r7823</b>	<b>DRIVE-CLiQ component read parameter value / Read DQ value</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> -
<b>Description:</b>	Displays the parameter value read from the DRIVE-CLiQ component.		
<b>Dependency:</b>	Refer to: p7820, p7821, p7822		

<b>r7825[0...6]</b>	<b>DRIVE-CLiQ component versions / DQ version</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> -
<b>Description:</b>	Displays the firmware and EPROM versions of the DRIVE-CLiQ component selected using p7828[1].		
<b>Index:</b>	[0] = Reference firmware version [1] = Actual firmware version [2] = EPROM0 version [3] = EPROM1 version [4] = EPROM2 version [5] = EPROM3 version [6] = EPROM4 version		
<b>Dependency:</b>	Refer to: p7828		
<b>Note:</b>	Reference firmware version: Version on the memory card/device memory. Current firmware version: Actual version of the DRIVE-CLiQ component. EPROM version: Current EPROM version of the DRIVE-CLiQ component.		

<b>p7826</b>	<b>Firmware update automatic / FW update auto</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 2	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Sets the behavior for the automatic firmware update of the DRIVE-CLiQ components.		
<b>Value:</b>	0: De-activated 1: Upgrade and downgrade 2: Upgrade		
<b>Notice:</b>	If this parameter is changed, it only becomes effective the next time that the drive system boots.		
<b>Note:</b>	The firmware is automatically updated when the system boots. The boot can take several minutes. After the update has been completed, it is necessary to carry out a new POWER ON (power-down/power-up) for the components involved. The firmware update procedure is displayed as follows: Control Unit (LED RDY): Flashes yellow with 0.5 Hz --> firmware is being updated. Flashing yellow with 2 Hz --> POWER ON is required for the components involved. Components involved: Flashing red/green with 0.5 Hz --> firmware is being updated. Flashing red/green with 2 Hz --> POWER ON of the components is required. Only components from firmware version 2.5 support the red/green flashing at 2 Hz.		
<b>r7827</b>	<b>Firmware update progress display / FW update progress</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> - [%]	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Displays the progress when updating the firmware of the DRIVE-CLiQ components.		
<b>p7828[0...1]</b>	<b>Firmware download component number / FW downl comp_no</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 399	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the component number for the required DRIVE-CLiQ component. Index 0: Component number of the DRIVE-CLiQ component for which a firmware download is to be made. Index 1: Component number of the DRIVE-CLiQ component for which the reference firmware version, saved in r7825 on the memory card/device memory, is to be displayed.		
<b>Index:</b>	[0] = Firmware download [1] = Reference firmware version		
<b>Dependency:</b>	Refer to: p0121, p0141, p0151, p7829		
<b>Note:</b>	For p7828[0] = 399, the firmware for all of the existing components is downloaded. The firmware download is started with p7829 = 1.		

<b>p7829</b>	<b>Activate firmware download / FW download act</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -1	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 999	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Activating the firmware download for the DRIVE-CLiQ components specified in p7828. 1: Activate download. -1: activate the download and carry out a reset. 0: Download successfully completed. > 1: Fault code 011: DRIVE-CLiQ component has detected a checksum error. 015: The selected DRIVE-CLiQ components did not accept the contents of the firmware file. 018: Firmware version is too old and is not accepted by the component. 019: Firmware version is not suitable for the hardware release of the component. 101: After several communication attempts, no response from the DRIVE-CLiQ component. 140: Firmware file for the DRIVE-CLiQ component not available on the memory card/device memory. 143: Component has not changed to the mode for firmware download. It was not possible to delete the existing firmware. 144: When checking the firmware that was downloaded (checksum), the component detected a fault. It is possible that the file on the memory card/device memory is defective. 145: Checking the loaded firmware (checksum) was not completed by the component in the appropriate time. 156: Component with the specified component number is not available. Additional values: Only for internal Siemens troubleshooting.		
<b>Dependency:</b>	Refer to: p7828		
<b>Note:</b>	p7829 is automatically set to 0 after the firmware has been successfully downloaded. The new firmware only becomes active at the next system run-up.		
<b>p7830</b>	<b>Telegram diagnostics selection / Telegr diag sel</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 3	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Selects a telegram whose contents should be shown in r7831 ... r7836.		
<b>Value:</b>	0: Reserved 1: First cyclic receive telegram sensor 1 2: First cyclic receive telegram sensor 2 3: First cyclic receive telegram sensor 3		
<b>Dependency:</b>	Refer to: r7831, r7832, r7833, r7834, r7835, r7836		
<b>r7831[0...15]</b>	<b>Telegram diagnostics signals / Telegr diag sig</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 15157	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the signals contained in the selected telegram (p7830).		

Value:	0:	UNUSED
	1:	UNKNOWN
	102:	SAPAR_ID_DSA_ALARM
	110:	SAPAR_ALARMBITS_FLOAT_0
	111:	SAPAR_ALARMBITS_FLOAT_1
	112:	SAPAR_ALARMBITS_FLOAT_2
	113:	SAPAR_ALARMBITS_FLOAT_3
	114:	SAPAR_ALARMBITS_FLOAT_4
	115:	SAPAR_ALARMBITS_FLOAT_5
	10500:	ENC_ID_TIME_PRETRIGGER
	10501:	ENC_ID_TIME_SEND_TELEG_1
	10502:	ENC_ID_TIME_CYCLE_FINISHED
	10503:	ENC_ID_TIME_DELTA_FUNMAN
	10504:	ENC_ID_SUBTRACE_CALCTIMES
	10505:	ENC_ID_SYNO_PERIOD
	10516:	ENC_ID_ADC_TRACK_A
	10517:	ENC_ID_ADC_TRACK_B
	10518:	ENC_ID_ADC_TRACK_C
	10519:	ENC_ID_ADC_TRACK_D
	10520:	ENC_ID_ADC_TRACK_A_SAFETY
	10521:	ENC_ID_ADC_TRACK_B_SAFETY
	10523:	ENC_ID_ADC_TEMP_1
	10524:	ENC_ID_SUBTRACE_TRACK_A
	10525:	ENC_ID_SUBTRACE_TRACK_B
	10526:	ENC_ID_ADC_TRACK_R
	10532:	ENC_ID_TRACK_AB_X
	10533:	ENC_ID_TRACK_AB_Y
	10534:	ENC_ID_OFFSET_CORR_AB_X
	10535:	ENC_ID_OFFSET_CORR_AB_Y
	10536:	ENC_ID_AB_ABS_VALUE
	10537:	ENC_ID_TRACK_CD_X
	10538:	ENC_ID_TRACK_CD_Y
	10539:	ENC_ID_TRACK_CD_ABS
	10542:	ENC_ID_AB_RAND_X
	10543:	ENC_ID_AB_RAND_Y
	10544:	ENC_ID_AB_RAND_ABS_VALUE
	10545:	ENC_ID_SUBTRACE_ABS_ARRAY
	10546:	ENC_ID_PROC_OFFSET_0
	10547:	ENC_ID_PROC_OFFSET_4
	10550:	ENC_ID_SUBTRACE_AMPL
	10564:	ENC_SELFTEMP_ACT
	10565:	ENC_ID_MOTOR_TEMP_TOP
	10566:	ENC_ID_MOTOR_TEMP_1
	10580:	ENC_ID_RESISTANCE_1
	10590:	ENC_ID_ANA_CHAN_A
	10591:	ENC_ID_ANA_CHAN_B
	10592:	ENC_ID_ANA_CHAN_X
	10593:	ENC_ID_ANA_CHAN_Y
	10596:	ENC_ID_AB_ANGLE
	10597:	ENC_ID_CD_ANGLE
	10598:	ENC_ID_MECH_ANGLE_HI
	10599:	ENC_ID_RM_POS_PHI_COMMU
	10600:	ENC_ID_PHI_COMMU
	10601:	ENC_ID_SUBTRACE_ANGLE
	10612:	ENC_ID_DIFF_CD_INC
	10613:	ENC_ID_RM_POS_PHI_COMMU_RFG
	10628:	ENC_ID_MECH_ANGLE
	10629:	ENC_ID_MECH_RM_POS
	10644:	ENC_ID_INIT_VECTOR
	10645:	FEAT_INIT_VECTOR
	10660:	ENC_ID_SENSOR_STATE
	10661:	ENC_ID_BASIC_SYSTEM
	10662:	ENC_ID_REFMARK_STATUS
	10663:	ENC_ID_DSA_STATUS1_SENSOR

10664: ENC\_ID\_DSA\_RMSTAT\_HANDSHAKE  
 10665: ENC\_ID\_DSA\_CONTROL1\_SENSOR  
 10667: ENC\_ID\_SAFETY  
 10669: ENC\_ID\_SUB\_STATE  
 10676: ENC\_ID\_COUNTCORR\_SAW\_VALUE  
 10677: ENC\_ID\_COUNTCORR\_ABS\_VALUE  
 10678: ENC\_ID\_SAWTOOTH\_CORR  
 10680: ENC\_ID\_SM\_XIST1\_CORRECTED\_QUADRANTS  
 10692: ENC\_ID\_RESISTANCE\_CALIB\_INSTANT  
 10693: ENC\_ID\_SERPROT\_POS  
 10723: ENC\_ID\_ACT\_STATEMACHINE\_FUNCTION  
 10724: ENC\_ID\_ACT\_FUNMAN\_FUNCTION  
 10725: ENC\_ID\_SAFETY\_COUNTER\_CRC  
 10728: ENC\_ID\_SUBTRACE\_AREA  
 10740: ENC\_ID\_POS\_ABSOLUTE  
 10741: ENC\_ID\_POS\_REFMARK  
 10742: ENC\_ID\_SAWTOOTH  
 10743: ENC\_ID\_SAFETY\_PULSE\_COUNTER  
 10745: ENC\_ID\_EIU\_ZEROCTRL  
 10756: ENC\_ID\_DSA\_ACTUAL\_SPEED  
 10757: ENC\_ID\_SPEED\_DEV\_ABS  
 10772: ENC\_ID\_DSA\_POS\_XIST1  
 10788: ENC\_ID\_AB\_CROSS\_CORR  
 10789: ENC\_ID\_AB\_GAIN\_Y\_CORR  
 10790: ENC\_ID\_AB\_PEAK\_CORR  
 11825: ENC\_ID\_RES\_TRANSITION\_RATIO  
 11826: ENC\_ID\_RES\_PHASE\_SHIFT  
 15150: ENC\_ID\_SPINDLE\_S1\_RAW  
 15151: ENC\_ID\_SPINDLE\_S4\_RAW  
 15152: ENC\_ID\_SPINDLE\_S5\_RAW  
 15155: ENC\_ID\_SPINDLE\_S1\_CAL  
 15156: ENC\_ID\_SPINDLE\_S4\_CAL  
 15157: ENC\_ID\_SPINDLE\_S5\_CAL

<b>r7832[0...15] Telegram diagnostics numerical format / Telegr diag format</b>			
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -1	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 14	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the original numerical format of the signals contained in the telegram. The associated signal number is represented in the appropriate index of r7831.		
<b>Value:</b>	-1: Unknown 0: Boolean 1: Signed 1 byte 2: Signed 2 byte 3: Signed 4 byte 4: Signed 8 byte 5: Unsigned 1 byte 6: Unsigned 2 byte 7: Unsigned 4 byte 8: Unsigned 8 byte 9: Float 4 byte 10: Double 8 byte 11: mm dd yy HH MM SS MS DOW 12: ASCII string 13: SINUMERIK frame type 14: SINUMERIK axis type		
<b>Dependency:</b>	Refer to: r7831		

<b>r7833[0...15]</b>	<b>Telegram diagnostics unsigned / Telegr diag unsign</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Parameter to display a DSA signal in the unsigned-integer format.  
The associated signal number is represented at the appropriate index in r7831.

<b>r7834[0...15]</b>	<b>Telegram diagnostics signed / Telegr diag sign</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Integer32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Parameter to display a DSA signal in the signed-integer format.  
The associated signal number is represented at the appropriate index in r7831.

<b>r7835[0...15]</b>	<b>Telegram diagnostics real / Telegr diag real</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Parameter to display a DSA signal in the float format.  
The associated signal number is represented at the appropriate index in r7831.

<b>r7836[0...15]</b>	<b>Telegram diagnostics unit / Telegr diag unit</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-1	147	-

**Description:** Displays the units of a DSA signal.  
The associated signal number is represented at the appropriate index in r7831.

**Value:**

- 1: Unknown
- 0: None
- 1: Millimeter or degrees
- 2: Millimeter
- 3: Degrees
- 4: mm/min or RPM
- 5: Millimeter / min
- 6: Revolutions / min
- 7: m/sec^2 or U/sec^2
- 8: m/sec^2
- 9: U/sec^2
- 10: m/sec^3 or U/sec^3
- 11: m/sec^3
- 12: U/sec^3
- 13: sec

List of parameters

---

14:	16.667 / sec
15:	mm/revolution
16:	ACX_UNIT_COMPENSATION_CORR
18:	Newton
19:	Kilogram
20:	Kilogram meter^2
21:	Percent
22:	Hertz
23:	Volt peak-to-peak
24:	Amps peak-to-peak
25:	Degrees Celsius
26:	Degrees
28:	Millimeter or degrees
29:	Meters / minute
30:	Meters / second
31:	ohm
32:	Millihenry
33:	Newton meter
34:	Newton meter/Ampere
35:	Volt/Ampere
36:	Newton meter second / rad
38:	31.25 microseconds
39:	Microseconds
40:	Milliseconds
42:	Kilowatt
43:	Micro amps peak-to-peak
44:	Volt seconds
45:	Microvolt seconds
46:	Micro newton meters
47:	Amps / volt seconds
48:	Per mille
49:	Hertz / second
53:	Micrometer or millidegrees
54:	Micrometer
55:	Millidegrees
59:	Nanometer
61:	Newton/Amps
62:	Volt seconds/meter
63:	Newton seconds/meter
64:	Micronewton
65:	Liters / minute
66:	Bar
67:	Cubic centimeters
68:	Millimeter / volt minute
69:	Newton/Volt
80:	Millivolts peak-to-peak
81:	Volt rms
82:	Millivolts rms
83:	Amps rms
84:	Micro amps rms
85:	Micrometers / revolution
90:	Tenths of a second
91:	Hundredths of a second
92:	10 microseconds
93:	Pulses
94:	256 pulses
95:	Tenths of a pulse
96:	Revolutions
97:	100 revolutions / minute
98:	10 revolutions / minute
99:	0.1 revolutions / minute
100:	Thousandth revolution / minute
101:	Pulses / second
102:	100 pulses / second



103:	10 revolutions / (minute x seconds)
104:	10000 pulses/second^2
105:	0.1 Hertz
106:	0.01 Hertz
107:	0.1 / seconds
108:	Factor 0.1
109:	Factor 0.01
110:	Factor 0.001
111:	Factor 0.0001
112:	0.1 Volt peak-to-peak
113:	0.1 Volt peak-to-peak
114:	0.1 amps peak-to-peak
115:	Watt
116:	100 Watt
117:	10 Watt
118:	0.01 percent
119:	1/second^3
120:	0.01 percent/millisecond
121:	Pulses / revolution
122:	Microfarads
123:	Milliohm
124:	0.01 Newton meter
125:	Kilogram millimeter^2
126:	Rad / (seconds newton meter)
127:	Henry
128:	Kelvin
129:	Hours
130:	Kilohertz
131:	Milliamperes peak-to-peak
132:	Millifarads
133:	Meter
135:	Kilowatt hours
136:	Percent
137:	Amps / Volt
138:	Volt
139:	Millivolts
140:	Microvolts
141:	Amps
142:	Milliamperes
143:	Micro amps
144:	Milliamperes rms
145:	Millimeter
146:	Nanometer
147:	Joules

<b>r7843[0...20]</b>	<b>Memory card serial number / Mem_card ser.no</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned8	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays the actual serial number of the memory card. The individual characters of the serial number are displayed in the ASCII code in the indices.		
<b>Dependency:</b>	Refer to: p9920, p9921		
<b>Notice:</b>	An ASCII table (excerpt) can be found, for example, in the appendix to the List Manual.		
<b>Note:</b>	Example: displaying the serial number for a memory card: r7843[0] = 49 dec --> ASCII characters = "1" --> serial number, character 1 r7843[1] = 49 dec --> ASCII characters = "1" --> serial number, character 2 r7843[2] = 49 dec --> ASCII characters = "1" --> serial number, character 3		

r7843[3] = 57 dec --> ASCII characters = "9" --> serial number, character 4  
 r7843[4] = 50 dec --> ASCII characters = "2" --> serial number, character 5  
 r7843[5] = 51 dec --> ASCII characters = "3" --> serial number, character 6  
 r7843[6] = 69 dec --> ASCII characters = "E" --> serial number, character 7  
 r7843[7] = 0 dec --> ASCII characters = " " --> serial number, character 8  
 ...  
 r7843[19] = 0 dec --> ASCII characters = " " --> serial number, character 20  
 r7843[20] = 0 dec  
 Serial number = 111923E

<b>r7844[0...2]</b>	<b>Device memory firmware version / Dev_mem FW</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 1 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the version of the firmware stored on the device memory.		
<b>Index:</b>	[0] = Internal [1] = External [2] = Parameter backup		
<b>Note:</b>	Re index 0: Displays the internal firmware version (e.g. 01402315). This firmware version is the version of the device memory and not the CU firmware (r0018), however, normally they have the same versions. Re index 1: Displays the external firmware version (e.g. 01040000 -> 1.4). Re index 2: Displays the internal CU firmware version (r0018) of the parameter backup. With this CU firmware version, the parameter backup was saved, which was used when powering up.		
<b>r7850[0...23]</b>	<b>Drive object operational/not operational / DO ready for oper</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> - <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -32786	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 32767	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays whether, for an activated drive object, all activated topology components are available or not (or whether these can be addressed). 0: Drive object not ready for operation 1: Drive object ready for operation		
<b>p7852</b>	<b>Number of indices for r7853 / Qty indices r7853</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 1	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 200	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Displays the number of indices for r7853[0...n]. This corresponds to the number of DRIVE-CLiQ components that are in the target topology.		
<b>Dependency:</b>	Refer to: r7853		

**Note:** The values are valid if all available Control Units adopt the "Initialization finished" state (r3988 = 800) following power-up.

<b>r7853[0...n]</b>	<b>Component available/not available / Comp present</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0000 hex	<b>Calculated:</b> - <b>Dyn. index:</b> p7852 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> FFFF hex	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the component and whether this component is currently present. High byte: Component number Low byte: 0/1 (not available/available)		
<b>Dependency:</b>	Refer to: p7852		
<b>Note:</b>	The values are valid if all available Control Units adopt the "Initialization finished" state (r3988 = 800) following power-up.		
<b>p7857</b>	<b>Sub-boot mode / Sub-boot mode</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150, TM15DI_DO, TM31	<b>Can be changed:</b> U, T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Sets the mode for the sub-boot.		
<b>Value:</b>	0: Sub-boot manual 1: Sub-boot automatic		
<b>Note:</b>	For p7857 = 0 (manual sub-boot) the following applies: The parameter should be set to 1 to start the sub-boot.		
<b>p7859[0...199]</b>	<b>Component number global / Comp_nr global</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -32786	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 32767	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0 <b>Factory setting</b> 0
<b>Description:</b>	Sets the global and unique component number in a drive system with several Control Units. Each index of the parameter corresponds to a possible local component number on the corresponding Control Unit. The indices are allocated to the global component numbers as follows: p7859[0]: Not used p7859[1]: Sets the global component number for the local component number 1 p7859[2]: Sets the global component number for the local component number 2 ... p7859[199]: Sets the global component number for the local component number 199		
<b>Notice:</b>	This parameter is preferably set via suitable commissioning software (e.g. UpdateAgent, STARTER, SCOUT). Changing the parameter via the AOP (Advanced Operator Panel) or BOP (Basic Operator Panel) can destroy a valid unique setting.		
<b>Note:</b>	The parameter is not influenced by setting the factory setting.		

**r7867      Status/configuration changes global / Changes global**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays status and configuration changes of all of the drive objects in the complete unit.  
When changing the status or the configuration of the Control Unit or a drive object, the value of this parameter is incremented.

**Dependency:** Refer to: r7868, r7869, r7870

**r7868[0...24]      Configuration changes drive object reference / Config\_chng DO ref**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Reference to the drive objects whose configuration has changed.  
Index 0:  
When changing one of the following indices, then the value in this index is increased.  
Index 1...n:  
The drive object with object number in p0101[n-1] has changed its configuration.  
Example:  
r7868[3] was incremented since the last time it was read.  
--> the configuration of the drive object with object number in p0101[2] was changed.

**Index:** [0] = Sum of the following indices  
[1] = Object number in p0101[0]  
[2] = Object number in p0101[1]  
[3] = Object number in p0101[2]  
[4] = Object number in p0101[3]  
[5] = Object number in p0101[4]  
[6] = Object number in p0101[5]  
[7] = Object number in p0101[6]  
[8] = Object number in p0101[7]  
[9] = Object number in p0101[8]  
[10] = Object number in p0101[9]  
[11] = Object number in p0101[10]  
[12] = Object number in p0101[11]  
[13] = Object number in p0101[12]  
[14] = Object number in p0101[13]  
[15] = Object number in p0101[14]  
[16] = Object number in p0101[15]  
[17] = Object number in p0101[16]  
[18] = Object number in p0101[17]  
[19] = Object number in p0101[18]  
[20] = Object number in p0101[19]  
[21] = Object number in p0101[20]  
[22] = Object number in p0101[21]  
[23] = Object number in p0101[22]  
[24] = Object number in p0101[23]

**Dependency:** Refer to: p0101, r7867, r7871

<b>r7869[0...24]</b>	<b>Status changes drive object reference / Status_chng DO ref</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Reference to the drive objects whose status has changed. Index 0: When changing one of the following indices, then the value in this index is increased. Index 1...n: The drive object with object number in p0101[n-1] has changed its status. Example: r7868[3] was incremented since the last time it was read. --> the status of the drive object with object number in p0101[2] was changed.		
<b>Index:</b>	[0] = Sum of the following indices [1] = Object number in p0101[0] [2] = Object number in p0101[1] [3] = Object number in p0101[2] [4] = Object number in p0101[3] [5] = Object number in p0101[4] [6] = Object number in p0101[5] [7] = Object number in p0101[6] [8] = Object number in p0101[7] [9] = Object number in p0101[8] [10] = Object number in p0101[9] [11] = Object number in p0101[10] [12] = Object number in p0101[11] [13] = Object number in p0101[12] [14] = Object number in p0101[13] [15] = Object number in p0101[14] [16] = Object number in p0101[15] [17] = Object number in p0101[16] [18] = Object number in p0101[17] [19] = Object number in p0101[18] [20] = Object number in p0101[19] [21] = Object number in p0101[20] [22] = Object number in p0101[21] [23] = Object number in p0101[22] [24] = Object number in p0101[23]		
<b>Dependency:</b>	Refer to: p0101, r7867, r7872		
<b>r7870[0...7]</b>	<b>Configuration changes global / Config_chng global</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the configuration changes of all of the drive objects in the complete unit.		
<b>Index:</b>	[0] = Sum of the following indices [1] = r7871[0] of a drive object [2] = p0101 or r0102 [3] = PROFIBUS configuration (p0978) [4] = DRIVE-CLiQ actual topology (r9900 or r9901) [5] = DRIVE-CLiQ target topology (r9902 or r9903)		

	[6] = DRIVE-CLiQ ports (p0109)
	[7] = OA applications
<b>Dependency:</b>	Refer to: r7867, r7871
<b>Note:</b>	Index 0: When changing one of the following indices, then the value in this index is incremented. Index 1: Drive object configuration. When changing r7871[0] on a drive object, the value in this index is incremented. Index 2: Drive object, configuration unit. When changing either p0101 or r0102, the value in this index is incremented. Index 3: PROFIBUS configuration unit. When changing p0978, the value in this index is incremented. Index 4: DRIVE-CLiQ actual topology. When changing either r9900 or r9901, the value in this index is incremented. Index 5: DRIVE-CLiQ target topology. When changing either p9902 or p9903, the value in this index is incremented. Index 6: DRIVE-CLiQ ports. When changing p0109, the value in this index is incremented. Index 7: OA applications. When changing OA applications, the value in this index is incremented.

---

<b>r7871[0...15]</b>	<b>Configuration changes drive object / Config_chng DO</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S, TM150, TM15DI_DO, TM31	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the configuration changes on the drive object.

**Index:**

- [0] = Sum of the following indices
- [1] = p0010, p0107 or p0108
- [2] = Drive object name (p0199)
- [3] = Structure-relevant parameters (e.g. p0180)
- [4] = BICO interconnections
- [5] = Activate/de-activate drive object
- [6] = Data backup required
- [7] = Reserved
- [8] = Reference or changeover parameters (e.g. p2000)
- [9] = Parameter count through Drive Control Chart (DCC)
- [10] = p0107 or p0108
- [11] = Reserved
- [12] = Write protection and know-how protection status
- [13] = Reserved
- [14] = Reserved
- [15] = Reserved

**Dependency:** Refer to: r7868, r7870

**Note:**

- Re index 0:  
When changing one of the following indices, then the value in this index is incremented.
- Re index 1:  
Drive object commissioning: When changing p0010, p0107 or p0108, the value in this index is incremented.
- Re index 2:  
Drive object name. When changing p0199, the value in this index is incremented.
- Re index 3:  
Drive object structure. When changing a parameter that is relevant for the structure (e.g. number of data sets), the value in this index is incremented.
- Re index 4:  
Drive object BICO interconnections. When changing r3977, the value in this index is incremented.

Re index 5:  
Drive object activity: When changing p0105, the value in this index is incremented.

Re index 6:  
Drive object, data save.  
0: There are no parameter changes to save.  
1: There are parameter changes to save.

Re index 8:  
Drive object changeover of units. When changing reference or changeover parameters (e.g. p2000, p0304), the value in this index is incremented.

Re index 9:  
Drive object parameter count. When changing the number of parameters by loading Drive Control Chart (DCC), the value in this index is incremented.

Re index 10:  
Drive object configuration. When changing either p0107 or p0108, the value in this index is incremented.

Re index 12:  
Drive object configuration. When activating/deactivating write protection or know-how protection, the value in this index is incremented.

<b>r7871[0...15] Configuration changes drive object / Config_chng DO</b>			
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the configuration changes on the drive object.		
<b>Index:</b>	[0] = Sum of the following indices [1] = p0010, p0107 or p0108 [2] = Drive object name (p0199) [3] = Structure-relevant parameters (e.g. p0180) [4] = BICO interconnections [5] = Activate/de-activate drive object [6] = Data backup required [7] = Activate/de-activate component [8] = Reference or changeover parameters (e.g. p2000) [9] = Parameter count through Drive Control Chart (DCC) [10] = p0107 or p0108 [11] = Reserved [12] = Write protection and know-how protection status [13] = Reserved [14] = Reserved [15] = Enc type (p0400)		
<b>Dependency:</b>	Refer to: r7868, r7870		
<b>Note:</b>	Re index 0: When changing one of the following indices, then the value in this index is incremented. Re index 1: Drive object commissioning: When changing p0010, p0107 or p0108, the value in this index is incremented. Re index 2: Drive object name. When changing p0199, the value in this index is incremented. Re index 3: Drive object structure. When changing a parameter that is relevant for the structure (e.g. number of data sets), the value in this index is incremented. Re index 4: Drive object BICO interconnections. When changing r3977, the value in this index is incremented. Re index 5: Drive object activity: When changing p0105, the value in this index is incremented.		

Re index 6:

Drive object, data save.

0: There are no parameter changes to save.

1: There are parameter changes to save.

Re index 7:

Drive object component activity: When changing either p0125 or p0145, the value in this index is incremented.

Re index 8:

Drive object changeover of units. When changing reference or changeover parameters (e.g. p2000, p0304), the value in this index is incremented.

Re index 9:

Drive object parameter count. When changing the number of parameters by loading Drive Control Chart (DCC), the value in this index is incremented.

Re index 10:

Drive object configuration. When changing either p0107 or p0108, the value in this index is incremented.

Re index 15:

Encoder configuration. When changing p0400, the value in this index is incremented.

---

<b>r7872[0...3]</b>	<b>Status changes drive object / Status_chng DO</b>		
All objects	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays the status changes on the drive object. Index 0: When changing one of the following indices, then the value in this index is incremented. Index 1: Drive object faults. When changing r0944, the value in this index is incremented. Index 2: Drive object alarms. When changing r2121, the value in this index is incremented. Index 3: Drive object safety messages. When changing r9744, the value in this index is incremented.		
<b>Index:</b>	[0] = Sum of the following indices [1] = Faults (r0944) [2] = Alarms (r2121) [3] = Safety messages (r9744)		
<b>Dependency:</b>	Refer to: r7869		

---

<b>p7900[0...23]</b>	<b>Drive objects priority / DO priority</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	65535	0
<b>Description:</b>	Sets the priority for processing the existing drive objects in the system. The parameter enables a free sequence to be set for processing the drive objects. For this purpose all the drive object numbers existing in the system have to be written in the desired sequence into the corresponding indices of the parameter. After re-booting this sequence will be effective without a plausibility check. With the factory setting the following priorities regarding processing are applicable: - The drive objects are pre-sorted according to type as follows: CU_DC, DC_CTRL, TM - If they are of the same type, they are sorted in ascending order according to their drive object number, i.e. the lower the number, the higher the priority for processing.		



**Index:**

- [0] = Drive object number Control Unit
- [1] = Drive object number object 1
- [2] = Drive object number object 2
- [3] = Drive object number object 3
- [4] = Drive object number object 4
- [5] = Drive object number object 5
- [6] = Drive object number object 6
- [7] = Drive object number object 7
- [8] = Drive object number object 8
- [9] = Drive object number object 9
- [10] = Drive object number object 10
- [11] = Drive object number object 11
- [12] = Drive object number object 12
- [13] = Drive object number object 13
- [14] = Drive object number object 14
- [15] = Drive object number object 15
- [16] = Drive object number object 16
- [17] = Drive object number object 17
- [18] = Drive object number object 18
- [19] = Drive object number object 19
- [20] = Drive object number object 20
- [21] = Drive object number object 21
- [22] = Drive object number object 22
- [23] = Drive object number object 23

**Notice:** This parameter may only be used by qualified service personnel.

**Note:** If the same drive object numbers are used and if the existing drive object numbers in the system are entered incompletely, the content of this parameter is ignored entirely. The behavior as with factory setting will then become effective.

---

#### **r7901[0...75]      Sampling times / t<sub>sample</sub>**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [µs]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> - [µs]	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [µs]
--	--	--	--

**Description:** Displays the sampling times currently present on the drive unit.  
 For r7901[x] = 0, the following applies:  
 The time slice is not active.

---

#### **r7903      Hardware sampling times still assignable / HW t<sub>samp</sub> free**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
--	--	---	---

**Description:** Displays the number of hardware sampling times that can still be assigned.  
 These free sampling times can be used by OA applications such as DCC (Drive Control Chart) or FBLOCKS (free function blocks).

**Note:** OA: Open Architecture

<b>p8550</b>	<b>AOP LOCAL/REMOTE / AOP LOCAL/REMOTE</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0000 0000 0000 1001 bin

**Description:** Setting for saving the actual configuration of the Advanced Operator Panel (AOP).

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	LOCAL save	Yes	No	-
	01	Start in LOCAL	Yes	No	-
	02	Change in oper.	Yes	No	-
	03	OFF acts like OFF1	Yes	No	-
	04	OFF acts like OFF2	Yes	No	-
	05	OFF acts like OFF3	Yes	No	-
	06	Reserved	Yes	No	-
	07	CW/CCW active	Yes	No	-
	08	Jog active	Yes	No	-
	09	Save speed setpoint	Yes	No	-
	14	Inhibit operation	Yes	No	-
	15	Inhibit parameterization	Yes	No	-

<b>r8570[0...39]</b>	<b>Macro drive object / Macro DO</b>		
All objects	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays the macro file saved in the appropriate directory on the memory card/device memory.		
<b>Dependency:</b>	Refer to: p0015		
<b>Note:</b>	For a value = 9999999, the following applies: The read operation is still running.		

<b>r8571[0...39]</b>	<b>Macro Binector Input (BI) / Macro BI</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays the ACX file saved in the appropriate directory in the non-volatile memory.		
<b>Dependency:</b>	Refer to: p0700		
<b>Note:</b>	For a value = 9999999, the following applies: The read operation is still running.		

<b>r8572[0...39]</b>	<b>Macro Connector Inputs (CI) for speed setpoints / Macro CI n_set</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays the ACX file saved in the appropriate directory in the non-volatile memory.		
<b>Dependency:</b>	Refer to: p1000		

**Note:** For a value = 9999999, the following applies: The read operation is still running.

<b>r8573[0...39]</b>	<b>Macro Connector Inputs (CI) for torque setpoints / Macro CI M_set</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays the ACX file saved in the appropriate directory in the non-volatile memory.		
<b>Dependency:</b>	Refer to: p1500		
<b>Note:</b>	For a value = 9999999, the following applies: The read operation is still running.		

<b>r8585</b>	<b>Macro execution actual / Macro executed</b>		
All objects	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays the macro currently being executed on the drive object.		
<b>Dependency:</b>	Refer to: p0015, p0700, p1000, p1500, r8570, r8571, r8572, r8573		

<b>p8811</b>	<b>SINAMICS Link project selection / SINAMICS Link proj</b>		
CU_DC (PROFINET), CU_DC_R (PROFINET), CU_DC_R_S (PROFINET), CU_DC_S (PROFINET)	<b>Can be changed:</b> C1(1)	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	16	64	64
<b>Description:</b>	Project selection for SINAMICS Link.		
<b>Value:</b>	16: SINAMICS Link project 16 participants 64: SINAMICS Link project 64 participants		
<b>Note:</b>	SINAMICS Link requires that the appropriate CBE20 firmware version is selected (p8835 = 3). The parameter must be set the same for all participants. A change only becomes effective after a POWER ON. The parameter is not influenced by setting the factory setting.		

<b>p8812[0...1]</b>	<b>SINAMICS Link settings / SINAMICS Link cl c</b>		
CU_DC (PROFINET), CU_DC_R (PROFINET), CU_DC_R_S (PROFINET), CU_DC_S (PROFINET)	<b>Can be changed:</b> C1(1)	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	2000	[0] 0 [1] 2000
<b>Description:</b>	Sets the clock cycle for SINAMICS Link.		

Re index 0:

0 = clock synchronous mode not activated, 1 = clock synchronous mode activated

Re index 1:

Possible values: 500, 1000, 2000 µs

**Index:** [0] = Activate isochronous mode

[1] = Bus CC [µs]

**Dependency:** Refer to: p8811**Note:** SINAMICS Link requires that the appropriate CBE20 firmware version is selected (p8835 = 3).

A change only becomes effective after a POWER ON.

The parameter is not influenced by setting the factory setting.

Re index 0:

Is applicable for the synchronization of the application. The SINAMICS Link itself is always synchronous.

Re index 1:

The value must be set the same for all participants.

When newly selecting the project p8811, p8812[1] is set to the factory setting.

For p8811 = 16, the following applies:

Min/max/factory setting: 500/500/500 µs

For p8811 = 64, the following applies:

Min/max/factory setting: 1000/2000/2000 µs

---

**p8829****CBE20 remote controller number / CBE20 rem ctrl num**CU\_DC  
(PROFINET),  
CU\_DC\_R  
(PROFINET),  
CU\_DC\_R\_S  
(PROFINET),  
CU\_DC\_S  
(PROFINET)**Can be changed:** C1(1)**Calculated:** -**Access level:** 3**Data type:** Integer16**Dyn. index:** -**Func. diagram:** -**P-Group:** Communications**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** -**Expert list:** 1**Min****Max****Factory setting**

1

2

1

**Description:**

Sets the number of remote controllers expected for PROFINET CBE20.

The "Shared Device" functionality is activated with a value = 2.

The drive is being accessed by two PROFINET controllers simultaneously:

- automation controller (SIMOTION or SIMATIC A-CPU).

- safety controller (SIMATIC F-CPU).

**Value:**

1: Automation or Safety

2: Automation and Safety

**Notice:**

The F CPU may only use PROFIsafe telegrams.

The A CPU must be connected to enable the F CPU to gain access.

Set the value = 1 to commission the F CPU individually.

**Note:**

A change only becomes effective after a POWER ON.

---

**p8835****CBE20 firmware selection / CBE20 FW sel**CU\_DC  
(PROFINET),  
CU\_DC\_R  
(PROFINET),  
CU\_DC\_R\_S  
(PROFINET),  
CU\_DC\_S  
(PROFINET)**Can be changed:** C1(1)**Calculated:** -**Access level:** 3**Data type:** Integer16**Dyn. index:** -**Func. diagram:** -**P-Group:** Communications**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** -**Expert list:** 1**Min****Max****Factory setting**

1

99

1

**Description:**

Selects the firmware version for the CBE20.

**Value:** 1: PROFINET Device  
3: SINAMICS Link  
4: Ethernet/IP  
99: Customer-specific from the OEM directory

**Note:** A change only becomes effective after a POWER ON.  
The parameter is not influenced by setting the factory setting.  
CBE20: Communication Board Ethernet 20

<b>p8836</b>		<b>SINAMICS Link address / SINAMICS Link add</b>	
CU_DC (PROFINET), CU_DC_R (PROFINET), CU_DC_R_S (PROFINET), CU_DC_S (PROFINET)	<b>Can be changed:</b> C1(1)	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 64	<b>Factory setting</b> 0
<b>Description:</b>		Selects the node address for the SINAMICS Link on the Communication Board Ethernet 20 (CBE20). p8836 = 0: SINAMICS Link de-activated p8836 = 1 ... 64: SINAMICS Link node address	
<b>Dependency:</b>		Refer to: p8835	
<b>Note:</b>		SINAMICS Link requires that the appropriate CBE20 firmware version is selected (p8835 = 3). A change only becomes effective after a POWER ON. The parameter is not influenced by setting the factory setting.	

<b>p8837</b>		<b>IF2 STW1.10 = 0 mode / IF2 STW1.10=0</b>	
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 2	<b>Factory setting</b> 2
<b>Description:</b>		Sets the processing mode for PROFIdrive STW1.10 "master control by PLC". Generally, control world 1 is received with the first receive word (PZD1) (this is in conformance to the PROFIdrive profile). The behavior of STW1.10 = 0 corresponds to that of the PROFIdrive profile. For other applications that deviate from this, the behavior can be adapted using this particular parameter.	
<b>Value:</b>		0: Freeze setpoints and continue to process sign-of-life 1: Freeze setpoints and sign-of-life 2: Do not freeze setpoints	
<b>Recommend.:</b>		Do not change the setting p2037 = 0.	
<b>Note:</b>		If the STW1 is not transferred according to the PROFIdrive with PZD1 (with bit 10 "master control by PLC"), then p2037 should be set to 2.	

<b>p8839[0...1]</b>		<b>PZD interface hardware assignment / PZD IF HW assign</b>	
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> C1(1)	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 99	<b>Factory setting</b> 99
<b>Description:</b>		Assignment of the hardware for cyclic communications via PZD interface 1 (IF1) and interface 2 (IF2).	

<b>Value:</b>	0: Inactive 1: Control Unit onboard 2: COMM BOARD 99: Automatic
<b>Index:</b>	[0] = Interface 1 [1] = Interface 2
<b>Dependency:</b>	Refer to: p2030
<b>Note:</b>	For value = 99 (automatic) the following applies: - if a COMM BOARD is not inserted, then the integrated communication interface (PROFIBUS/USS) communicates via IF1. - if a CBE20 is inserted, then PROFINET CBE20 communicates via IF1 and PROFIBUS/USS via IF2. For a value not equal to 99 (automatic) the following applies: - both indices must be set to a number not equal to 99 (automatic). A new setting only becomes effective after POWER ON, reset or download.

---

<b>p8840</b>	<b>COMM BOARD monitoring time / CB t_monit</b>		
CU_DC (PROFINET), CU_DC_R (PROFINET), CU_DC_R_S (PROFINET), CU_DC_S (PROFINET)	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Communications <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> 0 [ms]	<b>Max</b> 65535000 [ms]	<b>Factory setting</b> 20 [ms]
<b>Description:</b>	Sets the monitoring time to monitor the process data received via COMM BOARD. If, during this time, the Control Unit does not receive any process data from the COMM BOARD, then an appropriate message is output.		
<b>Note:</b>	This monitoring function only monitors the connection between the Control Unit and COMM BOARD and not the data traffic on the fieldbus. Value = 0: Monitoring is de-activated.		

---

<b>p8841[0...239]</b>	<b>COMM BOARD send configuration data / CB s config_dat</b>		
CU_DC (PROFINET), CU_DC_R (PROFINET), CU_DC_R_S (PROFINET), CU_DC_S (PROFINET)	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned16 <b>P-Group:</b> Communications <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 65535	<b>Factory setting</b> 0
<b>Description:</b>	Sets the send configuration data for the COMM BOARD. The setting is activated with p8842.		
<b>Dependency:</b>	Refer to: p8842		
<b>Note:</b>	The configuration data are specific to the inserted COMM BOARD. For CBE20, the configuration data are not relevant.		

<b>p8842</b>	<b>Activate COMM BOARD send configuration / CB s config act</b>			
CU_DC (PROFINET), CU_DC_R (PROFINET), CU_DC_R_S (PROFINET), CU_DC_S (PROFINET)	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned16 <b>P-Group:</b> Communications <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1	
	<b>Min</b> 0	<b>Max</b> 1	<b>Factory setting</b> 0	
<b>Description:</b>	Activate a modified send configuration for COMM BOARD. With p8842 = 1, the values in p8841 are transferred to the COMM BOARD and activated. After this, p8842 is automatically set to zero.			
<b>Dependency:</b>	Refer to: p8841			
<b>Note:</b>	For CBE20, certain SINAMICS parameters are newly evaluated and activated. An existing, cyclic bus connection is interrupted.			

<b>r8843.0...2</b>	<b>BO: IF2 PZD state / IF2 PZD state</b>				
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned8 <b>P-Group:</b> Communications <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 2410 <b>Unit selection:</b> - <b>Expert list:</b> 1		
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> -		
<b>Description:</b>	Displays the PROFIdrive PZD state.				
<b>Bit field:</b>	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>	<b>FP</b>
	00	Setpoint failure	Yes	No	-
	02	Fieldbus oper	Yes	No	-
<b>Dependency:</b>	Refer to: p2044				
<b>Note:</b>	When using the "setpoint failure" signal, the bus can be monitored and an application-specific response triggered when the setpoint fails.				

<b>p8844</b>	<b>IF2 fault delay / IF2 F delay</b>			
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Communications <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 2410 <b>Unit selection:</b> - <b>Expert list:</b> 1	
	<b>Min</b> 0 [s]	<b>Max</b> 100 [s]	<b>Factory setting</b> 0 [s]	
<b>Description:</b>	Sets the delay time to initiate fault F01910 after a setpoint failure. The time until the fault is initiated can be used by the application. This means that is is possible to respond to the failure while the drive is still operational (e.g. emergency retraction).			
<b>Dependency:</b>	Refer to: r2043			

<b>p8848</b>	<b>IF2 PZD sampling time / IF2 PZD t_sample</b>			
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> C1(3) <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> Communications <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1	
	<b>Min</b> 1.00 [ms]	<b>Max</b> 16.00 [ms]	<b>Factory setting</b> 4.00 [ms]	
<b>Description:</b>	Sets the sampling time for the cyclic interface 2 (IF2).			

**Note:** The system only permits certain sampling times and after writing to this parameter, displays the value that has actually been set.  
For clock cycle synchronous operation, the specified bus cycle time applies (Tdp).

<b>r8849[0...139]</b>	<b>COMM BOARD receive configuration data / CB r config_dat</b>		
CU_DC (PROFINET), CU_DC_R (PROFINET), CU_DC_R_S (PROFINET), CU_DC_S (PROFINET)	<b>Can be changed:</b> - <b>Data type:</b> Unsigned16 <b>P-Group:</b> Communications <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays the receive configuration data for the COMM BOARD.		
<b>r8850[0...63]</b>	<b>CO: IF2 PZD receive word / IF2 PZD recv word</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> Integer16 <b>P-Group:</b> Communications <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> 4000H	<b>Access level:</b> 3 <b>Func. diagram:</b> 2485, 9204, 9206 <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Connector output for interconnecting the PZD (setpoints) received via interface 2 in the word format.		
<b>Index:</b>	[0] = PZD 1 [1] = PZD 2 [2] = PZD 3 [3] = PZD 4 [4] = PZD 5 [5] = PZD 6 [6] = PZD 7 [7] = PZD 8 [8] = PZD 9 [9] = PZD 10 [10] = PZD 11 [11] = PZD 12 [12] = PZD 13 [13] = PZD 14 [14] = PZD 15 [15] = PZD 16 [16] = PZD 17 [17] = PZD 18 [18] = PZD 19 [19] = PZD 20 [20] = PZD 21 [21] = PZD 22 [22] = PZD 23 [23] = PZD 24 [24] = PZD 25 [25] = PZD 26 [26] = PZD 27 [27] = PZD 28 [28] = PZD 29 [29] = PZD 30 [30] = PZD 31 [31] = PZD 32 [32] = PZD 33 [33] = PZD 34		



[34] = PZD 35  
 [35] = PZD 36  
 [36] = PZD 37  
 [37] = PZD 38  
 [38] = PZD 39  
 [39] = PZD 40  
 [40] = PZD 41  
 [41] = PZD 42  
 [42] = PZD 43  
 [43] = PZD 44  
 [44] = PZD 45  
 [45] = PZD 46  
 [46] = PZD 47  
 [47] = PZD 48  
 [48] = PZD 49  
 [49] = PZD 50  
 [50] = PZD 51  
 [51] = PZD 52  
 [52] = PZD 53  
 [53] = PZD 54  
 [54] = PZD 55  
 [55] = PZD 56  
 [56] = PZD 57  
 [57] = PZD 58  
 [58] = PZD 59  
 [59] = PZD 60  
 [60] = PZD 61  
 [61] = PZD 62  
 [62] = PZD 63  
 [63] = PZD 64

**Dependency:** Refer to: r8860, r8890, r8891, r8892, r8893

**Notice:** Where there is a multiple interconnection of a connector output, all the connector inputs must either have Integer or FloatingPoint data types.

A BICO interconnection for a single PZD can only take place either on r8850 or r8860.

**Note:** IF2: Interface 2

PZD1 to PZD4 are displayed bit-serially in r8890 to r8893.

---

#### **r8850[0...4]      CO: IF2 PZD receive word / IF2 PZD recv word**

TM150, TM15DI_DO, TM31	<b>Can be changed:</b> - <b>Data type:</b> Integer16 <b>P-Group:</b> Communications <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> 4000H <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 2491 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
---------------------------	--	---	--

**Description:** Connector output for interconnecting the PZD (setpoints) received via interface 2 in the word format.

**Index:**  
 [0] = PZD 1  
 [1] = PZD 2  
 [2] = PZD 3  
 [3] = PZD 4  
 [4] = PZD 5

**Note:** IF2: Interface 2

PZD1 to PZD2 are displayed bit-serially in r8890 to r8891.

<b>p8851[0...63]</b>	<b>CI: IF2 PZD send word / IF2 PZD send word</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2487, 9208
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> 4000H	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0
<b>Description:</b>	Selects the PZD (actual values) to be sent via interface 2 in the word format.		
<b>Index:</b>	[0] = PZD 1 [1] = PZD 2 [2] = PZD 3 [3] = PZD 4 [4] = PZD 5 [5] = PZD 6 [6] = PZD 7 [7] = PZD 8 [8] = PZD 9 [9] = PZD 10 [10] = PZD 11 [11] = PZD 12 [12] = PZD 13 [13] = PZD 14 [14] = PZD 15 [15] = PZD 16 [16] = PZD 17 [17] = PZD 18 [18] = PZD 19 [19] = PZD 20 [20] = PZD 21 [21] = PZD 22 [22] = PZD 23 [23] = PZD 24 [24] = PZD 25 [25] = PZD 26 [26] = PZD 27 [27] = PZD 28 [28] = PZD 29 [29] = PZD 30 [30] = PZD 31 [31] = PZD 32 [32] = PZD 33 [33] = PZD 34 [34] = PZD 35 [35] = PZD 36 [36] = PZD 37 [37] = PZD 38 [38] = PZD 39 [39] = PZD 40 [40] = PZD 41 [41] = PZD 42 [42] = PZD 43 [43] = PZD 44 [44] = PZD 45 [45] = PZD 46 [46] = PZD 47 [47] = PZD 48 [48] = PZD 49 [49] = PZD 50 [50] = PZD 51 [51] = PZD 52 [52] = PZD 53		

[53] = PZD 54  
[54] = PZD 55  
[55] = PZD 56  
[56] = PZD 57  
[57] = PZD 58  
[58] = PZD 59  
[59] = PZD 60  
[60] = PZD 61  
[61] = PZD 62  
[62] = PZD 63  
[63] = PZD 64

**Dependency:** Refer to: p8861  
**Note:** IF2: Interface 2

---

**p8851[0...4] CI: IF2 PZD send word / IF2 PZD send word**

TM150, TM15DI_DO, TM31	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 / Integer16 <b>P-Group:</b> Communications <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> 4000H <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 2493, 9210 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
---------------------------	--	---	--

**Description:** Selects the PZD (actual values) to be sent via interface 2 in the word format.

**Index:**  
[0] = PZD 1  
[1] = PZD 2  
[2] = PZD 3  
[3] = PZD 4  
[4] = PZD 5

**Note:** IF2: Interface 2

---

**r8853[0...63] IF2 diagnostics PZD send / IF2 diag PZD send**

DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned16 <b>P-Group:</b> Communications <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 2487, 9208, 9210 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
---	---	---	---

**Description:** Displays the sent PZD (actual values) sent via interface 2.

**Index:**  
[0] = PZD 1  
[1] = PZD 2  
[2] = PZD 3  
[3] = PZD 4  
[4] = PZD 5  
[5] = PZD 6  
[6] = PZD 7  
[7] = PZD 8  
[8] = PZD 9  
[9] = PZD 10  
[10] = PZD 11  
[11] = PZD 12  
[12] = PZD 13  
[13] = PZD 14  
[14] = PZD 15  
[15] = PZD 16  
[16] = PZD 17  
[17] = PZD 18  
[18] = PZD 19  
[19] = PZD 20  
[20] = PZD 21

[21] = PZD 22  
 [22] = PZD 23  
 [23] = PZD 24  
 [24] = PZD 25  
 [25] = PZD 26  
 [26] = PZD 27  
 [27] = PZD 28  
 [28] = PZD 29  
 [29] = PZD 30  
 [30] = PZD 31  
 [31] = PZD 32  
 [32] = PZD 33  
 [33] = PZD 34  
 [34] = PZD 35  
 [35] = PZD 36  
 [36] = PZD 37  
 [37] = PZD 38  
 [38] = PZD 39  
 [39] = PZD 40  
 [40] = PZD 41  
 [41] = PZD 42  
 [42] = PZD 43  
 [43] = PZD 44  
 [44] = PZD 45  
 [45] = PZD 46  
 [46] = PZD 47  
 [47] = PZD 48  
 [48] = PZD 49  
 [49] = PZD 50  
 [50] = PZD 51  
 [51] = PZD 52  
 [52] = PZD 53  
 [53] = PZD 54  
 [54] = PZD 55  
 [55] = PZD 56  
 [56] = PZD 57  
 [57] = PZD 58  
 [58] = PZD 59  
 [59] = PZD 60  
 [60] = PZD 61  
 [61] = PZD 62  
 [62] = PZD 63  
 [63] = PZD 64

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Bit 0	ON	OFF	-
	01	Bit 1	ON	OFF	-
	02	Bit 2	ON	OFF	-
	03	Bit 3	ON	OFF	-
	04	Bit 4	ON	OFF	-
	05	Bit 5	ON	OFF	-
	06	Bit 6	ON	OFF	-
	07	Bit 7	ON	OFF	-
	08	Bit 8	ON	OFF	-
	09	Bit 9	ON	OFF	-
	10	Bit 10	ON	OFF	-
	11	Bit 11	ON	OFF	-
	12	Bit 12	ON	OFF	-
	13	Bit 13	ON	OFF	-
	14	Bit 14	ON	OFF	-
	15	Bit 15	ON	OFF	-

**Dependency:** Refer to: p8851, p8861

**Note:** IF2: Interface 2

**r8853[0...4] IF2 diagnostics PZD send / IF2 diag PZD send**

TM150, TM15DI_DO, TM31	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2493
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the sent PZD (actual values) sent via interface 2.

**Index:**  
 [0] = PZD 1  
 [1] = PZD 2  
 [2] = PZD 3  
 [3] = PZD 4  
 [4] = PZD 5

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Bit 0	ON	OFF	-
	01	Bit 1	ON	OFF	-
	02	Bit 2	ON	OFF	-
	03	Bit 3	ON	OFF	-
	04	Bit 4	ON	OFF	-
	05	Bit 5	ON	OFF	-
	06	Bit 6	ON	OFF	-
	07	Bit 7	ON	OFF	-
	08	Bit 8	ON	OFF	-
	09	Bit 9	ON	OFF	-
	10	Bit 10	ON	OFF	-
	11	Bit 11	ON	OFF	-
	12	Bit 12	ON	OFF	-
	13	Bit 13	ON	OFF	-
	14	Bit 14	ON	OFF	-
	15	Bit 15	ON	OFF	-

**Note:** IF2: Interface 2

**r8854 COMM BOARD state / CB state**

CU_DC (PROFINET), CU_DC_R (PROFINET), CU_DC_R_S (PROFINET), CU_DC_S (PROFINET)	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	255	-

**Description:** Status display for COMM BOARD.

**Value:**  
 0: No initialization  
 1: Fatal fault  
 2: Initialization  
 3: Send configuration  
 4: Receive configuration  
 5: Non-cyclic communication  
 6: Cyclic communications but no setpoints (stop/no clock cycle)  
 255: Cyclic communication

<b>r8858[0...39]</b>	<b>COMM BOARD read diagnostics channel / CB diag_chan read</b>		
CU_DC (PROFINET), CU_DC_R (PROFINET), CU_DC_R_S (PROFINET), CU_DC_S (PROFINET)	<b>Can be changed:</b> - <b>Data type:</b> Unsigned16 <b>P-Group:</b> Communications <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> -
<b>Description:</b>	Displays the COMM BOARD diagnostics data.		
<b>Note:</b>	The display depends on the COMM BOARD being used. Example for CBE20: r8858[0] = 4201 --> Siemens CBE20 r8858[1] = 1 --> firmware type = PROFINET device (see p8835) r8858[2] = x --> state of cyclic communication r8858[3] = y --> state of the IP configuration r8858[4] = 1281 --> device ID 0501 hex = SINAMICS S120/S150 r8858[5 ... 39] --> only for internal Siemens diagnostics.		

<b>r8859[0...7]</b>	<b>COMM BOARD identification data / CB ident data</b>		
CU_DC (PROFINET), CU_DC_R (PROFINET), CU_DC_R_S (PROFINET), CU_DC_S (PROFINET)	<b>Can be changed:</b> - <b>Data type:</b> Unsigned16 <b>P-Group:</b> Communications <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> -
<b>Description:</b>	Displays the COMM BOARD identification data		
<b>Index:</b>	[0] = Version interface structure [1] = Version interface driver [2] = Company (Siemens = 42) [3] = CB type [4] = Firmware version [5] = Firmware date (year) [6] = Firmware date (day/month) [7] = Firmware patch/hot fix		
<b>Note:</b>	Example for CBE20: r8859[0] = 100 --> version of the interface structure V1.00 r8859[1] = 111 --> version of the interface driver V1.11 r8859[2] = 42 --> SIEMENS r8859[3] = 0 --> CBE20 r8859[4] = 1200 --> first part, firmware version V12.00 (second part, see index 7) r8859[5] = 2010 --> year 2010 r8859[6] = 2306 --> 23rd June r8859[7] = 1300 --> second part, firmware version (complete version: V12.00.13.00)		

<b>r8860[0...62]</b>			
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>CO: IF2 PZD receive double word / IF2 PZD recv DW</b>		
	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Integer32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2485, 9204, 9206
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> 4000H	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
	-	-	-
<b>Description:</b>	Connector output for interconnecting the PZD (setpoints) received via interface 2 in the double word format.		
<b>Index:</b>	[0] = PZD 1 + 2 [1] = PZD 2 + 3 [2] = PZD 3 + 4 [3] = PZD 4 + 5 [4] = PZD 5 + 6 [5] = PZD 6 + 7 [6] = PZD 7 + 8 [7] = PZD 8 + 9 [8] = PZD 9 + 10 [9] = PZD 10 + 11 [10] = PZD 11 + 12 [11] = PZD 12 + 13 [12] = PZD 13 + 14 [13] = PZD 14 + 15 [14] = PZD 15 + 16 [15] = PZD 16 + 17 [16] = PZD 17 + 18 [17] = PZD 18 + 19 [18] = PZD 19 + 20 [19] = PZD 20 + 21 [20] = PZD 21 + 22 [21] = PZD 22 + 23 [22] = PZD 23 + 24 [23] = PZD 24 + 25 [24] = PZD 25 + 26 [25] = PZD 26 + 27 [26] = PZD 27 + 28 [27] = PZD 28 + 29 [28] = PZD 29 + 30 [29] = PZD 30 + 31 [30] = PZD 31 + 32 [31] = PZD 32 + 33 [32] = PZD 33 + 34 [33] = PZD 34 + 35 [34] = PZD 35 + 36 [35] = PZD 36 + 37 [36] = PZD 37 + 38 [37] = PZD 38 + 39 [38] = PZD 39 + 40 [39] = PZD 40 + 41 [40] = PZD 41 + 42 [41] = PZD 42 + 43 [42] = PZD 43 + 44 [43] = PZD 44 + 45 [44] = PZD 45 + 46 [45] = PZD 46 + 47 [46] = PZD 47 + 48 [47] = PZD 48 + 49 [48] = PZD 49 + 50 [49] = PZD 50 + 51 [50] = PZD 51 + 52 [51] = PZD 52 + 53		

[52] = PZD 53 + 54  
 [53] = PZD 54 + 55  
 [54] = PZD 55 + 56  
 [55] = PZD 56 + 57  
 [56] = PZD 57 + 58  
 [57] = PZD 58 + 59  
 [58] = PZD 59 + 60  
 [59] = PZD 60 + 61  
 [60] = PZD 61 + 62  
 [61] = PZD 62 + 63  
 [62] = PZD 63 + 64

**Dependency:** Refer to: r8850

**Notice:** Where there is a multiple interconnection of a connector output, all the connector inputs must either have Integer or FloatingPoint data types.

A BICO interconnection for a single PZD can only take place either on r8850 or r8860.

A maximum of 4 indices of the "trace" function can be used.

**Note:** IF2: Interface 2

---

### **p8861[0...62]    CI: IF2 PZD send double word / IF2 PZD send DW**

DC\_CTRL,  
 DC\_CTRL\_R,  
 DC\_CTRL\_R\_S,  
 DC\_CTRL\_S

**Can be changed:** U, T

**Calculated:** -

**Access level:** 3

**Data type:** Unsigned32 / Integer32

**Dyn. index:** -

**Func. diagram:** 2487, 9208,  
 9210

**P-Group:** Communications

**Units group:** -

**Unit selection:** -

**Not for motor type:** -

**Scaling:** 4000H

**Expert list:** 1

**Min**

**Max**

**Factory setting**  
 0

-

-

**Description:** Selects the PZD (actual values) to be sent via interface 2 in the double word format.

**Index:**

[0] = PZD 1 + 2  
 [1] = PZD 2 + 3  
 [2] = PZD 3 + 4  
 [3] = PZD 4 + 5  
 [4] = PZD 5 + 6  
 [5] = PZD 6 + 7  
 [6] = PZD 7 + 8  
 [7] = PZD 8 + 9  
 [8] = PZD 9 + 10  
 [9] = PZD 10 + 11  
 [10] = PZD 11 + 12  
 [11] = PZD 12 + 13  
 [12] = PZD 13 + 14  
 [13] = PZD 14 + 15  
 [14] = PZD 15 + 16  
 [15] = PZD 16 + 17  
 [16] = PZD 17 + 18  
 [17] = PZD 18 + 19  
 [18] = PZD 19 + 20  
 [19] = PZD 20 + 21  
 [20] = PZD 21 + 22  
 [21] = PZD 22 + 23  
 [22] = PZD 23 + 24  
 [23] = PZD 24 + 25  
 [24] = PZD 25 + 26  
 [25] = PZD 26 + 27  
 [26] = PZD 27 + 28  
 [27] = PZD 28 + 29  
 [28] = PZD 29 + 30  
 [29] = PZD 30 + 31  
 [30] = PZD 31 + 32  
 [31] = PZD 32 + 33  
 [32] = PZD 33 + 34



[33] = PZD 34 + 35  
 [34] = PZD 35 + 36  
 [35] = PZD 36 + 37  
 [36] = PZD 37 + 38  
 [37] = PZD 38 + 39  
 [38] = PZD 39 + 40  
 [39] = PZD 40 + 41  
 [40] = PZD 41 + 42  
 [41] = PZD 42 + 43  
 [42] = PZD 43 + 44  
 [43] = PZD 44 + 45  
 [44] = PZD 45 + 46  
 [45] = PZD 46 + 47  
 [46] = PZD 47 + 48  
 [47] = PZD 48 + 49  
 [48] = PZD 49 + 50  
 [49] = PZD 50 + 51  
 [50] = PZD 51 + 52  
 [51] = PZD 52 + 53  
 [52] = PZD 53 + 54  
 [53] = PZD 54 + 55  
 [54] = PZD 55 + 56  
 [55] = PZD 56 + 57  
 [56] = PZD 57 + 58  
 [57] = PZD 58 + 59  
 [58] = PZD 59 + 60  
 [59] = PZD 60 + 61  
 [60] = PZD 61 + 62  
 [61] = PZD 62 + 63  
 [62] = PZD 63 + 64

**Dependency:** Refer to: p8851  
**Notice:** A BICO interconnection for a single PZD can only take place either on p8851 or p8861.  
**Note:** IF2: Interface 2

---

### r8863[0...62] IF2 diagnostics PZD send double word / IF2 diag send DW

DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> Communications <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 2487 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
---	---	---	--

**Description:** Displays the PZD sent via interface 2 (actual values) with double word format.

**Index:**

[0] = PZD 1 + 2  
 [1] = PZD 2 + 3  
 [2] = PZD 3 + 4  
 [3] = PZD 4 + 5  
 [4] = PZD 5 + 6  
 [5] = PZD 6 + 7  
 [6] = PZD 7 + 8  
 [7] = PZD 8 + 9  
 [8] = PZD 9 + 10  
 [9] = PZD 10 + 11  
 [10] = PZD 11 + 12  
 [11] = PZD 12 + 13  
 [12] = PZD 13 + 14  
 [13] = PZD 14 + 15  
 [14] = PZD 15 + 16  
 [15] = PZD 16 + 17  
 [16] = PZD 17 + 18  
 [17] = PZD 18 + 19  
 [18] = PZD 19 + 20

[19] = PZD 20 + 21  
 [20] = PZD 21 + 22  
 [21] = PZD 22 + 23  
 [22] = PZD 23 + 24  
 [23] = PZD 24 + 25  
 [24] = PZD 25 + 26  
 [25] = PZD 26 + 27  
 [26] = PZD 27 + 28  
 [27] = PZD 28 + 29  
 [28] = PZD 29 + 30  
 [29] = PZD 30 + 31  
 [30] = PZD 31 + 32  
 [31] = PZD 32 + 33  
 [32] = PZD 33 + 34  
 [33] = PZD 34 + 35  
 [34] = PZD 35 + 36  
 [35] = PZD 36 + 37  
 [36] = PZD 37 + 38  
 [37] = PZD 38 + 39  
 [38] = PZD 39 + 40  
 [39] = PZD 40 + 41  
 [40] = PZD 41 + 42  
 [41] = PZD 42 + 43  
 [42] = PZD 43 + 44  
 [43] = PZD 44 + 45  
 [44] = PZD 45 + 46  
 [45] = PZD 46 + 47  
 [46] = PZD 47 + 48  
 [47] = PZD 48 + 49  
 [48] = PZD 49 + 50  
 [49] = PZD 50 + 51  
 [50] = PZD 51 + 52  
 [51] = PZD 52 + 53  
 [52] = PZD 53 + 54  
 [53] = PZD 54 + 55  
 [54] = PZD 55 + 56  
 [55] = PZD 56 + 57  
 [56] = PZD 57 + 58  
 [57] = PZD 58 + 59  
 [58] = PZD 59 + 60  
 [59] = PZD 60 + 61  
 [60] = PZD 61 + 62  
 [61] = PZD 62 + 63  
 [62] = PZD 63 + 64

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Bit 0	ON	OFF	-
	01	Bit 1	ON	OFF	-
	02	Bit 2	ON	OFF	-
	03	Bit 3	ON	OFF	-
	04	Bit 4	ON	OFF	-
	05	Bit 5	ON	OFF	-
	06	Bit 6	ON	OFF	-
	07	Bit 7	ON	OFF	-
	08	Bit 8	ON	OFF	-
	09	Bit 9	ON	OFF	-
	10	Bit 10	ON	OFF	-
	11	Bit 11	ON	OFF	-
	12	Bit 12	ON	OFF	-
	13	Bit 13	ON	OFF	-
	14	Bit 14	ON	OFF	-
	15	Bit 15	ON	OFF	-
	16	Bit 16	ON	OFF	-
	17	Bit 17	ON	OFF	-

18	Bit 18	ON	OFF	-
19	Bit 19	ON	OFF	-
20	Bit 20	ON	OFF	-
21	Bit 21	ON	OFF	-
22	Bit 22	ON	OFF	-
23	Bit 23	ON	OFF	-
24	Bit 24	ON	OFF	-
25	Bit 25	ON	OFF	-
26	Bit 26	ON	OFF	-
27	Bit 27	ON	OFF	-
28	Bit 28	ON	OFF	-
29	Bit 29	ON	OFF	-
30	Bit 30	ON	OFF	-
31	Bit 31	ON	OFF	-

**Notice:** A maximum of 4 indices of the "trace" function can be used.

**Note:** IF2: Interface 2

### r8867[0...1] IF2 PZD maximum interconnected / IF2 PZDmaxIntercon

DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150, TM15DI_DO, TM31	<b>Can be changed:</b> - <b>Data type:</b> Unsigned16 <b>P-Group:</b> Communications <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Display for the maximum interconnected PZD in the receive/send direction  
Index 0: receive (r8850, r8860)  
Index 1: send (p8851, p8861)

### p8870[0...15] SINAMICS Link receive telegram word PZD / Recv link word

CU_DC (PROFINET), CU_DC_R (PROFINET), CU_DC_R_S (PROFINET), CU_DC_S (PROFINET), DC_CTRL (PROFINET), DC_CTRL_R (PROFINET), DC_CTRL_R_S (PROFINET), DC_CTRL_S (PROFINET), TM150 (PROFINET), TM15DI_DO (PROFINET), TM31 (PROFINET)	<b>Can be changed:</b> T <b>Data type:</b> Unsigned16 <b>P-Group:</b> Communications <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	16	0

**Description:** Assignment of a PZD to a telegram word from a SINAMICS Link receive telegram.  
PZD p2050[index] is assigned by means of p8870[index], p8872[index].

**Index:**  
[0] = PZD 1  
[1] = PZD 2  
[2] = PZD 3  
[3] = PZD 4  
[4] = PZD 5

[5] = PZD 6  
 [6] = PZD 7  
 [7] = PZD 8  
 [8] = PZD 9  
 [9] = PZD 10  
 [10] = PZD 11  
 [11] = PZD 12  
 [12] = PZD 13  
 [13] = PZD 14  
 [14] = PZD 15  
 [15] = PZD 16

**Dependency:**

Refer to: p8872

**Note:**

Value range:

0: Not used

1 ... 16: Telegram word

A pair of values p8870[index], p8872[index] may only be used once in single a device.

A change only becomes effective after POWER ON, reset, project download or p8842 = 1.

---

**p8871[0...15]****SINAMICS Link send telegram word PZD / Send link word**

CU\_DC

**Can be changed:** T**Calculated:** -**Access level:** 3

(PROFINET),

**Data type:** Unsigned16**Dyn. index:** -**Func. diagram:** -

CU\_DC\_R

**P-Group:** Communications**Units group:** -**Unit selection:** -

(PROFINET),

**Not for motor type:** -**Scaling:** -**Expert list:** 1

CU\_DC\_R\_S

(PROFINET),

CU\_DC\_S

(PROFINET),

DC\_CTRL

(PROFINET),

DC\_CTRL\_R

(PROFINET),

DC\_CTRL\_R\_S

(PROFINET),

DC\_CTRL\_S

(PROFINET), TM150

(PROFINET),

TM15DI\_DO

(PROFINET), TM31

(PROFINET)

**Min**

0

**Max**

16

**Factory setting**

0

**Description:**

Assigns a PZD to a telegram word in the SINAMICS Link send telegram.  
 p8871[index] assigns PZD p2051[index].

**Index:**

[0] = PZD 1  
 [1] = PZD 2  
 [2] = PZD 3  
 [3] = PZD 4  
 [4] = PZD 5  
 [5] = PZD 6  
 [6] = PZD 7  
 [7] = PZD 8  
 [8] = PZD 9  
 [9] = PZD 10  
 [10] = PZD 11  
 [11] = PZD 12  
 [12] = PZD 13  
 [13] = PZD 14  
 [14] = PZD 15  
 [15] = PZD 16

**Dependency:**

Refer to: p2051, p8851

**Note:** Value range:  
0: Not used  
1 ... 16: Send telegram word  
A specific telegram word send may only be used once within a single device.  
A change only becomes effective after POWER ON, reset, project download or p8842 = 1.

p8872[0...15]		SINAMICS Link address receive PZD / Link addr rcv	
CU_DC (PROFINET), CU_DC_R (PROFINET), CU_DC_R_S (PROFINET), CU_DC_S (PROFINET), DC_CTRL (PROFINET), DC_CTRL_R (PROFINET), DC_CTRL_R_S (PROFINET), DC_CTRL_S (PROFINET), TM150 (PROFINET), TM15DI_DO (PROFINET), TM31 (PROFINET)	Can be changed: T	Calculated: -	Access level: 3
	Data type: Unsigned16	Dyn. index: -	Func. diagram: -
	P-Group: Communications	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min	Max	Factory setting
	0	64	0
Description:	Selects the address of the SINAMICS Link sender from which the process data (PZD) is received.		
Index:	[0] = PZD 1 [1] = PZD 2 [2] = PZD 3 [3] = PZD 4 [4] = PZD 5 [5] = PZD 6 [6] = PZD 7 [7] = PZD 8 [8] = PZD 9 [9] = PZD 10 [10] = PZD 11 [11] = PZD 12 [12] = PZD 13 [13] = PZD 14 [14] = PZD 15 [15] = PZD 16		
Dependency:	Refer to: p8870		
Note:	Value range: 0: Not used 1 ... 64: Address		
A change only becomes effective after POWER ON, reset, project download or p8842 = 1.			

<b>r8874[0...63]</b>	<b>IF2 diagnostics bus address PZD receive / IF2 diag addr recv</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays the bus address of sender from which the PZD is received.		
<b>Index:</b>	[0] = PZD 1 [1] = PZD 2 [2] = PZD 3 [3] = PZD 4 [4] = PZD 5 [5] = PZD 6 [6] = PZD 7 [7] = PZD 8 [8] = PZD 9 [9] = PZD 10 [10] = PZD 11 [11] = PZD 12 [12] = PZD 13 [13] = PZD 14 [14] = PZD 15 [15] = PZD 16 [16] = PZD 17 [17] = PZD 18 [18] = PZD 19 [19] = PZD 20 [20] = PZD 21 [21] = PZD 22 [22] = PZD 23 [23] = PZD 24 [24] = PZD 25 [25] = PZD 26 [26] = PZD 27 [27] = PZD 28 [28] = PZD 29 [29] = PZD 30 [30] = PZD 31 [31] = PZD 32 [32] = PZD 33 [33] = PZD 34 [34] = PZD 35 [35] = PZD 36 [36] = PZD 37 [37] = PZD 38 [38] = PZD 39 [39] = PZD 40 [40] = PZD 41 [41] = PZD 42 [42] = PZD 43 [43] = PZD 44 [44] = PZD 45 [45] = PZD 46 [46] = PZD 47 [47] = PZD 48 [48] = PZD 49 [49] = PZD 50 [50] = PZD 51 [51] = PZD 52 [52] = PZD 53		

[53] = PZD 54  
[54] = PZD 55  
[55] = PZD 56  
[56] = PZD 57  
[57] = PZD 58  
[58] = PZD 59  
[59] = PZD 60  
[60] = PZD 61  
[61] = PZD 62  
[62] = PZD 63  
[63] = PZD 64

**Note:** IF2: Interface 2  
Value range:  
0 - 125: Bus address of the sender  
255: Not assigned

---

#### **r8874[0...4] IF2 diagnostics bus address PZD receive / IF2 diag addr rcv**

TM150, TM15DI_DO, TM31	<b>Can be changed:</b> - <b>Data type:</b> Unsigned16 <b>P-Group:</b> Communications <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
---------------------------	---	---	---

**Description:** Displays the bus address of sender from which the PZD is received.

**Index:** [0] = PZD 1  
[1] = PZD 2  
[2] = PZD 3  
[3] = PZD 4  
[4] = PZD 5

---

#### **r8875[0...63] IF2 diagnostics telegram offset PZD receive / IF diag offs rcv**

DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned16 <b>P-Group:</b> Communications <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
---	---	---	---

**Description:** Displays the byte offset of the PZD in the receive telegram.

**Index:** [0] = PZD 1  
[1] = PZD 2  
[2] = PZD 3  
[3] = PZD 4  
[4] = PZD 5  
[5] = PZD 6  
[6] = PZD 7  
[7] = PZD 8  
[8] = PZD 9  
[9] = PZD 10  
[10] = PZD 11  
[11] = PZD 12  
[12] = PZD 13  
[13] = PZD 14  
[14] = PZD 15  
[15] = PZD 16  
[16] = PZD 17  
[17] = PZD 18  
[18] = PZD 19  
[19] = PZD 20  
[20] = PZD 21

[21] = PZD 22  
 [22] = PZD 23  
 [23] = PZD 24  
 [24] = PZD 25  
 [25] = PZD 26  
 [26] = PZD 27  
 [27] = PZD 28  
 [28] = PZD 29  
 [29] = PZD 30  
 [30] = PZD 31  
 [31] = PZD 32  
 [32] = PZD 33  
 [33] = PZD 34  
 [34] = PZD 35  
 [35] = PZD 36  
 [36] = PZD 37  
 [37] = PZD 38  
 [38] = PZD 39  
 [39] = PZD 40  
 [40] = PZD 41  
 [41] = PZD 42  
 [42] = PZD 43  
 [43] = PZD 44  
 [44] = PZD 45  
 [45] = PZD 46  
 [46] = PZD 47  
 [47] = PZD 48  
 [48] = PZD 49  
 [49] = PZD 50  
 [50] = PZD 51  
 [51] = PZD 52  
 [52] = PZD 53  
 [53] = PZD 54  
 [54] = PZD 55  
 [55] = PZD 56  
 [56] = PZD 57  
 [57] = PZD 58  
 [58] = PZD 59  
 [59] = PZD 60  
 [60] = PZD 61  
 [61] = PZD 62  
 [62] = PZD 63  
 [63] = PZD 64

**Note:**

IF2: Interface 2  
 Value range:  
 0 - 242: Byte offset  
 255: Not assigned

---

**r8875[0...4] IF2 diagnostics telegram offset PZD receive / IF diag offs recv**

TM150, TM15DI_DO, TM31	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the byte offset of the PZD in the receive telegram.

**Index:**

[0] = PZD 1  
 [1] = PZD 2  
 [2] = PZD 3  
 [3] = PZD 4  
 [4] = PZD 5



<b>r8876[0...63] IF2 diagnostics telegram offset PZD send / IF2 diag offs send</b>			
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays the byte offset of the PZD in the send telegram.		
<b>Index:</b>	[0] = PZD 1 [1] = PZD 2 [2] = PZD 3 [3] = PZD 4 [4] = PZD 5 [5] = PZD 6 [6] = PZD 7 [7] = PZD 8 [8] = PZD 9 [9] = PZD 10 [10] = PZD 11 [11] = PZD 12 [12] = PZD 13 [13] = PZD 14 [14] = PZD 15 [15] = PZD 16 [16] = PZD 17 [17] = PZD 18 [18] = PZD 19 [19] = PZD 20 [20] = PZD 21 [21] = PZD 22 [22] = PZD 23 [23] = PZD 24 [24] = PZD 25 [25] = PZD 26 [26] = PZD 27 [27] = PZD 28 [28] = PZD 29 [29] = PZD 30 [30] = PZD 31 [31] = PZD 32 [32] = PZD 33 [33] = PZD 34 [34] = PZD 35 [35] = PZD 36 [36] = PZD 37 [37] = PZD 38 [38] = PZD 39 [39] = PZD 40 [40] = PZD 41 [41] = PZD 42 [42] = PZD 43 [43] = PZD 44 [44] = PZD 45 [45] = PZD 46 [46] = PZD 47 [47] = PZD 48 [48] = PZD 49 [49] = PZD 50 [50] = PZD 51 [51] = PZD 52 [52] = PZD 53		

[53] = PZD 54  
 [54] = PZD 55  
 [55] = PZD 56  
 [56] = PZD 57  
 [57] = PZD 58  
 [58] = PZD 59  
 [59] = PZD 60  
 [60] = PZD 61  
 [61] = PZD 62  
 [62] = PZD 63  
 [63] = PZD 64

**Note:** IF2: Interface 2  
 Value range:  
 0 - 242: Byte offset  
 255: Not assigned

---

**r8876[0...4] IF2 diagnostics telegram offset PZD send / IF2 diag offs send**

TM150, TM15DI_DO, TM31	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the byte offset of the PZD in the send telegram.

**Index:** [0] = PZD 1  
 [1] = PZD 2  
 [2] = PZD 3  
 [3] = PZD 4  
 [4] = PZD 5

---

**p8880[0...15] BI: IF2 binector-connector converter status word 1 / Bin/con ZSW1**

DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2489
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Selects bits to be sent via interface 2.

The individual bits are combined to form status word 1.

**Index:** [0] = Bit 0  
 [1] = Bit 1  
 [2] = Bit 2  
 [3] = Bit 3  
 [4] = Bit 4  
 [5] = Bit 5  
 [6] = Bit 6  
 [7] = Bit 7  
 [8] = Bit 8  
 [9] = Bit 9  
 [10] = Bit 10  
 [11] = Bit 11  
 [12] = Bit 12  
 [13] = Bit 13  
 [14] = Bit 14  
 [15] = Bit 15

**Dependency:** Refer to: p8888, r8889

<b>p8881[0...15]</b>	<b>BI: IF2 binector-connector converter status word 2 / Bin/con ZSW2</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2489
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Selects bits to be sent via interface 2.  
The individual bits are combined to form status word 2.

**Index:** [0] = Bit 0  
[1] = Bit 1  
[2] = Bit 2  
[3] = Bit 3  
[4] = Bit 4  
[5] = Bit 5  
[6] = Bit 6  
[7] = Bit 7  
[8] = Bit 8  
[9] = Bit 9  
[10] = Bit 10  
[11] = Bit 11  
[12] = Bit 12  
[13] = Bit 13  
[14] = Bit 14  
[15] = Bit 15

**Dependency:** Refer to: p8888, r8889

<b>p8882[0...15]</b>	<b>BI: IF2 binector-connector converter status word 3 / Bin/con ZSW3</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2489
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Selects bits to be sent via interface 2.  
The individual bits are combined to form free status word 3.

**Index:** [0] = Bit 0  
[1] = Bit 1  
[2] = Bit 2  
[3] = Bit 3  
[4] = Bit 4  
[5] = Bit 5  
[6] = Bit 6  
[7] = Bit 7  
[8] = Bit 8  
[9] = Bit 9  
[10] = Bit 10  
[11] = Bit 11  
[12] = Bit 12  
[13] = Bit 13  
[14] = Bit 14  
[15] = Bit 15

**Dependency:** Refer to: p8888, r8889

<b>p8883[0...15]</b>	<b>BI: IF2 binector-connector converter status word 4 / Bin/con ZSW4</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2489
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Selects bits to be sent via interface 2.  
The individual bits are combined to form free status word 4.

**Index:** [0] = Bit 0  
[1] = Bit 1  
[2] = Bit 2  
[3] = Bit 3  
[4] = Bit 4  
[5] = Bit 5  
[6] = Bit 6  
[7] = Bit 7  
[8] = Bit 8  
[9] = Bit 9  
[10] = Bit 10  
[11] = Bit 11  
[12] = Bit 12  
[13] = Bit 13  
[14] = Bit 14  
[15] = Bit 15

**Dependency:** Refer to: p8888, r8889

<b>p8884[0...15]</b>	<b>BI: IF2 binector-connector converter status word 5 / Bin/con ZSW5</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2489
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Selects bits to be sent via interface 2.  
The individual bits are combined to form free status word 5.

**Index:** [0] = Bit 0  
[1] = Bit 1  
[2] = Bit 2  
[3] = Bit 3  
[4] = Bit 4  
[5] = Bit 5  
[6] = Bit 6  
[7] = Bit 7  
[8] = Bit 8  
[9] = Bit 9  
[10] = Bit 10  
[11] = Bit 11  
[12] = Bit 12  
[13] = Bit 13  
[14] = Bit 14  
[15] = Bit 15

**Dependency:** Refer to: p8888, r8889

<b>p8888[0...4]</b>	<b>IF2 invert binector-connector converter status word / Bin/con ZSW inv</b>		
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2489
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0000 0000 0000 0000 bin

**Description:** Setting to invert the individual binector inputs of the binector connector converter.

**Index:**  
 [0] = Status word 1  
 [1] = Status word 2  
 [2] = Free status word 3  
 [3] = Free status word 4  
 [4] = Free status word 5

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Bit 0	Inverted	Not inverted	-
	01	Bit 1	Inverted	Not inverted	-
	02	Bit 2	Inverted	Not inverted	-
	03	Bit 3	Inverted	Not inverted	-
	04	Bit 4	Inverted	Not inverted	-
	05	Bit 5	Inverted	Not inverted	-
	06	Bit 6	Inverted	Not inverted	-
	07	Bit 7	Inverted	Not inverted	-
	08	Bit 8	Inverted	Not inverted	-
	09	Bit 9	Inverted	Not inverted	-
	10	Bit 10	Inverted	Not inverted	-
	11	Bit 11	Inverted	Not inverted	-
	12	Bit 12	Inverted	Not inverted	-
	13	Bit 13	Inverted	Not inverted	-
	14	Bit 14	Inverted	Not inverted	-
	15	Bit 15	Inverted	Not inverted	-

**Dependency:** Refer to: p8880, p8881, p8882, p8883, p8884, r8889

#### **r8889[0...4] CO: IF2 send binector-connector converter status word / Bin/con ZSW send**

DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Connector output to interconnect the status words to a PZD send word.

**Index:**  
 [0] = Status word 1  
 [1] = Status word 2  
 [2] = Free status word 3  
 [3] = Free status word 4  
 [4] = Free status word 5

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Bit 0	ON	OFF	-
	01	Bit 1	ON	OFF	-
	02	Bit 2	ON	OFF	-
	03	Bit 3	ON	OFF	-
	04	Bit 4	ON	OFF	-
	05	Bit 5	ON	OFF	-
	06	Bit 6	ON	OFF	-
	07	Bit 7	ON	OFF	-
	08	Bit 8	ON	OFF	-
	09	Bit 9	ON	OFF	-
	10	Bit 10	ON	OFF	-

11	Bit 11	ON	OFF	-
12	Bit 12	ON	OFF	-
13	Bit 13	ON	OFF	-
14	Bit 14	ON	OFF	-
15	Bit 15	ON	OFF	-

**Dependency:** Refer to: p8851, p8880, p8881, p8882, p8883, p8884, p8888

**Note:** r8889 together with p8880 to p8884 forms five binector-connector converters.

#### r8890.0...15 BO: IF2 PZD1 receive bit-serial / IF2 PZD1 recv bitw

DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150, TM15DI_DO, TM31	<b>Can be changed:</b> - <b>Data type:</b> Unsigned16 <b>P-Group:</b> Communications <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 2485, 2491, 9204, 9206 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
---	---	---	---

**Description:** Binector output for bit-serial interconnection of PZD1 (normally control word 1) received via interface 2.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Bit 0	ON	OFF	-
	01	Bit 1	ON	OFF	-
	02	Bit 2	ON	OFF	-
	03	Bit 3	ON	OFF	-
	04	Bit 4	ON	OFF	-
	05	Bit 5	ON	OFF	-
	06	Bit 6	ON	OFF	-
	07	Bit 7	ON	OFF	-
	08	Bit 8	ON	OFF	-
	09	Bit 9	ON	OFF	-
	10	Bit 10	ON	OFF	-
	11	Bit 11	ON	OFF	-
	12	Bit 12	ON	OFF	-
	13	Bit 13	ON	OFF	-
	14	Bit 14	ON	OFF	-
	15	Bit 15	ON	OFF	-

**Dependency:** Refer to: r8850

**Note:** IF2: Interface 2

#### r8891.0...15 BO: IF2 PZD2 receive bit-serial / IF2 PZD2 recv bitw

DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150, TM15DI_DO, TM31	<b>Can be changed:</b> - <b>Data type:</b> Unsigned16 <b>P-Group:</b> Communications <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 2485, 2491, 9204, 9206 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
---	---	---	---

**Description:** Binector output for bit-serial interconnection of PZD2 received via interface 2.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Bit 0	ON	OFF	-
	01	Bit 1	ON	OFF	-
	02	Bit 2	ON	OFF	-
	03	Bit 3	ON	OFF	-
	04	Bit 4	ON	OFF	-
	05	Bit 5	ON	OFF	-
	06	Bit 6	ON	OFF	-
	07	Bit 7	ON	OFF	-
	08	Bit 8	ON	OFF	-
	09	Bit 9	ON	OFF	-

10	Bit 10	ON	OFF	-
11	Bit 11	ON	OFF	-
12	Bit 12	ON	OFF	-
13	Bit 13	ON	OFF	-
14	Bit 14	ON	OFF	-
15	Bit 15	ON	OFF	-

**Dependency:** Refer to: r8850

**Note:** IF2: Interface 2

#### r8892.0...15 BO: IF2 PZD3 receive bit-serial / IF2 PZD3 recv bitw

DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2485, 9204, 9206
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Binector output for bit-serial interconnection of PZD3 received via interface 2.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Bit 0	ON	OFF	-
	01	Bit 1	ON	OFF	-
	02	Bit 2	ON	OFF	-
	03	Bit 3	ON	OFF	-
	04	Bit 4	ON	OFF	-
	05	Bit 5	ON	OFF	-
	06	Bit 6	ON	OFF	-
	07	Bit 7	ON	OFF	-
	08	Bit 8	ON	OFF	-
	09	Bit 9	ON	OFF	-
	10	Bit 10	ON	OFF	-
	11	Bit 11	ON	OFF	-
	12	Bit 12	ON	OFF	-
	13	Bit 13	ON	OFF	-
	14	Bit 14	ON	OFF	-
	15	Bit 15	ON	OFF	-

**Dependency:** Refer to: r8850

**Note:** IF2: Interface 2

#### r8893.0...15 BO: IF2 PZD4 receive bit-serial / IF2 PZD4 recv bitw

DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2485, 9204, 9206
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Binector output for bit-serial interconnection of PZD4 (normally control word 2) received via interface 2.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Bit 0	ON	OFF	-
	01	Bit 1	ON	OFF	-
	02	Bit 2	ON	OFF	-
	03	Bit 3	ON	OFF	-
	04	Bit 4	ON	OFF	-
	05	Bit 5	ON	OFF	-
	06	Bit 6	ON	OFF	-
	07	Bit 7	ON	OFF	-
	08	Bit 8	ON	OFF	-
	09	Bit 9	ON	OFF	-

10	Bit 10	ON	OFF	-
11	Bit 11	ON	OFF	-
12	Bit 12	ON	OFF	-
13	Bit 13	ON	OFF	-
14	Bit 14	ON	OFF	-
15	Bit 15	ON	OFF	-

**Dependency:** Refer to: r8850

**Note:** IF2: Interface 2

#### r8894.0...15 BO: IF2 connector-binector converter binector output / Con/bin outp

DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2485, 2491
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Binector output for bit-serial interconnection of a PZD word received via interface 2.  
The PZD is selected via p8899[0].

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Bit 0	ON	OFF	-
	01	Bit 1	ON	OFF	-
	02	Bit 2	ON	OFF	-
	03	Bit 3	ON	OFF	-
	04	Bit 4	ON	OFF	-
	05	Bit 5	ON	OFF	-
	06	Bit 6	ON	OFF	-
	07	Bit 7	ON	OFF	-
	08	Bit 8	ON	OFF	-
	09	Bit 9	ON	OFF	-
	10	Bit 10	ON	OFF	-
	11	Bit 11	ON	OFF	-
	12	Bit 12	ON	OFF	-
	13	Bit 13	ON	OFF	-
	14	Bit 14	ON	OFF	-
	15	Bit 15	ON	OFF	-

**Dependency:** Refer to: p8899

#### r8895.0...15 BO: IF2 connector-binector converter binector output / Con/bin outp

DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2485, 2491
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Binector output for bit-serial interconnection of a PZD word received via interface 2.  
The PZD is selected via p8899[1].

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Bit 0	ON	OFF	-
	01	Bit 1	ON	OFF	-
	02	Bit 2	ON	OFF	-
	03	Bit 3	ON	OFF	-
	04	Bit 4	ON	OFF	-
	05	Bit 5	ON	OFF	-
	06	Bit 6	ON	OFF	-
	07	Bit 7	ON	OFF	-
	08	Bit 8	ON	OFF	-
	09	Bit 9	ON	OFF	-



10	Bit 10	ON	OFF	-
11	Bit 11	ON	OFF	-
12	Bit 12	ON	OFF	-
13	Bit 13	ON	OFF	-
14	Bit 14	ON	OFF	-
15	Bit 15	ON	OFF	-

**Dependency:** Refer to: p8898, p8899

<b>p8898[0...1]</b>	<b>IF2 invert connector-binector converter binector output / Con/bin outp inv</b>			
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3	
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2485, 2491	
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -	
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1	
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>	
	-	-	0000 0000 0000 0000 bin	

**Description:** Setting to invert the individual binector outputs of the connector-binector converter.  
Using p8898[0], the signals of CI: p8899[0] are influenced.  
Using p8898[1], the signals of CI: p8899[1] are influenced.

<b>Bit field:</b>	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>	<b>FP</b>
	00	Bit 0	Inverted	Not inverted	-
	01	Bit 1	Inverted	Not inverted	-
	02	Bit 2	Inverted	Not inverted	-
	03	Bit 3	Inverted	Not inverted	-
	04	Bit 4	Inverted	Not inverted	-
	05	Bit 5	Inverted	Not inverted	-
	06	Bit 6	Inverted	Not inverted	-
	07	Bit 7	Inverted	Not inverted	-
	08	Bit 8	Inverted	Not inverted	-
	09	Bit 9	Inverted	Not inverted	-
	10	Bit 10	Inverted	Not inverted	-
	11	Bit 11	Inverted	Not inverted	-
	12	Bit 12	Inverted	Not inverted	-
	13	Bit 13	Inverted	Not inverted	-
	14	Bit 14	Inverted	Not inverted	-
	15	Bit 15	Inverted	Not inverted	-

**Dependency:** Refer to: r8894, r8895, p8899

<b>p8899[0...1]</b>	<b>CI: IF2 connector-binector converter signal source / Con/bin S_src</b>			
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3	
	<b>Data type:</b> Unsigned32 / Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2485, 2491	
	<b>P-Group:</b> Communications	<b>Units group:</b> -	<b>Unit selection:</b> -	
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1	
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>	
	-	-	0	

**Description:** Sets the signal source for the connector-binector converter.  
A PZD receive word can be selected as signal source. The signals are available to be serially passed-on (interconnection).

**Dependency:** Refer to: r8850, r8894, r8895, p8898

**Note:** From the signal source set via the connector input, the corresponding lower 16 bits are converted.  
p8899[0...1] together with r8894.0...15 and r8895.0...15 forms two connector-binector converters:  
Connector input p8899[0] to binector output in r8894.0...15  
Connector input p8899[1] to binector output in r8895.0...15

<b>r8909</b>	<b>PN device ID / PN device ID</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the PROFINET Device ID. Every SINAMICS device type has its own PROFINET Device ID and its own PROFINET GSD.		
<b>Note:</b>	List of the SINAMICS Device IDs: 0501 hex: S120/S150 0504 hex: G130/G150 050A hex: DC MASTER 050C hex: MV 050F hex: G120P 0510 hex: G120C 0511 hex: G120 CU240E-2 0512 hex: G120D 0513 hex: G120 CU250S-2 Vector 0514 hex: G110M 0515 hex: G120 CU250S-2 Servo		

---

<b>p8940[0...239]</b>	<b>CBE20 Name of Station / CBE20 Name Stat</b>		
CU_DC (PROFINET), CU_DC_R (PROFINET), CU_DC_R_S (PROFINET), CU_DC_S (PROFINET)	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned8 <b>P-Group:</b> - <b>Not for motor type:</b> -  <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -  <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1  <b>Factory setting</b> -
<b>Description:</b>	Sets the station name for the Communication Board Ethernet 20 (CBE20).		
<b>Note:</b>	An ASCII table (excerpt) can be found, for example, in the appendix to the List Manual. The parameter is only valid for firmware version "PROFINET Device" (p8835 = 1) or "Ethernet/IP" (p8835 = 4). The interface configuration (p8940 and following) is activated with p8945 = 2 (becomes effective after the next POWER ON). The parameter is not influenced by setting the factory setting.		

---

<b>p8941[0...3]</b>	<b>CBE20 IP Address of Station / CBE20 IP of Stat</b>		
CU_DC (PROFINET), CU_DC_R (PROFINET), CU_DC_R_S (PROFINET), CU_DC_S (PROFINET)	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned8 <b>P-Group:</b> - <b>Not for motor type:</b> -  <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -  <b>Max</b> 255	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1  <b>Factory setting</b> 0
<b>Description:</b>	Sets the IP address for the Communication Board Ethernet 20 (CBE20).		

**Note:** The parameter is only valid for firmware version "PROFINET Device" (p8835 = 1) or "Ethernet/IP" (p8835 = 4).  
The interface configuration (p8940 and following) is activated with p8945 = 2 (becomes effective after the next POWER ON).  
The parameter is not influenced by setting the factory setting.

<b>p8942[0...3]</b>	<b>CBE20 Default Gateway of Station / CBE20 Def Gateway</b>		
CU_DC (PROFINET), CU_DC_R (PROFINET), CU_DC_R_S (PROFINET), CU_DC_S (PROFINET)	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned8	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 255	<b>Factory setting</b> 0

**Description:** Sets the default gateway for the Communication Board Ethernet 20 (CBE20).

**Note:** The parameter is only valid for firmware version "PROFINET Device" (p8835 = 1) or "Ethernet/IP" (p8835 = 4).  
The interface configuration (p8940 and following) is activated with p8945 = 2 (becomes effective after the next POWER ON).  
The parameter is not influenced by setting the factory setting.

<b>p8943[0...3]</b>	<b>CBE20 Subnet Mask of Station / CBE20 Subnet Mask</b>		
CU_DC (PROFINET), CU_DC_R (PROFINET), CU_DC_R_S (PROFINET), CU_DC_S (PROFINET)	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned8	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 255	<b>Factory setting</b> 0

**Description:** Sets the subnet mask for the Communication Board Ethernet 20 (CBE20).

**Note:** The parameter is only valid for firmware version "PROFINET Device" (p8835 = 1) or "Ethernet/IP" (p8835 = 4).  
The interface configuration (p8940 and following) is activated with p8945 = 2 (becomes effective after the next POWER ON).  
The parameter is not influenced by setting the factory setting.

<b>p8944</b>	<b>CBE20 DHCP Mode / CBE20 DHCP Mode</b>		
CU_DC (PROFINET), CU_DC_R (PROFINET), CU_DC_R_S (PROFINET), CU_DC_S (PROFINET)	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned8	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 255	<b>Factory setting</b> 0

**Description:** Sets the DHCP mode for the Communication Board Ethernet 20 (CBE20).

**Note:** The parameter is only valid for firmware version "PROFINET Device" (p8835 = 1) or "Ethernet/IP" (p8835 = 4).  
The interface configuration (p8940 and following) is activated with p8945 = 2 (becomes effective after the next POWER ON).  
The parameter is not influenced by setting the factory setting.

<b>p8945</b>	<b>CBE20 interface configuration / CBE20 IF config</b>		
CU_DC (PROFINET), CU_DC_R (PROFINET), CU_DC_R_S (PROFINET), CU_DC_S (PROFINET)	<b>Can be changed:</b> U, T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 3	<b>Factory setting</b> 0
<b>Description:</b>	Sets the activation of the interface configuration for the Communication Board Ethernet 20 (CBE20). p8945 is automatically set to 0 at the end of an operation.		
<b>Value:</b>	0: No function 2: Save and activate configuration 3: Delete configuration		
<b>Note:</b>	The parameter is only valid for firmware version "PROFINET Device" (p8835 = 1) or "Ethernet/IP" (p8835 = 4). Otherwise, it is locked. Re p8945 = 2: The interface configuration (p8940 and following) is saved and activated after the next POWER ON. Re p8945 = 3: The factory setting of the interface configuration is loaded after the next POWER ON.		
<b>r8950[0...239]</b>	<b>CBE20 Name of Station active / CBE20 name act</b>		
CU_DC (PROFINET), CU_DC_R (PROFINET), CU_DC_R_S (PROFINET), CU_DC_S (PROFINET)	<b>Can be changed:</b> - <b>Data type:</b> Unsigned8 <b>P-Group:</b> - <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> -
<b>Description:</b>	Displays the active station name for the Communication Board Ethernet 20 (CBE20).		
<b>r8951[0...3]</b>	<b>CBE20 IP Address of Station active / CBE20 IP act</b>		
CU_DC (PROFINET), CU_DC_R (PROFINET), CU_DC_R_S (PROFINET), CU_DC_S (PROFINET)	<b>Can be changed:</b> - <b>Data type:</b> Unsigned8 <b>P-Group:</b> - <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 255	<b>Factory setting</b> -
<b>Description:</b>	Displays the active IP address for the Communication Board Ethernet 20 (CBE20).		

<b>r8952[0...3]</b>	<b>CBE20 Default Gateway of Station active / CBE20 def GW act</b>		
CU_DC (PROFINET), CU_DC_R (PROFINET), CU_DC_R_S (PROFINET), CU_DC_S (PROFINET)	Can be changed: - Data type: Unsigned8 P-Group: - Not for motor type: -	Calculated: - Dyn. index: - Units group: - Scaling: -	Access level: 3 Func. diagram: - Unit selection: - Expert list: 1
	Min 0	Max 255	Factory setting -
<b>Description:</b>	Displays the active standard gateway for the Communication Board Ethernet 20 (CBE20).		
<b>r8953[0...3]</b>	<b>CBE20 Subnet Mask of Station active / CBE20 sub mask act</b>		
CU_DC (PROFINET), CU_DC_R (PROFINET), CU_DC_R_S (PROFINET), CU_DC_S (PROFINET)	Can be changed: - Data type: Unsigned8 P-Group: - Not for motor type: -	Calculated: - Dyn. index: - Units group: - Scaling: -	Access level: 3 Func. diagram: - Unit selection: - Expert list: 1
	Min 0	Max 255	Factory setting -
<b>Description:</b>	Displays the active subnet mask for the Communication Board Ethernet 20 (CBE20).		
<b>r8954</b>	<b>CBE20 DHCP Mode active / CBE20 DHCP act</b>		
CU_DC (PROFINET), CU_DC_R (PROFINET), CU_DC_R_S (PROFINET), CU_DC_S (PROFINET)	Can be changed: - Data type: Unsigned8 P-Group: - Not for motor type: -	Calculated: - Dyn. index: - Units group: - Scaling: -	Access level: 3 Func. diagram: - Unit selection: - Expert list: 1
	Min 0	Max 255	Factory setting -
<b>Description:</b>	Displays the active DHCP mode for the Communication Board Ethernet 20 (CBE20).		
<b>r8955[0...5]</b>	<b>CBE20 MAC Address of Station / CBE20 MAC addr</b>		
CU_DC (PROFINET), CU_DC_R (PROFINET), CU_DC_R_S (PROFINET), CU_DC_S (PROFINET)	Can be changed: - Data type: Unsigned8 P-Group: - Not for motor type: -	Calculated: - Dyn. index: - Units group: - Scaling: -	Access level: 3 Func. diagram: - Unit selection: - Expert list: 1
	Min 0000 hex	Max 00FF hex	Factory setting -
<b>Description:</b>	Displays the MAC address for the Communication Board Ethernet 20 (CBE20).		

<b>r8959</b>	<b>CBE20 DAP ID / CBE20 DAP ID</b>		
CU_DC (PROFINET), CU_DC_R (PROFINET), CU_DC_R_S (PROFINET), CU_DC_S (PROFINET)	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> - <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> 0000 hex	<b>Max</b> FFFF FFFF hex	<b>Factory setting</b> -
<b>Description:</b>	Displays the PROFINET Device Access Point ID (DAP ID) for PROFINET CBE20. The combination of device ID (r8909) and DAP ID uniquely identifies a PROFINET access point.		
<b>Note:</b>	List of the SINAMICS CBE20 DAP IDs: 20007 hex: CBE20 V4.5 20008 hex: CBE20 V4.6		

<b>r8960[0...2]</b>	<b>PN subslot controller assignment / PN subslot assign</b>		
All objects	<b>Can be changed:</b> - <b>Data type:</b> Unsigned8 <b>P-Group:</b> - <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 8	<b>Factory setting</b> -
<b>Description:</b>	Displays the controller assignment of a PROFINET subslot on the actual drive object.		
<b>Index:</b>	[0] = Subslot 2 PROFIsafe [1] = Subslot 3 PZD telegram [2] = Subslot 4 PZD supplementary data		
<b>Note:</b>	Example: If the parameter contains the value 2 in index [1], then this means that subslot 3 is assigned to controller 2.		

<b>r8970[0...2]</b>	<b>CBE20 subslot controller assignment / CBE20 subslot</b>		
CU_DC (PROFINET), CU_DC_R (PROFINET), CU_DC_R_S (PROFINET), CU_DC_S (PROFINET), DC_CTRL (PROFINET), DC_CTRL_R (PROFINET), DC_CTRL_R_S (PROFINET), DC_CTRL_S (PROFINET), TM150 (PROFINET), TM15DI_DO (PROFINET), TM31 (PROFINET)	<b>Can be changed:</b> - <b>Data type:</b> Unsigned8 <b>P-Group:</b> - <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 8	<b>Factory setting</b> -
<b>Description:</b>	Displays the controller assignment of a PROFINET subslot on the actual drive object.		

<b>Index:</b>	[0] = Subslot 2 PROFIsafe [1] = Subslot 3 PZD telegram [2] = Subslot 4 PZD supplementary data
<b>Dependency:</b>	Refer to: r8971, r8972
<b>Note:</b>	Example: If the parameter contains the value 2 in index [1], then this means that subslot 3 is assigned to controller 2.

<b>r8971[0...3]</b>	<b>CBE20 IP Address Remote Controller 1 / CBE20 IP Rem Ctrl1</b>		
CU_DC (PROFINET), CU_DC_R (PROFINET), CU_DC_R_S (PROFINET), CU_DC_S (PROFINET)	<b>Can be changed:</b> - <b>Data type:</b> Unsigned8 <b>P-Group:</b> - <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 255	<b>Factory setting</b> -

**Description:** Displays the IP address of the first PROFINET controller connected with the device via CBE20.

<b>r8972[0...3]</b>	<b>CBE20 IP Address Remote Controller 2 / CBE20 IP Rem Ctrl2</b>		
CU_DC (PROFINET), CU_DC_R (PROFINET), CU_DC_R_S (PROFINET), CU_DC_S (PROFINET)	<b>Can be changed:</b> - <b>Data type:</b> Unsigned8 <b>P-Group:</b> - <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 255	<b>Factory setting</b> -

**Description:** Displays the IP address of the second PROFINET controller connected with the device via CBE20.

<b>p9206[0...2]</b>	<b>Topology direct access / Topo access</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 <b>P-Group:</b> Topology <b>Not for motor type:</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 4294967295	<b>Factory setting</b> 0

**Description:** Data setting to read topology properties.  
The result is displayed depending on the property in r9207 or r9208.  
Re index 0:  
0: actual topology, 1: target topology  
Re index 1:  
Sets the component number of the component involved.  
Re index 2:  
7: Name (r9208)  
8: Component type (r9207)  
9: Number of DRIVE-CLiQ connections (r9207)  
11: Manufacturer (upper byte) and version (lower byte) (r9207)  
12: Serial number (r9208)  
13: Index (r9207)  
15: Comparison level (r9207)  
23: Order number (r9207)  
24: Hardware serial number (r9208)

	25: Collective order number (r9207)
	28: Firmware version (r9207)
	29: EPROM version (r9207)
	30: Hardware version (r9207)
<b>Index:</b>	[0] = Actual topology/target topology [1] = Component number [2] = Identifier/property
<b>Dependency:</b>	Refer to: r9207, r9208

<b>r9207</b>	<b>Topology direct access integer value / Topo access int</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> Topology <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the value for the property set in p9206. A value is only displayed for integer type properties.		
<b>Dependency:</b>	Refer to: p9206, r9208		

<b>r9208[0...50]</b>	<b>Topology direct access string / Topo access string</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned8 <b>P-Group:</b> Topology <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the value for the property set in p9206. A value is only displayed for string type properties.		
<b>Dependency:</b>	Refer to: p9206, r9207		
<b>Note:</b>	An ASCII table (excerpt) can be found, for example, in the appendix to the List Manual.		

<b>p9210</b>	<b>Flashing component number / Flash comp_no</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned16 <b>P-Group:</b> Topology <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 499	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the component number for a component to get its status LED to flash.		
<b>Dependency:</b>	Refer to: p9211		

<b>p9211</b>	<b>Flash function / Flash fct.</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> Integer16 <b>P-Group:</b> Topology <b>Not for motor type:</b> - <b>Min</b> -1	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -1
<b>Description:</b>	Sets the function for the component selected in p9210. After initiating a function, the parameter is automatically reset again.		



Example:

- Set the component number (p9210).
- Select the "flashing on" function (set p9211 = 1).

**Value:**

- 1: Select function
- 0: Flashing off
- 1: Flashing on

**Dependency:** Refer to: p9210

**Notice:** If a task cannot be executed (e.g. the component number in p9210 does not exist), the following applies:

- There is no negative feedback signal.
- The value is reset anyway.

---

### p9400 Safely remove memory card / Mem\_card rem

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 100	<b>Access level:</b> 2 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
--	---	---	---

**Description:** Setting and display when memory card is "removed safely".  
Procedure:  
Setting p9400 = 2 results in a value of 3  
--> The memory card can be removed safely. After removal the value sets itself to 0 automatically.  
Setting p9400 = 2 results in a value of 100  
--> The memory card cannot be removed safely. Removal may destroy the file system on the memory card. It may be necessary to set p9400 = 2 again.

**Value:**

- 0: No memory card inserted
- 1: Memory card inserted
- 2: Request "safe removal" of the memory card
- 3: "Safe removal" possible
- 100: "Safe removal" not possible due to access

**Dependency:** Refer to: r9401

**Notice:** Removing the memory card without a request (p9400 = 2) and confirmation (p9400 = 3) may destroy the file system on the memory card. The memory card will then no longer work properly and must be replaced.

**Note:** The status when the memory card is being "removed safely" is shown in r9401.  
Re value = 0, 1, 3, 100:  
These values can only be displayed, not set.

---

### r9401 Safely remove memory card status / Mem\_card rem stat

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
--	--	---	---

**Description:** Displays the status of the memory card.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Memory card inserted	Yes	No	-
	01	Memory card activated	Yes	No	-
	02	SIEMENS memory card	Yes	No	-
	03	Memory card as USB data storage medium from the PC used	Yes	No	-

**Dependency:** Refer to: p9400

**Note:**

Re bit 00 and bit 01:  
 Bit 1/0 = 0/0: No memory card inserted (corresponds to p9400 = 0).  
 Bit 1/0 = 0/1: "Safe removal" possible (corresponds to p9400 = 3).  
 Bit 1/0 = 1/0: Status not possible.  
 Bit 1/0 = 1/1: Memory card inserted (corresponds to p9400 = 1, 2, 100).  
 Re bit 00 and bit 02:  
 Bit 2/0 = 0/0: No memory card inserted.  
 Bit 2/0 = 0/1: Memory card inserted, but not a SIEMENS memory card.  
 Bit 2/0 = 1/0: Status not possible.  
 Bit 2/0 = 1/1: SIEMENS memory card inserted.

<b>r9406[0...19]</b>	<b>PS file parameter number parameter not transferred / PS par_no n transf</b>		
All objects	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays the parameters that were not able to be transferred when reading the parameter back-up files (PS files) from the non-volatile memory (e.g. memory card). r9406[0] = 0 --> All of the parameter values were able to be transferred error-free. r9406[0...x] > 0 --> indicates the parameter number in the following cases: - parameter, whose value was not able to be completely accepted. - indexed parameter, where at least 1 index was not able to be accepted. The first index that is not transferred is displayed in r9407.		
<b>Dependency:</b>	Refer to: r9407, r9408		
<b>Note:</b>	All indices from r9406 to r9408 designate the same parameter. r9406[x] parameter number, parameter not accepted r9407[x] parameter index, parameter not accepted r9408[x] fault code, parameter not accepted		

<b>r9407[0...19]</b>	<b>PS file parameter index parameter not transferred / PS parameter index</b>		
All objects	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays the first index of the parameters that could not be transferred when the parameter backup files (PS files) were read from the non-volatile memory (e.g. memory card). If, from an indexed parameter, at least one index was not able to be transferred, then the parameter number is displayed in r9406[n] and the first index that was not transferred is displayed in r9407[n]. r9406[0] = 0 --> All of the parameter values were able to be transferred error-free. r9406[n] > 0 --> Displays r9407[n] the first index of the parameter number r9406[n] that was not transferred.		
<b>Dependency:</b>	Refer to: r9406, r9408		
<b>Note:</b>	All indices from r9406 to r9408 designate the same parameter. r9406[x] parameter number, parameter not accepted r9407[x] parameter index, parameter not accepted r9408[x] fault code, parameter not accepted		

<b>r9408[0...19] PS file fault code parameter not transferred / PS fault code</b>			
All objects	<b>Can be changed:</b> - <b>Data type:</b> Unsigned16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 1 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Only for internal Siemens service purposes.		
<b>Dependency:</b>	Refer to: r9406, r9407		
<b>Note:</b>	All indices from r9406 to r9408 designate the same parameter. r9406[x] parameter number, parameter not accepted r9407[x] parameter index, parameter not accepted r9408[x] fault code, parameter not accepted		

<b>r9409 Number of parameters to be saved / Qty par to save</b>			
All objects	<b>Can be changed:</b> - <b>Data type:</b> Unsigned16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the number of modified parameters and those that have still not be saved for this drive object.		
<b>Dependency:</b>	Refer to: p0971, p0977		
<b>Notice:</b>	Inherent to the system, the list of the parameters to be backed up is empty after the following actions: - Download - Warm restart - Factory setting  In these cases, a new parameter backup must be initiated, which is then the starting point for the list of modified parameters.		
<b>Note:</b>	The modified parameters that still need to be saved are internally listed in r9410 ... r9419.		

<b>r9450[0...29] Reference value change parameter with unsuccessful calculation / Ref_chg par n poss</b>			
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the parameters for which the re-calculation was unsuccessful after an internal system reference value change.		

<b>r9451[0...29] Units changeover adapted parameters / Unit_chngov par</b>			
DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 1 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the parameters whose parameter would have to be changed during a units changeover.		

**r9481 Number of BICO interconnections / BICO count**

All objects	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the number of BICO interconnections (signal sinks).

**Dependency:** Refer to: r9482, r9483

**Note:** The selected BICO interconnections should be entered into r9482 and r9483.

**r9482[0...n] BICO interconnections BI/CI parameters / BICO BI/CI par**

All objects	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> r9481	<b>Func. diagram:</b> -
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the signal sinks (binector/connector inputs, BI/CI parameters).

The number of BICO interconnections is displayed in r9481.

**Dependency:** Refer to: r9481, r9483

**Note:** The list is sorted according to signal sources and is structured as follows:

r9842[0]: Interconnection 1 (signal sink, BICO coded), r9843[0]: Interconnection 1 (signal source, BICO coded)

r9842[1]: Interconnection 2 (signal sink, BICO coded), r9843[1]: Interconnection 2 (signal source, BICO coded)

...

**r9483[0...n] BICO interconnections BO/CO parameters / BICO BO/CO par**

All objects	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> r9481	<b>Func. diagram:</b> -
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the signal sources (binector/connector outputs, BO/CO parameters).

The number of BICO interconnections is displayed in r9481.

**Dependency:** Refer to: r9481, r9482

**Note:** The list is sorted according to signal sources and is structured as follows:

r9842[0]: Interconnection 1 (signal sink, BICO coded), r9843[0]: Interconnection 1 (signal source, BICO coded)

r9842[1]: Interconnection 2 (signal sink, BICO coded), r9843[1]: Interconnection 2 (signal source, BICO coded)

...

**p9484 BICO interconnections search signal source / BICO S\_src srch**

All objects	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	4294967295	0

**Description:** Sets the signal source (BO/CO parameter, BICO coded) to search in the signal sinks.

The question is answered:

How often is a connection made to a signal source in the drive object and from which index are these interconnections saved (r9482 and r9483)?

**Dependency:** Refer to: r9481, r9482, r9483, r9485, r9486

---

**r9485 BICO interconnections signal source search count / BICO S\_src srchQty**


---

All objects	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the number of BICO interconnections to the signal sink being searched for.

**Dependency:** Refer to: r9481, r9482, r9483, p9484, r9486

**Note:** The signal source to be searched is set in p9484 (BICO-coded).  
The search result is contained in r9482 and r9483 and is specified by the count (r9485) and the first index (r9486).

---

**r9486 BICO interconnections signal source search first index / BICO S\_src srchIdx**


---

All objects	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the first index of the signal source being searched for.

**Dependency:** Refer to: r9481, r9482, r9483, p9484, r9485

**Note:** The signal source to be searched is set in p9484 (BICO-coded).  
The search result is contained in r9482 and r9483 and is specified by the count (r9485) and the first index (r9486).

---

**r9490 Number of BICO interconnections to other drives / Qty BICO to drive**


---

All objects	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the number of signal sources from this drive to other drives/drive objects (Binector Output/Connector Output, BO/CO).

**Dependency:** Refer to: r9491, r9492, p9493

---

**r9491[0...9] BI/CI of BICO interconnections to other drives / BI/CI to drive**


---

All objects	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the signal receiver list (Binector Input/Connector Input, BI/CI) for the first interconnections between this drive and other drives/drive objects.

**Dependency:** Refer to: r9490, r9492, p9493

**Notice:** A drive cannot be deleted if this list is not empty!  
Otherwise, another drive would continue to attempt to read a signal from a drive that no longer existed.

**Note:** All indices of r9491 to p9493 designate the same interconnection.  
r9491[x] contains the signal receiver and r9492[x] the matching signal source; p9493[x] can be set to modify the interconnection.

<b>r9492[0...9]</b>	<b>BO/CO of BICO interconnections to other drives / BO/CO to drive</b>		
All objects	<b>Can be changed:</b> - <b>Data type:</b> Unsigned32 <b>P-Group:</b> Commands <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the signal source list (Binector Output/Connector Output, BO/CO) for the first interconnections between this drive and other drives/drive objects.		
<b>Dependency:</b>	Refer to: r9490, r9491, p9493		
<b>Notice:</b>	A drive cannot be deleted if this list is not empty! Otherwise, another drive would continue to attempt to read a signal from a drive that no longer existed.		
<b>Note:</b>	All indices of r9491 to p9493 designate the same interconnection. r9491[x] contains the signal receiver and r9492[x] the matching signal source; p9493[x] can be set to modify the interconnection.		
<b>p9493[0...9]</b>	<b>Reset BICO interconnections to other drives / Reset BICO to drv</b>		
All objects	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 15	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 15
<b>Description:</b>	Setting to reset the BICO interconnections to other drives. Each interconnection can be individually reset.		
<b>Value:</b>	0: Set connection to 0 1: Set connection to 1 (100 %) 2: Set connection to factory setting 15: Finished		
<b>Dependency:</b>	Refer to: r9490, r9491, r9492		
<b>Note:</b>	All indices of r9491 to p9493 designate the same interconnection. r9491[x] contains the signal receiver and r9492[x] the matching signal source; p9493[x] can be set to modify the interconnection.		
<b>p9495</b>	<b>BICO behavior for de-activated drive objects / Behav for deact DO</b>		
All objects	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 2	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the behavior for BICO interconnections to drive objects that are either not capable of operation or have been deactivated. BO/CO parameters are on the drive object that is either not capable of operation or has been deactivated (signal source).		
<b>Value:</b>	0: Inactive 1: Save interconnections 2: Save interconnections and establish the factory setting		
<b>Dependency:</b>	Refer to: p9496, p9497, p9498, p9499		

**Note:** For p9495 = 0, the following applies:  
 - the number of interconnections is zero (p9497 = 0).  
 For p9495 not equal to 0, the following applies:  
 - the BI/CI parameters involved are listed in p9498[0...29] (signal sink).  
 - the associated BO/CO parameters are listed in p9499[0...29] (signal source).

<b>p9496 BICO behavior when activating drive objects / Behav when act DO</b>			
All objects	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 2	<b>Factory setting</b> 0
<b>Description:</b>	Sets the behavior when activating BICO interconnections to drive objects that are either not capable of operation or have been deactivated.		
<b>Value:</b>	0: Inactive 1: Restore the interconnections from the list 2: Delete the interconnections from the list		
<b>Dependency:</b>	Refer to: p9495, p9497, p9498, p9499		
<b>Note:</b>	The BI/CI parameters involved are listed in p9498[0...29] (signal sink). The associated BO/CO parameters are listed in p9499[0...29] (signal source). After p9496 = 1, 2 the following applies: - p9497 = 0 - p9496 = 0		

<b>p9497 BICO interconnections to de-activated drive objects number / Interconn obj qty</b>			
All objects	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 65535	<b>Factory setting</b> 0
<b>Description:</b>	Displays the number of saved BICO interconnections to drive objects that are either not capable of operation or have been deactivated. BO/CO parameters are on the drive object that is either not capable of operation or has been deactivated (signal source).		
<b>Dependency:</b>	Refer to: p9495, p9496, p9498, p9499		

<b>p9498[0...29] BICO BI/CI parameters to de-activated drive objects / BI/CI to deact obj</b>			
All objects	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> 0
<b>Description:</b>	Displays the saved BI/CI parameters (signal sink), whose source is located on drive objects that are either not capable of operation or have been deactivated.		
<b>Dependency:</b>	Refer to: p9495, p9496, p9497, p9499		
<b>Note:</b>	A BICO interconnection (signal sink, signal source) is displayed in the same index of p9498 and p9499.		

<b>p9499[0...29]</b>	<b>BICO BO/CO parameters to de-activated drive objects / BO/CO to deact obj</b>		
All objects	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Commands	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0
<b>Description:</b>	Displays the saved BO/CO parameters (signal source), which are located on drive objects that are either not capable of operation or have been deactivated.		
<b>Dependency:</b>	Refer to: p9495, p9496, p9497, p9498		
<b>Note:</b>	A BICO interconnection (signal sink, signal source) is displayed in the same index of p9498 and p9499.		

<b>r9900</b>	<b>Actual topology number of indices / Act topo indices</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Topology	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays the number of indices of the actual topology.		
<b>Dependency:</b>	Refer to: r9901		
<b>Note:</b>	Only for internal Siemens use. The parameter is not displayed for the STARTER commissioning software.		

<b>r9901[0...n]</b>	<b>Actual topology / Act topo</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> r9900	<b>Func. diagram:</b> -
	<b>P-Group:</b> Topology	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 0
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

<b>Description:</b>	<p>Displays the actual topology of the drive unit.</p> <p>The actual topology is sub-divided into several sections. Each of the following data is saved under an index.</p> <p>General data on the topology:</p> <ul style="list-style-type: none"> <li>- version</li> <li>- attribute to compare the actual topology and target topology</li> <li>- number of components</li> </ul> <p>Data on a component:</p> <ul style="list-style-type: none"> <li>- type component of the node ID of the component</li> <li>- number of DRIVE-CLiQ sockets in the Node Identifier</li> <li>- manufacturer and version of the Node Identifier</li> <li>- serial number of the Node Identifier (4 indices)</li> <li>- index of the component</li> <li>- order number (8 indices)</li> <li>- attribute to compare the actual topology and target topology of the component</li> <li>- communications address</li> <li>- number of port types</li> <li>- port type</li> <li>- number of ports of the port type</li> <li>- communications address of the associated/linked component</li> <li>- number of the associated/linked port</li> </ul>		
---------------------	--	--	--



- communications address of the associated/linked component
- number of the associated port, etc.
- Data on the next component:
- etc.

**Dependency:**

Refer to: r9900

**Note:**

Only for internal Siemens use.

The parameter is not displayed for the STARTER commissioning software.

## p9902

### Target topology number of indices / TargetTopo indices

CU\_DC, CU\_DC\_R,  
CU\_DC\_R\_S,  
CU\_DC\_S

**Can be changed:** -

**Calculated:** -

**Access level:** 3

**Data type:** Unsigned16

**Dyn. index:** -

**Func. diagram:** -

**P-Group:** Topology

**Units group:** -

**Unit selection:** -

**Not for motor type:** -

**Scaling:** -

**Expert list:** 0

**Min**

**Max**

**Factory setting**

1

65535

1

**Description:**

Sets the number of target topology indices.

**Dependency:**

Refer to: p9903

**Note:**

Only for internal Siemens use.

The parameter is not displayed for the STARTER commissioning software.

## p9903[0...n]

### Target topology / Target topo

CU\_DC, CU\_DC\_R,  
CU\_DC\_R\_S,  
CU\_DC\_S

**Can be changed:** -

**Calculated:** -

**Access level:** 3

**Data type:** Unsigned16

**Dyn. index:** p9902

**Func. diagram:** -

**P-Group:** Topology

**Units group:** -

**Unit selection:** -

**Not for motor type:** -

**Scaling:** -

**Expert list:** 0

**Min**

**Max**

**Factory setting**

0000 hex

FFFF hex

0000 hex

**Description:**

Sets the target topology of the drive unit.

The target topology is sub-divided into several sections. Each of the following data is saved under an index.

General data on the topology:

- version
- attribute to compare the actual topology and target topology
- number of components
- Data on a component:
- type component of the Node Identifier of the component
- number of DRIVE-CLiQ sockets in the Node Identifier
- manufacturer and version of the Node Identifier
- serial number of the Node Identifier (4 indices)
- index of the component
- order number (8 indices)
- attribute to compare the actual topology and target topology of the component
- component number
- number of port types
- port type
- number of ports of the port type
- component number of the associated/linked component
- number of the associated/linked port
- component number of the associated/linked component
- number of the associated port, etc.

Data on the next component:

- etc.

**Dependency:**

Refer to: p9902

**Note:** The target topology can only be modified using the commissioning software.  
The parameter is not displayed for the STARTER commissioning software.  
Changes only become effective when the state of p0009 = 101 changes to 0 or 111.

p9904		Topology comparison acknowledge differences / Topo_compare ackn	
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> C1(1)	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Topology	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0000 hex	<b>Max</b> FFFF FFFF hex	<b>Factory setting</b> 0000 hex
<b>Description:</b>	If, when comparing the actual topology and target topology, only error has occurred, that can be acknowledged, then using this parameter, a new comparison can be started - acknowledging the error in the target topology. Differences that can be acknowledged: - topology comparison, component shifted - topology comparison, serial number of a component has been detected to be different (byte 3 = 1) - topology comparison shows one component that is connected differently The following parameter values are available: p9904 = 1 --> the procedure is started. p9904 = 0 after starting --> the procedure has been successfully completed. p9904 = 1 after starting --> the procedure has not been successfully completed. The possible causes for an unsuccessful procedure are located in bytes 4, 3, 2. Byte 2: Number of structural differences. Byte 3: Number of differences that can be acknowledged (p9904). Byte 4: Number of differences. These differences can be resolved as follows: - sets the topology comparison (p9906 or p9907/p9908). - change over the actual topology. The appropriate action should be selected corresponding to the message that is displayed/output.		
<b>Note:</b>	In order to permanently accept the acknowledgement of the fault that can be resolved, then it must be saved in a non-volatile fashion (p0977).		

p9905		Device specialization / Specialization		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> C1(1)	<b>Calculated:</b> -	<b>Access level:</b> 3	
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -	
	<b>P-Group:</b> Topology	<b>Units group:</b> -	<b>Unit selection:</b> -	
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1	
	<b>Min</b> 0	<b>Max</b> 2	<b>Factory setting</b> 0	
<b>Description:</b>	With p9905 = 1, the serial numbers and the hardware versions of all of the components are transferred from the actual topology into the target topology and a new comparison is started. For this device specialization, the components of the target topology may only differ from those of the actual topology by the serial numbers. With p9905 = 2, the serial numbers, the hardware versions and the order numbers of all of the components are transferred from the actual topology into the target topology and a new comparison is started. For this device specialization, the components of the target topology may only differ from those of the actual topology by the serial numbers and order numbers.			
<b>Note:</b>	p9905 is automatically set to 0 at the end of the operation. In order to permanently accept the data, it is necessary to save in a non-volatile fashion (p0977).			

<b>p9906</b>	<b>Topology comparison comparison stage of all components / Topo_cmpr tot comp</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> C1(1) <b>Data type:</b> Integer16 <b>P-Group:</b> Topology <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 99	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the type of comparison between the actual topology and target topology. The comparison is started by setting the required value.		
<b>Value:</b>	0: High: Compares the complete electronic rating plate 1: Average: Compares the component type and the Order number 2: Low: Compares the component type 3: Minimum: Compares the component class 99: Topology has different comparison stages		
<b>Note:</b>	The electronic rating plate comprises the following data: - component type (e.g. "SMC20") - Order No. (e.g. "6SL3055-0AA0-5BA0") - manufacturer (e.g. SIEMENS) - hardware version (e.g. "A") - Serial No. (e.g. "T-P30050495") When comparing the topology, the following data is compared in the target and actual topologies: p9906 = 0: Component type, Order No., Hardware version, Manufacturer, Serial No. p9906 = 1: Component type, Order No. p9906 = 2: Component type p9906 = 3: Component class (e.g. Sensor Module or Motor Module)		
<b>p9907</b>	<b>Topology comparison comparison stage of the component number / Topo_cmpr comp_no</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> C1(1) <b>Data type:</b> Unsigned8 <b>P-Group:</b> Topology <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 199	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Enters the number of the component where the setting of how the actual topology should be compared to the target topology should be changed.		
<b>Dependency:</b>	Refer to: p9908		
<b>p9908</b>	<b>Topology comparison comparison stage of a component / Topo_cmpr 1 comp</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> C1(1) <b>Data type:</b> Integer16 <b>P-Group:</b> Topology <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 99	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the type of comparison of a component in the target topology with the actual topology. The comparison is started by setting the required value.		
<b>Value:</b>	0: High: Compares the complete electronic rating plate 1: Average: Compares the component type and the Order number 2: Low: Compares the component type 3: Minimum: Compares the component class 99: Topology has different comparison stages		
<b>Dependency:</b>	Refer to: p9907		

**Note:** The electronic rating plate comprises the following data:

- component type (e.g. "SMC20")
- Order No. (e.g. "6SL3055-0AA0-5BA0")
- manufacturer (e.g. SIEMENS)
- hardware version (e.g. "A")
- Serial No. (e.g. "T-P30050495")

When comparing the topology, the following data is compared in the target and actual topologies:

p9908 = 0: Component type, Order No., Hardware version, Manufacturer, Serial No.

p9908 = 1: Component type, Order No.

p9908 = 2: Component type

p9908 = 3: Component class (e.g. Sensor Module or Motor Module)

<b>p9909 Topology comparison component replacement / Topo_cmpr replace</b>			
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> C1(1)	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned8	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Topology	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	1	1
<b>Description:</b>	For p9909 = 1, the serial number and the hardware version of the new replaced component is automatically transferred from the actual topology into the target topology and then saved in a non-volatile fashion. For the components that have been replaced, the electronic rating plate must match as far as the following data is concerned: - component type (e.g. "SMC20") - Order No. (e.g. "6SL3055-0AA0-5BA0") For p9909 = 0, serial numbers and hardware versions are not automatically transferred. In this case, the transfer must be made using p9904.		
<b>Dependency:</b>	Refer to: p9904, p9905		
<b>Note:</b>	The modified target topology is automatically saved in a non-volatile fashion when the drive object runs-up (e.g. after a POWER ON). Special case for Control Unit and option slot modules: When replacing these components, independent of p9909, the serial number and hardware version are automatically transferred and saved in a non-volatile fashion.		

<b>p9910 Transfer additional components into the target topology / Transfer comp</b>			
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> C1(1)	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Topology	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	1	0
<b>Description:</b>	Transfer additional inserted DRIVE-CLiQ components into the target topology and add the appropriate drive objects to the project.		
<b>Value:</b>	0: No selection 1: Transfer components		

<b>p9915 DRIVE-CLiQ data transfer error shutdown threshold master / DQ fault master</b>			
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> C1(1)	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> Topology	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0000 hex	0007 07FF hex	0007 02FF hex
<b>Description:</b>	Only for internal Siemens service purposes.		

<b>p9916</b>	<b>DRIVE-CLiQ data transfer error shutdown threshold slave / DQ fault slave</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> C1(1) <b>Data type:</b> Unsigned32 <b>P-Group:</b> Topology <b>Not for motor type:</b> - <b>Min</b> 0000 hex	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 0007 07FF hex	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0007 02FF hex
<b>Description:</b>	Only for internal Siemens service purposes.		
<b>p9920[0...99]</b>	<b>Licensing enter license key / Enter license key</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned8 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Enters the license key for this drive unit. Example of the license key: EACZ-QBCA = 69 65 67 90 45 81 66 67 65 dec (ASCII characters) Index 0 = license key character 1 (e.g. 69 dec) Index 1 = license key character 2 (e.g. 65 dec) ... Index 8 = license key character 9 (e.g. 65 dec) Index 9 = license key character 10 (e.g. 0 dec) ...		
<b>Dependency:</b>	Refer to: r7843, p9921		
<b>Notice:</b>	An ASCII table (excerpt) can be found, for example, in the appendix to the List Manual. With the STARTER commissioning software, ASCII characters are not entered coded, i.e. the characters of the license key can be entered as printed in the Certificate of License. In this case, STARTER codes the characters.		
<b>Note:</b>	For an invalid license key, all the indices have the value 0 dec. Only the ASCII characters contained in a license key can be entered ("1" to "9", "A" to "H", "K" to "N", "P" to "Z" as well as "-"). When manually changing p9920[x] to the value 0 dec, all the values of all the following indices are also set to 0 dec. After entering the license key, the license key must be activated (p9921). If the licensing is not adequate, then the following alarm is displayed together with LED: - A13000 --> licensing not sufficient - LED READY --> flashes green/red with 0.5 Hz		
<b>p9921</b>	<b>Licensing activate license key / Act license key</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1	<b>Access level:</b> 2 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Activates the entered license key. The following is executed when activating the license key. - the checksum of the entered license key is checked. - the entered license key is saved in a non-volatile fashion on the memory card. - re-enter the license key.		
<b>Value:</b>	0: Inactive 1: Activate start license key		

**Dependency:** Refer to: p9920

**Note:** Before activation, the license key entered using parameter p9920 is checked. If this check identifies an error, activation is rejected. In this case, writing a 1 to p9921 is rejected.  
When the license key has been activated, p9921 is automatically set to 0.

---

**r9925[0...99]      Firmware file incorrect / FW file incorr**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned8	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the directory and name of the file whose status as shipped from the factory was identified as impermissible.

**Dependency:** Refer to: r9926

**Note:** The directory and name of the file is displayed in the ASCII code.

---

**r9926      Firmware check status / FW check status**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned8	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the status when the firmware is checked when the system is booted.  
0: Firmware not yet checked.  
1: Check running.  
2: Check successfully completed.  
3: Check indicates an error.

**Dependency:** Refer to: r9925

---

**p9930[0...8]      System logbook activation / SYSLOG activation**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Unsigned8	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	255	0

**Description:** Only for service purposes.

**Index:** [0] = System logbook stage (0: Not active)  
[1] = COM2/COM1 (0: COM2, 1: COM1)  
[2] = Activate file write (0: Not active)  
[3] = Display time stamp (0: Not displayed)  
[4...7] = Reserved  
[8] = System logbook file size (stages, each 10 kB)

**Notice:** Before powering down the Control Unit, ensure that the system logbook is switched out (p9930[0] = 0).  
If writing to the file is activated (p9930[2] = 1), writing to the file must be de-activated again before switching off the Control Unit (p9930[2] = 0) in order to ensure that the system logbook has been completely written to the file.

<b>p9931[0...129]</b>		<b>System logbook module selection / SYSLOG mod select</b>			
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0000 hex	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> FFFF FFFF hex	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0000 hex		
<b>Description:</b>		Only for service purposes.			
<b>p9932</b>		<b>Save system logbook EEPROM / SYSLOG EEPROM save</b>			
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned8 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 255	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0		
<b>Description:</b>		Only for service purposes.			
<b>r9935.0</b>		<b>BO: POWER ON delay signal / POWER ON t_delay</b>			
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> - <b>Data type:</b> Unsigned8 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -		
<b>Description:</b>		Display and binector output for a delay after POWER ON. After power-on, binector output r9935.0 is set with the start of the first sampling time and is again reset after approx. 100 ms.			
<b>Bit field:</b>	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>	<b>FP</b>
	00	POWER ON delay signal	High	Low	-
<b>r9936[0...199]</b>		<b>DRIVE-CLiQ diagnostic error counter connection / DQdiag err counter</b>			
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> - <b>Data type:</b> Integer32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -		
<b>Description:</b>		Displays the error counter for the individual DRIVE-CLiQ connections/cables. r9936[0]: sum of the error counter for all connections r9936[1]: not used r9936[2]: error counter for the feeder cable to DRIVE-CLiQ components with component number 2 ... r9936[199]: error counter for the feeder cable to DRIVE-CLiQ components with component number 199 The feeder cable is the DRIVE-CLiQ cable that is connected to a component in the direction of the Control Unit.			
<b>Dependency:</b>		Refer to: p9937, p9938			

**p9937 DRIVE-CLiQ diagnostic configuration / DQ diag config**CU\_DC, CU\_DC\_R,  
CU\_DC\_R\_S,  
CU\_DC\_S**Can be changed:** U, T**Data type:** Unsigned16**P-Group:** -**Not for motor type:** -**Min**

-

**Calculated:** -**Dyn. index:** -**Units group:** -**Scaling:** -**Max**

-

**Access level:** 4**Func. diagram:** -**Unit selection:** -**Expert list:** 1**Factory setting**

0000 0000 0000 0000 bin

**Description:**

Sets the configuration for the DRIVE-CLiQ diagnostics (error counter r9936).

Using this function, connections and cables of DRIVE-CLiQ connections can be checked for transfer errors. The error counter is evaluated in the PHY blocks involved.

**Bit field:****Bit Signal name****1 signal****0 signal****FP**

00 Alarm for connection error

Yes

No

-

08 Reset error counter

Yes

No

-

**Dependency:**

Refer to: r9936, p9938

**Note:**

Re bit 00:

To activate this function, p9938 must be set to 0 (inactive).

After changing the error counter (r9936), an appropriate alarm is output.

The alarm automatically disappears after 5 seconds.

Re bit 08:

With p9937.8 = 1, the error counters are reset (r9936[0...199]).

After the reset, p9937.8 is automatically set to 0.

**p9938 DRIVE-CLiQ detailed diagnostics configuration / DQ diag config**CU\_DC, CU\_DC\_R,  
CU\_DC\_R\_S,  
CU\_DC\_S**Can be changed:** U, T**Data type:** Integer16**P-Group:** -**Not for motor type:** -**Min**

0

**Calculated:** -**Dyn. index:** -**Units group:** -**Scaling:** -**Max**

6

**Access level:** 4**Func. diagram:** -**Unit selection:** -**Expert list:** 1**Factory setting**

0

**Description:**

Sets the configuration for the DRIVE-CLiQ detailed diagnostics (r9943).

Using the detailed diagnostics, it is possible to investigate data transfer errors on an individual connection, selected using p9942.

**Value:**

0: Inactive  
 1: Sum send and receive errors  
 2: Only send errors  
 3: Only receive errors  
 4: Siemens internal  
 5: Siemens internal  
 6: Siemens internal

**Dependency:**

The functions in p9938 can only be set for p9937.0 = 0.

Refer to: r9936, p9937, p9939, p9942

**Notice:**

If value = 0:

- detailed diagnostics is inactive.  
 - the error counter is active (r9936).

Re value &gt; 0:

- the error counter is inactive (r9936).  
 - the detailed diagnostics as configured is active (r9943).



<b>p9939</b>	<b>DRIVE-CLiQ detailed diagnostics time interval / DQ detail t_interv</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 1 [s]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 3600 [s]	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1 [s]
<b>Description:</b>	Sets the time interval for recording the error counter in r9943.		
<b>Dependency:</b>	Refer to: r9936, p9938, p9942, r9943		
<b>p9941</b>	<b>Target topology feature delete all components / Feature delete</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> C1(1) <b>Data type:</b> Unsigned32 <b>P-Group:</b> Topology <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 0 <b>Factory setting</b> 0
<b>Description:</b>	For p9941 =1, the serial numbers of all components in the target topology are deleted (zero is written). Through activation and de-activation this enables the actual topology components to be newly assigned to the target topology components.		
<b>Note:</b>	p9941 is automatically set to 0 at the end of the operation. A warm restart is triggered automatically after p0009 = 0.		
<b>p9942</b>	<b>DRIVE-CLiQ detailed diagnostics select individual connection / DQ detail conn</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 199	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the component, whose feeder cable is monitored for data transfer errors. The feeder cable is the DRIVE-CLiQ cable that is connected to a component in the direction of the Control Unit. Errors that have occurred in the selected time interval (p9939) can be read-out from r9943.		
<b>Dependency:</b>	Refer to: r9936, p9938, p9939, r9943		
<b>r9943</b>	<b>DRIVE-CLiQ detailed diagn. individual connection error counter / DQ det err counter</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> - <b>Data type:</b> Integer32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the connection errors of the individual connection that have occurred within the time interval (p9939). The detailed diagnostics for the individual connection is activated via p9938 > 0 and is selected via p9942.		
<b>Dependency:</b>	Refer to: r9936, p9938, p9939, p9942		

<b>r9975[0...7]</b>	<b>System utilization measured / Sys util meas</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> - [%]	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Displays the measured system utilization. The higher the value displayed, the higher the system utilization.		
<b>Index:</b>	[0] = Computing time utilization (min) [1] = Computing time utilization (averaged) [2] = Computing time utilization (max) [3] = Largest total utilization (min) [4] = Largest total utilization (averaged) [5] = Largest total utilization (max) [6] = Reserved [7] = Reserved		
<b>Dependency:</b>	Refer to: r9976, r9979, r9980, r9981		
<b>Note:</b>	Re index 3 ... 5: The total utilizations are determined using all sampling times used. The largest total utilizations are mapped here. The sampling time with the largest total utilization is displayed in r9979. Total utilization: Computing time load of sampling time involved including load from higher-priority sampling times (interrupts).		

---

<b>r9976[0...7]</b>	<b>System utilization / Sys util</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> - [%]	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Displays the system utilization. If the utilization is greater than 100%, fault F01054 is output.		
<b>Index:</b>	[0] = Reserved [1] = Computing time utilization [2] = Reserved [3] = Reserved [4] = Reserved [5] = Largest total utilization [6] = Reserved [7] = Reserved		
<b>Dependency:</b>	Refer to: r9979, r9980		
<b>Note:</b>	Re index 1: The value shows the total computing time load of the system. Re index 5: The total utilization is determined using all sampling times used. The largest total utilization is mapped here. The sampling time with the largest total utilization is displayed in r9979. Total utilization: Computing time load of sampling time involved including load from higher-priority sampling times (interrupts).		

<b>r9979</b>	<b>Sampling time with largest total utilization / t_sampl lg total</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [µs]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> - [µs]	<b>Access level:</b> 3 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [µs]
<b>Description:</b>	Displays the sampling time with the largest total utilization.		
<b>Dependency:</b>	Refer to: r7901, r9976		
<b>Note:</b>	The largest total utilization is displayed in r9976[5]. Total utilization: Computing time load of sampling time involved including load from higher-priority sampling times (interrupts).		

<b>r9980[0...165]</b>	<b>Sampling times utilization calculated / t_sampl util calc</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> - [%]	<b>Access level:</b> 4 <b>Func. diagram:</b> - <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Displays the calculated utilizations for the active sampling times based on the existing target topology.		
<b>Index:</b>	[0] = Net utilization 0 [1] = Total utilization 0 [2] = Net utilization 1 [3] = Total utilization 1 [4] = Net utilization 2 [5] = Total utilization 2 [6] = Net utilization 3 [7] = Total utilization 3 [8] = Net utilization 4 [9] = Total utilization 4 [10] = Net utilization 5 [11] = Total utilization 5 [12] = Net utilization 6 [13] = Total utilization 6 [14] = Net utilization 7 [15] = Total utilization 7 [16] = Net utilization 8 [17] = Total utilization 8 [18] = Net utilization 9 [19] = Total utilization 9 [20] = Net utilization 10 [21] = Total utilization 10 [22] = Net utilization 11 [23] = Total utilization 11 [24] = Net utilization 12 [25] = Total utilization 12 [26] = Net utilization 13 [27] = Total utilization 13 [28] = Net utilization 14 [29] = Total utilization 14 [30] = Net utilization 15 [31] = Total utilization 15 [32] = Net utilization 16 [33] = Total utilization 16 [34] = Net utilization 17 [35] = Total utilization 17 [36] = Net utilization 18		

[37] = Total utilization 18  
[38] = Net utilization 19  
[39] = Total utilization 19  
[40] = Net utilization 20  
[41] = Total utilization 20  
[42] = Net utilization 21  
[43] = Total utilization 21  
[44] = Net utilization 22  
[45] = Total utilization 22  
[46] = Net utilization 23  
[47] = Total utilization 23  
[48] = Net utilization 24  
[49] = Total utilization 24  
[50] = Net utilization 25  
[51] = Total utilization 25  
[52] = Net utilization 26  
[53] = Total utilization 26  
[54] = Net utilization 27  
[55] = Total utilization 27  
[56] = Net utilization 28  
[57] = Total utilization 28  
[58] = Net utilization 29  
[59] = Total utilization 29  
[60] = Net utilization 30  
[61] = Total utilization 30  
[62] = Net utilization 31  
[63] = Total utilization 31  
[64] = Net utilization 32  
[65] = Total utilization 32  
[66] = Net utilization 33  
[67] = Total utilization 33  
[68] = Net utilization 34  
[69] = Total utilization 34  
[70] = Net utilization 35  
[71] = Total utilization 35  
[72] = Net utilization 36  
[73] = Total utilization 36  
[74] = Net utilization 37  
[75] = Total utilization 37  
[76] = Net utilization 38  
[77] = Total utilization 38  
[78] = Net utilization 39  
[79] = Total utilization 39  
[80] = Net utilization 40  
[81] = Total utilization 40  
[82] = Net utilization 41  
[83] = Total utilization 41  
[84] = Net utilization 42  
[85] = Total utilization 42  
[86] = Net utilization 43  
[87] = Total utilization 43  
[88] = Net utilization 44  
[89] = Total utilization 44  
[90] = Net utilization 45  
[91] = Total utilization 45  
[92] = Net utilization 46  
[93] = Total utilization 46  
[94] = Net utilization 47  
[95] = Total utilization 47  
[96] = Net utilization 48  
[97] = Total utilization 48  
[98] = Net utilization 49  
[99] = Total utilization 49  
[100] = Net utilization 50

[101] = Total utilization 50  
[102] = Net utilization 51  
[103] = Total utilization 51  
[104] = Net utilization 52  
[105] = Total utilization 52  
[106] = Net utilization 53  
[107] = Total utilization 53  
[108] = Net utilization 54  
[109] = Total utilization 54  
[110] = Net utilization 55  
[111] = Total utilization 55  
[112] = Net utilization 56  
[113] = Total utilization 56  
[114] = Net utilization 57  
[115] = Total utilization 57  
[116] = Net utilization 58  
[117] = Total utilization 58  
[118] = Net utilization 59  
[119] = Total utilization 59  
[120] = Net utilization 60  
[121] = Total utilization 60  
[122] = Net utilization 61  
[123] = Total utilization 61  
[124] = Net utilization 62  
[125] = Total utilization 62  
[126] = Net utilization 63  
[127] = Total utilization 63  
[128] = Net utilization 64  
[129] = Total utilization 64  
[130] = Net utilization 65  
[131] = Total utilization 65  
[132] = Net utilization 66  
[133] = Total utilization 66  
[134] = Net utilization 67  
[135] = Total utilization 67  
[136] = Net utilization 68  
[137] = Total utilization 68  
[138] = Net utilization 69  
[139] = Total utilization 69  
[140] = Net utilization 70  
[141] = Total utilization 70  
[142] = Net utilization 71  
[143] = Total utilization 71  
[144] = Net utilization 72  
[145] = Total utilization 72  
[146] = Net utilization 73  
[147] = Total utilization 73  
[148] = Net utilization 74  
[149] = Total utilization 74  
[150] = Net utilization 75  
[151] = Total utilization 75  
[152] = Net utilization 76  
[153] = Total utilization 76  
[154] = Net utilization 77  
[155] = Total utilization 77  
[156] = Net utilization 78  
[157] = Total utilization 78  
[158] = Net utilization 79  
[159] = Total utilization 79  
[160] = Net utilization 80  
[161] = Total utilization 80  
[162] = Net utilization 81  
[163] = Total utilization 81

[164] = Net utilization 82  
 [165] = Total utilization 82

**Dependency:** Refer to: r7901, r9976, r9979

**Note:** The corresponding sampling times can be read out in parameter r7901.  
 Net utilization:  
 Computing time load that is only called by the sampling time involved.  
 Total utilization:  
 Computing time load of sampling time involved including load from higher-priority sampling times (interrupts).

<b>r9981[0...165]    Sampling times utilization measured / t_sampl util meas</b>			
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]
<b>Description:</b>	Displays the utilizations measured for the active sampling times.		
<b>Index:</b>	[0] = Net utilization 0 [1] = Total utilization 0 [2] = Net utilization 1 [3] = Total utilization 1 [4] = Net utilization 2 [5] = Total utilization 2 [6] = Net utilization 3 [7] = Total utilization 3 [8] = Net utilization 4 [9] = Total utilization 4 [10] = Net utilization 5 [11] = Total utilization 5 [12] = Net utilization 6 [13] = Total utilization 6 [14] = Net utilization 7 [15] = Total utilization 7 [16] = Net utilization 8 [17] = Total utilization 8 [18] = Net utilization 9 [19] = Total utilization 9 [20] = Net utilization 10 [21] = Total utilization 10 [22] = Net utilization 11 [23] = Total utilization 11 [24] = Net utilization 12 [25] = Total utilization 12 [26] = Net utilization 13 [27] = Total utilization 13 [28] = Net utilization 14 [29] = Total utilization 14 [30] = Net utilization 15 [31] = Total utilization 15 [32] = Net utilization 16 [33] = Total utilization 16 [34] = Net utilization 17 [35] = Total utilization 17 [36] = Net utilization 18 [37] = Total utilization 18 [38] = Net utilization 19 [39] = Total utilization 19 [40] = Net utilization 20 [41] = Total utilization 20 [42] = Net utilization 21		

[43] = Total utilization 21  
[44] = Net utilization 22  
[45] = Total utilization 22  
[46] = Net utilization 23  
[47] = Total utilization 23  
[48] = Net utilization 24  
[49] = Total utilization 24  
[50] = Net utilization 25  
[51] = Total utilization 25  
[52] = Net utilization 26  
[53] = Total utilization 26  
[54] = Net utilization 27  
[55] = Total utilization 27  
[56] = Net utilization 28  
[57] = Total utilization 28  
[58] = Net utilization 29  
[59] = Total utilization 29  
[60] = Net utilization 30  
[61] = Total utilization 30  
[62] = Net utilization 31  
[63] = Total utilization 31  
[64] = Net utilization 32  
[65] = Total utilization 32  
[66] = Net utilization 33  
[67] = Total utilization 33  
[68] = Net utilization 34  
[69] = Total utilization 34  
[70] = Net utilization 35  
[71] = Total utilization 35  
[72] = Net utilization 36  
[73] = Total utilization 36  
[74] = Net utilization 37  
[75] = Total utilization 37  
[76] = Net utilization 38  
[77] = Total utilization 38  
[78] = Net utilization 39  
[79] = Total utilization 39  
[80] = Net utilization 40  
[81] = Total utilization 40  
[82] = Net utilization 41  
[83] = Total utilization 41  
[84] = Net utilization 42  
[85] = Total utilization 42  
[86] = Net utilization 43  
[87] = Total utilization 43  
[88] = Net utilization 44  
[89] = Total utilization 44  
[90] = Net utilization 45  
[91] = Total utilization 45  
[92] = Net utilization 46  
[93] = Total utilization 46  
[94] = Net utilization 47  
[95] = Total utilization 47  
[96] = Net utilization 48  
[97] = Total utilization 48  
[98] = Net utilization 49  
[99] = Total utilization 49  
[100] = Net utilization 50  
[101] = Total utilization 50  
[102] = Net utilization 51  
[103] = Total utilization 51  
[104] = Net utilization 52  
[105] = Total utilization 52  
[106] = Net utilization 53

[107] = Total utilization 53  
[108] = Net utilization 54  
[109] = Total utilization 54  
[110] = Net utilization 55  
[111] = Total utilization 55  
[112] = Net utilization 56  
[113] = Total utilization 56  
[114] = Net utilization 57  
[115] = Total utilization 57  
[116] = Net utilization 58  
[117] = Total utilization 58  
[118] = Net utilization 59  
[119] = Total utilization 59  
[120] = Net utilization 60  
[121] = Total utilization 60  
[122] = Net utilization 61  
[123] = Total utilization 61  
[124] = Net utilization 62  
[125] = Total utilization 62  
[126] = Net utilization 63  
[127] = Total utilization 63  
[128] = Net utilization 64  
[129] = Total utilization 64  
[130] = Net utilization 65  
[131] = Total utilization 65  
[132] = Net utilization 66  
[133] = Total utilization 66  
[134] = Net utilization 67  
[135] = Total utilization 67  
[136] = Net utilization 68  
[137] = Total utilization 68  
[138] = Net utilization 69  
[139] = Total utilization 69  
[140] = Net utilization 70  
[141] = Total utilization 70  
[142] = Net utilization 71  
[143] = Total utilization 71  
[144] = Net utilization 72  
[145] = Total utilization 72  
[146] = Net utilization 73  
[147] = Total utilization 73  
[148] = Net utilization 74  
[149] = Total utilization 74  
[150] = Net utilization 75  
[151] = Total utilization 75  
[152] = Net utilization 76  
[153] = Total utilization 76  
[154] = Net utilization 77  
[155] = Total utilization 77  
[156] = Net utilization 78  
[157] = Total utilization 78  
[158] = Net utilization 79  
[159] = Total utilization 79  
[160] = Net utilization 80  
[161] = Total utilization 80  
[162] = Net utilization 81  
[163] = Total utilization 81  
[164] = Net utilization 82  
[165] = Total utilization 82

**Dependency:** Refer to: r7901, r9975, r9980



**Note:** The corresponding sampling times can be read out in parameter r7901.  
 Net utilization:  
 Computing time load that is only called by the sampling time involved.  
 Total utilization:  
 Computing time load of sampling time involved including load from higher-priority sampling times (interrupts).

---

**r9982[0...4] Data memory utilization / Mem\_util dat\_mem**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]

**Description:** Displays the calculated data memory utilization rates based on the existing target topology.

**Index:**  
 [0] = Fast data memory 1  
 [1] = Fast data memory 2  
 [2] = Fast data memory 3  
 [3] = Fast data memory 4  
 [4] = Reserved

---

**r9983[0...4] Measured data memory utilization (actual load) / Mem\_ut dat\_mem ms**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]

**Description:** Displays the measured data memory utilization rates based on the existing target topology.

**Index:**  
 [0] = Fast Memory 1  
 [1] = Fast Memory 2  
 [2] = Fast Memory 3  
 [3] = Fast Memory 4  
 [4] = Heap

---

**r9984[0...4] Data memory utilization OA / Mem\_ut dat\_mem OA**

CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]

**Description:** Displays the utilization of the data memory by OA applications.

**Index:**  
 [0] = Fast Memory 1  
 [1] = Fast Memory 2  
 [2] = Fast Memory 3  
 [3] = Fast Memory 4  
 [4] = Reserved

<b>r9986[0...7]</b>	<b>DRIVE-CLiQ system load / DQ system load</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]
<b>Description:</b>	Displays the calculated DRIVE-CLiQ system load based on the existing target topology. The values are not made available until the RUNUP READY (800) state is adopted (see p3988). Index 0 ... 7 corresponds to DRIVE-CLiQ socket X100 ... X107.		

<b>r9987[0...7]</b>	<b>DRIVE-CLiQ bandwidth load / DQ bandw load</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]
<b>Description:</b>	Displays the calculated DRIVE-CLiQ bandwidth load based on the existing target topology. The values are not made available until the RUNUP READY (800) state is adopted (see p3988). Index 0 ... 7 corresponds to DRIVE-CLiQ socket X100 ... X107.		

<b>r9988[0...7]</b>	<b>DRIVE-CLiQ DPRAM load / DQ DPRAM load</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]
<b>Description:</b>	Displays the calculated DRIVE-CLiQ DPRAM load based on the existing target topology. The values are not made available until the RUNUP READY (800) state is adopted (see p3988). Index 0 ... 7 corresponds to DRIVE-CLiQ socket X100 ... X107.		

<b>p9990</b>	<b>DO memory usage actual value determination selection / Mem_use ActVal sel</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	65535	0
<b>Description:</b>	The meaning of the parameter differs for reading and writing. Read: - Returns the number of memory areas monitored. Write: - Memory usage of a drive object: Enter drive object number - Memory usage of the complete system: Enter value 65535		

<b>r9991[0...4]</b>	<b>Memory usage drive object actual value / Mem_use DO ActVal</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays the memory usage for each drive object as actual value.		
<b>Index:</b>	[0] = Fast Memory 1 [1] = Fast Memory 2 [2] = Fast Memory 3 [3] = Fast Memory 4 [4] = Heap		

<b>r9992[0...4]</b>	<b>Memory usage drive object reference value / Mem_use DO ref val</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays the memory usage for each drive object as reference value.		
<b>Index:</b>	[0] = Fast Memory 1 [1] = Fast Memory 2 [2] = Fast Memory 3 [3] = Fast Memory 4 [4] = Heap		

<b>r9993[0...4]</b>	<b>Memory usage OA application / Mem_use OA</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays the memory usage of an OA application.		
<b>Index:</b>	[0] = Fast Memory 1 [1] = Fast Memory 2 [2] = Fast Memory 3 [3] = Fast Memory 4 [4] = Heap		

<b>r9999[0...99]</b>	<b>Software error internal supplementary diagnostics / SW_err int diag</b>		
CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Diagnostics parameter to display additional information for internal software errors.		
<b>Note:</b>	Only for internal Siemens troubleshooting.		

**r50000 Status indicator / Status ind**

DC\_CTRL

**Can be changed:** -**Data type:** FloatingPoint32**P-Group:** -**Not for motor type:** -**Min**

-

**Calculated:** -**Dyn. index:** -**Units group:** -**Scaling:** -**Max**

-

**Access level:** 1**Func. diagram:** 2651, 6905**Unit selection:** -**Expert list:** 1**Factory setting**

-

**Description:**

o0.0 No torque direction switched on  
o0.1 Torque direction I switched on  
o0.2 Torque direction II switched on  
o0.9 Wait for enable from master  
o1.0 Wait time for brake opening time running  
o1.1 Wait for operating enable at terminal 13  
o1.2 Wait for operating enable (signal source acc. to p0852)  
o1.3 Wait time after withdrawing a jog command running  
o1.4 Wait for field reversal to be implemented or for "Braking by field reversal" to be withdrawn  
o1.5 Wait for operating enable from the optimization run  
o1.6 Wait for withdrawal of the immediate pulse inhibit (signal source acc. to p50177)  
o1.7 Wait until SINAMICS DCMs connected in parallel are in status o0  
o1.8 Wait until the power unit topology has been switched over  
o2.0 Wait for setpoint |r52193| > p50091[1]  
o3.0 Wait for the thyristor check to be completed  
o3.1 Wait for the line symmetry check to be completed  
o3.2 Wait for a DC contactor to pick up  
o3.3 Wait for the feedback signal, "line contactor" (signal source acc. to p50691)  
o4.0 Wait for voltage at power connections 1U1, 1V1, 1W1  
o4.1 Wait for fuse monitoring to signal OK  
o4.5 Wait for pre-charging of the CCP's chopper capacitors to be completed  
o5.0 Wait until the field current actual value r52265 is > p50396 and until "I\_field ext > If\_min" (see p50265)  
o5.1 Wait for voltage at power connections 3U1, 3W1

**Note:**  
A specific time, which can be set in p50089, represents the maximum wait time in states o4 and o5 combined. If, after this time, the relevant conditions have still not been met, the corresponding error message will be triggered.

o6.0 Wait for the auxiliaries to power up (wait time p50093)  
o6.1 Wait for a setpoint <= p50091[0] at the RFG input (p520193)  
o7.0 Wait for power-on via terminal 12  
o7.1 Wait for power-on (signal source according to p0840)  
o7.2 Wait for the "Braking by field reversal" command to be withdrawn  
o7.3 Wait for parallel master to power up  
o7.4 Optimization run executes pre-work/post-work  
o7.5 Wait until the SINAMICS DCM devices connected in parallel are ready to be switched on  
o7.6 Wait for "Load MLFB" to be completed (carried out by manufacturer prior to delivery)  
o8.0 Wait for closing lockout to be acknowledged  
o8.1 Simulation mode active (see p51840)  
o9.1 Quick stop (OFF3) (signal source acc. to p0848) present  
o9.2 Quick stop (OFF3) (signal source acc. to p0849) present  
o10.1 Voltage disconnect (OFF2) (signal source acc. to p0844) pending  
o10.2 Voltage disconnect (OFF2) (signal source acc. to p0845) pending  
o10.3 E stop (safety shutdown) (terminal 105/106) pending  
o10.6 CUD right  
o11.0 Fault  
o12.0 Initializ. of line voltage sensing for field in progress

- o12.1 Initializ. of line voltage sensing for armature in progr.
- o12.3 Read out data from gating modules (armature and field)
- o12.4 Offset calibr. of curr. act. val. sensing being performed
- o12.5 Read out data from the power unit
- o12.6 Wait for second processor (TMS320) to go into normal operation

---

#### **r50012      Motor temperature / Mot temp**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8030
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [°C]	- [°C]	- [°C]

**Description:** Displays the motor temperature.

The temperature sensor is connected via terminal X177.53/54/55 of the CUD.

**Dependency:** The temperature value is only displayed when using one of the following temperature sensors:

- KTY84 (p50490 = 1): measuring range = -40 °C to +300 °C
- PT100 (p50490 = 6): measuring range = -200 °C to +300 °C
- NTC thermistor K227 (p50490 = 7): measuring range = +85 °C to +200 °C
- PT1000 (p50490 = 8): measuring range = -200 °C to +300 °C

Refer to: p50490, r52051

**Note:** If p50490 = 0, 2 to 5, a value of 0 is displayed.

---

#### **r50013[0...4]      Temperature sensor/Module / Temp sensor/Mod**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8048
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [°C]	- [°C]	- [°C]

**Description:** Displays the temperature of the various temperature sensors for device and modules.

**Index:**  
 [0] = Temperature sensor 1  
 [1] = Temperature sensor 2  
 [2] = Temperature sensor 3  
 [3] = Gating module temperature  
 [4] = CUD Control Unit temperature

**Note:** Temperature sensors which are not in use return a high negative value (approx. -200 °C).

---

#### **r50014[0...1]      Temperature rises calculated / Temp rise calc**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8038, 8042
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]

**Description:** Displays the values calculated for the temperature rise of the motors and the thyristors.

**Index:**  
 [0] = Motor temperature rise  
 [1] = Thyristor temperature rise

**Dependency:** Refer to: p50075, r52310

**r50015 Armature circuit rms value of phase-to-phase line voltage / Arm cct V\_line rms**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6950
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> - [Vrms]	<b>Max</b> - [Vrms]	<b>Factory setting</b> - [Vrms]

**Description:** Displays the phase-to-phase line voltage in the armature circuit (rms value).

**r50016 Field circuit line voltage rms value / F cct V\_line rms**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6952
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> - [Vrms]	<b>Max</b> - [Vrms]	<b>Factory setting</b> - [Vrms]

**Description:** Displays the line voltage in the field circuit (rms value).

**r50017[0...1] Line frequency / f\_line**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6854, 6950, 6952
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> - [Hz]	<b>Max</b> - [Hz]	<b>Factory setting</b> - [Hz]

**Description:** Displays the line frequency in the armature circuit/field circuit.

**Index:**  
[0] = Armature circuit  
[1] = Field circuit

**r50018 Armature firing angle / Arm fir angle**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6860
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> - [°]	<b>Max</b> - [°]	<b>Factory setting</b> - [°]

**Description:** Displays the firing angle on the armature circuit.

**r50019 Armature current actual value / Arm I\_act**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6850
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> - [%]	<b>Max</b> - [%]	<b>Factory setting</b> - [%]

**Description:** Displays the internal signed current actual value in the armature circuit.

The value is an average value over 6 cycles and relates to the motor's rated armature current.

**r50020 Closed-loop armature current control motor current set abs value / la ctr I\_set abs**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6855
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> - [%]	<b>Max</b> - [%]	<b>Factory setting</b> - [%]

**Description:** Displays the absolute value of the motor current setpoint.

**r50021 Torque limiting torque setpoint after limiting / Tqe set after lim**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6830
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> - [%]	<b>Max</b> - [%]	<b>Factory setting</b> - [%]

**Description:** Displays the torque setpoint after limiting.

**Note:** 1 corresponds to 0.1% of the rated torque of the motor.

**r50022 Torque limiting torque setpoint before limiting / Tqe set bef lim**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6830
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> - [%]	<b>Max</b> - [%]	<b>Factory setting</b> - [%]

**Description:** Displays the torque setpoint before limiting.

**Note:** 1 corresponds to 0.1% of the rated torque of the motor.

**r50025 Speed controller actual value selection / Act sel**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6810
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> - [%]	<b>Max</b> - [%]	<b>Factory setting</b> - [%]

**Description:** Display and connector output of the selected speed actual value on the speed controller.

**r50028 Speed setpoint before the ramp-function generator display / n\_set bef RFG disp**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 3135
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> p2000	<b>Expert list:</b> 1
	<b>Min</b> - [rpm]	<b>Max</b> - [rpm]	<b>Factory setting</b> - [rpm]

**Description:** Displays the speed setpoint before the ramp-function generator.

**Dependency:** Refer to: r52193

---

**r50029      Speed setpoint AOP30 display / n\_set AOP30 disp**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 3113
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> p2000	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [rpm]	- [rpm]	- [rpm]

**Description:** Displays the speed setpoint from the Advanced Operator Panel 30 (AOP30).

---

**r50030[0...3]      Device fan speed / Dev fan n**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8047
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [rpm]	- [rpm]	- [rpm]

**Description:** Displays the speed of the device fan.

**Index:**  
 [0] = Fan 1 speed  
 [1] = Fan 2 speed  
 [2] = Fan 3 speed  
 [3] = Fan 4 speed

**Dependency:** Refer to: p50082, p50096

**Note:** The following options are available, dependent upon the power unit used:

- No fans
- 2 DC fans
- 1 AC fan
- 2 AC fan
- 2 AC fans + 1 DC fan

---

**r50033      Field voltage actual value / Uf act val**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6902
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [V]	- [V]	- [V]

**Description:** Displays the actual value of the field voltage.

---

**r50034      Field firing angle / Field fir angle**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6915
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [°]	- [°]	- [°]

**Description:** Displays the firing angle on the field circuit.



**r50035 Field current controller actual value / I<sub>field</sub> ctr act**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6910
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> - [%]	<b>Max</b> - [%]	<b>Factory setting</b> - [%]

**Description:** Displays the actual value on the field current controller.

**r50036 Field current controller setpoint / I<sub>field</sub> ctr set**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6910
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> - [%]	<b>Max</b> - [%]	<b>Factory setting</b> - [%]

**Description:** Displays the setpoint value on the field current controller.

**r50037 EMF actual value / EMF act**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6902
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> - [V]	<b>Max</b> - [V]	<b>Factory setting</b> - [V]

**Description:** Displays the EMF actual value.

**r50038 Armature voltage actual value / U<sub>a</sub> act**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6902
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> - [V]	<b>Max</b> - [V]	<b>Factory setting</b> - [V]

**Description:** Displays the actual value of the armature voltage.

**r50039 Motor EMF setpoint / Mot EMF set**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6900
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> - [V]	<b>Max</b> - [V]	<b>Factory setting</b> - [V]

**Description:** Displays the EMF setpoint calculated from the motor data.

**r50047[0...31]    Faults additional information / Fault add info**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2651
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays more detailed information about faults which have occurred with numbers 60000 and higher.  
 [0] = Fault value  
 [1] = Additional information about the most recent fault which occurred (see corresponding fault)  
 ...  
 [30] = Additional information about the most recent fault which occurred (see corresponding fault)  
 [31] = Fault number

**p50051    Optimization run selection / Opt run sel**

DC_CTRL	<b>Can be changed:</b> C2(1), T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2660
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	30	0

**Description:** Setting to select the optimization run for the next ON command.

**Value:** 0: No optimization run  
 24: Closed-loop field current control  
 25: Closed-loop armature current control  
 26: Closed-loop speed control and moment of inertia  
 27: Field weakening control  
 28: Friction compensation  
 29: Torsion optimization  
 30: CCP (Converter Commutation Protector)

**Notice:** If value = 30:

The CCP optimization run does not require a switch-on command and is directly started when selecting the value.

**Note:** Only a value of 0 can be set at the right-hand CUD.

A value not equal to 0 can only be set in the operating states o7.0 and o7.1 if an optimization run is presently not active.

If value = 0:

No optimization run has been selected.

If value = 24:

Optimization run for pre-control and the current controller for the field converter.

If value = 25:

Optimization run for pre-control and the current controller for the armature converter.

If value = 26:

Optimization run for the speed controller and moment of inertia.

If value = 27:

Optimization run for field weakening.

If value = 28:

Optimization run for friction compensation.

If value = 29:

Optimization run for speed controllers and moment of inertia for drives that are capable of oscillation.

If value = 30:

Optimization run for CCP (Converter Commutation Protector).

<b>r50052 Optimization run status / Opt run status</b>			
DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2660
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	701	-
<b>Description:</b>	Displays the status during the optimization run.		
<b>Value:</b>	0: No optimization run 1: Wait for operating state 7.4 2: Check prerequisites 3: Save original interconnection 4: Interconnect optimization parameters 5: Wait for operating state 0.x or 1.5 6: Set optimized parameter values 7: Wait for operating state 8.0 8: Troubleshooting 9: Exit optimization run 101: Set field current to 100% 102: Measure field circuit resistance 103: Measure field circuit inductance 201: Wait for field decay 202: Set armature current to 100% 203: Measure armature circuit resistance 204: Measure armature circuit inductance 301: Record speed characteristic 302: Stop motor 401: Calculate nominal EMF 402: Calculate nominal speed 403: Record field characteristic 91 % field current 404: Record field characteristic 83 % field current 405: Record field characteristic 76 % field current 406: Record field characteristic 70 % field current 407: Record field characteristic 65 % field current 408: Record field characteristic 60.5 % field current 409: Record field characteristic 56.5 % field current 410: Record field characteristic 53 % field current 411: Record field characteristic 50 % field current 412: Record field characteristic 47 % field current 413: Record field characteristic 44 % field current 414: Record field characteristic 41 % field current 415: Record field characteristic 38 % field current 416: Record field characteristic 35 % field current 417: Record field characteristic 32 % field current 418: Record field characteristic 29 % field current 419: Record field characteristic 26 % field current 420: Record field characteristic 23 % field current 421: Record field characteristic 20 % field current 422: Record field characteristic 17 % field current 423: Record field characteristic 14 % field current 424: Record field characteristic 11 % field current 425: Record field characteristic 8% field current 426: Recording of field characteristic is complete 501: Wait for field to build up 502: Recording the friction characteristic - 10% rated speed 503: Recording the friction characteristic - 20% rated speed 504: Recording the friction characteristic - 30% rated speed 505: Recording the friction characteristic - 40% rated speed 506: Recording the friction characteristic - 50% rated speed 507: Recording the friction characteristic - 60% rated speed 508: Recording the friction characteristic - 70% rated speed		

- 509: Recording the friction characteristic - 80% rated speed  
 510: Recording the friction characteristic - 90% rated speed  
 511: Recording the friction characteristic - 100% rated speed  
 701: Calculation is carried out

---

**r50060[0...14] Software version / SW version**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the existing software versions.

**Index:**  
 [0] = Complete device version external  
 [1] = Complete device version internal  
 [2] = DSAC Bootloader Version  
 [3] = BIOS version  
 [4] = Configuration EEPROM version  
 [5] = Base system version  
 [6] = DC MASTER version  
 [7] = TMS version  
 [8] = TMS image version  
 [9] = TMS bootloader version  
 [10] = TMS bootloader image version  
 [11] = Powerstack properties version  
 [12] = In-plant information  
 [13] = DCC version  
 [14] = FBLOCKS version

**Note:** Some of these software versions are also displayed at other parameters.

Index 0 <--> r7844[1]

Index 1 <--> r7844[0]

Index 2 <--> r0197

Index 5 <--> r0018

Index 6, 13, 14 <--> r4957[x]

---

**r50063[0...1] CUD information / CUD info**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8054
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays information about the Control Unit DC MASTER (CUD).

**Index:**  
 [0] = CUD position  
 [1] = CUD variant

**Note:** Re index 0:

Indicates the position of the Control Unit DC MASTER (CUD) in the device.

- Value = 0: CUD is installed on the left.

- Value = 1: CUD is installed on the right.

Re index 1:

Indicates the variant of the Control Unit DC MASTER (CUD).

- Value = 0: CUD is the standard version.

- Value = 1: CUD is the advanced version.

<b>p50066 Power unit I2t monitoring derating factor K1 limit value / PU fact K1 lim val</b>			
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.50	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1.00	<b>Access level:</b> 2 <b>Func. diagram:</b> 8042 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.50
<b>Description:</b>	Sets the limit value for derating factor K1 (thermal power reduction factor). This limit value is necessary for devices with option L99. If this limit value is fallen below, then an appropriate alarm is output.		
<b>Note:</b>	The derating factor K1 should be taken from the following reference: SINAMICS DCM Operating Instructions - Chapter "Sensor for ambient or air intake temperature"		
<hr/>			
<b>p50067 Load class / Load class</b>			
DC_CTRL	<b>Can be changed:</b> C2(1), T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 1	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 5	<b>Access level:</b> 1 <b>Func. diagram:</b> 6960 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Load class setting. Dependent upon the selected load class, the device's rated direct current is reduced to a value which will vary according to power unit and load class. The current value of the device's rated direct current is displayed via r50072[1].		
<b>Value:</b>	1: DC I 2: DC II 3: DC III 4: DC IV 5: US rating		
<b>Note:</b>	If the device's rated direct current is also reduced via p50076[0], the smaller of the two values will be applied. If p50067 is set to a value > 1, you must ensure that the "dynamic overload capability of the power unit" is enabled (in other words, a value > 0 must be set in p50075). The device does not check for compliance with the load class set in p50067. If the power unit is able to tolerate it, the device can run at overload for longer than is permitted by the load class. The actual permissible overload duration for each power unit is always longer than the overload duration permitted by the load class. The device checks for compliance with the overload duration actually permitted by the power unit.		
<hr/>			
<b>r50068[0...95] Power unit nameplate options / PU options</b>			
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> Unsigned8 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 1 <b>Func. diagram:</b> 6960 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the options according to the power unit's nameplate.		
<b>Note:</b>	The individual digits of the number are displayed in ASCII code in the indices. An ASCII table (excerpt) can be found, for example, in the appendix to the List Manual.		

**r50069[0...31] Power unit serial number / PU ser no.**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned8	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6960
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the serial number of the power unit.

**Note:** The individual digits of the number are displayed in ASCII code in the indices.  
An ASCII table (excerpt) can be found, for example, in the appendix to the List Manual.

**r50070[0...31] Power unit order number / PU Order No.**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned8	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6960
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the order number (MLFB) of the power unit.

**Note:** The individual digits of the number are displayed in ASCII code in the indices.  
An ASCII table (excerpt) can be found, for example, in the appendix to the List Manual.

**r50071 Device rated line-side voltage armature / Device Ua<sub>rated</sub>**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6960
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [Vrms]	- [Vrms]	- [Vrms]

**Description:** Displays the device rated line-side voltage for the armature as indicated on the device's nameplate.

**r50072[0...1] Device rated direct current armature / Device Ia<sub>rated</sub>**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6800, 6825, 6830, 6840, 6850, 6851, 6855, 6910, 6960, 6965, 8038, 8040, 8042
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [A]	- [A]	- [A]

**Description:** Displays the device rated direct current (armature).

**Index:** [0] = Device rated direct current armature  
[1] = Reduced rated direct current armature

**Note:** Re index 0:  
Device rated direct current (armature) as indicated on the device's nameplate.  
Re index 1:  
Actual device rated direct current (armature) according to the setting in parameter p50076[0] or p50067.  
Also see the note for parameter p50076[0].

<b>r50073[0...1]</b>	<b>Device rated direct current field / Device If<sub>rated</sub></b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32  <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [A]	<b>Calculated:</b> - <b>Dyn. index:</b> -  <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> - [A]	<b>Access level:</b> 1 <b>Func. diagram:</b> 6900, 6905, 6910, 6912, 6960, 8044 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [A]
<b>Description:</b>	Displays the device rated direct current (field).		
<b>Index:</b>	[0] = Device rated direct current field [1] = Reduced rated direct current field		
<b>Note:</b>	When using an external field device (p50084 > 20) the rated device DC field current is taken from the value set in p51838. Re index 0: Device rated direct current (field) as indicated on the device's nameplate (output direct current at power connections 3C and 3D). Re index 1: Actual device rated direct current (field) according to the setting in parameter p50076[1].		
<b>r50074</b>	<b>Device rated line-side voltage field / V<sub>rated</sub> field</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [Vrms]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> - [Vrms]	<b>Access level:</b> 1 <b>Func. diagram:</b> 6960 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [Vrms]
<b>Description:</b>	Displays the device rated line-side voltage for the field as indicated on the device's nameplate.		
<b>p50075</b>	<b>Power unit I2t monitoring response / PU I2t mon resp</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 2	<b>Access level:</b> 2 <b>Func. diagram:</b> 8042 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the response for I2t monitoring of the power unit.		
<b>Value:</b>	0: Dynamic overload not permitted 1: Dynamic overload possible, A60039 2: Dynamic overload possible, F60139		
<b>Note:</b>	If value = 0: Dynamic overload capability is not permissible. The armature current setpoint (r52133) is limited to p50077 * r50072[1]. A value of 0 can only be set, if p50067 = 1. If value = 1: Dynamic overload capability is permissible. As long as the calculated temperature rise of the thyristors does not exceed the permissible value, the armature current setpoint is limited to the value p50077 * r50072[1] * 180%. If the permissible value is exceeded, the device will protect itself by reducing the current limit to p50077 * r50072[1]. Alarm A60039 is triggered at the same time. The armature current setpoint limit will only be increased back to the value p50077 * r50072[1] * 180% and alarm A60039 will only disappear once the calculated temperature rise of the thyristors falls back below the permissible value and the armature current setpoint is less than the device rated current r50072[1]. If value = 2: Dynamic overload capability is permissible. If the calculated temperature rise of the thyristors exceeds the permissible value, the drive will be shut down with fault F60139.		


<b>p50076[0...1]</b>	<b>Device rated direct current reduction / Device I<sub>rated</sub> red</b>		
DC_CTRL	<b>Can be changed:</b> C2(1), T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 1.0 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> 100.0 [%]	<b>Access level:</b> 1 <b>Func. diagram:</b> 6850, 6960 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 100.0 [%]
<b>Description:</b>	Sets the reduction of the device rated direct current for armature and field. The device rated direct current is reduced to the value set here to better adapt the device to the motor.		
<b>Index:</b>	[0] = Armature [1] = Field		
<b>Note:</b>	- If a load class has been set in parameter p50067 which reduces the device rated direct current, the smaller of the two values will be applied. - The value set in index 0 (armature) results in a hardware-based adaption of the current actual value sensing gain. This can only be adapted in a discrete stages. As a consequence, the value set here is not precisely effective, but the next possible value. The actually effective rated device current can be seen in parameter r50072[1]. The following applies: $r50072[1] = K * r50072[0]$ $K = A/255$ $A = p50076[0] * 255/100$ (rounded to the next lower integer number)		
<b>p50077</b>	<b>Power unit I<sub>2t</sub> monitoring derating factor / PU I<sub>2t</sub> mon derat</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.50	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1.00	<b>Access level:</b> 2 <b>Func. diagram:</b> 6840, 8042 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1.00
<b>Description:</b>	Sets the derating factor for I <sub>2t</sub> monitoring of the power unit.		
<b>Note:</b>	Derating is required in the following cases: - Operation at increased ambient temperature - Installation altitude more than 1000 m above sea level The derating factor should be taken from the following reference: SINAMICS DCM Operating Instructions - Chapter "Derating" and "Sensor for ambient or air intake temperature"		
<b>p50078[0...1]</b>	<b>Supply voltage rated value / V<sub>supp</sub> rated val</b>		
DC_CTRL	<b>Can be changed:</b> C2(1), T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 10 [Vrms]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 2000 [Vrms]	<b>Access level:</b> 1 <b>Func. diagram:</b> 6855, 6900, 6902, 6950, 6952, 6960 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 400 [Vrms]
<b>Description:</b>	Sets the rated value of the supply voltage for armature and field. This parameter should be used to set the rated voltage value of the actual line used to supply power to the power unit.		
<b>Index:</b>	[0] = Armature [1] = Field		
<b>Note:</b>	This value is the reference value for the following parameters: p50351, p50352, p50353 r52285 to r52289, r52291, r52292, r52301, r52302, r52303, r52305 Re index 0: Only values less than r50071 can be set.		



Re index 1:  
Only values less than r50074 can be set.

<b>p50079 Armature gating unit short pulses/long pulses / Arm sh/lg pulse</b>			
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1	<b>Access level:</b> 3 <b>Func. diagram:</b> 6860 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the short pulses/long pulses on the armature gating unit. Value = 0: The gating unit emits short pulses (0.89 ms = approx. 16 degrees at 50 Hz). Value = 1: The gating unit emits long pulses (pulse duration up to approx. 0.1 ms before the next pulse) (e.g. required in the case of field infeed from the armature terminals).		
<b>Value:</b>	0: Short pulses 1: Long pulses		
<hr/>			
<b>p50080 Brake control braking mode / Brake ctr mode</b>			
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 2	<b>Access level:</b> 2 <b>Func. diagram:</b> 2750 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the braking mode for brake control.		
<b>Value:</b>	0: No brake 1: Holding brake 2: Operational brake		
<b>Dependency:</b>	Refer to: p50370, p50371		
<b>Note:</b>	If p50080 = 1 (holding brake): If the "Enable operation" command is withdrawn or the "Disconnect voltage" or "E-stop" command is set, the "Close brake" command will not be set until "n < n_min" is reached. If p50080 = 2 (operational brake): If the "Enable operation" command is withdrawn or the "Disconnect voltage" or "E-stop" command is set, the "Close brake" command will be set immediately (in other words, even if the motor is still running).		
<hr/>			
<b>p50081 Field weakening activation / Field weak act</b>			
DC_CTRL	<b>Can be changed:</b> C2(1), T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1	<b>Access level:</b> 1 <b>Func. diagram:</b> 6900 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the activation/de-activation of EMF-dependent field weakening.		
<b>Value:</b>	0: Deactivated 1: Activated		
<b>Notice:</b>	When field weakening is active (p50081 = 1), a valid field characteristic must be available (p50117 = 1); if not, the optimization run for field weakening (p50051 = 27) must be performed.		

<b>p50082 Field power unit operating mode / Field PU op mode</b>			
DC_CTRL	<b>Can be changed:</b> C2(1), T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6910, 8044, 8047
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	24	2
<b>Description:</b>	Sets the operating mode for the field power unit. If p50082 = 1, 2, 3, 4, the motor flux is calculated according to the field characteristic (p50120 to p50139) as a function of the field current actual value (r52265).		
<b>Value:</b>	0: No field 1: Field switched with line contactor 2: Standstill field for $\geq 0.7.0$ 3: Field continuously active 4: Field switched with Auxiliaries ON signal 21: External field power unit, otherwise as setting 1 22: External field power unit, otherwise as setting 2 23: External field power unit, otherwise as setting 3 24: External field power unit, otherwise as setting 4		
<b>Dependency:</b>	Refer to: r50073, p50076, p50258, p50265, p50612, p51838, r52265, r52268, r52290		
<b>Notice:</b>	Although it is permissible for the parameter to be changed to values not equal to 0 in operating states $\geq 0.0$ , such changes will not be applied until operating states greater than or equal to $\geq 0.7.0$ .		
<b>Note:</b>	<p>If an external field device is used, the setpoint comes from r52268 (e.g. via an analog output or over the peer-to-peer interface).</p> <p>The rated direct current of the external field device should be set in p51838. This value is also displayed in r50073[1]. p50076[2] is redundant.</p> <p>If the external field device sends a field current actual value signal, this should be fed in via p50612. If the external field device is not able to send a field current actual value signal, p50263 should be set to a value of 1 or 2.</p> <p>If the external field device sends an <math>I_{\text{field}} &lt; I_{\text{field\_min}}</math> signal, this can be fed in at injection point p50265.</p> <p>If p50082 = 0:</p> <ul style="list-style-type: none"> <li>- No field is used (e.g. in the case of permanent-magnet motors). The field firing pulses are disabled. The motor flux is set to the value for 100% rated flux.</li> </ul> <p>If p50082 = 1:</p> <ul style="list-style-type: none"> <li>- Internal field power unit. The line supplies for the field and armature sections are connected or disconnected simultaneously. The field firing pulses are enabled/disabled at the same time as the line contactor closes/opens; the field current decays with the field time constant during freewheeling.</li> </ul> <p>If p50082 = 2:</p> <ul style="list-style-type: none"> <li>- Internal field power unit. Automatic injection of standstill field set in p50257 after expiry of a period of time set in p50258 once operating state <math>\geq 0.7</math> or higher has been reached.</li> </ul> <p>If p50082 = 3:</p> <ul style="list-style-type: none"> <li>- Internal field power unit. The field is active continuously.</li> </ul> <p>If p50082 = 4:</p> <ul style="list-style-type: none"> <li>- Internal field power unit. The field is switched together with the Auxiliaries ON signal (p53210.2).</li> </ul> <p>If p50082 = 21:</p> <ul style="list-style-type: none"> <li>- External field device. The field is controlled in the same way as with p50082 = 1.</li> </ul> <p>If p50082 = 22:</p> <ul style="list-style-type: none"> <li>- External field device. The field is controlled in the same way as with p50082 = 2.</li> </ul> <p>If p50082 = 23:</p> <ul style="list-style-type: none"> <li>- External field device. The field is controlled in the same way as with p50082 = 3.</li> </ul> <p>If p50082 = 24:</p> <ul style="list-style-type: none"> <li>- External field device. The field is controlled in the same way as with p50082 = 4.</li> </ul>		

<b>p50083[0...n] Speed controller actual value selection / n_ctr act sel</b>			
DC_CTRL	<b>Can be changed:</b> C2(1), T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 5	<b>Access level:</b> 1 <b>Func. diagram:</b> 6810 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Selection of the speed actual value.		
<b>Value:</b>	0: Selection de-activated 1: Analog tachometer 2: Incr encoder 3: EMF actual value internal 4: Free interconnection using p50609 5: DRIVE-CLiQ encoder		
<b>Dependency:</b>	Refer to: p50115, p50609		
<b>Warning:</b>	If value = 3:		
	Monitoring for overspeed is only active subject to restrictions since if the EMF is used as the speed actual value with a field current actual value which is too low, very high motor speeds will be reached.		
<b>Note:</b>	If value = 3: The EMF actual value is evaluated with p50115.		

<b>p50084 Closed-loop speed control/Closed-loop current/torque control sel / n//tqe ctr sel</b>			
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 1	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 2	<b>Access level:</b> 2 <b>Func. diagram:</b> 6810, 6830 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Sets closed-loop speed control or closed-loop current/torque control.		
<b>Value:</b>	1: Closed-loop speed control 2: Closed-loop current/torque control		
<b>Note:</b>	If value = 2: The setpoint provided by the RFG output is set as the current/torque setpoint and the speed controller is bypassed.		

<b>p50085 Sequence control withdraw jog wait time / S ctr jog t</b>			
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.0 [s]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 60.0 [s]	<b>Access level:</b> 2 <b>Func. diagram:</b> 2651 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 10.0 [s]
<b>Description:</b>	Sets the wait time for sequence control once the jog command has been withdrawn. Once the jog command has been withdrawn, the wait time does not start until n < n_min (p50370, p50371) is reached.		
<b>Note:</b>	Once a jog command has been withdrawn, the drive will remain in operating state o1.3 for the set wait time, with the controllers inhibited and the line contactor picked up. If a second jog command is sent during this time, the drive will switch to the next operating state (o1.2 or lower). However, if the time elapses without a second jog command being sent, the line contactor will drop out and the drive will switch to operating state o7.		

<b>p50086</b>	<b>Sequence control line voltage failure duration permissible / V_line_fail t perm</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2651
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0.00 [s]	<b>Max</b> 10.00 [s]	<b>Factory setting</b> 0.00 [s]

**Description:** Sets the permissible duration of a line voltage failure.  
If a line voltage failure lasts longer than this time, the corresponding fault will be triggered.  
If the line voltage failure is shorter than the set time, a restart will follow automatically.

**Caution:** The value in p50090 must be smaller than that in p50086 (unless for a value = 0.0) and in p50089!



<b>p50087</b>	<b>Brake control brake opening time / Br ctr t open</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2750
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> -10.00 [s]	<b>Max</b> 10.00 [s]	<b>Factory setting</b> 0.00 [s]

**Description:** Sets the brake closing time.  
When "Open brake" is sent, the firing pulse enable is delayed by this time.

**Note:** For a negative time setting:  
With "Open brake", a delay corresponding to the set time is applied in relation to the enable for the firing pulses for the thyristors. During this time, the motor works in opposition to the brake, which is still closed. This is useful, for example, in the cases of suspended loads.  
For a positive time setting:  
When the "Switch on", "Jog" or "Creep" command is sent with operation enabled, the firing pulses for the thyristors are not enabled until the set time has elapsed. During this time, the drive is in operating state o1.0 to give a holding brake the opportunity to open in advance.

<b>p50088</b>	<b>Brake control brake closing time / Br ctr t close</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2750
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0.00 [s]	<b>Max</b> 10.00 [s]	<b>Factory setting</b> 0.00 [s]

**Description:** Sets the brake closing time.  
When "Close brake" is sent, the firing pulse inhibit is delayed by this time.

**Note:** During this time, the drive is in operating state o1.1, o1.2, or o1.0 and is still applying torque.

<b>p50089</b>	<b>Sequence control voltage at power unit wait time / S ctr V at PU t</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2651
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0.01 [s]	<b>Max</b> 60.00 [s]	<b>Factory setting</b> 2.00 [s]

**Description:** Sets the wait time for voltage and field current at the power unit.

Once the line contactor has dropped out and the "Switch on", "Jog" or "Creep" commands have been sent, in operating states o4 and o5, the drive waits for voltage at the power unit and for a field current actual value (r52265) > 50% of the field current setpoint (r52268).

If, during this time, no voltage is detected at the power unit and the field current is missing, a message is output accordingly.

**Dependency:**

Refer to: p50353

**Caution:**

The value in p50090 must be smaller than that in p50086 (unless p50086 = 0.0) and p50089!



**Note:**

This parameter indicates the total wait times during which the drive must pass through operating states o4 and o5 (response threshold for monitoring for the presence of voltage at the power unit, see p50353).

## p50090

### Line voltage stabilization time / V\_line t\_stabil

DC\_CTRL

**Can be changed:** U, T

**Calculated:** -

**Access level:** 3

**Data type:** FloatingPoint32

**Dyn. index:** -

**Func. diagram:** 6950, 6952

**P-Group:** -

**Units group:** -

**Unit selection:** -

**Not for motor type:** -

**Scaling:** -

**Expert list:** 1

**Min**

**Max**

**Factory setting**

0.01 [s]

1.00 [s]

0.05 [s]

**Description:**

Sets the line voltage stabilization time.

**Caution:**

The value in p50090 must be smaller than that in p50086 (unless p50086 = 0.0) and p50089!



**Note:**

When the "Switch on", "Jog" or "Creep" command is sent and also after a phase failure affecting the line infeed has been detected with the "Automatic restart" function parameterized (p50086 > 0), the drive waits in operating state o4 for voltage at the power unit.

If amplitude, frequency and phase symmetry remain within the permissible tolerance for longer than this set stabilization time, line voltage is assumed to be present at the power connections.

## p50091[0...1]

### Sequence control setpoint threshold / S\_ctr set thresh

DC\_CTRL

**Can be changed:** U, T

**Calculated:** -

**Access level:** 2

**Data type:** FloatingPoint32

**Dyn. index:** -

**Func. diagram:** 2650, 2651

**P-Group:** -

**Units group:** -

**Unit selection:** -

**Not for motor type:** -

**Scaling:** PERCENT

**Expert list:** 1

**Min**

**Max**

**Factory setting**

0.00 [%]

200.00 [%]

[0] 200.00 [%]

[1] 0.00 [%]

**Description:**

Sets the thresholds for "Switch on only with low setpoint" and "Automatic pulse inhibit with low setpoint".

**Index:**

[0] = Switch on only with low setpoint

[1] = Automatic pulse inhibit with low setpoint

**Dependency:**

Refer to: r52166, r52193

**Note:**

If p50091[0]:

Switching on is possible only if a setpoint |r52193| < p50091[0] is present at the RFG input.

If a higher setpoint is present, following activation, state o6 will remain set until |r52193| < p50091[0].

If p50091[1]:

If |r52193| and r52166 are smaller than p50091[1], the firing pulses will be inhibited and the motor will switch to state o2.0.

<b>p50092[0...3]</b>	<b>Field reversal wait times / Field rev t_wait</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.0 [s]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 10.0 [s]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6920 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> [0] 3.0 [s] [1] 0.2 [s] [2] 0.1 [s] [3] 3.0 [s]
<b>Description:</b>	Sets the times to control the reversing contactor to reverse the field for a 2-quadrant device with field reversal.		
<b>Index:</b>	[0] = Field decay [1] = Control new field contactor [2] = Enable field firing pulses [3] = After field build up before armature enable		
<b>Dependency:</b>	Refer to: p50580, p50581, p50583, r53195		
<b>Note:</b>	Re index 0: Wait time for the field to decay before opening the actual field contactor. When initiating an operation to reverse the field, after reaching I_Field (r52265) < I_Field_min (p50394), this wait time expires before the actual field contactor is opened. Re index 1: Wait time before controlling the new field contactor. After the actual field contactor has opened, this wait time expires before the field contactor is controlled for the "new" field direction (the dropout delay time of the contactor used is generally higher than the closing delay time). Re index 2: Wait time before enabling the field firing pulses. After controlling the field contactor for the "new" field direction, this wait time expires before the field firing pulses are enabled. This time must be greater than the closing delay time of the contactor being used. Re index 3: Wait time after the field has been re-established before the armature is enabled. After the field firing pulses have been enabled, the field current actual value I_field in the "new" field direction reaches the value I_field (r52265) > I_field_set (r52268) * p50398/100%. This wait time then starts to run. After this expires, the internal (armature) "operating enable for field reversal" is issued, and the drive is no longer held in operating state o1.4. After the field current has been re-established, this wait time allows the system to wait for the overshoot of the field current actual value to end and therefore the overshoot of the EMF of the DC motor before armature operation is enabled. This is intended to avoid armature overcurrents due to an excessively high EMF during an overshoot.		
<b>p50093</b>	<b>Sequence control line contactor ON delay / Line cont t_ON</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.0 [s]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 120.0 [s]	<b>Access level:</b> 2 <b>Func. diagram:</b> 2651 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.0 [s]
<b>Description:</b>	Sets the ON delay for the line contactor. The switching on of the line contactor in relation to that of the auxiliaries is delayed by the time set here.		

<b>p50094</b>	<b>Sequence control auxiliaries OFF delay / Aux t_OFF</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.0 [s]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 6500.0 [s]	<b>Access level:</b> 2 <b>Func. diagram:</b> 2651 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.0 [s]
<b>Description:</b>	Sets the OFF delay for the auxiliaries. The switching off of the auxiliaries in relation to that of the line contactor is delayed by the time set here.		
<b>p50095</b>	<b>Sequence control DC circuit contactor wait time / DC cont t_wait</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.00 [s]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1.00 [s]	<b>Access level:</b> 2 <b>Func. diagram:</b> 2651 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.00 [s]
<b>Description:</b>	Sets the wait time for a contactor in the DC circuit. The time set in p50095 starts to elapse during a switch-on operation when operating state o5 is reached. If this time is still running when operating state o4 is exited, then the system stays in state o3.2 until this time lapses.		
<b>Dependency:</b>	Refer to: p50691		
<b>Notice:</b>	If the motor is connected to the DC current output (terminal 1C1, 1D1) via a contactor, then generally, this contactor is also controlled from the relay for the line contactor (terminals 109, 110). In this case, it must be ensured that the firing pulses are only enabled after it is completely certain that the contactor has closed. To realize this, this additional wait time is required when switching on.		
<b>Note:</b>	If the function "Feedback line contactor" is used, a change to 1 signal must be detected via p50691 within the time set in p50095. Otherwise, state o3.3 is adopted until it elapses and afterwards fault F60104 is triggered with fault value 6.		
<b>p50096</b>	<b>Device fan run-on time / Dev fan t_run-on</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.0 [s]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 3600.0 [s]	<b>Access level:</b> 2 <b>Func. diagram:</b> 8047 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 240.0 [s]
<b>Description:</b>	Sets the run-on time for the device fan(s). After a pulse inhibit (reaching an operating state $\geq 0.9$ ), the device fan(s) run-on until the power unit has cooled down and until the run-time has expired. The power unit is considered to have been cooled down if all of the following conditions apply: <ul style="list-style-type: none"> <li>- All temperature sensors of the power unit indicate values less than 35 °C.</li> <li>- The thermal model for the thyristors supplies a value of less than 5 %.</li> <li>- The field current is less than 10 A.</li> </ul>		
<b>Dependency:</b>	Refer to: r53135		

**p50097 Field current response to faults / I\_field resp to F**

DC\_CTRL

**Can be changed:** U, T**Calculated:** -**Access level:** 2**Data type:** Integer16**Dyn. index:** -**Func. diagram:** 6910**P-Group:** -**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** -**Expert list:** 1**Min****Max****Factory setting**

0

1

1

**Description:** Sets the response of the field current to faults.**Value:**  
0: Inhibit field pulses  
1: Enable field pulses**Note:** If value = 0:

The field pulses are inhibited when a fault occurs.

If value = 1:

The field pulses are not inhibited when a fault occurs. However, it will not be possible to increase the field current setpoint any further.

**p50098 Sequence control contactor in DC circuit / Cont in DC cct**

DC\_CTRL

**Can be changed:** T**Calculated:** -**Access level:** 2**Data type:** Integer16**Dyn. index:** -**Func. diagram:** 2651, 6902**P-Group:** -**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** -**Expert list:** 1**Min****Max****Factory setting**

0

1

0

**Description:** Setting indicating whether a contactor is used in the DC circuit.The values for the armature voltage U<sub>a</sub> and for the EMF (r52123, r52286, r52287, r52291, r52292, r50037, r50038) are then always set to 0% when the line contactor drops out (r53081.0 = 0). This is because in this case the motor terminals are isolated from the output terminals 1C and 1D on the SINAMICS DC MASTER, thereby preventing the sensing of the armature voltage U<sub>a</sub> (and thus the EMF).**Value:**  
0: No contactor in DC circuit  
1: Contactor in DC circuit**Dependency:** Refer to: r50037, r50038, r52123, r52286, r52287, r52291, r52292**p50099 Communication monitoring delay time / Com mon t\_del**

DC\_CTRL

**Can be changed:** U, T**Calculated:** -**Access level:** 2**Data type:** FloatingPoint32**Dyn. index:** -**Func. diagram:** 9300, 9350**P-Group:** -**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** -**Expert list:** 1**Min****Max****Factory setting**

0.000 [s]

1000.000 [s]

10.000 [s]

**Description:** Sets the delay time for monitoring the communication interfaces.

Following the switching on of the electronic supply, the monitoring mechanisms for the communication interfaces in the proximity of the drive (parallel interface and peer-to-peer interface) do not become active until the delay time set here has elapsed.

**Dependency:** Refer to: r53300, r53310**Note:** This will prevent the interface monitoring mechanisms responding in the event of the electronic power supply to the components being switched on at different times.



<b>p50100[0...n]</b>	<b>Motor rated armature current / Mot rated I_armat</b>		
DC_CTRL	Can be changed: C2(1), T	Calculated: -	Access level: 1
	Data type: FloatingPoint32	Dyn. index: DDS, p0180	Func. diagram: 6851, 8038
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min 0.0 [A]	Max 20000.0 [A]	Factory setting 0.0 [A]
<b>Description:</b>	Sets the rated armature current as indicated on the motor's nameplate.		
<b>Note:</b>	If p50100 = 0.0 A, the drive cannot be switched on and put into operation.		
<b>p50101[0...n]</b>	<b>Motor rated armature voltage / Mot rated V_armat</b>		
DC_CTRL	Can be changed: C2(1), T	Calculated: -	Access level: 1
	Data type: FloatingPoint32	Dyn. index: DDS, p0180	Func. diagram: 6900
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min 10 [V]	Max 2800 [V]	Factory setting 400 [V]
<b>Description:</b>	Sets the rated armature voltage as indicated on the motor's nameplate. This parameter is used, for example, to specify the trigger point in field weakening operation.		
<b>Note:</b>	If a significant voltage drop is to be expected at the motor's supply line when the motor is at rated current (e.g. very long motor cable), a value increased by this voltage drop should be set at p50101.		
<b>p50102[0...n]</b>	<b>Motor rated excitation current / Mot rated I_exc</b>		
DC_CTRL	Can be changed: C2(1), U, T	Calculated: -	Access level: 1
	Data type: FloatingPoint32	Dyn. index: DDS, p0180	Func. diagram: 6905
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min 0.00 [A]	Max 600.00 [A]	Factory setting 0.00 [A]
<b>Description:</b>	Sets the rated excitation current as indicated on the motor's nameplate.		
<b>Note:</b>	If p50102 = 0.00 A, the drive cannot be switched on and put into operation.		
<b>p50103[0...n]</b>	<b>Minimum motor excitation current / Mot I_exc min</b>		
DC_CTRL	Can be changed: U, T	Calculated: -	Access level: 2
	Data type: FloatingPoint32	Dyn. index: DDS, p0180	Func. diagram: 6905
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min 0.00 [A]	Max 100.00 [A]	Factory setting 0.00 [A]
<b>Description:</b>	Sets the minimum excitation current for the motor.		
<b>p50104[0...n]</b>	<b>Speed-dependent current limitation speed n1 / I_lim n_dep n1</b>		
DC_CTRL	Can be changed: C2(1), U, T	Calculated: -	Access level: 1
	Data type: FloatingPoint32	Dyn. index: DDS, p0180	Func. diagram: 8040
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min 1 [rpm]	Max 10000 [rpm]	Factory setting 5000 [rpm]
<b>Description:</b>	Sets speed n1 according to the motor's nameplate for "speed-dependent current limitation". The characteristic for "speed-dependent current limitation" is defined by 2 pairs of values (p50104/p50105, p50106/p50107). This parameter sets speed n1 for the first pair of values (p50104/p50105).		

**Dependency:** Refer to: p50105, p50106, p50107, p50108, p50109

**Note:** The following condition applies:  
p50104 <= p50106 (n1 <= n2)

<b>p50105[0...n] Speed-dependent current limitation armature current I1 / I_lim n_dep I1</b>			
DC_CTRL	<b>Can be changed:</b> C2(1), U, T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 8040
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0.1 [A]	<b>Max</b> 20000.0 [A]	<b>Factory setting</b> 0.1 [A]
<b>Description:</b>	Sets armature current I1 according to the motor's nameplate for "speed-dependent current limitation". The characteristic for "speed-dependent current limitation" is defined by 2 pairs of values (p50104/p50105, p50106/p50107). This parameter sets armature current I1 for the first pair of values (p50104/p50105).		
<b>Dependency:</b>	Refer to: p50104, p50106, p50107, p50108, p50109		
<b>Note:</b>	The following condition applies: p50105 >= p50107 (I1 >= I2)		

<b>p50106[0...n] Speed-dependent current limitation speed n2 / I_lim n_dep n2</b>			
DC_CTRL	<b>Can be changed:</b> C2(1), U, T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 8040
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 1 [rpm]	<b>Max</b> 10000 [rpm]	<b>Factory setting</b> 5000 [rpm]
<b>Description:</b>	Sets speed n2 according to the motor's nameplate for "speed-dependent current limitation". The characteristic for "speed-dependent current limitation" is defined by 2 pairs of values (p50104/p50105, p50106/p50107). This parameter sets speed n2 for the second pair of values (p50106/p50107).		
<b>Dependency:</b>	Refer to: p50104, p50105, p50107, p50108, p50109		
<b>Note:</b>	The following condition applies: p50104 <= p50106 (n1 <= n2)		

<b>p50107[0...n] Speed-dependent current limitation armature current I2 / I_lim n_dep I2</b>			
DC_CTRL	<b>Can be changed:</b> C2(1), U, T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 8040
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0.1 [A]	<b>Max</b> 20000.0 [A]	<b>Factory setting</b> 0.1 [A]
<b>Description:</b>	Sets armature current I2 according to the motor's nameplate for "speed-dependent current limitation". The characteristic for "speed-dependent current limitation" is defined by 2 pairs of values (p50104/p50105, p50106/p50107). This parameter sets armature current I2 for the second pair of values (p50106/p50107).		
<b>Dependency:</b>	Refer to: p50104, p50105, p50106, p50108, p50109		
<b>Note:</b>	The following condition applies: p50105 >= p50107 (I1 >= I2)		

<b>p50108[0...n]</b>	<b>Speed-dependent current limitation maximum operating speed n3 / I_lim n_dep n3</b>		
DC_CTRL	<b>Can be changed:</b> C2(1), U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 1 [rpm]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 10000 [rpm]	<b>Access level:</b> 1 <b>Func. diagram:</b> 8040 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 5000 [rpm]
<b>Description:</b>	Sets the maximum operating speed n3 for "speed-dependent current limitation".		
<b>Dependency:</b>	Refer to: p50104, p50105, p50106, p50107, p50109		
<b>Note:</b>	In this parameter, the following maximum speed must be set dependent upon the setting of the signal source for the speed actual value (p50083): - p50083 = 1 (analog tachometer): Speed prevailing at a tachometer voltage according to p50741 - p50083 = 2 (incremental encoder TTL/HTL): Same value as maximum speed according to p50143 - p50083 = 3 (operation without tachometer): Speed prevailing at an EMF according to p50115.		
<b>p50109[0...n]</b>	<b>Speed-dependent current limitation activation / I_lim n_dep act</b>		
DC_CTRL	<b>Can be changed:</b> C2(1), U, T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1	<b>Access level:</b> 1 <b>Func. diagram:</b> 8040 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets activation/de-activation of the "speed-dependent current limitation" function.		
<b>Value:</b>	0: Deactivated 1: Activated		
<b>p50110[0...n]</b>	<b>Armature circuit resistance / Ra</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.000 [ohm]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 4000.000 [ohm]	<b>Access level:</b> 3 <b>Func. diagram:</b> 6852, 6855, 6900, 6902 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.000 [ohm]
<b>Description:</b>	Sets the armature circuit resistance.		
<b>Note:</b>	The parameter is set automatically during the optimization run for pre-control and the current controller for the armature converter (p50051 = 25).		
<b>p50111[0...n]</b>	<b>Armature circuit inductance / La</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.000 [mH]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1000000.000 [mH]	<b>Access level:</b> 3 <b>Func. diagram:</b> 6852, 6854, 6902 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.000 [mH]
<b>Description:</b>	Sets the armature circuit inductance.		
<b>Note:</b>	The parameter is set automatically during the optimization run for pre-control and the current controller for the armature converter (p50051 = 25).		

<b>p50112[0...n] Field circuit resistance / R_field circuit</b>			
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.000 [ohm]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 4000.000 [ohm]	<b>Access level:</b> 3 <b>Func. diagram:</b> 6910 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.000 [ohm]
<b>Description:</b>	Sets the field circuit resistance.		
<b>Note:</b>	The parameter is set automatically during the optimization run for closed-loop field current control (p50051 = 24).		
<b>p50113[0...n] Motor I2t monitoring continuous current factor / Mot I2t I_cont</b>			
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.50	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 2.00	<b>Access level:</b> 2 <b>Func. diagram:</b> 8038 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1.00
<b>Description:</b>	Sets the permissible continuous armature current for motor I2t monitoring.		
<b>Note:</b>	At this permissible continuous current, fault F60037 is not output. The current is calculated as follows: p50113 * p50100.		
<b>p50114[0...n] Motor thermal time constant / Mot T therm</b>			
DC_CTRL	<b>Can be changed:</b> C2(1), U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0 [s]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 10000 [s]	<b>Access level:</b> 1 <b>Func. diagram:</b> 8038 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 600 [s]
<b>Description:</b>	Sets the thermal time constant of the motor.		
<b>Note:</b>	Value = 0: The motor's I2t monitoring is de-activated.		
<b>p50115[0...n] Speed controller EMF at maximum speed / EMF at n_max</b>			
DC_CTRL	<b>Can be changed:</b> C2(1), U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 1.00 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> 140.00 [%]	<b>Access level:</b> 1 <b>Func. diagram:</b> 6810 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 100.00 [%]
<b>Description:</b>	Setting of the percentage value in relation to p50078[0] for specifying the EMF at maximum speed. The speed is adjusted using the EMF as the speed actual value.		
<b>p50116[0...n] Field circuit inductance / L_field circuit</b>			
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.0 [mH]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1000000.0 [mH]	<b>Access level:</b> 3 <b>Func. diagram:</b> 6910 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.0 [mH]
<b>Description:</b>	Sets the field circuit inductance.		
<b>Dependency:</b>	Refer to: p51597		

**Note:** The parameter is set automatically during the optimization run for pre-control and the current controller for the field converter (p50051 = 24).

---

**p50117[0...n] Field characteristic status / Field char stat**


---

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 1	<b>Factory setting</b> 0

**Description:** Status of the field characteristic.

**Value:** 0: Field characteristic not recorded  
1: Field characteristic recorded

**Note:** The parameter is set automatically during the optimization run for field weakening (p50051 = 27).  
If p50117 = 1, the field characteristic is valid (p50118 to p50139).

---

**p50118[0...n] EMF rated value / EMF rated**


---

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6900
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0 [%]	<b>Max</b> 200 [%]	<b>Factory setting</b> 63 [%]

**Description:** Sets the EMF generated at full field (corresponding to p50102) and a speed according to p50119.

**Dependency:** Refer to: p50119

**Note:** This parameter is set automatically during the optimization run for field weakening (p50051 = 27).  
Only the ratio of p50118 to p50119 is decisive for field weakening control.  
If p50102 is modified subsequently or the maximum speed is altered downstream, the optimization run for field weakening has to be repeated.  
If p50100, p50101 or p50110 is modified subsequently, the optimization run for field weakening does not have to be repeated.

---

**p50119[0...n] Rated speed / n\_rated**


---

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6900
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0.0 [%]	<b>Max</b> 200.0 [%]	<b>Factory setting</b> 100.0 [%]

**Description:** Sets the speed generated at full field (corresponding to p50102) and an EMF actual value according to p50118.

**Dependency:** Refer to: p50118

**Note:** This parameter is set automatically during the optimization run for field weakening (p50051 = 27).  
Only the ratio of p50118 to p50119 is decisive for field weakening control.  
If p50102 is modified subsequently or the maximum speed is altered downstream, the optimization run for field weakening has to be repeated.  
If p50100, p50101 or p50110 is modified subsequently, the optimization run for field weakening does not have to be repeated.

<b>p50120[0...n]</b>	<b>Field current for motor flux 0 % / I<sub>field</sub> flux 0%</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6900, 6910
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0.0 [%]	<b>Max</b> 100.0 [%]	<b>Factory setting</b> 0.0 [%]
<b>Description:</b>	Setting of the field current for a motor flux of 0 %.		
<b>Note:</b>	This parameter is set automatically during the optimization run for field weakening (p50051 = 27). Only values less than p50121 can be set.		
<b>p50121[0...n]</b>	<b>Field current for motor flux 5 % / I<sub>field</sub> flux 5%</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6900, 6910
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0.0 [%]	<b>Max</b> 100.0 [%]	<b>Factory setting</b> 3.7 [%]
<b>Description:</b>	Setting of the field current for a motor flux of 5 %.		
<b>Note:</b>	This parameter is set automatically during the optimization run for field weakening (p50051 = 27). Only values greater than p50120 and less than p50122 can be set.		
<b>p50122[0...n]</b>	<b>Field current for motor flux 10 % / I<sub>field</sub> flux 10%</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6900, 6910
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0.0 [%]	<b>Max</b> 100.0 [%]	<b>Factory setting</b> 7.3 [%]
<b>Description:</b>	Setting of the field current for a motor flux of 10 %.		
<b>Note:</b>	This parameter is set automatically during the optimization run for field weakening (p50051 = 27). Only values greater than p50121 and less than p50123 can be set.		
<b>p50123[0...n]</b>	<b>Field current for motor flux 15 % / I<sub>field</sub> flux 15%</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6900, 6910
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0.0 [%]	<b>Max</b> 100.0 [%]	<b>Factory setting</b> 11.0 [%]
<b>Description:</b>	Setting of the field current for a motor flux of 15 %.		
<b>Note:</b>	This parameter is set automatically during the optimization run for field weakening (p50051 = 27). Only values greater than p50122 and less than p50124 can be set.		

<b>p50124[0...n]</b>	<b>Field current for motor flux 20 % / I<sub>field</sub> flux 20%</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6900, 6910
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0.0 [%]	<b>Max</b> 100.0 [%]	<b>Factory setting</b> 14.7 [%]
<b>Description:</b>	Setting of the field current for a motor flux of 20 %.		
<b>Note:</b>	This parameter is set automatically during the optimization run for field weakening (p50051 = 27). Only values greater than p50123 and less than p50125 can be set.		
<b>p50125[0...n]</b>	<b>Field current for motor flux 25 % / I<sub>field</sub> flux 25%</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6900, 6910
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0.0 [%]	<b>Max</b> 100.0 [%]	<b>Factory setting</b> 18.4 [%]
<b>Description:</b>	Setting of the field current for a motor flux of 25 %.		
<b>Note:</b>	This parameter is set automatically during the optimization run for field weakening (p50051 = 27). Only values greater than p50124 and less than p50126 can be set.		
<b>p50126[0...n]</b>	<b>Field current for motor flux 30 % / I<sub>field</sub> flux 30%</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6900, 6910
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0.0 [%]	<b>Max</b> 100.0 [%]	<b>Factory setting</b> 22.0 [%]
<b>Description:</b>	Setting of the field current for a motor flux of 30 %.		
<b>Note:</b>	This parameter is set automatically during the optimization run for field weakening (p50051 = 27). Only values greater than p50125 and less than p50127 can be set.		
<b>p50127[0...n]</b>	<b>Field current for motor flux 35 % / I<sub>field</sub> flux 35%</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6900, 6910
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0.0 [%]	<b>Max</b> 100.0 [%]	<b>Factory setting</b> 25.7 [%]
<b>Description:</b>	Setting of the field current for a motor flux of 35 %.		
<b>Note:</b>	This parameter is set automatically during the optimization run for field weakening (p50051 = 27). Only values greater than p50126 and less than p50128 can be set.		

<b>p50128[0...n]</b>	<b>Field current for motor flux 40 % / I<sub>field</sub> flux 40%</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6900, 6910
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0.0 [%]	<b>Max</b> 100.0 [%]	<b>Factory setting</b> 29.4 [%]
<b>Description:</b>	Setting of the field current for a motor flux of 40 %.		
<b>Note:</b>	This parameter is set automatically during the optimization run for field weakening (p50051 = 27). Only values greater than p50127 and less than p50129 can be set.		
<b>p50129[0...n]</b>	<b>Field current for motor flux 45 % / I<sub>field</sub> flux 45%</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6900, 6910
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0.0 [%]	<b>Max</b> 100.0 [%]	<b>Factory setting</b> 33.1 [%]
<b>Description:</b>	Setting of the field current for a motor flux of 45 %.		
<b>Note:</b>	This parameter is set automatically during the optimization run for field weakening (p50051 = 27). Only values greater than p50128 and less than p50130 can be set.		
<b>p50130[0...n]</b>	<b>Field current for motor flux 50 % / I<sub>field</sub> flux 50%</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6900, 6910
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0.0 [%]	<b>Max</b> 100.0 [%]	<b>Factory setting</b> 36.8 [%]
<b>Description:</b>	Setting of the field current for a motor flux of 50 %.		
<b>Note:</b>	This parameter is set automatically during the optimization run for field weakening (p50051 = 27). Only values greater than p50129 and less than p50131 can be set.		
<b>p50131[0...n]</b>	<b>Field current for motor flux 55 % / I<sub>field</sub> flux 55%</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6900, 6910
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0.0 [%]	<b>Max</b> 100.0 [%]	<b>Factory setting</b> 40.6 [%]
<b>Description:</b>	Setting of the field current for a motor flux of 55 %.		
<b>Note:</b>	This parameter is set automatically during the optimization run for field weakening (p50051 = 27). Only values greater than p50130 and less than p50132 can be set.		



<b>p50132[0...n]</b>	<b>Field current for motor flux 60 % / I<sub>field</sub> flux 60%</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6900, 6910
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0.0 [%]	<b>Max</b> 100.0 [%]	<b>Factory setting</b> 44.6 [%]
<b>Description:</b>	Setting of the field current for a motor flux of 60 %.		
<b>Note:</b>	This parameter is set automatically during the optimization run for field weakening (p50051 = 27). Only values greater than p50131 and less than p50133 can be set.		
<b>p50133[0...n]</b>	<b>Field current for motor flux 65 % / I<sub>field</sub> flux 65%</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6900, 6910
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0.0 [%]	<b>Max</b> 100.0 [%]	<b>Factory setting</b> 48.9 [%]
<b>Description:</b>	Setting of the field current for a motor flux of 65 %.		
<b>Note:</b>	This parameter is set automatically during the optimization run for field weakening (p50051 = 27). Only values greater than p50132 and less than p50134 can be set.		
<b>p50134[0...n]</b>	<b>Field current for motor flux 70 % / I<sub>field</sub> flux 70%</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6900, 6910
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0.0 [%]	<b>Max</b> 100.0 [%]	<b>Factory setting</b> 53.6 [%]
<b>Description:</b>	Setting of the field current for a motor flux of 70 %.		
<b>Note:</b>	This parameter is set automatically during the optimization run for field weakening (p50051 = 27). Only values greater than p50133 and less than p50135 can be set.		
<b>p50135[0...n]</b>	<b>Field current for motor flux 75 % / I<sub>field</sub> flux 75%</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6900, 6910
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0.0 [%]	<b>Max</b> 100.0 [%]	<b>Factory setting</b> 58.9 [%]
<b>Description:</b>	Setting of the field current for a motor flux of 75 %.		
<b>Note:</b>	This parameter is set automatically during the optimization run for field weakening (p50051 = 27). Only values greater than p50134 and less than p50136 can be set.		

<b>p50136[0...n]</b>	<b>Field current for motor flux 80 % / I<sub>field</sub> flux 80%</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6900, 6910
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0.0 [%]	<b>Max</b> 100.0 [%]	<b>Factory setting</b> 64.9 [%]
<b>Description:</b>	Setting of the field current for a motor flux of 80 %.		
<b>Note:</b>	This parameter is set automatically during the optimization run for field weakening (p50051 = 27). Only values greater than p50135 and less than p50137 can be set.		
<b>p50137[0...n]</b>	<b>Field current for motor flux 85 % / I<sub>field</sub> flux 85%</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6900, 6910
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0.0 [%]	<b>Max</b> 100.0 [%]	<b>Factory setting</b> 71.8 [%]
<b>Description:</b>	Setting of the field current for a motor flux of 85 %.		
<b>Note:</b>	This parameter is set automatically during the optimization run for field weakening (p50051 = 27). Only values greater than p50136 and less than p50138 can be set.		
<b>p50138[0...n]</b>	<b>Field current for motor flux 90 % / I<sub>field</sub> flux 90%</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6900, 6910
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0.0 [%]	<b>Max</b> 100.0 [%]	<b>Factory setting</b> 79.8 [%]
<b>Description:</b>	Setting of the field current for a motor flux of 90 %.		
<b>Note:</b>	This parameter is set automatically during the optimization run for field weakening (p50051 = 27). Only values greater than p50137 and less than p50139 can be set.		
<b>p50139[0...n]</b>	<b>Field current for motor flux 95% / I<sub>field</sub> flux 95%</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6900, 6910
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0.0 [%]	<b>Max</b> 100.0 [%]	<b>Factory setting</b> 89.1 [%]
<b>Description:</b>	Setting of the field current for a motor flux of 95%.		
<b>Note:</b>	This parameter is set automatically during the optimization run for field weakening (p50051 = 27). Only values greater than p50138 can be set.		

<b>p50140</b>	<b>Motor I2t monitoring starting behavior / Mot I2t strt behav</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 2	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 12	<b>Access level:</b> 2 <b>Func. diagram:</b> 8038 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 12
<b>Description:</b>	Sets the starting behavior for I2t monitoring of the motor.		
<b>Value:</b>	2: Start I2t with zero 12: Start I2t with saved value		
<b>Note:</b>	If value = 12: For motor I2t monitoring, when switching off, the model temperature is saved in a non-volatile fashion. When switching on, the saved value is taken into account in the model calculation. As a consequence, the UL508C specification is fulfilled.		
<b>p50148[0...n]</b>	<b>Armature converter Alpha W limit (single-phase operation) / A Alpha W lim 1-ph</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 120.0 [°]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 180.0 [°]	<b>Access level:</b> 3 <b>Func. diagram:</b> 6860 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 178.0 [°]
<b>Description:</b>	Sets the inverter stability limit for the firing angle of the armature converter in single-phase operation.		
<b>Dependency:</b>	Refer to: r53190		
<b>Note:</b>	The status of the Alpha W limit is shown in r53190.8.		
<b>p50149[0...n]</b>	<b>Armature converter correction angle Alpha W limit / Arm corr Alpha W</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -60.0 [°]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 0.0 [°]	<b>Access level:</b> 3 <b>Func. diagram:</b> 6860 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.0 [°]
<b>Description:</b>	Setting of the correction angle for current-dependent offset of the Alpha W limit.		
<b>p50150[0...n]</b>	<b>Armature converter Alpha G limit / Arm Alpha G lim</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.0 [°]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 165.0 [°]	<b>Access level:</b> 3 <b>Func. diagram:</b> 6860 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 30.0 [°]
<b>Description:</b>	Sets the rectifier stability limit for the firing angle of the armature converter.		
<b>Dependency:</b>	Refer to: r53190		
<b>Note:</b>	The status of the Alpha G limit is shown in r53190.7.		

<b>p50151[0...n] Armature converter Alpha W limit / Arm Alpha W lim</b>			
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 120.0 [°] <b>Description:</b> Sets the inverter stability limit for the firing angle of the armature converter. <b>Dependency:</b> Refer to: r53190 <b>Note:</b> The status of the Alpha W limit is shown in r53190.8.	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 165.0 [°]	<b>Access level:</b> 3 <b>Func. diagram:</b> 6860 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 150.0 [°]
<b>p50152[0...n] Armature average number of line periods / Arm line per no.</b>			
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 1 <b>Description:</b> Setting of the number of line periods for line frequency correction in the armature circuit. <b>Note:</b> The internal line synchronization for the armature firing pulses derived from the power terminals (line infeed) is averaged over the number of line periods set in this parameter. In the case of operation on "weak" power supplies with unstable frequencies (on a diesel-driven generator, for example (isolated operation), this parameter must be set lower than for operation on "constant V/Hz" systems to achieve a higher frequency correction speed.	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 20	<b>Access level:</b> 3 <b>Func. diagram:</b> 6950 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 20
<b>p50153[0...n] Control word for armature pre-control / A prec STW</b>			
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0 <b>Description:</b> Sets the control word for armature pre-control. <b>Value:</b> 0: Armature pre-control disabled and pre-control = 165 ° 1: Armature pre-control active 2: Armature pre-control active EMF only with torque direction chge 3: Armature pre-control active EMF irrelevant <b>Note:</b> If value = 3: For pre-control, in this case the EMF is applied with a value of 0 (recommended setting in the case of supplying high inductances from armature terminals, e.g. solenoids, field supply).	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 3	<b>Access level:</b> 2 <b>Func. diagram:</b> 6855 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>p50154[0...n] Closed-loop armature current control integral comp activation / la ctr l comp act</b>			
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0 <b>Description:</b> Sets activation/de-activation of the integral component on the armature current controller. <b>Value:</b> 0: Deactivated 1: Activated	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1	<b>Access level:</b> 2 <b>Func. diagram:</b> 6855 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1

**Note:** If value = 0:  
The integral component of the armature current controller is kept constantly at zero (i.e. the armature current controller functions solely as a proportional controller).

<b>p50155[0...n] Closed-loop armature current control P gain / la ctr Kp</b>			
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.01	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 200.00	<b>Access level:</b> 2 <b>Func. diagram:</b> 6855 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.10
<b>Description:</b>	Sets the P gain of the armature current controller.		
<b>Dependency:</b>	Refer to: p50175		
<b>Note:</b>	The parameter is set automatically during the optimization run for pre-control and the current controller for the armature converter (p50051 = 25). The P gain (Kp) for the armature current controller is calculated as follows: $Kp = p50155 \times  p50175 $		

<b>p50156[0...n] Closed-loop armature current control integral time / la ctr Tn</b>			
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.001 [s]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 10.000 [s]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6855 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.200 [s]
<b>Description:</b>	Sets the integral time of the armature current controller.		
<b>Dependency:</b>	Refer to: p50176		
<b>Note:</b>	The parameter is set automatically during the optimization run for pre-control and the current controller for the armature converter (p50051 = 25). The integral time (Tn) for the armature current controller is calculated as follows: $Tn = p50156 \times  p50176 $		

<b>p50157[0...n] Current limitation setpoint integrator selection / I_set integ sel</b>			
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1	<b>Access level:</b> 2 <b>Func. diagram:</b> 6845 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Selection of the current setpoint integrator.		
<b>Value:</b>	0: Reduced gearbox stressing 1: Current setpoint integrator		
<b>Note:</b>	If value = 0: The integrator is only effective after a change in torque direction (only functions as a ramp-function generator for the current setpoint until the first time the output reaches the setpoint at the integrator input after a change in torque direction). If value = 1: The integrator is always effective (functions as a ramp-function generator for the current setpoint).		

<b>p50158[0...n]</b>	<b>Current limitation setpoint integrator ramp-up time / Set integ t_r-up</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6845
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0.000 [s]	<b>Max</b> 1.000 [s]	<b>Factory setting</b> 0.000 [s]
<b>Description:</b>	Sets the ramp-up time for the setpoint integrator during current limitation. Duration of a ramp-up in the event of a setpoint jump from 0 to 100% of parameter r50072[1].		
<b>Notice:</b>	When setting a ramp-up time > 0.000 s, it is not permissible to enter a supplementary current setpoint via p50601[5]. p50601[5] must be set = 0. Possible effect if this is not observed: Torque direction change will not be able to be completed. The drive remains in one torque direction.		
<b>p50159[0...n]</b>	<b>Auto-reversing stage changeover threshold / Auto-rev thresh</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6860
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0.00 [%]	<b>Max</b> 100.00 [%]	<b>Factory setting</b> 0.01 [%]
<b>Description:</b>	Sets the changeover threshold for the torque direction in the auto-reversing stage.		
<b>p50160[0...n]</b>	<b>Auto-reversing stage additional torque-free interval / Auto-rev interval</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6860
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0.000 [s]	<b>Max</b> 2.000 [s]	<b>Factory setting</b> 0.000 [s]
<b>Description:</b>	Sets the additional torque-free interval when switching over the torque direction in the auto-reversing stage.		
<b>p50161[0...n]</b>	<b>Auto-reversing stage Alpha W pulses second pulse inhibited / Auto-rev Alpha W1</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6860
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 50000	<b>Factory setting</b> 0
<b>Description:</b>	Sets the additional Alpha W pulses with inhibited second pulse in the auto-reversing stage.		
<b>Recommend.:</b>	This parameter should be set to values > 0 in particular when supplying high inductances (e.g. infeed of solenoids).		
<b>Dependency:</b>	Refer to: p50179		
<b>Note:</b>	Number of additional Alpha W pulses with disabled second pulse following detection of I = 0 signal prior to a change in torque direction. These pulses cause the current to decay prior to a change in torque direction. When it drops below the thyristor holding current value, the current is suddenly chopped by the unfired second thyristor and the residual energy stored in the load inductance must be dissipated via a protective circuit (e.g. a varistor) to prevent the load inductance from producing an overvoltage.		

<b>p50162[0...n]</b>	<b>EMF selection / EMF sel</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 1	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 4	<b>Access level:</b> 2 <b>Func. diagram:</b> 6852 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Sets the calculation method for the EMF in armature pre-control.		
<b>Value:</b>	1: Measured EMF 2: EMF with Ua from p50193 3: EMF with EMF from p50193 4: EMF with EMF from r52167		
<b>Note:</b>	If p50162 = 1: The EMF derived from the measured armature voltage (r52123) is used. If p50162 = 2: The EMF for armature current pre-control is calculated from the armature voltage selected with p50193 (the resistive + inductive armature voltage drop is subtracted internally; if p50079 = 2, then p50110 and p50111 only apply at half their value). If p50162 = 3: The parameter selected with p50193 is used as the EMF for armature current pre-control. This setting also allows a closed-loop DC link voltage control to be implemented. If p50162 = 4: The EMF for the armature precontrol (12-pulse in parallel) is calculated as follows: $r52290 * (r52167/p50119) * p50118$		
<b>p50163[0...n]</b>	<b>EMF smoothing selection / EMF smoothing sel</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 160	<b>Access level:</b> 2 <b>Func. diagram:</b> 6852 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 6
<b>Description:</b>	Sets the method for filtering the EMF for armature pre-control.		
<b>Value:</b>	0: No filtering 1: Averaging over last 1 EMF values 2: Averaging over last 2 EMF values 3: Averaging over last 3 EMF values 4: Averaging over last 4 EMF values 5: Averaging over last 5 EMF values 6: Averaging over last 6 EMF values 10: PT1 time constant = 10 ms 20: PT1 time constant = 20 ms 40: PT1 time constant = 40 ms 80: PT1 time constant = 80 ms 160: PT1 time constant = 160 ms		
<b>p50164[0...n]</b>	<b>Closed-loop armature current ctr proportional comp activation / Ia ctr Kp act</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1	<b>Access level:</b> 2 <b>Func. diagram:</b> 6855 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Sets activation/de-activation of the proportional component for armature current control.		

**Value:** 0: Deactivated  
1: Activated

**Note:** If value = 0:  
The proportional component of the armature current controller is kept constantly at zero (i.e. the armature current controller functions solely as an integral controller).

---

**p50165[0...n] BI: Signal source for change in torque direction enable / Torq dir en sig s**

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> CDS, p0170	<b>Func. diagram:</b> 6860
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	53190.0

**Description:** Sets the signal source to enable a torque direction in the event of a change in torque direction.  
1 signal:  
Enable available for M0 or MI.  
0 signal:  
Enable available for M0 or MII.

---

**p50166 Thyristor blocking voltage calculation activation / Thy\_block\_calc act**

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6860
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	1	0

**Description:** Setting to activate/de-activate the calculation of the thyristor blocking voltage.

**Value:** 0: De-activating  
1: Activating

**Note:** The calculation of the thyristor blocking voltage can only be activated if the hardware (Power Interface Module) supports this function.  
This parameter is only evaluated once while powering up, i.e. a change only becomes effective after POWER ON or after powering up with saved parameters (p0976 = 11).

---

**p50169[0...n] Torque limiting selection torque limiting/current limitation / T lim sel T/I\_lim**

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6830
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	1	1

**Description:** Setting to select torque limiting or current limitation.

**Value:** 0: Current lim  
1: Torque limiting

**Dependency:** If p50169 = 1 or p50170 = 1:  
A valid field characteristic (p50117 = 1) is required, otherwise fault F60055 will be output on power-up. If this setting is selected, the optimization run for field weakening must be performed in advance (p50051 = 27).  
Parameter p50263 defines the input variable for determining the motor flux.  
If p50169 = 1 and p50170 = 1:  
This is an invalid setting.  
If p50170 = 1, it will not be possible to set p50169 = 1.  
Refer to: p50051, p50117, p50263



**Note:** If p50169 = 0:  
Current limitation.  
If p50169 = 1:  
Torque limiting; in other words, the pre-set torque limit is converted into a current limit:  
current limit = torque limit/motor flux

<b>p50170[0...n]</b>	<b>Selection of control type for closed-loop current/torque control / Ctrl type I/tq sel</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1	<b>Access level:</b> 2 <b>Func. diagram:</b> 6835 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the controller's control type (closed-loop current control or closed-loop torque control). p50170 = 0: The controller is current-controlled. p50170 = 1: The controller is torque-controlled; in other words, the torque setpoint is converted into a current setpoint (current setpoint = torque setpoint/motor flux).		
<b>Value:</b>	0: Closed-loop current control 1: Closed-loop torque control		
<b>Dependency:</b>	If p50169 or p50170 is set to a value of 1, there must be a valid field characteristic (p50117 = 1); otherwise fault F60055 will be output on power-up. If this setting is selected, the optimization run for field weakening must be performed in advance (p50051 = 27). Parameter p50263 defines the input variable for determining the motor flux. If p50169 = 1 and p50170 = 1: This is an invalid setting. If p50169 = 1, it will not be possible to set p50170 = 1. Refer to: p50051, p50117, p50173, p50263		
<b>Note:</b>	The following parameters are used to change over between current control and torque control: - Signal source via connector input p50173 or - Fixed set value in p50170		

<b>p50171[0...n]</b>	<b>Current limitation armature current limit torque dir I factor / la lim t d I fact</b>		
DC_CTRL	<b>Can be changed:</b> C2(1), U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.0 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> 300.0 [%]	<b>Access level:</b> 1 <b>Func. diagram:</b> 6825, 6840 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 100.0 [%]
<b>Description:</b>	Sets the factor for the armature current limit in torque direction I.		

<b>p50172[0...n]</b>	<b>Current limitation armature current limit torque dir II factor / la lim t d II fact</b>		
DC_CTRL	<b>Can be changed:</b> C2(1), U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -300.0 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> 0.0 [%]	<b>Access level:</b> 1 <b>Func. diagram:</b> 6825, 6840 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -100.0 [%]
<b>Description:</b>	Sets the factor for the armature current limit in torque direction II.		

<b>p50173[0...n]</b>	<b>BI: Signal source for closed-loop current/torque control ctr type / Ctr I/tq ctr sig s</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> 6835 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the signal source for changeover between closed-loop current control and closed-loop torque control. p50170 = 0 and p50173 = 0 signal: The controller is current-controlled. p50170 = 1 or p50173 = 1 signal: The controller is torque-controlled; in other words, the torque setpoint is converted into a current setpoint (current setpoint = torque setpoint/motor flux).		
<b>Dependency:</b>	If p50169 or p50170 is set to a value of 1, there must be a valid field characteristic (p50117 = 1); otherwise fault F60055 will be output on power-up. If this setting is selected, the optimization run for field weakening must be performed in advance (p50051 = 27). Parameter p50263 defines the input variable for determining the motor flux. Refer to: p50170		
<b>Note:</b>	The following parameters are used to change over between current control and torque control: - Signal source via connector input p50173 or - Fixed set value in p50170		

---

<b>p50175[0...n]</b>	<b>CI: Signal source for closed-loop armature current control P gain / Ia ctr Kp sig s</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 6855 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Sets the signal source for variable control of the armature current controller's P gain.		
<b>Dependency:</b>	Refer to: p50155		
<b>Note:</b>	The P gain (Kp) for the armature current controller is calculated as follows: $Kp = p50155 \times  p50175 $		

---

<b>p50176[0...n]</b>	<b>CI: Signal source for closed-loop armature current ctr integr time / Ia ctr Tn sig s</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 6855 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Sets the signal source for variable control of the armature current controller's integral time.		
<b>Note:</b>	The integral time (Tn) for the armature current controller is calculated as follows: $Tn = p50156 \times  p50176 $		

<b>p50177[0...n]</b>	<b>BI: Signal source for the "No immediate pulse inhibit" command / No pulse inh sig s</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> 6860 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Sets the signal source for the "No immediate pulse inhibit" command. A low signal will cause the armature firing pulses to be inhibited immediately without waiting for the I = 0 signal or sending Alpha W pulses for current decay. The additional Alpha W pulses (as set in p50161 and p50179) are not output either. As long as this command is pending, it will not be possible to switch to an operating state lower than o1.6.		
<b>Note:</b>	This command can be used, for example, if the drive is being used to supply a field rather than a motor and the current is to be reduced via an external built-on field discharge resistor connected in parallel.		
<b>p50178[0...n]</b>	<b>BI: Sig source for the "Fire all thyristors simultaneously" command / All thy fire sig s</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> 6860 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the signal source for the "Fire all thyristors simultaneously" command. The default setting of this command (high signal) causes all 6 thyristors on thyristor bridge I to be fired continuously and simultaneously. Changeover to long pulses is automatic.		
<b>Note:</b>	However, this command is only active if no line voltage is applied to the armature power unit.		
<b>p50179[0...n]</b>	<b>Auto-reversing stage Alpha W pluses second pulse enabled / Auto-rev Alpha W2</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 50000	<b>Access level:</b> 2 <b>Func. diagram:</b> 6860 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the additional Alpha W pulses with enabled second pulse in the auto-reversing stage.		
<b>Recommend.:</b>	This parameter should be set to values > 0 in particular when supplying high inductances (e.g. infeed of solenoids).		
<b>Note:</b>	Number of additional Alpha W pulses with enabled second pulse following detection of I = 0 signal prior to a change in torque direction. These pulses cause the current to decay before a change in torque direction; the thyristors are fired in pairs to prevent sudden chopping and the generation of overvoltage by the load inductance when the current drops below the thyristor holding current. When a change in torque direction is required, the current in the existing direction must be reduced.		
<b>p50180[0...n]</b>	<b>Torque limiting torque limit 1 positive / T lim 1 pos</b>		
DC_CTRL	<b>Can be changed:</b> C2(1), U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -300.00 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> 300.00 [%]	<b>Access level:</b> 1 <b>Func. diagram:</b> 6825 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 300.00 [%]
<b>Description:</b>	Sets positive torque limit 1.		
<b>Dependency:</b>	Refer to: p50182		

**Note:** If torque limit changeover is selected (p50694 = 1) and the speed is higher than the set changeover speed (p50184), then torque limit 2 is activated in place of torque limit 1.

<b>p50181[0...n] Torque limiting torque limit 1 negative / T lim 1 neg</b>			
DC_CTRL	<b>Can be changed:</b> C2(1), U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -300.00 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> 300.00 [%]	<b>Access level:</b> 1 <b>Func. diagram:</b> 6825 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -300.00 [%]
<b>Description:</b>	Sets negative torque limit 1.		
<b>Dependency:</b>	Refer to: p50183		
<b>Note:</b>	If torque limit changeover is selected (p50694 = 1) and the speed is higher than the set changeover speed (p50184), then torque limit 2 is activated in place of torque limit 1.		
<hr/>			
<b>p50182[0...n] Torque limiting torque limit 2 positive / T lim 2 pos</b>			
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -300.00 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> 300.00 [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6825 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 300.00 [%]
<b>Description:</b>	Sets positive torque limit 2.		
<b>Dependency:</b>	Refer to: p50180		
<b>Note:</b>	If torque limit changeover is selected (p50694 = 1) and the speed is higher than the set changeover speed (p50184), then torque limit 2 is activated in place of torque limit 1.		
<hr/>			
<b>p50183[0...n] Torque limiting torque limit 2 negative / T lim 2 neg</b>			
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -300.00 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> 300.00 [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6825 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -300.00 [%]
<b>Description:</b>	Sets negative torque limit 2.		
<b>Dependency:</b>	Refer to: p50181		
<b>Note:</b>	If torque limit changeover is selected (p50694 = 1) and the speed is higher than the set changeover speed (p50184), then torque limit 2 is activated in place of torque limit 1.		
<hr/>			
<b>p50184[0...n] Torque limiting changeover speed / T lim n_chng</b>			
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.00 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> 120.00 [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6825 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.00 [%]
<b>Description:</b>	Sets the changeover speed for torque limit selection.		
<b>Dependency:</b>	Refer to: r52166		
<b>Note:</b>	If torque limit changeover is selected (p50694 = 1) and the speed (p52166) is higher than the changeover speed set in p50184, then torque limit 2 (p50182, p50183) is activated in place of torque limit 1 (p50180, p50181).		

<b>p50190[0...n]</b>	<b>CI-loop arm current ctr prectr setpoint smoothing time constant / la prec set T</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6855
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0 [ms]	<b>Max</b> 10000 [ms]	<b>Factory setting</b> 0 [ms]
<b>Description:</b>	Sets the time constant for smoothing the armature current setpoints at the armature current pre-control input for closed-loop armature current control.		
<b>Note:</b>	The smoothing time constant is used to decouple armature current pre-control from the armature current controller.		
<b>p50191[0...n]</b>	<b>CI-loop arm current ctr curr controller setp sm time constant / la ctr set T</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6855
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0 [ms]	<b>Max</b> 10000 [ms]	<b>Factory setting</b> 0 [ms]
<b>Description:</b>	Sets the time constant for smoothing the armature setpoint for closed-loop armature current control.		
<b>Note:</b>	The smoothing time constant is used to decouple armature current pre-control from the armature current controller.		
<b>p50192[0...n]</b>	<b>Armature Alpha W limit control word / A Alpha W lim STW</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6860
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 1	<b>Factory setting</b> 0
<b>Description:</b>	Sets the control word for the Alpha W limit on the armature.		
<b>Value:</b>	0: Alpha W limit = 165 ° with pulsating armature current 1: Alpha W limit = p50151		
<b>Note:</b>	If value = 0: Continuous current: Alpha W limit = parameter p50151 Pulsating current: Alpha W limit = 165 ° If value = 1: Alpha W limit = parameter p50151		
<b>p50193</b>	<b>CI: EMF/Ua external signal source / EMF/Ua ext sig s</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6852
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> 52287[0]
<b>Description:</b>	Sets the signal source for EMF actual value or armature voltage actual value for armature current pre-control. If p50162[D] = 2: Armature voltage actual value If p50162[D] = 3: EMF actual value		

**p50200[0...n] Speed controller speed actual value smoothing time constant / n\_ctr n\_act T**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6810
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0 [ms]	<b>Max</b> 10000 [ms]	<b>Factory setting</b> 0 [ms]

**Description:** Sets the smoothing time constant for smoothing the speed actual value on the speed controller.

**p50201[0...n] Band-stop 1 resonant frequency / Band-st 1 f\_n**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6810
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 1 [Hz]	<b>Max</b> 140 [Hz]	<b>Factory setting</b> 1 [Hz]

**Description:** Sets the resonant frequency for band-stop 1.

**Dependency:** Refer to: p50202, p50628, r52177

**p50202[0...n] Band-stop 1 quality / Band-st 1 quality**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6810
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 3	<b>Factory setting</b> 0

**Description:** Sets the quality for band-stop 1.

**Value:**  
0: Quality = 0.5  
1: Quality = 1  
2: Quality = 2  
3: Quality = 3

**Dependency:** Refer to: p50201, p50628, r52177

**p50203[0...n] Band-stop 2 resonant frequency / Band-st 2 f\_n**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6810
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 1 [Hz]	<b>Max</b> 140 [Hz]	<b>Factory setting</b> 1 [Hz]

**Description:** Sets the resonant frequency for band-stop 2.

**Dependency:** Refer to: p50204, p50629, r52178

**p50204[0...n] Band-stop 2 quality / Band-st 2 quality**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6810
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 3	<b>Factory setting</b> 0

**Description:** Sets the quality for band-stop 2.

**Value:** 0: Quality = 0.5  
1: Quality = 1  
2: Quality = 2  
3: Quality = 3

**Dependency:** Refer to: p50203, p50629, r52178

---

**p50205[0...n] Derivative-action element derivative-action time / D-act el t<sub>d-act</sub>**

<b>DC_CTRL</b>	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6810
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0 [ms]	1000 [ms]	0 [ms]

**Description:** Sets the derivative-action time for the derivative-action element.

**Dependency:** Refer to: p50206, p50627, r52168, r52169

---

**p50206[0...n] Derivative-action element smoothing time / Der-act el t<sub>DAE</sub>**

<b>DC_CTRL</b>	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6810
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0 [ms]	100 [ms]	0 [ms]

**Description:** Sets the smoothing time for the derivative-action element.

**Dependency:** Refer to: p50205, p50627, r52168, r52169

---

**r50217 Speed controller droop effective / n<sub>ctr</sub> droop eff**

<b>DC_CTRL</b>	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6805
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the effective droop on the speed controller.

**Notice:** The effective droop is displayed as absolute factor without any dimensions and it is especially important to note that it is not a percentage.

Example:

r50217 = 0.05 --> corresponds to an effective droop of 5 %.

---

**r50218 Speed controller integral time effective / n<sub>ctr</sub> T<sub>n</sub> eff**

<b>DC_CTRL</b>	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6805
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [s]	- [s]	- [s]

**Description:** Displays the effective integral time (T<sub>n</sub>) on the speed controller.

**r50219 CO: Speed controller P-gain effective / n\_ctr Kp eff**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6805
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the effective P gain (Kp) on the speed controller.

**p50220[0...n] Speed controller changeover PI/P speed setpoint threshold / PI/P n\_set thresh**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6815
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0.00 [%]	200.00 [%]	200.00 [%]

**Description:** Sets the threshold for the speed setpoint to changeover between PI and P control, so that overshoot-free stopping of the drive with setpoint = 0 is possible with the controllers enabled.

**Dependency:** Refer to: p50221, p50222, p50698, r52166

**p50221[0...n] Speed controller changeover PI/P hysteresis / PI/P hyst**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6815
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0.00 [%]	100.00 [%]	2.00 [%]

**Description:** Sets the hysteresis to changeover over between PI and P control, so that overshoot-free stopping of the drive with setpoint = 0 is possible with the controllers enabled.

**Dependency:** Refer to: p50222, p50698, r52166

**p50222[0...n] Speed controller changeover PI/P speed actual value threshold / PI/P n\_act thresh**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6815
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0.00 [%]	10.00 [%]	0.00 [%]

**Description:** Sets the threshold for the speed actual value to changeover between PI and P control, so that overshoot-free stopping of the drive with setpoint = 0 is possible with the controllers enabled.

**Dependency:** Refer to: p50221, p50698, r52166

**p50223[0...n] Speed controller pre-control enable / n\_ctr prec ena**

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6815
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	1	0

**Description:** Sets the enable signal for pre-control of the speed controller.



**Value:** 0: No enable  
1: Enable

**Note:** Dependent upon the setting, the following values are added to the output of the speed controller as a torque set-point:  
Value = 0: No enable (0%)  
Value = 1: Enable (r52171)

---

**p50224[0...n] Speed controller integral component configuration / n\_ctl comp conf**

DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 3	<b>Access level:</b> 2 <b>Func. diagram:</b> 6815 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
---------	---	--	--

**Description:** Sets the response of the integral component on the speed controller.

**Value:** 0: Integral component off (absolute P controller)  
1: Stop integral component from defined tqe/I limit  
2: Stop integral component from defined tqe limit  
3: Stop integral component at +/- 200%

---

**p50225[0...n] Speed controller adaptation Kp y coordinate 2 / Adapt Kp y2**

DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.10	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 2000.00	<b>Access level:</b> 2 <b>Func. diagram:</b> 6805 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 3.00
---------	---	--	---

**Description:** Sets the y coordinate for pair of values 2 for adaptation of the P gain (Kp).

**Note:** The value is set automatically during the optimization run for the speed controller (p50051 = 26).  
The adaptation of the P gain (Kp) is defined using 2 pairs of values.  
Pair of values 1:  
p50556/p50550 (x/y coordinate)  
Pair of values 2:  
p50559/p50225 (x/y coordinate)

---

**p50226[0...n] Speed controller adaptation Tn y coordinate 2 / Adapt Tn y2**

DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.010 [s]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 10.000 [s]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6805 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.650 [s]
---------	--	---	--

**Description:** Sets the y coordinate for pair of values 2 for adaptation of the integral time (Tn).

**Note:** The value is set automatically during the optimization run for the speed controller (p50051 = 26).  
The adaptation of the integral time (Tn) is defined using 2 pairs of values.  
Pair of values 1:  
p50557/p50551 (x/y coordinate)  
Pair of values 2:  
p50560/p50226 (x/y coordinate)

<b>p50227[0...3]      Speed controller adaptation droop y coordinate 2 / Adapt droop y2</b>			
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.000	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 10.000	<b>Access level:</b> 2 <b>Func. diagram:</b> 6805 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.000
<b>Description:</b>	Sets the y coordinate for pair of values 2 for adaptation of the droop.		
<b>Notice:</b>	<p>- For the droop, generally values up to 10 % are practical (p50227 = 0.000 ... 0.100). Under certain circumstances, higher values can result in an unstable response of the speed controller.</p> <p>- The droop is entered as absolute factor without any dimensions and it is especially important to note that it is not a percentage.</p> <p>Example:</p> <p>Set droop = 5 % --&gt; p50227 = 0.05</p>		
<b>Note:</b>	<p>The adaptation of the droop is defined using 2 pairs of values.</p> <p>Pair of values 1:</p> <p>p50558/p50552 (x/y coordinate)</p> <p>Pair of values 2:</p> <p>p50561/p50227 (x/y coordinate)</p>		
<hr/>			
<b>p50228[0...n]      Speed controller speed setpoint smoothing time constant / n_ctr n_set T</b>			
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0 [ms]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 10000 [ms]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6810 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0 [ms]
<b>Description:</b>	Sets the smoothing time constant for smoothing the speed setpoint on the speed controller.		
<b>Recommend.:</b>	If the ramp-function generator is being used, setting lower values may be sensible.		
<b>Note:</b>	The value is set automatically during the optimization run for the speed controller to the same value as the integral time (Tn) (p50051 = 26).		
<hr/>			
<b>p50229[0...n]      Mast/Sl drive ctr speed controller tracking I component / M/S drive ctr track</b>			
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1	<b>Access level:</b> 2 <b>Func. diagram:</b> 6810 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Setting for the control of the integral component tracking on the speed controller.		
<b>Value:</b>	0:      Tracking ON 1:      Tracking OFF		
<b>Dependency:</b>	Refer to: p50084, p50687		
<b>Note:</b>	<p>p50229 = 0:</p> <p>Tracking of the integral component on the speed controller activated. The speed actual value is used as speed set-point and the integral component of the speed controller is tracked so that r52148 = r52140 results.</p> <p>p50229 = 1:</p> <p>Tracking of the integral component on the speed controller de-activated.</p>		

<b>p50230[0...n]</b>	<b>Set speed controller integral component duration / Set I_comp dur</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0 [ms]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 10000 [ms]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6815 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0 [ms]
<b>Description:</b>	Sets the duration for setting the integral component on the speed controller. Following a positive edge on binector input p50695, the integral component of the speed controller is set to the value of the signal source set at connector input p50631. If p50230 = 0: The integral component of the speed controller is set to the instantaneous value of the signal present at connector input p50631. If p50230 > 0: The integral component of the speed controller is tracked continuously during the time set to the value of the signal present at connector input p50631.		
<b>p50234[0...n]</b>	<b>Speed controller proportional component enable / n_ctr P_comp ena</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1	<b>Access level:</b> 2 <b>Func. diagram:</b> 6815 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Setting for enabling the proportional component for the speed controller.		
<b>Value:</b>	0: Without proportional component 1: With proportional component		
<b>p50236</b>	<b>Speed controller optimization speed controller dynamic response / n_ctr_opt dyn</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 10 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> 100 [%]	<b>Access level:</b> 3 <b>Func. diagram:</b> 2660 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 75 [%]
<b>Description:</b>	Sets the dynamic response of the speed control circuit as the default for the speed controller optimization run.		
<b>Recommend.:</b>	On drives with gear backlash, for example, optimization should be started commencing with low dynamic response values at and above 10%. On drives with maximum requirements in terms of synchronous operation and dynamic response, values of up to 100 % can be selected.		
<b>Note:</b>	If this value is changed, the optimization run for the speed controller will have to be performed again before the new value is applied.		
<b>p50237[0...n]</b>	<b>Speed controller reference model natural frequency / n_ctrl ref_m fn</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.0 [Hz]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 150.0 [Hz]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6812 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.0 [Hz]
<b>Description:</b>	Sets the natural frequency of a PT2 element for the reference model of the speed controller.		
<b>Recommend.:</b>	The reference model is correctly set when the characteristics of r52154 (reference model output) and r52167 (actual speed value) are virtually identical when the I component of the speed controller is disabled.		

**Dependency:** In conjunction with p50238 and p50239, the characteristics (in time) of the P-controlled speed control loop can be emulated.  
Refer to: p50238, p50239

---

<b>p50238[0...n]</b>	<b>Speed controller reference model damping / n_ctrl ref_m d</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6812
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0.000	<b>Max</b> 5.000	<b>Factory setting</b> 1.000

**Description:** Sets the damping of a PT2 element for the reference model of the speed controller.

**Recommend.:** The reference model is correctly set when the characteristics of r52154 (reference model output) and r52167 (actual speed value) are virtually identical when the I component of the speed controller is disabled.

**Dependency:** In conjunction with p50237 and p50239, the characteristics (in time) of the P-controlled speed control loop can be emulated.  
Refer to: p50237, p50239

---

<b>p50239[0...n]</b>	<b>Speed controller reference model dead time / n_ctr ref_m t_dead</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6812
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0.00	<b>Max</b> 2.00	<b>Factory setting</b> 0.00

**Description:** Sets the "fractional" dead time for the reference model of the speed controller.

This parameter emulates the computing dead time of the proportionally controlled speed control loop.

The multiplier set refers to the speed controller clock cycle.

**Recommend.:** The reference model is correctly set when the characteristics of r52154 (reference model output) and r52167 (actual speed value) are virtually identical when the I component of the speed controller is disabled.

**Dependency:** In conjunction with p50237 and p50238, the characteristics (in time) of the P-controlled speed control loop can be emulated.  
Refer to: p50237, p50238

---

<b>p50240[0...n]</b>	<b>Speed controller reference model activation / n_ctrl ref_m act</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6815
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 1	<b>Factory setting</b> 0

**Description:** Setting to activate the influence of the reference model for the speed controller.

**Value:**  
0: Reference model not effective  
1: Reference model effective

**Dependency:** Refer to: p50241

<b>p50241</b>	<b>CI: Speed controller reference model signal source / n_ctrl ref_m sig s</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> 6815 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 52155[0]
<b>Description:</b>	Sets the signal source for the input signal of the reference model for the speed controller.		
<b>Dependency:</b>	Refer to: p50240		
<b>p50250[0...n]</b>	<b>Field converter Alpha G limit / Field Alpha G lim</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0 [°]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 180 [°]	<b>Access level:</b> 3 <b>Func. diagram:</b> 6915 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0 [°]
<b>Description:</b>	Sets the rectifier stability limit for the firing angle of the field converter.		
<b>Dependency:</b>	Refer to: r53191		
<b>Note:</b>	The status of the Alpha G limit is shown in r53191.1.		
<b>p50251[0...n]</b>	<b>Field converter Alpha W limit / Field Alpha W lim</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0 [°]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 180 [°]	<b>Access level:</b> 3 <b>Func. diagram:</b> 6915 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 180 [°]
<b>Description:</b>	Sets the inverter stability limit for the firing angle of the field converter.		
<b>Dependency:</b>	Refer to: r53191		
<b>Note:</b>	The status of the Alpha W limit is shown in r53191.0.		
<b>p50252[0...n]</b>	<b>Field average number of line periods / Field line per no.</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 1	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 20	<b>Access level:</b> 3 <b>Func. diagram:</b> 6952 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 20
<b>Description:</b>	Setting of the number of line periods for line frequency correction in the field circuit.		
<b>Note:</b>	The internal line synchronization for the field firing pulses derived from the power terminals (line infeed) is averaged over the number of line periods set in this parameter.  In the case of operation on "weak" power supplies with unstable frequencies (on a diesel-driven generator, for example (isolated operation), this parameter must be set lower than for operation on "constant V/Hz" systems to achieve a higher frequency correction speed.		

<b>p50253[0...n]</b>	<b>Field pre-control activation / Field prec act</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6910
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 1	<b>Factory setting</b> 1
<b>Description:</b>	Sets activation/de-activation for field pre-control.		
<b>Value:</b>	0: Deactivated 1: Activated		
<b>Note:</b>	If value = 0: The field pre-control output is -100% (corresponds to 180 °).		
<b>p50254[0...n]</b>	<b>Field current controller integral component activation / I_field_ctr I comp</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6910
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 1	<b>Factory setting</b> 1
<b>Description:</b>	Sets activation/de-activation of the integral component on the field current controller.		
<b>Value:</b>	0: Deactivated 1: Activated		
<b>Dependency:</b>	Refer to: p50255, p50256		
<b>Note:</b>	If value = 0: The integral component of the field current controller is kept constantly at zero (i.e. the field current controller functions solely as a proportional controller).		
<b>p50255[0...n]</b>	<b>Field current controller P gain / I_field_ctr Kp</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6908
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0.01	<b>Max</b> 100.00	<b>Factory setting</b> 5.00
<b>Description:</b>	Sets the P gain of the field current controller.		
<b>Dependency:</b>	Refer to: p50256		
<b>Note:</b>	The parameter is set automatically during the optimization run for closed-loop field current control (p50051 = 24).		
<b>p50256[0...n]</b>	<b>Field current controller integral time / I_field_ctr Tn</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6908
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0.001 [s]	<b>Max</b> 10.000 [s]	<b>Factory setting</b> 0.200 [s]
<b>Description:</b>	Sets the integral time of the field current controller.		
<b>Dependency:</b>	Refer to: p50255		
<b>Note:</b>	The parameter is set automatically during the optimization run for closed-loop field current control (p50051 = 24).		

<b>p50257[0...n]</b>	<b>Closed-loop field current control standstill field / If_ctr stst_field</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6910
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0.0 [%]	<b>Max</b> 100.0 [%]	<b>Factory setting</b> 0.0 [%]
<b>Description:</b>	Sets the standstill field for closed-loop field current control.		
<b>Dependency:</b>	Refer to: p50692		
<b>Note:</b>	The field current is reduced to this value when the "Automatic field current reduction" function is parameterized (p50082 = 2) or in the case of signal-driven selection of the "Standstill excitation" function (p50692).		
<b>p50258[0...n]</b>	<b>Cl-loop field current control field current reduction delay time / If_ctr I_red t_del</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6910
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0.0 [s]	<b>Max</b> 60.0 [s]	<b>Factory setting</b> 10.0 [s]
<b>Description:</b>	Sets the delay time for automatic field current reduction.		
<b>p50260[0...n]</b>	<b>Field current pre-control setpoint smoothing time constant / Field_prec set T</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6910
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0 [ms]	<b>Max</b> 10000 [ms]	<b>Factory setting</b> 0 [ms]
<b>Description:</b>	Sets the smoothing time constant for the setpoint for field current pre-control.		
<b>Dependency:</b>	Refer to: p50261		
<b>Note:</b>	This smoothing enables field-current pre-control to be decoupled from the field current controller.		
<b>p50261[0...n]</b>	<b>Field current controller setpoint smoothing time constant / I_field_ctr set T</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6910
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0 [ms]	<b>Max</b> 10000 [ms]	<b>Factory setting</b> 0 [ms]
<b>Description:</b>	Sets the smoothing time constant for the setpoint for the field current controller.		
<b>Dependency:</b>	Refer to: p50260		
<b>Note:</b>	This smoothing enables field-current pre-control to be decoupled from the field current controller.		
<b>p50263[0...n]</b>	<b>Selection of motor flux input variable / Mot fl input sel</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6910
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 2	<b>Factory setting</b> 1
<b>Description:</b>	Selection of the input variable for determining the motor flux.		

<b>Value:</b>	0: Field current controller actual value (r52265) 1: EMF pre-control output (r52293 or r52268) 2: Field current controller setpoint (r52268)
<b>Note:</b>	If value = 0: This setting is recommended for a fully compensated DC motor. If value = 1: This setting is recommended for an uncompensated DC motor. The EMF controller must be active for this setting (the EMF controller compensates the armature reaction). If value = 2: This setting is recommended for a fully compensated DC motor. Advantage compared with value = 0: Values derived from the setpoint are generally steadier than those derived from the actual value. Disadvantage compared with value = 0: The actual value can deviate from the setpoint dramatically, thereby distorting the motor flux calculation.

<b>p50264[0...n]</b>	<b>Field current controller proportional component activation / I_field_ctr P comp</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6910
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	1	1
<b>Description:</b>	Sets activation/de-activation of the proportional component on the field current controller.		
<b>Value:</b>	0: Deactivated 1: Activated		
<b>Dependency:</b>	Refer to: p50255, p50256		
<b>Note:</b>	If value = 0: The proportional component of the field current controller is kept constantly at zero (i.e. the field current controller functions solely as an integral controller).		

<b>p50265[0...n]</b>	<b>BI: Signal source for field current monitoring / I_field mon sig s</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> CDS, p0170	<b>Func. diagram:</b> 8044
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	1
<b>Description:</b>	Sets the signal source for external monitoring of the field current. The delay time in p50397 is started after a 1/0 signal and a corresponding fault is triggered once it has elapsed.		
<b>Dependency:</b>	Refer to: p50397		

<b>p50266[0...n]</b>	<b>CI: Field current controller Tn factor signal source / If_ctrTnFact sig s</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / FloatingPoint32	<b>Dyn. index:</b> CDS, p0170	<b>Func. diagram:</b> 6908
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	1
<b>Description:</b>	Sets the signal source for a factor of the integral time Tn for the field current controller.		
<b>Dependency:</b>	Refer to: p50256		



<b>p50267[0...n]</b>	<b>CI: Field current controller Kp factor signal source / If_ctrKpFact sig s</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> 6908 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Sets the signal source for a factor of the proportional gain Kp for the field current controller.		
<b>Dependency:</b>	Refer to: p50255		
<b>p50269</b>	<b>Freeze field current setpoint operating mode / If freeze op_mode</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 2	<b>Access level:</b> 2 <b>Func. diagram:</b> 6905 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 2
<b>Description:</b>	Sets the operating mode for the "Freeze field current setpoint" function.		
<b>Value:</b>	0: Never freeze 1: Freeze for tachometer breakage 2: Freeze for every fault		
<b>p50272</b>	<b>Field current reduction activation / I_field_red act</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1	<b>Access level:</b> 2 <b>Func. diagram:</b> 6900 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets activation/de-activation of automatic field current reduction if the EMF is too high for braking operation.		
<b>Value:</b>	0: Fault 1: Alarm and field reduction		
<b>Note:</b>	If value = 0: If the EMF is too high for braking operation, a message is output accordingly.		
<b>p50273[0...n]</b>	<b>EMF controller pre-control activation / EMF ctr prec act</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1	<b>Access level:</b> 2 <b>Func. diagram:</b> 6900 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Sets activation/de-activation for EMF controller pre-control.		
<b>Value:</b>	0: Deactivated 1: Activated		
<b>Note:</b>	If value = 0: The EMF controller's pre-control output is set to 100% (corresponding to the rated excitation current of the motor (p50102)).		

<b>p50274[0...n] EMF controller integral component activation / EMF ctr I comp act</b>			
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1	<b>Access level:</b> 2 <b>Func. diagram:</b> 6900 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Sets activation/de-activation of the integral component on the EMF controller.		
<b>Value:</b>	0: Deactivated 1: Activated		
<b>Dependency:</b>	Refer to: p50284		
<b>Note:</b>	If value = 0:  The integral component of the EMF controller is kept constantly at zero (i.e. the EMF controller functions solely as a proportional controller).		
<hr/>			
<b>p50275[0...n] EMF controller P gain / EMF ctr Kp</b>			
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.01	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 100.00	<b>Access level:</b> 2 <b>Func. diagram:</b> 6900 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.60
<b>Description:</b>	Sets the P gain of the EMF controller.		
<b>Dependency:</b>	Refer to: p50276		
<b>Note:</b>	The parameter is set automatically during the optimization run for field weakening (p50051 = 27).		
<hr/>			
<b>p50276[0...n] EMF controller integral time / EMF ctr Tn</b>			
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.010 [s]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 10.000 [s]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6900 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.200 [s]
<b>Description:</b>	Sets the integral time of the EMF controller.		
<b>Dependency:</b>	Refer to: p50275		
<b>Note:</b>	The parameter is set automatically during the optimization run for field weakening (p50051 = 27).		
<hr/>			
<b>p50277[0...n] EMF controller droop / EMF ctr droop</b>			
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.0 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> 10.0 [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6900 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.0 [%]
<b>Description:</b>	Sets the value for the EMF controller's droop feedback.		
<b>Note:</b>	If value = 0:  Droop feedback is de-activated.		

<b>p50280[0...n]</b>	<b>EMF controller pre-control setpoint smoothing time constant / EMF prec set T</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6900
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0 [ms]	<b>Max</b> 10000 [ms]	<b>Factory setting</b> 0 [ms]
<b>Description:</b>	Sets the smoothing time constant for the setpoint for EMF controller pre-control.		
<b>Dependency:</b>	Refer to: p50283		
<b>Note:</b>	This smoothing enables the EMF controller pre-control to be decoupled from the EMF controller.		

<b>p50281[0...n]</b>	<b>EMF controller setpoint smoothing time constant / EMF ctr set T</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6900
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0 [ms]	<b>Max</b> 10000 [ms]	<b>Factory setting</b> 0 [ms]
<b>Description:</b>	Sets the smoothing time constant for the EMF controller's setpoint.		
<b>Dependency:</b>	Refer to: p50282		
<b>Note:</b>	This smoothing enables the EMF controller pre-control to be decoupled from the EMF controller.		

<b>p50282[0...n]</b>	<b>EMF controller actual value smoothing time constant / EMF ctr act T</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6900
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0 [ms]	<b>Max</b> 10000 [ms]	<b>Factory setting</b> 0 [ms]
<b>Description:</b>	Sets the smoothing time constant for the EMF controller's actual value.		
<b>Dependency:</b>	Refer to: p50281		
<b>Note:</b>	This smoothing enables the EMF controller pre-control to be decoupled from the EMF controller.		

<b>p50283[0...n]</b>	<b>EMF controller pre-control actual value smoothing time constant / EMF prec act T</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6900
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0 [ms]	<b>Max</b> 10000 [ms]	<b>Factory setting</b> 0 [ms]
<b>Description:</b>	Sets the smoothing time constant for the actual value for EMF controller pre-control.		
<b>Dependency:</b>	Refer to: p50280		
<b>Note:</b>	This smoothing enables the EMF controller pre-control to be decoupled from the EMF controller.		

<b>p50284[0...n]</b>	<b>EMF controller proportional component activation / EMF ctr P comp act</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6900
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 1	<b>Factory setting</b> 1
<b>Description:</b>	Sets activation/de-activation of the proportional component on the EMF controller.		
<b>Value:</b>	0: Deactivated 1: Activated		
<b>Dependency:</b>	Refer to: p50275, p50276		
<b>Note:</b>	If value = 0: The proportional component of the EMF controller is kept constantly at zero (i.e. the EMF controller functions solely as an integral controller).		
<b>p50285[0...n]</b>	<b>EMF setpoint reduction line voltage smoothing time / EMF set line t_sm</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6895
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0.00 [s]	<b>Max</b> 10.00 [s]	<b>Factory setting</b> 0.00 [s]
<b>Description:</b>	Sets the smoothing time for the line voltage for the EMF setpoint reduction.		
<b>Dependency:</b>	Refer to: p50286, p50287, p50288, p50289, r52294		
<b>p50286[0...n]</b>	<b>EMF setpoint reduction line voltage upper limit / EMF set line upper</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6895
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 100.0 [%]	<b>Max</b> 150.0 [%]	<b>Factory setting</b> 110.0 [%]
<b>Description:</b>	Sets the upper limit for the line voltage for EMF setpoint reduction.		
<b>Dependency:</b>	Refer to: p50287, p50288, p50289, r52294		
<b>p50287[0...n]</b>	<b>EMF setpoint reduction line voltage lower limit / EMF set line lower</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6895
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0.0 [%]	<b>Max</b> 100.0 [%]	<b>Factory setting</b> 0.0 [%]
<b>Description:</b>	Sets the lower limit for the line voltage for the EMF setpoint reduction.		
<b>Dependency:</b>	Refer to: p50286, p50288, p50289, r52294		

<b>p50288[0...n] EMF setpoint reduction evaluation factor / EMF set eval_fact</b>			
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.0 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> 200.0 [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6895 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 100.0 [%]
<b>Description:</b>		Sets the evaluation factor for the EMF setpoint reduction.	
<b>Dependency:</b>		Refer to: p50286, p50287, p50289, r52294	

<b>p50289[0...n] BI: EMF setpoint reduction activation signal source / EMF set act sig s</b>			
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> 6895 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>		Sets the signal source to activate the EMF setpoint reduction.	
<b>Dependency:</b>		Refer to: p50285, p50286, p50287, p50288, r52294	

<b>p50295[0...n] Transition rounding operating mode / RFG rounding mode</b>			
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1	<b>Access level:</b> 2 <b>Func. diagram:</b> 3152 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>		Sets the response to setpoint inversion on the ramp-function generator.	
<b>Value:</b>		0: Hard setpoint change 1: Soft setpoint change	
<b>Note:</b>		If p50295 = 0:  In the event of setpoint inversion during ramping up, ramp-up is aborted and ramp-down initial rounding commences immediately, and vice versa. As the setpoint is not increased (decreased) any further, the signal at the ramp-function generator output has a breakpoint (in other words, there is a step change in the acceleration rate).  If p50295 = 1:  In the event of setpoint inversion during ramping up, ramp-up is slowly switched over to ramp-down, and vice versa. The setpoint increases/decreases further. There is no breakpoint in the signal at the ramp-function generator output (in other words, there is no step change in the acceleration rate).	

<b>p50296[0...n] RFG quick stop (OFF3) ramp-down time / RFG OFF3 t_ramp-dn</b>			
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.00 [s]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 650.00 [s]	<b>Access level:</b> 2 <b>Func. diagram:</b> 3150 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.00 [s]
<b>Description:</b>		Sets the ramp-down time for quick stop (OFF3) on the ramp-function generator.  When the "Quick stop" command is sent, the drive is decelerated to zero speed at the current limit.  However, if this is not permissible or desirable for mechanical reasons, a value > 0 must be set in this parameter. The drive will then decelerate along the down ramp set here.	

<b>p50297[0...n]</b>	<b>RFG quick stop (OFF3) initial rounding / RFG OFF3 init rndg</b>		
DC_CTRL	Can be changed: U, T	Calculated: -	Access level: 2
	Data type: FloatingPoint32	Dyn. index: DDS, p0180	Func. diagram: 3150
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min 0.00 [s]	Max 100.00 [s]	Factory setting 0.00 [s]
<b>Description:</b>	Sets the initial rounding for quick stop (OFF3) on the ramp-function generator.		
<b>p50298[0...n]</b>	<b>RFG quick stop (OFF3) final rounding / RFG OFF3 fin rndg</b>		
DC_CTRL	Can be changed: U, T	Calculated: -	Access level: 2
	Data type: FloatingPoint32	Dyn. index: DDS, p0180	Func. diagram: 3150
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min 0.00 [s]	Max 100.00 [s]	Factory setting 0.00 [s]
<b>Description:</b>	Sets the final rounding for quick stop (OFF3) on the ramp-function generator.		
<b>p50300[0...n]</b>	<b>RFG positive setpoint limit after ramp-function generator / RFG pos after RFG</b>		
DC_CTRL	Can be changed: U, T	Calculated: -	Access level: 2
	Data type: FloatingPoint32	Dyn. index: DDS, p0180	Func. diagram: 3155
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: PERCENT	Expert list: 1
	Min -200.00 [%]	Max 200.00 [%]	Factory setting 100.00 [%]
<b>Description:</b>	Sets positive setpoint limiting after the ramp-function generator.		
<b>p50301[0...n]</b>	<b>RFG negative setpoint limit after ramp-function generator / RFG neg after RFG</b>		
DC_CTRL	Can be changed: U, T	Calculated: -	Access level: 2
	Data type: FloatingPoint32	Dyn. index: DDS, p0180	Func. diagram: 3155
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: PERCENT	Expert list: 1
	Min -200.00 [%]	Max 200.00 [%]	Factory setting -100.00 [%]
<b>Description:</b>	Sets negative setpoint limiting after the ramp-function generator.		
<b>p50302[0...n]</b>	<b>RFG ramp-up integrator operating mode / RFG integ op mode</b>		
DC_CTRL	Can be changed: T	Calculated: -	Access level: 2
	Data type: Integer16	Dyn. index: DDS, p0180	Func. diagram: 3150
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min 0	Max 3	Factory setting 0
<b>Description:</b>	Sets the operating mode for the ramp-up integrator. The ramp-up integrator controls the changing over of the ramp-function generator parameter sets as appropriate for the set operating mode once the setpoint has been reached for the first time.		
<b>Value:</b>	0: RFG normal operation 1: Operating mode 1 2: Operating mode 2 3: Operating mode 3		

**Note:** If p50302 = 0:  
 - The parameter sets are not changed over and ramp-function generator setting 1 is always used (or the setting made using p50637, p50638).  
 If p50302 = 1:  
 - Once the setpoint has been reached for the first time, the ramp-function generator parameter set is changed over from 1 to 0.  
 If p50302 = 2:  
 - Once the setpoint has been reached for the first time, the ramp-function generator parameter set is changed over from 1 to 2.  
 If p50302 = 3:  
 - Once the setpoint has been reached for the first time, the ramp-function generator parameter set is changed over from 1 to 3.

<b>p50303[0...n]</b>		<b>RFG ramp-up time 1 / RFG t<sub>ramp-up</sub> 1</b>	
DC_CTRL	<b>Can be changed:</b> C2(1), U, T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 3150
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0.00 [s]	<b>Max</b> 650.00 [s]	<b>Factory setting</b> 10.00 [s]
<b>Description:</b>	Sets the ramp-up time for ramp-function generator parameter set 1.		
<b>Note:</b>	The parameter is effective in the following cases: - No quick stop (OFF3) active - No other ramp-function generator parameter set selected - No selection via ramp-up integrator		

<b>p50304[0...n]</b>		<b>RFG ramp-down time 1 / RFG t<sub>ramp-dn</sub> 1</b>	
DC_CTRL	<b>Can be changed:</b> C2(1), U, T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 3150
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0.00 [s]	<b>Max</b> 650.00 [s]	<b>Factory setting</b> 10.00 [s]
<b>Description:</b>	Sets the ramp-down time for ramp-function generator parameter set 1.		
<b>Note:</b>	The parameter is effective in the following cases: - No quick stop (OFF3) active - No other ramp-function generator parameter set selected - No selection via ramp-up integrator		

<b>p50305[0...n]</b>		<b>RFG initial rounding 1 / RFG init rndg 1</b>	
DC_CTRL	<b>Can be changed:</b> C2(1), U, T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 3150
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0.00 [s]	<b>Max</b> 100.00 [s]	<b>Factory setting</b> 0.00 [s]
<b>Description:</b>	Sets the initial rounding for ramp-function generator parameter set 1.		
<b>Dependency:</b>	Refer to: p50295		
<b>Note:</b>	The parameter is effective in the following cases: - No quick stop (OFF3) active - No other ramp-function generator parameter set selected - No selection via ramp-up integrator		

<b>p50306[0...n] RFG final rounding 1 / RFG fin rndg 1</b>			
DC_CTRL	<b>Can be changed:</b> C2(1), U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.00 [s]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 100.00 [s]	<b>Access level:</b> 1 <b>Func. diagram:</b> 3150 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.00 [s]
<b>Description:</b> Sets the final rounding for ramp-function generator parameter set 1.			
<b>Dependency:</b> Refer to: p50295			
<b>Note:</b> The parameter is effective in the following cases: - No quick stop (OFF3) active - No other ramp-function generator parameter set selected - No selection via ramp-up integrator			
<hr/>			
<b>p50307[0...n] RFG ramp-up time 2 / RFG t_ramp-up 2</b>			
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.00 [s]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 650.00 [s]	<b>Access level:</b> 2 <b>Func. diagram:</b> 3150 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 10.00 [s]
<b>Description:</b> Sets the ramp-up time for ramp-function generator parameter set 2.			
<hr/>			
<b>p50308[0...n] RFG ramp-down time 2 / RFG ramp-dn time 2</b>			
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.00 [s]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 650.00 [s]	<b>Access level:</b> 2 <b>Func. diagram:</b> 3150 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 10.00 [s]
<b>Description:</b> Sets the ramp-down time for ramp-function generator parameter set 2.			
<hr/>			
<b>p50309[0...n] RFG initial rounding 2 / RFG init rndg 2</b>			
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.00 [s]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 100.00 [s]	<b>Access level:</b> 2 <b>Func. diagram:</b> 3150 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.00 [s]
<b>Description:</b> Sets the initial rounding for ramp-function generator parameter set 2.			
<b>Dependency:</b> Refer to: p50295			
<hr/>			
<b>p50310[0...n] RFG final rounding 2 / RFG fin rndg 2</b>			
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.00 [s]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 100.00 [s]	<b>Access level:</b> 2 <b>Func. diagram:</b> 3150 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.00 [s]
<b>Description:</b> Sets the final rounding for ramp-function generator parameter set 2.			
<b>Dependency:</b> Refer to: p50295			



**p50311[0...n] RFG ramp-up time 3 / RFG t\_ramp-up 3**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 3150
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0.00 [s]	650.00 [s]	10.00 [s]

**Description:** Sets the ramp-up time for ramp-function generator parameter set 3.

**p50312[0...n] RFG ramp-down time 3 / RFG t\_ramp-dn 3**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 3150
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0.00 [s]	650.00 [s]	10.00 [s]

**Description:** Sets the ramp-down time for ramp-function generator parameter set 3.

**p50313[0...n] RFG initial rounding 3 / RFG init rndg 3**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 3150
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0.00 [s]	100.00 [s]	0.00 [s]

**Description:** Sets the initial rounding for ramp-function generator parameter set 3.

**Dependency:** Refer to: p50295

**p50314[0...n] RFG final rounding 3 / RFG fin rndg 3**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 3150
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0.00 [s]	100.00 [s]	0.00 [s]

**Description:** Sets the final rounding for ramp-function generator parameter set 3.

**Dependency:** Refer to: p50295

**r50315[0...3] RFG effective times / RFG t effective**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 3150
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [s]	- [s]	- [s]

**Description:** Displays the effective times on the ramp-function generator.

**Index:**  
 [0] = Ramp-up time  
 [1] = Ramp-down time  
 [2] = Initial rounding  
 [3] = Final rounding

**r50316 RFG state / RFG state**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 3152
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the state on the ramp-function generator.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	RFG enable	ON	OFF	3152
	01	RFG start	ON	OFF	3152
	02	Setpoint enable & OFF1	ON	OFF	3152
	03	Set ramp-function generator	ON	OFF	3152
	04	Track ramp-function generator	ON	OFF	3152
	05	Bypass ramp-function generator	ON	OFF	3152
	07	Ramp-down	ON	OFF	3152
	15	Ramp-up	ON	OFF	3152

**p50317[0...n] RFG tracking enable / RFG track ena**

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 3152
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	1	0

**Description:** Sets the enable for ramp-function generator tracking.

**Value:**  
 0: Inhibit  
 1: Enable

**Dependency:** RFG tracking has to be controlled by setting a 1 signal at binector input p50647.  
 Refer to: p50647

**p50318[0...n] RFG setting value selection / RFG set val sel**

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 3152
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	2	0

**Description:** Selection of the setting value for the ramp-function generator output for OFF1.

**Value:**  
 0: Ramp-function generator output not set  
 1: Set RFG output to setting value 1  
 2: Set RFG output to setting value 2

**Recommend.:** During "shutdown", limiting is not applied to the ramp-function generator output. As limiting the ramp-function generator output during "shutdown" does not generate a temporary increase in speed, p50318 should be set to 1 or 2.

**Dependency:** Refer to: p50650

**Note:**  
 If p50318 = 0:  
 The ramp-function generator output is not set.  
 If p50318 = 1:  
 The value supplied via connector input p50650[0] is applied as the setting value.  
 If p50318 = 2:  
 The value supplied via connector input p50650[1] is applied as the setting value.

<b>p50319[0...n]</b>	<b>RFG setpoint enable delay time / RFG set_ena i_del</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.00 [s]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 10.00 [s]	<b>Access level:</b> 2 <b>Func. diagram:</b> 3151 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.00 [s]
<b>Description:</b>	Sets the delay time for enabling the setpoint on the ramp-function generator. In the case of a setpoint enable, the setpoint is not injected on the ramp-function generator until this time has elapsed.		
<b>p50320[0...n]</b>	<b>Setpoint processing main setpoint factor / m_set_factor</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -300.00 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> 300.00 [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 3135 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 100.00 [%]
<b>Description:</b>	Sets the fixed factor for the main setpoint.		
<b>Dependency:</b>	Refer to: p50322		
<b>p50321[0...n]</b>	<b>Setpoint processing additional setpoint factor / Add_set_factor</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -300.00 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> 300.00 [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 3135 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 100.00 [%]
<b>Description:</b>	Sets the fixed factor for the additional setpoint.		
<b>Dependency:</b>	Refer to: p50323		
<b>p50322[0...n]</b>	<b>CI: Setpoint processing signal source for main setpoint factor / M set factor sig s</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 3135 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Sets the signal source for the variable factor for the main setpoint.		
<b>Dependency:</b>	Refer to: p50320		
<b>p50323[0...n]</b>	<b>CI: Setpoint processing signal source for additional setpoint factor / Add set fac sig s</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 3135 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Sets the signal source for the variable factor for the additional setpoint.		
<b>Dependency:</b>	Refer to: p50321		

<b>p50330[0...n]</b>			
<b>RFG time unit / RFG time unit</b>			
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 3150, 3152
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	1	0
<b>Description:</b> Sets the unit for the ramp-function generator times.			
<b>Value:</b> 0: Second 1: Minute			
<b>Note:</b> This time unit is applied to the following parameters: p50296, p50297, p50298: - Ramp-down time 4, initial rounding 4, final rounding 4 p50303, p50304, p50305, p50306: - Ramp-up time 1, ramp-down time 1, initial rounding 1, final rounding 1 p50307, p50308, p50309, p50310: - Ramp-up time 2, ramp-down time 2, initial rounding 2, final rounding 2 p50311, p50312, p50313, p50314: - Ramp-up time 3, ramp-down time 3, initial rounding 3, final rounding 3 p50542: - RFG dy/dt time difference			
<hr/>			
<b>p50331</b>			
<b>Braking distance Encoder Data Set selection / Br dist EDS sel</b>			
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned8	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 3152
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	15	0
<b>Description:</b> Sets the Encoder Data Set (EDS) used to calculate the braking distance (r52047, r52048).			
<hr/>			
<b>p50351[0...n]</b>			
<b>Line undervoltage threshold / Line V_und thresh</b>			
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6954
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-97 [%]	0 [%]	-20 [%]
<b>Description:</b> Sets the threshold for detecting line undervoltage for armature or field.			
<b>Note:</b> If the line voltage deviates by a higher value and does not fall back within the tolerance limits by the end of the restart time set in p50086, fault F60006 is triggered. During the time of excess deviation, the drive is kept in operating state "o4". For "optimization run for CCP" (p50051 = 30) the parameter is automatically set to -20% if the actual value is less than -20%.			

<b>p50352[0...n]</b>	<b>Line overvoltage threshold / Line V<sub>over</sub> thresh</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6954
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0 [%]	<b>Max</b> 99 [%]	<b>Factory setting</b> 20 [%]
<b>Description:</b>	Sets the threshold for detecting line undervoltage for armature or field.		
<b>Note:</b>	If the line voltage deviates by a higher value and does not fall back within the tolerance limits by the end of the restart time set in p50086, fault F60007 is triggered. During the time of excess deviation, the drive is kept in operating state "o4".		
<b>p50353[0...n]</b>	<b>Line monitoring phase failure threshold / Ph<sub>fail</sub> thresh</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6954
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 3 [%]	<b>Max</b> 100 [%]	<b>Factory setting</b> 40 [%]
<b>Description:</b>	Sets the threshold for phase failure detection in the context of line monitoring.		
<b>Note:</b>	If the line voltage in operating states <= o4 undershoots the setting value and does not adopt an "OK" state within the restart time set in p50086, fault F60004 is triggered. During the time that the threshold value is undershot and the voltage stabilization time which follows (set in p50090), the drive is kept in operating state o4. If the drive is switched on in operating state o4, the voltages of all phases will not be checked for compliance with this threshold until the time set in p50089 has elapsed.		
<b>p50354</b>	<b>BI: Stall protection activation signal source / Stall pr act sig s</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8046
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> 0
<b>Description:</b>	Sets the signal source to activate stall protection.		
<b>Dependency:</b>	Refer to: p50355, p50356		
<b>Note:</b>	1 signal: Stall protection activated 0 signal: Stall protection de-activated		
<b>p50355[0...n]</b>	<b>Stall protection monitoring time / Stall t<sub>mon</sub></b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 8046
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0.0 [s]	<b>Max</b> 600.0 [s]	<b>Factory setting</b> 0.5 [s]
<b>Description:</b>	Sets the monitoring time for stall protection. The set time starts when a stalled drive is detected. If these conditions still prevail once the time has elapsed, stall protection is activated and fault F60035 is triggered.		
<b>Dependency:</b>	Refer to: p50354, p50356		
<b>Note:</b>	"Stall protection" monitoring is switched off when p50355 = 0.00 s.		

**p50356[0...n] Stall protection threshold / Stall prot thresh**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 8046
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0.0 [%]	<b>Max</b> 10.0 [%]	<b>Factory setting</b> 0.4 [%]
<b>Description:</b>	Sets the speed threshold for stall protection.		
<b>Dependency:</b>	Refer to: p50355		

**p50357[0...n] Tachometer interruption monitoring threshold / Tacho\_mon thresh**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 8046
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 10 [%]	<b>Max</b> 100 [%]	<b>Factory setting</b> 10 [%]
<b>Description:</b>	Sets the threshold for tachometer interruption monitoring.		
<b>Note:</b>	For p50357 = 100 %, the tachometer interruption monitoring is not active!		

**p50361[0...n] Line monitoring undervoltage delay time / V\_under t\_del**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6954
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0 [ms]	<b>Max</b> 60000 [ms]	<b>Factory setting</b> 0 [ms]
<b>Description:</b>	Sets the delay time for undervoltage detection in the context of line monitoring.		
<b>Note:</b>	This time starts when undervoltage is detected. While this delay time is running, firing pulses are emitted; at the end of this time, fault F60006 is triggered. If a time has been set for automatic restart (p50086), it will not begin until the time set here has elapsed.		


**p50362[0...n] Line monitoring overvoltage delay time / Line V\_over t\_del**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6954
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0 [ms]	<b>Max</b> 60000 [ms]	<b>Factory setting</b> 0 [ms]
<b>Description:</b>	Sets the delay time for overvoltage monitoring in the context of line monitoring.		
<b>Note:</b>	The triggering of fault F60007 (line overvoltage) is delayed by the time set at this parameter. Firing pulses are emitted while this time is running. If a time has been set for automatic restart (p50086), it will not begin until the time set here has elapsed.		

**p50363[0...n] Line frequency minimum threshold / f\_line min thresh**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6954
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 23.0 [Hz]	<b>Max</b> 60.0 [Hz]	<b>Factory setting</b> 45.0 [Hz]
<b>Description:</b>	Sets the threshold for detecting that the line frequency has been undershot.		

**Note:** If the line frequency undershoots the value set here and does not rise back above it within the restart time set in p50086, fault F60008 is triggered.  
All the while the line frequency remains lower than the value set here, the drive is kept in operating state "o4".

<b>p50364[0...n] Line frequency maximum threshold / f_line max thresh</b>			
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6954
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 50.0 [Hz]	<b>Max</b> 500.0 [Hz]	<b>Factory setting</b> 65.0 [Hz]
<b>Description:</b>	Sets the threshold for detecting that the line frequency has been overshot.		
<b>Caution:</b>	SINAMICS DCM DC converters are suitable for line frequencies from 20 Hz up to 120 Hz. The SINAMICS DCM Control Module is suitable for line frequencies from 20 Hz up to 500 Hz if it is operated with a power unit designed for this frequency range. For a SINAMICS DCM DC converter, this parameter may only be set to a maximum value of 120 Hz! If a SINAMICS DCM DC converter were to be operated with a line frequency above 120 Hz, then it would be damaged or destroyed as a result of overheating.		
			
<b>Note:</b>	If the line frequency overshoots the value set here and does not fall back below it within the restart time set in p50086, fault F60009 is triggered. All the while the line frequency remains higher than the value set here, the drive is kept in operating state "o4".		

<b>p50366[0...1] CI: Current limitation signal source for speed and I2t monitoring / la lim n I2t sig s</b>			
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6840
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> [0] 52129[0] [1] 52130[0]
<b>Description:</b>	Sets the signal source for speed-dependent current limitation and current limitation from I2t monitoring.		
<b>Note:</b>	[0] = Speed-dependent current limitation [1] = Current limitation from I2t monitoring		

<b>p50370[0...n] Messages for speed less than minimum speed threshold / n &lt; n_min thresh</b>			
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 8020
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0.00 [%]	<b>Max</b> 200.00 [%]	<b>Factory setting</b> 0.50 [%]
<b>Description:</b>	Sets the threshold for the "Speed less then minimum speed" message.		
<b>Dependency:</b>	Refer to: p50371, p50593, r53025		
<b>Note:</b>	The "Speed less than minimum speed" message is available as follows: - r53025.6 (not inverted) - r53025.7 (inverted)		

<b>p50371[0...n]</b>	<b>Messages for speed less than minimum speed hysteresis / <math>n &lt; n\_min</math> hyst</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 8020
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0.00 [%]	<b>Max</b> 200.00 [%]	<b>Factory setting</b> 0.50 [%]
<b>Description:</b>	Sets the hysteresis for the "Speed less then minimum speed" message. The message is triggered when the threshold is undershot. Once the value rises above the threshold plus the hysteresis, the message is withdrawn.		
<b>Dependency:</b>	Refer to: p50370, p50593, r53025		
<b>Note:</b>	The "Speed less than minimum speed reached" message is available as follows: - r53025.6 (not inverted) - r53025.7 (inverted)		
<b>p50372[0...n]</b>	<b>Messages speed positive hysteresis / Msg <math>n &gt; 0</math> hyst</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 8025
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0.00 [%]	<b>Max</b> 10.00 [%]	<b>Factory setting</b> 0.10 [%]
<b>Description:</b>	Sets the hysteresis for the "Speed positive" message. This parameter acts on the "Speed setpoint positive" message as well as on the "Speed actual value positive" message.		
<b>Dependency:</b>	Refer to: p50594, p50598, r53025		
<b>Note:</b>	The "Speed positive" message is available as follows: Setpoint: - r53025.8 (not inverted) - r53025.9 (inverted) Actual value: - r53025.12 (not inverted) - r53025.13 (inverted)		
<b>p50373[0...n]</b>	<b>Messages for reference speed threshold / Ref_speed thresh</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 8020
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0.00 [%]	<b>Max</b> 200.00 [%]	<b>Factory setting</b> 100.00 [%]
<b>Description:</b>	Sets the threshold for the "Reference speed reached" message.		
<b>Dependency:</b>	Refer to: p50374, p50375, p50592, r53025		
<b>Note:</b>	The "Reference speed reached" message is available as follows: - r53025.4 (not inverted) - r53025.5 (inverted)		



<b>p50374[0...n] Messages for reference speed hysteresis / Ref_speed hyst</b>			
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.00 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> 200.00 [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 8020 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 3.00 [%]
<b>Description:</b>	Sets the hysteresis for the "Reference speed reached" message. The message is triggered when the threshold is overshoot. Once the value falls below the threshold minus the hysteresis, the message is withdrawn.		
<b>Dependency:</b>	Refer to: p50373, p50375, p50592, r53025		
<b>p50375[0...n] Messages for reference speed OFF delay / Ref_speed t_OFF</b>			
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.0 [s]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 100.0 [s]	<b>Access level:</b> 2 <b>Func. diagram:</b> 8020 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 3.0 [s]
<b>Description:</b>	Sets the OFF delay for the "Reference speed reached" message.		
<b>Dependency:</b>	Refer to: p50373, p50374, p50592, r53025		
<b>p50376[0...n] Messages for setpoint/actual value deviation 2 threshold / Set/act 2 thresh</b>			
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.00 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> 200.00 [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 8020 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 3.00 [%]
<b>Description:</b>	Sets the threshold for the "Setpoint/actual value deviation 2 reached" message.		
<b>Dependency:</b>	Refer to: p50377, p50378, p50596, p50597, r53025		
<b>Note:</b>	The "Setpoint/actual value deviation 2 reached" message is available as follows: - r53025.2 (not inverted) - r53025.3 (inverted)		
<b>p50377[0...n] Messages for setpoint/actual value deviation 2 hysteresis / Set/act 2 hyst</b>			
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.00 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> 200.00 [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 8020 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1.00 [%]
<b>Description:</b>	Sets the hysteresis for the "Setpoint/actual value deviation 2 reached" message. The message is triggered when the threshold is overshoot. Once the value falls below the threshold minus the hysteresis, the message is withdrawn.		
<b>Dependency:</b>	Refer to: p50376, p50378, p50596, p50597, r53025		

**p50378[0...n] Messages for setpoint/actual value deviation 2 OFF delay / Set/act 2 t\_OFF**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 8020
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0.0 [s]	<b>Max</b> 100.0 [s]	<b>Factory setting</b> 3.0 [s]
<b>Description:</b>	Sets the OFF delay for the "Setpoint/actual value deviation 2 reached" message.		
<b>Dependency:</b>	Refer to: p50376, p50377, p50596, p50597, r53025		

**p50380[0...n] Messages for overspeed threshold positive direction of rotation / Msg n\_over pos**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 8025
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0.0 [%]	<b>Max</b> 200.0 [%]	<b>Factory setting</b> 120.0 [%]
<b>Description:</b>	Sets the threshold for the maximum speed in positive direction of rotation.		
<b>Dependency:</b>	Refer to: p50381, p50595, r53025		
<b>Note:</b>	The "Overspeed" message is available as follows: - F60038 - r53025.10 (not inverted) - r53025.11 (inverted)		

**p50381[0...n] Messages for overspeed threshold negative direction of rotation / Msg n\_over neg**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 8025
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> -200.0 [%]	<b>Max</b> 0.0 [%]	<b>Factory setting</b> -120.0 [%]
<b>Description:</b>	Sets the threshold for the maximum speed in negative direction of rotation.		
<b>Dependency:</b>	Refer to: p50380, p50595, r53025		
<b>Note:</b>	The "Overspeed" message is available as follows: - F60038 - r53025.10 (not inverted) - r53025.11 (inverted)		

**p50388[0...n] Messages for setpoint/actual value deviation 1 threshold / Set/act 1 thresh**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 8020
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0.00 [%]	<b>Max</b> 200.00 [%]	<b>Factory setting</b> 3.00 [%]
<b>Description:</b>	Sets the threshold for the "Setpoint/actual value deviation 1 reached" message.		
<b>Dependency:</b>	Refer to: p50389, p50390, p50590, p50591, r53025		
<b>Note:</b>	The "Setpoint/actual value deviation 1 reached" message is available as follows: - F60031 - r53025.0 (not inverted) - r53025.1 (inverted)		

<b>p50389[0...n] Messages for setpoint/actual value deviation 1 hysteresis / Set/act 1 hyst</b>			
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 8020
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0.00 [%]	<b>Max</b> 200.00 [%]	<b>Factory setting</b> 1.00 [%]
<b>Description:</b>	Sets the hysteresis for the "Setpoint/actual value deviation 1 reached" message. The message is triggered when the threshold is overshot. Once the value falls below the threshold minus the hysteresis, the message is withdrawn.		
<b>Dependency:</b>	Refer to: p50388, p50390, p50590, p50591, r53025		
<hr/>			
<b>p50390[0...n] Messages for setpoint/actual value deviation 1 OFF delay / Set/act t_OFF</b>			
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 8020
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0.0 [s]	<b>Max</b> 100.0 [s]	<b>Factory setting</b> 3.0 [s]
<b>Description:</b>	Sets the OFF delay for the "Setpoint/actual value deviation 1 reached" message.		
<b>Dependency:</b>	Refer to: p50388, p50389, p50590, p50591, r53025		
<hr/>			
<b>p50394[0...n] Messages for field current threshold minimum threshold / Msg If min thresh</b>			
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 8025
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0.00 [%]	<b>Max</b> 200.00 [%]	<b>Factory setting</b> 3.00 [%]
<b>Description:</b>	Sets the threshold for the "Field current threshold minimum" message.		
<b>Dependency:</b>	Refer to: p50395, r53026		
<b>Note:</b>	This threshold also affects the phase logic execution in the context of the Direction reversal by field reversal and Braking by field reversal functions. The "Field current threshold minimum" message is displayed via r53026.0.		
<hr/>			
<b>p50395[0...n] Messages for field current threshold minimum hysteresis / Msg If min hyst</b>			
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 8025
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0.00 [%]	<b>Max</b> 100.00 [%]	<b>Factory setting</b> 1.00 [%]
<b>Description:</b>	Sets the hysteresis for the "Field current threshold minimum" message. The message is triggered when the threshold is undershot. Once the value rises above the threshold plus the hysteresis, the message is withdrawn.		
<b>Dependency:</b>	Refer to: r53026		
<b>Note:</b>	The "Field current threshold minimum" message is displayed via r53026.0.		

**p50396[0...n] Field current monitoring setpoint factor / If\_mon set\_fact**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 8044
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 1 [%]	<b>Max</b> 100 [%]	<b>Factory setting</b> 50 [%]
<b>Description:</b>	Sets the factor for the setpoint in the context of field current monitoring.		
<b>Dependency:</b>	Refer to: p50265, p50397		

**p50397[0...n] Field current monitoring fault delay time / If\_mon F t\_del**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 8044
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0.02 [s]	<b>Max</b> 60.00 [s]	<b>Factory setting</b> 0.50 [s]
<b>Description:</b>	Sets the delay time for triggering fault F60005 in the context of field current monitoring.		
<b>Dependency:</b>	Refer to: p50265, p50396		

**p50398[0...n] Messages for field current actual value less than setpoint fact / Msg If<set fact**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 8025
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0.00 [%]	<b>Max</b> 200.00 [%]	<b>Factory setting</b> 80.00 [%]
<b>Description:</b>	Sets the factor for the setpoint for the "Field current actual value less than setpoint" message.		
<b>Dependency:</b>	Refer to: p50399, r53026		
<b>Note:</b>	This threshold also affects the phase logic execution in the context of the Direction reversal by field reversal and Braking by field reversal functions. The "Field current actual value less than setpoint" message is displayed via r53026.1.		

**p50399[0...n] Messages for field current actual value less than setpoint hyst / Msg If<set hyst**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 8025
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0.00 [%]	<b>Max</b> 100.00 [%]	<b>Factory setting</b> 1.00 [%]
<b>Description:</b>	Sets the hysteresis for the "Field current actual value less than setpoint" message. The message is triggered when the threshold is undershot (setpoint x factor). Once the value rises above the threshold (setpoint x factor) plus the hysteresis, the message is withdrawn.		
<b>Dependency:</b>	Refer to: p50398, r53026		
<b>Note:</b>	The "Field current actual value less than setpoint" message is displayed via r53026.1.		

---

**p50401[0...n]      Fixed value 1 / Fix val 1**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 3100
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> -200.00 [%]	<b>Max</b> 200.00 [%]	<b>Factory setting</b> 0.00 [%]
<b>Description:</b>	Sets fixed value 1.		
<b>Dependency:</b>	Refer to: r52401		
<b>Note:</b>	This value can be interconnected via connector output r52401.		

---

**p50402[0...n]      Fixed value 2 / Fix val 2**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 3100
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> -200.00 [%]	<b>Max</b> 200.00 [%]	<b>Factory setting</b> 0.00 [%]
<b>Description:</b>	Sets fixed value 2.		
<b>Dependency:</b>	Refer to: r52402		
<b>Note:</b>	This value can be interconnected via connector output r52402.		

---

**p50403[0...n]      Fixed value 3 / Fix val 3**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 3100
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> -200.00 [%]	<b>Max</b> 200.00 [%]	<b>Factory setting</b> 0.00 [%]
<b>Description:</b>	Sets fixed value 3.		
<b>Dependency:</b>	Refer to: r52403		
<b>Note:</b>	This value can be interconnected via connector output r52403.		

---

**p50404[0...n]      Fixed value 4 / Fix val 4**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 3100
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> -200.00 [%]	<b>Max</b> 200.00 [%]	<b>Factory setting</b> 0.00 [%]
<b>Description:</b>	Sets fixed value 4.		
<b>Dependency:</b>	Refer to: r52404		
<b>Note:</b>	This value can be interconnected via connector output r52404.		

**p50405[0...n]      Fixed value 5 / Fix val 5**

DC\_CTRL

**Can be changed:** U, T**Data type:** FloatingPoint32**P-Group:** -**Not for motor type:** -**Min**

-200.00 [%]

**Calculated:** -**Dyn. index:** DDS, p0180**Units group:** -**Scaling:** PERCENT**Max**

200.00 [%]

**Access level:** 2**Func. diagram:** 3100**Unit selection:** -**Expert list:** 1**Factory setting**

0.00 [%]

**Description:** Sets fixed value 5.**Dependency:** Refer to: r52405**Note:** This value can be interconnected via connector output r52405.**p50406[0...n]      Fixed value 6 / Fix val 6**

DC\_CTRL

**Can be changed:** U, T**Data type:** FloatingPoint32**P-Group:** -**Not for motor type:** -**Min**

-200.00 [%]

**Calculated:** -**Dyn. index:** DDS, p0180**Units group:** -**Scaling:** PERCENT**Max**

200.00 [%]

**Access level:** 2**Func. diagram:** 3100**Unit selection:** -**Expert list:** 1**Factory setting**

0.00 [%]

**Description:** Sets fixed value 6.**Dependency:** Refer to: r52406**Note:** This value can be interconnected via connector output r52406.**p50407[0...n]      Fixed value 7 / Fix val 7**

DC\_CTRL

**Can be changed:** U, T**Data type:** FloatingPoint32**P-Group:** -**Not for motor type:** -**Min**

-200.00 [%]

**Calculated:** -**Dyn. index:** DDS, p0180**Units group:** -**Scaling:** PERCENT**Max**

200.00 [%]

**Access level:** 2**Func. diagram:** 3100**Unit selection:** -**Expert list:** 1**Factory setting**

0.00 [%]

**Description:** Sets fixed value 7.**Dependency:** Refer to: r52407**Note:** This value can be interconnected via connector output r52407.**p50408[0...n]      Fixed value 8 / Fix val 8**

DC\_CTRL

**Can be changed:** U, T**Data type:** FloatingPoint32**P-Group:** -**Not for motor type:** -**Min**

-200.00 [%]

**Calculated:** -**Dyn. index:** DDS, p0180**Units group:** -**Scaling:** PERCENT**Max**

200.00 [%]

**Access level:** 2**Func. diagram:** 3100**Unit selection:** -**Expert list:** 1**Factory setting**

0.00 [%]

**Description:** Sets fixed value 8.**Dependency:** Refer to: r52408**Note:** This value can be interconnected via connector output r52408.

---

**p50409[0...n]      Fixed value 9 / Fix val 9**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 3100
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> -200.00 [%]	<b>Max</b> 200.00 [%]	<b>Factory setting</b> 0.00 [%]
<b>Description:</b>	Sets fixed value 9.		
<b>Dependency:</b>	Refer to: r52409		
<b>Note:</b>	This value can be interconnected via connector output r52409.		

---

**p50410[0...n]      Fixed value 10 / Fix val 10**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 3100
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> -200.00 [%]	<b>Max</b> 200.00 [%]	<b>Factory setting</b> 0.00 [%]
<b>Description:</b>	Sets fixed value 10.		
<b>Dependency:</b>	Refer to: r52410		
<b>Note:</b>	This value can be interconnected via connector output r52410.		

---

**p50411[0...n]      Fixed value 11 / Fix val 11**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 3100
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> -200.00 [%]	<b>Max</b> 200.00 [%]	<b>Factory setting</b> 0.00 [%]
<b>Description:</b>	Sets fixed value 11.		
<b>Dependency:</b>	Refer to: r52411		
<b>Note:</b>	This value can be interconnected via connector output r52411.		

---

**p50412[0...n]      Fixed value 12 / Fix val 12**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 3100
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> -340.28235E36 [%]	<b>Max</b> 340.28235E36 [%]	<b>Factory setting</b> 0.00 [%]
<b>Description:</b>	Sets fixed value 12.		
<b>Dependency:</b>	Refer to: r52412		
<b>Note:</b>	This value can be interconnected via connector output r52412.		

**p50413[0...n]      Fixed value 13 / Fix val 13**

DC\_CTRL

**Can be changed:** U, T**Data type:** FloatingPoint32**P-Group:** -**Not for motor type:** -**Min**

-340.28235E36 [%]

**Calculated:** -**Dyn. index:** DDS, p0180**Units group:** -**Scaling:** PERCENT**Max**

340.28235E36 [%]

**Access level:** 2**Func. diagram:** 3100**Unit selection:** -**Expert list:** 1**Factory setting**

0.00 [%]

**Description:** Sets fixed value 13.**Dependency:** Refer to: r52413**Note:** This value can be interconnected via connector output r52413.**p50414[0...n]      Fixed value 14 / Fix val 14**

DC\_CTRL

**Can be changed:** U, T**Data type:** FloatingPoint32**P-Group:** -**Not for motor type:** -**Min**

-340.28235E36 [%]

**Calculated:** -**Dyn. index:** DDS, p0180**Units group:** -**Scaling:** PERCENT**Max**

340.28235E36 [%]

**Access level:** 2**Func. diagram:** 3100**Unit selection:** -**Expert list:** 1**Factory setting**

0.00 [%]

**Description:** Sets fixed value 14.**Dependency:** Refer to: r52414**Note:** This value can be interconnected via connector output r52414.**p50415[0...n]      Fixed value 15 / Fix val 15**

DC\_CTRL

**Can be changed:** U, T**Data type:** FloatingPoint32**P-Group:** -**Not for motor type:** -**Min**

-340.28235E36 [%]

**Calculated:** -**Dyn. index:** DDS, p0180**Units group:** -**Scaling:** PERCENT**Max**

340.28235E36 [%]

**Access level:** 2**Func. diagram:** 3100**Unit selection:** -**Expert list:** 1**Factory setting**

0.00 [%]

**Description:** Sets fixed value 15.**Dependency:** Refer to: r52415**Note:** This value can be interconnected via connector output r52415.**p50416[0...n]      Fixed value 16 / Fix val 16**

DC\_CTRL

**Can be changed:** U, T**Data type:** FloatingPoint32**P-Group:** -**Not for motor type:** -**Min**

-340.28235E36 [%]

**Calculated:** -**Dyn. index:** DDS, p0180**Units group:** -**Scaling:** PERCENT**Max**

340.28235E36 [%]

**Access level:** 2**Func. diagram:** 3100**Unit selection:** -**Expert list:** 1**Factory setting**

0.00 [%]

**Description:** Sets fixed value 16.**Dependency:** Refer to: r52416**Note:** This value can be interconnected via connector output r52416.



**p50421[0...n] Fixed bit 0 / Fixed bit 0**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 3100
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	1	0
<b>Description:</b>	Sets the signal level for fixed bit 0.		
<b>Value:</b>	0: Low 1: High		
<b>Dependency:</b>	Refer to: r53230		
<b>Note:</b>	This signal can be interconnected via binector output r53230.0.		

**p50422[0...n] Fixed bit 1 / Fixed bit 1**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 3100
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	1	0
<b>Description:</b>	Sets the signal level for fixed bit 1.		
<b>Value:</b>	0: Low 1: High		
<b>Dependency:</b>	Refer to: r53230		
<b>Note:</b>	This signal can be interconnected via binector output r53230.1.		

**p50423[0...n] Fixed bit 2 / Fixed bit 2**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 3100
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	1	0
<b>Description:</b>	Sets the signal level for fixed bit 2.		
<b>Value:</b>	0: Low 1: High		
<b>Dependency:</b>	Refer to: r53230		
<b>Note:</b>	This signal can be interconnected via binector output r53230.2.		

**p50424[0...n] Fixed bit 3 / Fixed bit 3**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 3100
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	1	0
<b>Description:</b>	Sets the signal level for fixed bit 3.		
<b>Value:</b>	0: Low 1: High		
<b>Dependency:</b>	Refer to: r53230		
<b>Note:</b>	This signal can be interconnected via binector output r53230.3.		

**p50425[0...n]      Fixed bit 4 / Fixed bit 4**

DC\_CTRL

**Can be changed:** U, T**Data type:** Integer16**P-Group:** -**Not for motor type:** -**Min**

0

**Calculated:** -**Dyn. index:** DDS, p0180**Units group:** -**Scaling:** -**Max**

1

**Access level:** 2**Func. diagram:** 3100**Unit selection:** -**Expert list:** 1**Factory setting**

0

**Description:** Sets the signal level for fixed bit 4.**Value:**  
0:     Low  
1:     High**Dependency:** Refer to: r53230**Note:** This signal can be interconnected via binector output r53230.4.**p50426[0...n]      Fixed bit 5 / Fixed bit 5**

DC\_CTRL

**Can be changed:** U, T**Data type:** Integer16**P-Group:** -**Not for motor type:** -**Min**

0

**Calculated:** -**Dyn. index:** DDS, p0180**Units group:** -**Scaling:** -**Max**

1

**Access level:** 2**Func. diagram:** 3100**Unit selection:** -**Expert list:** 1**Factory setting**

0

**Description:** Sets the signal level for fixed bit 5.**Value:**  
0:     Low  
1:     High**Dependency:** Refer to: r53230**Note:** This signal can be interconnected via binector output r53230.5.**p50427[0...n]      Fixed bit 6 / Fixed bit 6**

DC\_CTRL

**Can be changed:** U, T**Data type:** Integer16**P-Group:** -**Not for motor type:** -**Min**

0

**Calculated:** -**Dyn. index:** DDS, p0180**Units group:** -**Scaling:** -**Max**

1

**Access level:** 2**Func. diagram:** 3100**Unit selection:** -**Expert list:** 1**Factory setting**

0

**Description:** Sets the signal level for fixed bit 6.**Value:**  
0:     Low  
1:     High**Dependency:** Refer to: r53230**Note:** This signal can be interconnected via binector output r53230.6.**p50428[0...n]      Fixed bit 7 / Fixed bit 7**

DC\_CTRL

**Can be changed:** U, T**Data type:** Integer16**P-Group:** -**Not for motor type:** -**Min**

0

**Calculated:** -**Dyn. index:** DDS, p0180**Units group:** -**Scaling:** -**Max**

1

**Access level:** 2**Func. diagram:** 3100**Unit selection:** -**Expert list:** 1**Factory setting**

0

**Description:** Sets the signal level for fixed bit 7.**Value:**  
0:     Low  
1:     High**Dependency:** Refer to: r53230**Note:** This signal can be interconnected via binector output r53230.7.

<b>p50430[0...7]</b>	<b>BI: Fixed setpoint signal source for connector selection / Fix set conn sig s</b>		
DC_CTRL	Can be changed: T	Calculated: -	Access level: 2
	Data type: Unsigned32 / Binary	Dyn. index: -	Func. diagram: 3115
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min	Max	Factory setting
	-	-	0
<b>Description:</b>	Sets the signal source for the selection of the connectors (p50431[0 to 7]).		
<b>Dependency:</b>	Refer to: p50431, p50432, p50680, p50681, r52204, r52209, r52210, r53170		
<b>p50431[0...7]</b>	<b>CI: Signal source for fixed setpoint / Fix set sig s</b>		
DC_CTRL	Can be changed: T	Calculated: -	Access level: 2
	Data type: Unsigned32 / FloatingPoint32	Dyn. index: -	Func. diagram: 3115
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: PERCENT	Expert list: 1
	Min	Max	Factory setting
	-	-	0
<b>Description:</b>	Sets the signal sources for generating the fixed setpoint (CO: r52204).		
<b>Dependency:</b>	Refer to: p50430, p50432, p50680, p50681, r52204, r52209, r52210, r53170		
<b>p50432[0...7]</b>	<b>Fixed setpoint bypass ramp-function generator / Fix set bypass RFG</b>		
DC_CTRL	Can be changed: T	Calculated: -	Access level: 2
	Data type: Integer16	Dyn. index: -	Func. diagram: 3115
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min	Max	Factory setting
	0	1	0
<b>Description:</b>	Setting to enable or disable the impact of the individual fixed setpoints when generating signal r53170.10, "Bypass ramp-function generator".		
<b>Value:</b>	0: Inhibit 1: Enable		
<b>Dependency:</b>	Refer to: r53170		
<b>Note:</b>	[0] = Enable bypassing of ramp-function generator at fixed setpoint 0 ... [7] = Enable bypassing of ramp-function generator at fixed setpoint 7		
<b>p50433[0...n]</b>	<b>CI: Signal source for default setpoint / Def set sig s</b>		
DC_CTRL	Can be changed: T	Calculated: -	Access level: 2
	Data type: Unsigned32 / FloatingPoint32	Dyn. index: CDS, p0170	Func. diagram: 3113
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: PERCENT	Expert list: 1
	Min	Max	Factory setting
	-	-	52011[0]
<b>Description:</b>	Sets the signal source for the default setpoint.		

<b>p50435[0...7]</b>	<b>BI: Jog setpoint signal source for connector selection / Jog set conn sig s</b>		
DC_CTRL	Can be changed: T	Calculated: -	Access level: 2
	Data type: Unsigned32 / Binary	Dyn. index: -	Func. diagram: 3125
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min	Max	Factory setting
	-	-	0
<b>Description:</b>	Sets the signal source for the selection of the connectors (p50436[0 to 7]).		
<b>p50436[0...7]</b>	<b>CI: Signal source for jog setpoint / Jog set sig s</b>		
DC_CTRL	Can be changed: T	Calculated: -	Access level: 2
	Data type: Unsigned32 / FloatingPoint32	Dyn. index: -	Func. diagram: 3125
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: PERCENT	Expert list: 1
	Min	Max	Factory setting
	-	-	0
<b>Description:</b>	Sets the signal sources for generating the jog setpoint (CO: r52202).		
<b>p50437[0...7]</b>	<b>Jog setpoint bypass ramp-function generator / Jog set bypass RFG</b>		
DC_CTRL	Can be changed: T	Calculated: -	Access level: 2
	Data type: Integer16	Dyn. index: -	Func. diagram: 3125
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min	Max	Factory setting
	0	1	0
<b>Description:</b>	Setting to enable or disable the impact of the individual jog setpoints when generating signal r53170.11, "Bypass ramp-function generator".		
<b>Value:</b>	0: Do not bypass 1: Bypass		
<b>Note:</b>	[0] = Enable bypassing of ramp-function generator at jog setpoint 0 ... [7] = Enable bypassing of ramp-function generator at jog setpoint 7		
<b>p50438[0...n]</b>	<b>CI: Jog signal source for default setpoint / Jog def set sig s</b>		
DC_CTRL	Can be changed: T	Calculated: -	Access level: 2
	Data type: Unsigned32 / FloatingPoint32	Dyn. index: CDS, p0170	Func. diagram: 3125
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: PERCENT	Expert list: 1
	Min	Max	Factory setting
	-	-	52208[0]
<b>Description:</b>	Sets the signal source for the default setpoint when jog is not selected.		
<b>p50440[0...7]</b>	<b>BI: Creep setpoint signal source for connector selection / Cr set sig s</b>		
DC_CTRL	Can be changed: T	Calculated: -	Access level: 2
	Data type: Unsigned32 / Binary	Dyn. index: -	Func. diagram: 3130
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min	Max	Factory setting
	-	-	0
<b>Description:</b>	Sets the signal source for the selection of the connectors (p50441[0 to 7]) for the creep setpoint.		
<b>Dependency:</b>	Refer to: p50441		

<b>p50441[0...7]</b>			
<b>CI: Signal source for creep setpoint / Cr set sig s</b>			
DC_CTRL	Can be changed: T	Calculated: -	Access level: 2
	Data type: Unsigned32 / FloatingPoint32	Dyn. index: -	Func. diagram: 3130
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: PERCENT	Expert list: 1
	Min	Max	Factory setting
	-	-	0
<b>Description:</b> Sets the signal sources for generating the creep setpoint (CO: r52201).			
<b>Dependency:</b> Refer to: r52201			
<b>p50442[0...7]</b>			
<b>Creep setpoint bypass ramp-function generator / Cr set bypass RFG</b>			
DC_CTRL	Can be changed: T	Calculated: -	Access level: 2
	Data type: Integer16	Dyn. index: -	Func. diagram: 3130
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min	Max	Factory setting
	0	1	0
<b>Description:</b> Setting to enable/disable the impact of the individual creep setpoints when generating signal r53170.12, "Bypass ramp-function generator".			
<b>Value:</b> 0: Do not bypass 1: Bypass			
<b>Note:</b> [0]: Enable bypassing of ramp-function generator at creep setpoint 0 ... [7]: Enable bypassing of ramp-function generator at creep setpoint 7			
<b>p50443[0...n]</b>			
<b>CI: Creep signal source for default setpoint / Cr def set sig s</b>			
DC_CTRL	Can be changed: T	Calculated: -	Access level: 2
	Data type: Unsigned32 / FloatingPoint32	Dyn. index: CDS, p0170	Func. diagram: 3130
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: PERCENT	Expert list: 1
	Min	Max	Factory setting
	-	-	52207[0]
<b>Description:</b> Sets the signal source for the default setpoint when creep is not selected.			
<b>p50444[0...n]</b>			
<b>BI: Creep signal source for shutdown / Cr shutdn sig s</b>			
DC_CTRL	Can be changed: T	Calculated: -	Access level: 2
	Data type: Unsigned32 / Binary	Dyn. index: CDS, p0170	Func. diagram: 3130
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min	Max	Factory setting
	-	-	0
<b>Description:</b> Sets the signal source for shutting down/resetting the injection of the creep setpoint.			
<b>p50445</b>			
<b>Creep setpoint level/edge / Cr set lev/ed</b>			
DC_CTRL	Can be changed: T	Calculated: -	Access level: 2
	Data type: Integer16	Dyn. index: -	Func. diagram: 3130
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min	Max	Factory setting
	0	1	0
<b>Description:</b> Sets whether the ON command is triggered by a logic 1 level or a 0/1 edge.			

**Value:** 0: 1 level  
1: 0/1 edge

---

**p50460[0...n] Motorized potentiometer activate ramp-function generator / Mot pot act RFG**


---

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 3110
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	1	1

**Description:** Setting to activate/de-activate the ramp-function generator on the motorized potentiometer.

**Value:** 0: RFG de-activated in automatic mode  
1: RFG activated in automatic and manual modes

---

**p50461[0...n] CI: Motorized potentiometer signal source for automatic setpoint / MotP aut s sig s**


---

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / FloatingPoint32	<b>Dyn. index:</b> CDS, p0170	<b>Func. diagram:</b> 3110
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Sets the signal source for the ramp-function generator's setpoint in automatic mode on the motorized potentiometer.

---

**p50462[0...n] Motorized potentiometer ramp-up time / MotP t\_r-up**


---

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 3110
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0.01 [s]	300.00 [s]	10.00 [s]

**Description:** Sets the ramp-up time on the motorized potentiometer.

---

**p50463[0...n] Motorized potentiometer ramp-down time / MotP t\_r-dn**


---

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 3110
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0.01 [s]	300.00 [s]	10.00 [s]

**Description:** Sets the ramp-down time on the motorized potentiometer.

---

**p50464[0...n] Motorized potentiometer time difference for dy/dt / MotP t\_dif dy/dt**


---

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 3110
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0.01 [s]	300.00 [s]	10.00 [s]

**Description:** Sets the time difference for the ramp-function generator dy/dt on the motorized potentiometer.

<b>p50465[0...n]</b>	<b>Motorized potentiometer expansion factor / MotP exp fact</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1	<b>Access level:</b> 2 <b>Func. diagram:</b> 3110 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the expansion factor on the motorized potentiometer.		
<b>Value:</b>	0: Factor 1 1: Factor 60		
<b>Dependency:</b>	Refer to: p50462, p50463, p50464		
<b>Note:</b>	The expansion factor affects the following parameters: - p50462 (ramp-up time) - p50463 (ramp-down time) - p50464 (time difference for dy/dt)		
<b>p50466[0...n]</b>	<b>CI: Motor potentiometer setting value signal source / MotP s val sig s</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> 3110 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the signal source for the setting value for the motorized potentiometer.		
<b>Dependency:</b>	Refer to: p50472		
<b>Note:</b>	The setting value (CI: p50466) becomes effective on a 0/1 edge of the setting command (BI: p50472).		
<b>p50467[0...n]</b>	<b>Motorized potentiometer starting value / MotP start value</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -200.00 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> 200.00 [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 3110 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.00 [%]
<b>Description:</b>	Sets the starting value on the motorized potentiometer.		
<b>Dependency:</b>	Refer to: p50473		
<b>Note:</b>	The value is only effective when saving of the output value is de-activated (p50473 = 0).		
<b>p50468[0...n]</b>	<b>Motorized potentiometer maximum speed / MotP n_max</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -200.00 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> 200.00 [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 3110 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 100.00 [%]
<b>Description:</b>	Sets the maximum speed on the motorized potentiometer.		
<b>Dependency:</b>	Refer to: p50471		
<b>Note:</b>	This parameter is only effective in manual mode (p50471 = 0). The setpoint output from the motorized potentiometer is limited to this value.		

**p50469[0...n] Motorized potentiometer minimum speed / MotP n\_min**

DC\_CTRL

**Can be changed:** U, T**Calculated:** -**Access level:** 2**Data type:** FloatingPoint32**Dyn. index:** DDS, p0180**Func. diagram:** 3110**P-Group:** -**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** PERCENT**Expert list:** 1**Min****Max****Factory setting**

-200.00 [%]

200.00 [%]

-100.00 [%]

**Description:** Sets the minimum speed on the motorized potentiometer.**Dependency:** Refer to: p50471**Note:** This parameter is only effective in manual mode (p50471 = 0).  
The setpoint output from the motorized potentiometer is limited to this value.**p50470[0...n] BI: Motorized potentiometer signal source for CW/CCW / MotP CW/CCW sig s**

DC\_CTRL

**Can be changed:** T**Calculated:** -**Access level:** 2**Data type:** Unsigned32 / Binary**Dyn. index:** CDS, p0170**Func. diagram:** 3110**P-Group:** -**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** -**Expert list:** 1**Min****Max****Factory setting**

-

-

0

**Description:** Sets the signal source for changing over between clockwise/counter-clockwise rotation on the motorized potentiometer.**p50471[0...n] BI: Motorized potentiometer signal source for manual/automatic / MotP man/aut sig s**

DC\_CTRL

**Can be changed:** T**Calculated:** -**Access level:** 2**Data type:** Unsigned32 / Binary**Dyn. index:** CDS, p0170**Func. diagram:** 3110**P-Group:** -**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** -**Expert list:** 1**Min****Max****Factory setting**

-

-

0

**Description:** Sets the signal source for changing between manual and automatic modes.**Dependency:** Refer to: p50461, p50673, p50674**Note:** If p50471 = 0 signal (manual mode):

In manual mode, the setpoint is increased and reduced using binector inputs p50673 and p50674 respectively.

If p50471 = 1 signal (automatic mode):

In automatic mode, the setpoint is specified using connector input p50461.

**p50472[0...n] BI: Motorized potentiometer accept setting value / MotP acc set val**

DC\_CTRL

**Can be changed:** T**Calculated:** -**Access level:** 2**Data type:** Unsigned32 / Binary**Dyn. index:** CDS, p0170**Func. diagram:** 3110**P-Group:** -**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** -**Expert list:** 1**Min****Max****Factory setting**

-

-

0

**Description:** Sets the signal source to accept the setting value for the motorized potentiometer.**Dependency:** Refer to: p50466**Note:** The setting value (CI: p50466) becomes effective on a 0/1 edge of the setting command (BI: p50472).



<b>p50473[0...n] Motorized potentiometer save output value / MotP save outp val</b>			
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1	<b>Access level:</b> 2 <b>Func. diagram:</b> 3110 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets how the output value is saved on the motorized potentiometer.		
<b>Value:</b>	0: Save de-activated 1: Save activated		
<b>Dependency:</b>	Refer to: p50467, r52240		
<b>Note:</b>	If p50473 = 0: The output value (CI: r52240) is not saved. The starting value specified in p50467 is applied after ON. If p50473 = 1: The output value (CI: r52240) is saved to non-volatile memory after OFF. The saved value is applied after ON.		
<hr/>			
<b>p50480[0...n] Oscillation setpoint 1 / Oscillation set 1</b>			
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -200.0 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> 200.0 [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 3120 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.5 [%]
<b>Description:</b>	Sets setpoint 1 for the square-wave generator.		
<b>Dependency:</b>	Refer to: p50481, p50482, p50483		
<b>Note:</b>	This setpoint is applied for the time set in p50481.		
<hr/>			
<b>p50481[0...n] Oscillation setpoint 1 time / Oscill set 1 t</b>			
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.1 [s]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 300.0 [s]	<b>Access level:</b> 2 <b>Func. diagram:</b> 3120 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.1 [s]
<b>Description:</b>	Sets the time during which setpoint 1 should be applied for the square-wave generator.		
<b>Dependency:</b>	Refer to: p50480, p50482, p50483		
<hr/>			
<b>p50482[0...n] Oscillation setpoint 2 / Oscillation set 2</b>			
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -200.0 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> 200.0 [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 3120 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -0.4 [%]
<b>Description:</b>	Sets setpoint 2 for the square-wave generator.		
<b>Dependency:</b>	Refer to: p50480, p50481, p50483		
<b>Note:</b>	This setpoint is applied for the time set in p50483.		

<b>p50483[0...n]</b>	<b>Oscillation setpoint 2 time / Oscill set 2 t</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.1 [s]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 300.0 [s]	<b>Access level:</b> 2 <b>Func. diagram:</b> 3120 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.1 [s]
<b>Description:</b>	Sets the time during which setpoint 2 should be applied for the square-wave generator.		
<b>Dependency:</b>	Refer to: p50480, p50481, p50482		
<b>p50484[0...n]</b>	<b>CI: Oscillation signal source for default setpoint / Oscill def set</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> 3120 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 52209[0]
<b>Description:</b>	Sets the signal source for the default setpoint for oscillation. This setpoint is injected when the "Oscillate" function is not selected.		
<b>Dependency:</b>	Refer to: p50485		
<b>p50485[0...n]</b>	<b>BI: Oscillation selection of signal source / Oscill sel sig s</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> 3120 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the signal source for the selection of the "Oscillate" function.		
<b>Dependency:</b>	Refer to: p50480, p50481, p50482, p50483, p50484		
<b>Note:</b>	BI: p50485 = 0 signal Oscillation is not selected. The default setpoint is applied (CI: p50484). BI: p50485 = 1 signal Oscillation is selected. The square-wave generator is active (p50480, p50481, p50482, p50483).		
<b>p50486</b>	<b>BI: Motor interface signal source for brush length / Mot br l sig s</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> 8035 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the signal source for triggering fault F60025 "Brush length".		
<b>Dependency:</b>	Refer to: r53120		
<b>Note:</b>	The fault is triggered with a delay. The signal is available via binector output r53210.0 for further interconnection.		

<b>p50487</b>	<b>BI: Motor interface signal source for bearing condition / Mot brg cond sig s</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8035
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Sets the signal source for triggering fault F60026 "Bearing condition".

**Dependency:** Refer to: r53120

**Note:** The fault is triggered with a delay.

The signal is available via binector output r53120.1 for further interconnection.

<b>p50488</b>	<b>BI: Motor interface signal source for motor fan / Mot mot fan sig s</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8035
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Sets the signal source for triggering fault F60027 "Motor fan".

**Dependency:** Refer to: r53120

**Note:** The fault is triggered with a delay.

The signal is available via binector output r53210.0 for further interconnection.

<b>p50489</b>	<b>BI: Motor interface signal source for motor temperature / Mot mot temp sig s</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8035
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Sets the signal source for triggering fault F60028 "Motor temperature".

**Dependency:** Refer to: r53120

**Note:** The fault is triggered with a delay.

The signal is available via binector output r53210.3 for further interconnection.

<b>p50490</b>	<b>Motor interface temperature sensor / Mot temp sensor</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8030
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	8	0

**Description:** Sets the temperature sensor for monitoring the motor temperature.

**Value:**

- 0: No sensor
- 1: KTY84
- 2: PTC thermistor R<sub>rated</sub> 600
- 3: PTC thermistor R<sub>rated</sub> 1200
- 4: PTC thermistor R<sub>rated</sub> 1330
- 5: PTC thermistor R<sub>rated</sub> 2660
- 6: PT100
- 7: NTC thermistor K227
- 8: PT1000

**Dependency:** Refer to: r50012, r52051

**Note:** Comments regarding PTC thermistors:  
 - PTC thermistors according to DIN 44081 / 44082 with the specified R for the rated response temperature.  
 - For Siemens motors, PTC thermistors with 1330 Ohm are used.  
 - Parameters p50491 and p50492 (alarm and switch-off temperature) are ineffective. The alarm and switch-off temperatures are defined by the PTC thermistor type being used.  
 Comments on NTC thermistor K227:  
 The evaluation electronics on the CUD only allow resistance values of less than approx. 2 kOhm to be measured. As a consequence, only temperatures greater than approx. 90 °C can be measured when using these temperature sensors. For lower temperatures, the lowest possible value (approx. 90 °C) is displayed.

---

**p50491[0...n] Motor interface alarm threshold for temperature monitoring / Mot\_temp al thr**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 8030
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0 [°C]	200 [°C]	0 [°C]

**Description:** Sets the alarm threshold for monitoring the motor temperature.

**Dependency:** The parameter is only valid for the following temperature sensors with a continuous characteristic:  
 - KTY84 (p50490 = 1)  
 - PT100 (p50490 = 6)  
 - NTC thermistor K227 (p50490 = 7)  
 - PT1000 (p50490 = 8)  
 Refer to: p50490, p50492, r52051

---

**p50492[0...n] Motor interface fault threshold for temperature monitoring / Mot\_temp flt thr**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 8030
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0 [°C]	200 [°C]	0 [°C]

**Description:** Sets the fault threshold for monitoring the motor temperature.

**Dependency:** The parameter is only valid for the following temperature sensors with a continuous characteristic:  
 - KTY84 (p50490 = 1)  
 - PT100 (p50490 = 6)  
 - NTC thermistor K227 (p50490 = 7)  
 - PT1000 (p50490 = 8)  
 Refer to: p50490, p50491, r52051

---

**p50500[0...n] CI: Torque limiting signal source for t\_set in slave mode / T\_set s mode sig s**

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / FloatingPoint32	<b>Dyn. index:</b> CDS, p0170	<b>Func. diagram:</b> 6830
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	52170[0]

**Description:** Sets the signal source for the torque setpoint in slave mode.

**Dependency:** Refer to: p50503

**p50501[0...n] CI: Torque limiting signal source for torque additional setpoint / T\_lim add s sig s**

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / FloatingPoint32	<b>Dyn. index:</b> CDS, p0170	<b>Func. diagram:</b> 6830
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Sets the signal source for the torque additional setpoint in torque limiting.  
The value is injected in addition to friction and moment of inertia compensation.

**p50502 CI: Speed controller additional setpoint signal source / Add set sig s**

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6815
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Sets the signal source for the additional setpoint of the speed controller.  
This value is added to the speed controller's output value.

**p50503[0...n] Torque limiting t\_set factor in slave mode / T\_set fact sl mode**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6830
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-300.00 [%]	300.00 [%]	100.00 [%]

**Description:** Sets the factor for the torque setpoint in slave mode.

**Dependency:** Refer to: p50500

**p50509 CI: Speed limiting controller signal source for speed actual value / n\_lim n\_act sig s**

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6835
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	52167[0]

**Description:** Sets the signal source for the speed actual value (n\_act) on the speed limiting controller.

**p50510 CI: Speed limiting controller signal source for pos torque limit / T lim pos sig s**

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6835
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	52002[0]

**Description:** Sets the signal source for the positive torque limit on the speed limiting controller.

**Dependency:** Refer to: r52136

**Note:** This parameter specifies which parameter is to be injected as the limit value for torque limiting 1 (r52136).

<b>p50511</b>	<b>CI: Speed limiting controller signal source for neg torque limit / T lim neg sig s</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6835
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	52004[0]

**Description:** Sets the signal source for the negative torque limit on the speed limiting controller.

**Dependency:** Refer to: r52137

**Note:** This parameter specifies which parameter is to be injected as the limit value for torque limiting 2 (r52137).

<b>p50512[0...n]</b>	<b>Speed limiting controller max speed pos direction of rotation / n_max pos dir rot</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6835
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0.0 [%]	200.0 [%]	105.0 [%]

**Description:** Sets the maximum speed for the positive direction of rotation on the speed limiting controller.

<b>p50513[0...n]</b>	<b>Speed limiting controller max speed neg direction of rotation / n_max neg dir</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6835
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-200.0 [%]	0.0 [%]	-105.0 [%]

**Description:** Sets the maximum speed for the negative direction of rotation on the speed limiting controller.

<b>p50515[0...n]</b>	<b>Speed limiting controller P gain / n_lim Kp</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6835
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0.10	200.00	3.00

**Description:** Sets the P gain on the speed limiting controller.

<b>p50519[0...1]</b>	<b>CI: Input signal for friction compensation / Fric comp inp sig</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6820
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	[0] 52179[0]
			[1] 0

**Description:** Sets the signal sources for friction compensation.

**Index:** [0] = Signed  
[1] = Absolute

**Note:** The signals in p50519[0] and p50519[1] are summed and applied to the friction compensation input.

<b>p50520[0...n]</b>	<b>Friction compensation 0 % speed / Fric comp n 0%</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.0 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> 100.0 [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6820 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.0 [%]
<b>Description:</b>	Sets friction compensation at 0 % speed.		
<b>Recommend.:</b>	In the case of operation in both directions of rotation, this basic value should be set to 0% to prevent the armature current from oscillating.		
<b>Note:</b>	The basic values are based on the device rated direct current or the device rated torque. The basic values for friction compensation (p50520 ... p50530) are set automatically during the optimization run for friction compensation (p50051 = 28). There is linear interpolation between the basic values; here, the friction compensation value takes on the input signal's sign.		
<b>p50521[0...n]</b>	<b>Friction compensation 10 % speed / Fric comp n 10%</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.0 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> 100.0 [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6820 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.0 [%]
<b>Description:</b>	Sets friction compensation at 10 % speed.		
<b>p50522[0...n]</b>	<b>Friction compensation 20 % speed / Fric comp n 20%</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.0 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> 100.0 [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6820 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.0 [%]
<b>Description:</b>	Sets friction compensation at 20 % speed.		
<b>p50523[0...n]</b>	<b>Friction compensation 30 % speed / Fric comp n 30%</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.0 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> 100.0 [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6820 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.0 [%]
<b>Description:</b>	Sets friction compensation at 30 % speed.		
<b>p50524[0...n]</b>	<b>Friction compensation 40 % speed / Fric comp n 40%</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.0 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> 100.0 [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6820 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.0 [%]
<b>Description:</b>	Sets friction compensation at 40 % speed.		

**p50525[0...n] Friction compensation 50 % speed / Fric comp n 50%**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6820
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0.0 [%]	<b>Max</b> 100.0 [%]	<b>Factory setting</b> 0.0 [%]
<b>Description:</b>	Sets friction compensation at 50 % speed.		

**p50526[0...n] Friction compensation 60 % speed / Fric comp n 60%**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6820
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0.0 [%]	<b>Max</b> 100.0 [%]	<b>Factory setting</b> 0.0 [%]
<b>Description:</b>	Sets friction compensation at 60 % speed.		

**p50527[0...n] Friction compensation 70 % speed / Fric comp n 70%**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6820
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0.0 [%]	<b>Max</b> 100.0 [%]	<b>Factory setting</b> 0.0 [%]
<b>Description:</b>	Sets friction compensation at 70 % speed.		

**p50528[0...n] Friction compensation 80 % speed / Fric comp n 80%**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6820
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0.0 [%]	<b>Max</b> 100.0 [%]	<b>Factory setting</b> 0.0 [%]
<b>Description:</b>	Sets friction compensation at 80 % speed.		

**p50529[0...n] Friction compensation 90 % speed / Fric comp n 90%**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6820
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0.0 [%]	<b>Max</b> 100.0 [%]	<b>Factory setting</b> 0.0 [%]
<b>Description:</b>	Sets friction compensation at 90 % speed.		



<b>p50530[0...n]</b>	<b>Friction compensation 100% speed / Fric comp n 100%</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.0 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> 100.0 [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6820 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.0 [%]
<b>Description:</b>	Sets friction compensation at 100% speed.		
<b>Note:</b>	This basic value is also effective at speeds > 100%.		
<b>p50540[0...n]</b>	<b>Speed controller acceleration time / n_ctr t_accel</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.00 [s]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1000.00 [s]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6820 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.01 [s]
<b>Description:</b>	Sets the acceleration time on the speed controller.		
<b>Dependency:</b>	Refer to: r52150, r52174		
<b>Note:</b>	The acceleration time is the time which would be needed to accelerate the drive from 0 to 100% of the maximum speed at 100% device rated current (with no friction present). It is a measure of the moment of inertia at the motor shaft. The acceleration time is set automatically during the optimization run for the speed controller (p50051 = 26).		
<b>p50541[0...3]</b>	<b>Speed controller setpoint/actual value difference factor / Set/act dif fact</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.00	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 650.00	<b>Access level:</b> 2 <b>Func. diagram:</b> 6820 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.00
<b>Description:</b>	Sets the factor for the acceleration on the speed controller, which is dependent upon the difference between the setpoint and the actual value. In the case of the "Acceleration dependent upon setpoint/actual value difference" function, only the proportion of the speed controller's setpoint/actual value difference which has an absolute value in excess of the threshold (p50543) is switched through.		
<b>Dependency:</b>	Refer to: p50543		
<b>p50542[0...n]</b>	<b>RFG dy/dt time difference / RFG dy/dt t_dif</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.00 [s]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1000.00 [s]	<b>Access level:</b> 2 <b>Func. diagram:</b> 3152 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.01 [s]
<b>Description:</b>	Sets the dt for the output of dy/dt in r52191. The change in the ramp-function generator's output variable (p52190) in relation to the time set in p50542 is output in r52191.		
<b>Dependency:</b>	Refer to: p50330, r52191		

**Note:** Example:  
 A ramp-up time of 5 s is set on the ramp-function generator; in other words, a complete ramp-up from y = 0% to 100% will take 5 s.  
 A time difference dt of 2 s is set in p50542. This results in a dy/dt of 40% at r52191, since the set dt of 2s produces a dy of (2 s / 5 s) \* 100% = 40%.

<b>p50543[0...n] Speed controller setpoint/actual value difference threshold / Set/act dif thresh</b>			
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.00 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> 100.00 [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6820 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.00 [%]
<b>Description:</b>	Sets the threshold for acceleration dependent upon the setpoint/actual value difference. In the case of the "Acceleration dependent upon setpoint/actual value difference" function, only the proportion of the speed controller's setpoint/actual value difference which has an absolute value in excess of the threshold (p50543) is switched through.		
<b>Dependency:</b>	Refer to: p50541		

<b>p50546[0...n] Smoothing time constant for inertia compensation / Comp inert T</b>			
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0 [ms]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 10000 [ms]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6820 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0 [ms]
<b>Description:</b>	Sets the smoothing time constant for the acceleration value for moment of inertia compensation.		
<b>Dependency:</b>	Refer to: p50619		

<b>p50550[0...n] Speed controller adaptation Kp y coordinate 1 / Adapt Kp y1</b>			
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.10	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 2000.00	<b>Access level:</b> 2 <b>Func. diagram:</b> 6805 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 3.00
<b>Description:</b>	Sets the y coordinate for pair of values 1 for adaptation of the P gain (Kp).		
<b>Note:</b>	This P gain (Kp) is effective up to x coordinate 1 (p50556). The adaptation of the P gain (Kp) is defined using 2 pairs of values. Pair of values 1: p50556/p50550 (x/y coordinate) Pair of values 2: p50559/p50225 (x/y coordinate)		

<b>p50551[0...n] Speed controller adaptation Tn y coordinate 1 / Adapt Tn y1</b>			
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.010 [s]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 10.000 [s]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6805 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.650 [s]
<b>Description:</b>	Sets the y coordinate for pair of values 1 for adaptation of the integral time (Tn).		

**Note:** This integral time (Tn) is effective up to x coordinate 1 (p50557).  
 The adaptation of the integral time (Tn) is defined using 2 pairs of values.  
 Pair of values 1:  
 p50557/p50551 (x/y coordinate)  
 Pair of values 2:  
 p50560/p50226 (x/y coordinate)

<b>p50552[0...3] Speed controller adaptation droop y coordinate 1 / Adapt droop y1</b>			
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.000	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 10.000	<b>Access level:</b> 2 <b>Func. diagram:</b> 6805 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.000
<b>Description:</b>	Sets the y coordinate for pair of values 1 for adaptation of the droop.		
<b>Notice:</b>	<p>- For the droop, generally values up to 10 % are practical (p50552 = 0.000 ... 0.100). Under certain circumstances, higher values can result in an unstable response of the speed controller.</p> <p>- The droop is entered as absolute factor without any dimensions and it is especially important to note that it is not a percentage.</p> <p>Example:            Set droop = 5 % --&gt; p50552 = 0.05</p>		
<b>Note:</b>	<p>This droop is effective up to x coordinate 1 (p50558).            The adaptation of the droop is defined using 2 pairs of values.            Pair of values 1:            p50558/p50552 (x/y coordinate)            Pair of values 2:            p50561/p50227 (x/y coordinate)</p>		

<b>p50553[0...n] CI: Speed controller adaptation Kp signal source / Adapt Kp sig s</b>			
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> 6805 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the signal source for the P gain (Kp) on the speed controller.		

<b>p50554[0...n] CI: Speed controller adaptation Tn signal source / Adapt Tn sig s</b>			
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> 6805 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the signal source for the integral time (Tn) on the speed controller.		

<b>p50555[0...n]</b>	<b>CI: Speed controller adaptation droop signal source / Adapt droop sig s</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> 6805 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the signal source for the droop on the speed controller.		
<b>Note:</b>	A setting of 10% droop means that at 100% controller output (100% torque or current setpoint), the speed will deviate from the setpoint by 10% ("softening" of closed-loop control).		
<b>p50556[0...n]</b>	<b>Speed controller adaptation Kp x coordinate 1 / Adapt Kp x1</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.00 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> 100.00 [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6805 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.00 [%]
<b>Description:</b>	Sets the x coordinate for pair of values 1 for adaptation of the P gain (Kp).		
<b>Notice:</b>	The following condition applies for x coordinate 1/2: p50556 < p50559		
<b>Note:</b>	The adaptation of the P gain (Kp) is defined using 2 pairs of values. Pair of values 1: p50556/p50550 (x/y coordinate) Pair of values 2: p50559/p50225 (x/y coordinate)		
<b>p50557[0...n]</b>	<b>Speed controller adaptation Tn x coordinate 1 / Adapt Tn x1</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.00 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> 100.00 [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6805 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.00 [%]
<b>Description:</b>	Sets the x coordinate for pair of values 1 for adaptation of the integral time (Tn).		
<b>Notice:</b>	The following condition applies for x coordinate 1/2: p50557 < p50560		
<b>Note:</b>	The adaptation of the integral time (Tn) is defined using 2 pairs of values. Pair of values 1: p50557/p50551 (x/y coordinate) Pair of values 2: p50560/p50226 (x/y coordinate)		
<b>p50558[0...3]</b>	<b>Speed controller adaptation droop x coordinate 1 / Adapt droop x1</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.00 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> 100.00 [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6805 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.00 [%]
<b>Description:</b>	Sets the x coordinate for pair of values 1 for adaptation of the droop.		

**Notice:** The following condition applies for x coordinate 1/2:

p50558 < p50561

**Note:** The adaptation of the droop is defined using 2 pairs of values.

Pair of values 1:

p50558/p50552 (x/y coordinate)

Pair of values 2:

p50561/p50227 (x/y coordinate)

---

### **p50559[0...n] Speed controller adaptation Kp x coordinate 2 / Adapt Kp x2**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6805
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0.00 [%]	<b>Max</b> 100.00 [%]	<b>Factory setting</b> 0.00 [%]

**Description:** Sets the x coordinate for pair of values 2 for adaptation of the P gain (Kp).

**Notice:** The following condition applies for x coordinate 1/2:

p50556 < p50559

**Note:** The adaptation of the P gain (Kp) is defined using 2 pairs of values.

Pair of values 1:

p50556/p50550 (x/y coordinate)

Pair of values 2:

p50559/p50225 (x/y coordinate)

---

### **p50560[0...n] Speed controller adaptation Tn x coordinate 2 / Adapt Tn x2**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6805
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0.00 [%]	<b>Max</b> 100.00 [%]	<b>Factory setting</b> 0.00 [%]

**Description:** Sets the x coordinate for pair of values 2 for adaptation of the integral time (Tn).

**Notice:** The following condition applies for x coordinate 1/2:

p50557 < p50560

**Note:** The adaptation of the integral time (Tn) is defined using 2 pairs of values.

Pair of values 1:

p50557/p50551 (x/y coordinate)

Pair of values 2:

p50560/p50226 (x/y coordinate)

---

### **p50561[0...n] Speed controller adaptation droop x coordinate 2 / Adapt droop x2**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6805
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0.00 [%]	<b>Max</b> 100.00 [%]	<b>Factory setting</b> 0.00 [%]

**Description:** Sets the x coordinate for pair of values 2 for adaptation of the droop.

**Notice:** The following condition applies for x coordinate 1/2:

p50558 < p50561

**Note:** The adaptation of the droop is defined using 2 pairs of values.

Pair of values 1:

p50558/p50552 (x/y coordinate)

Pair of values 2:

p50561/p50227 (x/y coordinate)

---

**p50562[0...n] Speed controller droop positive limiting / Droop pos lim**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6805
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0.00 [%]	<b>Max</b> 200.00 [%]	<b>Factory setting</b> 100.00 [%]

**Description:** Sets positive limiting for the droop on the speed controller.

**Dependency:** Refer to: p50563

---

**p50563[0...n] Speed controller droop negative limiting / Droop neg lim**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6805
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> -200.00 [%]	<b>Max</b> 0.00 [%]	<b>Factory setting</b> -100.00 [%]

**Description:** Sets negative limiting for the droop on the speed controller.

**Dependency:** Refer to: p50562

---

**p50565 Speed controller optimization frequency response plot base speed / f\_plot n\_base**

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2660
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 1.0 [%]	<b>Max</b> 30.0 [%]	<b>Factory setting</b> 20.0 [%]

**Description:** Sets the base speed for the frequency response plot for the optimization run "Speed control optimization for drives that are capable of oscillation" (p50051 = 29).

**Dependency:** Refer to: p50566, p50567

---

**p50566 Speed controller optimization frequency response plot amplitude / f\_plot amplitude**

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2660
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 0.01 [%]	<b>Max</b> 5.00 [%]	<b>Factory setting</b> 1.00 [%]

**Description:** Sets the amplitude for the frequency response plot for the optimization run "Speed control optimization for drives that are capable of oscillation" (p50051 = 29).

<b>p50567</b>	<b>Speed controller optimization frequency response plot time / f_plot time</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2660
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0.30 [s]	<b>Max</b> 3.00 [s]	<b>Factory setting</b> 1.00 [s]
<b>Description:</b>	Sets the time for the frequency response plot for the optimization run "Speed control optimization for drives that are capable of oscillation" (p50051 = 29). In this case, an average is generated over the time set here per measuring frequency.		
<b>Note:</b>	High values improve the result, however they slow down the measuring time. For the 3.0 s setting, it takes approximately 9 minutes to plot the frequency response.		
<b>p50570[0...n]</b>	<b>Adaptation armature current controller changeover input / Adapt Ia chgov inp</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6853
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 1	<b>Factory setting</b> 0
<b>Description:</b>	Sets the input quantity for armature current controller adaptation.		
<b>Value:</b>	0: Ia_act r52117 1: Ia_set r52119		
<b>Dependency:</b>	Refer to: p50571, p50572		
<b>p50571[0...n]</b>	<b>Adaptation armature current controller non-linear L activation / Adapt N_lin L act</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6853
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 1	<b>Factory setting</b> 0
<b>Description:</b>	Setting to activate the adaptation of non-linear inductances for the armature current controller.		
<b>Value:</b>	0: Adaptation non-linear L active 1: Fixed value 100 % effective		
<b>Dependency:</b>	Refer to: p50570, p50572, r52350		
<b>p50572[0...n]</b>	<b>Adapt arm curr controller intermittent adapt activation / Adapt Interm Act</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6853
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0	<b>Max</b> 1	<b>Factory setting</b> 0
<b>Description:</b>	Setting to activate the intermittent adaptation for the armature current controller.		
<b>Value:</b>	0: Intermittent adaptation effective 1: Fixed value 100 %		
<b>Dependency:</b>	Refer to: p50570, p50571, r52350		

<b>p50573[0...n]</b>				<b>Adaptation armature current controller limiting / Adapt Ia_ctrl lim</b>			
DC_CTRL	<b>Can be changed:</b> U, T		<b>Calculated:</b> -		<b>Access level:</b> 2		
	<b>Data type:</b> FloatingPoint32		<b>Dyn. index:</b> DDS, p0180		<b>Func. diagram:</b> 6853		
	<b>P-Group:</b> -		<b>Units group:</b> -		<b>Unit selection:</b> -		
	<b>Not for motor type:</b> -		<b>Scaling:</b> PERCENT		<b>Expert list:</b> 1		
	<b>Min</b> 1.0 [%]		<b>Max</b> 1000.0 [%]		<b>Factory setting</b> 200.0 [%]		
<b>Description:</b>		Setting to limit the armature current controller adaptation.					
<b>Dependency:</b>		Refer to: p50571, p50572, r52350					
<b>p50574[0...n]</b>				<b>Adapt arm curr controller intermittent adapt Kp increase / Ad Interm Kp incr</b>			
DC_CTRL	<b>Can be changed:</b> U, T		<b>Calculated:</b> -		<b>Access level:</b> 2		
	<b>Data type:</b> FloatingPoint32		<b>Dyn. index:</b> DDS, p0180		<b>Func. diagram:</b> 6853		
	<b>P-Group:</b> -		<b>Units group:</b> -		<b>Unit selection:</b> -		
	<b>Not for motor type:</b> -		<b>Scaling:</b> -		<b>Expert list:</b> 1		
	<b>Min</b> 0.0		<b>Max</b> 10.0		<b>Factory setting</b> 1.0		
<b>Description:</b>		Sets the Kp increase for the intermittent adaptation for the armature current controller.					
<b>Dependency:</b>		Refer to: p50572					
<b>p50575[0...n]</b>				<b>Adaptation field current controller changeover input / Adapt If chgov inp</b>			
DC_CTRL	<b>Can be changed:</b> U, T		<b>Calculated:</b> -		<b>Access level:</b> 2		
	<b>Data type:</b> Integer16		<b>Dyn. index:</b> DDS, p0180		<b>Func. diagram:</b> 6908		
	<b>P-Group:</b> -		<b>Units group:</b> -		<b>Unit selection:</b> -		
	<b>Not for motor type:</b> -		<b>Scaling:</b> -		<b>Expert list:</b> 1		
	<b>Min</b> 0		<b>Max</b> 1		<b>Factory setting</b> 0		
<b>Description:</b>		Sets the input variable for the field current controller adaptation.					
<b>Value:</b>		0: If_act r52265 1: If_set r52268					
<b>Dependency:</b>		Refer to: p50576, p50577					
<b>p50576[0...n]</b>				<b>Adaptation field current controller non-linear L activation / Adapt n_lin act</b>			
DC_CTRL	<b>Can be changed:</b> U, T		<b>Calculated:</b> -		<b>Access level:</b> 2		
	<b>Data type:</b> Integer16		<b>Dyn. index:</b> DDS, p0180		<b>Func. diagram:</b> 6908		
	<b>P-Group:</b> -		<b>Units group:</b> -		<b>Unit selection:</b> -		
	<b>Not for motor type:</b> -		<b>Scaling:</b> -		<b>Expert list:</b> 1		
	<b>Min</b> 0		<b>Max</b> 1		<b>Factory setting</b> 0		
<b>Description:</b>		Setting to activate the adaptation of non-linear inductances for the field current controller.					
<b>Value:</b>		0: Adaptation non-linear L active 1: Fixed value 100 % effective					
<b>Dependency:</b>		Refer to: p50575, p50577, r52355					
<b>p50577[0...n]</b>				<b>Adapt field curr controller non-linear gating unit activation / Adapt n_lin GU act</b>			
DC_CTRL	<b>Can be changed:</b> U, T		<b>Calculated:</b> -		<b>Access level:</b> 2		
	<b>Data type:</b> Integer16		<b>Dyn. index:</b> DDS, p0180		<b>Func. diagram:</b> 6908		
	<b>P-Group:</b> -		<b>Units group:</b> -		<b>Unit selection:</b> -		
	<b>Not for motor type:</b> -		<b>Scaling:</b> -		<b>Expert list:</b> 1		
	<b>Min</b> 0		<b>Max</b> 1		<b>Factory setting</b> 0		
<b>Description:</b>		Activates the adaptation to the non-linearity of the gating unit for the field current controller.					



**Value:** 0: Adaptation gating unit effective  
1: Fixed value 100 % effective

**Dependency:** Refer to: p50575, p50576, r52355

<b>p50578[0...n]</b>	<b>Adaptation field current controller limiting / Adapt If_ctrl lim</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6908
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 1.0 [%]	<b>Max</b> 1000.0 [%]	<b>Factory setting</b> 200.0 [%]
<b>Description:</b>	Setting to limit the field current controller adaptation.		
<b>Dependency:</b>	Refer to: p50576, p50577, r52355		

<b>p50580[0...n]</b>	<b>BI: Field reversal direction of rotation signal source / Field rev sig s</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> CDS, p0170	<b>Func. diagram:</b> 6920
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> 0
<b>Description:</b>	Sets the signal source for the direction of rotation for the "field reversal" function. 0 signal: Positive field direction is selected (r53195.0 = 1, r53195.1 = 0). The speed actual value is not inverted. 1 signal: Negative field direction is selected (r53195.0 = 0, r53195.1 = 1). The speed actual value is inverted.		
<b>Dependency:</b>	Refer to: p50092, p50581, p50583, r53195		

<b>p50581[0...n]</b>	<b>BI: Field reversal braking signal source / Field rev br sig s</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> CDS, p0170	<b>Func. diagram:</b> 6920
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> 0
<b>Description:</b>	Sets the signal source for the "field reversal braking" function. 0/1 signal: Reversal of the field direction (this has a braking effect). At $n < n_{min}$ , the original field direction is selected again. The drive goes into operating state o7.2.		
<b>Dependency:</b>	Refer to: p50092, p50580, p50583, r53195		

<b>p50583[0...n]</b>	<b>CI: Field reversal speed actual value signal source / FldRev n_act sig s</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / FloatingPoint32	<b>Dyn. index:</b> CDS, p0170	<b>Func. diagram:</b> 6920
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> 52167[0]
<b>Description:</b>	Sets the signal source for the speed actual value when reversing the field.		
<b>Dependency:</b>	Refer to: p50092, p50580, p50581, r53195		

<b>p50590</b>	<b>CI: Messages for set/act val dev 1 signal source for speed setpoint / Msg dev1 set sig s</b>		
DC_CTRL	Can be changed: T Data type: Unsigned32 / FloatingPoint32 P-Group: - Not for motor type: - Min -	Calculated: - Dyn. index: - Units group: - Scaling: PERCENT Max -	Access level: 2 Func. diagram: 8020 Unit selection: - Expert list: 1 Factory setting 52174[0]
<b>Description:</b>	Sets the signal source for the speed setpoint for the "Setpoint/actual value deviation 1" message.		
<b>Dependency:</b>	Refer to: p50591, r53025		
<b>p50591</b>	<b>CI: Messages for set/act val dev 1 signal source for speed act val / Msg dev1 act sig s</b>		
DC_CTRL	Can be changed: T Data type: Unsigned32 / FloatingPoint32 P-Group: - Not for motor type: - Min -	Calculated: - Dyn. index: - Units group: - Scaling: PERCENT Max -	Access level: 2 Func. diagram: 8020 Unit selection: - Expert list: 1 Factory setting 52167[0]
<b>Description:</b>	Sets the signal source for the speed actual value for the "Setpoint/actual value deviation 1" message.		
<b>Dependency:</b>	Refer to: p50590, r53025		
<b>p50592</b>	<b>CI: Messages for ref speed signal source for speed actual value / Msg ref act sig s</b>		
DC_CTRL	Can be changed: T Data type: Unsigned32 / FloatingPoint32 P-Group: - Not for motor type: - Min -	Calculated: - Dyn. index: - Units group: - Scaling: PERCENT Max -	Access level: 2 Func. diagram: 8020 Unit selection: - Expert list: 1 Factory setting 52167[0]
<b>Description:</b>	Sets the signal source for the speed actual value for the "Reference speed reached" message.		
<b>Dependency:</b>	Refer to: r53025		
<b>p50593</b>	<b>CI: Messages for speed less than min speed signal source for act val / Msg n&lt;n_min sig s</b>		
DC_CTRL	Can be changed: T Data type: Unsigned32 / FloatingPoint32 P-Group: - Not for motor type: - Min -	Calculated: - Dyn. index: - Units group: - Scaling: PERCENT Max -	Access level: 2 Func. diagram: 8020 Unit selection: - Expert list: 1 Factory setting 52167[0]
<b>Description:</b>	Sets the signal source for the "Speed less then minimum speed" message.		
<b>Dependency:</b>	Refer to: r53025		
<b>p50594[0...n]</b>	<b>CI: Messages polarity speed setpoint signal source / MsgPol n_set S_src</b>		
DC_CTRL	Can be changed: T Data type: Unsigned32 / FloatingPoint32 P-Group: - Not for motor type: - Min -	Calculated: - Dyn. index: CDS, p0170 Units group: - Scaling: PERCENT Max -	Access level: 2 Func. diagram: 8025 Unit selection: - Expert list: 1 Factory setting 52170[0]
<b>Description:</b>	Sets the signal source for the "Speed setpoint polarity" message.		
<b>Dependency:</b>	Refer to: p50372, r53025		

<b>p50595</b>	<b>CI: Signal source for overspeed messages / Msg n_over sig s</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> 8025 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 52167[0]
<b>Description:</b>	Sets the signal source for the speed actual value for the overspeed message.		
<b>Dependency:</b>	Refer to: p50380, p50381, r53025		
<b>p50596</b>	<b>CI: Messages for set/act val dev 2 signal source for speed setpoint / Msg dev2 set sig s</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> 8020 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 52174[0]
<b>Description:</b>	Sets the signal source for the speed setpoint for the "Setpoint/actual value deviation 2" message.		
<b>Dependency:</b>	Refer to: p50597, r53025		
<b>p50597</b>	<b>CI: Messages for set/act val dev 2 signal source for speed act val / Msg dev2 act sig s</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> 8020 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 52167[0]
<b>Description:</b>	Sets the signal source for the speed actual value for the "Setpoint/actual value deviation 2" message.		
<b>Dependency:</b>	Refer to: p50596, r53025		
<b>p50598[0...n]</b>	<b>CI: Messages polarity speed actual value signal source / MsgPol n_act S_src</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> 8025 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 52179[0]
<b>Description:</b>	Sets the signal source for the "Speed actual value polarity" message.		
<b>Dependency:</b>	Refer to: p50372, r53025		
<b>p50600[0...4]</b>	<b>CI: Signal source for armature gating unit input / A g unit in sig s</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 6858, 6860 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> [0] 52102[0] [1...4] 0
<b>Description:</b>	Sets the signal source for the gating unit input on the armature circuit.		

<b>p50601[0...5]</b>			
<b>CI: Signal source for speed limiting controller setpoint / n_lim set sig s</b>			
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6835, 6840, 6855
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	[0] 52141[0] [1] 0 [2] 52134[0] [3] 0 [4] 52125[0] [5] 0
<b>Description:</b>	Sets the signal source for the setpoint on the armature current controller.		
<b>Notice:</b>	Re index 5: When entering a supplementary current setpoint via p50601[5] it is not permissible to use the current setpoint integrator or the reduced gearbox load function. p50158 must be set = 0.000 s. Possible effect if this is not observed: Torque direction change will not be able to be completed. The drive remains in one torque direction.		
<b>Note:</b>	[0 to 1] = Speed limiting controller Sets the signal sources for the setpoint on the speed limiting controller. The two values are added together. [2 to 3] = Current limitation Sets the signal sources for the setpoint on the current controller (before current limitation). The two values are added together. [4 to 5] = Closed-loop current control Sets the signal sources for the setpoint on the current controller (before the current controller). The two values are added together. The absolute value is generated from the value in index 5.		

<b>p50602</b>			
<b>CI: CI-loop arm current control sig source for arm current act val / la ctr la ac sig s</b>			
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6855
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	52117[0]
<b>Description:</b>	Sets the signal source for the armature current actual value for closed-loop armature current control.		

<b>p50603[0...6]</b>			
<b>CI: Current limitation current limit torque direction I / I_lim I_lim t d I</b>			
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6840
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	[0...4] 1 [5] 52002[0] [6] 52002[0]
<b>Description:</b>	Sets the signal source for the variable current limit in torque direction I.		
<b>Note:</b>	About [0 to 3]: Selects which parameter is injected as the variable current limit in torque direction I. Scaling: +100% corresponding to p50100 * p50171.		

About [4]:

Selects which parameter is injected as the current limit in torque direction I for quick stop or shutdown.

Scaling: +100% corresponding to p50100 \* p50171.

About [5]:

Selects which parameter is injected as the variable current limit in torque direction I.

Scaling: +100% corresponding to r50072[1].

About [6]:

Selects which parameter is injected as the current limit in torque direction I for quick stop or shutdown.

Scaling: +100% corresponding to r50072[1].

<b>p50604[0...6] CI: Current limitation current limit torque direction II / I_lim I_lim t d II</b>			
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6840
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	[0] 52135[0]
			[1] 52135[1]
			[2] 52135[2]
			[3] 52135[3]
			[4] 52135[4]
			[5] 52135[5]
			[6] 52135[6]

**Description:** Sets the signal source for the variable current limit in torque direction II.

**Note:**

About [0 to 3]:

Selects which parameter is injected as the variable current limit in torque direction II.

Scaling: +100% corresponding to p50100 \* p50171.

About [4]:

Selects which parameter is injected as the current limit in torque direction II for quick stop or shutdown.

Scaling: +100% corresponding to p50100 \* p50171.

About [5]:

Selects which parameter is injected as the variable current limit in torque direction II.

Scaling: +100% corresponding to r50072[1].

About [6]:

Selects which parameter is injected as the current limit in torque direction II for quick stop or shutdown.

Scaling: +100% corresponding to r50072[1].

<b>p50605[0...4] CI: Torque limiting signal source for positive torque limit / T lim pos sig s</b>			
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6825
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	52002[0]

**Description:** Sets the signal source for the variable positive torque limit.

**Note:**

Scaling:

[0 to 3] = 100% of the parameter value corresponds to the positive system torque limit according to Ia = p50171.

[4] = 100% of the parameter value corresponds to the positive torque limit according to Ia = r50072[1].

<b>p50606[0...4]</b>	<b>CI: Torque limiting signal source for negative torque limit / T lim neg sig s</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 6825 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> [0] 52138[0] [1] 52138[1] [2] 52138[2] [3] 52138[3] [4] 52138[4]
<b>Description:</b>	Sets the signal source for the variable negative torque limit.		
<b>Note:</b>	Scaling: [0 to 3] = 100% of the parameter value corresponds to the negative system torque limit according to Ia = p50171. [4] = 100% of the parameter value corresponds to the negative torque limit according to Ia = r50072[1].		
<b>p50607[0...n]</b>	<b>CI: Torque limiting signal source for master drive t_set / Mst tq set sig s</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 6830 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 52148[0]
<b>Description:</b>	Sets the signal source for the master drive's torque setpoint.		
<b>p50608</b>	<b>CI: Auto-reversing stage signal source for torque direction setpoint / Tqe dir set sig s</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 6860 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 52119[0]
<b>Description:</b>	Sets the signal source for the torque direction setpoint for the auto-reversing stage.		
<b>p50609[0...n]</b>	<b>CI: Signal source for speed controller actual value / n_ctr act sig s</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 6810 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the signal source for the actual value on the speed controller.		
<b>Dependency:</b>	Refer to: p50083		

<b>p50610</b>	<b>CI: Signal source for field gating unit input value / Field g unit sig s</b>		
DC_CTRL	Can be changed: T	Calculated: -	Access level: 3
	Data type: Unsigned32 / FloatingPoint32	Dyn. index: -	Func. diagram: 6915
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: PERCENT	Expert list: 1
	Min	Max	Factory setting
	-	-	52252[0]
<b>Description:</b>	Sets the signal source for the input value on the field gating unit.		
<b>p50611[0...3]</b>	<b>CI: Field curr setp limiting setpoint sig source / If_lim set sig s</b>		
DC_CTRL	Can be changed: T	Calculated: -	Access level: 3
	Data type: Unsigned32 / FloatingPoint32	Dyn. index: -	Func. diagram: 6905
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: PERCENT	Expert list: 1
	Min	Max	Factory setting
	-	-	[0] 52277[0]
			[1] 0
			[2] 0
			[3] 0
<b>Description:</b>	Sets the signal sources for generating the field current setpoint (CO: r52275).		
<b>Dependency:</b>	Refer to: r52275		
<b>p50612[0...1]</b>	<b>CI: CI-loop field current ctrl sig source for field current act val / If_ctr If_ac sig s</b>		
DC_CTRL	Can be changed: T	Calculated: -	Access level: 3
	Data type: Unsigned32 / FloatingPoint32	Dyn. index: -	Func. diagram: 6910
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: PERCENT	Expert list: 1
	Min	Max	Factory setting
	-	-	[0] 52266[0]
			[1] 0
<b>Description:</b>	Sets the signal source for the field current actual value for closed-loop field current control.		
<b>p50613[0...4]</b>	<b>CI: Field current setpoint limiting sig source for var upper limit / If_li up li sig s</b>		
DC_CTRL	Can be changed: T	Calculated: -	Access level: 3
	Data type: Unsigned32 / FloatingPoint32	Dyn. index: -	Func. diagram: 6905
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: PERCENT	Expert list: 1
	Min	Max	Factory setting
	-	-	1
<b>Description:</b>	Sets the signal sources for generating the upper limit of the field current setpoint (CO: r52273).		
<b>Dependency:</b>	Refer to: r50073, p50102, r52273		
<b>p50614[0...4]</b>	<b>CI: Field current setpoint limiting sig source for var lower limit / If_lim l lim sig s</b>		
DC_CTRL	Can be changed: T	Calculated: -	Access level: 3
	Data type: Unsigned32 / FloatingPoint32	Dyn. index: -	Func. diagram: 6905
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: PERCENT	Expert list: 1
	Min	Max	Factory setting
	-	-	[0...3] 1
			[4] 0
<b>Description:</b>	Sets the signal sources for generating the lower limit of the field current setpoint (CO: r52274).		

**Dependency:** Refer to: p50103, r52274

<b>p50615[0...3]</b>	<b>CI: EMF controller setpoint signal source / EMF ctr set sig s</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6900
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	[0] 52289[0]
			[1] 0
			[2] 0
			[3] 0

**Description:** Sets the signal source for the setpoints on the EMF controller.

**Index:**  
 [0] = Setpoint 0  
 [1] = Setpoint 1  
 [2] = Setpoint 2  
 [3] = Setpoint 3

**Dependency:** Refer to: r52288

**Note:** The overall setpoint is available via connector output r52288 for further interconnection.

<b>p50616</b>	<b>CI: EMF controller actual value signal source / EMF ctr act sig s</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6900
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	52286[0]

**Description:** Sets the signal source for the actual value on the EMF controller.

**Dependency:** Refer to: r52285

**Note:** The actual value is available via connector output r52285 for further interconnection.

<b>p50618</b>	<b>CI: Field gating unit signal source for field direction / Field g unit dir</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6915
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	52268[0]

**Description:** Sets the signal source for the field direction on the field gating unit.

<b>p50619</b>	<b>CI: Acceleration value for inertia compensation / Comp inert acc val</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6820
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	52191[0]

**Description:** Sets the signal source for the acceleration value for inertia compensation.



<b>p50620</b>	<b>CI: Speed controller setpoint/actual value difference signal source / n_ctr set/ac sig s</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 6815 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 52165[0]
<b>Description:</b>	Sets the signal source for the setpoint/actual value difference on the speed controller.		
<b>Dependency:</b>	Refer to: r52164		
<b>Note:</b>	The setpoint/actual value difference for the speed controller is available in r52164 for further interconnection.		
<b>p50621</b>	<b>CI: Speed controller setpoint 1 signal source / n_ctr set 1 sig s</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 6810 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 52176[0]
<b>Description:</b>	Sets the signal source for setpoint 1 on the speed controller.		
<b>Dependency:</b>	Refer to: p50622, p50623, p50624, r52165		
<b>Note:</b>	The setpoint/actual value difference (r52165) results from setpoint 1 and 2 (p50621, p50622) and actual value 1 and 2 (p50623, p50624).		
<b>p50622</b>	<b>CI: Speed controller setpoint 2 signal source / n_ctr set 2 sig s</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 6810 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 52174[0]
<b>Description:</b>	Sets the signal source for setpoint 2 on the speed controller.		
<b>Dependency:</b>	Refer to: p50621, p50623, p50624, r52165		
<b>Note:</b>	The setpoint/actual value difference (r52165) results from setpoint 1 and 2 (p50621, p50622) and actual value 1 and 2 (p50623, p50624).		
<b>p50623</b>	<b>CI: Signal source for speed controller actual value 1 / n_ctr act 1 sig s</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 6810 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 52179[0]
<b>Description:</b>	Sets the signal source for actual value 1 on the speed controller.		
<b>Dependency:</b>	Refer to: p50621, p50622, p50624, r52165		
<b>Note:</b>	The setpoint/actual value difference (r52165) results from setpoint 1 and 2 (p50621, p50622) and actual value 1 and 2 (p50623, p50624).		

<b>p50624</b>	<b>CI: Signal source for speed controller actual value 2 / n_ctr act 2 sig s</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 6810 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the signal source for actual value 2 on the speed controller.		
<b>Dependency:</b>	Refer to: p50621, p50622, p50623, r52165		
<b>Note:</b>	The setpoint/actual value difference (r52165) results from setpoint 1 and 2 (p50621, p50622) and actual value 1 and 2 (p50623, p50624).		
<b>p50625[0...n]</b>	<b>CI: Signal source for speed controller setpoint / n_ctr set sig s</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 6810 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 52170[0]
<b>Description:</b>	Sets the signal source for the setpoint on the speed controller. This signal can be smoothed using p50228.		
<b>Dependency:</b>	Refer to: p50228		
<b>p50626[0...n]</b>	<b>CI: Signal source for speed controller actual value smoothing / Act v smoo sig s</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 6810 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 52167[0]
<b>Description:</b>	Sets the signal source to enable smoothing of the actual value on the speed controller.		
<b>p50627</b>	<b>CI: Derivative-action element signal source / D elem sig s</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 6810 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 52178[0]
<b>Description:</b>	Sets the signal source for the derivative-action element.		
<b>Dependency:</b>	Refer to: p50205, p50206, r52168, r52169		
<b>p50628</b>	<b>CI: Band-stop 1 signal source / Band-st 1 sig s</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 6810 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 52179[0]
<b>Description:</b>	Sets the signal source for band-stop 1.		
<b>Dependency:</b>	Refer to: p50201, p50202, r52177		

<b>p50629</b>	<b>CI: Band-stop 2 signal source / Band-st 2 sig s</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 6810 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 52177[0]
<b>Description:</b>	Sets the signal source for band-stop 2.		
<b>Dependency:</b>	Refer to: p50203, p50204, r52178		
<b>p50630</b>	<b>CI: Speed controller droop signal source / Droop sig s</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 6805 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 52162[0]
<b>Description:</b>	Sets the signal source for the droop on the speed controller.		
<b>p50631</b>	<b>CI: Speed controller integral component setting value signal source / I_co set v sig s</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 6815 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the signal source for the setting value of the integral component for the speed controller.		
<b>Dependency:</b>	Refer to: p50230, p50695		
<b>p50632[0...3]</b>	<b>CI: RFG signal source for positive limiting after RFG / RFG pos lim sig s</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 3155 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Sets the signal sources for positive limiting after the ramp-function generator (setpoint limiting).		
<b>Note:</b>	The minimum of the signals is forwarded to the limiter via connector input p50632[0 to 3].		
<b>p50633[0...3]</b>	<b>CI: RFG signal source for negative limiting after RFG / RFG neg lim sig s</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 3155 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> [0] 52210[0] [1] 52210[1] [2] 52210[2] [3] 52210[3]
<b>Description:</b>	Sets the signal sources for negative limiting after the ramp-function generator (setpoint limiting).		
<b>Note:</b>	The maximum of the signals is forwarded to the limiter via connector input p50633[0 to 3].		

<b>p50634[0...1]</b>	<b>CI: RFG input signal for limiting after RFG / RFG lim inp sig</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 3155 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> [0] 52190[0] [1] 0
<b>Description:</b>	Sets the signal sources for the input signals in the case of limiting after the ramp-function generator (setpoint limiting).		
<b>Note:</b>	The signals via connector input p50634[0 to 1] are added to the input and forwarded to "Limiting after ramp-function generator".		
<b>p50635[0...n]</b>	<b>CI: Setpoint processing signal source for RFG setpoint / RFG set sig s</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 3135 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 52194[0]
<b>Description:</b>	Sets the signal source for the ramp-function generator's setpoint.		
<b>p50636[0...5]</b>	<b>CI: RFG signal source for valuation factor 1 / RFG val_f 1 sig s</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 3150 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Sets the signal sources for the valuation factors for ramp-function generator parameter set 1.		
<b>Index:</b>	[0] = Ramp-up time and ramp-down time [1] = Initial rounding and final rounding [2] = Ramp-up time [3] = Ramp-down time [4] = Initial rounding [5] = Final rounding		
<b>Dependency:</b>	Refer to: p50303, p50304, p50305, p50306		
<b>Note:</b>	The valuation factors affect the set values of the following parameters: - p50303: Ramp-up time 1 - p50304: Ramp-down time 1 - p50305: Initial rounding 1 - p50306: Final rounding 1		
<b>p50637[0...n]</b>	<b>BI: RFG parameter set 2 selection signal source / RFG par s 2 sig s</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 3150 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the signal source for the selection of "ramp-function generator parameter set 2". 1 signal: RFG parameter set 2 is effective (p50307, p50308, p50309, p50310).		

**Dependency:** Refer to: p50307, p50308, p50309, p50310, p50638

**Note:** The following applies as regards selection of ramp-function generator parameter set 2:

- This selection has a higher priority than selection by means of the ramp-up integrator.
- This selection has a lower priority than quick stop (OFF3); in other words, in the event of a quick stop (OFF3) the values set in p50296, p50297, and p50298 become effective.
- A corresponding message is output if ramp-function generator parameter sets 2 and 3 are selected at the same time.

---

**p50638[0...n] BI: RFG parameter set 3 selection signal source / RFG par s 3 sig s**

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> CDS, p0170	<b>Func. diagram:</b> 3150
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Sets the signal source for the selection of "ramp-function generator parameter set 3".  
1 signal:

RFG parameter set 3 is effective (p50311, p50312, p50313, p50314).

**Dependency:** Refer to: p50311, p50312, p50313, p50314, p50637

**Note:** The following applies as regards selection of ramp-function generator parameter set 3:

- This selection has a higher priority than selection by means of the ramp-up integrator.
- This selection has a lower priority than quick stop (OFF3); in other words, in the event of a quick stop (OFF3) the values set in p50296, p50297, and p50298 become effective.
- A corresponding message is output if ramp-function generator parameter sets 2 and 3 are selected at the same time.

---

**p50639[0...1] CI: RFG signal source for setting value / RFG set val sig s**

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 3152
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	52167[0]

**Description:** Sets the signal source for the ramp-function generator's setting values.

**Index:** [0] = Setting value  
[1] = Setting value if machine is not running

**Dependency:** The setting value for the ramp-function generator output is selected via binector input p50640.  
p50640 = 0 signal:  
If the machine is not running, the value supplied via connector input p50639[1] is accepted.  
p50640 = 1 signal:  
The value supplied via connector input p50639[0] is accepted as the setting value.  
Refer to: p50640

---

**p50640[0...n] BI: RFG signal source for accepting setting value / RFG accept set v**

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> CDS, p0170	<b>Func. diagram:</b> 3152
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Sets the signal source for accepting the setting value of the ramp-function generator.

**Dependency:** Refer to: p50639

<b>p50641[0...n]</b>	<b>BI: Bypass ramp-function generator signal source / Bypass RFG sig s</b>		
DC_CTRL	Can be changed: T	Calculated: -	Access level: 3
	Data type: Unsigned32 / Binary	Dyn. index: CDS, p0170	Func. diagram: 3152
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min	Max	Factory setting
	-	-	0
<b>Description:</b>	Sets the signal source for "Bypass ramp-function generator".		
<b>Note:</b>	The "Bypass ramp-function generator" signal can also be set via binector input p50649[0 to 2].		
<b>p50642[0...3]</b>	<b>CI: Setpoint processing sig source for pos limiting of main setpoint / M set lim p sig s</b>		
DC_CTRL	Can be changed: T	Calculated: -	Access level: 3
	Data type: Unsigned32 / FloatingPoint32	Dyn. index: -	Func. diagram: 3135
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: PERCENT	Expert list: 1
	Min	Max	Factory setting
	-	-	52002[0]
<b>Description:</b>	Sets the signal source for variable positive limiting of the main setpoint.		
<b>Notice:</b>	Negative values at the selected parameters generate a negative maximum value at the limiting output.		
<b>Note:</b>	The minimum of the values set via index 0 to 3 is applied as the limit.		
<b>p50643[0...3]</b>	<b>CI: Setpoint processing sig source for neg limiting of main setpoint / M set lim n sig s</b>		
DC_CTRL	Can be changed: T	Calculated: -	Access level: 3
	Data type: Unsigned32 / FloatingPoint32	Dyn. index: -	Func. diagram: 3135
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: PERCENT	Expert list: 1
	Min	Max	Factory setting
	-	-	[0] 52184[0]
			[1] 52185[0]
			[2] 52186[0]
			[3] 52187[0]
<b>Description:</b>	Sets the signal source for variable positive limiting of the main setpoint.		
<b>Notice:</b>	Positive values at the selected parameters generate a positive minimum value at the limiting output.		
<b>Note:</b>	The maximum of the values set via index 0 to 3 is applied as the limit.		
<b>p50644[0...n]</b>	<b>CI: Setpoint processing signal source for main setpoint / M set sig s</b>		
DC_CTRL	Can be changed: T	Calculated: -	Access level: 3
	Data type: Unsigned32 / FloatingPoint32	Dyn. index: CDS, p0170	Func. diagram: 3135
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: PERCENT	Expert list: 1
	Min	Max	Factory setting
	-	-	52206[0]
<b>Description:</b>	Sets the signal source for the main setpoint in the context of setpoint processing.		
<b>Dependency:</b>	Refer to: p50320, p50322		

**p50645[0...n] CI: Setpoint processing signal source for additional setpoint / A set sig s**

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / FloatingPoint32	<b>Dyn. index:</b> CDS, p0170	<b>Func. diagram:</b> 3135
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Sets the signal source for the additional setpoint in the context of setpoint processing.

**Dependency:** Refer to: p50321, p50323

**p50646[0...n] BI: RFG signal source for ramp-up integrator enable / R-up int ena sig s**

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> CDS, p0170	<b>Func. diagram:</b> 3150
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	1

**Description:** Sets the signal source for enabling the ramp-up integrator on the ramp-function generator.

**p50647[0...n] BI: RFG tracking activation signal source / RFG trck act sig s**

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> CDS, p0170	<b>Func. diagram:</b> 3152
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Sets the signal source for activating/de-activating ramp-function generator tracking.

**Dependency:** The enable for ramp-function generator tracking must be available (p50317 = 1).

Refer to: p50317

**p50648 CI: RFG signal source for input signal / RFG inp sig sig s**

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 3151
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	52193[0]

**Description:** Sets the signal source for the ramp-function generator's input signal.

**p50649[0...2] BI: Bypass ramp-function generator signal source / Bypass RFG sig s**

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 3152
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	[0] 53170.10
			[1] 53170.11
			[2] 53170.12

**Description:** Sets the signal sources for "Bypass ramp-function generator".

**Dependency:** Refer to: p50641

**Note:** The "Bypass ramp-function generator" signal can also be set via binector input p50641.  
 About index 0, 1, 2 and their factory setting:  
 The "Bypass ramp-function generator" signal comes from the "Fixed setpoint", "Jog setpoint", "Creep setpoint" function.

<b>p50650[0...1]</b> <b>CI: RFG signal source for setting value with OFF1 / RFG s v OFF1 sig s</b>			
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 3152 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> [0] 52167[0] [1] 52179[0]
<b>Description:</b>	Sets the signal sources for the ramp-function generator's setting value with OFF1. The ramp-function generator is set to this value once.		
<b>Index:</b>	[0] = Setting value 1 [1] = Setting value 2		
<b>Dependency:</b>	The selection of the signal source for the setting value is set via p50318. p50318 = 0: Do not set ramp-function generator output p50318 = 1: Set ramp-function generator output to the value supplied via connector input p50650[0]. p50318 = 2: Set ramp-function generator output to the value supplied via connector input p50650[1]. Refer to: p50318		
<hr/>			
<b>p50651[0...6]</b> <b>CI: RFG tracking signal sources / RFG track sig s</b>			
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 3152 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> [0] 52290[0] [1] 52167[0] [2] 52143[0] [3] 52144[0] [4] 52131[0] [5] 52132[0] [6] 50219[0]
<b>Description:</b>	Sets the signal sources for the effective limits for ramp-function generator tracking.		
<b>Index:</b>	[0] = Scaled motor flux [1] = Speed actual value [2] = Effective positive torque limit [3] = Effective negative torque limit [4] = Effective positive current limit [5] = Effective negative current limit [6] = Effective speed controller proportional gain		
<hr/>			
<b>p50671[0...n]</b> <b>BI: Setpoint processing sig source to enable neg dir of rotation / Ena n dir r sig s</b>			
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> 3135 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Sets the signal source to enable the negative direction of rotation.		
<b>Dependency:</b>	Refer to: p50672		



**Note:** 1 signal: Negative direction of rotation enabled  
0 signal: Negative direction of rotation disabled

---

**p50672[0...n] BI: Setpoint processing signal source to enable pos dir of rotation / Ena p dir r sig s**


---

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> CDS, p0170	<b>Func. diagram:</b> 3135
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	1

**Description:** Sets the signal source to enable the positive direction of rotation.

**Dependency:** Refer to: p50671

**Note:** 1 signal: Positive direction of rotation enabled  
0 signal: Positive direction of rotation disabled

---

**p50673[0...n] BI: Motorized potentiometer signal source to increase setpoint / MotP incr sig s**


---

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> CDS, p0170	<b>Func. diagram:</b> 3110
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Sets the signal source to increase the setpoint for the motorized potentiometer.

**Dependency:** Refer to: p50471

**Note:** This parameter is only effective in manual mode (p50471 = 0).

---

**p50674[0...n] BI: Motorized potentiometer signal source to lower setpoint / MotP lower sig s**


---

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> CDS, p0170	<b>Func. diagram:</b> 3110
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Sets the signal source to lower the setpoint for the motorized potentiometer.

**Dependency:** Refer to: p50471

**Note:** This parameter is only effective in manual mode (p50471 = 0).

---

**p50680[0...n] BI: Fixed setpoint signal source for connector selection 0 / Fix set con0 sig s**


---

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> CDS, p0170	<b>Func. diagram:</b> 3115
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Sets the signal source for the selection of connector 0 (p50431[0]).

**Dependency:** Refer to: p50430, p50431

<b>p50681[0...n]</b>	<b>BI: Fixed setpoint signal source for connector selection 1 / Fix set con1 sig s</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> 3115 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the signal source for the selection of connector 1 (p50431[1]).		
<b>Dependency:</b>	Refer to: p50430, p50431		
<b>p50684[0...n]</b>	<b>BI: Speed controller droop enable / Droop enable</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> 6805 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Sets the signal source to enable droop on the speed controller.		
<b>Note:</b>	The following values are multiplied by the droop output dependent upon the signal state: 1 signal: Enable (r50630) 0 signal: No enable (0%)		
<b>p50687[0...n]</b>	<b>BI: Speed controller signal source for master/slave drive / Mast/sl sig s</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> 6810, 6830 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the signal source for the master or slave drive on the speed controller.		
<b>Note:</b>	1 signal: Torque control is active on the slave drive. 0 signal: Speed control is active on the master drive.		
<b>p50691[0...n]</b>	<b>BI: Sequence control line contactor feedback / Line cont feedb</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> CDS, p0170 <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> 2651 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Sets the signal source for feedback from the line contactor. The feedback signal is checked and fault F60104 is triggered in the following cases: - If, following power-up, a 1 signal is not detected within the time set in p50095 (in other words, if the line contactor has not closed). - If a 0 signal is detected during operation.		
<b>Note:</b>	Feedback from the line contactor can be achieved by integrating one of the line contactor's auxiliary contacts into the device control.		

**p50692[0...n] BI: CI-loop field curr ctrl sig source for inject of standst field / If\_ctr stst sig s**

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> CDS, p0170	<b>Func. diagram:</b> 6910, 8046
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Sets the signal source for the selection of standstill field injection.

**p50693[0...n] BI: EMF controller enable signal source / EMF ctr ena sig s**

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> CDS, p0170	<b>Func. diagram:</b> 6900
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	1

**Description:** Sets the signal source to enable the EMF controller.

**p50694[0...n] BI: Torque limiting signal source to enable changeover / T lim ch ena sig s**

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> CDS, p0170	<b>Func. diagram:</b> 6825
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Sets the signal source to enable the torque limits to be changed over.

**Dependency:** Refer to: p50180, p50181, p50182, p50183

**Note:** 1 signal: Changeover enabled  
0 signal: Changeover disabled

**p50695[0...n] BI: Signal source for setting speed controller integral component / Set I\_co sig s**

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> CDS, p0170	<b>Func. diagram:</b> 6815
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Sets the signal source for setting the integral component on the speed controller.

The value supplied via connector input p50631 is used as the setting value.

With a 0/1 signal from p50695, the integral component of the speed controller is tracked continuously to the value of the signal present at connector input p50631 for the time that has been set in p50230.

**Dependency:** Refer to: p50230, p50631

**Note:** For the same signal source for the speed controller enable and integral component, the time in p50230 must be set greater than 0 ms.

**p50696[0...n] BI: Signal source for stop speed controller integral component / Stop I\_co sig s**

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> CDS, p0170	<b>Func. diagram:</b> 6815
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Sets the signal source for stopping the integral component on the speed controller.

**Note:** Dependent upon the signal state, the following applies:

0 signal: Integral component is not stopped

1 signal: Integral component is stopped

**p50697[0...n] BI: Enable for inertia compensation / Inert comp ena**

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> CDS, p0170	<b>Func. diagram:</b> 6820
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	1

**Description:** Sets the signal source for enabling moment of inertia compensation.

**Note:** Dependent upon the signal state, the following values are added to the output for friction and moment of inertia compensation:

1 signal: Enable (r52173)

0 signal: No enable (0%)

**p50698[0...n] BI: Signal source for speed controller PI/P controller changeover / n\_ctr PI/P sig s**

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> CDS, p0170	<b>Func. diagram:</b> 6815
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	1

**Description:** Sets the signal source for the speed-dependent changeover between PI and P controller on the speed controller.

**Dependency:** Refer to: p50221, p50222, r52166

**p50700 CUD analog input 0 type / CUD AI 0 type**

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2075
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	2	0

**Description:** Sets the type for analog input 0 (X177.25/26) on the CUD.

**Value:**  
0: Bipolar voltage input (-10 V ... +10 V)  
1: Bipolar current input (-20 mA to +20 mA)  
2: Unipolar current input monitored (+4 mA to +20 mA)

**Note:** AI: Analog Input

<b>p50701[0...n]</b>	<b>CUD analog input 0 scaling / CUD AI 0 scal</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -1000.0 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> DDS, p0180 <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> 1000.0 [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 2075 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 100.0 [%]
<b>Description:</b>	Sets the scaling for analog input 0 (X177.25/26) on the CUD. The value indicates the percentage value for the mapping of an input voltage of 10 V or an input current of 20 mA at the analog input. Example: p50701 = 90% --> 10 V or 20 mA is scaled to 90% --> 5 V or 10 mA is equivalent to 45%		
<b>p50702</b>	<b>CUD analog input 0 offset / CUD AI 0 offs</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -200.00 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> 200.00 [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 2075 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.00 [%]
<b>Description:</b>	Sets the offset for analog input 0 (X177.25/26) on the CUD.		
<b>p50703</b>	<b>CUD analog input 0 signal processing / CUD AI 0 sig proc</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 3	<b>Access level:</b> 2 <b>Func. diagram:</b> 2075 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the signal processing mode for analog input 0 (X177.25/26) on the CUD.		
<b>Value:</b>	0: Signal not controlled 1: Signal absolute value generation 2: Signal inverted 3: Signal absolute value generation inverted		
<b>p50704</b>	<b>BI: CUD analog input 0 inversion / CUD AI 0 inv</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> 2075 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the signal source for inverting the signal from analog input 0 (X177.25/26) on the CUD. 1 signal: Inversion 0 signal: No inversion		

<b>p50705</b>	<b>CUD analog input 0 smoothing time constant / CUD AI 0 T</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0 [ms]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 10000 [ms]	<b>Access level:</b> 2 <b>Func. diagram:</b> 2075 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0 [ms]
<b>Description:</b>	Sets the time constant for smoothing the signal from analog input 0 (X177.25/26) on the CUD.		
<b>p50706</b>	<b>BI: CUD analog input 0 signal source for enable / CUD AI 0 ena sig s</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> 2075 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Sets the signal source for enabling analog input 0 (X177.25/26) on the CUD.		
<b>Note:</b>	1 signal: Analog input enabled 0 signal: Analog input not enabled (r52011 = 0%)		
<b>p50707</b>	<b>CUD analog input 0 simulation setpoint / CUD AI 0 sim setp</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -130.0 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> 130.0 [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 2075 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.0 [%]
<b>Description:</b>	Sets the setpoint for the simulation of analog input 0 (X177.25/26) on the CUD.		
<b>Dependency:</b>	Refer to: p50709		
<b>Note:</b>	Simulation is selected using p50709 = 1.		
<b>p50708</b>	<b>Activation of analog input synchronization / AI sync act</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 3	<b>Access level:</b> 2 <b>Func. diagram:</b> 2083 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Setting to activate/de-activate the synchronization of the analog inputs of two Control Unit DC MASTERS (CUDs).		
<b>Value:</b>	0: No synchronized analog inputs 1: 6 synchronized analog inputs on left-hand CUD 2: 6 synchronized analog inputs on right-hand CUD 3: 6 synchronized analog inputs on left-hand and right-hand CUD		
<b>Notice:</b>	This parameter must always be set to the same value on both CUDs!		
<b>Note:</b>	If value = 0: There is no quasi-synchronization of the analog inputs on the two CUDs. Connector outputs r52030[0 to 6] on both CUDs always indicate a value of 0%. If value = 1: The analog inputs of the right-hand CUD are interpolated on the left-hand CUD in such a way that 6 simultaneously scanned values appear at the connector outputs r52030[0 to 6] of the left-hand CUD. Connector outputs r52030[0 to 6] on the right-hand CUD always indicate a value of 0%.		

If value = 2:

The analog inputs of the left-hand CUD are interpolated on the right-hand CUD in such a way that 6 simultaneously scanned values appear at the connector outputs r52030[0 to 6] of the right-hand CUD. Connector outputs r52030[0 to 6] on the left-hand CUD always indicate a value of 0%.

If value = 3:

The analog inputs of the right-hand CUD are interpolated on the left-hand CUD in such a way that 6 simultaneously scanned values appear at the connector outputs r52030[0 to 6] of the left-hand CUD.

The analog inputs of the left-hand CUD are interpolated on the right-hand CUD in such a way that 6 simultaneously scanned values appear at the connector outputs r52030[0 to 6] of the right-hand CUD.

p50709 CUD analog input 0 simulation selection / CUD AI 0 sim sel			
DC_CTRL	Can be changed: T Data type: Integer16 P-Group: - Not for motor type: - Min 0	Calculated: - Dyn. index: - Units group: - Scaling: - Max 1	Access level: 2 Func. diagram: 2075 Unit selection: - Expert list: 1 Factory setting 0
<b>Description:</b> Setting to select the simulation of analog input 0 (X177.25/26) on the CUD.			
<b>Value:</b> 0: Simulation deactivated 1: Simulation activated			
<b>Dependency:</b> Refer to: p50707			
<b>Note:</b> The setpoint for the simulation is set in p50707.			
p50710 CUD analog input 1 type / CUD AI 1 type			
DC_CTRL	Can be changed: T Data type: Integer16 P-Group: - Not for motor type: - Min 0	Calculated: - Dyn. index: - Units group: - Scaling: - Max 2	Access level: 2 Func. diagram: 2080 Unit selection: - Expert list: 1 Factory setting 0
<b>Description:</b> Sets the type for analog input 1 (X177.27/28) on the CUD.			
<b>Value:</b> 0: Bipolar voltage input (-10 V ... +10 V) 1: Bipolar current input (-20 mA to +20 mA) 2: Unipolar current input monitored (+4 mA to +20 mA)			
<b>Note:</b> AI: Analog Input			
p50711[0...n] CUD analog input 1 scaling / CUD AI 1 scal			
DC_CTRL	Can be changed: U, T Data type: FloatingPoint32 P-Group: - Not for motor type: - Min -1000.0 [%]	Calculated: - Dyn. index: DDS, p0180 Units group: - Scaling: PERCENT Max 1000.0 [%]	Access level: 2 Func. diagram: 2080 Unit selection: - Expert list: 1 Factory setting 100.0 [%]
<b>Description:</b> Sets the scaling for analog input 1 (X177.27/28) on the CUD. The value indicates the percentage value for the mapping of an input voltage of 10 V or an input current of 20 mA at the analog input. Example: p50711 = 90% --> 10 V or 20 mA is scaled to 90% --> 5 V or 10 mA is equivalent to 45%			

<b>p50712</b>	<b>CUD analog input 1 offset / CUD AI 1 offs</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -200.00 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> 200.00 [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 2080 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.00 [%]
<b>Description:</b>	Sets the offset for analog input 1 (X177.27/28) on the CUD.		
<b>p50713</b>	<b>CUD analog input 1 signal processing / CUD AI 1 sig proc</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 3	<b>Access level:</b> 2 <b>Func. diagram:</b> 2080 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the signal processing mode for analog input 1 (X177.27/28) on the CUD.		
<b>Value:</b>	0: Signal not controlled 1: Signal absolute value generation 2: Signal inverted 3: Signal absolute value generation inverted		
<b>p50714</b>	<b>BI: CUD analog input 1 inversion / CUD AI 1 inv</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> 2080 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the signal source for inverting the signal from analog input 1 (X177.27/28) on the CUD. 1 signal: Inversion 0 signal: No inversion		
<b>p50715</b>	<b>CUD analog input 1 smoothing time constant / CUD AI 1 T</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0 [ms]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 10000 [ms]	<b>Access level:</b> 2 <b>Func. diagram:</b> 2080 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0 [ms]
<b>Description:</b>	Sets the time constant for smoothing the signal from analog input 1 (X177.27/28) on the CUD.		
<b>p50716</b>	<b>BI: CUD analog input 1 signal source for enable / CUD AI 1 ena sig s</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> 2080 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Sets the signal source for enabling analog input 1 (X177.27/28) on the CUD.		



**Note:** 1 signal:  
Analog input is enabled  
0 signal:  
Analog input is disabled (value = 0%)

---

<b>p50717</b>	<b>CUD analog input 1 simulation setpoint / CUD AI 1 sim setp</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2080
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-130.0 [%]	130.0 [%]	0.0 [%]
<b>Description:</b>	Sets the setpoint for the simulation of analog input 1 (X177.27/28) on the CUD.		
<b>Dependency:</b>	Refer to: p50719		
<b>Note:</b>	Simulation is selected using p50719 = 1.		

---

<b>p50719</b>	<b>CUD analog input 1 simulation selection / CUD AI 1 sim sel</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2080
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	1	0
<b>Description:</b>	Setting to select the simulation of analog input 1 (X177.27/28) on the CUD.		
<b>Value:</b>	0: Simulation deactivated 1: Simulation activated		
<b>Dependency:</b>	Refer to: p50717		
<b>Note:</b>	The setpoint for the simulation is set in p50717.		

---

<b>p50721[0...n]</b>	<b>CUD analog input 2 scaling / CUD AI 2 scal</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 2080
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-1000.0 [%]	1000.0 [%]	100.0 [%]
<b>Description:</b>	Sets the scaling for analog input 2 (X177.29/30) on the CUD. The value indicates the percentage value for the mapping of an input voltage of 10 V at the analog input. Example: p50721 = 90% --> 10 V is scaled to 90 % --> 5 V corresponds to 45 %		
<b>Note:</b>	AI: Analog Input		

---

<b>p50722</b>	<b>CUD analog input 2 offset / CUD AI 2 offs</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2080
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-200.00 [%]	200.00 [%]	0.00 [%]
<b>Description:</b>	Sets the offset for analog input 2 (X177.29/30) on the CUD.		

<b>p50723</b>	<b>CUD analog input 2 signal processing / CUD AI 2 sig proc</b>		
DC_CTRL	Can be changed: T	Calculated: -	Access level: 2
	Data type: Integer16	Dyn. index: -	Func. diagram: 2080
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min	Max	Factory setting
	0	3	0
<b>Description:</b>	Sets the signal processing mode for analog input 2 (X177.29/30) on the CUD.		
<b>Value:</b>	0: Signal not controlled 1: Signal absolute value generation 2: Signal inverted 3: Signal absolute value generation inverted		
<b>p50724</b>	<b>BI: CUD analog input 2 inversion / CUD AI 2 inv</b>		
DC_CTRL	Can be changed: T	Calculated: -	Access level: 2
	Data type: Unsigned32 / Binary	Dyn. index: -	Func. diagram: 2080
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min	Max	Factory setting
	-	-	0
<b>Description:</b>	Sets the signal source for inverting the signal from analog input 2 (X177.29/30) on the CUD. 1 signal: Inversion 0 signal: No inversion		
<b>p50725</b>	<b>CUD analog input 2 smoothing time constant / CUD AI 2 T</b>		
DC_CTRL	Can be changed: U, T	Calculated: -	Access level: 2
	Data type: FloatingPoint32	Dyn. index: -	Func. diagram: 2080
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min	Max	Factory setting
	0 [ms]	10000 [ms]	0 [ms]
<b>Description:</b>	Sets the time constant for smoothing the signal from analog input 2 (X177.29/30) on the CUD.		
<b>p50726</b>	<b>BI: CUD analog input 2 signal source for enable / CUD AI 2 ena sig s</b>		
DC_CTRL	Can be changed: T	Calculated: -	Access level: 2
	Data type: Unsigned32 / Binary	Dyn. index: -	Func. diagram: 2080
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min	Max	Factory setting
	-	-	1
<b>Description:</b>	Sets the signal source for enabling analog input 2 (X177.29/30) on the CUD.		
<b>Note:</b>	1 signal: Analog input is enabled 0 signal: Analog input is disabled (value = 0%)		

<b>p50727 CUD analog input 2 simulation setpoint / CUD AI 2 sim setp</b>			
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -130.0 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> 130.0 [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 2080 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.0 [%]
<b>Description:</b>	Sets the setpoint for the simulation of analog input 2 (X177.29/30) on the CUD.		
<b>Dependency:</b>	Refer to: p50729		
<b>Note:</b>	Simulation is selected using p50729 = 1.		
<b>p50729 CUD analog input 2 simulation selection / CUD AI 2 sim sel</b>			
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1	<b>Access level:</b> 2 <b>Func. diagram:</b> 2080 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Setting to select the simulation of analog input 2 (X177.29/30) on the CUD.		
<b>Value:</b>	0:       Simulation deactivated 1:       Simulation activated		
<b>Dependency:</b>	Refer to: p50727		
<b>Note:</b>	The setpoint for the simulation is set in p50727.		
<b>p50731[0...3] Fast analog inputs scaling / Fast AI scal</b>			
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -1000.0 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> 1000.0 [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 2085, 2090 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 100.0 [%]
<b>Description:</b>	Sets the scaling for fast analog inputs "Select input 3 to 6". The value indicates the percentage value for the mapping of an input voltage of 10 V at the analog input. Example: p50731[2] = 90% --> 10 V is scaled to 90% for select input 5 --> 5 V corresponds to 45% for select input 5		
<b>Index:</b>	[0] = Select input 3 (X177.1/2) [1] = Select input 4 (X177.3/4) [2] = Select input 5 (X177.5/6) [3] = Select input 6 (X177.7/8)		
<b>Note:</b>	AI: Analog Input		
<b>p50732[0...3] Fast analog inputs offset / Fast AI offs</b>			
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -200.00 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> 200.00 [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 2085, 2090 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.00 [%]
<b>Description:</b>	Sets the offset for fast analog inputs "Select input 3 to 6".		

**Index:**  
 [0] = Select input 3 (X177.1/2)  
 [1] = Select input 4 (X177.3/4)  
 [2] = Select input 5 (X177.5/6)  
 [3] = Select input 6 (X177.7/8)

---

**p50733[0...3] Fast analog inputs signal processing / Fast AI sig**

<b>DC_CTRL</b>	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2085, 2090
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	3	0

**Description:** Sets the signal processing for fast analog inputs "Select input 3 to 6".

**Value:**  
 0: Signal not controlled  
 1: Signal absolute value generation  
 2: Signal inverted  
 3: Signal absolute value generation inverted

**Index:**  
 [0] = Select input 3 (X177.1/2)  
 [1] = Select input 4 (X177.3/4)  
 [2] = Select input 5 (X177.5/6)  
 [3] = Select input 6 (X177.7/8)

---

**p50734[0...3] BI: Fast analog inputs inversion / Fast AI inv**

<b>DC_CTRL</b>	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2085, 2090
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Sets the signal source for inverting the signals for fast analog inputs "Select input 3 to 6".  
 1 signal: Inversion  
 0 signal: No inversion

**Index:**  
 [0] = Select input 3 (X177.1/2)  
 [1] = Select input 4 (X177.3/4)  
 [2] = Select input 5 (X177.5/6)  
 [3] = Select input 6 (X177.7/8)

---

**p50735[0...3] Fast analog inputs smoothing time constant / Fast AI T**

<b>DC_CTRL</b>	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2085, 2090
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0 [ms]	10000 [ms]	0 [ms]

**Description:** Sets the time constant for smoothing the signals for fast analog inputs "Select input 3 to 6".

**Index:**  
 [0] = Select input 3 (X177.1/2)  
 [1] = Select input 4 (X177.3/4)  
 [2] = Select input 5 (X177.5/6)  
 [3] = Select input 6 (X177.7/8)

<b>p50736[0...3] BI: Signal source to enable fast analog inputs / Fast AI enable signals</b>			
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> 2085, 2090 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Sets the signal source for enabling fast analog inputs "Select input 3 to 6".		
<b>Index:</b>	[0] = Select input 3 (X177.1/2) [1] = Select input 4 (X177.3/4) [2] = Select input 5 (X177.5/6) [3] = Select input 6 (X177.7/8)		
<b>Note:</b>	1 signal: Analog input is enabled 0 signal: Analog input is disabled (value = 0%)		
<hr/>			
<b>p50737[0...3] Fast analog inputs setpoint simulation / Fast AI simulation setpoint</b>			
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -130.0 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> 130.0 [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 2085, 2090 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.0 [%]
<b>Description:</b>	Sets the setpoint for the simulation of the fast analog inputs (select input 3 ... 6).		
<b>Index:</b>	[0] = Select input 3 (X177.1/2) [1] = Select input 4 (X177.3/4) [2] = Select input 5 (X177.5/6) [3] = Select input 6 (X177.7/8)		
<b>Dependency:</b>	Refer to: p50739		
<b>Note:</b>	Simulation is selected using p50739[0...3] = 1.		
<hr/>			
<b>p50739[0...3] Fast analog inputs simulation selection / Fast AI simulation selection</b>			
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1	<b>Access level:</b> 2 <b>Func. diagram:</b> 2085, 2090 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Setting to select the simulation of the fast analog inputs (select input 3 ... 6).		
<b>Value:</b>	0: Simulation deactivated 1: Simulation activated		
<b>Index:</b>	[0] = Select input 3 (X177.1/2) [1] = Select input 4 (X177.3/4) [2] = Select input 5 (X177.5/6) [3] = Select input 6 (X177.7/8)		
<b>Dependency:</b>	Refer to: p50737		
<b>Note:</b>	The setpoint for the simulation is set in p50737[0...3].		

<b>p50741[0...n]</b>	<b>Analog input main actual value scaling / AI m act scal</b>		
DC_CTRL	<b>Can be changed:</b> C2(1), U, T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 2075
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-270.00 [V]	270.00 [V]	60.00 [V]
<b>Description:</b>	Sets the input voltage (8 - 270 V) for scaling to 100%. Rated value of the input voltage at n_max (= tachometer voltage at maximum speed). This parameter specifies the maximum speed at p50083 = 1.		
<b>Note:</b>	AI: Analog Input Example: p50741 = 60 --> 30 V is scaled to 50 % for analog input main actual value scaled --> 60 V is scaled to 100% for analog input main actual value scaled		

<b>p50742</b>	<b>Analog input main actual value offset / AI m act offs</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2075
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-200.00 [%]	200.00 [%]	0.00 [%]
<b>Description:</b>	Sets the offset for the "main actual value" (XT1.103/104).		

<b>p50743</b>	<b>Analog input main actual value signal processing / AI m act sig</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2075
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	3	0
<b>Description:</b>	Sets the mode for signal processing for the "main actual value" analog input (XT1.103/104).		
<b>Value:</b>	0: Signal not controlled 1: Signal absolute value generation 2: Signal inverted 3: Signal absolute value generation inverted		

<b>p50744</b>	<b>BI: Analog input main actual value inversion / AI m act inv</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2075
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0
<b>Description:</b>	Sets the signal source for inverting the signal from the "main actual value" analog input (XT1.103/104). 0 signal: No inversion 1 signal: Inversion		

<b>p50745</b>	<b>Analog input main actual value smoothing time constant / AI m act T</b>		
DC_CTRL	Can be changed: U, T	Calculated: -	Access level: 2
	Data type: FloatingPoint32	Dyn. index: -	Func. diagram: 2075
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min	Max	Factory setting
	0 [ms]	10000 [ms]	0 [ms]
<b>Description:</b>	Sets the time constant for smoothing the signal from the "main actual value" analog input (XT1.103/104).		
<b>p50746</b>	<b>BI: Signal source to enable analog input main actual value / AI m act ena sig s</b>		
DC_CTRL	Can be changed: T	Calculated: -	Access level: 2
	Data type: Unsigned32 / Binary	Dyn. index: -	Func. diagram: 2075
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min	Max	Factory setting
	-	-	1
<b>Description:</b>	Sets the signal source for enabling the analog input for the "main actual value (XT1.103/104).		
<b>Note:</b>	1 signal: Analog input enabled 0 signal: Analog input not enabled (r52013 = 0%).		
<b>p50747</b>	<b>Analog input main actual value setpoint simulation / AI m_actV sim setp</b>		
DC_CTRL	Can be changed: U, T	Calculated: -	Access level: 2
	Data type: FloatingPoint32	Dyn. index: -	Func. diagram: 2075
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: PERCENT	Expert list: 1
	Min	Max	Factory setting
	-130.0 [%]	130.0 [%]	0.0 [%]
<b>Description:</b>	Sets the setpoint for the simulation of the "main actual value" analog input (XT1.103/104).		
<b>Dependency:</b>	Refer to: p50749		
<b>Note:</b>	Simulation is selected using p50749 = 1.		
<b>p50749</b>	<b>Analog input main actual value simulation selection / AI m_actV sim sel</b>		
DC_CTRL	Can be changed: T	Calculated: -	Access level: 2
	Data type: Integer16	Dyn. index: -	Func. diagram: 2075
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min	Max	Factory setting
	0	1	0
<b>Description:</b>	Setting to select the simulation of the "main actual value" analog input (XT1.103/104).		
<b>Value:</b>	0: Simulation deactivated 1: Simulation activated		
<b>Dependency:</b>	Refer to: p50747		
<b>Note:</b>	The setpoint for the simulation is set in p50747.		

<b>p50750</b>	<b>CI: CUD analog output 0 signal source / CUD AO 0 sig s</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2095
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0
<b>Description:</b>	Sets the signal source for the output value at analog output 0 (X177.49/50).		
<b>Note:</b>	AO: Analog Output		

<b>p50751</b>	<b>CUD analog output 0 signal processing / CUD AO 0 sig proc</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2095
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	3	0
<b>Description:</b>	Sets the mode for signal processing at analog output 0 (X177.49/50).		
<b>Value:</b>	0: Signal not controlled 1: Signal absolute value generation 2: Signal inverted 3: Signal absolute value generation inverted		

<b>p50752</b>	<b>CUD analog output 0 smoothing time constant / CUD AO 0 T</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2095
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0 [ms]	10000 [ms]	0 [ms]
<b>Description:</b>	Sets the time constant for smoothing the signal from analog output 0 (X177.49/50).		

<b>p50753</b>	<b>CUD analog output 0 scaling / CUD AO 0 scal</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2095
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-200.00 [V]	200.00 [V]	10.00 [V]
<b>Description:</b>	Sets the scaling for analog output 0 (X177.49/50). The value indicates the output value for the mapping of an input value of 100% at the analog output.		
<b>Note:</b>	Example: p50753 = 5 V --> 100% is scaled to 5 V --> 50% corresponds to 2.5 V		



<b>p50754</b>	<b>CUD analog output 0 offset / CUD AO 0 offs</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -10.00 [V]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 10.00 [V]	<b>Access level:</b> 2 <b>Func. diagram:</b> 2095 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.00 [V]
<b>Description:</b>	Sets the offset for analog output 0 (X177.49/50).		
<b>p50755</b>	<b>CI: CUD analog output 1 signal source / CUD AO 1 sig s</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> 2095 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the signal source for the output value at analog output 1 (X177.51/52).		
<b>Note:</b>	AO: Analog Output		
<b>p50756</b>	<b>CUD analog output 1 signal processing / CUD AO 1 sig proc</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 3	<b>Access level:</b> 2 <b>Func. diagram:</b> 2095 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the mode for signal processing at analog output 1 (X177.51/52).		
<b>Value:</b>	0: Signal not controlled 1: Signal absolute value generation 2: Signal inverted 3: Signal absolute value generation inverted		
<b>p50757</b>	<b>CUD analog output 1 smoothing time constant / CUD AO 1 T</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0 [ms]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 10000 [ms]	<b>Access level:</b> 2 <b>Func. diagram:</b> 2095 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0 [ms]
<b>Description:</b>	Sets the time constant for smoothing the signal from analog output 1 (X177.51/52).		
<b>p50758</b>	<b>CUD analog output 1 scaling / CUD AO 1 scal</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -200.00 [V]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 200.00 [V]	<b>Access level:</b> 2 <b>Func. diagram:</b> 2095 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 10.00 [V]
<b>Description:</b>	Sets the scaling for analog output 1 (X177.51/52). The value indicates the output value for the mapping of an input value of 100% at the analog output.		

**Note:** Example:  
p50758 = 5 V  
--> 100% is scaled to 5 V  
--> 50% corresponds to 2.5 V

---

**p50759 CUD analog output 1 offset / CUD AO 1 offs**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2095
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-10.00 [V]	10.00 [V]	0.00 [V]

**Description:** Sets the offset for analog output 1 (X177.51/52).

---

**p50765 CUD digital inputs simulation selection / CUD DI sim sel**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2050, 2060, 2065
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0000 0000 bin

**Description:** Setting to select the simulation of the digital inputs on the CUD.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	DI 0 (X177.11)	High	Low	2050
	01	DI 1 (X177.12)	High	Low	2050
	02	DI 2 (X177.13)	High	Low	2050
	03	DI 3 (X177.14)	High	Low	2050
	04	DI 4 (X177.15)	High	Low	2060
	05	DI 5 (X177.16)	High	Low	2060
	06	DI 6 (X177.17)	High	Low	2065
	07	DI 7 (X177.18)	High	Low	2065

**Dependency:** Refer to: p50766

**Note:** The setpoint for the simulation is set in p50766.0...7.

---

**p50766 CUD digital inputs simulation setpoint / CUD DI simul setp**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2050, 2060, 2065
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0000 0000 bin

**Description:** Sets the setpoint for the simulation of the digital inputs on the CUD.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	DI 0 (X177.11)	High	Low	2050
	01	DI 1 (X177.12)	High	Low	2050
	02	DI 2 (X177.13)	High	Low	2050
	03	DI 3 (X177.14)	High	Low	2050
	04	DI 4 (X177.15)	High	Low	2060
	05	DI 5 (X177.16)	High	Low	2060
	06	DI 6 (X177.17)	High	Low	2065
	07	DI 7 (X177.18)	High	Low	2065

**Dependency:** Refer to: p50765

**Note:** Simulation is selected using p50765.0...7 = 1.

<b>p50770[0...3]</b>	<b>CUD digital outputs inversion / CUD DO inv</b>		
DC_CTRL	Can be changed: U, T Data type: Integer16 P-Group: - Not for motor type: - Min 0	Calculated: - Dyn. index: - Units group: - Scaling: - Max 1	Access level: 2 Func. diagram: 2055 Unit selection: - Expert list: 1 Factory setting 0
<b>Description:</b>	Setting to invert the signals at the CUD's digital outputs.		
<b>Value:</b>	0: Not inverted 1: Inverted		
<b>Index:</b>	[0] = DO 0 (X177.19) [1] = DO 1 (X177.20) [2] = DO 2 (X177.21) [3] = DO 3 (X177.22)		
<b>Note:</b>	DO: Digital Output		
<b>p50771</b>	<b>BI: CUD digital output 0 signal source / CUD DO 0 sig s</b>		
DC_CTRL	Can be changed: U, T Data type: Unsigned32 / Binary P-Group: - Not for motor type: - Min -	Calculated: - Dyn. index: - Units group: - Scaling: - Max -	Access level: 2 Func. diagram: 2055 Unit selection: - Expert list: 1 Factory setting 0
<b>Description:</b>	Sets the signal source for digital output 0 (X177.19) on the CUD.		
<b>p50772</b>	<b>BI: CUD digital output 1 signal source / CUD DO 1 sig s</b>		
DC_CTRL	Can be changed: U, T Data type: Unsigned32 / Binary P-Group: - Not for motor type: - Min -	Calculated: - Dyn. index: - Units group: - Scaling: - Max -	Access level: 2 Func. diagram: 2055 Unit selection: - Expert list: 1 Factory setting 0
<b>Description:</b>	Sets the signal source for digital output 1 (X177.20) on the CUD.		
<b>p50773</b>	<b>BI: CUD digital output 2 signal source / CUD DO 2 sig s</b>		
DC_CTRL	Can be changed: U, T Data type: Unsigned32 / Binary P-Group: - Not for motor type: - Min -	Calculated: - Dyn. index: - Units group: - Scaling: - Max -	Access level: 2 Func. diagram: 2055 Unit selection: - Expert list: 1 Factory setting 0
<b>Description:</b>	Sets the signal source for digital output 2 (X177.21) on the CUD.		
<b>p50774</b>	<b>BI: CUD digital output 3 signal source / CUD DO 3 sig s</b>		
DC_CTRL	Can be changed: U, T Data type: Unsigned32 / Binary P-Group: - Not for motor type: - Min -	Calculated: - Dyn. index: - Units group: - Scaling: - Max -	Access level: 2 Func. diagram: 2055 Unit selection: - Expert list: 1 Factory setting 0
<b>Description:</b>	Sets the signal source for digital output 3 (X177.22) on the CUD.		

<b>p50775</b>	<b>CUD digital output 0 delay time / CUD DO 0 t_del</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0 [ms]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 10000 [ms]	<b>Access level:</b> 2 <b>Func. diagram:</b> 2055 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0 [ms]
<b>Description:</b>	Sets the delay time for digital output 0 (X177.19) on the CUD.		
<b>Note:</b>	The level at the digital output can only change if the changed internal level remains constant for longer than the set delay time.		
<b>p50776</b>	<b>CUD digital output 1 delay time / CUD DO 1 t_del</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0 [ms]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 10000 [ms]	<b>Access level:</b> 2 <b>Func. diagram:</b> 2055 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0 [ms]
<b>Description:</b>	Sets the delay time for digital output 1 (X177.20) on the CUD.		
<b>Note:</b>	The level at the digital output can only change if the changed internal level remains constant for longer than the set delay time.		
<b>p50777</b>	<b>CUD digital output 2 delay time / CUD DO 2 t_del</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0 [ms]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 10000 [ms]	<b>Access level:</b> 2 <b>Func. diagram:</b> 2055 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0 [ms]
<b>Description:</b>	Sets the delay time for digital output 2 (X177.21) on the CUD.		
<b>Note:</b>	The level at the digital output can only change if the changed internal level remains constant for longer than the set delay time.		
<b>p50778</b>	<b>CUD digital output 3 delay time / CUD DO 3 t_del</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0 [ms]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 10000 [ms]	<b>Access level:</b> 2 <b>Func. diagram:</b> 2055 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0 [ms]
<b>Description:</b>	Sets the delay time for digital output 3 (X177.22) on the CUD.		
<b>Note:</b>	The level at the digital output can only change if the changed internal level remains constant for longer than the set delay time.		
<b>p50780[0...3]</b>	<b>CUD digital inputs/outputs inversion / CUD DI/DO inv</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1	<b>Access level:</b> 2 <b>Func. diagram:</b> 2060, 2065 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Setting to invert the signals at the CUD's digital outputs.		

**Value:** 0: Not inverted  
1: Inverted

**Index:** [0] = DI/DO 4 (X177.15)  
[1] = DI/DO 5 (X177.16)  
[2] = DI/DO 6 (X177.17)  
[3] = DI/DO 7 (X177.18)

**Dependency:** The terminal must be set as an output (p50789[0 to 3]).  
Refer to: p50789

**Note:** DI/DO: Bidirectional Digital Input/Output

---

**p50781 BI: CUD digital input/output 4 signal source / CUD DI/DO 4 sig s**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2060
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Sets the signal source for digital input/output 4 (X177.15) on the CUD.

**Dependency:** The terminal must be set as an output (p50789[0] = 1).  
Refer to: p50789

---

**p50782 BI: CUD digital input/output 5 signal source / CUD DI/DO 5 sig s**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2060
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Sets the signal source for digital input/output 5 (X177.16) on the CUD.

**Dependency:** The terminal must be set as an output (p50789[1] = 1).  
Refer to: p50789

---

**p50783 BI: CUD digital input/output 6 signal source / CUD DI/DO 6 sig s**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2065
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Sets the signal source for digital input/output 6 (X177.17) on the CUD.

**Dependency:** The terminal must be set as an output (p50789[2] = 1).  
Refer to: p50789

---

**p50784 BI: CUD digital input/output 7 signal source / CUD DI/DO 7 sig s**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2065
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Sets the signal source for digital input/output 7 (X177.18) on the CUD.

**Dependency:** The terminal must be set as an output (p50789[3] = 1).  
Refer to: p50789

<b>p50785</b>	<b>CUD digital input/output 4 delay time / CUD DI/DO 4 t_del</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0 [ms]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 10000 [ms]	<b>Access level:</b> 2 <b>Func. diagram:</b> 2060 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0 [ms]
<b>Description:</b>	Sets the delay time for digital input/output 4 (X177.15) on the CUD.		
<b>Dependency:</b>	The terminal must be set as an output (p50789[0] = 1). Refer to: p50789		
<b>Note:</b>	The level at the digital output can only change if the changed internal level remains constant for longer than the set delay time.		
<b>p50786</b>	<b>CUD digital input/output 5 delay time / CUD DI/DO 5 t_del</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0 [ms]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 10000 [ms]	<b>Access level:</b> 2 <b>Func. diagram:</b> 2060 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0 [ms]
<b>Description:</b>	Sets the delay time for digital input/output 5 (X177.16) on the CUD.		
<b>Dependency:</b>	The terminal must be set as an output (p50789[1] = 1). Refer to: p50789		
<b>Note:</b>	The level at the digital output can only change if the changed internal level remains constant for longer than the set delay time.		
<b>p50787</b>	<b>CUD digital input/output 6 delay time / CUD DI/DO 6 t_del</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0 [ms]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 10000 [ms]	<b>Access level:</b> 2 <b>Func. diagram:</b> 2065 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0 [ms]
<b>Description:</b>	Sets the delay time for digital input/output 6 (X177.17) on the CUD.		
<b>Dependency:</b>	The terminal must be set as an output (p50789[2] = 1). Refer to: p50789		
<b>Note:</b>	The level at the digital output can only change if the changed internal level remains constant for longer than the set delay time.		
<b>p50788</b>	<b>CUD digital input/output 7 delay time / CUD DI/DO 7 t_del</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0 [ms]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 10000 [ms]	<b>Access level:</b> 2 <b>Func. diagram:</b> 2065 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0 [ms]
<b>Description:</b>	Sets the delay time for digital input/output 7 (X177.18) on the CUD.		
<b>Dependency:</b>	The terminal must be set as an output (p50789[3] = 1). Refer to: p50789		
<b>Note:</b>	The level at the digital output can only change if the changed internal level remains constant for longer than the set delay time.		

<b>p50789[0...3] CUD digital inputs/outputs type / CUD DI/DO typ</b>			
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1	<b>Access level:</b> 2 <b>Func. diagram:</b> 2060, 2065 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the type for the digital inputs/outputs on the CUD.		
<b>Value:</b>	0: Input 1: Output		
<b>Index:</b>	[0] = DI/DO 4 (X177.15) [1] = DI/DO 5 (X177.16) [2] = DI/DO 6 (X177.17) [3] = DI/DO 7 (X177.18)		
<b>Note:</b>	DI/DO: Bidirectional Digital Input/Output		
<hr/>			
<b>p50790 P2P IF operating mode / P2P op mode</b>			
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 6	<b>Access level:</b> 2 <b>Func. diagram:</b> 9300 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the operating mode for the peer-to-peer interface (P2P IF).		
<b>Value:</b>	0: No function 5: Peer-to-peer communication 6: Communication with SIMOREG CCP		
<b>Note:</b>	P2P IF: Peer-to-peer interface CCP: Converter Commutation Protector		
<hr/>			
<b>p50791 P2P IF number of data words / P2P num words</b>			
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 1	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 5	<b>Access level:</b> 2 <b>Func. diagram:</b> 9300 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 5
<b>Description:</b>	Sets the number of words to be transmitted for the peer-to-peer interface (P2P IF) in "Peer-to-peer communication" mode (p50790 = 5).		
<b>Dependency:</b>	Refer to: p50790		
<hr/>			
<b>p50793 P2P IF baud rate / P2P baud rate</b>			
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 1	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 13	<b>Access level:</b> 2 <b>Func. diagram:</b> 9300 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 13
<b>Description:</b>	Sets the baud rate for the peer-to-peer interface (P2P IF).		
<b>Value:</b>	1: 300 baud 2: 600 baud 3: 1200 baud 4: 2400 baud		

5: 4800 baud  
 6: 9600 baud  
 7: 19200 baud  
 8: 38400 baud  
 9: 56700 baud  
 11: 93750 baud  
 13: 187500 baud

---

**p50794[0...4] CI: P2P IF transmit data signal source / P2P tr data sig s**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9300
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> 4000H	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Sets the signal source for the data to be transmitted on the peer-to-peer interface (P2P IF).  
 The transmit data is displayed in r50813[0 to 4].

**Index:**  
 [0] = Word 1  
 [1] = Word 2  
 [2] = Word 3  
 [3] = Word 4  
 [4] = Word 5

**Dependency:** Refer to: r50813

---

**p50795 P2P/CCP bus terminator / P2P/CCP bus term**

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6970, 9300
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	1	0

**Description:** Sets the bus terminator for the peer-to-peer interface and the interface to the SIMOREG CCP.

**Value:**  
 0: OFF  
 1: ON

**Note:** CCP: Converter Commutation Protector  
 P2P: Peer-to-Peer interface

---

**p50797 P2P IF telegram monitoring time / P2P t\_telegr mon**

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9300
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0.000 [s]	65.000 [s]	0.000 [s]

**Description:** Sets the telegram monitoring time for the peer-to-peer interface (P2P IF).  
 The time set is only effective in "Peer-to-peer interface" operating mode (p50790 = 5).  
 p50797 = 0:  
 Monitoring is de-activated.  
 p50797 > 0:  
 Monitoring is activated.  
 As well as one valid telegram being received, the next valid telegram must be received within the set time. Otherwise, fault F60012 is triggered.



**Note:** Telegram monitoring is activated in the following cases:

- From receipt of the first error-free telegram
- After switching on of the electronics power supply
- From receipt of the first error-free telegram after telegram monitoring has responded (i.e. telegram monitoring timeout).

The telegram monitoring time (p50797) depends on the baud rate set (p50793) The following minimum setting values are recommended for safe operation:

- 300 baud --> p50797 = 0.520 s (recommended minimum value)
- 600 baud --> p50797 = 0.260 s (recommended minimum value)
- 1200 baud --> p50797 = 0.140 s (recommended minimum value)
- 2400 baud --> p50797 = 0.080 s (recommended minimum value)
- 4800 baud --> p50797 = 0.040 s (recommended minimum value)

If the "Automatic restart" function (p50086b > 0) has been selected on the peer-to-peer communication partner, only a parameter setting p50797 > p50086 (on the communication partner) will be meaningful.

<b>p50798</b>	<b>BI: P2P IF signal source for triggering F60012 / P2P F60012 sig s</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9300
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	53300.0

**Description:** Sets the signal source for triggering fault F60012 "Telegram monitoring timeout".

<b>r50799[0...8]</b>	<b>P2P/CCP diagnostics / P2P/CCP diag</b>		
DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6970, 9300
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the diagnostic information for the peer-to-peer interface and the interface to SIMOREG CCP.

**Index:**

- [0] = Number of error-free telegrams
- [1] = Number of erroneous telegrams
- [2] = Number of byte frame errors
- [3] = Number of overrun errors
- [4] = Number of parity errors
- [5] = Number of STX errors
- [6] = Number of block check errors
- [7] = Number of break errors
- [8] = Number of timeout errors

**Note:** The fault frequency is recorded with free-running counters; when a counter reaches 65535 it is reset to 0.  
The diagnostic information in indexes 5, 6 and 8 is irrelevant for communication with SIMOREG CCP (p50790 = 6).  
Possible causes for STX errors:

- Non-observance of start interval before STX
- STX incorrect, i.e. not equal to 02

Possible causes for timeout errors:

- Telegram monitoring timeout (p50797)

**r50813[0...4] P2P IF transmit data display / P2P tr data disp**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9300
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the transmit data for the peer-to-peer interface (P2P IF).  
The signal source for the data to be transmitted is set via connector input p50794[0 to 4].

**Index:** [0] = Word 1  
[1] = Word 2  
[2] = Word 3  
[3] = Word 4  
[4] = Word 5

**Dependency:** Refer to: p50794

**p50816 BI: P2P IF receive enable signal source / P2P rcv ena sig s**

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9300
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	1

**Description:** Sets the signal source to enable data to be received on the peer-to-peer interface (P2P IF).  
1 signal: Data receive enabled  
0 signal: Data receive not enabled

**p50817 BI: P2P IF transmit enable signal source / P2P tr ena sig s**

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9300
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	1

**Description:** Sets the signal source to enable data to be transmitted on the peer-to-peer interface (P2P IF).  
1 signal: Data transmission enabled  
0 signal: Data transmission not enabled

**p50820 PPI/USS bus terminator / PPI/USS bus term**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2410
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	1	1

**Description:** Sets the bus terminator for the RS485 interface (PPI/USS, X178).

**Value:** 0: OFF  
1: ON

**r50823[0...1]      Electronic power supply voltage display / Electr supp V disp**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8048
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> p2001	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [V]	- [V]	- [V]
<b>Description:</b>	Displays the voltages for the electronic power supply.		
<b>Index:</b>	[0] = P10 (+10 V) [1] = N10 (-10 V)		
<b>Dependency:</b>	Refer to: r50824		
<b>Note:</b>	For r50823[0]: A voltage value outside the permissible limits will trigger fault F60091. For r50823[1]: A voltage value outside the permissible limits will trigger fault F60092.		

**r50824      Electronic power supply failure duration / Electr supp t\_fail**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8048
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [ms]	- [ms]	- [ms]
<b>Description:</b>	Displays the failure duration for the electronic power supply.		
<b>Dependency:</b>	Refer to: r50823		

**r50825[0...29]      Armature power unit compensation values / PU arm comp val**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8054
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays the compensation values for the armature power unit.		

**r50826[0...15]      Field power unit compensation values / PU field comp val**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8054
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays the compensation values for the field power unit.		

---

**r50827 Internal diagnostics / Int diag**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8060
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the counter reading for internal errors.

---

**r50829[0...55] CUD compensation values / CUD comp val**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8054
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the compensation values for the analog inputs/outputs on the Control Unit DC MASTER (CUD).

**Note:**

Analog input 0 - X177.25/26 - voltage input  
[0] = Compensation value at 0 V  
[1] = Compensation value at +10 V  
[2] = Compensation value at -10 V  
[3] = Compensation value at reference value  
Analog input 0 - X177.25/26 - current input  
[4] = Compensation value at 0 mA  
[5] = Compensation value at +20 mA  
[6] = Compensation value at -20 mA  
[7] = Compensation value at reference value  
Analog input 1 - X177.27/28 - voltage input  
[8] = Compensation value at 0 V  
[9] = Compensation value at +10 V  
[10] = Compensation value at -10 V  
[11] = Compensation value at reference value  
Analog input 1 - X177.27/28 - current input  
[12] = Compensation value at 0 mA  
[13] = Compensation value at +20 mA  
[14] = Compensation value at -20 mA  
[15] = Compensation value at reference value  
Analog input 2 - X177.29/30  
[16] = Compensation value at 0 V  
[17] = Compensation value at +10 V  
[18] = Compensation value at -10 V  
[19] = Compensation value at reference value  
Analog input XT1.103/104 - 25 V  
[20] = Compensation value at 0 V  
[21] = Compensation value at +25 V  
[22] = Compensation value at -25 V  
[23] = Compensation value at reference value  
Analog input XT1.103/104 - 80 V  
[24] = Compensation value at 0 V  
[25] = Compensation value at +80 V  
[26] = Compensation value at -80 V  
[27] = Compensation value at reference value  
Analog input XT1.103/104 - 270 V  
[28] = Compensation value at 0 V  
[29] = Compensation value at +270 V  
[30] = Compensation value at -270 V  
[31] = Compensation value at reference value  
Analog input 3 - X177.1/2  
[32] = Compensation value at 0 V  
[33] = Compensation value at +10 V  
[34] = Compensation value at -10 V  
[35] = Compensation value at reference value  
Analog input 4 - X177.3/4  
[36] = Compensation value at 0 V  
[37] = Compensation value at +10 V  
[38] = Compensation value at -10 V  
[39] = Compensation value at reference value

Analog input 5 - X177.5/6

[40] = Compensation value at 0 V

[41] = Compensation value at +10 V

[42] = Compensation value at -10 V

[43] = Compensation value at reference value

Analog input 6 - X177.7/8

[44] = Compensation value at 0 V

[45] = Compensation value at +10 V

[46] = Compensation value at -10 V

[47] = Compensation value at reference value

Analog output 0 - X177.49/50

[48] = Compensation value for 0 V

[49] = Compensation value for +10 V

[50] = Compensation value for -10 V

[51] = Compensation value for reference value

Analog output 1 - X177.51/52

[52] = Compensation value for 0 V

[53] = Compensation value for +10 V

[54] = Compensation value for -10 V

[55] = Compensation value for reference value

The compensation values for analog outputs 0 and 1, as well as for analog inputs 3 to 6, are calculated from the measurement result + an offset of 32768.

<b>p50830 Thyristor diagnostics mode / Thyr_diag mode</b>			
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 3	<b>Access level:</b> 2 <b>Func. diagram:</b> 6865 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the thyristor diagnostics mode. Value = 0: The thyristor test is de-activated. Value = 1: The thyristors are tested when first switching on or jogging after the electronics power supply has been switched on. Value = 2: The thyristors are tested at each switch-on or jogging. Value = 3: The thyristors are tested at the next switch-on or jogging. p50830 is set to 0 if the test was completed error-free.		
<b>Value:</b>	0: Switched off 1: After the first ON command 2: After each ON command 3: After next ON command		
<b>Note:</b>	The thyristor test function cannot be used when supplying extremely high inductances (e.g. when supplying a field from armature terminals, supplying solenoids, etc.) and must be de-activated (p50830 = 0).		

<b>p50831 Diagnostics log trace control word / Trace STW</b>			
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 2	<b>Access level:</b> 3 <b>Func. diagram:</b> 8052 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the trigger resolution for the trace.		

**Value:**

0:	No trigger for start
1:	Start immediately
2:	Start together with STARTER trace

---

**p50832      Diagnostics log copy recording file to memory card / Copy diag file**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8052
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	2	0

**Description:** Setting for starting the procedure to copy the diagnostics file to the memory card.

**Value:**

0:	Inactive
1:	Start copying procedure
2:	Copy file into User\Data folder

**Note:** The value is reset automatically at the end of the copying procedure.  
If a diagnostics file is empty, the file written to the memory card will also be empty.  
This file will overwrite any existing file on the memory card.

---

**p50833      Device fan test / Dev fan test**

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8047
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	1	0

**Description:** Setting to test the device fans.

**Value:**

0:	Stop fan
1:	Start fan

**Dependency:** Refer to: r53135

**Note:** The status of the fans is displayed in binector outputs r53135.8 to 11.

---

**r50836[0...3]      Voltage sensing communication error counter / V\_sens comm\_err**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8054
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the communication error for armature and field voltage sensing.

**Index:**

[0]	= Number of CRC errors armature
[1]	= Number of communication errors armature
[2]	= Number of CRC errors field
[3]	= Number of communication errors field

---

**p50837[0...11]      Reset thyristor load data / Thyr\_load reset**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	1	0

**Description:** Setting to reset the thyristor load data for a thyristor.

**Value:** 0: Do not reset data  
1: Reset data

**Index:** [0] = Thyristor X11  
[1] = Thyristor X12  
[2] = Thyristor X13  
[3] = Thyristor X14  
[4] = Thyristor X15  
[5] = Thyristor X16  
[6] = Thyristor X21  
[7] = Thyristor X22  
[8] = Thyristor X23  
[9] = Thyristor X24  
[10] = Thyristor X25  
[11] = Thyristor X26

**Note:** It is only permissible to reset the thyristor load data after a thyristor has been replaced.

---

#### **p50838[0...2]    Diagnostics memory message number / Diag\_mem msg\_no**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8052
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 60000	<b>Max</b> 60999	<b>Factory setting</b> 60000

**Description:** Sets message numbers for the diagnostics memory.  
A trace is saved in the diagnostics file if one of these messages occurs.

---

#### **r50840[0...31]    Gating module serial number / Gate\_mod ser\_no.**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned8	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6960
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> -

**Description:** Displays the serial number of the gating module.  
For the Control Module, the serial number of the voltage sensing module is displayed.  
r50840[0]: Serial number character 1  
...  
r50840[31]: Serial number character 32  
For the commissioning software, the ASCII characters are displayed uncoded.

**Note:** An ASCII table (excerpt) can be found, for example, in the appendix to the List Manual.

---

#### **r50841[0...31]    Gating module part number / Gat\_mod part no.**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned8	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6960
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> -

**Description:** Displays the part number of the gating module.  
For the Control Module, the part number of the voltage sensing module is displayed.  
r50841[0]: Part number character 1  
...  
r50841[31]: Part number character 32  
For the commissioning software, the ASCII characters are displayed uncoded.

**Note:** An ASCII table (excerpt) can be found, for example, in the appendix to the List Manual.



<b>r50842[0...31]      Field module serial number / Field mod ser no.</b>			
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> Unsigned8 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 1 <b>Func. diagram:</b> 6960 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the serial number of the field module.		
<b>Note:</b>	The individual digits of the number are displayed in ASCII code in the indices. An ASCII table (excerpt) can be found, for example, in the appendix to the List Manual.		
<hr/>			
<b>r50843[0...31]      Field module part number / Field mod part no.</b>			
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> Unsigned8 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 1 <b>Func. diagram:</b> 6960 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the part number of the field module.		
<b>Note:</b>	The individual digits of the number are displayed in ASCII code in the indices. An ASCII table (excerpt) can be found, for example, in the appendix to the List Manual.		
<hr/>			
<b>p50899[0...6]      Control blocks activation / Ctrl blocks act</b>			
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1	<b>Access level:</b> 3 <b>Func. diagram:</b> 1721 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Setting to activate/de-activate control blocks. Index 0 (FP3130): The switch-on command and the intervention of r0807.0 and r53010.2 are always active. Index 2 (FP6810): The "speed actual value selection" is always active.		
<b>Value:</b>	0:      Control block de-activated 1:      Control block activated		
<b>Index:</b>	[0] = Speed setpoint processing (FP3105 to FP3135) [1] = RFG (FP3150 to FP3155) [2] = Closed-loop speed control (FP6800 to FP6820) [3] = Torque limiting/Current limitation (FP6825 to FP6845, FP8040) [4] = Closed-loop armature current control (FP6852 to FP6855) [5] = EMF setpoint processing and control (FP6900) [6] = Closed-loop field current control (FP6905 to FP6910)		
<b>Note:</b>	This parameter is only evaluated once while powering up, i.e. a change only becomes effective after POWER ON or after powering up with saved parameters (p0976 = 11).  The ability to de-activate control function blocks has been designed for users who set up their own control configurations using Drive Control Chart (DCC) (e.g. synchronous generator field winding instead of running a motor). De-activating control function blocks which are not needed frees up CPU time for the DCC blocks.		

**r50960[0...4]     Device fan operating hours display / Dev\_fan h disp**

DC\_CTRL

**Can be changed:** -**Calculated:** -**Access level:** 1**Data type:** FloatingPoint32**Dyn. index:** -**Func. diagram:** 8045**P-Group:** -**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** -**Expert list:** 1**Min****Max****Factory setting**

- [h]

- [h]

- [h]

**Description:** Displays the operating hours for the device fan.**Index:**

[0] = Fan terminal XV1  
 [1] = Fan terminal XV2  
 [2] = Fan terminal XV3  
 [3] = Fan terminal XV4  
 [4] = Fan ON

**Dependency:** Refer to: p50961, p50962**Note:** The operating hours from "fan on" are only increased for the Control Module.**p50961[0...4]     Device fan service life / Dev\_fan serv life**

DC\_CTRL

**Can be changed:** U, T**Calculated:** -**Access level:** 2**Data type:** FloatingPoint32**Dyn. index:** -**Func. diagram:** 8045**P-Group:** -**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** -**Expert list:** 1**Min****Max****Factory setting**

0 [h]

1000000 [h]

[0...3] 30000 [h]

[4] 0 [h]

**Description:** Sets the service life for the device fan.**Index:**

[0] = Fan terminal XV1  
 [1] = Fan terminal XV2  
 [2] = Fan terminal XV3  
 [3] = Fan terminal XV4  
 [4] = Fan ON

**Dependency:** Refer to: r50960, p50962**Note:** An appropriate alarm is issued 500 hours before the set service life expires.**p50962[0...4]     Device fan reset operating hours / Dev\_fan reset h**

DC\_CTRL

**Can be changed:** T**Calculated:** -**Access level:** 2**Data type:** Integer16**Dyn. index:** -**Func. diagram:** 8045**P-Group:** -**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** -**Expert list:** 1**Min****Max****Factory setting**

0

1

0

**Description:** Setting to reset the operating hours of the device fan that have accumulated.**Value:**

0: Inactive  
 1: Reset

**Index:**

[0] = Fan terminal XV1  
 [1] = Fan terminal XV2  
 [2] = Fan terminal XV3  
 [3] = Fan terminal XV4  
 [4] = Fan ON

**Dependency:** Refer to: r50960, p50961**Note:** Procedure to reset the operating hours:

Set p50962[x] = 1

The parameter is automatically set to zero after this is done.

<b>p51117[0...15]</b>	<b>BI: Binector-connector converter signal source / Bin/con sig s</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9300
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0
<b>Description:</b>	Sets the signal sources for the binector inputs on the binector-connector converter.		
<b>Dependency:</b>	Refer to: r52620		

<b>p51118</b>	<b>Invert binector-connector converter signals / Bin/con sig inv</b>				
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2		
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9300		
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -		
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1		
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>		
	-	-	0000 0000 0000 0000 bin		
<b>Description:</b>	Setting to invert the individual binector inputs of the binector connector converter.				
<b>Bit field:</b>	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>	<b>FP</b>
	00	BI p51117[0]	Inverted	Not inverted	-
	01	BI p51117[1]	Inverted	Not inverted	-
	02	BI p51117[2]	Inverted	Not inverted	-
	03	BI p51117[3]	Inverted	Not inverted	-
	04	BI p51117[4]	Inverted	Not inverted	-
	05	BI p51117[5]	Inverted	Not inverted	-
	06	BI p51117[6]	Inverted	Not inverted	-
	07	BI p51117[7]	Inverted	Not inverted	-
	08	BI p51117[8]	Inverted	Not inverted	-
	09	BI p51117[9]	Inverted	Not inverted	-
	10	BI p51117[10]	Inverted	Not inverted	-
	11	BI p51117[11]	Inverted	Not inverted	-
	12	BI p51117[12]	Inverted	Not inverted	-
	13	BI p51117[13]	Inverted	Not inverted	-
	14	BI p51117[14]	Inverted	Not inverted	-
	15	BI p51117[15]	Inverted	Not inverted	-
<b>Dependency:</b>	Refer to: p51117, r52620				
<b>Note:</b>	BI: Binector Input				

<b>r51560[0...1]</b>	<b>CCP software version / CCP SW version</b>		
DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6970
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays the software version for the Converter Commutation Protector (CCP). Index 0: CCP software version Index 1: Version of the CCP boot sector software		

**r51569[0...15] CCP serial number / CCP ser no.**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned8	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6970
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the serial number of the Converter Commutation Protector (CCP).

**Note:** The individual digits of the number are displayed in ASCII code in the indices.  
An ASCII table (excerpt) can be found, for example, in the appendix to the List Manual.

**r51570 CCP order number / CCP Order No.**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6970
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	254	-

**Description:** Displays the order number (MLFB) of the connected Converter Commutation Protector (CCP).

**Value:**  
 0: No CCP connected  
 250: 6RA7085-6FC00-0  
 251: 6RA7091-6FC00-0  
 252: 6RA7095-6FC00-0  
 253: 6RA7090-6KC00-0  
 254: 6RA7095-6KC00-0

**r51571 CCP rated supply voltage / CCP V<sub>rated</sub>**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6970
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [V]	- [V]	- [V]

**Description:** Displays the rated supply voltage according to the rating plate of the Converter Commutation Protector (CCP).

**r51572 CCP rated current / CCP I<sub>rated</sub>**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6970
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [A]	- [A]	- [A]

**Description:** Displays the rated current according to the rating plate of the Converter Commutation Protector (CCP).

**r51574.0...12 CO/BO: CCP state / CCP state**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6970
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Display and connector output for the state of the Converter Commutation Protector (CCP).

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Voltage at U, V, W ok	Yes	No	6970
	01	Voltage at C - D greater than +100 V	Yes	No	6970
	02	Voltage at C - D less than -100 V	Yes	No	6970
	03	Turn-off capacitors have reached the set-point voltage	Yes	No	6970
	04	Turn-off in progress	Yes	No	6970
	05	Connection between parallel CCPs OK	Yes	No	6970
	08	Connector X165_2 (at DCM) is connected with X165 (at CCP)	Yes	No	6970
	09	I2t value voltage limiting chopper 1 too high	Yes	No	6970
	10	I2t value voltage limiting chopper 2 too high	Yes	No	6970
	11	Memory for technical data for CCP OK	Yes	No	6970
	12	Chopper capacitors pre-charging completed	Yes	No	6970

---

**r51575 CO: CCP I2t value voltage limiting chopper 1 / CCP I2t chopper 1**


---

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6970
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]

**Description:** Displays the I2t value for the voltage limiting chopper 1 for Converter Commutation Protector (CCP).

---

**r51576 CO: CCP I2t value voltage limiting chopper 2 / CCP I2t chopper 2**


---

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6970
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]

**Description:** Displays the I2t value for the voltage limiting chopper 2 for Converter Commutation Protector (CCP).

---

**p51577 CCP chopper voltage setpoint response threshold upper / CCP V\_set thr up**


---

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6970
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	850 [V]	2900 [V]	1600 [V]

**Description:** Sets the upper response threshold of the voltage limiter implemented in the CCP.  
During the turn-off operation of the CCP when reducing the armature current, this limits the counter voltage that is created - and which is also necessary - to a non-hazardous value for the basic device and for the associated CCP.

**Note:** CCP: Converter Commutation Protector

The parameter is set automatically during the "optimization run for CCP" (p50051 = 30).

The correct setting of this parameter can be taken from the following reference:

SIMOREG CCP Operating Instructions

<b>p51578 CCP turn-off capacitors pre-charging voltage setpoint / C pre-ch V_set</b>				
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3	
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6970	
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -	
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1	
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>	
	145 [V]	830 [V]	145 [V]	
<b>Description:</b>	Sets the minimum charging voltage required for the turn-off capacitors used in the CCP to successfully turn off the thyristors. This value is used as setpoint for the two-level controller, which precharges the turn-off capacitors from the line supply. The maximum pre-charging voltage that can be reached is limited by the average rectified value of the line voltage that is actually connected.			
<b>Note:</b>	CCP: Converter Commutation Protector The parameter is set automatically during the "optimization run for CCP" (p50051 = 30). The correct setting of this parameter can be taken from the following reference: SIMOREG CCP Operating Instructions			
<hr/>				
<b>r51579.0...7 CO/BO: CCP command / CCP command</b>				
DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3	
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6970	
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -	
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1	
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>	
	-	-	-	
<b>Description:</b>	Display and connector output for the command from the SINAMICS DCM to the SIMOREG CCP.			
<b>Bit field:</b>	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>
	00	Firing the turn-off thyristors	Yes	No
	01	Line voltage (armature) in the tolerance range	Yes	No
	02	CCP connected to the parallel switching master	Yes	No
	03	Line contactor ON	Yes	No
	04	Torque direction I active	Yes	No
	05	Torque direction II active	Yes	No
	06	Reserved (always 1)	Yes	No
	07	Reserved (always 1)	Yes	No
<b>Note:</b>	CCP: Converter Commutation Protector			
<hr/>				
<b>p51580 Commutation monitoring control word / Commut_monit STW</b>				
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3	
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6865	
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -	
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1	
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>	
	-	-	0111 bin	
<b>Description:</b>	Sets the criterion to detect a commutation failure for the commutation monitoring. 3 decision criteria are available in order to identify commutation failure. For test purposes, these criteria can be individually set using these parameters.			

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Criterion 1 (signal from thyristor blocking voltage)	Yes	No	6865
	01	Criterion 2 (curvature of the current cusp)	Yes	No	6865
	02	Criterion 3 (amplitude of the current actual value)	Yes	No	6865

**Note:** The converter commutation is continuously monitored.  
If a commutation failure is detected, fault F60030 is initiated and thyristor turn-off is initiated by the CCP (if available).  
Re bit 00, 01:  
These criteria are only effective if a CCP (Converter Commutation Protector) is being used.

---

### p51583 CCP test turn-off command / CCP turn-off cmnd

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6970
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	2	0

**Description:** Setting to issue a turn-off command to the Converter Commutation Protector (CCP) for test purposes.

**Value:**  
0: No turn-off cmnd  
1: Issue in torque direction I  
2: Issue in torque direction II

**Notice:** After a turn-off command is issued to the CCP, this parameter automatically returns to the value 0.

**Note:** If the test command is issued in operation (i.e. in operating state o0.1 or o0.2), then the turn-off operation of the SIMOREG CCP acts on the thyristor bridge that is presently enabled. This is independent of whether the turn-off command is issued in torque direction I or II.

---

### p51591[0...n] Armature inductance reduction factor / L\_armat red fact

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6854
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	10 [%]	100 [%]	100 [%]

**Description:** Sets the reduction factor for the current-dependent armature inductance.

At 100% motor rated current (p50100), the armature inductance is lower than it is at armature current 0 by this factor.

**Dependency:** Refer to: p50111

**Note:** The parameter is set automatically during the "Optimization run for pre-control and the current controller for the armature converter" (p50051 = 25).

---

### p51592[0...n] Armature commutating inductance / Arm Lk

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6854
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0.0 [mH]	1000.0 [mH]	0.0 [mH]

**Description:** Sets the commutating inductance in the armature circuit.

<b>p51594[0...n]</b>	<b>Interphase inductance in 12-pulse operation / L_intph 12-pulse</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6854
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0.0 [mH]	<b>Max</b> 1000000.0 [mH]	<b>Factory setting</b> 0.0 [mH]
<b>Description:</b>	Sets the inductance of the interphase transformer in 12-pulse operation (two 6-pulse thyristor bridge circuits connected in parallel).		
<b>Dependency:</b>	Refer to: p51595		
<b>Note:</b>	The parameter is set automatically during the "Optimization run for pre-control and the current controller for the armature converter" (p50051 = 25).		
<b>p51595[0...n]</b>	<b>Interphase inductance reduction factor / L_intph red fact</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6854
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 10 [%]	<b>Max</b> 100 [%]	<b>Factory setting</b> 100 [%]
<b>Description:</b>	Sets the reduction factor for the current-dependent interphase inductance. At 100% motor rated current (p50100), the interphase inductance is lower than it is at armature current 0 by this factor.		
<b>Dependency:</b>	Refer to: p51594		
<b>Note:</b>	The parameter is set automatically during the "Optimization run for pre-control and the current controller for the armature converter" (p50051 = 25).		
<b>p51596[0...n]</b>	<b>Interphase resistance in 12-pulse operation / R_intph 12-pulse</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> 0.000 [ohm]	<b>Max</b> 1000.000 [ohm]	<b>Factory setting</b> 0.000 [ohm]
<b>Description:</b>	Sets the resistance of an interphase transformer in 12-pulse operation.		
<b>Note:</b>	The parameter is set automatically during the "Optimization run for pre-control and the current controller for the armature converter" (p50051 = 25).		
<b>p51597[0...n]</b>	<b>Field inductance reduction factor / L_field red fact</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6910
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> 10 [%]	<b>Max</b> 100 [%]	<b>Factory setting</b> 100 [%]
<b>Description:</b>	Sets the reduction factor for the current-dependent field inductance. At 100% motor rated current (p50102), the field inductance is lower than it is at field current 0 by this factor.		
<b>Dependency:</b>	Refer to: p50116		
<b>Note:</b>	The parameter is set automatically during the "Optimization run for pre-control and the current controller for the field current controller" (p50051 = 24).		



<b>r51598</b>	<b>Short-circuit voltage <math>U_k</math>, per unit / <math>V_{sh-cct} U_k</math> p.u.</b>		
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [%]	Calculated: - Dyn. index: - Units group: - Scaling: PERCENT Max - [%]	Access level: 1 Func. diagram: 6854 Unit selection: - Expert list: 1 Factory setting - [%]
<b>Description:</b>	Displays the per unit short-circuit voltage of the line supply. The value is calculated from the commutation inductance (p51592) and the rated converter data ( $I_n = r50072[1]$ , $V_n = p50078[0]$ , $f_n = r50017$ ).		
<b>p51607[0...n]</b>	<b>BI: Setpoint processing reduction signal source / Red sig s</b>		
DC_CTRL	Can be changed: T Data type: Unsigned32 / Binary P-Group: - Not for motor type: - Min -	Calculated: - Dyn. index: CDS, p0170 Units group: - Scaling: - Max -	Access level: 2 Func. diagram: 3135 Unit selection: - Expert list: 1 Factory setting 1
<b>Description:</b>	Sets the signal source for activating/de-activating the reduction factor for the speed setpoint.		
<b>Dependency:</b>	Refer to: p51608, r52194, r52195		
<b>Note:</b>	Dependent upon binector input (p51607): 1 signal: The reduction factor (p51608) is de-activated ( $r52194 = r52195$ ). 0 signal: The reduction factor (p51608) is activated ( $r52194 = r52195 \times p51608$ ).		
<b>p51608[0...n]</b>	<b>Setpoint processing reduction factor / Red factor</b>		
DC_CTRL	Can be changed: U, T Data type: FloatingPoint32 P-Group: - Not for motor type: - Min 0.00 [%]	Calculated: - Dyn. index: DDS, p0180 Units group: - Scaling: PERCENT Max 100.00 [%]	Access level: 2 Func. diagram: 3135 Unit selection: - Expert list: 1 Factory setting 15.00 [%]
<b>Description:</b>	Sets the reduction factor for the speed setpoint in the context of setpoint processing.		
<b>Dependency:</b>	Dependent upon binector input (p51607): 1 signal: The reduction factor (p51608) is not applied ( $r52194 = r52195$ ). 0 signal: The reduction factor (p51608) is applied ( $r52194 = r52195 \times p51608$ ). Refer to: p51607, r52194, r52195		
<b>p51616</b>	<b>E stop response / E stop response</b>		
DC_CTRL	Can be changed: U, T Data type: Integer16 P-Group: - Not for motor type: - Min 0	Calculated: - Dyn. index: - Units group: - Scaling: - Max 1	Access level: 2 Func. diagram: 2070 Unit selection: - Expert list: 1 Factory setting 0
<b>Description:</b>	Sets the response of the control to the triggering of an E stop.		
<b>Value:</b>	0: E stop has the same effect as OFF2 1: E stop triggers immediate pulse inhibit		

**Note:** If value = 0:  
E stop has the same effect as OFF2.  
If value = 1:  
E stop interrupts the firing pulse sequence immediately. The process does not wait for Ia = 0 and Alpha W pulses are not emitted.

---

**p51618 LOCAL mode enable behavior / LOCAL enab behav**

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2580
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	1	0

**Description:** Sets the behavior for enable via terminal X177.13 in the LOCAL mode.

**Value:** 0: Terminal X177.13 is not effective in the LOCAL mode  
1: Terminal X177.13 is effective in the LOCAL mode

---

**p51619[0...n] BI: Signal source for switching on line contactor / Line cont ON sig s**

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> CDS, p0170	<b>Func. diagram:</b> 2070
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	53081.0

**Description:** Sets the signal source for the "Line contactor ON" relay output (XR1.109/110).

---

**p51651[0...n] Speed controller start pulse positive setpoint / Start pul pos set**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6800
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-100.00 [%]	100.00 [%]	0.00 [%]

**Description:** Sets the setpoint for the positive start pulse on the speed controller.

**Recommend.:** The value can also be used as an integrator setting value for the speed controller.

---

**p51652[0...n] Speed controller start pulse negative factor / Start pul neg fact**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6800
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0.00 [%]	200.00 [%]	50.00 [%]

**Description:** Sets the factor for the start pulse when the setpoint is negative.

---

**p51653[0...n] Speed controller start pulse negative setpoint / Start pul neg set**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> DDS, p0180	<b>Func. diagram:</b> 6800
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-100.00 [%]	100.00 [%]	0.00 [%]

**Description:** Sets the setpoint for the negative start pulse on the speed controller.

<b>p51655</b>	<b>CI: Speed controller start pulse positive signal source / Start p pos sig s</b>		
DC_CTRL	Can be changed: T	Calculated: -	Access level: 2
	Data type: Unsigned32 / FloatingPoint32	Dyn. index: -	Func. diagram: 6800
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: PERCENT	Expert list: 1
	Min	Max	Factory setting
	-	-	52451[0]
<b>Description:</b>	Sets the signal source for the setpoint of the positive start pulse on the speed controller.		
<b>p51656</b>	<b>CI: Speed controller start pulse negative signal source / Start p neg sig s</b>		
DC_CTRL	Can be changed: T	Calculated: -	Access level: 2
	Data type: Unsigned32 / FloatingPoint32	Dyn. index: -	Func. diagram: 6800
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: PERCENT	Expert list: 1
	Min	Max	Factory setting
	-	-	52452[0]
<b>Description:</b>	Sets the signal source for the setpoint of the negative start pulse on the speed controller.		
<b>p51657[0...n]</b>	<b>BI: Speed controller start pulse pos/neg changeover signal source / Start p ch sig s</b>		
DC_CTRL	Can be changed: T	Calculated: -	Access level: 2
	Data type: Unsigned32 / Binary	Dyn. index: CDS, p0170	Func. diagram: 6800
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min	Max	Factory setting
	-	-	0
<b>Description:</b>	Sets the signal source for changing over the setpoint between positive and negative start pulses on the speed controller.		
<b>p51660</b>	<b>BI: Signal source for master switch travel command 1 / Trav comm 1 sig s</b>		
DC_CTRL	Can be changed: T	Calculated: -	Access level: 2
	Data type: Unsigned32 / Binary	Dyn. index: -	Func. diagram: 3105
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min	Max	Factory setting
	-	-	0
<b>Description:</b>	Sets the signal source for travel command 1 on the 4-step master switch.		
<b>p51661</b>	<b>BI: Signal source for master switch travel command 2 / Trav comm 2 sig s</b>		
DC_CTRL	Can be changed: T	Calculated: -	Access level: 2
	Data type: Unsigned32 / Binary	Dyn. index: -	Func. diagram: 3105
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min	Max	Factory setting
	-	-	0
<b>Description:</b>	Sets the signal source for travel command 2 on the 4-step master switch.		

<b>p51662</b>	<b>BI: Signal source for master switch setpoint step S2 / Set step S2 sig s</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 3105
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Sets the signal source for changing over to setpoint step S2 on the 4-step master switch.

<b>p51663</b>	<b>BI: Signal source for master switch setpoint step S3 / Set step S3 sig s</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 3105
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Sets the signal source for changing over to setpoint step S3 on the 4-step master switch.

<b>p51664</b>	<b>BI: Signal source for master switch setpoint step S4 / Set step S4 sig s</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 3105
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Sets the signal source for changing over to setpoint step S4 on the 4-step master switch.

<b>p51665</b>	<b>Master switch setpoint step S1 value / Set step S1 value</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 3105
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0.00 [%]	110.00 [%]	10.00 [%]

**Description:** Sets the setpoint for setpoint step S1 on the 4-step master switch.

<b>p51666</b>	<b>Master switch setpoint step S2 value / Set step S2 value</b>		
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 3105
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0.00 [%]	110.00 [%]	25.00 [%]

**Description:** Sets the setpoint for setpoint step S2 on the 4-step master switch.

**p51667 Master switch setpoint step S3 value / Set step S3 value**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 3105
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0.00 [%]	110.00 [%]	40.00 [%]

**Description:** Sets the setpoint for setpoint step S3 on the 4-step master switch.

**p51668 Master switch setpoint step S4 value / Set step S4 value**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 3105
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0.00 [%]	110.00 [%]	100.00 [%]

**Description:** Sets the setpoint for setpoint step S4 on the 4-step master switch.

**p51700[0...1] CI: Signal source for connector recorder function / Rec fct con sig s**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8050
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Sets the signal source for the connectors to be recorded by the recorder function.

**Dependency:** Refer to: p51701, p51702, p51703, p51704, p51705, p51706

**Note:** [0] = Signal source for the first connector to be recorded  
[1] = Signal source for the second connector to be recorded

**p51701[0...1] BI: Signal source for binector recorder function / Rec fct bin sig s**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8050
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0

**Description:** Sets the signal source for the binectors to be recorded by the recorder function.

**Dependency:** Refer to: p51700, p51702, p51703, p51704, p51705, p51706

**Note:** [0] = Signal source for the first binector to be recorded  
[1] = Signal source for the second binector to be recorded

**p51702 Recorder function channel selection / Rec fct sel**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8050
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	1111 bin

**Description:** Setting to select the channels to be recorded.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Channel 0	Active	Not active	-
	01	Channel 1	Active	Not active	-
	02	Channel 2	Active	Not active	-
	03	Channel 3	Active	Not active	-

**Dependency:** Refer to: p51700, p51701, p51703, p51704, p51705, p51706

---

### **p51703 Recorder function recording interval / Rec fct t\_rec**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8050
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	1 [s]	1000 [s]	1 [s]

**Description:** Sets the recording interval, during which the signals selected with the channel selection parameters (p51702.0 to 3) are scanned and saved internally.

**Dependency:** Refer to: p51700, p51701, p51702, p51704, p51705, p51706

---

### **p51704 Recorder function save interval / Rec fct t\_save**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8050
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	1	60	1

**Description:** Sets the save interval, during which the signals recorded internally are saved to the following recording file:  
\\USER\SINAMICS\DATA\LOG\Track.csv

**Dependency:** Refer to: p51700, p51701, p51702, p51703, p51705, p51706

**Notice:** The value is set in minutes.

---

### **p51705 Start/stop recorder function / Rec fct StartStop**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8050
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	2	0

**Description:** Setting to start and stop the recorder function.  
Value = 1:  
Recording is started and stopped after reaching of the number of entries set in p51706. p51705 is set to 0.  
Value = 2:  
Recording is started: After reaching of the number of entries set in p51706, the file is overwritten from the beginning.  
Recording runs until it is stopped by setting of p51705 = 0.

**Value:**  
0: Stop  
1: Start  
2: Start with overwrite

**Dependency:** Refer to: p51700, p51701, p51702, p51703, p51704, p51706

**Notice:** Starting the recorder function overwrites any existing recording file.

<b>p51706</b>	<b>Recorder function number of entries / Rec fct num ent</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> Unsigned32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 10	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 100000	<b>Access level:</b> 2 <b>Func. diagram:</b> 8050 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 3600
<b>Description:</b>	Sets the number of entries in the recorder function's recording file. Dependent upon the start command (p51705 = 1 or 2), recording is stopped after this number of entries has been reached or the recording file is overwritten from the beginning.		
<b>Dependency:</b>	Refer to: p51700, p51701, p51702, p51703, p51704, p51705		
<b>p51790</b>	<b>BI: Topology switchover signal source / Top_switch s_src</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> 9360 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the signal source to select the required power unit topology.		
<b>p51791</b>	<b>BI: Topology switchover feedback signal source / Top_sw fdbk s_src</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / Binary <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> 9360 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the signal source for the feedback signal of the active power unit topology.		
<b>p51792</b>	<b>Topology switchover feedback signal stabilization time / Topo_sw t_stab</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0 [ms]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1000 [ms]	<b>Access level:</b> 2 <b>Func. diagram:</b> 9360 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0 [ms]
<b>Description:</b>	Sets the stabilization time for the feedback signal of the active power unit topology.		
<b>p51793</b>	<b>Topology switchover feedback signal duration / Topo_sw fdbk t_sig</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0 [ms]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 10000 [ms]	<b>Access level:</b> 2 <b>Func. diagram:</b> 9360 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 100 [ms]
<b>Description:</b>	Sets the maximum duration of the power unit topology switchover.		

**p51794 Topology switchover armature converter mode of operation 2 / Topo\_sw mode 2**

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9360
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	42	0

**Description:** Sets the mode of operation of the armature converter for power unit topology 2.

**Value:**

- 0: Standard mode of operation
- 1: Sole power unit 1-phase
- 3: Sole power unit 3-phase
- 21: 12-pulse parallel, firing angle from the master
- 22: 12-pulse parallel, firing angle master/slave
- 31: 6-pulse serial, firing angle from the master
- 32: 6-pulse serial with sequential phase control
- 41: 12-pulse serial, firing angle from the master
- 42: 12-pulse serial with sequential phase control

**Dependency:** Refer to: p51795

**Note:** Comments, the same as for p51799

**p51795 Topology switchover power unit topology position 2 / Topo\_sw pos 2**

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9360
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	45	0

**Description:** Sets the position of the power unit in converter topology 2.

**Value:**

- 0: Parallel interface not active
- 1: Power unit independent/CUD right
- 11: 6-pulse parallel master
- 12: 6-pulse parallel slave
- 13: 6-pulse parallel slave/replacement master
- 21: 12-pulse parallel master
- 22: 12-pulse parallel slave
- 23: 12-pulse parallel, slave parallel to master
- 24: 12-pulse parallel, slave parallel to slave
- 31: 6-pulse serial master
- 32: 6-pulse serial slave
- 33: 6-pulse serial parallel to master
- 34: 6-pulse serial parallel to slave
- 35: 6-pulse serial master, slave is a diode bridge
- 41: 12-pulse serial master
- 42: 12-pulse serial slave
- 43: 12-pulse serial parallel to master
- 44: 12-pulse serial parallel to slave
- 45: 12-pulse serial master, slave is a diode bridge

**Dependency:** Refer to: p51799

**Note:** Comments, the same as for p51800



<b>p51797[0...1]</b>	<b>Sequential phase control switch-on threshold/hysteresis / Seq ph ctr on/hys</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 5 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> 100 [%]	<b>Access level:</b> 3 <b>Func. diagram:</b> 6860 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> [0] 35 [%] [1] 30 [%]
<b>Description:</b>	Sets the switch-on threshold and hysteresis for the phase sequence control. The values are referred to the rated device current r50072[1].		
<b>Index:</b>	[0] = Switch-on threshold [1] = Hysteresis		
<b>Dependency:</b>	Refer to: p51799		
<b>Note:</b>	The switch-off threshold is calculated as follows: Switch-off threshold = switch-on threshold - hysteresis		
<b>p51798</b>	<b>Armature converter voltage diode bridge / la_convert U diode</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 50.00 [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> 100.00 [%]	<b>Access level:</b> 3 <b>Func. diagram:</b> 6902 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 85.00 [%]
<b>Description:</b>	Sets the line voltage at the diode bridge for a 6-pulse/12-pulse series circuit of a SINAMICS DCM with an uncontrolled rectifier (diode bridge).		
<b>Note:</b>	The value set here is a percentage of the line voltage at the SINAMICS DCM.		
<b>p51799</b>	<b>Armature converter mode of operation / la_conv mode_op</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 42	<b>Access level:</b> 3 <b>Func. diagram:</b> 6855 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the mode of operation of the armature converter		
<b>Value:</b>	0: Standard mode of operation 1: Sole power unit 1-phase 3: Sole power unit 3-phase 21: 12-pulse parallel, firing angle from the master 22: 12-pulse parallel, firing angle master/slave 31: 6-pulse serial, firing angle from the master 32: 6-pulse serial with sequential phase control 41: 12-pulse serial, firing angle from the master 42: 12-pulse serial with sequential phase control		
<b>Dependency:</b>	Refer to: p51797, p51800		
<b>Note:</b>	If value = 0: Standard for the corresponding topology (acc. to p51800). If value = 1: Sole power unit in 1-phase operation (line connection at inputs 1U and 1V). If value = 3: Sole power unit in 3-phase operation (= standard). If value = 21: 12-pulse parallel connection with central firing angle generation in the master (= standard).		

If value = 22:

12-pulse parallel connection with current setpoint interface, own closed-loop current control and firing angle generation in the master and in the slave.

If value = 31:

6-pulse series circuit with central firing pulse generation in the master (= standard).

If value = 32:

6-pulse series connection with sequential phase control.

If value = 41:

12-pulse series circuit with central firing pulse generation in the master (= standard).

If value = 42:

12-pulse series connection with sequential phase control.

<b>p51800 Power unit topology position / PU topo pos</b>			
<b>DC_CTRL</b>	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9350
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	45	0
<b>Description:</b>	Sets the position of the power unit in the converter topology.		
<b>Value:</b>	0: Parallel interface not active 1: Power unit independent/CUD right 11: 6-pulse parallel master 12: 6-pulse parallel slave 13: 6-pulse parallel slave/replacement master 21: 12-pulse parallel master 22: 12-pulse parallel slave 23: 12-pulse parallel, slave parallel to master 24: 12-pulse parallel, slave parallel to slave 31: 6-pulse serial master 32: 6-pulse serial slave 33: 6-pulse serial parallel to master 34: 6-pulse serial parallel to slave 35: 6-pulse serial master, slave is a diode bridge 41: 12-pulse serial master 42: 12-pulse serial slave 43: 12-pulse serial parallel to master 44: 12-pulse serial parallel to slave 45: 12-pulse serial master, slave is a diode bridge		
<b>Dependency:</b>	Refer to: p51799		
<b>Note:</b>	If value = 0: The parallel connection interface is inactive, the hardware does not have to be connected. The power unit operates alone. If value = 1: a) Several converters are connected with one another via the parallel interface. The power units operate independently of one another. Data exchange via the parallel interface is only used to exchange BICO signals. b) At a CUD in the right-hand slot, a value of 1 must always be set. For values > 1: Several converters are connected with one another via the parallel interface. The power units are also connected with one another and operate together (series connection, parallel connection). Data exchange via the parallel interface allows the power units to operate together and is additionally used to exchange BICO signals.		

<b>p51801</b>	<b>Parallel interface number of transmit data / Par IF num tr data</b>		
DC_CTRL	Can be changed: T	Calculated: -	Access level: 2
	Data type: Integer16	Dyn. index: -	Func. diagram: 9355
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min	Max	Factory setting
	0	16	4
<b>Description:</b>	Sets the number of words to be transmitted on the parallel interface.		
<b>Value:</b>	0: 0 words 4: 4 words 8: 8 words 12: 12 words 16: 16 words		
<b>p51802</b>	<b>Parallel interface number of power units / Par_IF PU qty</b>		
DC_CTRL	Can be changed: T	Calculated: -	Access level: 2
	Data type: Unsigned8	Dyn. index: -	Func. diagram: 9350
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min	Max	Factory setting
	1	16	1
<b>Description:</b>	Sets the number of converters whose power units operate together in the selected converter topology (p51800).		
<b>Note:</b>	For a 6-pulse parallel connection (p51800 = 11, 12 or 13) and activated redundant operation (p51803 = 1), then the power units may fail (e.g. go into a fault condition). In this operating mode, using this parameter, the minimum number of power units must be set which must be ready for operation. In all other cases, the number of power units that operate together must be precisely set.		
<b>p51803</b>	<b>Parallel interface activation of redundancy mode / Par IF redund mod</b>		
DC_CTRL	Can be changed: T	Calculated: -	Access level: 2
	Data type: Integer16	Dyn. index: -	Func. diagram: 9350
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min	Max	Factory setting
	0	2	0
<b>Description:</b>	Setting to activate/de-activate redundancy mode for the parallel interface.		
<b>Value:</b>	0: Deactivated 1: Activated armature 2: Activated armature + field		
<b>Note:</b>	When a SINAMICS DCM is operated together with a SIMOREG DC-MASTER Converter Commutation Protector (CCP), then the redundant mode must be deactivated.		
<b>p51804[0...15]</b>	<b>CI: Parallel interface slave transmit data / PI slave tr data</b>		
DC_CTRL	Can be changed: U, T	Calculated: -	Access level: 2
	Data type: Unsigned32 / Integer16	Dyn. index: -	Func. diagram: 9355
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: 4000H	Expert list: 1
	Min	Max	Factory setting
	-	-	0
<b>Description:</b>	Sets the signal sources for transmit data when operating the device as a slave on the parallel interface.		
<b>Index:</b>	[0] = Word 1 [1] = Word 2 [2] = Word 3 [3] = Word 4 [4] = Word 5		

[5] = Word 6  
 [6] = Word 7  
 [7] = Word 8  
 [8] = Word 9  
 [9] = Word 10  
 [10] = Word 11  
 [11] = Word 12  
 [12] = Word 13  
 [13] = Word 14  
 [14] = Word 15  
 [15] = Word 16

<b>p51805</b>	<b>Parallel interface bus terminator / Par IF bus term</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1	<b>Access level:</b> 2 <b>Func. diagram:</b> 9350 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Setting to activate/de-activate the bus terminator on the parallel interface.		
<b>Value:</b>	0: Bus terminator OFF 1: Bus terminator ON		
<b>Dependency:</b>	Refer to: p51806		
<b>p51806</b>	<b>Parallel interface bus address / Par IF bus addr</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 1	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 16	<b>Access level:</b> 2 <b>Func. diagram:</b> 9350 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Sets the bus address for the parallel connection of devices.		
<b>Dependency:</b>	Refer to: p51805		
<b>p51807</b>	<b>Parallel interface telegram monitoring failure time / Telegr mon t_fail</b>		
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.000 [s]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 65.000 [s]	<b>Access level:</b> 2 <b>Func. diagram:</b> 9350 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.100 [s]
<b>Description:</b>	Sets the permissible telegram failure time for the parallel interface. This setting means that every device connected to the parallel switching interface can monitor whether it is connected to the parallel switching interface. If a telegram is not received from any other device connected to the parallel switching interface for longer than the set time, then BICO output r53310.0 is set to 1, and also fault F60014 is initiated in the factory setting. Value = 0.0: Telegram monitoring is de-activated. Value = 0.001 ... 65.000: Telegram monitoring is activated.		
<b>Dependency:</b>	Refer to: p50099, r53310		

**Note:** Telegram monitoring is active in the following cases:

- From the first error-free telegram received after the electronic power supply has been switched on The telegram can be received from any device.
- From the first telegram received error-free after the telegram monitoring has responded (as a result of the failure time expiring).

<b>p51808</b>	<b>BI: Parallel interface signal source for F60014 / P IF F60014 sig s</b>		
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / Binary	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9350
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	53310.0
<b>Description:</b>	Sets the signal source for triggering fault F60014 "Telegram monitoring timeout".		
	The fault is triggered on a 1 signal.		
<b>Dependency:</b>	Refer to: r53310		

<b>r51809[0...4]</b>	<b>Parallel interface diagnostic information / Par IF diag info</b>		
DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9350
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays the diagnostic information for the parallel interface.		
<b>Index:</b>	[0] = Telegrams transmitted without errors [1] = Telegrams received without errors [2] = Transmission error [3] = Receive error [4] = Timeouts		
<b>Dependency:</b>	Refer to: p51807		
<b>Note:</b>	The counters are reset to 0 at POWER ON. The counters restart at 0 after reaching a value of 65535.		

<b>r51810</b>	<b>Parallel interface activity display / Par IF act disp</b>			
DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1	
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9350	
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -	
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1	
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>	
	-	-	-	
<b>Description:</b>	Displays the activities on the individual stations on the parallel interface.			
<b>Bit field:</b>	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>
	00	Station 1 transmitting data	Yes	No
	01	Station 2 transmitting data	Yes	No
	02	Station 3 transmitting data	Yes	No
	03	Station 4 transmitting data	Yes	No
	04	Station 5 transmitting data	Yes	No
	05	Station 6 transmitting data	Yes	No
	06	Station 7 transmitting data	Yes	No
	07	Station 8 transmitting data	Yes	No
	08	Station 9 transmitting data	Yes	No
	09	Station 10 transmitting data	Yes	No
	10	Station 11 transmitting data	Yes	No
	11	Station 12 transmitting data	Yes	No
				<b>FP</b>
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-
				-

12	Station 13 transmitting data	Yes	No	-
13	Station 14 transmitting data	Yes	No	-
14	Station 15 transmitting data	Yes	No	-
15	Station 16 transmitting data	Yes	No	-

---

**r51811 Parallel interface CAN diagnostic information / PI CAN diag info**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9350
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the CAN diagnostic information for the parallel interface.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Abort acknowledge flag			9350
	01	Write denied flag			9350
	02	Wake-up flag			9350
	03	Received msg lost flag			9350
	04	Bus-off condition flag			9350
	05	Error passive mode flag			9350
	06	Warning level flag			9350
	07	Form error flag			9350
	08	Bit error flag			9350
	09	Stuck at dominant bit			9350
	10	CRC error			9350
	11	Stuff bit error			9350
	12	ACK error			9350
	13	Bus-off status			9350
	14	Error passive state			9350
	15	Warning status			9350

---

**r51813[0...15] Parallel interface transmit data display / PI trans data disp**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9355
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the data selected for transmission.

**Index:**  
 [0] = Word 1  
 [1] = Word 2  
 [2] = Word 3  
 [3] = Word 4  
 [4] = Word 5  
 [5] = Word 6  
 [6] = Word 7  
 [7] = Word 8  
 [8] = Word 9  
 [9] = Word 10  
 [10] = Word 11  
 [11] = Word 12  
 [12] = Word 13  
 [13] = Word 14  
 [14] = Word 15  
 [15] = Word 16

<b>p51814[0...15]</b>			
<b>CI: Parallel interface master transmit data / PI master tr data</b>			
DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned32 / Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9355
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> 4000H	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	0
<b>Description:</b>	Sets the signal sources for transmit data when operating the device as a master on the parallel interface.		
<b>Index:</b>	[0] = Word 1 [1] = Word 2 [2] = Word 3 [3] = Word 4 [4] = Word 5 [5] = Word 6 [6] = Word 7 [7] = Word 8 [8] = Word 9 [9] = Word 10 [10] = Word 11 [11] = Word 12 [12] = Word 13 [13] = Word 14 [14] = Word 15 [15] = Word 16		
<b>Note:</b>	This parameter is used to define the transmit data and its position in the transmit telegram. [0]: Word 1 in the telegram ... [4]: Word 5 in the telegram [5]: Word 1 in the telegram ... [9]: Word 5 in the telegram ...		

<b>p51815</b>			
<b>Parallel interface number of devices / Par_IF device qty</b>			
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned8	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9350
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	1	16	1
<b>Description:</b>	Sets the number of CUDs, which communicate with one another via the parallel switching interface. This setting is intended so that every device connected to the parallel switching interface can monitor whether all devices are active and/or available. Each of the devices connected to the parallel switching interface continually monitors whether all of the devices regularly send telegrams. "Device connected to the parallel switching interface" is every CUD, at which p51800 > 0 . "Regularly sending telegrams" means that the time between two send telegrams from the same device must be less than 100 ms.		
<b>Note:</b>	- If the number set here is less than the actual number of devices connected to the parallel switching interface, then failure of some of the devices is ignored. - A setting of 1 means that the monitoring is inactive.		

<b>p51819[0...1]</b>	<b>External voltage transformer transformation ratio / V transf ext ratio</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.000100	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1.000000	<b>Access level:</b> 2 <b>Func. diagram:</b> 6950, 6965 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1.000000
<b>Description:</b>	Sets the ratio between output and input voltage on the external voltage transformer for line and armature voltage.		
<b>Index:</b>	[0] = Line voltage [1] = Armature voltage		
<b>Note:</b>	The parameter is only effective on the Control Module. Example: Output voltage = 100 V Input voltage = 2000 V --> p51819 = 100 V / 2000 V = 0.050		
<b>p51820</b>	<b>Armature rated supply voltage / Arm V_rated</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 50 [Vrms]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 5000 [Vrms]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6965 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1000 [Vrms]
<b>Description:</b>	Sets the rated supply voltage (rms value) for which the power unit is suitable (electric strength of the thyristors).		
<b>Note:</b>	The parameter is only effective on the Control Module. The set supply voltage is displayed in r50071. Parameter p50078[0] (armature rated input voltage) is limited to this value.		
<b>p51821[0...1]</b>	<b>Measurement cable connection / Meas cab conn</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1000	<b>Access level:</b> 2 <b>Func. diagram:</b> 6965 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1000
<b>Description:</b>	Sets the connections used to measure the line voltage and the armature voltage on the A7117 module.		
<b>Value:</b>	0: No selection 6: XU6 / XV6 / XW6 or XC6 / XD6 50: XU5 / XV5 / XW5 or XC5 / XD5 125: XU4 / XV4 / XW4 or XC4 / XD4 250: XU3 / XV3 / XW3 or XC3 / XD3 575: XU2 / XV2 / XW2 or XC2 / XD2 1000: XU1 / XV1 / XW1 or XC1 / XD1		
<b>Index:</b>	[0] = Line voltage [1] = Armature voltage		
<b>Note:</b>	The parameter is only effective on the Control Module. The parameter value indicates the rated rms value of the maximum measurable line voltage.		



<b>p51822 Armature rated direct current / Arm I<sub>rated</sub></b>			
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.1 [A]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 20000.0 [A]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6965 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0.1 [A]
<b>Description:</b>	Sets the rated direct current for the armature. The output direct current supported by the power unit in continuous operation should be set in this parameter.		
<b>Note:</b>	The parameter is only effective on the Control Module.		

<b>p51823 Load voltage at armature rated current / V<sub>load</sub> I<sub>a</sub> rated</b>			
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.2000 [V]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1.2000 [V]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6850, 6965 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1.0000 [V]
<b>Description:</b>	Sets the load voltage resulting from the following calculation formula: V <sub>load</sub> = R <sub>load</sub> * tr * Id V <sub>load</sub> : The load voltage to be set in this parameter R <sub>load</sub> : The load resistance (default 10 ohm) r: Transformation ratio of the current transformer (I2 / I1) Id: Output direct current according to parameter p51822		
<b>Note:</b>	The parameter is only effective on the Control Module.		

<b>p51824 Current transformer configuration / I<sub>transf</sub> config</b>			
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 1	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 5	<b>Access level:</b> 2 <b>Func. diagram:</b> 6850, 6965 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 2
<b>Description:</b>	Sets the configuration for the current transformer for current actual value sensing.		
<b>Value:</b>	1: Current transformer in phase U and V 2: Current transformer in phase U and W 3: Current transformer in phase V and W 4: External current transformer connected in V circuit 5: Bipolar current actual value signal (external shunt)		
<b>Note:</b>	The parameter is only effective on the Control Module.		

<b>p51825 Power unit type / PU typ</b>			
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 2	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 4	<b>Access level:</b> 2 <b>Func. diagram:</b> 6965 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 2
<b>Description:</b>	Sets the power unit type.		
<b>Value:</b>	2: 2-quadrant power unit 4: 4-quadrant power unit		
<b>Note:</b>	The parameter is only effective on the Control Module.		

p51826[0...2] Armature current converter firing pulse chopping times / Pulse chop t			
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0 [µs]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 105 [µs]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6860, 6965 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> [0] 50 [µs] [1] 35 [µs] [2] 70 [µs]
<b>Description:</b>	Sets the times for firing pulse chopping on the armature current converter.		
<b>Index:</b>	[0] = Length of first pulse [1] = Length additional pulses [2] = Break length		
<b>Note:</b>	The parameter is only effective on the Control Module. Block pulses are generated (i.e. firing pulses without pulse chopping) with the following setting: - p51826[0] = 105 µs - p51826[1] = 105 µs - p51826[2] = 0 µs		

p51829[0...2] Heat sink temperature threshold / Htsk temp thresh			
DC_CTRL	<b>Can be changed:</b> U, T <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0.0 [°C]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 200.0 [°C]	<b>Access level:</b> 2 <b>Func. diagram:</b> 8048 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 90.0 [°C]
<b>Description:</b>	Sets the threshold for temperature monitoring on the Control Module.		
<b>Index:</b>	[0] = Temperature sensor 1 / XT5 / A7109 [1] = Temperature sensor 2 / XT6 / A7109 [2] = Temperature sensor 3 / XT7 / A7116		
<b>Dependency:</b>	Refer to: p51830		
<b>Note:</b>	The parameter is only effective on the Control Module.		

p51830[0...2] Heat sink temperature sensor type / Htsk temp type			
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 2	<b>Access level:</b> 2 <b>Func. diagram:</b> 8048 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the sensor type for the temperature sensors on the Control Module.		
<b>Value:</b>	0: No temperature sensor present 1: NTC with 6.8 kOhm 2: NTC with 10 kOhm		
<b>Index:</b>	[0] = Temperature sensor 1 / XT5 / A7109 [1] = Temperature sensor 2 / XT6 / A7109 [2] = Temperature sensor 3 / XT7 / A7116		
<b>Dependency:</b>	Refer to: p51829		
<b>Note:</b>	The NTC temperature sensor should be connected at module A7109 or A7116 at terminal XT5, XT6 or XT7. The parameter is only effective on the Control Module.		

<b>p51831[0...4] Fuse monitoring activation / Fuse mon act</b>			
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 1	<b>Access level:</b> 2 <b>Func. diagram:</b> 6957, 6965 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Setting to activate/de-activate fuse monitoring on the Control Module.		
<b>Value:</b>	0: Deactivated 1: Activated		
<b>Index:</b>	[0] = Connector X23B [1] = Connector X23C [2] = Connector X23D [3] = Connector X23E [4] = Connector X23F		
<b>Note:</b>	The parameter is only effective on the Control Module. Connector X23B is available on the power interface and on the expansion module (A7112 module). Monitoring at connectors X23C to X23F is only possible using the expansion module. Only groups of up to 6 inputs can be activated and de-activated at the same time. If an expansion module is connected to slot X23A, slot X23B cannot be used on the power interface.		

<b>p51832 Fan monitoring configuration / Fan mon config</b>			
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 2	<b>Access level:</b> 2 <b>Func. diagram:</b> 8049 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Sets the configuration for fan monitoring on the Control Module.		
<b>Value:</b>	0: OFF 1: ON and Low active 2: ON and High active		
<b>Dependency:</b>	Refer to: r53140		
<b>Note:</b>	Fan monitoring is wired via input terminal 122/123. The parameter can only be changed for the Control Module.		

<b>p51833 External fault mode / Ext F mode</b>			
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 2	<b>Access level:</b> 2 <b>Func. diagram:</b> 6965, 8049 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Sets the mode to trigger the external fault F60203 via input terminal 124/125 on the Control Module.		
<b>Value:</b>	0: Switched off 1: Switched on and Low level triggers fault 2: Switched on and High level triggers fault		
<b>Dependency:</b>	Refer to: r53140		
<b>Note:</b>	The parameter can only be changed for the Control Module. If value = 1: The input signal is available via binector output r53140.4 for further interconnection. If value = 2: The input signal is available via binector output r53140.3 for further interconnection.		

**p51834 BI: Signal source for device fan relay output / Fan relay sig s**

DC\_CTRL

**Can be changed:** T**Calculated:** -**Access level:** 2**Data type:** Unsigned32 / Binary**Dyn. index:** -**Func. diagram:** 6965, 8049**P-Group:** -**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** -**Expert list:** 1**Min****Max****Factory setting**

-

-

0

**Description:** Sets the signal source for the "Fan On" relay output (terminal 120/121) on the power interface.**Note:** The parameter can only be changed for the Control Module.**p51835[0...2] Delay times for device fan monitoring / Fan mon t\_del**

DC\_CTRL

**Can be changed:** T**Calculated:** -**Access level:** 2**Data type:** FloatingPoint32**Dyn. index:** -**Func. diagram:** 8049**P-Group:** -**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** -**Expert list:** 1**Min****Max****Factory setting**

0.0 [s]

60.0 [s]

[0] 15.0 [s]

[1] 5.0 [s]

[2] 2.0 [s]

**Description:** Sets the delay times for device fan monitoring on the Control Module.**Index:**  
[0] = ON delay monitoring  
[1] = ON delay fault  
[2] = ON delay alarm**Note:** The parameter can only be changed for the Control Module.**p51838 Field device external rated direct current / I\_rated ext**

DC\_CTRL

**Can be changed:** T**Calculated:** -**Access level:** 2**Data type:** FloatingPoint32**Dyn. index:** -**Func. diagram:** 6960, 6910**P-Group:** -**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** -**Expert list:** 1**Min****Max****Factory setting**

0.00 [A]

600.00 [A]

0.00 [A]

**Description:** Sets the rated direct current of an external field device (if there is one).**Dependency:** Refer to: p50082**Note:** This parameter is only effective if p50082 >= 21.**p51839 External field monitoring / Ext field monit**

DC\_CTRL

**Can be changed:** U, T**Calculated:** -**Access level:** 2**Data type:** Integer16**Dyn. index:** -**Func. diagram:** 8044**P-Group:** -**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** -**Expert list:** 1**Min****Max****Factory setting**

0

1

0

**Description:** Setting for activating/de-activating the monitoring for the external field.**Value:**  
0: Deactivated  
1: Activated**Dependency:** Refer to: p50082

**p51840 Auto-reversing stage simulation mode / Auto-rev simul**

DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6865
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	26	0

**Description:** Setting to control simulation mode in the auto-reversing stage.

**Value:**

- 0: No simulation mode
- 11: Fire thyristor 11
- 12: Fire thyristor 12
- 13: Fire thyristor 13
- 14: Fire thyristor 14
- 15: Fire thyristor 15
- 16: Fire thyristor 16
- 21: Fire thyristor 21
- 22: Fire thyristor 22
- 23: Fire thyristor 23
- 24: Fire thyristor 24
- 25: Fire thyristor 25
- 26: Fire thyristor 26

**Note:** The simulation mode can only be activated in operating states  $\geq 07.0$ .

**p51845 Line zero crossings offset angle fixed / Line offset fixed**

DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6950
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-120.00 [°]	120.00 [°]	0.00 [°]

**Description:** Sets a fixed offset angle between the line zero crossings at the power unit and the synchronizing voltage.

**Dependency:** Refer to: p51846, p51847

**p51846[0...5] Line zero crossings offset angle thyristor pair-dependent factor / Line offset Fact**


DC_CTRL	<b>Can be changed:</b> U, T	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6950
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-10.00 [°]	10.00 [°]	0.00 [°]


**Description:** Sets an offset angle dependent on a thyristor pair between the line zero crossings at the power unit and the synchronizing voltage.

**Index:**

- [0] = Thyristor pair 1-6 (UV+)
- [1] = Thyristor pair 1-2 (WU-)
- [2] = Thyristor pair 2-3 (VW+)
- [3] = Thyristor pair 3-4 (UV-)
- [4] = Thyristor pair 4-5 (WU+)
- [5] = Thyristor pair 5-6 (VW-)

**Dependency:** Refer to: p51845, p51847

<b>p51847[0...5]</b>	<b>CI: Line zero crossings offset angle thyristor pair-dependent s_src / Line offset s_src</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Unsigned32 / FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 3 <b>Func. diagram:</b> 6950 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 1
<b>Description:</b>	Sets the signal source for the offset angle dependent on a thyristor pair between the line zero crossings at the power unit and the synchronizing voltage.		
<b>Index:</b>	[0] = Thyristor pair 1-6 (UV+) [1] = Thyristor pair 1-2 (WU-) [2] = Thyristor pair 2-3 (VW+) [3] = Thyristor pair 3-4 (UV-) [4] = Thyristor pair 4-5 (WU+) [5] = Thyristor pair 5-6 (VW-)		
<b>Dependency:</b>	Refer to: p51845, p51846		
<b>p51852</b>	<b>Current actual value sensing analog input configuration / I_sens AI config</b>		
DC_CTRL	<b>Can be changed:</b> T <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> 0	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> 4	<b>Access level:</b> 2 <b>Func. diagram:</b> 6850 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> 0
<b>Description:</b>	Sets the configuration for the armature current actual value sensing. Value = 0: The device-internal armature current actual value sensing is active. Value > 0: An external armature current actual value sensing is fed to the SINAMICS DC MASTER via an analog input. The device-internal armature current actual value sensing is not active.		
<b>Value:</b>	0: Ia sensing internal 1: Sensing via analog input 3 (X177.1/2) 2: Sensing via analog input 4 (X177.3/4) 3: Sensing via analog input 5 (X177.5/6) 4: Sensing via analog input 6 (X177.7/8)		
<b>Dependency:</b>	Refer to: p51823, p51824		
<b>Danger:</b>	For value > 0, the following applies: Incorrect setting of parameter p51853 leads to damaging or destruction of the power unit!		
			
<b>Note:</b>	For value > 0, the following applies: This is to be used only in certain special cases, where the accuracy of the device-internal armature current actual value sensing is regarded as insufficient. The following applies for the Control Module: p51852 = 0: p51824 is active p51852 > 0: p51824 is not active		

<b>p51853</b>			
<b>Current actual value sensing analog input voltage at rated Ia / I_sen AI V at Ia</b>			
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6850
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0.100 [V]	10.000 [V]	5.000 [V]
<b>Description:</b>	Sets the voltage for the external current actual value sensing. This voltage is supplied via the input terminal X177:x/x at armature rated current.		
<b>Dependency:</b>	Refer to: p51823, p51824		
<b>Danger:</b>	The following applies for p51852 > 0: Incorrect setting of parameter p51853 leads to damaging or destruction of the power unit!		
			
<b>Note:</b>	The following applies for the DC converter: p51852 = 0: p51853 is not active p51852 > 0: p51853 is active The following applies for the Control Module: p51852 = 0: p51823 is active p51852 > 0: p51853 is active, p51823 is not active		

---

<b>p51854</b>			
<b>Armature voltage sensing configuration / Va_sens config</b>			
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Integer16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6902
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	0	1	0
<b>Description:</b>	Sets the configuration for the armature voltage sensing. Value = 0: The device-internal armature voltage sensing is effective. Value = 1: An external armature voltage sensing is entered via analog input 2 (X177.29/30). The device-internal armature voltage sensing is not effective.		
<b>Value:</b>	0: Va sensing internal 1: Va sensing via AI 2 (X177.29/30)		
<b>Dependency:</b>	Refer to: p51823, p51824		
<b>Notice:</b>	The following applies for p51854 = 0 --> 1: The device must be restarted. Only then does the armature voltage sensing operate correctly via analog input 2.		
<b>Note:</b>	AI: Analog Input		

---

<b>p51855</b>			
<b>Armature voltage sensing analog input reference voltage / Va_sens AI V_ref</b>			
DC_CTRL	<b>Can be changed:</b> T	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6902
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	10.000 [V]	2000.000 [V]	10.000 [V]
<b>Description:</b>	Sets the armature voltage, which corresponds to a +10 V voltage at analog input 2 (X177.29/30).		
<b>Dependency:</b>	Refer to: p51854		
<b>Note:</b>	The parameter is only effective for p51854 = 1.		

<b>r52000</b>	<b>CO: Fixed value 0 % / Fix val 0%</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 3100 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Connector output with constant fixed value 0 %.		
<b>r52001</b>	<b>CO: Fixed value 100 % / Fix val 100%</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 3100 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Connector output with constant fixed value 100 %.		
<b>r52002</b>	<b>CO: Fixed value 200 % / Fix val 200%</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 3100 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Connector output with constant fixed value 200 %.		
<b>r52003</b>	<b>CO: Fixed value -100 % / Fix val -100%</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 3100 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Connector output with constant fixed value -100 %.		
<b>r52004</b>	<b>CO: Fixed value -200 % / Fix val -200%</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 3100 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Connector output with constant fixed value -200 %.		



<b>r52005</b>	<b>CO: Fixed value 50 % / Fix val 50%</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 3100 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Connector output with constant fixed value 50 %.		
<b>r52006</b>	<b>CO: Fixed value 150 % / Fix val 150%</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 3100 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Connector output with constant fixed value 150 %.		
<b>r52007</b>	<b>CO: Fixed value -50 % / Fix val -50%</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 3100 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Connector output with constant fixed value -50 %.		
<b>r52008</b>	<b>CO: Fixed value -150 % / Fix val -150%</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 3100 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Connector output with constant fixed value -150%.		
<b>r52010</b>	<b>CO: CUD analog input main setpoint raw value / CUD AI m set raw</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 2075 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the raw value at the "Main setpoint" analog input (X177.25/26).		

**r52011 CO: CUD analog input main setpoint / CUD AI m set**

DC\_CTRL

**Can be changed:** -**Calculated:** -**Access level:** 1**Data type:** FloatingPoint32**Dyn. index:** -**Func. diagram:** 2075**P-Group:** -**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** PERCENT**Expert list:** 1**Min****Max****Factory setting**

- [%]

- [%]

- [%]

**Description:**

Display and connector output for the "Main setpoint" analog input (X177.25/26).

**r52012 CO: CUD analog input main actual value raw value / CUD AI m act raw**

DC\_CTRL

**Can be changed:** -**Calculated:** -**Access level:** 2**Data type:** FloatingPoint32**Dyn. index:** -**Func. diagram:** 2075**P-Group:** -**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** PERCENT**Expert list:** 1**Min****Max****Factory setting**

- [%]

- [%]

- [%]

**Description:**

Display and connector output for the raw value at the "Main actual value" analog input (XT1.103/104).

**r52013 CO: CUD analog input main actual value / CUD AI m act**

DC\_CTRL

**Can be changed:** -**Calculated:** -**Access level:** 2**Data type:** FloatingPoint32**Dyn. index:** -**Func. diagram:** 2075, 6810**P-Group:** -**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** PERCENT**Expert list:** 1**Min****Max****Factory setting**

- [%]

- [%]

- [%]

**Description:**

Display and connector output for the "Main actual value" analog input (XT1.103/104).

**r52014 CO: CUD analog input select input 1 raw value / CUD AI sel 1 raw**

DC\_CTRL

**Can be changed:** -**Calculated:** -**Access level:** 2**Data type:** FloatingPoint32**Dyn. index:** -**Func. diagram:** 2080**P-Group:** -**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** PERCENT**Expert list:** 1**Min****Max****Factory setting**

- [%]

- [%]

- [%]

**Description:**

Display and connector output for the raw value at the analog "Select input 1" (X177.27/28).

**r52015 CO: CUD analog input select input 1 / CUD AI sel 1**

DC\_CTRL

**Can be changed:** -**Calculated:** -**Access level:** 2**Data type:** FloatingPoint32**Dyn. index:** -**Func. diagram:** 2080**P-Group:** -**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** PERCENT**Expert list:** 1**Min****Max****Factory setting**

- [%]

- [%]

- [%]

**Description:**

Display and connector output for the analog "Select input 1" (X177.27/28).

<b>r52016</b>	<b>CO: CUD analog input select input 2 raw value / CUD AI sel 2 raw</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 2080 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the raw value at the analog "Select input 2" (X177.29/30).		
<b>r52017</b>	<b>CO: CUD analog input select input 2 / CUD AI sel 2</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 2080 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the analog "Select input 2" (X177.29/30).		
<b>r52018</b>	<b>CO: CUD analog input 3 raw value / CUD AI 3 raw</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 2085 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the raw value at analog input 3 (X177.1/2) on the CUD.		
<b>Dependency:</b>	Refer to: r52019		
<b>Note:</b>	AI: Analog Input		
<b>r52019</b>	<b>CO: CUD analog input 3 result / CUD AI 3 res</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 2085 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the conversion result at analog input 3 (X177.1/2) on the CUD.		
<b>r52020</b>	<b>CO: CUD analog input 4 raw value / CUD AI 4 raw</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 2085 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the raw value at analog input 4 (X177.3/4) on the CUD.		
<b>Dependency:</b>	Refer to: r52021		

<b>r52021</b>	<b>CO: CUD analog input 4 result / CUD AI 4 res</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 2085 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the conversion result at analog input 4 (X177.3/4) on the CUD.		
<b>r52022</b>	<b>CO: CUD analog input 5 raw value / CUD AI 5 raw</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 2090 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the raw value at analog input 5 (X177.5/6) on the CUD.		
<b>Dependency:</b>	Refer to: r52023		
<b>r52023</b>	<b>CO: CUD analog input 5 result / CUD AI 5 res</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 2090 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the conversion result at analog input 5 (X177.5/6) on the CUD.		
<b>r52024</b>	<b>CO: CUD analog input 6 raw value / CUD AI 6 raw</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 2090 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the raw value at analog input 6 (X177.7/8) on the CUD.		
<b>Dependency:</b>	Refer to: r52025		
<b>r52025</b>	<b>CO: CUD analog input 6 result / CUD AI 6 res</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 2090 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the conversion result at analog input 6 (X177.7/8) on the CUD.		

<b>r52026</b>	<b>CO: CUD analog output 0 value after smoothing / CUD AO 0 v aft sm</b>		
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [%]	Calculated: - Dyn. index: - Units group: - Scaling: PERCENT Max - [%]	Access level: 2 Func. diagram: 2095 Unit selection: - Expert list: 1 Factory setting - [%]
<b>Description:</b>	Display and connector output for analog output 0 (X177.49/50) on the CUD.		
<b>Dependency:</b>	Refer to: p50750		
<b>Note:</b>	AO: Analog Output		
<b>r52027</b>	<b>CO: CUD analog output 1 value after smoothing / CUD AO 1 v aft sm</b>		
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [%]	Calculated: - Dyn. index: - Units group: - Scaling: PERCENT Max - [%]	Access level: 2 Func. diagram: 2095 Unit selection: - Expert list: 1 Factory setting - [%]
<b>Description:</b>	Display and connector output for analog output 1 (X177.51/52) on the CUD.		
<b>Dependency:</b>	Refer to: p50755		
<b>Note:</b>	AO: Analog Output		
<b>r52047</b>	<b>CO: Ramp-function generator braking distance (Unsigned32) / RFG brake dist U32</b>		
DC_CTRL	Can be changed: - Data type: Unsigned32 P-Group: - Not for motor type: - Min -	Calculated: - Dyn. index: - Units group: - Scaling: - Max -	Access level: 3 Func. diagram: 3152 Unit selection: - Expert list: 1 Factory setting -
<b>Description:</b>	Display and connector output for the braking distance required as increments of the pulse encoder defined in p0400. The pulse encoder to be used must be selected using p50331. The required braking distance is calculated assuming that the speed setpoint at the ramp-function generator input has been set to 0 and the speed actual value is approaching 0, taking the set ramp-down time and roundings into consideration.		
<b>Note:</b>	For p0400[p50331] = 0, a braking distance of 0 is displayed. The braking distance calculation is only correct if the ramp-down time and the roundings do not change during braking (p50302, r00899.5, p50637, p50638).		
<b>r52048</b>	<b>CO: Ramp-function generator braking distance (FloatingPoint32) / RFG br dist float</b>		
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min -	Calculated: - Dyn. index: - Units group: - Scaling: - Max -	Access level: 3 Func. diagram: 3152 Unit selection: - Expert list: 1 Factory setting -
<b>Description:</b>	Display and connector output for the braking distance required as increments of the pulse encoder defined in p0400. The pulse encoder to be used must be selected using p50331. The required braking distance is calculated assuming that the speed setpoint at the ramp-function generator input has been set to 0 and the speed actual value is approaching 0, taking the set ramp-down time and roundings into consideration.		

**Note:** For p0400[p50331] = 0, a braking distance of 0 is displayed.  
The braking distance calculation is only correct if the ramp-down time and the roundings do not change during braking (p50302, r00899.5, p50637, p50638).

---

**r52049 Temperature sensor available / Temp\_sens avail**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6960
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the integrated temperature sensors.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Temperature sensor XT5	Available	Not present	6960
	01	Temperature sensor XT6	Available	Not present	6960
	02	Temperature sensor XT7	Available	Not present	6960
	03	Gating module temperature sensor	Available	Not present	6960

**Note:** The display is independent of the temperature sensor status and only indicates the desired state.

---

**r52050[0...4] CO: Temperature sensor display / Temp sensor disp**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8047, 8048
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]

**Description:** Display and connector output for the device's temperature outputs.

**Index:**  
[0] = Temperature 1  
[1] = Temperature 2  
[2] = Temperature 3  
[3] = Gating module temperature  
[4] = CUD Control Unit temperature

**Note:** Temperature sensors which are not in use return a high negative value (approx. -200 °C).

---

**r52051 CO: Motor temperature output / Mot temp outp**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8030
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]

**Description:** Display and connector output for the motor temperature.

Scaling:

0 % corresponds to 0 °C

100 % corresponds to 100 °C

**Dependency:** The parameter is only valid for the following temperature sensors with a continuous characteristic:

- KTY84 (p50490 = 1)
- PT100 (p50490 = 6)
- NTC thermistor K227 (p50490 = 7)
- PT1000 (p50490 = 8)

Refer to: p50490

**Note:** If p50490 = 0, 2 to 5, a value of 0 is displayed.

**r52100 CO: Armature firing angle after limiting / Fir ang aft lim**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6860
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]

**Description:** Display and connector output for the armature firing angle after limiting by the auto-reversing stage.

**r52101 CO: Armature firing angle before limiting / Fir ang bef lim**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6860, 6900
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]

**Description:** Display and connector output for the armature firing angle before limiting by the auto-reversing stage.

**r52102 CO: CI-loop arm curr ctrl prectr value + arm curr controller output / la ctr prec+outp**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6855
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]

**Description:** Display and connector output for the output to the armature gating module (pre-control value + armature current controller output).

**r52103 CO: Armature current flow duration / Arm I\_flow dur**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6850
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]

**Description:** Displays the armature current flow duration/time ratio between 2 consecutive firing pulses.

**r52104 CO: Armature current increase / Arm I\_incr**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6850
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Display and connector output for the current increase in the armature (dIa/dt) in A/s.

<b>r52106</b>	<b>Torque direction requested / Tqe dir requ</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> Integer16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 2 <b>Func. diagram:</b> 6860 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Displays the requested torque direction.		
<b>Note:</b>	Value = 0: No torque direction requested Value = 1: Torque direction 1 requested Value = 2: Torque direction 2 requested		
<b>r52107</b>	<b>CO: Arm curr act val averaged over 6 cycles with reference to motor / Ia act 6 mot cyc</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6851, 6854 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output of the signed armature current actual value. The value is averaged over 6 firing cycles and referenced to the rated motor current.		
<b>r52108[0...2]</b>	<b>CO: Phase currents rms value / I<sub>phase</sub> rms</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6850 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the rms values of the phase currents. The values are averaged over six firing cycles. 100 % corresponds to $\sqrt{2/3} \cdot r50072[1] = 0.8165 \cdot r50072[1]$ The reference value is that rms value of the phase currents that is obtained if the rated DC current flows in the B6 bridge.		
<b>Index:</b>	[0] = Phase U [1] = Phase V [2] = Phase W		
<b>r52109</b>	<b>CO: Armature current actual value averaged over 6 cycles / Ia act 6 cyc</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6851, 6902, 8038, 8042, 8046 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output of the signed armature current actual value. The value is averaged over 6 firing cycles.		



<b>r52110</b>	<b>CO: CI-loop arm curr control curr controller output / la ctr outp</b>		
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [%]	Calculated: - Dyn. index: - Units group: - Scaling: PERCENT Max - [%]	Access level: 1 Func. diagram: 6855 Unit selection: - Expert list: 1 Factory setting - [%]
<b>Description:</b>	Display and connector output for the closed-loop armature current control output.		
<b>r52111</b>	<b>CO: CI-loop arm curr control curr controller outp proportional comp / la ctr outp P comp</b>		
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [%]	Calculated: - Dyn. index: - Units group: - Scaling: PERCENT Max - [%]	Access level: 2 Func. diagram: 6855 Unit selection: - Expert list: 1 Factory setting - [%]
<b>Description:</b>	Display and connector output for the proportional component of closed-loop armature current control.		
<b>r52112</b>	<b>CO: CI-loop arm curr control curr controller outp integral comp / la ctr outp I comp</b>		
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [%]	Calculated: - Dyn. index: - Units group: - Scaling: PERCENT Max - [%]	Access level: 2 Func. diagram: 6855 Unit selection: - Expert list: 1 Factory setting - [%]
<b>Description:</b>	Display and connector output for the integral component of closed-loop armature current control.		
<b>r52113</b>	<b>CO: CI-loop arm curr control curr setpoint/actual value difference / la ctr set/act</b>		
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [%]	Calculated: - Dyn. index: - Units group: - Scaling: PERCENT Max - [%]	Access level: 1 Func. diagram: 6855 Unit selection: - Expert list: 1 Factory setting - [%]
<b>Description:</b>	Display and connector output for the setpoint/actual value difference of closed-loop armature current control.		
<b>r52114</b>	<b>CO: Armature current actual value averaged over 1 cycle / la act 1 cyc</b>		
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [%]	Calculated: - Dyn. index: - Units group: - Scaling: PERCENT Max - [%]	Access level: 2 Func. diagram: 6851 Unit selection: - Expert list: 1 Factory setting - [%]
<b>Description:</b>	Display and connector output of the signed armature current actual value. The value is averaged over 1 firing cycle.		

<b>r52115</b>	<b>CO: CI-loop arm curr control curr controller actual value abs value / la ctr I_act abs</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 1 <b>Func. diagram:</b> 6855 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the absolute value of the current controller actual value for closed-loop armature current control.		
<b>r52116</b>	<b>CO: Armature current actual value internal absolute value / A I_act int abs</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6851 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the absolute value of the internal armature current actual value. The value is averaged over 1 firing cycle.		
<b>r52117</b>	<b>CO: Armature current actual value internal signed / A I_act int sign</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6851 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the signed internal armature current actual value. The value is averaged between the centers of the firing intervals.		
<b>r52118</b>	<b>CO: CI-loop arm curr control curr controller setpoint absolute value / la ctr I_set abs</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 1 <b>Func. diagram:</b> 6855 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the absolute value of the current controller setpoint for closed-loop armature current control.		
<b>Dependency:</b>	Refer to: r50020		
<b>r52119</b>	<b>CO: CI-loop arm curr control curr controller setpoint / la ctr I_set</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6855 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the current controller setpoint prior to absolute value generation for closed-loop armature current control.		

**r52120 CO: Curr limitation arm curr setpoint before red gearbox stressing / la\_set bef gear**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6845
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]

**Description:** Display and connector output for the current controller setpoint before reduced gearbox stressing.

**r52121 CO: Closed-loop armature current control pre-control output / la ctr prec outp**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6855
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]

**Description:** Display and connector output for the armature current pre-control output.

**r52122 CO: EMF actual value armature current pre-control / EMF act prec**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6852, 6855
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]

**Description:** Display and connector output for the EMF actual value for armature current pre-control.

**Note:** 100% corresponds to  $p50078[0] * (3 * \sqrt{2}) / \pi$ .

**r52123 CO: EMF actual value signed / EMF act sign**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6852, 6902
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]

**Description:** Display and connector output for the signed unsmoothed EMF actual value.

**Note:** 100% corresponds to  $p50078[0] * (3 * \sqrt{2}) / \pi$ .

**r52124 CO: Active power for a pure ohmic load / P\_act ohm load**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6902
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]

**Description:** Display and connector output for the active power for a pure ohmic load (= r52126 \* r52127).

The value is averaged over six firing cycles.

**Note:** This quantity is used for heating applications (rms value current control or rms value power control).

**r52125 CO: Curr limitation arm curr setpoint aft reduced gearbox stressing / la set aft gear**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6845
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]

**Description:** Display and connector output for the current controller setpoint after reduced gearbox stressing.

**r52126 CO: Armature current actual value rms value / la\_act rms**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6851
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]

**Description:** Display and connector output for the rms value of the internal armature current actual value.  
The value is averaged over 6 firing cycles, and referred to the rated device current (r50072[1]).

**r52127 CO: Armature voltage rms value / Ua\_act rms**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6902
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]

**Description:** Display and connector output for the rms value of the armature voltage.  
The value is averaged over six firing cycles.  
100 % corresponds to  $(3 * \sqrt{2}) / \pi * p50078[0] = 1.35 * p50078[0]$  (= U\_di0\_rated)

**r52128 CO: Firing angle linearized / Firing angle lin**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6858
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]

**Description:** Displays the linearized firing angle.

**Dependency:** Refer to: p50600

**Note:** This parameter is calculated when Ua\_set is fed into the gating unit.  
-100 % corresponds to 180 degrees  
+100% corresponds to 0 degrees

**r52129 CO: n-dependent current limitation armature current setpoint limit / I\_lim la set lim**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8040
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]

**Description:** Display and connector output for the armature current setpoint after speed-dependent current limitation.

Dependency: Refer to: p50109

<b>r52130</b>	<b>CO: I2t monitoring armature current setpoint after limitation / I2t la set n lim</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 8042 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the armature current setpoint after limitation by means of I2t monitoring as a percentage of r50072[1].		
<b>r52131</b>	<b>CO: Current limitation minimum positive armature current limit / la lim pos min</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6840, 6845 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the minimum positive armature current limit.		
<b>r52132</b>	<b>CO: Current limitation maximum negative armature current limit / la lim neg max</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6840, 6845 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the maximum negative armature current limit.		
<b>r52133</b>	<b>CO: Current limitation setpoint before limitation (with add_s) / Set bef lim w add</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 1 <b>Func. diagram:</b> 6840, 8042 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the armature current controller setpoint before limitation (with additional setpoint).		
<b>r52134</b>	<b>CO: Speed limiting controller curr controller setp before limitation / la set bef lim</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 1 <b>Func. diagram:</b> 6835 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the current controller setpoint before current limitation.		

<b>r52135[0...6]</b>	<b>CO: Current limitation default for torque direction II / la lim def t d II</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6840 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the variable torque limiting defaults in torque direction II.		
<b>Dependency:</b>	Refer to: p50603, p50604		
<b>Note:</b>	Connector output r52135[0 to 6] is the inverse of p50603[0 to 6] and interconnected by default via connector input p50604[0 to 6].		
<b>r52136</b>	<b>CO: Speed limiting controller upper torque limit effective / n_lim t lim up max</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6835 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the effective upper torque limit (maximum value) on the speed limiting controller.		
<b>Dependency:</b>	Refer to: r52137		
<b>r52137</b>	<b>CO: Speed limiting controller lower torque limit effective / n_lim t lim l min</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6835 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the effective lower torque limit (minimum value) on the speed limiting controller.		
<b>Dependency:</b>	Refer to: r52136		
<b>r52138[0...4]</b>	<b>CO: Torque limiting negative default / Tqe lim neg def</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6825 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the defaults for variable negative torque limiting.		
<b>Dependency:</b>	Refer to: p50606		
<b>Note:</b>	Connector output r52138[0 to 4] is the inverse of p50605[0 to 4]; it is interconnected by default via connector input p50606[0 to 4].		
<b>r52140</b>	<b>CO: Torque limiting torque setpoint / Tqe lim set</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6835 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the torque setpoint.		

<b>r52141</b>	<b>CO: Torque limiting torque setpoint after limiting / T lim set aft lim</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 1 <b>Func. diagram:</b> 6830 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the torque setpoint after limiting.		
<b>r52142</b>	<b>CO: Armature current actual value sensing torque actual value / A act val s tq act</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6851 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the torque actual value as a percentage of r50072[1] * p50102.		
<b>r52143</b>	<b>CO: Torque limiting armature torque limit min pos / T lim arm min pos</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6830 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the minimum positive torque limit for the armature.		
<b>r52144</b>	<b>CO: Torque limiting armature torque limit max neg / T lim arm max neg</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6830 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the maximum negative torque limit for the armature.		
<b>r52145</b>	<b>CO: Torque limiting setpoint before limiting (with add_s) / Set bef lim w add</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 1 <b>Func. diagram:</b> 6830 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the torque setpoint before limiting (with additional setpoint).		

<b>r52147</b>	<b>CO: Torque limiting setpoint before limiting (without add_s) / Set b lim w/o add</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 1 <b>Func. diagram:</b> 6830, 6840 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the torque setpoint before limiting (without additional setpoint).		
<b>r52148</b>	<b>CO: Speed controller torque setpoint / n_ctr tq set</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 1 <b>Func. diagram:</b> 6815 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the speed controller's output value with friction and inertia compensation and additional torque setpoint.		
<b>r52149</b>	<b>CO: Torque actual value in relation to p50100 * p50102 / Tqe act ref</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6851 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the torque actual value referenced to p50100 * p50102.		
<b>r52150</b>	<b>CO: Speed controller setpoint change / n_ctr set chng</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6820 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the setpoint change on the speed controller.		
<b>Dependency:</b>	Refer to: p50540, r52174		
<b>r52152</b>	<b>CO: Speed controller setpoint/actual value difference output / Set/act dif outp</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6820 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for acceleration dependent upon setpoint/actual value difference. In the case of the "Acceleration dependent upon setpoint/actual value difference" function, only the proportion of the speed controller's setpoint/actual value difference which has an absolute value in excess of the threshold (p50543) is switched through.		
<b>Dependency:</b>	Refer to: p50541, p50543		



<b>r52154</b>	<b>CO: Speed controller reference model output / n_ctrl ref outp</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6812 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the reference model for the speed controller.		
<b>Dependency:</b>	Refer to: p50237, p50238, p50239		
<b>r52155</b>	<b>CO: Speed controller reference model setpoint-actual val difference / n_ctr ref set-act</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6812 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the setpoint-actual value difference after the influence of the reference model for the speed controller.		
<b>Dependency:</b>	Refer to: p50621, p50622, p50623, p50624		
<b>r52160</b>	<b>CO: Speed controller output value / n_ctr outp val</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 1 <b>Func. diagram:</b> 6815 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the speed controller's output value.		
<b>r52161</b>	<b>CO: Speed controller proportional component output value / P comp outp val</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6815 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the output value of the proportional component on the speed controller.		
<b>r52162</b>	<b>CO: Speed controller integral component output value / I_comp outp val</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6815 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the integral component of the speed controller's output value.		

<b>r52164</b>	<b>CO: Speed controller setpoint/actual value difference / n_ctr set/act dif</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 1 <b>Func. diagram:</b> 6815, 6820 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output of the speed setpoint/actual value difference used for the speed controller.		
<b>Dependency:</b>	Refer to: p50620		
<b>r52165</b>	<b>CO: Speed controller setpoint/actual value difference / n_ctr set/act dif</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 1 <b>Func. diagram:</b> 6810 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the result of the setpoint/actual value difference on the speed controller.		
<b>Dependency:</b>	Refer to: p50621, p50622, p50623, p50624		
<b>Note:</b>	The setpoint/actual value difference (r52165) results from setpoint 1 and 2 (p50621, p50622) and actual value 1 and 2 (p50623, p50624).		
<b>r52166</b>	<b>CO: Speed controller actual value selection absolute value / Sel act abs</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6810, 6815, 6825, 6900, 8040, 8046 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output of the selected speed actual value as an absolute value on the speed controller.		
<b>r52167</b>	<b>CO: Speed controller actual value selection / Act sel</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 1 <b>Func. diagram:</b> 6810 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output of the selected speed actual value on the speed controller.		
<b>r52168</b>	<b>CO: Derivative-action element negative output value / D elem neg outp</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6810 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the negative output value of the derivative-action element.		
<b>Dependency:</b>	Refer to: p50205, p50206, p50627, r52169		

<b>r52169</b>	<b>CO: Derivative-action element output value / D elem outp</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6810 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the output value of the derivative-action element.		
<b>Dependency:</b>	Refer to: p50205, p50206, p50627, r52168		
<b>r52170</b>	<b>CO: RFG speed setpoint after limiting / RFG n_set aft lim</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 1 <b>Func. diagram:</b> 1720, 3155 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the speed setpoint after limiting.		
<b>r52171</b>	<b>CO: Friction/inertia compensation output value / Comp outp</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6815, 6820 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output of the compensation output value for friction and inertia.		
<b>Dependency:</b>	Refer to: p50223		
<b>Note:</b>	If p50223 = 1: This value is added to the speed controller's output.		
<b>r52172</b>	<b>CO: Friction compensation output value / Fric comp outp</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6820 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the friction compensation output value.		
<b>r52173</b>	<b>CO: Inertia compensation output value / Inert comp outp</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6820 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the moment of inertia compensation output value.		
<b>Dependency:</b>	Refer to: p50697		
<b>Note:</b>	If p50697 = 1 signal: This value is added to the friction and moment of inertia compensation output.		

<b>r52174</b>	<b>CO: Speed controller setpoint smoothed / n_ctr set smooth</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 1 <b>Func. diagram:</b> 6810, 6820 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output of the smoothed setpoint on the speed controller.		
<b>r52176</b>	<b>CO: Speed controller droop output value / Droop outp val</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6805 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the droop output value on the speed controller.		
<b>r52177</b>	<b>CO: Band-stop 1 output value / Band-st 1 outp</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6810 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for output value of band-stop 1.		
<b>Dependency:</b>	Refer to: p50201, p50202, p50628		
<b>r52178</b>	<b>CO: Band-stop 2 output value / Band-st 2 outp</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6810 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for output value of band-stop 2.		
<b>Dependency:</b>	Refer to: p50203, p50204, p50629		
<b>r52179</b>	<b>CO: Speed controller actual value smoothed / n_ctr act sm</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 1 <b>Func. diagram:</b> 6810 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output of the smoothed actual value on the speed controller.		

<b>r52181</b>	<b>CO: RFG effective positive setpoint limit / RFG set lim pos</b>		
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [%]	Calculated: - Dyn. index: - Units group: - Scaling: PERCENT Max - [%]	Access level: 2 Func. diagram: 3155 Unit selection: - Expert list: 1 Factory setting - [%]
<b>Description:</b>	Display and connector output for the effective positive setpoint limit with "Limiting after ramp-function generator".		
<b>r52182</b>	<b>CO: RFG effective negative setpoint limit / RFG set lim neg</b>		
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [%]	Calculated: - Dyn. index: - Units group: - Scaling: PERCENT Max - [%]	Access level: 2 Func. diagram: 3155 Unit selection: - Expert list: 1 Factory setting - [%]
<b>Description:</b>	Display and connector output for the effective negative setpoint limit with "Limiting after ramp-function generator".		
<b>r52183</b>	<b>CO: RFG speed setpoint before limiting / RFG n_set bef lim</b>		
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [%]	Calculated: - Dyn. index: - Units group: - Scaling: PERCENT Max - [%]	Access level: 1 Func. diagram: 3155 Unit selection: - Expert list: 1 Factory setting - [%]
<b>Description:</b>	Display and connector output for the speed setpoint with "Limiting after ramp-function generator".		
<b>r52184</b>	<b>CO: Setpoint processing main setpoint lim neg default 0 / M set neg def 0</b>		
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [%]	Calculated: - Dyn. index: - Units group: - Scaling: PERCENT Max - [%]	Access level: 2 Func. diagram: 3135 Unit selection: - Expert list: 1 Factory setting - [%]
<b>Description:</b>	Display and connector output for the default value of variable negative main setpoint limiting with index 0.		
<b>Dependency:</b>	Refer to: p50642		
<b>Note:</b>	The value represents the inversion of p50642[0].		
<b>r52185</b>	<b>CO: Setpoint processing main setpoint lim neg default 1 / M set neg def 1</b>		
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [%]	Calculated: - Dyn. index: - Units group: - Scaling: PERCENT Max - [%]	Access level: 2 Func. diagram: 3135 Unit selection: - Expert list: 1 Factory setting - [%]
<b>Description:</b>	Display and connector output for the default value of variable negative main setpoint limiting with index 1.		
<b>Dependency:</b>	Refer to: p50642		
<b>Note:</b>	The value represents the inversion of p50642[1].		

<b>r52186</b>	<b>CO: Setpoint processing main setpoint lim neg default 2 / M set neg def 2</b>		
DC_CTRL	Can be changed: -	Calculated: -	Access level: 2
	Data type: FloatingPoint32	Dyn. index: -	Func. diagram: 3135
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: PERCENT	Expert list: 1
	Min	Max	Factory setting
	- [%]	- [%]	- [%]
<b>Description:</b>	Display and connector output for the default value of variable negative main setpoint limiting with index 2.		
<b>Dependency:</b>	Refer to: p50642		
<b>Note:</b>	The value represents the inversion of p50642[2].		
<b>r52187</b>	<b>CO: Setpoint processing main setpoint lim neg default 3 / M set neg def 3</b>		
DC_CTRL	Can be changed: -	Calculated: -	Access level: 2
	Data type: FloatingPoint32	Dyn. index: -	Func. diagram: 3135
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: PERCENT	Expert list: 1
	Min	Max	Factory setting
	- [%]	- [%]	- [%]
<b>Description:</b>	Display and connector output for the default value of variable negative main setpoint limiting with index 3.		
<b>Dependency:</b>	Refer to: p50642		
<b>Note:</b>	The value represents the inversion of p50642[3].		
<b>r52190</b>	<b>CO: RFG speed setpoint output / RFG n_set outp</b>		
DC_CTRL	Can be changed: -	Calculated: -	Access level: 1
	Data type: FloatingPoint32	Dyn. index: -	Func. diagram: 3150, 3151, 3152, 3155
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: PERCENT	Expert list: 1
	Min	Max	Factory setting
	- [%]	- [%]	- [%]
<b>Description:</b>	Display and connector output for the speed setpoint calculated by the ramp-function generator.		
<b>r52191</b>	<b>CO: RFG dy/dt rise in relation to p50542 / RFG dy/dt p50542</b>		
DC_CTRL	Can be changed: -	Calculated: -	Access level: 2
	Data type: FloatingPoint32	Dyn. index: -	Func. diagram: 3152
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: PERCENT	Expert list: 1
	Min	Max	Factory setting
	- [%]	- [%]	- [%]
<b>Description:</b>	Display and connector output for the rise of the ramp-function generator output in relation to the time set in p50542.		
<b>Dependency:</b>	Refer to: p50542		
<b>r52192</b>	<b>CO: RFG setpoint before ramp-function generator / RFG set bef RFG</b>		
DC_CTRL	Can be changed: -	Calculated: -	Access level: 1
	Data type: FloatingPoint32	Dyn. index: -	Func. diagram: 3151, 3152
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: PERCENT	Expert list: 1
	Min	Max	Factory setting
	- [%]	- [%]	- [%]
<b>Description:</b>	Display and connector output for the setpoint before the ramp-function generator.		

<b>r52193</b>	<b>CO: Setpoint processing output to ramp-function generator / Outp to RFG</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 1 <b>Func. diagram:</b> 3135 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the setpoint to the ramp-function generator.		
<b>Dependency:</b>	Refer to: p50648		
<b>r52194</b>	<b>CO: Setpoint processing setpoint after reduction / Set after reduc</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 1 <b>Func. diagram:</b> 3135 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the sum "main setpoint (limited) + additional setpoint" after setpoint reduction.		
<b>Dependency:</b>	Refer to: p51607, p51608, r52195		
<b>Note:</b>	Setpoint reduction is set via p51608 and activated/de-activated via binector input p51607.		
<b>r52195</b>	<b>CO: Setpoint processing setpoint before reduction / Set before reduc</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 1 <b>Func. diagram:</b> 3135 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the sum "main setpoint (limited) + additional setpoint" before setpoint reduction.		
<b>Dependency:</b>	Refer to: p51607, p51608, r52194		
<b>Note:</b>	Setpoint reduction is set via p51608 and activated/de-activated via binector input p51607.		
<b>r52196</b>	<b>CO: Setpoint processing main setpoint upper limit effective / M set up lim eff</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 3135 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the effective upper limit in the case of main setpoint limiting.		
<b>r52197</b>	<b>CO: Setpoint processing main setpoint lower limit effective / M set low lim eff</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 3135 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the effective lower limit in the case of main setpoint limiting.		

<b>r52198</b>	<b>CO: Setpoint processing main setpoint before limiting / M_setp bef lim</b>		
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [%]	Calculated: - Dyn. index: - Units group: - Scaling: PERCENT Max - [%]	Access level: 1 Func. diagram: 3135 Unit selection: - Expert list: 1 Factory setting - [%]
<b>Description:</b>	Display and connector output for the main setpoint before setpoint limiting.		
<b>r52201</b>	<b>CO: Creep setpoint output / Creep set outp</b>		
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [%]	Calculated: - Dyn. index: - Units group: - Scaling: PERCENT Max - [%]	Access level: 2 Func. diagram: 3130 Unit selection: - Expert list: 1 Factory setting - [%]
<b>Description:</b>	Display and connector output for the sum of all creep setpoints (p504441[0 to 7]).		
<b>Dependency:</b>	Refer to: p50440, p50441		
<b>r52202</b>	<b>CO: Jog setpoint output / Jog set outp</b>		
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [%]	Calculated: - Dyn. index: - Units group: - Scaling: PERCENT Max - [%]	Access level: 2 Func. diagram: 3125 Unit selection: - Expert list: 1 Factory setting - [%]
<b>Description:</b>	Display and connector output for the sum of all jog setpoints (p50436[0 to 7]).		
<b>Dependency:</b>	Refer to: p50435, p50436		
<b>r52203</b>	<b>CO: Oscillation square-wave generator setpoint / Oscill sq-w gen</b>		
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [%]	Calculated: - Dyn. index: - Units group: - Scaling: PERCENT Max - [%]	Access level: 2 Func. diagram: 3120 Unit selection: - Expert list: 1 Factory setting - [%]
<b>Description:</b>	Display and connector output for the square-wave generator.		
<b>Dependency:</b>	Refer to: p50480, p50481, p50482, p50483		
<b>r52204</b>	<b>CO: Fixed setpoint output / Fix set outp</b>		
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [%]	Calculated: - Dyn. index: - Units group: - Scaling: PERCENT Max - [%]	Access level: 2 Func. diagram: 3115 Unit selection: - Expert list: 1 Factory setting - [%]
<b>Description:</b>	Display and connector output for the sum of all fixed setpoints (p50431[0 to 7]).		
<b>Dependency:</b>	Refer to: p50430, p50431		



**r52206 CO: Creep setpoint output after selection / Cr set outp**

DC\_CTRL

**Can be changed:** -**Data type:** FloatingPoint32**P-Group:** -**Not for motor type:** -**Min**

- [%]

**Calculated:** -**Dyn. index:** -**Units group:** -**Scaling:** PERCENT**Max**

- [%]

**Access level:** 1**Func. diagram:** 3130**Unit selection:** -**Expert list:** 1**Factory setting**

- [%]

**Description:**

Display and connector output of the setpoint dependent upon creep.

**r52207 CO: Jog setpoint output after selection / Jog set outp**

DC\_CTRL

**Can be changed:** -**Data type:** FloatingPoint32**P-Group:** -**Not for motor type:** -**Min**

- [%]

**Calculated:** -**Dyn. index:** -**Units group:** -**Scaling:** PERCENT**Max**

- [%]

**Access level:** 1**Func. diagram:** 3125**Unit selection:** -**Expert list:** 1**Factory setting**

- [%]

**Description:**

Display and connector output of the setpoint dependent upon jog.

**r52208 CO: Oscillation output after selection / Oscil outp aft sel**

DC\_CTRL

**Can be changed:** -**Data type:** FloatingPoint32**P-Group:** -**Not for motor type:** -**Min**

- [%]

**Calculated:** -**Dyn. index:** -**Units group:** -**Scaling:** PERCENT**Max**

- [%]

**Access level:** 1**Func. diagram:** 3120**Unit selection:** -**Expert list:** 1**Factory setting**

- [%]

**Description:**

Display and connector output of the setpoint dependent upon oscillation selection.

**Note:**

If oscillation is selected (p50485 = 1 signal):

r52208 = r52203

If oscillation is de-selected (p50485 = 0 signal):

r52208 = p50484

**r52209 CO: Fixed setpoint output after selection / Fix set outp**

DC\_CTRL

**Can be changed:** -**Data type:** FloatingPoint32**P-Group:** -**Not for motor type:** -**Min**

- [%]

**Calculated:** -**Dyn. index:** -**Units group:** -**Scaling:** PERCENT**Max**

- [%]

**Access level:** 1**Func. diagram:** 3115**Unit selection:** -**Expert list:** 1**Factory setting**

- [%]

**Description:**

Display and connector output of the sum of all fixed setpoints following selection of at least one connector.

**Dependency:**

Refer to: p50430, p50431

**Note:**

If at least one connector has been selected via p50430[0 to 7]:

r52209 = r52204

If no connectors have been selected via p50430[0 to 7]:

r52209 = r52210

<b>r52210[0...3]</b>	<b>CO: RFG positive limiting inverted after RFG / RFG pos lim inv</b>		
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [%]	Calculated: - Dyn. index: - Units group: - Scaling: PERCENT Max - [%]	Access level: 2 Func. diagram: 3155 Unit selection: - Expert list: 1 Factory setting - [%]
<b>Description:</b>	Display and connector output for the signals interconnected and inverted via connector input p50632[0 to 3].		
<b>Index:</b>	[0] = Signal p50632[0] inverted [1] = Signal p50632[1] inverted [2] = Signal p50632[2] inverted [3] = Signal p50632[3] inverted		
<b>r52211</b>	<b>CO: Fixed setpoint output after AOP30 / Fix set outp AOP</b>		
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [%]	Calculated: - Dyn. index: - Units group: - Scaling: PERCENT Max - [%]	Access level: 1 Func. diagram: 3113 Unit selection: - Expert list: 1 Factory setting - [%]
<b>Description:</b>	Display and connector output for the fixed setpoint after intervention from the advanced operator panel 30 (AOP30).		
<b>Dependency:</b>	Refer to: p50433		
<b>r52240</b>	<b>CO: Motorized potentiometer output / MotP outp</b>		
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [%]	Calculated: - Dyn. index: - Units group: - Scaling: PERCENT Max - [%]	Access level: 2 Func. diagram: 3110 Unit selection: - Expert list: 1 Factory setting - [%]
<b>Description:</b>	Display and connector output on the motorized potentiometer.		
<b>r52241</b>	<b>CO: Motorized potentiometer output dy/dt / MotP outp dy/dt</b>		
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [%]	Calculated: - Dyn. index: - Units group: - Scaling: PERCENT Max - [%]	Access level: 2 Func. diagram: 3110 Unit selection: - Expert list: 1 Factory setting - [%]
<b>Description:</b>	Display and connector output of the dy/dt output on the motorized potentiometer.		
<b>r52242</b>	<b>CO: Motorized potentiometer setpoint / MotP set</b>		
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [%]	Calculated: - Dyn. index: - Units group: - Scaling: PERCENT Max - [%]	Access level: 2 Func. diagram: 3110 Unit selection: - Expert list: 1 Factory setting - [%]
<b>Description:</b>	Display and connector output of the setpoint on the motorized potentiometer.		

<b>r52250</b>	<b>CO: Field firing angle after limiting / Fir ang aft lim</b>		
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [%]	Calculated: - Dyn. index: - Units group: - Scaling: PERCENT Max - [%]	Access level: 1 Func. diagram: 6915 Unit selection: - Expert list: 1 Factory setting - [%]
<b>Description:</b>	Display and connector output for the field firing angle after limiting by the auto-reversing stage.		
<b>r52251</b>	<b>CO: Field firing angle before limiting / Fir ang bef lim</b>		
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [%]	Calculated: - Dyn. index: - Units group: - Scaling: PERCENT Max - [%]	Access level: 1 Func. diagram: 6915 Unit selection: - Expert list: 1 Factory setting - [%]
<b>Description:</b>	Displays the field firing angle before limiting by the auto-reversing stage.		
<b>r52252</b>	<b>CO: CI-loop field curr ctrl prectr and field curr controller output / If_ctr prec+ctrl</b>		
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [%]	Calculated: - Dyn. index: - Units group: - Scaling: PERCENT Max - [%]	Access level: 1 Func. diagram: 6910 Unit selection: - Expert list: 1 Factory setting - [%]
<b>Description:</b>	Display and connector output of the output value from pre-control and the field current controller.		
<b>r52260</b>	<b>CO: Closed-loop field current control current controller output / If_ctr I_ctr outp</b>		
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [%]	Calculated: - Dyn. index: - Units group: - Scaling: PERCENT Max - [%]	Access level: 1 Func. diagram: 6910 Unit selection: - Expert list: 1 Factory setting - [%]
<b>Description:</b>	Display and connector output for the output in the case of closed-loop field current control.		
<b>r52261</b>	<b>CO: CI-loop field curr control curr controller proportional comp / If_ctr I_ctr P com</b>		
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [%]	Calculated: - Dyn. index: - Units group: - Scaling: PERCENT Max - [%]	Access level: 2 Func. diagram: 6910 Unit selection: - Expert list: 1 Factory setting - [%]
<b>Description:</b>	Display and connector output for the proportional component in the case of closed-loop field current control.		

<b>r52262</b>	<b>CO: CI-loop field curr control curr controller integral comp / If_ctr I_ctr I com</b>		
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [%]	Calculated: - Dyn. index: - Units group: - Scaling: PERCENT Max - [%]	Access level: 2 Func. diagram: 6910 Unit selection: - Expert list: 1 Factory setting - [%]
<b>Description:</b>	Display and connector output for the integral component in the case of closed-loop field current control.		
<b>r52263</b>	<b>CO: CI-loop field curr ctrl current controller set/act val diff / If_ctr I_ctr dif</b>		
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [%]	Calculated: - Dyn. index: - Units group: - Scaling: PERCENT Max - [%]	Access level: 1 Func. diagram: 6910 Unit selection: - Expert list: 1 Factory setting - [%]
<b>Description:</b>	Display and connector output for the setpoint/actual value difference in the case of closed-loop field current control.		
<b>r52265</b>	<b>CO: CI-loop field curr ctrl current controller actual value / If_ctr act</b>		
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [%]	Calculated: - Dyn. index: - Units group: - Scaling: PERCENT Max - [%]	Access level: 1 Func. diagram: 6905, 6910, 8025, 8044 Unit selection: - Expert list: 1 Factory setting - [%]
<b>Description:</b>	Display and connector output of the field current controller's actual value.		
<b>r52266</b>	<b>CO: Field current actual value internal absolute value / If_act int abs</b>		
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [%]	Calculated: - Dyn. index: - Units group: - Scaling: PERCENT Max - [%]	Access level: 1 Func. diagram: 6912 Unit selection: - Expert list: 1 Factory setting - [%]
<b>Description:</b>	Displays the absolute value of the internal field current actual value as a percentage of p50073.01.		
<b>r52268</b>	<b>CO: Closed-loop field current control current controller setpoint / If_ctr set</b>		
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [%]	Calculated: - Dyn. index: - Units group: - Scaling: PERCENT Max - [%]	Access level: 1 Func. diagram: 6910, 8025, 8044 Unit selection: - Expert list: 1 Factory setting - [%]
<b>Description:</b>	Display and connector output of the field current controller's setpoint.		

**r52271 CO: Closed-loop field current control pre-control output / If\_ctr prec outp**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6910
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]

**Description:** Display and connector output of pre-control for closed-loop field current control.

**r52273 CO: Field current setpoint limiting upper limit output / If lim up lim**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6905
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]

**Description:** Display and connector output for the upper limit of the field current setpoint.

**Dependency:** Refer to: r50073, p50102, p50613

**r52274 CO: Field current setpoint limiting lower limit output / If lim low lim**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6905
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]

**Description:** Display and connector output for the lower limit of the field current setpoint.

**Dependency:** Refer to: p50103, p50614

**r52275 CO: Field current setpoint limiting output after limiting / If lim outp lim**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6905, 6910
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]

**Description:** Display and connector output for the field current setpoint after field current setpoint limiting.

**Dependency:** Refer to: p50611

**r52276 CO: Field current setpoint limiting output before limiting / If lim outp**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6905
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]

**Description:** Display and connector output for the field current setpoint before field current setpoint limiting.

**Dependency:** Refer to: p50611

<b>r52277</b>	<b>CO: EMF controller pre-control and controller output after selection / EMF prec+ctrl sel</b>		
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [%]	Calculated: - Dyn. index: - Units group: - Scaling: - Max - [%]	Access level: 1 Func. diagram: 6900 Unit selection: - Expert list: 1 Factory setting - [%]
<b>Description:</b>	Display and connector output from pre-control and EMF controller after selection. If p50081 = 0: --> r52277 = 100% If p50081 = 1: --> r52277 = Sum of EMF controller and EMF pre-control outputs		
<b>Dependency:</b>	Refer to: p50081		
<b>r52278</b>	<b>CO: EMF controller pre-control and controller output / EMF prec+ctrl outp</b>		
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [%]	Calculated: - Dyn. index: - Units group: - Scaling: - Max - [%]	Access level: 1 Func. diagram: 6900 Unit selection: - Expert list: 1 Factory setting - [%]
<b>Description:</b>	Display and connector output of the sum of the outputs from EMF pre-control and the EMF controller.		
<b>r52280</b>	<b>CO: EMF controller output / EMF ctr outp</b>		
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [%]	Calculated: - Dyn. index: - Units group: - Scaling: - Max - [%]	Access level: 1 Func. diagram: 6900 Unit selection: - Expert list: 1 Factory setting - [%]
<b>Description:</b>	Display and connector output on the EMF controller.		
<b>r52281</b>	<b>CO: EMF controller proportional component output / EMF ctr P com outp</b>		
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [%]	Calculated: - Dyn. index: - Units group: - Scaling: - Max - [%]	Access level: 2 Func. diagram: 6900 Unit selection: - Expert list: 1 Factory setting - [%]
<b>Description:</b>	Display and connector output of the proportional component on the EMF controller.		
<b>r52282</b>	<b>CO: EMF controller integral component output / EMF ctr I com outp</b>		
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [%]	Calculated: - Dyn. index: - Units group: - Scaling: - Max - [%]	Access level: 2 Func. diagram: 6900 Unit selection: - Expert list: 1 Factory setting - [%]
<b>Description:</b>	Display and connector output of the integral component on the EMF controller.		

<b>r52283</b>	<b>CO: EMF controller setpoint/actual value difference / EMF ctr dif</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 1 <b>Func. diagram:</b> 6900 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output of the setpoint/actual value difference on the EMF controller.		
<b>r52284</b>	<b>CO: EMF controller setpoint/actual value difference after droop / EMF ctr dif droop</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 1 <b>Func. diagram:</b> 6900 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output of the setpoint/actual value difference after droop on the EMF controller.		
<b>r52285</b>	<b>CO: EMF controller actual value / EMF ctr act</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 1 <b>Func. diagram:</b> 6900 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the absolute value of the actual value on the EMF controller.		
<b>Dependency:</b>	Refer to: p50616		
<b>Note:</b>	A value of 100% corresponds to $p50078[0] * (3 * \sqrt{2}) / \text{Pi}$ .		
<b>r52286</b>	<b>CO: Average absolute value of EMF actual value / EMF act abs avg</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6902 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Displays the absolute value of the EMF actual value averaged over the last 3 firing periods (r52287).		
<b>Dependency:</b>	Refer to: r52287		
<b>Note:</b>	100% corresponds to $p50078[0] * (3 * \sqrt{2}) / \text{Pi}$		
<b>r52287</b>	<b>CO: Average EMF actual value / EMF act avg</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6810, 6902, 8046 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Displays the signed EMF actual value averaged over the last 3 firing periods.		
<b>Note:</b>	100% corresponds to $p50078[0] * (3 * \sqrt{2}) / \text{Pi}$		

**r52288 CO: EMF controller setpoint / EMF ctr set**

DC\_CTRL

**Can be changed:** -**Calculated:** -**Access level:** 1**Data type:** FloatingPoint32**Dyn. index:** -**Func. diagram:** 6900**P-Group:** -**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** PERCENT**Expert list:** 1**Min****Max****Factory setting**

- [%]

- [%]

- [%]

**Description:**

Display and connector output for the absolute value of the setpoint on the EMF controller.

**Dependency:**

Refer to: p50615

**Note:**A value of 100% corresponds to  $p50078[0] * (3 * \sqrt{2}) / \pi$ .**r52289 CO: EMF controller setpoint absolute value / EMF ctr set abs**

DC\_CTRL

**Can be changed:** -**Calculated:** -**Access level:** 1**Data type:** FloatingPoint32**Dyn. index:** -**Func. diagram:** 6900**P-Group:** -**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** PERCENT**Expert list:** 1**Min****Max****Factory setting**

- [%]

- [%]

- [%]

**Description:**

Display and connector output for the absolute value of the setpoint on the EMF controller.

**Dependency:**

Refer to: r50039, p50100, p50101, p50110

**Note:**A value of 100% corresponds to  $p50078[0] * (3 * \sqrt{2}) / \pi$ .**r52290 CO: Closed-loop field current control motor flux output / If ctr motor flux**

DC\_CTRL

**Can be changed:** -**Calculated:** -**Access level:** 2**Data type:** FloatingPoint32**Dyn. index:** -**Func. diagram:** 6830, 6835, 6851, 6910**P-Group:** -**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** PERCENT**Expert list:** 1**Min****Max****Factory setting**

- [%]

- [%]

- [%]

**Description:**Display and connector output of the motor flux in the case of closed-loop field current control.  
The value is a percentage of p50102.**r52291 CO: Armature voltage actual value absolute value / Ua act abs**

DC\_CTRL

**Can be changed:** -**Calculated:** -**Access level:** 2**Data type:** FloatingPoint32**Dyn. index:** -**Func. diagram:** 6902**P-Group:** -**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** PERCENT**Expert list:** 1**Min****Max****Factory setting**

- [%]

- [%]

- [%]

**Description:**

Display and connector output for the actual value of the armature voltage as an absolute value.

**Dependency:**

Refer to: r52292

**Note:**100% corresponds to  $p50078[0] * (3 * \sqrt{2}) / \pi$



**r52292 CO: Armature voltage signed actual value / Ua act signed**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6902
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]
<b>Description:</b>	Display and connector output for the signed actual value of the armature voltage.		
<b>Dependency:</b>	Refer to: r52291		
<b>Note:</b>	100% corresponds to $p50078[0] * (3 * \sqrt{2}) / \pi$		

**r52293 CO: EMF controller pre-control output / EMF ctr prec outp**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 1
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6900, 6910
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]
<b>Description:</b>	Display and connector output for pre-control on the EMF controller.		
<b>Dependency:</b>	Refer to: p50273		

**r52294 CO: EMF setpoint reduction output / EMF setp\_red outp**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6895
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]
<b>Description:</b>	Display and connector output for the EMF setpoint reduction.		
<b>Dependency:</b>	Refer to: p50287, p50288		

**r52295 CO: Field voltage actual value absolute value / Uf act abs**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6902
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]
<b>Description:</b>	Display and connector output for the actual value of the field voltage as an absolute value.		
<b>Dependency:</b>	Refer to: r52296		
<b>Note:</b>	100% corresponds to $p50078[1] * (3 * \sqrt{2}) / \pi$		

**r52296 CO: Field voltage actual value signed / Uf act val sign**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6902
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]
<b>Description:</b>	Display and connector output for the signed actual value of the field voltage.		
<b>Dependency:</b>	Refer to: r52295		

**Note:** 100% corresponds to  $p50078[1] * (3 * \sqrt{2}) / \pi$ .

---

**r52301 CO: Armature line voltage U-V / Arm V\_line U-V**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6950
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]

**Description:** Display and connector output for the line voltage U-V in the armature circuit.

---

**r52302 CO: Armature line voltage V-W / Arm V\_line V-W**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6950
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]

**Description:** Display and connector output for the line voltage V-W in the armature circuit.

---

**r52303 CO: Armature line voltage W-U / Arm V\_line W-U**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6950
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]

**Description:** Display and connector output for the line voltage W-U in the armature circuit.

---

**r52304 CO: Field line voltage / Field V\_line**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6910, 6952
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]

**Description:** Display and connector output for the line voltage in the field circuit.

---

**r52305 CO: Average armature line voltage / Arm V\_line avg**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6950, 6855
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]

**Description:** Display and connector output for the average line voltage over the 3 phases in the armature circuit.

<b>r52306</b>	<b>CO: Armature line frequency / Arm f_line</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6855, 6950 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the line frequency in the armature circuit. The value is a percentage of 50 Hz.		
<b>r52307</b>	<b>CO: Average motor power supplied / Mot P supp avg</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6902 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the average motor power supplied.		
<b>Dependency:</b>	Refer to: r52109, r52287		
<b>r52309</b>	<b>CO: Calculated motor temperature rise / Calc mot temp rise</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 8038 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the calculated motor temperature rise.		
<b>Dependency:</b>	Refer to: p50114		
<b>r52310</b>	<b>CO: I2t monitoring thyristor temperature rise / I2t thyr temp rise</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 8042 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the calculated thyristor temperature rise as a percentage of the maximum temperature.		
<b>r52316</b>	<b>CO: Field line frequency / Field f_line</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 6952 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output for the field line frequency. The value is a percentage of 50 Hz.		

<b>r52320</b>	<b>CO: Armature current control counter EMF ratio / V_counter_ratio</b>		
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min -	Calculated: - Dyn. index: - Units group: - Scaling: - Max -	Access level: 2 Func. diagram: 6855 Unit selection: - Expert list: 1 Factory setting -
<b>Description:</b>	Display and connector output of the counter EMF ratio EMF/V_line.		
<b>Dependency:</b>	Refer to: r52122, r52305		
<b>r52350</b>	<b>CO: Adaptation armature current control output / Adapt Ia_ctrl outp</b>		
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [%]	Calculated: - Dyn. index: - Units group: - Scaling: PERCENT Max - [%]	Access level: 2 Func. diagram: 6853 Unit selection: - Expert list: 1 Factory setting - [%]
<b>Description:</b>	Display and connector output for the armature current controller adaptation.		
<b>Dependency:</b>	Refer to: p50572, p50573, p50574		
<b>r52355</b>	<b>CO: Adaptation field current control output / Adapt If_ctrl outp</b>		
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [%]	Calculated: - Dyn. index: - Units group: - Scaling: PERCENT Max - [%]	Access level: 2 Func. diagram: 6908 Unit selection: - Expert list: 1 Factory setting - [%]
<b>Description:</b>	Display and connector output for the field current controller adaptation.		
<b>Dependency:</b>	Refer to: p50577, p50578		
<b>r52401</b>	<b>CO: Fixed value 1 / Fix val 1</b>		
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [%]	Calculated: - Dyn. index: - Units group: - Scaling: PERCENT Max - [%]	Access level: 2 Func. diagram: 3100 Unit selection: - Expert list: 1 Factory setting - [%]
<b>Description:</b>	Connector output for fixed value 1 set in p50401.		
<b>Dependency:</b>	Refer to: p50401		
<b>r52402</b>	<b>CO: Fixed value 2 / Fix val 2</b>		
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [%]	Calculated: - Dyn. index: - Units group: - Scaling: PERCENT Max - [%]	Access level: 2 Func. diagram: 3100 Unit selection: - Expert list: 1 Factory setting - [%]
<b>Description:</b>	Connector output for fixed value 2 set in p50402.		
<b>Dependency:</b>	Refer to: p50402		

**r52403 CO: Fixed value 3 / Fix val 3**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 3100
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]
<b>Description:</b>	Connector output for fixed value 3 set in p50403.		
<b>Dependency:</b>	Refer to: p50403		

**r52404 CO: Fixed value 4 / Fix val 4**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 3100
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]
<b>Description:</b>	Connector output for fixed value 4 set in p50404.		
<b>Dependency:</b>	Refer to: p50404		

**r52405 CO: Fixed value 5 / Fix val 5**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 3100
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]
<b>Description:</b>	Connector output for fixed value 5 set in p50405.		
<b>Dependency:</b>	Refer to: p50405		

**r52406 CO: Fixed value 6 / Fix val 6**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 3100
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]
<b>Description:</b>	Connector output for fixed value 6 set in p50406.		
<b>Dependency:</b>	Refer to: p50406		

**r52407 CO: Fixed value 7 / Fix val 7**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 3100
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]
<b>Description:</b>	Connector output for fixed value 7 set in p50407.		
<b>Dependency:</b>	Refer to: p50407		

<b>r52408</b>	<b>CO: Fixed value 8 / Fix val 8</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 3100 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Connector output for fixed value 8 set in p50408.		
<b>Dependency:</b>	Refer to: p50408		
<b>r52409</b>	<b>CO: Fixed value 9 / Fix val 9</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 3100 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Connector output for fixed value 9 set in p50409.		
<b>Dependency:</b>	Refer to: p50409		
<b>r52410</b>	<b>CO: Fixed value 10 / Fix val 10</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 3100 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Connector output for fixed value 10 set in p50410.		
<b>Dependency:</b>	Refer to: p50410		
<b>r52411</b>	<b>CO: Fixed value 11 / Fix val 11</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 3100 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Connector output for fixed value 11 set in p50411.		
<b>Dependency:</b>	Refer to: p50411		
<b>r52412</b>	<b>CO: Fixed value 12 / Fix val 12</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 3100 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Connector output for fixed value 12 set in p50412.		
<b>Dependency:</b>	Refer to: p50412		

**r52413 CO: Fixed value 13 / Fix val 13**

DC\_CTRL

**Can be changed:** -**Data type:** FloatingPoint32**P-Group:** -**Not for motor type:** -**Min**

- [%]

**Calculated:** -**Dyn. index:** -**Units group:** -**Scaling:** PERCENT**Max**

- [%]

**Access level:** 2**Func. diagram:** 3100**Unit selection:** -**Expert list:** 1**Factory setting**

- [%]

**Description:** Connector output for fixed value 13 set in p50413.**Dependency:** Refer to: p50413**r52414 CO: Fixed value 14 / Fix val 14**

DC\_CTRL

**Can be changed:** -**Data type:** FloatingPoint32**P-Group:** -**Not for motor type:** -**Min**

- [%]

**Calculated:** -**Dyn. index:** -**Units group:** -**Scaling:** PERCENT**Max**

- [%]

**Access level:** 2**Func. diagram:** 3100**Unit selection:** -**Expert list:** 1**Factory setting**

- [%]

**Description:** Connector output for fixed value 14 set in p50414.**Dependency:** Refer to: p50414**r52415 CO: Fixed value 15 / Fix val 15**

DC\_CTRL

**Can be changed:** -**Data type:** FloatingPoint32**P-Group:** -**Not for motor type:** -**Min**

- [%]

**Calculated:** -**Dyn. index:** -**Units group:** -**Scaling:** PERCENT**Max**

- [%]

**Access level:** 2**Func. diagram:** 3100**Unit selection:** -**Expert list:** 1**Factory setting**

- [%]

**Description:** Connector output for fixed value 15 set in p50415.**Dependency:** Refer to: p50415**r52416 CO: Fixed value 16 / Fix val 16**

DC\_CTRL

**Can be changed:** -**Data type:** FloatingPoint32**P-Group:** -**Not for motor type:** -**Min**

- [%]

**Calculated:** -**Dyn. index:** -**Units group:** -**Scaling:** PERCENT**Max**

- [%]

**Access level:** 2**Func. diagram:** 3100**Unit selection:** -**Expert list:** 1**Factory setting**

- [%]

**Description:** Connector output for fixed value 16 set in p50416.**Dependency:** Refer to: p50416**r52451 CO: Speed controller start pulse positive setpoint / Start pul pos set**

DC\_CTRL

**Can be changed:** -**Data type:** FloatingPoint32**P-Group:** -**Not for motor type:** -**Min**

- [%]

**Calculated:** -**Dyn. index:** -**Units group:** -**Scaling:** PERCENT**Max**

- [%]

**Access level:** 2**Func. diagram:** 6800**Unit selection:** -**Expert list:** 1**Factory setting**

- [%]

**Description:** Display and connector output for the positive setpoint of the start pulse on the speed controller.

**r52452 CO: Speed controller start pulse negative setpoint evaluated / Start pul neg set**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6800
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]

**Description:** Display and connector output for the negative setpoint of the start pulse on the speed controller.  
The setpoint is evaluated via p51652.

**Dependency:** Refer to: p51652

**r52453 CO: Speed controller start pulse negative setpoint / Start pul neg set**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6800
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]

**Description:** Display and connector output for the negative setpoint of the start pulse on the speed controller.

**r52454 CO: Speed controller start pulse output value / Start pul outp val**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6800
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]

**Description:** Display and connector output for the output value of the start pulse on the speed controller.

**r52510 CO: Master switch setpoint output / Set outp**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 3105
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]

**Description:** Display and connector output for the setpoint prevailing on the 4-step master switch.

**r52601 CO: P2P IF receive data word 1 / P2P recv 1**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9300
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]

**Description:** Display and connector output for word 1 of the receive data on the peer-to-peer interface (P2P IF).

**Dependency:** Refer to: r52606



<b>r52602</b>		<b>CO: P2P IF receive data word 2 / P2P rcv 2</b>			
DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2		
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9300		
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -		
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1		
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>		
	- [%]	- [%]	- [%]		
<b>Description:</b>	Display and connector output for word 2 of the receive data on the peer-to-peer interface (P2P IF).				
<b>Dependency:</b>	Refer to: r52607				
<b>r52603</b>		<b>CO: P2P IF receive data word 3 / P2P rcv 3</b>			
DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2		
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9300		
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -		
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1		
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>		
	- [%]	- [%]	- [%]		
<b>Description:</b>	Display and connector output for word 3 of the receive data on the peer-to-peer interface (P2P IF).				
<b>Dependency:</b>	Refer to: r52608				
<b>r52604</b>		<b>CO: P2P IF receive data word 4 / P2P rcv 4</b>			
DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2		
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9300		
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -		
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1		
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>		
	- [%]	- [%]	- [%]		
<b>Description:</b>	Display and connector output for word 4 of the receive data on the peer-to-peer interface (P2P IF).				
<b>Dependency:</b>	Refer to: r52609				
<b>r52605</b>		<b>CO: P2P IF receive data word 5 / P2P rcv 5</b>			
DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2		
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9300		
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -		
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1		
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>		
	- [%]	- [%]	- [%]		
<b>Description:</b>	Display and connector output for word 5 of the receive data on the peer-to-peer interface (P2P IF).				
<b>Dependency:</b>	Refer to: r52610				
<b>r52606.0...15</b>		<b>CO/BO: P2P IF receive data word 1 bit by bit / P2P rcv 1 bbb</b>			
DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2		
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9300		
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -		
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1		
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>		
	-	-	-		
<b>Description:</b>	Binector output for the bit-by-bit interconnection of word 1 of the receive data on the peer-to-peer interface (P2P IF).				
<b>Bit field:</b>	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>	<b>FP</b>
	00	P2P IF receive data bit 0	1	0	9300
	01	P2P IF receive data bit 1	1	0	9300

02	P2P IF receive data bit 2	1	0	9300
03	P2P IF receive data bit 3	1	0	9300
04	P2P IF receive data bit 4	1	0	9300
05	P2P IF receive data bit 5	1	0	9300
06	P2P IF receive data bit 6	1	0	9300
07	P2P IF receive data bit 7	1	0	9300
08	P2P IF receive data bit 8	1	0	9300
09	P2P IF receive data bit 9	1	0	9300
10	P2P IF receive data bit 10	1	0	9300
11	P2P IF receive data bit 11	1	0	9300
12	P2P IF receive data bit 12	1	0	9300
13	P2P IF receive data bit 13	1	0	9300
14	P2P IF receive data bit 14	1	0	9300
15	P2P IF receive data bit 15	1	0	9300

Dependency: Refer to: r52601

#### r52607.0...15 CO/BO: P2P IF receive data word 2 bit by bit / P2P recv 2 bbb

DC_CTRL	Can be changed: -	Calculated: -	Access level: 2
	Data type: Unsigned16	Dyn. index: -	Func. diagram: 9300
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min	Max	Factory setting
	-	-	-

Description: Binector output for the bit-by-bit interconnection of word 2 of the receive data on the peer-to-peer interface (P2P IF).

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	P2P IF receive data bit 0	1	0	9300
	01	P2P IF receive data bit 1	1	0	9300
	02	P2P IF receive data bit 2	1	0	9300
	03	P2P IF receive data bit 3	1	0	9300
	04	P2P IF receive data bit 4	1	0	9300
	05	P2P IF receive data bit 5	1	0	9300
	06	P2P IF receive data bit 6	1	0	9300
	07	P2P IF receive data bit 7	1	0	9300
	08	P2P IF receive data bit 8	1	0	9300
	09	P2P IF receive data bit 9	1	0	9300
	10	P2P IF receive data bit 10	1	0	9300
	11	P2P IF receive data bit 11	1	0	9300
	12	P2P IF receive data bit 12	1	0	9300
	13	P2P IF receive data bit 13	1	0	9300
	14	P2P IF receive data bit 14	1	0	9300
	15	P2P IF receive data bit 15	1	0	9300

Dependency: Refer to: r52602

#### r52608.0...15 CO/BO: P2P IF receive data word 3 bit by bit / P2P recv 3 bbb

DC_CTRL	Can be changed: -	Calculated: -	Access level: 2
	Data type: Unsigned16	Dyn. index: -	Func. diagram: 9300
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min	Max	Factory setting
	-	-	-

Description: Binector output for the bit-by-bit interconnection of word 3 of the receive data on the peer-to-peer interface (P2P IF).

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	P2P IF receive data bit 0	1	0	9300
	01	P2P IF receive data bit 1	1	0	9300
	02	P2P IF receive data bit 2	1	0	9300
	03	P2P IF receive data bit 3	1	0	9300
	04	P2P IF receive data bit 4	1	0	9300
	05	P2P IF receive data bit 5	1	0	9300

06	P2P IF receive data bit 6	1	0	9300
07	P2P IF receive data bit 7	1	0	9300
08	P2P IF receive data bit 8	1	0	9300
09	P2P IF receive data bit 9	1	0	9300
10	P2P IF receive data bit 10	1	0	9300
11	P2P IF receive data bit 11	1	0	9300
12	P2P IF receive data bit 12	1	0	9300
13	P2P IF receive data bit 13	1	0	9300
14	P2P IF receive data bit 14	1	0	9300
15	P2P IF receive data bit 15	1	0	9300

**Dependency:** Refer to: r52603

#### **r52609.0...15 CO/BO: P2P IF receive data word 4 bit by bit / P2P recv 4 bbb**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9300
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Binector output for the bit-by-bit interconnection of word 4 of the receive data on the peer-to-peer interface (P2P IF).

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	P2P IF receive data bit 0	1	0	9300
	01	P2P IF receive data bit 1	1	0	9300
	02	P2P IF receive data bit 2	1	0	9300
	03	P2P IF receive data bit 3	1	0	9300
	04	P2P IF receive data bit 4	1	0	9300
	05	P2P IF receive data bit 5	1	0	9300
	06	P2P IF receive data bit 6	1	0	9300
	07	P2P IF receive data bit 7	1	0	9300
	08	P2P IF receive data bit 8	1	0	9300
	09	P2P IF receive data bit 9	1	0	9300
	10	P2P IF receive data bit 10	1	0	9300
	11	P2P IF receive data bit 11	1	0	9300
	12	P2P IF receive data bit 12	1	0	9300
	13	P2P IF receive data bit 13	1	0	9300
	14	P2P IF receive data bit 14	1	0	9300
	15	P2P IF receive data bit 15	1	0	9300

**Dependency:** Refer to: r52604

#### **r52610.0...15 CO/BO: P2P IF receive data word 5 bit by bit / P2P recv 5 bbb**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9300
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Binector output for the bit-by-bit interconnection of word 5 of the receive data on the peer-to-peer interface (P2P IF).

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	P2P IF receive data bit 0	1	0	9300
	01	P2P IF receive data bit 1	1	0	9300
	02	P2P IF receive data bit 2	1	0	9300
	03	P2P IF receive data bit 3	1	0	9300
	04	P2P IF receive data bit 4	1	0	9300
	05	P2P IF receive data bit 5	1	0	9300
	06	P2P IF receive data bit 6	1	0	9300
	07	P2P IF receive data bit 7	1	0	9300
	08	P2P IF receive data bit 8	1	0	9300
	09	P2P IF receive data bit 9	1	0	9300

10	P2P IF receive data bit 10	1	0	9300
11	P2P IF receive data bit 11	1	0	9300
12	P2P IF receive data bit 12	1	0	9300
13	P2P IF receive data bit 13	1	0	9300
14	P2P IF receive data bit 14	1	0	9300
15	P2P IF receive data bit 15	1	0	9300

**Dependency:** Refer to: r52605

#### r52620.0...15 CO/BO: Binector-connector converter output / Bin/con outp

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9300
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Display and connector output on the binector-connector converter.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	P2P binector-connector converter bit 0	1	0	9300
	01	P2P binector-connector converter bit 1	1	0	9300
	02	P2P binector-connector converter bit 2	1	0	9300
	03	P2P binector-connector converter bit 3	1	0	9300
	04	P2P binector-connector converter bit 4	1	0	9300
	05	P2P binector-connector converter bit 5	1	0	9300
	06	P2P binector-connector converter bit 6	1	0	9300
	07	P2P binector-connector converter bit 7	1	0	9300
	08	P2P binector-connector converter bit 8	1	0	9300
	09	P2P binector-connector converter bit 9	1	0	9300
	10	P2P binector-connector converter bit 10	1	0	9300
	11	P2P binector-connector converter bit 11	1	0	9300
	12	P2P binector-connector converter bit 12	1	0	9300
	13	P2P binector-connector converter bit 13	1	0	9300
	14	P2P binector-connector converter bit 14	1	0	9300
	15	P2P binector-connector converter bit 15	1	0	9300

**Dependency:** Refer to: p51117

**Note:** The individual signals supplied via binector input p51117[0 to 15] are combined to form connector output r52620.

#### r52700[0...15] CO: Parallel interface master receive data word by word / Master recv wbw

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9352
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]

**Description:** Display and connector output of the word-by-word receive data from the master on the parallel interface.

**Index:**

- [0] = Word 1
- [1] = Word 2
- [2] = Word 3
- [3] = Word 4
- [4] = Word 5
- [5] = Word 6
- [6] = Word 7
- [7] = Word 8
- [8] = Word 9
- [9] = Word 10
- [10] = Word 11
- [11] = Word 12
- [12] = Word 13
- [13] = Word 14

	[14] = Word 15 [15] = Word 16
<b>Dependency:</b>	Refer to: r52720
<b>Note:</b>	The receive data in word 1 is also available in non-scaled format bit by bit and word by word for further interconnection.

---

**r52701[0...15] CO: Parallel interface slave 1 receive data word by word / Slave1 recv wbw**


---

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9352
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]

**Description:** Display and connector output of the word-by-word receive data from slave 1 on the parallel interface.

**Index:**  
 [0] = Word 1  
 [1] = Word 2  
 [2] = Word 3  
 [3] = Word 4  
 [4] = Word 5  
 [5] = Word 6  
 [6] = Word 7  
 [7] = Word 8  
 [8] = Word 9  
 [9] = Word 10  
 [10] = Word 11  
 [11] = Word 12  
 [12] = Word 13  
 [13] = Word 14  
 [14] = Word 15  
 [15] = Word 16

**Dependency:** Refer to: r52721

**Note:** The receive data in word 1 is also available in non-scaled format bit by bit and word by word for further interconnection.

---

**r52702[0...15] CO: Parallel interface slave 2 receive data word by word / Slave2 recv wbw**


---

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9352
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]

**Description:** Display and connector output of the word-by-word receive data from slave 2 on the parallel interface.

**Index:**  
 [0] = Word 1  
 [1] = Word 2  
 [2] = Word 3  
 [3] = Word 4  
 [4] = Word 5  
 [5] = Word 6  
 [6] = Word 7  
 [7] = Word 8  
 [8] = Word 9  
 [9] = Word 10  
 [10] = Word 11  
 [11] = Word 12  
 [12] = Word 13  
 [13] = Word 14  
 [14] = Word 15  
 [15] = Word 16

**Dependency:** Refer to: r52722

**Note:** The receive data in word 1 is also available in non-scaled format bit by bit and word by word for further interconnection.

---

**r52703[0...15] CO: Parallel interface slave 3 receive data word by word / Slave3 recv wbw**


---

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9352
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]

**Description:** Display and connector output of the word-by-word receive data from slave 3 on the parallel interface.

**Index:**

- [0] = Word 1
- [1] = Word 2
- [2] = Word 3
- [3] = Word 4
- [4] = Word 5
- [5] = Word 6
- [6] = Word 7
- [7] = Word 8
- [8] = Word 9
- [9] = Word 10
- [10] = Word 11
- [11] = Word 12
- [12] = Word 13
- [13] = Word 14
- [14] = Word 15
- [15] = Word 16

**Dependency:** Refer to: r52723

**Note:** The receive data in word 1 is also available in non-scaled format bit by bit and word by word for further interconnection.

---

**r52704[0...15] CO: Parallel interface slave 4 receive data word by word / Slave4 recv wbw**


---

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9352
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]

**Description:** Display and connector output of the word-by-word receive data from slave 4 on the parallel interface.

**Index:**

- [0] = Word 1
- [1] = Word 2
- [2] = Word 3
- [3] = Word 4
- [4] = Word 5
- [5] = Word 6
- [6] = Word 7
- [7] = Word 8
- [8] = Word 9
- [9] = Word 10
- [10] = Word 11
- [11] = Word 12
- [12] = Word 13
- [13] = Word 14
- [14] = Word 15
- [15] = Word 16

**Dependency:** Refer to: r52724

**Note:** The receive data in word 1 is also available in non-scaled format bit by bit and word by word for further interconnection.

<b>r52705[0...15] CO: Parallel interface slave 5 receive data word by word / Slave5 recv wbw</b>			
<b>DC_CTRL</b>	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9352
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> - [%]	<b>Max</b> - [%]	<b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output of the word-by-word receive data from slave 5 on the parallel interface.		
<b>Index:</b>	[0] = Word 1 [1] = Word 2 [2] = Word 3 [3] = Word 4 [4] = Word 5 [5] = Word 6 [6] = Word 7 [7] = Word 8 [8] = Word 9 [9] = Word 10 [10] = Word 11 [11] = Word 12 [12] = Word 13 [13] = Word 14 [14] = Word 15 [15] = Word 16		
<b>Dependency:</b>	Refer to: r52725		
<b>Note:</b>	The receive data in word 1 is also available in non-scaled format bit by bit and word by word for further interconnection.		

<b>r52706[0...15] CO: Parallel interface slave 6 receive data word by word / Slave6 recv wbw</b>			
<b>DC_CTRL</b>	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9352
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> - [%]	<b>Max</b> - [%]	<b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output of the word-by-word receive data from slave 6 on the parallel interface.		
<b>Index:</b>	[0] = Word 1 [1] = Word 2 [2] = Word 3 [3] = Word 4 [4] = Word 5 [5] = Word 6 [6] = Word 7 [7] = Word 8 [8] = Word 9 [9] = Word 10 [10] = Word 11 [11] = Word 12 [12] = Word 13 [13] = Word 14 [14] = Word 15 [15] = Word 16		
<b>Dependency:</b>	Refer to: r52726		
<b>Note:</b>	The receive data in word 1 is also available in non-scaled format bit by bit and word by word for further interconnection.		

<b>r52707[0...15] CO: Parallel interface slave 7 receive data word by word / Slave7 recv wbw</b>			
DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9352
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> - [%]	<b>Max</b> - [%]	<b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output of the word-by-word receive data from slave 7 on the parallel interface.		
<b>Index:</b>	[0] = Word 1 [1] = Word 2 [2] = Word 3 [3] = Word 4 [4] = Word 5 [5] = Word 6 [6] = Word 7 [7] = Word 8 [8] = Word 9 [9] = Word 10 [10] = Word 11 [11] = Word 12 [12] = Word 13 [13] = Word 14 [14] = Word 15 [15] = Word 16		
<b>Dependency:</b>	Refer to: r52727		
<b>Note:</b>	The receive data in word 1 is also available in non-scaled format bit by bit and word by word for further interconnection.		

<b>r52708[0...15] CO: Parallel interface slave 8 receive data word by word / Slave8 recv wbw</b>			
DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9352
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b> - [%]	<b>Max</b> - [%]	<b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output of the word-by-word receive data from slave 8 on the parallel interface.		
<b>Index:</b>	[0] = Word 1 [1] = Word 2 [2] = Word 3 [3] = Word 4 [4] = Word 5 [5] = Word 6 [6] = Word 7 [7] = Word 8 [8] = Word 9 [9] = Word 10 [10] = Word 11 [11] = Word 12 [12] = Word 13 [13] = Word 14 [14] = Word 15 [15] = Word 16		
<b>Dependency:</b>	Refer to: r52728		
<b>Note:</b>	The receive data in word 1 is also available in non-scaled format bit by bit and word by word for further interconnection.		



<b>r52709[0...15] CO: Parallel interface slave 9 receive data word by word / Slave9 recv wbw</b>			
DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9352
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]
<b>Description:</b>	Display and connector output of the word-by-word receive data from slave 9 on the parallel interface.		
<b>Index:</b>	[0] = Word 1 [1] = Word 2 [2] = Word 3 [3] = Word 4 [4] = Word 5 [5] = Word 6 [6] = Word 7 [7] = Word 8 [8] = Word 9 [9] = Word 10 [10] = Word 11 [11] = Word 12 [12] = Word 13 [13] = Word 14 [14] = Word 15 [15] = Word 16		
<b>Dependency:</b>	Refer to: r52729		
<b>Note:</b>	The receive data in word 1 is also available in non-scaled format bit by bit and word by word for further interconnection.		

<b>r52710[0...15] CO: Parallel interface slave 10 receive data word by word / Slave10 recv wbw</b>			
DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9352
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]
<b>Description:</b>	Display and connector output of the word-by-word receive data from slave 10 on the parallel interface.		
<b>Index:</b>	[0] = Word 1 [1] = Word 2 [2] = Word 3 [3] = Word 4 [4] = Word 5 [5] = Word 6 [6] = Word 7 [7] = Word 8 [8] = Word 9 [9] = Word 10 [10] = Word 11 [11] = Word 12 [12] = Word 13 [13] = Word 14 [14] = Word 15 [15] = Word 16		
<b>Dependency:</b>	Refer to: r52730		
<b>Note:</b>	The receive data in word 1 is also available in non-scaled format bit by bit and word by word for further interconnection.		

<b>r52711[0...15]</b>	<b>CO: Parallel interface slave 11 receive data word by word / Slave11 recv wbw</b>		
DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9352
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]
<b>Description:</b>	Display and connector output of the word-by-word receive data from slave 11 on the parallel interface.		
<b>Index:</b>	[0] = Word 1 [1] = Word 2 [2] = Word 3 [3] = Word 4 [4] = Word 5 [5] = Word 6 [6] = Word 7 [7] = Word 8 [8] = Word 9 [9] = Word 10 [10] = Word 11 [11] = Word 12 [12] = Word 13 [13] = Word 14 [14] = Word 15 [15] = Word 16		
<b>Dependency:</b>	Refer to: r52731		
<b>Note:</b>	The receive data in word 1 is also available in non-scaled format bit by bit and word by word for further interconnection.		

<b>r52712[0...15]</b>	<b>CO: Parallel interface slave 12 receive data word by word / Slave12 recv wbw</b>		
DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9352
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]
<b>Description:</b>	Display and connector output of the word-by-word receive data from slave 12 on the parallel interface.		
<b>Index:</b>	[0] = Word 1 [1] = Word 2 [2] = Word 3 [3] = Word 4 [4] = Word 5 [5] = Word 6 [6] = Word 7 [7] = Word 8 [8] = Word 9 [9] = Word 10 [10] = Word 11 [11] = Word 12 [12] = Word 13 [13] = Word 14 [14] = Word 15 [15] = Word 16		
<b>Dependency:</b>	Refer to: r52732		
<b>Note:</b>	The receive data in word 1 is also available in non-scaled format bit by bit and word by word for further interconnection.		

<b>r52713[0...15] CO: Parallel interface slave 13 receive data word by word / Slave13 recv wbw</b>			
DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9352
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]
<b>Description:</b>	Display and connector output of the word-by-word receive data from slave 13 on the parallel interface.		
<b>Index:</b>	[0] = Word 1 [1] = Word 2 [2] = Word 3 [3] = Word 4 [4] = Word 5 [5] = Word 6 [6] = Word 7 [7] = Word 8 [8] = Word 9 [9] = Word 10 [10] = Word 11 [11] = Word 12 [12] = Word 13 [13] = Word 14 [14] = Word 15 [15] = Word 16		
<b>Dependency:</b>	Refer to: r52733		
<b>Note:</b>	The receive data in word 1 is also available in non-scaled format bit by bit and word by word for further interconnection.		

<b>r52714[0...15] CO: Parallel interface slave 14 receive data word by word / Slave14 recv wbw</b>			
DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9352
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]
<b>Description:</b>	Display and connector output of the word-by-word receive data from slave 14 on the parallel interface.		
<b>Index:</b>	[0] = Word 1 [1] = Word 2 [2] = Word 3 [3] = Word 4 [4] = Word 5 [5] = Word 6 [6] = Word 7 [7] = Word 8 [8] = Word 9 [9] = Word 10 [10] = Word 11 [11] = Word 12 [12] = Word 13 [13] = Word 14 [14] = Word 15 [15] = Word 16		
<b>Dependency:</b>	Refer to: r52734		
<b>Note:</b>	The receive data in word 1 is also available in non-scaled format bit by bit and word by word for further interconnection.		

<b>r52715[0...15]</b>	<b>CO: Parallel interface slave 15 receive data word by word / Slave15 recv wbw</b>		
DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9352
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]
<b>Description:</b>	Display and connector output of the word-by-word receive data from slave 15 on the parallel interface.		
<b>Index:</b>	[0] = Word 1 [1] = Word 2 [2] = Word 3 [3] = Word 4 [4] = Word 5 [5] = Word 6 [6] = Word 7 [7] = Word 8 [8] = Word 9 [9] = Word 10 [10] = Word 11 [11] = Word 12 [12] = Word 13 [13] = Word 14 [14] = Word 15 [15] = Word 16		
<b>Dependency:</b>	Refer to: r52735		
<b>Note:</b>	The receive data in word 1 is also available in non-scaled format bit by bit and word by word for further interconnection.		

<b>r52716[0...15]</b>	<b>CO: Parallel interface slave 16 receive data word by word / Slave16 recv wbw</b>		
DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9352
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]
<b>Description:</b>	Display and connector output of the word-by-word receive data from slave 16 on the parallel interface.		
<b>Index:</b>	[0] = Word 1 [1] = Word 2 [2] = Word 3 [3] = Word 4 [4] = Word 5 [5] = Word 6 [6] = Word 7 [7] = Word 8 [8] = Word 9 [9] = Word 10 [10] = Word 11 [11] = Word 12 [12] = Word 13 [13] = Word 14 [14] = Word 15 [15] = Word 16		
<b>Dependency:</b>	Refer to: r52736		
<b>Note:</b>	The receive data in word 1 is also available in non-scaled format bit by bit and word by word for further interconnection.		

<b>r52720.0...15</b>	<b>CO/BO: Parallel interface master receive word 1 bit by bit / Master recv1 bbb</b>				
DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2		
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9352		
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -		
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1		
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>		
	-	-	-		
<b>Description:</b>	Display and binector/connector output for receive word 1 from the master on the parallel interface.				
<b>Bit field:</b>	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>	<b>FP</b>
	00	Bit 0	Yes	No	9352
	01	Bit 1	Yes	No	9352
	02	Bit 2	Yes	No	9352
	03	Bit 3	Yes	No	9352
	04	Bit 4	Yes	No	9352
	05	Bit 5	Yes	No	9352
	06	Bit 6	Yes	No	9352
	07	Bit 7	Yes	No	9352
	08	Bit 8	Yes	No	9352
	09	Bit 9	Yes	No	9352
	10	Bit 10	Yes	No	9352
	11	Bit 11	Yes	No	9352
	12	Bit 12	Yes	No	9352
	13	Bit 13	Yes	No	9352
	14	Bit 14	Yes	No	9352
	15	Bit 15	Yes	No	9352
<b>Dependency:</b>	Refer to: r52700				
<b>Note:</b>	Receive word 1 is also available scaled word by word for further interconnection.				

<b>r52721.0...15</b>	<b>CO/BO: Parallel interface slave 1 receive word 1 bit by bit / Slave1 recv1 bbb</b>				
DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2		
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9352		
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -		
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1		
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>		
	-	-	-		
<b>Description:</b>	Display and binector/connector output for receive word 1 from slave 1 on the parallel interface.				
<b>Bit field:</b>	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>	<b>FP</b>
	00	Bit 0	Yes	No	9352
	01	Bit 1	Yes	No	9352
	02	Bit 2	Yes	No	9352
	03	Bit 3	Yes	No	9352
	04	Bit 4	Yes	No	9352
	05	Bit 5	Yes	No	9352
	06	Bit 6	Yes	No	9352
	07	Bit 7	Yes	No	9352
	08	Bit 8	Yes	No	9352
	09	Bit 9	Yes	No	9352
	10	Bit 10	Yes	No	9352
	11	Bit 11	Yes	No	9352
	12	Bit 12	Yes	No	9352
	13	Bit 13	Yes	No	9352
	14	Bit 14	Yes	No	9352
	15	Bit 15	Yes	No	9352
<b>Dependency:</b>	Refer to: r52701				
<b>Note:</b>	Receive word 1 is also available scaled word by word for further interconnection.				

<b>r52722.0...15 CO/BO: Parallel interface slave 2 receive word 1 bit by bit / Slave2 recv1 bbb</b>				
DC_CTRL	<b>Can be changed:</b> -		<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16		<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9352
	<b>P-Group:</b> -		<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -		<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>		<b>Max</b>	<b>Factory setting</b>
	-		-	-
<b>Description:</b> Display and binector/connector output for receive word 1 from slave 2 on the parallel interface.				
<b>Bit field:</b>				
	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>
	00	Bit 0	Yes	No
	01	Bit 1	Yes	No
	02	Bit 2	Yes	No
	03	Bit 3	Yes	No
	04	Bit 4	Yes	No
	05	Bit 5	Yes	No
	06	Bit 6	Yes	No
	07	Bit 7	Yes	No
	08	Bit 8	Yes	No
	09	Bit 9	Yes	No
	10	Bit 10	Yes	No
	11	Bit 11	Yes	No
	12	Bit 12	Yes	No
	13	Bit 13	Yes	No
	14	Bit 14	Yes	No
	15	Bit 15	Yes	No
<b>Dependency:</b> Refer to: r52702				
<b>Note:</b> Receive word 1 is also available scaled word by word for further interconnection.				

<b>r52723.0...15 CO/BO: Parallel interface slave 3 receive word 1 bit by bit / Slave3 recv1 bbb</b>				
DC_CTRL	<b>Can be changed:</b> -		<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16		<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9352
	<b>P-Group:</b> -		<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -		<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>		<b>Max</b>	<b>Factory setting</b>
	-		-	-
<b>Description:</b> Display and binector/connector output for receive word 1 from slave 3 on the parallel interface.				
<b>Bit field:</b>				
	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>
	00	Bit 0	Yes	No
	01	Bit 1	Yes	No
	02	Bit 2	Yes	No
	03	Bit 3	Yes	No
	04	Bit 4	Yes	No
	05	Bit 5	Yes	No
	06	Bit 6	Yes	No
	07	Bit 7	Yes	No
	08	Bit 8	Yes	No
	09	Bit 9	Yes	No
	10	Bit 10	Yes	No
	11	Bit 11	Yes	No
	12	Bit 12	Yes	No
	13	Bit 13	Yes	No
	14	Bit 14	Yes	No
	15	Bit 15	Yes	No
<b>Dependency:</b> Refer to: r52703				
<b>Note:</b> Receive word 1 is also available scaled word by word for further interconnection.				

**r52724.0...15 CO/BO: Parallel interface slave 4 receive word 1 bit by bit / Slave4 recv1 bbb**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9352
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Display and binector/connector output for receive word 1 from slave 4 on the parallel interface.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Bit 0	Yes	No	9352
	01	Bit 1	Yes	No	9352
	02	Bit 2	Yes	No	9352
	03	Bit 3	Yes	No	9352
	04	Bit 4	Yes	No	9352
	05	Bit 5	Yes	No	9352
	06	Bit 6	Yes	No	9352
	07	Bit 7	Yes	No	9352
	08	Bit 8	Yes	No	9352
	09	Bit 9	Yes	No	9352
	10	Bit 10	Yes	No	9352
	11	Bit 11	Yes	No	9352
	12	Bit 12	Yes	No	9352
	13	Bit 13	Yes	No	9352
	14	Bit 14	Yes	No	9352
	15	Bit 15	Yes	No	9352

**Dependency:** Refer to: r52704

**Note:** Receive word 1 is also available scaled word by word for further interconnection.

**r52725.0...15 CO/BO: Parallel interface slave 5 receive word 1 bit by bit / Slave5 recv1 bbb**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9352
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Display and binector/connector output for receive word 1 from slave 5 on the parallel interface.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Bit 0	Yes	No	9352
	01	Bit 1	Yes	No	9352
	02	Bit 2	Yes	No	9352
	03	Bit 3	Yes	No	9352
	04	Bit 4	Yes	No	9352
	05	Bit 5	Yes	No	9352
	06	Bit 6	Yes	No	9352
	07	Bit 7	Yes	No	9352
	08	Bit 8	Yes	No	9352
	09	Bit 9	Yes	No	9352
	10	Bit 10	Yes	No	9352
	11	Bit 11	Yes	No	9352
	12	Bit 12	Yes	No	9352
	13	Bit 13	Yes	No	9352
	14	Bit 14	Yes	No	9352
	15	Bit 15	Yes	No	9352

**Dependency:** Refer to: r52705

**Note:** Receive word 1 is also available scaled word by word for further interconnection.

<b>r52726.0...15 CO/BO: Parallel interface slave 6 receive word 1 bit by bit / Slave6 recv1 bbb</b>				
DC_CTRL	<b>Can be changed:</b> -		<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16		<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9352
	<b>P-Group:</b> -		<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -		<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>		<b>Max</b>	<b>Factory setting</b>
	-		-	-
<b>Description:</b> Display and binector/connector output for receive word 1 from slave 6 on the parallel interface.				
<b>Bit field:</b>				
	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>
	00	Bit 0	Yes	No
	01	Bit 1	Yes	No
	02	Bit 2	Yes	No
	03	Bit 3	Yes	No
	04	Bit 4	Yes	No
	05	Bit 5	Yes	No
	06	Bit 6	Yes	No
	07	Bit 7	Yes	No
	08	Bit 8	Yes	No
	09	Bit 9	Yes	No
	10	Bit 10	Yes	No
	11	Bit 11	Yes	No
	12	Bit 12	Yes	No
	13	Bit 13	Yes	No
	14	Bit 14	Yes	No
	15	Bit 15	Yes	No
<b>Dependency:</b> Refer to: r52706				
<b>Note:</b> Receive word 1 is also available scaled word by word for further interconnection.				

<b>r52727.0...15 CO/BO: Parallel interface slave 7 receive word 1 bit by bit / Slave7 recv1 bbb</b>				
DC_CTRL	<b>Can be changed:</b> -		<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16		<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9352
	<b>P-Group:</b> -		<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -		<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>		<b>Max</b>	<b>Factory setting</b>
	-		-	-
<b>Description:</b> Display and binector/connector output for receive word 1 from slave 7 on the parallel interface.				
<b>Bit field:</b>				
	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>
	00	Bit 0	Yes	No
	01	Bit 1	Yes	No
	02	Bit 2	Yes	No
	03	Bit 3	Yes	No
	04	Bit 4	Yes	No
	05	Bit 5	Yes	No
	06	Bit 6	Yes	No
	07	Bit 7	Yes	No
	08	Bit 8	Yes	No
	09	Bit 9	Yes	No
	10	Bit 10	Yes	No
	11	Bit 11	Yes	No
	12	Bit 12	Yes	No
	13	Bit 13	Yes	No
	14	Bit 14	Yes	No
	15	Bit 15	Yes	No
<b>Dependency:</b> Refer to: r52707				
<b>Note:</b> Receive word 1 is also available scaled word by word for further interconnection.				



**r52728.0...15 CO/BO: Parallel interface slave 8 receive word 1 bit by bit / Slave8 recv1 bbb**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9352
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Display and binector/connector output for receive word 1 from slave 8 on the parallel interface.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Bit 0	Yes	No	9352
	01	Bit 1	Yes	No	9352
	02	Bit 2	Yes	No	9352
	03	Bit 3	Yes	No	9352
	04	Bit 4	Yes	No	9352
	05	Bit 5	Yes	No	9352
	06	Bit 6	Yes	No	9352
	07	Bit 7	Yes	No	9352
	08	Bit 8	Yes	No	9352
	09	Bit 9	Yes	No	9352
	10	Bit 10	Yes	No	9352
	11	Bit 11	Yes	No	9352
	12	Bit 12	Yes	No	9352
	13	Bit 13	Yes	No	9352
	14	Bit 14	Yes	No	9352
	15	Bit 15	Yes	No	9352

**Dependency:** Refer to: r52708

**Note:** Receive word 1 is also available scaled word by word for further interconnection.

**r52729.0...15 CO/BO: Parallel interface slave 9 receive word 1 bit by bit / Slave9 recv1 bbb**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9352
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Display and binector/connector output for receive word 1 from slave 9 on the parallel interface.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Bit 0	Yes	No	9352
	01	Bit 1	Yes	No	9352
	02	Bit 2	Yes	No	9352
	03	Bit 3	Yes	No	9352
	04	Bit 4	Yes	No	9352
	05	Bit 5	Yes	No	9352
	06	Bit 6	Yes	No	9352
	07	Bit 7	Yes	No	9352
	08	Bit 8	Yes	No	9352
	09	Bit 9	Yes	No	9352
	10	Bit 10	Yes	No	9352
	11	Bit 11	Yes	No	9352
	12	Bit 12	Yes	No	9352
	13	Bit 13	Yes	No	9352
	14	Bit 14	Yes	No	9352
	15	Bit 15	Yes	No	9352

**Dependency:** Refer to: r52709

**Note:** Receive word 1 is also available scaled word by word for further interconnection.

**r52730.0...15 CO/BO: Parallel interface slave 10 receive word 1 bit by bit / Slave10 recv1 bbb**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9352
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Display and binector/connector output for receive word 1 from slave 10 on the parallel interface.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Bit 0	Yes	No	9352
	01	Bit 1	Yes	No	9352
	02	Bit 2	Yes	No	9352
	03	Bit 3	Yes	No	9352
	04	Bit 4	Yes	No	9352
	05	Bit 5	Yes	No	9352
	06	Bit 6	Yes	No	9352
	07	Bit 7	Yes	No	9352
	08	Bit 8	Yes	No	9352
	09	Bit 9	Yes	No	9352
	10	Bit 10	Yes	No	9352
	11	Bit 11	Yes	No	9352
	12	Bit 12	Yes	No	9352
	13	Bit 13	Yes	No	9352
	14	Bit 14	Yes	No	9352
	15	Bit 15	Yes	No	9352

**Dependency:** Refer to: r52710

**Note:** Receive word 1 is also available scaled word by word for further interconnection.

**r52731.0...15 CO/BO: Parallel interface slave 11 receive word 1 bit by bit / Slave11 recv1 bbb**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9352
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Display and binector/connector output for receive word 1 from slave 11 on the parallel interface.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Bit 0	Yes	No	9352
	01	Bit 1	Yes	No	9352
	02	Bit 2	Yes	No	9352
	03	Bit 3	Yes	No	9352
	04	Bit 4	Yes	No	9352
	05	Bit 5	Yes	No	9352
	06	Bit 6	Yes	No	9352
	07	Bit 7	Yes	No	9352
	08	Bit 8	Yes	No	9352
	09	Bit 9	Yes	No	9352
	10	Bit 10	Yes	No	9352
	11	Bit 11	Yes	No	9352
	12	Bit 12	Yes	No	9352
	13	Bit 13	Yes	No	9352
	14	Bit 14	Yes	No	9352
	15	Bit 15	Yes	No	9352

**Dependency:** Refer to: r52711

**Note:** Receive word 1 is also available scaled word by word for further interconnection.

**r52732.0...15 CO/BO: Parallel interface slave 12 receive word 1 bit by bit / Slave12 recv1 bbb**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9352
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Display and binector/connector output for receive word 1 from slave 12 on the parallel interface.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Bit 0	Yes	No	9352
	01	Bit 1	Yes	No	9352
	02	Bit 2	Yes	No	9352
	03	Bit 3	Yes	No	9352
	04	Bit 4	Yes	No	9352
	05	Bit 5	Yes	No	9352
	06	Bit 6	Yes	No	9352
	07	Bit 7	Yes	No	9352
	08	Bit 8	Yes	No	9352
	09	Bit 9	Yes	No	9352
	10	Bit 10	Yes	No	9352
	11	Bit 11	Yes	No	9352
	12	Bit 12	Yes	No	9352
	13	Bit 13	Yes	No	9352
	14	Bit 14	Yes	No	9352
	15	Bit 15	Yes	No	9352

**Dependency:** Refer to: r52712

**Note:** Receive word 1 is also available scaled word by word for further interconnection.

**r52733.0...15 CO/BO: Parallel interface slave 13 receive word 1 bit by bit / Slave12 recv1 bbb**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9352
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Display and binector/connector output for receive word 1 from slave 13 on the parallel interface.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Bit 0	Yes	No	9352
	01	Bit 1	Yes	No	9352
	02	Bit 2	Yes	No	9352
	03	Bit 3	Yes	No	9352
	04	Bit 4	Yes	No	9352
	05	Bit 5	Yes	No	9352
	06	Bit 6	Yes	No	9352
	07	Bit 7	Yes	No	9352
	08	Bit 8	Yes	No	9352
	09	Bit 9	Yes	No	9352
	10	Bit 10	Yes	No	9352
	11	Bit 11	Yes	No	9352
	12	Bit 12	Yes	No	9352
	13	Bit 13	Yes	No	9352
	14	Bit 14	Yes	No	9352
	15	Bit 15	Yes	No	9352

**Dependency:** Refer to: r52713

**Note:** Receive word 1 is also available scaled word by word for further interconnection.

**r52734.0...15 CO/BO: Parallel interface slave 14 receive word 1 bit by bit / Slave14 recv1 bbb**

DC_CTRL	Can be changed: -	Calculated: -	Access level: 2
	Data type: Unsigned16	Dyn. index: -	Func. diagram: 9352
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min	Max	Factory setting
	-	-	-

**Description:** Display and binector/connector output for receive word 1 from slave 14 on the parallel interface.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Bit 0	Yes	No	9352
	01	Bit 1	Yes	No	9352
	02	Bit 2	Yes	No	9352
	03	Bit 3	Yes	No	9352
	04	Bit 4	Yes	No	9352
	05	Bit 5	Yes	No	9352
	06	Bit 6	Yes	No	9352
	07	Bit 7	Yes	No	9352
	08	Bit 8	Yes	No	9352
	09	Bit 9	Yes	No	9352
	10	Bit 10	Yes	No	9352
	11	Bit 11	Yes	No	9352
	12	Bit 12	Yes	No	9352
	13	Bit 13	Yes	No	9352
	14	Bit 14	Yes	No	9352
	15	Bit 15	Yes	No	9352

**Dependency:** Refer to: r52714

**Note:** Receive word 1 is also available scaled word by word for further interconnection.

**r52735.0...15 CO/BO: Parallel interface slave 15 receive word 1 bit by bit / Slave15 recv1 bbb**

DC_CTRL	Can be changed: -	Calculated: -	Access level: 2
	Data type: Unsigned16	Dyn. index: -	Func. diagram: 9352
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min	Max	Factory setting
	-	-	-

**Description:** Display and binector/connector output for receive word 1 from slave 15 on the parallel interface.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Bit 0	Yes	No	9352
	01	Bit 1	Yes	No	9352
	02	Bit 2	Yes	No	9352
	03	Bit 3	Yes	No	9352
	04	Bit 4	Yes	No	9352
	05	Bit 5	Yes	No	9352
	06	Bit 6	Yes	No	9352
	07	Bit 7	Yes	No	9352
	08	Bit 8	Yes	No	9352
	09	Bit 9	Yes	No	9352
	10	Bit 10	Yes	No	9352
	11	Bit 11	Yes	No	9352
	12	Bit 12	Yes	No	9352
	13	Bit 13	Yes	No	9352
	14	Bit 14	Yes	No	9352
	15	Bit 15	Yes	No	9352

**Dependency:** Refer to: r52715

**Note:** Receive word 1 is also available scaled word by word for further interconnection.

**r52736.0...15 CO/BO: Parallel interface slave 16 receive word 1 bit by bit / Slave16 recv1 bbb**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9352
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Display and binector/connector output for receive word 1 from slave 16 on the parallel interface.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Bit 0	Yes	No	9352
	01	Bit 1	Yes	No	9352
	02	Bit 2	Yes	No	9352
	03	Bit 3	Yes	No	9352
	04	Bit 4	Yes	No	9352
	05	Bit 5	Yes	No	9352
	06	Bit 6	Yes	No	9352
	07	Bit 7	Yes	No	9352
	08	Bit 8	Yes	No	9352
	09	Bit 9	Yes	No	9352
	10	Bit 10	Yes	No	9352
	11	Bit 11	Yes	No	9352
	12	Bit 12	Yes	No	9352
	13	Bit 13	Yes	No	9352
	14	Bit 14	Yes	No	9352
	15	Bit 15	Yes	No	9352

**Dependency:** Refer to: r52716

**Note:** Receive word 1 is also available scaled word by word for further interconnection.

**r52800 CO: Sequence control operating state / S ctr op state**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2651
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Display and connector output for the sequence control operating state.

**Note:** The values correspond to the operating state of the drive (r0002 (DC\_CTRL)).

**r52900 CO: Optimization run output 0 / Opt run outp 0**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2660
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> PERCENT	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	- [%]	- [%]	- [%]

**Description:** Display and connector output of output 0 during the optimization run.

<b>r52901</b>	<b>CO: Optimization run output 1 / Opt run outp 1</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 2660 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output of output 1 during the optimization run.		
<b>r52902</b>	<b>CO: Optimization run output 2 / Opt run outp 2</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 2660 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output of output 2 during the optimization run.		
<b>r52903</b>	<b>CO: Optimization run output 3 / Opt run outp 3</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 2660 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output of output 3 during the optimization run.		
<b>r52904</b>	<b>CO: Optimization run output 4 / Opt run outp 4</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [%]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> PERCENT <b>Max</b> - [%]	<b>Access level:</b> 2 <b>Func. diagram:</b> 2660 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [%]
<b>Description:</b>	Display and connector output of output 4 during the optimization run.		
<b>r52921[0...4]</b>	<b>CO: Measurement results ASIC 1 raw values / Meas res ASIC1 raw</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> Unsigned16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 4 <b>Func. diagram:</b> 8054 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Display and connector output for the raw values from the measurements of Power Stack ASIC 1. For devices with 480 V: - 0 corresponds to -825.0 V - 32767 corresponds to 0 V - 65535 corresponds to +825.0 V		

For devices with 575 V:  
 - 0 corresponds to -1036.2 V  
 - 32767 corresponds to 0 V  
 - 65535 corresponds to +1036.2 V  
 For devices with 1000 V:  
 - 0 corresponds to -1795.2 V  
 - 32767 corresponds to 0 V  
 - 65535 corresponds to +1795.2 V

**Index:** [0] = Phase VU  
 [1] = Phase VW  
 [2] = Voltage CV  
 [3] = Voltage CD  
 [4] = Voltage S13V  
**Dependency:** Refer to: r52922, r52923  
**Note:** This parameter is used solely for internal diagnostics.

---

**r52922[0...2] CO: Measurement results ASIC 2 raw values / Meas res ASIC2 raw**

---

DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> Unsigned16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 4 <b>Func. diagram:</b> 8054 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
---------	--	---	--

**Description:** Display and connector output for the raw values from the measurements of Power Stack ASIC 2.  
 For voltage channels:  
 - 0 corresponds to -825.0 V  
 - 32767 corresponds to 0 V  
 - 65535 corresponds to +825.0 V  
 For the current channel:  
 - 49151 corresponds to 0 A  
 For devices with rated field current = 3A:  
 - 8218 corresponds to 3 A  
 For devices with rated field current = 5 A:  
 - 9065 corresponds to 5 A  
 For devices with rated field current = 10 A:  
 - 9065 corresponds to 10 A  
 For devices with rated field current = 15 A:  
 - 29108 corresponds to 15 A  
 For devices with rated field current = 25 A:  
 - 15746 corresponds to 25 A  
 For devices with rated field current = 30 A & A7115:  
 - 9065 corresponds to 30 A  
 For devices with rated field current = 30 A & A7116:  
 - 24608 corresponds to 30 A  
 For devices with rated field current = 40 A:  
 - 16427 corresponds to 40 A  
 For devices with rated field current = 85 A:  
 - 14382 corresponds to 85 A

**Index:** [0] = Raw value voltage 3U3W  
 [1] = Raw value voltage 3C3D  
 [2] = Raw value field current  
**Dependency:** Refer to: r52921, r52923  
**Note:** This parameter is used solely for internal diagnostics.

<b>r52923[0...1]</b>	<b>CO: Measurement results current actual values raw values / Meas res I_act raw</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> Unsigned16 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 4 <b>Func. diagram:</b> 8054 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
<b>Description:</b>	Display and connector output for raw values when measuring current actual values. The following applies: - 0 corresponds to approx. 3 x device rated current in negative direction - 32767 corresponds to 0 A - 65535 corresponds to approx. 3 x device rated current in positive direction		
<b>Index:</b>	[0] = Armature current 1 [1] = Armature current 2		
<b>Dependency:</b>	Refer to: r52921, r52922		
<b>Note:</b>	This parameter is used solely for internal diagnostics.		
<b>r52950[0...3]</b>	<b>CO: Line voltages scan values / V_line sc values</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [V]	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> - [V]	<b>Access level:</b> 3 <b>Func. diagram:</b> 6950, 6952 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [V]
<b>Description:</b>	Display and connector output for the scan values of line voltages UV, VW, WU.		
<b>Index:</b>	[0] = Line voltage UV [1] = Line voltage VW [2] = Line voltage WU [3] = Field line voltage		
<b>r52951[0...1]</b>	<b>CO: Armature voltage/field voltage scan values / Ua/Uf scan_values</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32  <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [V]	<b>Calculated:</b> - <b>Dyn. index:</b> -  <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> - [V]	<b>Access level:</b> 3 <b>Func. diagram:</b> 6902, 6950, 6952 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [V]
<b>Description:</b>	Display and connector output for the armature voltage/field voltage scan values.		
<b>Index:</b>	[0] = Scan values of Ua [1] = Scan values of Uf		
<b>r52952[0...3]</b>	<b>CO: Armature current/field current scan values / Ia/If sc_values</b>		
DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> FloatingPoint32  <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> - [A]	<b>Calculated:</b> - <b>Dyn. index:</b> -  <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> - [A]	<b>Access level:</b> 3 <b>Func. diagram:</b> 6850, 6851, 6912 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> - [A]
<b>Description:</b>	Display and connector output for the armature current and field current scan values.		



**Index:**  
 [0] = Armature current Ia  
 [1] = Field current If  
 [2] = Armature current Ia current transformer I  
 [3] = Armature current Ia current transformer II

r52953[0...11] CO: Thyristor blocking voltages scan values / V_thyr scan_values			
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [V]	Calculated: - Dyn. index: - Units group: - Scaling: - Max - [V]	Access level: 3 Func. diagram: 6950 Unit selection: - Expert list: 1 Factory setting - [V]
Description:	Display and connector output for the scan values of the thyristor blocking voltages.		
Index:	[0] = Blocking voltage thyristor X11 [1] = Blocking voltage thyristor X12 [2] = Blocking voltage thyristor X13 [3] = Blocking voltage thyristor X14 [4] = Blocking voltage thyristor X15 [5] = Blocking voltage thyristor X16 [6] = Blocking voltage thyristor X21 [7] = Blocking voltage thyristor X22 [8] = Blocking voltage thyristor X23 [9] = Blocking voltage thyristor X24 [10] = Blocking voltage thyristor X25 [11] = Blocking voltage thyristor X26		
r52960 Armature line zero crossings deviation / Arm line zero dev			
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [µs]	Calculated: - Dyn. index: - Units group: - Scaling: - Max - [µs]	Access level: 4 Func. diagram: 6950 Unit selection: - Expert list: 1 Factory setting - [µs]
Description:	Displays the deviation of the last point in time on the averaged time grid from the last point in time on an original time grid (armature).		
r52961 Field line zero crossings deviation / Field line zero dv			
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [µs]	Calculated: - Dyn. index: - Units group: - Scaling: - Max - [µs]	Access level: 4 Func. diagram: 6952 Unit selection: - Expert list: 1 Factory setting - [µs]
Description:	Displays the deviation of the last point in time on the averaged time grid from the last point in time on an original time grid (field).		
r52965[0...1] Line analysis armature line phase offset / Arm line ph offs			
DC_CTRL	Can be changed: - Data type: FloatingPoint32 P-Group: - Not for motor type: - Min - [V]	Calculated: - Dyn. index: - Units group: - Scaling: - Max - [V]	Access level: 4 Func. diagram: 6950 Unit selection: - Expert list: 1 Factory setting - [V]
Description:	Displays the DC offset (= direct-current component) of the armature line phases in volts.		
Index:	[0] = Armature phase UV [1] = Armature phase VW		

**r52966 Line analysis field line phase offset / Field line ph offs**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> FloatingPoint32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6952
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> - [V]	<b>Max</b> - [V]	<b>Factory setting</b> - [V]

**Description:** Displays the DC offset (= direct-current component) of the field line phases in volts.

**r52970 CO: Line analysis armature line zero crossing positive phase UV / Arm zero pos UV**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6950
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> -

**Description:** Displays the point in time (timer value) of the last positive zero crossing of armature phase UV.

**Note:** The value is displayed in [10 ns] unit.

**r52971 CO: Line analysis armature line zero crossing negative phase UV / Arm zero neg UV**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6950
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> -

**Description:** Displays the point in time (timer value) of the last negative zero crossing of armature phase UV.

**Note:** The value is displayed in [10 ns] unit.

**r52972 CO: Line analysis armature line zero crossing positive phase VW / Arm zero pos VW**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6950
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> -

**Description:** Displays the point in time (timer value) of the last positive zero crossing of armature phase VW.

**Note:** The value is displayed in [10 ns] unit.

**r52973 CO: Line analysis armature line zero crossing negative phase VW / Arm zero neg VW**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Unsigned32	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6950
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b> -	<b>Max</b> -	<b>Factory setting</b> -

**Description:** Displays the point in time (timer value) of the last negative zero crossing of armature phase UV.

**Note:** The value is displayed in [10 ns] unit.

<b>r52974</b>	<b>CO: Line analysis armature line zero crossing positive phase WU / Arm zero pos WU</b>		
DC_CTRL	Can be changed: -	Calculated: -	Access level: 4
	Data type: Unsigned32	Dyn. index: -	Func. diagram: 6950
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min	Max	Factory setting
	-	-	-
<b>Description:</b>	Displays the point in time (timer value) of the last positive zero crossing of armature phase WU.		
<b>Note:</b>	The value is displayed in [10 ns] unit.		
<b>r52975</b>	<b>CO: Line analysis armature line zero crossing negative phase WU / Arm zero neg WU</b>		
DC_CTRL	Can be changed: -	Calculated: -	Access level: 4
	Data type: Unsigned32	Dyn. index: -	Func. diagram: 6950
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min	Max	Factory setting
	-	-	-
<b>Description:</b>	Displays the point in time (timer value) of the last negative zero crossing of armature phase WU.		
<b>Note:</b>	The value is displayed in [10 ns] unit.		
<b>r52976</b>	<b>CO: Line analysis field line zero crossing positive phase F / Field zero pos F</b>		
DC_CTRL	Can be changed: -	Calculated: -	Access level: 4
	Data type: Unsigned32	Dyn. index: -	Func. diagram: 6952
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min	Max	Factory setting
	-	-	-
<b>Description:</b>	Displays the point in time (timer value) of the last positive zero crossing of the field phase.		
<b>Note:</b>	The value is displayed in [10 ns] unit.		
<b>r52977</b>	<b>CO: Line analysis field line zero crossing negative phase F / Field zero neg F</b>		
DC_CTRL	Can be changed: -	Calculated: -	Access level: 4
	Data type: Unsigned32	Dyn. index: -	Func. diagram: 6952
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min	Max	Factory setting
	-	-	-
<b>Description:</b>	Displays the point in time (timer value) of the last negative zero crossing of the field phase.		
<b>Note:</b>	The value is displayed in [10 ns] unit.		
<b>r52980</b>	<b>Cause of the armature firing pulse / Cause arm fir plus</b>		
DC_CTRL	Can be changed: -	Calculated: -	Access level: 4
	Data type: Unsigned8	Dyn. index: -	Func. diagram: 8054
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min	Max	Factory setting
	-	-	-
<b>Description:</b>	Displays the cause of the armature firing pulse. 1: firing angle = firing angle specified by the armature current control (after Alpha G/W limiting). 2: firing angle = Alpha-W (= p50151, as $I_a < 0$ or $I_a = 0$ for less than 125 $\mu$ s). 3: firing angle = Alpha-W (= 165 °, as $I_a = 0$ for more than 125 $\mu$ s).		

- 4: The firing angle received from the parallel switching master was issued.  
 5: The firing angle received from the parallel switching master was no longer able to be realized, as this point in time has already been passed.  
 6: For a 12-pulse series circuit, a firing pulse delayed by 30 ° was output.  
 7: The firing angle specified by the thyristor check function was realized.  
 8: The master firing angle specified by the sequential phase control was realized.  
 9: The slave firing angle specified by the sequential phase control was realized.  
 1x:  
 firing angle = next possible point in time: firing angle update was not able to be realized.  
 2x:  
 firing angle = next possible point in time: new firing angle was not able to be realized.  
 3x:  
 firing angle = next possible point in time: calculated firing angle was not able to be realized.

**Note:** This parameter is only for internal SIEMENS troubleshooting.

<b>r52981 Cause of the torque direction / Cause M_dir</b>			
DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 4
	<b>Data type:</b> Unsigned8	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8054
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	<p>Displays the cause of the torque direction.</p> <p>0: M0 no torque direction, as not in the operating mode.</p> <p>1: M0 no torque direction as a firing angle &gt; 165 ° was specified.</p> <p>2: M0 no torque direction as the wait time according to p50160 is running.</p> <p>3: M0 no torque direction as the signal selected with p50165 does not permit the required torque direction.</p> <p>4: M0 no torque direction as the I=0 signal was 125 µs long but however was present for less than 625 µs. The torque-free interval is extended.</p> <p>5: M0 no torque direction as the thyristor blocking voltage monitoring signals "thyristor conductive". The torque-free interval is extended.</p> <p>6: M0 no torque direction as the immediate pulse inhibit according to p50177 has been selected.</p> <p>7: M0 no torque direction, as an emergency stop is present.</p> <p>8: M0 no torque direction, as the line supply is not OK.</p> <p>9: M0 no torque direction, as a valid firing instant was not found (for example, this can occur in the slave connected in parallel if the master is lost).</p> <p>10, 11, 12:  M0, M1, M11 torque direction = r52106.</p> <p>15: M0 no torque direction as the selected thyristor pair is inhibited during the thyristor check.</p> <p>16: M0 no torque direction, as the slave connected in parallel is not in the operating state.</p> <p>17: M0 no torque direction, as an immediate pulse inhibit was executed, because either an emergency stop is present or the CCP was triggered.</p> <p>21, 22:  M1, M11 Alpha-W pulse with second pulse in the old torque direction.  Cause: Ia was still not 625 µs long = 0.</p> <p>23, 24:  M1, M11 Alpha-W pulse with second pulse in the old torque direction.  Cause: thyristor blocking voltage monitoring signals "Thyristor conductive"</p> <p>31, 32:  M1, M11 Alpha-W pulse without second pulse in the old torque direction.  Cause: Ia was still not 625 µs long = 0.</p> <p>33, 34:  M1, M11 Alpha-W pulse without second pulse in the old torque direction.  Cause: thyristor blocking voltage monitoring signals "Thyristor conductive"</p>		

41, 42:  
 MI, MII Alpha-W pulse with second pulse in the old torque direction.  
 Cause: additional Alpha-W pulses according to p50179.

51, 52:  
 MI, MII Alpha-W pulse without second pulse in the old torque direction.  
 Cause: additional Alpha-W pulses according to p50161.

60, 61, 62:  
 M0, MI, MII torque direction according to p51840 (simulation operation).

71: MI the command "simultaneously fire all thyristors" (according to p50176) was performed.

81: MI the torque direction specified by the thyristor check was realized.

82: MII the torque direction specified by the thyristor check was realized.

95, 96, 97:  
 M0, MI, MII the torque direction of the parallel switching master was realized.

**Note:** This parameter is only for internal SIEMENS troubleshooting.

---

### **r52982 Armature current zero current signal / Ia I=0 signal**

DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> Unsigned8 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 4 <b>Func. diagram:</b> 8054 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
---------	---	---	--

**Description:** Displays the number of zero current signals of the armature current.  
 For scan values below the threshold I = 0, the counter is incremented.  
 The counter is reset in the following cases:  
 - firing pulse.  
 - scan value above the threshold for I = 0.

**Note:** This parameter is only for internal SIEMENS troubleshooting.  
 The scan values are every 62.5 µs.  
 The threshold for I = 0 is 1 % of the rated unit current.

---

### **r52983 Thyristor code / Thyr\_code**

DC_CTRL	<b>Can be changed:</b> - <b>Data type:</b> Unsigned8 <b>P-Group:</b> - <b>Not for motor type:</b> - <b>Min</b> -	<b>Calculated:</b> - <b>Dyn. index:</b> - <b>Units group:</b> - <b>Scaling:</b> - <b>Max</b> -	<b>Access level:</b> 4 <b>Func. diagram:</b> 8054 <b>Unit selection:</b> - <b>Expert list:</b> 1 <b>Factory setting</b> -
---------	---	---	--

**Description:** Displays the thyristor code.  
 Bit 0 = 1: Thyristor 1 was fired  
 ...  
 Bit 5 = 1: Thyristor 6 was fired  
 Bit 6 = 1: thyristors were fired for torque direction 1  
 Bit 7 = 1: thyristors were fired for torque direction 2

**Note:** This parameter is only for internal SIEMENS troubleshooting.

**r53010.0...15 CO/BO: CUD digital inputs, status / CUD DI status**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2050, 2060, 2065, 2580
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Display and connector output for the CUD's digital inputs.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	DI 0 (X177.11)	High	Low	2050
	01	DI 0 inverted (X177.11)	High	Low	2050
	02	DI 1 (X177.12)	High	Low	2050
	03	DI 1 inverted (X177.12)	High	Low	2050
	04	DI 2 (X177.13)	High	Low	2050
	05	DI 2 inverted (X177.13)	High	Low	2050
	06	DI 3 (X177.14)	High	Low	2050
	07	DI 3 inverted (X177.14)	High	Low	2050
	08	DI/DO 4 (X177.15)	High	Low	2060
	09	DI/DO 4 inverted (X177.15)	High	Low	2060
	10	DI/DO 5 (X177.16)	High	Low	2060
	11	DI/DO 5 inverted (X177.16)	High	Low	2060
	12	DI/DO 6 (X177.17)	High	Low	2065
	13	DI/DO 6 inverted (X177.17)	High	Low	2065
	14	DI/DO 7 (X177.18)	High	Low	2065
	15	DI/DO 7 inverted (X177.18)	High	Low	2065

**Dependency:** For bits 08 to 15:  
The terminal must be set as an input (p50789[0 to 3] = 0).

**Note:** DI: Digital Input  
DI/DO: Bidirectional Digital Input/Output

**r53020.0...7 CO/BO: CUD digital outputs status / CUD DO status**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2055, 2060, 2065
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Display and connector output for the CUD's digital outputs.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	DO 0 (X177.19)	High	Low	2055
	01	DO 1 (X177.20)	High	Low	2055
	02	DO 2 (X177.21)	High	Low	2055
	03	DO 3 (X177.22)	High	Low	2055
	04	DI/DO 4 (X177.15)	High	Low	2060
	05	DI/DO 5 (X177.16)	High	Low	2060
	06	DI/DO 6 (X177.17)	High	Low	2065
	07	DI/DO 7 (X177.18)	High	Low	2065

**Dependency:** For bits 04 to 07:  
The terminal must be set as an output (p50789[0...3] = 1).

**Note:** DO: Digital Output  
DI/DO: Bidirectional Digital Input/Output

<b>r53021.0...7</b>	<b>CO/BO: CUD digital outputs overload monitoring / CUD DO overload</b>				
DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2		
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2055, 2060, 2065		
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -		
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1		
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>		
-	-	-			
<b>Description:</b>	Display and connector output for the overload monitoring of the digital outputs.				
<b>Bit field:</b>	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>	<b>FP</b>
	00	DO 0 (X177.19) overload present	Yes	No	2055
	01	DO 1 (X177.20) overload present	Yes	No	2055
	02	DO 2 (X177.21) overload present	Yes	No	2055
	03	DO 3 (X177.22) overload present	Yes	No	2055
	04	DI/DO 4 (X177.15) overload present	Yes	No	2060
	05	DI/DO 5 (X177.16) overload present	Yes	No	2060
	06	DI/DO 6 (X177.17) overload present	Yes	No	2065
	07	DI/DO 7 (X177.18) overload present	Yes	No	2065
<b>Dependency:</b>	For bits 04 to 07: The terminal must be set as an output (p50789[0...3] = 1).				
<b>Note:</b>	DO: Digital Output DI/DO: Bidirectional Digital Input/Output				

<b>r53025.0...13</b>	<b>CO/BO: Speed messages / n messages</b>				
DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2		
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8020, 8025		
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -		
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1		
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>		
	-	-	-		
<b>Description:</b>	Displays the state of the messages for speed comparisons and limits.				
<b>Bit field:</b>	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>	<b>FP</b>
	00	Setpoint/actual value deviation 1 less than threshold	Yes	No	8020
	01	Setpoint/actual value deviation 1 less than threshold inverted	Yes	No	8020
	02	Setpoint/actual value deviation 2 less than threshold	Yes	No	8020
	03	Setpoint/actual value deviation 2 less than threshold inverted	Yes	No	8020
	04	Comparison setpoint reached	Yes	No	8020
	05	Comparison setpoint reached inverted	Yes	No	8020
	06	Deceleration speed reached	Yes	No	8020
	07	Deceleration speed reached inverted	Yes	No	8020
	08	Positive speed setpoint	Yes	No	8025
	09	Positive speed setpoint inverted	Yes	No	8025
	10	Overspeed	Yes	No	8025
	11	Overspeed inverted	Yes	No	8025
	12	Positive speed actual value	Yes	No	8025
	13	Positive speed actual value inverted	Yes	No	8025

**r53026.0...1 CO/BO: Field current messages / If messages**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8025
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Control word for field current thresholds.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Field current less than minimum field current threshold	Yes	No	-
	01	Field current actual value less than field current setpoint x	Yes	No	-

**r53030.0...1 CO/BO: CUD analog inputs wire break message / CUD AI wire brk**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2075, 2080
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Display and connector output for the "Wire break" message in the case of the CUD analog inputs.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	AI "Main setpoint" wire-break monitoring responded	Yes	No	2075
	01	AI 1 (X177.27/28) Wire-break monitoring responded	Yes	No	2080

**r53081.0...1 CO/BO: Sequence control line contactor control / Ctrl line cont**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2651
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Display and connector output for the line contactor control.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Line contactor	ON	OFF	2651
	01	Line contactor inverted	ON	OFF	2651

**r53082.0 CO/BO: Line contactor state / Line cont state**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2070
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the status of the line contactor control.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Line contactor ON	Yes	No	2070

**Dependency:** Refer to: p51619



**Note:** Re bit 00:  
 1 signal: The relay output for the line contactor is activated via binector input p51619.  
 0 signal: The relay output for the line contactor is de-activated via binector input p51619.

<b>r53100.0...1</b>	<b>CO/BO: E stop status / E stop stat</b>			
DC_CTRL	<b>Can be changed:</b> -		<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16		<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2070, 2580
	<b>P-Group:</b> -		<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -		<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>		<b>Max</b>	<b>Factory setting</b>
	-		-	-
<b>Description:</b>	Display and connector output for the status in the event of an E stop (emergency stop).			
<b>Bit field:</b>	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>
	00	No E stop	Yes	No
				2070, 2580
	01	E stop active	Yes	No
				2070

<b>r53120.0...3</b>	<b>CO/BO: Motor control checks / Mot mon state</b>				
DC_CTRL	<b>Can be changed:</b> -		<b>Calculated:</b> -		<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16		<b>Dyn. index:</b> -		<b>Func. diagram:</b> 8035
	<b>P-Group:</b> -		<b>Units group:</b> -		<b>Unit selection:</b> -
	<b>Not for motor type:</b> -		<b>Scaling:</b> -		<b>Expert list:</b> 1
	<b>Min</b>		<b>Max</b>		<b>Factory setting</b>
	-		-		-
<b>Description:</b>	Displays the state of the motor interface.				
<b>Bit field:</b>	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>	<b>FP</b>
	00	Brush length too short	Yes (fault)	No	-
	01	Poor bearing condition	Yes (fault)	No	-
	02	Motor fan fault	Yes (fault)	No	-
	03	Motor temperature too high	Yes (fault)	No	-
<b>Dependency:</b>	Refer to: p50486, p50487, p50488, p50489				

<b>r53130.0...1</b>	<b>CO/BO: Motor interface temperature monitoring state / Mot temp_mon</b>			
DC_CTRL	<b>Can be changed:</b> -		<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16		<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8030
	<b>P-Group:</b> -		<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -		<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>	
	-	-	-	
<b>Description:</b>	Displays the state of temperature monitoring on the motor interface.			
<b>Bit field:</b>	<b>Bit</b>	<b>Signal name</b>	<b>1 signal</b>	<b>0 signal</b>
	00	Motor temperature alarm	Yes	No
	01	Motor temperature fault	Yes	No
				<b>FP</b>
				-
				-
<b>Dependency:</b>	Refer to: p50490, p50491, p50492			

<b>r53135.0...12</b>	<b>CO/BO: Device fan state / Dev fan state</b>		
DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Display and connector output/binector output for the state of the device fan.		

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Switch on fan	ON	OFF	8047
	01	Switch on fan inverted	ON	OFF	8047
	08	Fan 1 speed OK	Yes	No (too low)	8047
	09	Fan 2 speed OK	Yes	No (too low)	8047
	10	Fan 3 speed OK	Yes	No (too low)	8047
	11	Fan 4 speed OK	Yes	No (too low)	8047
	12	Control Module fan speed OK	Yes	No	8049

**Dependency:** Refer to: p50082, p50096

**Note:** Dependent upon the order number (MLFB), the fan configuration may be as follows:

- No fans

- 2 DC fans

- 1 AC fan

Re bits 8 ... 11:

These bits are not effective on the Control Module.

Re bit 12:

This bit is only effective on the Control Module.

---

### r53136 Device fan present / Device\_fan pres

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6960
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the integrated device fan.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	DC fan 1	Available	Not present	6960
	01	DC fan 2	Available	Not present	6960
	02	AC fan 1	Available	Not present	6960
	03	AC fan 2	Available	Not present	6960
	04	Control Module fan	Available	Not present	6960

**Note:** For the Control Module, fan "available" is always displayed as the Control Module only has one output to control the fan.

The display is independent of the state of the fan and only indicates the desired state.

---

### r53140.0...4 CO/BO: Fan and external fault / Fan ext F

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8049
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Display and connector output of the state of the fan and external fault for the Control Module.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Fan ON	ON	OFF	-
	01	Fan ON inverted	ON	OFF	-
	02	Fan relay status	Switched on	Switched off	-
	03	External fault	Yes	No	-
	04	External fault inverted	Yes	No	-

**Dependency:** Refer to: p51832, p51833, p51834, p51835

**r53145.0...13****CO/BO: Line state / Line state**

DC\_CTRL

**Can be changed:** -**Calculated:** -**Access level:** 2**Data type:** Unsigned16**Dyn. index:** -**Func. diagram:** 6950, 6954**P-Group:** -**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** -**Expert list:** 1**Min****Max****Factory setting**

-

-

-

**Description:**

Displays the state of the line for armature and field.

**Bit field:**

Bit	Signal name	1 signal	0 signal	FP
00	Armature supply system overvoltage	Yes	No	-
01	Armature supply system undervoltage	Yes	No	-
02	Armature supply system overfrequency	Yes	No	-
03	Armature supply system underfrequency	Yes	No	-
04	Armature supply system phase failure	Yes	No	-
05	Field supply system overvoltage	Yes	No	-
06	Field supply system undervoltage	Yes	No	-
07	Field supply system overfrequency	Yes	No	-
08	Field supply system underfrequency	Yes	No	-
09	Field supply system phase failure	Yes	No	-
10	Armature supply system OK	Yes	No	-
11	Field supply system OK	Yes	No	-
12	Phase rotating clockwise	Yes	No	-
13	Line symmetry	Yes	No	-

**r53146.0...13****CO/BO: Thyristor state / Thyr state**

DC\_CTRL

**Can be changed:** -**Calculated:** -**Access level:** 3**Data type:** Unsigned16**Dyn. index:** -**Func. diagram:** 6950**P-Group:** -**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** -**Expert list:** 1**Min****Max****Factory setting**

-

-

-

**Description:**

Display and connector output for the state of the thyristors.

**Bit field:**

Bit	Signal name	1 signal	0 signal	FP
00	Thyristor X11 conducting	Yes	No	-
01	Thyristor X12 conducting	Yes	No	-
02	Thyristor X13 conducting	Yes	No	-
03	Thyristor X14 conducting	Yes	No	-
04	Thyristor X15 conducting	Yes	No	-
05	Thyristor X16 conducting	Yes	No	-
08	Thyristor X21 conducting	Yes	No	-
09	Thyristor X22 conducting	Yes	No	-
10	Thyristor X23 conducting	Yes	No	-
11	Thyristor X24 conducting	Yes	No	-
12	Thyristor X25 conducting	Yes	No	-
13	Thyristor X26 conducting	Yes	No	-

**r53147.0...13****CO/BO: Thyristor blocking state / Thyr block state**

DC\_CTRL

**Can be changed:** -**Calculated:** -**Access level:** 3**Data type:** Unsigned16**Dyn. index:** -**Func. diagram:** 6950**P-Group:** -**Units group:** -**Unit selection:** -**Not for motor type:** -**Scaling:** -**Expert list:** 1**Min****Max****Factory setting**

-

-

-

**Description:**

Displays the blocked state of the thyristors.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Thyristor X11	Blocking	Inhibited	-
	01	Thyristor X12	Blocking	Inhibited	-
	02	Thyristor X13	Blocking	Inhibited	-
	03	Thyristor X14	Blocking	Inhibited	-
	04	Thyristor X15	Blocking	Inhibited	-
	05	Thyristor X16	Blocking	Inhibited	-
	08	Thyristor X21	Blocking	Inhibited	-
	09	Thyristor X22	Blocking	Inhibited	-
	10	Thyristor X23	Blocking	Inhibited	-
	11	Thyristor X24	Blocking	Inhibited	-
	12	Thyristor X25	Blocking	Inhibited	-
	13	Thyristor X26	Blocking	Inhibited	-

**Note:** The blocked state is only relevant for the state "non-conducting" (r53146.x = 0).

---

**r53148.0...1 CO/BO: Power unit I2t state / PU I2t state**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 8042
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the state of the I2t monitoring of the power unit.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	I2t power unit response threshold exceeded	Yes	No	8042
	01	I2t power unit response threshold exceeded and saved	Yes	No	8042

---

**r53149.0 CO/BO: Power unit properties / PU properties**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6840, 6960, 6965
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Display and BICO output for properties of the power unit.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	4Q power unit	Yes	No	6960

---

**r53150.0...5 CO/BO: Speed limiting controller/torque limiting state / n\_lim/T lim state**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6830, 6835
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the state on the speed limiting controller and with regard to torque limiting.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Positive speed limit reached	Yes	No	6835
	01	Negative speed limit reached	Yes	No	6835
	02	Limiting controller active	Yes	No	6835
	03	Positive torque limit reached	Yes	No	6830
	04	Negative torque limit reached	Yes	No	6830
	05	Torque limiting active	Yes	No	6830

**r53151.0...4 CO/BO: Current limitation state / la lim state**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6845
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Display and connector output for the state of armature current limitation.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Positive armature current limit reached	Yes	No	6845
	01	Negative armature current limit reached	Yes	No	6845
	02	Armature current limitation active	Yes	No	6845
	04	Torque limiting/Armature current limitation active	Yes	No	6845

**r53160.0 CO/BO: Speed controller enable / n\_ctr ena**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6815
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Display and BICO output to enable the speed controller.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Speed controller enable present	Yes	No	6815

**r53170.4...15 CO/BO: Setpoint processing control word / Set proc STW**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2585
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Control word for setpoint processing.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	04	Direction of rotation enable	No enable	Enable	3135
	08	Jog ON command	ON	OFF	3125
	09	Creep ON command	ON	OFF	3130
	10	Fixed setpoint bypass ramp-function generator	ON	OFF	3115
	11	Jog setpoint bypass ramp-function generator	ON	OFF	3125
	12	Creep setpoint bypass ramp-function generator	ON	OFF	3130
	13	Fixed setpoint input active	Yes	No	3115
	14	Setpoint from AOP/PC active	Yes	No	3113
	15	Jog setpoint is zero	Yes	No	3125

**r53171.0...5 CO/BO: RFG state / RFG state**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 3150, 3151, 3152, 3155
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the state of the ramp-function generator.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Limiting active after ramp-function generator	Yes	No	3155
	01	RFG output equals zero	Yes	No	3152
	02	RFG ramping up	Yes	No	3150, 3152
	03	RFG ramping down	Yes	No	3150, 3152
	04	RFG setpoint enable present	Yes	No	3151
	05	RFG active	Yes	No	3150

**r53190.0...12 CO/BO: Armature auto-reversing stage state / Arm stage state**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6815, 6855, 6860, 6862, 8046
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the state of the auto-reversing stage.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Torque direction enabled	M0 or MI	M0 or MII	-
	01	Torque direction I active	Yes	No	-
	02	Torque direction II active	Yes	No	-
	03	Torque direction 0 requested	Yes	No	-
	04	Torque direction I requested	Yes	No	-
	05	Torque direction II requested	Yes	No	-
	06	Torque direction change in progress	Yes	No	-
	07	Alpha G limit reached	Yes	No	-
	08	Alpha W limit reached	Yes	No	-
	09	Alpha G limit or Alpha W limit reached	Yes	No	-
	10	Positive limit of n, M, I, Alpha reached	Yes	No	-
	11	Negative limit of n, M, I, Alpha reached	Yes	No	-
	12	Alpha W shift active	Yes	No	-

**r53191.0...2 CO/BO: Field auto-reversing stage state / Field stage state**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6910, 6915
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the state of the auto-reversing stage for field control.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Alpha G limit reached	Yes	No	6910, 6915
	01	Alpha W limit reached	Yes	No	6910, 6915
	02	Alpha G/Alpha W limit reached	Yes	No	6915

**r53192.0 CO/BO: Armature current state / Ia state**

DC_CTRL	Can be changed: -	Calculated: -	Access level: 2
	Data type: Unsigned16	Dyn. index: -	Func. diagram: 6850
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min	Max	Factory setting
	-	-	-

**Description:** Displays the state of the armature current.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Armature current not pulsating	Yes	No	6850

**r53193.0...3 CO/BO: Field current setpoint limiting state / If lim state**

DC_CTRL	Can be changed: -	Calculated: -	Access level: 2
	Data type: Unsigned16	Dyn. index: -	Func. diagram: 6900, 6905
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min	Max	Factory setting
	-	-	-

**Description:** Control word for field current setpoint limiting.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Positive field current setpoint limit reached	Yes	No	-
	01	Negative field current setpoint limit reached	Yes	No	-
	02	Standstill field switched in	Yes	No	-
	03	Field current setpoint withdrawn	Yes	No	-

**r53195.0...2 CO/BO: Field reversal contactor signals / Field rev cont sig**

DC_CTRL	Can be changed: -	Calculated: -	Access level: 2
	Data type: Unsigned16	Dyn. index: -	Func. diagram: 6920
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min	Max	Factory setting
	-	-	-

**Description:** Control word to control the field contactors for field reversal.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Field direction positive	ON	OFF	-
	01	Field direction negative	ON	OFF	-
	02	Invert speed actual value	Yes	No	-

**Dependency:** Refer to: p50092, p50580, p50581, p50583

**r53200.0...1 CO/BO: Motorized potentiometer state / MotP state**

DC_CTRL	Can be changed: -	Calculated: -	Access level: 2
	Data type: Unsigned16	Dyn. index: -	Func. diagram: 3110
	P-Group: -	Units group: -	Unit selection: -
	Not for motor type: -	Scaling: -	Expert list: 1
	Min	Max	Factory setting
	-	-	-

**Description:** Displays the state on the motorized potentiometer.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Output is zero (y = 0)	Yes	No	-
	01	Ramp-up/ramp-down complete (y = x)	Yes	No	-

**r53210.0...5 CO/BO: Sequence control output signals / Seq\_ctrl outp\_sig**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 2585, 2651, 2750
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Display and BICO output for the sequence control output signals.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Close brake	Yes	No	2585, 2750
	01	Close brake inverted	Yes	No	2750
	02	Switch on auxiliaries	Yes	No	2651
	03	Switch on auxiliaries inverted	Yes	No	2651
	04	Automatic restart active	Yes	No	2651, 2750
	05	Automatic restart active inverted	Yes	No	2651, 2750

**r53220.0...5 CO/BO: Fuses at X23B state / Fuses X23B**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6957
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Display and connector output/binector output for the state of the fuses at X23B.  
The fuses are monitored via connection A7109:X23B or A7112:X23B.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Fuse XS1	Okay	Ruptured	-
	01	Fuse XS2	Okay	Ruptured	-
	02	Fuse XS3	Okay	Ruptured	-
	03	Fuse XS4	Okay	Ruptured	-
	04	Fuse XS5	Okay	Ruptured	-
	05	Fuse XS6	Okay	Ruptured	-

**Dependency:** Refer to: p51831

**Note:** The fuses are only set to "OK" in operating state o7.0. The fuses are set to "ruptured" in all other operating states.  
The parameter is only relevant for the Control Module.

**r53221.0...5 CO/BO: Fuses at X23C state / Fuses X23C**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6957
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Display and connector output/binector output for the state of the fuses at X23C.  
The fuses are monitored via connection A7112:X23C.



Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Fuse XS1	Okay	Ruptured	-
	01	Fuse XS2	Okay	Ruptured	-
	02	Fuse XS3	Okay	Ruptured	-
	03	Fuse XS4	Okay	Ruptured	-
	04	Fuse XS5	Okay	Ruptured	-
	05	Fuse XS6	Okay	Ruptured	-
<b>Dependency:</b>	Refer to: p51831				
<b>Note:</b>	The fuses are only set to "OK" in operating state o7.0. The fuses are set to "ruptured" in all other operating states. The parameter is only relevant for the Control Module.				

**r53222.0...5 CO/BO: Fuses at X23D state / Fuses X23D**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6957
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Display and connector output/binector output for the state of the fuses at X23D.  
The fuses are monitored via connection A7112:X23D.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Fuse XS1	Okay	Ruptured	-
	01	Fuse XS2	Okay	Ruptured	-
	02	Fuse XS3	Okay	Ruptured	-
	03	Fuse XS4	Okay	Ruptured	-
	04	Fuse XS5	Okay	Ruptured	-
	05	Fuse XS6	Okay	Ruptured	-

**Dependency:** Refer to: p51831

**Note:** The fuses are only set to "OK" in operating state o7.0. The fuses are set to "ruptured" in all other operating states.  
The parameter is only relevant for the Control Module.

**r53223.0...5 CO/BO: Fuses at X23E state / Fuses X23E**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6957
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Display and connector output/binector output for the state of the fuses at X23E.  
The fuses are monitored via connection A7112:X23E.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Fuse XS1	Okay	Ruptured	-
	01	Fuse XS2	Okay	Ruptured	-
	02	Fuse XS3	Okay	Ruptured	-
	03	Fuse XS4	Okay	Ruptured	-
	04	Fuse XS5	Okay	Ruptured	-
	05	Fuse XS6	Okay	Ruptured	-

**Dependency:** Refer to: p51831

**Note:** The fuses are only set to "OK" in operating state o7.0. The fuses are set to "ruptured" in all other operating states.  
The parameter is only relevant for the Control Module.

**r53224.0...5 CO/BO: Fuses at X23F state / Fuses X23F**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 6957
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Display and connector output/binector output for the state of the fuses at X23F.  
The fuses are monitored via connection A7112:X23F.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Fuse XS1	Okay	Ruptured	-
	01	Fuse XS2	Okay	Ruptured	-
	02	Fuse XS3	Okay	Ruptured	-
	03	Fuse XS4	Okay	Ruptured	-
	04	Fuse XS5	Okay	Ruptured	-
	05	Fuse XS6	Okay	Ruptured	-

**Dependency:** Refer to: p51831

**Note:** The fuses are only set to "OK" in operating state o7.0. The fuses are set to "ruptured" in all other operating states.  
The parameter is only relevant for the Control Module.

**r53230.0...7 CO/BO: Fixed bit 0 to 7 / Fix bit 0 to 7**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 3100
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Connector/binector output for fixed bit 0 to 7.

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Fixed bit 0 (p50421)	High	Low	-
	01	Fixed bit 1 (p50422)	High	Low	-
	02	Fixed bit 2 (p50423)	High	Low	-
	03	Fixed bit 3 (p50424)	High	Low	-
	04	Fixed bit 4 (p50425)	High	Low	-
	05	Fixed bit 5 (p50426)	High	Low	-
	06	Fixed bit 6 (p50427)	High	Low	-
	07	Fixed bit 7 (p50428)	High	Low	-

**Dependency:** Refer to: p50421, p50422, p50423, p50424, p50425, p50426, p50427, p50428

**r53300.0...1 CO/BO: P2P IF telegram monitoring state / P2P telegr mon**

DC_CTRL	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 2
	<b>Data type:</b> Unsigned16	<b>Dyn. index:</b> -	<b>Func. diagram:</b> 9300
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-

**Description:** Displays the state of telegram monitoring on the peer-to-peer interface (P2P IF).

Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Telegram monitoring timeout	Yes	No	9300
	01	Telegram monitoring timeout and 1 s pulse pending	Yes	No	9300

**Note:** The "Telegram monitoring timeout" signal is triggered:  
- With binector output r53300.0 as a continuous signal  
- With binector output r53300.1 as a one-off pulse with a duration of 1 s

r53310.0...1		CO/BO: Parallel interface telegram monitoring state / Par IF mon state			
DC_CTRL	Can be changed: -		Calculated: -		Access level: 2
	Data type: Unsigned16		Dyn. index: -		Func. diagram: 9350
	P-Group: -		Units group: -		Unit selection: -
	Not for motor type: -		Scaling: -		Expert list: 1
	Min		Max		Factory setting
	-		-		-
Description:		Displays the state of telegram monitoring on the parallel interface.			
Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Telegram monitoring timeout - continuous signal	Yes	No	9350
	01	Telegram monitoring timeout - pulse	Yes	No	9350
Dependency:		Refer to: p50099, p51807			

r53311.0		CO/BO: Parallel interface master/slave state / Par IF ma/sl state			
DC_CTRL	Can be changed: -		Calculated: -		Access level: 2
	Data type: Unsigned16		Dyn. index: -		Func. diagram: 9350
	P-Group: -		Units group: -		Unit selection: -
	Not for motor type: -		Scaling: -		Expert list: 1
	Min		Max		Factory setting
	-		-		-
Description:		Displays the state of the parallel interface.			
Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Active master	Master	Slave	9350
Dependency:		Refer to: p51800			

r53312.0...1		CO/BO: Topology switchover command / Top_sw command			
DC_CTRL	Can be changed: -		Calculated: -		Access level: 2
	Data type: Unsigned16		Dyn. index: -		Func. diagram: 9360
	P-Group: -		Units group: -		Unit selection: -
	Not for motor type: -		Scaling: -		Expert list: 1
	Min		Max		Factory setting
	-		-		-
Description:		Display and BICO output to control the contactors to switch over the power unit topology.			
Bit field:	Bit	Signal name	1 signal	0 signal	FP
	00	Power unit topology 1	Requested	Not requested	9360
	01	Power unit topology 2	Requested	Not requested	9360
Dependency:		Refer to: p51790			

r61000[0...239]		PROFINET Name of Station / PN Name of Station			
CU_DC (PROFINET), CU_DC_R (PROFINET), CU_DC_R_S (PROFINET), CU_DC_S (PROFINET)	Can be changed: -		Calculated: -		Access level: 3
	Data type: Unsigned8		Dyn. index: -		Func. diagram: -
	P-Group: -		Units group: -		Unit selection: -
	Not for motor type: -		Scaling: -		Expert list: 1
	Min		Max		Factory setting
	-		-		-
Description:		Displays PROFINET Name of Station.			
Notice:		An ASCII table (excerpt) can be found, for example, in the appendix to the List Manual.			

<b>r61001[0...3]</b> CU_DC (PROFINET), CU_DC_R (PROFINET), CU_DC_R_S (PROFINET), CU_DC_S (PROFINET)	<b>PROFINET IP of Station / PN IP of Station</b>		
	<b>Can be changed:</b> -	<b>Calculated:</b> -	<b>Access level:</b> 3
	<b>Data type:</b> Unsigned8	<b>Dyn. index:</b> -	<b>Func. diagram:</b> -
	<b>P-Group:</b> -	<b>Units group:</b> -	<b>Unit selection:</b> -
	<b>Not for motor type:</b> -	<b>Scaling:</b> -	<b>Expert list:</b> 1
	<b>Min</b>	<b>Max</b>	<b>Factory setting</b>
	-	-	-
<b>Description:</b>	Displays PROFINET IP of Station.		

## 1.3 Parameters for data sets

### 1.3.1 Parameters for command data sets (CDS)

---

**Note:**

References: SINAMICS DC MASTER operating instructions  
"Data sets" Chapter

---

The following list contains the parameters that are dependent on the command data sets.

Product: SINAMICS DC MASTER, Version: 4601800, Language: eng, Type: CDS  
Product: SINAMICS DC MASTER OA, Version: 1400800, Language: eng, Type: CDS

p0700[0...n]	Macro Binector Input (BI) / Macro BI
p0820[0...n]	BI: Drive Data Set selection DDS bit 0 / DDS select bit 0
p0821[0...n]	BI: Drive Data Set selection DDS bit 1 / DDS select bit 1
p0840[0...n]	BI: ON / OFF (OFF1) / ON / OFF (OFF1)
p0844[0...n]	BI: No coast-down / coast-down (OFF2) signal source 1 / OFF2 S_src 1
p0845[0...n]	BI: No coast-down / coast-down (OFF2) signal source 2 / OFF2 S_src 2
p0848[0...n]	BI: No Quick Stop / Quick Stop (OFF3) signal source 1 / OFF3 S_src 1
p0849[0...n]	BI: No Quick Stop / Quick Stop (OFF3) signal source 2 / OFF3 S_src 2
p0852[0...n]	BI: Enable operation/inhibit operation / Operation enable
p0854[0...n]	BI: Control by PLC/no control by PLC / Master ctrl by PLC
p0855[0...n]	BI: Unconditionally open holding brake / Uncond open brake
p0856[0...n]	BI: Speed controller enable / n_ctrl enable
p0858[0...n]	BI: Unconditionally close holding brake / Uncond close brake
p1000[0...n]	Macro Connector Inputs (CI) for speed setpoints / Macro CI n_set
p1035[0...n]	BI: Motorized potentiometer setpoint raise / Mop raise
p1036[0...n]	BI: Motorized potentiometer lower setpoint / Mop lower
p1055[0...n]	BI: Jog bit 0 / Jog bit 0
p1056[0...n]	BI: Jog bit 1 / Jog bit 1
p1070[0...n]	CI: Main setpoint / Main setpoint
p1113[0...n]	BI: Setpoint inversion / Setp inv
p1140[0...n]	BI: Enable ramp-function generator/inhibit ramp-function generator / RFG enable
p1141[0...n]	BI: Continue ramp-function generator/freeze ramp-function generator / Continue RFG
p1142[0...n]	BI: Enable setpoint/inhibit setpoint / Setpoint enable
p1500[0...n]	Macro Connector Inputs (CI) for torque setpoints / Macro CI M_set
p2103[0...n]	BI: 1. Acknowledge faults / 1. Acknowledge
p2104[0...n]	BI: 2. Acknowledge faults / 2. Acknowledge
p2105[0...n]	BI: 3. Acknowledge faults / 3. Acknowledge
p2106[0...n]	BI: External fault 1 / External fault 1
p2107[0...n]	BI: External fault 2 / External fault 2
p2108[0...n]	BI: External fault 3 / External fault 3
p2112[0...n]	BI: External alarm 1 / External alarm 1
p2116[0...n]	BI: External alarm 2 / External alarm 2
p2117[0...n]	BI: External alarm 3 / External alarm 3
p2200[0...n]	BI: Technology controller enable / Tec_ctrl enable
p2253[0...n]	CI: Technology controller setpoint 1 / Tec_ctrl setp 1
p2254[0...n]	CI: Technology controller setpoint 2 / Tec_ctrl setp 2
p2264[0...n]	CI: Technology controller actual value / Tec_ctrl act val
p2286[0...n]	BI: Hold technology controller integrator / Tec_ctr integ stop

p2289[0...n]	Cl: Technology controller pre-control signal / Tec_ctrl prectrl
p2296[0...n]	Cl: Technology controller output scaling / Tec_ctrl outp scal
p2297[0...n]	Cl: Technology controller maximum limit signal source / Tec_ctrMaxLimS_src
p2298[0...n]	Cl: Technology controller minimum limit signal source / Tec_ctrl min_l s_s
p2299[0...n]	Cl: Technology controller limit offset / Tech_ctrl lim offs
p3111[0...n]	Bl: External fault 3 enable / Ext fault 3 enab
p3112[0...n]	Bl: External fault 3 enable negated / Ext flt 3 enab neg
p50165[0...n]	Bl: Signal source for change in torque direction enable / Torq dir en sig s
p50173[0...n]	Bl: Signal source for closed-loop current/torque control ctr type / Ctr l/tq ctr sig s
p50175[0...n]	Cl: Signal source for closed-loop armature current control P gain / Ia ctr Kp sig s
p50176[0...n]	Cl: Signal source for closed-loop armature current ctr integr time / Ia ctr Tn sig s
p50177[0...n]	Bl: Signal source for the "No immediate pulse inhibit" command / No pulse inh sig s
p50178[0...n]	Bl: Sig source for the "Fire all thyristors simultaneously" command / All thy fire sig s
p50265[0...n]	Bl: Signal source for field current monitoring / I_field mon sig s
p50266[0...n]	Cl: Field current controller Tn factor signal source / If_ctrTnFact sig s
p50267[0...n]	Cl: Field current controller Kp factor signal source / If_ctrKpFact sig s
p50289[0...n]	Bl: EMF setpoint reduction activation signal source / EMF set act sig s
p50322[0...n]	Cl: Setpoint processing signal source for main setpoint factor / M set factor sig s
p50323[0...n]	Cl: Setpoint processing signal source for additional setpoint factor / Add set fac sig s
p50433[0...n]	Cl: Signal source for default setpoint / Def set sig s
p50438[0...n]	Cl: Jog signal source for default setpoint / Jog def set sig s
p50443[0...n]	Cl: Creep signal source for default setpoint / Cr def set sig s
p50444[0...n]	Bl: Creep signal source for shutdown / Cr shutdn sig s
p50461[0...n]	Cl: Motorized potentiometer signal source for automatic setpoint / MotP aut s sig s
p50466[0...n]	Cl: Motor potentiometer setting value signal source / MotP s val sig s
p50470[0...n]	Bl: Motorized potentiometer signal source for CW/CCW / MotP CW/CCW sig s
p50471[0...n]	Bl: Motorized potentiometer signal source for manual/automatic / MotP man/aut sig s
p50472[0...n]	Bl: Motorized potentiometer accept setting value / MotP acc set val
p50484[0...n]	Cl: Oscillation signal source for default setpoint / Oscill def set
p50485[0...n]	Bl: Oscillation selection of signal source / Oscill sel sig s
p50500[0...n]	Cl: Torque limiting signal source for t_set in slave mode / T_set s mode sig s
p50501[0...n]	Cl: Torque limiting signal source for torque additional setpoint / T_lim add s sig s
p50553[0...n]	Cl: Speed controller adaptation Kp signal source / Adapt Kp sig s
p50554[0...n]	Cl: Speed controller adaptation Tn signal source / Adapt Tn sig s
p50555[0...n]	Cl: Speed controller adaptation droop signal source / Adapt droop sig s
p50580[0...n]	Bl: Field reversal direction of rotation signal source / Field rev sig s
p50581[0...n]	Bl: Field reversal braking signal source / Field rev br sig s
p50583[0...n]	Cl: Field reversal speed actual value signal source / FldRev n_act sig s
p50594[0...n]	Cl: Messages polarity speed setpoint signal source / MsgPol n_set S_src
p50598[0...n]	Cl: Messages polarity speed actual value signal source / MsgPol n_act S_src
p50607[0...n]	Cl: Torque limiting signal source for master drive t_set / Mst tq set sig s
p50609[0...n]	Cl: Signal source for speed controller actual value / n_ctr act sig s
p50625[0...n]	Cl: Signal source for speed controller setpoint / n_ctr set sig s
p50626[0...n]	Cl: Signal source for speed controller actual value smoothing / Act v smoo sig s
p50635[0...n]	Cl: Setpoint processing signal source for RFG setpoint / RFG set sig s
p50637[0...n]	Bl: RFG parameter set 2 selection signal source / RFG par s 2 sig s
p50638[0...n]	Bl: RFG parameter set 3 selection signal source / RFG par s 3 sig s
p50640[0...n]	Bl: RFG signal source for accepting setting value / RFG accept set v
p50641[0...n]	Bl: Bypass ramp-function generator signal source / Bypass RFG sig s
p50644[0...n]	Cl: Setpoint processing signal source for main setpoint / M set sig s
p50645[0...n]	Cl: Setpoint processing signal source for additional setpoint / A set sig s
p50646[0...n]	Bl: RFG signal source for ramp-up integrator enable / R-up int ena sig s
p50647[0...n]	Bl: RFG tracking activation signal source / RFG trck act sig s

p50671[0...n]	BI: Setpoint processing sig source to enable neg dir of rotation / Ena n dir r sig s
p50672[0...n]	BI: Setpoint processing signal source to enable pos dir of rotation / Ena p dir r sig s
p50673[0...n]	BI: Motorized potentiometer signal source to increase setpoint / MotP incr sig s
p50674[0...n]	BI: Motorized potentiometer signal source to lower setpoint / MotP lower sig s
p50680[0...n]	BI: Fixed setpoint signal source for connector selection 0 / Fix set con0 sig s
p50681[0...n]	BI: Fixed setpoint signal source for connector selection 1 / Fix set con1 sig s
p50684[0...n]	BI: Speed controller droop enable / Droop enable
p50687[0...n]	BI: Speed controller signal source for master/slave drive / Mast/sl sig s
p50691[0...n]	BI: Sequence control line contactor feedback / Line cont feedb
p50692[0...n]	BI: CI-loop field curr ctrl sig source for inject of standst field / If_ctr stst sig s
p50693[0...n]	BI: EMF controller enable signal source / EMF ctr ena sig s
p50694[0...n]	BI: Torque limiting signal source to enable changeover / T lim ch ena sig s
p50695[0...n]	BI: Signal source for setting speed controller integral component / Set I_co sig s
p50696[0...n]	BI: Signal source for stop speed controller integral component / Stop I_co sig s
p50697[0...n]	BI: Enable for inertia compensation / Inert comp ena
p50698[0...n]	BI: Signal source for speed controller PI/P controller changeover / n_ctr PI/P sig s
p51607[0...n]	BI: Setpoint processing reduction signal source / Red sig s
p51619[0...n]	BI: Signal source for switching on line contactor / Line cont ON sig s
p51657[0...n]	BI: Speed controller start pulse pos/neg changeover signal source / Start p ch sig s

### 1.3.2 Parameters for drive data sets (DDS)

---

#### Note:

References: SINAMICS DC MASTER operating instructions  
"Data sets" Chapter

---

The following list contains the parameters that are dependent on the drive data sets.

Product: SINAMICS DC MASTER, Version: 4601800, Language: eng, Type: DDS	
Product: SINAMICS DC MASTER OA, Version: 1400800, Language: eng, Type: DDS	
p0187[0...n]	Encoder 1 encoder data set number / Enc 1 EDS number
p0188[0...n]	Encoder 2 encoder data set number / Enc 2 EDS number
p0340[0...n]	Automatic calculation motor/control parameters / Calc auto par
p1441[0...n]	Actual speed smoothing time / n_act T_smooth
p1821[0...n]	Direction of rotation / Dir of rot
p2504[0...n]	LR motor/load motor revolutions / Mot/load motor rev
p2505[0...n]	LR motor/load load revolutions / Mot/load load rev
p2720[0...n]	Load gear configuration / Load gear config
p2721[0...n]	Load gear rotary absolute encoder revolutions virtual / Abs rot rev
p2722[0...n]	Load gear position tracking tolerance window / Pos track tol
r2723[0...n]	CO: Load gear absolute value / Load gear abs_val
r2724[0...n]	CO: Load gear position difference / Load gear pos diff
p2900[0...n]	CO: Fixed value 1 [%] / Fixed value 1 [%]
p2901[0...n]	CO: Fixed value 2 [%] / Fixed value 2 [%]
p2930[0...n]	CO: Fixed value M [Nm] / Fixed value M [Nm]
p50083[0...n]	Speed controller actual value selection / n_ctr act sel
p50100[0...n]	Motor rated armature current / Mot rated I_armat
p50101[0...n]	Motor rated armature voltage / Mot rated V_armat
p50102[0...n]	Motor rated excitation current / Mot rated I_exc
p50103[0...n]	Minimum motor excitation current / Mot I_exc min

p50104[0...n]	Speed-dependent current limitation speed n1 / I_lim n_dep n1
p50105[0...n]	Speed-dependent current limitation armature current I1 / I_lim n_dep I1
p50106[0...n]	Speed-dependent current limitation speed n2 / I_lim n_dep n2
p50107[0...n]	Speed-dependent current limitation armature current I2 / I_lim n_dep I2
p50108[0...n]	Speed-dependent current limitation maximum operating speed n3 / I_lim n_dep n3
p50109[0...n]	Speed-dependent current limitation activation / I_lim n_dep act
p50110[0...n]	Armature circuit resistance / Ra
p50111[0...n]	Armature circuit inductance / La
p50112[0...n]	Field circuit resistance / R_field circuit
p50113[0...n]	Motor I2t monitoring continuous current factor / Mot I2t I_cont
p50114[0...n]	Motor thermal time constant / Mot T therm
p50115[0...n]	Speed controller EMF at maximum speed / EMF at n_max
p50116[0...n]	Field circuit inductance / L_field circuit
p50117[0...n]	Field characteristic status / Field char stat
p50118[0...n]	EMF rated value / EMF rated
p50119[0...n]	Rated speed / n Rated
p50120[0...n]	Field current for motor flux 0 % / I_field flux 0%
p50121[0...n]	Field current for motor flux 5 % / I_field flux 5%
p50122[0...n]	Field current for motor flux 10 % / I_field flux 10%
p50123[0...n]	Field current for motor flux 15 % / I_field flux 15%
p50124[0...n]	Field current for motor flux 20 % / I_field flux 20%
p50125[0...n]	Field current for motor flux 25 % / I_field flux 25%
p50126[0...n]	Field current for motor flux 30 % / I_field flux 30%
p50127[0...n]	Field current for motor flux 35 % / I_field flux 35%
p50128[0...n]	Field current for motor flux 40 % / I_field flux 40%
p50129[0...n]	Field current for motor flux 45 % / I_field flux 45%
p50130[0...n]	Field current for motor flux 50 % / I_field flux 50%
p50131[0...n]	Field current for motor flux 55 % / I_field flux 55%
p50132[0...n]	Field current for motor flux 60 % / I_field flux 60%
p50133[0...n]	Field current for motor flux 65 % / I_field flux 65%
p50134[0...n]	Field current for motor flux 70 % / I_field flux 70%
p50135[0...n]	Field current for motor flux 75 % / I_field flux 75%
p50136[0...n]	Field current for motor flux 80 % / I_field flux 80%
p50137[0...n]	Field current for motor flux 85 % / I_field flux 85%
p50138[0...n]	Field current for motor flux 90 % / I_field flux 90%
p50139[0...n]	Field current for motor flux 95 % / I_field flux 95%
p50148[0...n]	Armature converter Alpha W limit (single-phase operation) / A Alpha W lim 1-ph
p50149[0...n]	Armature converter correction angle Alpha W limit / Arm corr Alpha W
p50150[0...n]	Armature converter Alpha G limit / Arm Alpha G lim
p50151[0...n]	Armature converter Alpha W limit / Arm Alpha W lim
p50152[0...n]	Armature average number of line periods / Arm line per no.
p50153[0...n]	Control word for armature pre-control / A prec STW
p50154[0...n]	Closed-loop armature current control integral comp activation / la ctr I comp act
p50155[0...n]	Closed-loop armature current control P gain / la ctr Kp
p50156[0...n]	Closed-loop armature current control integral time / la ctr Tn
p50157[0...n]	Current limitation setpoint integrator selection / I_set integ sel
p50158[0...n]	Current limitation setpoint integrator ramp-up time / Set integ t_r-up
p50159[0...n]	Auto-reversing stage changeover threshold / Auto-rev thresh
p50160[0...n]	Auto-reversing stage additional torque-free interval / Auto-rev interval
p50161[0...n]	Auto-reversing stage Alpha W pulses second pulse inhibited / Auto-rev Alpha W1
p50162[0...n]	EMF selection / EMF sel
p50163[0...n]	EMF smoothing selection / EMF smoothing sel
p50164[0...n]	Closed-loop armature current ctr proportional comp activation / la ctr Kp act



p50169[0...n]	Torque limiting selection torque limiting/current limitation / T lim sel T/I_lim
p50170[0...n]	Selection of control type for closed-loop current/torque control / Ctrl type I/tq sel
p50171[0...n]	Current limitation armature current limit torque dir I factor / la lim t d I fact
p50172[0...n]	Current limitation armature current limit torque dir II factor / la lim t d II fact
p50179[0...n]	Auto-reversing stage Alpha W pluses second pulse enabled / Auto-rev Alpha W2
p50180[0...n]	Torque limiting torque limit 1 positive / T lim 1 pos
p50181[0...n]	Torque limiting torque limit 1 negative / T lim 1 neg
p50182[0...n]	Torque limiting torque limit 2 positive / T lim 2 pos
p50183[0...n]	Torque limiting torque limit 2 negative / T lim 2 neg
p50184[0...n]	Torque limiting changeover speed / T lim n_chng
p50190[0...n]	CI-loop arm current ctr prectr setpoint smoothing time constant / la prec set T
p50191[0...n]	CI-loop arm current ctr curr controller setp sm time constant / la ctr set T
p50192[0...n]	Armature Alpha W limit control word / A Alpha W lim STW
p50200[0...n]	Speed controller speed actual value smoothing time constant / n_ctr n_act T
p50201[0...n]	Band-stop 1 resonant frequency / Band-st 1 f_n
p50202[0...n]	Band-stop 1 quality / Band-st 1 quality
p50203[0...n]	Band-stop 2 resonant frequency / Band-st 2 f_n
p50204[0...n]	Band-stop 2 quality / Band-st 2 quality
p50205[0...n]	Derivative-action element derivative-action time / D-act el t_d-act
p50206[0...n]	Derivative-action element smoothing time / Der-act el t_DAE
p50220[0...n]	Speed controller changeover PI/P speed setpoint threshold / PI/P n_set thresh
p50221[0...n]	Speed controller changeover PI/P hysteresis / PI/P hyst
p50222[0...n]	Speed controller changeover PI/P speed actual value threshold / PI/P n_act thresh
p50223[0...n]	Speed controller pre-control enable / n_ctr prec ena
p50224[0...n]	Speed controller integral component configuration / n_ctr I comp conf
p50225[0...n]	Speed controller adaptation Kp y coordinate 2 / Adapt Kp y2
p50226[0...n]	Speed controller adaptation Tn y coordinate 2 / Adapt Tn y2
p50228[0...n]	Speed controller speed setpoint smoothing time constant / n_ctr n_set T
p50229[0...n]	Mast/SI drive ctr speed controller tracking I component / M/S drve ctr track
p50230[0...n]	Set speed controller integral component duration / Set I_comp dur
p50234[0...n]	Speed controller proportional component enable / n_ctr P_comp ena
p50237[0...n]	Speed controller reference model natural frequency / n_ctrl ref_m fn
p50238[0...n]	Speed controller reference model damping / n_ctrl ref_m d
p50239[0...n]	Speed controller reference model dead time / n_ctrl ref_m t_dead
p50240[0...n]	Speed controller reference model activation / n_ctrl ref_m act
p50250[0...n]	Field converter Alpha G limit / Field Alpha G lim
p50251[0...n]	Field converter Alpha W limit / Field Alpha W lim
p50252[0...n]	Field average number of line periods / Field line per no.
p50253[0...n]	Field pre-control activation / Field prec act
p50254[0...n]	Field current controller integral component activation / I_field_ctr I comp
p50255[0...n]	Field current controller P gain / I_field ctr Kp
p50256[0...n]	Field current controller integral time / I_field ctr Tn
p50257[0...n]	Closed-loop field current control standstill field / If_ctr stst_field
p50258[0...n]	CI-loop field current control field current reduction delay time / If_ctr I_red t_del
p50260[0...n]	Field current pre-control setpoint smoothing time constant / Field_prec set T
p50261[0...n]	Field current controller setpoint smoothing time constant / I_field_ctr set T
p50263[0...n]	Selection of motor flux input variable / Mot fl input sel
p50264[0...n]	Field current controller proportional component activation / I_field_ctr P comp
p50273[0...n]	EMF controller pre-control activation / EMF ctr prec act
p50274[0...n]	EMF controller integral component activation / EMF ctr I comp act
p50275[0...n]	EMF controller P gain / EMF ctr Kp
p50276[0...n]	EMF controller integral time / EMF ctr Tn
p50277[0...n]	EMF controller droop / EMF ctr droop

p50280[0...n]	EMF controller pre-control setpoint smoothing time constant / EMF prec set T
p50281[0...n]	EMF controller setpoint smoothing time constant / EMF ctr set T
p50282[0...n]	EMF controller actual value smoothing time constant / EMF ctr act T
p50283[0...n]	EMF controller pre-control actual value smoothing time constant / EMF prec act T
p50284[0...n]	EMF controller proportional component activation / EMF ctr P comp act
p50285[0...n]	EMF setpoint reduction line voltage smoothing time / EMF set line t_sm
p50286[0...n]	EMF setpoint reduction line voltage upper limit / EMF set line upper
p50287[0...n]	EMF setpoint reduction line voltage lower limit / EMF set line lower
p50288[0...n]	EMF setpoint reduction evaluation factor / EMF set eval_fact
p50295[0...n]	Transition rounding operating mode / RFG rounding mode
p50296[0...n]	RFG quick stop (OFF3) ramp-down time / RFG OFF3 t_ramp-dn
p50297[0...n]	RFG quick stop (OFF3) initial rounding / RFG OFF3 init rndg
p50298[0...n]	RFG quick stop (OFF3) final rounding / RFG OFF3 fin rndg
p50300[0...n]	RFG positive setpoint limit after ramp-function generator / RFG pos after RFG
p50301[0...n]	RFG negative setpoint limit after ramp-function generator / RFG neg after RFG
p50302[0...n]	RFG ramp-up integrator operating mode / RFG integ op mode
p50303[0...n]	RFG ramp-up time 1 / RFG t_ramp-up 1
p50304[0...n]	RFG ramp-down time 1 / RFG t_ramp-dn 1
p50305[0...n]	RFG initial rounding 1 / RFG init rndg 1
p50306[0...n]	RFG final rounding 1 / RFG fin rndg 1
p50307[0...n]	RFG ramp-up time 2 / RFG t_ramp-up 2
p50308[0...n]	RFG ramp-down time 2 / RFG ramp-dn time 2
p50309[0...n]	RFG initial rounding 2 / RFG init rndg 2
p50310[0...n]	RFG final rounding 2 / RFG fin rndg 2
p50311[0...n]	RFG ramp-up time 3 / RFG t_ramp-up 3
p50312[0...n]	RFG ramp-down time 3 / RFG t_ramp-dn 3
p50313[0...n]	RFG initial rounding 3 / RFG init rndg 3
p50314[0...n]	RFG final rounding 3 / RFG fin rndg 3
p50317[0...n]	RFG tracking enable / RFG track ena
p50318[0...n]	RFG setting value selection / RFG set val sel
p50319[0...n]	RFG setpoint enable delay time / RFG set_ena i_del
p50320[0...n]	Setpoint processing main setpoint factor / m_set_factor
p50321[0...n]	Setpoint processing additional setpoint factor / Add_set_factor
p50330[0...n]	RFG time unit / RFG time unit
p50351[0...n]	Line undervoltage threshold / Line V_und thresh
p50352[0...n]	Line overvoltage threshold / Line V_over thresh
p50353[0...n]	Line monitoring phase failure threshold / Ph_fail thresh
p50355[0...n]	Stall protection monitoring time / Stall t_mon
p50356[0...n]	Stall protection threshold / Stall prot thresh
p50357[0...n]	Tachometer interruption monitoring threshold / Tacho_mon thresh
p50361[0...n]	Line monitoring undervoltage delay time / V_under t_del
p50362[0...n]	Line monitoring overvoltage delay time / Line V_over t_del
p50363[0...n]	Line frequency minimum threshold / f_line min thresh
p50364[0...n]	Line frequency maximum threshold / f_line max thresh
p50370[0...n]	Messages for speed less than minimum speed threshold / n < n_min thresh
p50371[0...n]	Messages for speed less than minimum speed hysteresis / n < n_min hyst
p50372[0...n]	Messages speed positive hysteresis / Msg n > 0 hyst
p50373[0...n]	Messages for reference speed threshold / Ref_speed thresh
p50374[0...n]	Messages for reference speed hysteresis / Ref_speed hyst
p50375[0...n]	Messages for reference speed OFF delay / Ref_speed t_OFF
p50376[0...n]	Messages for setpoint/actual value deviation 2 threshold / Set/act 2 thresh
p50377[0...n]	Messages for setpoint/actual value deviation 2 hysteresis / Set/act 2 hyst
p50378[0...n]	Messages for setpoint/actual value deviation 2 OFF delay / Set/act 2 t_OFF

p50380[0...n]	Messages for overspeed threshold positive direction of rotation / Msg n_over pos
p50381[0...n]	Messages for overspeed threshold negative direction of rotation / Msg n_over neg
p50388[0...n]	Messages for setpoint/actual value deviation 1 threshold / Set/act 1 thresh
p50389[0...n]	Messages for setpoint/actual value deviation 1 hysteresis / Set/act 1 hyst
p50390[0...n]	Messages for setpoint/actual value deviation 1 OFF delay / Set/act t_OFF
p50394[0...n]	Messages for field current threshold minimum threshold / Msg If min thresh
p50395[0...n]	Messages for field current threshold minimum hysteresis / Msg If min hyst
p50396[0...n]	Field current monitoring setpoint factor / If_mon set_fact
p50397[0...n]	Field current monitoring fault delay time / If_mon F t_del
p50398[0...n]	Messages for field current actual value less than setpoint fact / Msg If<set fact
p50399[0...n]	Messages for field current actual value less than setpoint hyst / Msg If<set hyst
p50401[0...n]	Fixed value 1 / Fix val 1
p50402[0...n]	Fixed value 2 / Fix val 2
p50403[0...n]	Fixed value 3 / Fix val 3
p50404[0...n]	Fixed value 4 / Fix val 4
p50405[0...n]	Fixed value 5 / Fix val 5
p50406[0...n]	Fixed value 6 / Fix val 6
p50407[0...n]	Fixed value 7 / Fix val 7
p50408[0...n]	Fixed value 8 / Fix val 8
p50409[0...n]	Fixed value 9 / Fix val 9
p50410[0...n]	Fixed value 10 / Fix val 10
p50411[0...n]	Fixed value 11 / Fix val 11
p50412[0...n]	Fixed value 12 / Fix val 12
p50413[0...n]	Fixed value 13 / Fix val 13
p50414[0...n]	Fixed value 14 / Fix val 14
p50415[0...n]	Fixed value 15 / Fix val 15
p50416[0...n]	Fixed value 16 / Fix val 16
p50421[0...n]	Fixed bit 0 / Fixed bit 0
p50422[0...n]	Fixed bit 1 / Fixed bit 1
p50423[0...n]	Fixed bit 2 / Fixed bit 2
p50424[0...n]	Fixed bit 3 / Fixed bit 3
p50425[0...n]	Fixed bit 4 / Fixed bit 4
p50426[0...n]	Fixed bit 5 / Fixed bit 5
p50427[0...n]	Fixed bit 6 / Fixed bit 6
p50428[0...n]	Fixed bit 7 / Fixed bit 7
p50460[0...n]	Motorized potentiometer activate ramp-function generator / Mot pot act RFG
p50462[0...n]	Motorized potentiometer ramp-up time / MotP t_r-up
p50463[0...n]	Motorized potentiometer ramp-down time / MotP t_r-dn
p50464[0...n]	Motorized potentiometer time difference for dy/dt / MotP t_dif dy/dt
p50465[0...n]	Motorized potentiometer expansion factor / MotP exp fact
p50467[0...n]	Motorized potentiometer starting value / MotP start value
p50468[0...n]	Motorized potentiometer maximum speed / MotP n_max
p50469[0...n]	Motorized potentiometer minimum speed / MotP n_min
p50473[0...n]	Motorized potentiometer save output value / MotP save outp val
p50480[0...n]	Oscillation setpoint 1 / Oscillation set 1
p50481[0...n]	Oscillation setpoint 1 time / Oscill set 1 t
p50482[0...n]	Oscillation setpoint 2 / Oscillation set 2
p50483[0...n]	Oscillation setpoint 2 time / Oscill set 2 t
p50491[0...n]	Motor interface alarm threshold for temperature monitoring / Mot_temp al thr
p50492[0...n]	Motor interface fault threshold for temperature monitoring / Mot_temp flt thr
p50503[0...n]	Torque limiting t_set factor in slave mode / T_set fact sl mode
p50512[0...n]	Speed limiting controller max speed pos direction of rotation / n_max pos dir rot
p50513[0...n]	Speed limiting controller max speed neg direction of rotation / n_max neg dir

p50515[0...n]	Speed limiting controller P gain / n_lim Kp
p50520[0...n]	Friction compensation 0 % speed / Fric comp n 0%
p50521[0...n]	Friction compensation 10 % speed / Fric comp n 10%
p50522[0...n]	Friction compensation 20 % speed / Fric comp n 20%
p50523[0...n]	Friction compensation 30 % speed / Fric comp n 30%
p50524[0...n]	Friction compensation 40 % speed / Fric comp n 40%
p50525[0...n]	Friction compensation 50 % speed / Fric comp n 50%
p50526[0...n]	Friction compensation 60 % speed / Fric comp n 60%
p50527[0...n]	Friction compensation 70 % speed / Fric comp n 70%
p50528[0...n]	Friction compensation 80 % speed / Fric comp n 80%
p50529[0...n]	Friction compensation 90 % speed / Fric comp n 90%
p50530[0...n]	Friction compensation 100% speed / Fric comp n 100%
p50540[0...n]	Speed controller acceleration time / n_ctr t_accel
p50542[0...n]	RFG dy/dt time difference / RFG dy/dt t_dif
p50543[0...n]	Speed controller setpoint/actual value difference threshold / Set/act dif thresh
p50546[0...n]	Smoothing time constant for inertia compensation / Comp inert T
p50550[0...n]	Speed controller adaptation Kp y coordinate 1 / Adapt Kp y1
p50551[0...n]	Speed controller adaptation Tn y coordinate 1 / Adapt Tn y1
p50556[0...n]	Speed controller adaptation Kp x coordinate 1 / Adapt Kp x1
p50557[0...n]	Speed controller adaptation Tn x coordinate 1 / Adapt Tn x1
p50559[0...n]	Speed controller adaptation Kp x coordinate 2 / Adapt Kp x2
p50560[0...n]	Speed controller adaptation Tn x coordinate 2 / Adapt Tn x2
p50561[0...n]	Speed controller adaptation droop x coordinate 2 / Adapt droop x2
p50562[0...n]	Speed controller droop positive limiting / Droop pos lim
p50563[0...n]	Speed controller droop negative limiting / Droop neg lim
p50570[0...n]	Adaptation armature current controller changeover input / Adapt Ia chgov inp
p50571[0...n]	Adaptation armature current controller non-linear L activation / Adapt N_lin L act
p50572[0...n]	Adapt arm curr controller intermittent adapt activation / Adapt Interm Act
p50573[0...n]	Adaptation armature current controller limiting / Adapt Ia_ctrl lim
p50574[0...n]	Adapt arm curr controller intermittent adapt Kp increase / Ad Interm Kp incr
p50575[0...n]	Adaptation field current controller changeover input / Adapt If chgov inp
p50576[0...n]	Adaptation field current controller non-linear L activation / Adapt n_lin act
p50577[0...n]	Adapt field curr controller non-linear gating unit activation / Adapt n_lin GU act
p50578[0...n]	Adaptation field current controller limiting / Adapt If_ctrl lim
p50701[0...n]	CUD analog input 0 scaling / CUD AI 0 scal
p50711[0...n]	CUD analog input 1 scaling / CUD AI 1 scal
p50721[0...n]	CUD analog input 2 scaling / CUD AI 2 scal
p50741[0...n]	Analog input main actual value scaling / AI m act scal
p51591[0...n]	Armature inductance reduction factor / L_armat red fact
p51592[0...n]	Armature commutating inductance / Arm Lk
p51594[0...n]	Interphase inductance in 12-pulse operation / L_intph 12-pulse
p51595[0...n]	Interphase inductance reduction factor / L_intph red fact
p51596[0...n]	Interphase resistance in 12-pulse operation / R_intph 12-pulse
p51597[0...n]	Field inductance reduction factor / L_field red fact
p51608[0...n]	Setpoint processing reduction factor / Red factor
p51651[0...n]	Speed controller start pulse positive setpoint / Start pul pos set
p51652[0...n]	Speed controller start pulse negative factor / Start pul neg fact
p51653[0...n]	Speed controller start pulse negative setpoint / Start pul neg set

### 1.3.3 Parameters for encoder data sets (EDS)

---

**Note:**

References: SINAMICS DC MASTER operating instructions  
"Data sets" Chapter

---

The following list contains the parameters that are dependent on the encoder data sets.

Product: SINAMICS DC MASTER, Version: 4601800, Language: eng, Type: EDS

p0141[0...n]	Encoder interface (Sensor Module) component number / Enc_interf comp_no
p0142[0...n]	Encoder component number / Encoder comp_no
p0144[0...n]	Sensor Module detection via LED / SM detection LED
p0145[0...n]	Activate/de-activate encoder interface / Enc_intf act/deact
r0146[0...n]	Encoder interface active/inactive / Enc_intf act/inact
r0147[0...n]	Sensor Module EEPROM data version / SM EEPROM version
r0148[0...n]	Sensor Module firmware version / SM FW version
p0400[0...n]	Encoder type selection / Enc_typ sel
p0401[0...n]	Encoder type OEM selection / Enc type OEM sel
p0402[0...n]	Gearbox type selection / Gearbox type sel
p0404[0...n]	Encoder configuration effective / Enc_config eff
p0405[0...n]	Square-wave encoder track A/B / Sq-wave enc A/B
p0407[0...n]	Linear encoder grid division / Enc grid div
p0408[0...n]	Rotary encoder pulse number / Rot enc pulse No.
p0410[0...n]	Encoder inversion actual value / Enc inv act value
p0411[0...n]	Measuring gear configuration / Meas gear config
p0412[0...n]	Measuring gear absolute encoder rotary revolutions virtual / Abs rot rev
p0413[0...n]	Measuring gear position tracking tolerance window / Pos track window
p0414[0...n]	Redundant coarse position value relevant bits (identified) / Relevant bits
p0415[0...n]	Gx_XIST1 Coarse position safe most significant bit (identified) / Gx_XIST1 safe MSB
p0416[0...n]	Non safety-relevant meas. steps position value pos1 (detected) / nsrPos1
p0417[0...n]	Encoder safety comparison algorithm (detected) / Safety comp_algo
p0418[0...n]	Fine resolution Gx_XIST1 (in bits) / Enc fine Gx_XIST1
p0419[0...n]	Fine resolution absolute value Gx_XIST2 (in bits) / Enc fine Gx_XIST2
p0420[0...n]	Encoder connection / Enc_connection
p0421[0...n]	Absolute encoder rotary multiturn resolution / Enc abs multiturn
p0422[0...n]	Absolute encoder linear measuring step resolution / Enc abs meas step
p0423[0...n]	Absolute encoder rotary singleturn resolution / Enc abs singleturn
p0424[0...n]	Encoder linear zero mark distance / Enc lin ZM_dist
p0425[0...n]	Encoder rotary zero mark distance / Enc rot dist ZM
p0426[0...n]	Encoder zero mark differential distance / Enc ZM Dif_dist
p0427[0...n]	Encoder SSI baud rate / Enc SSI baud rate
p0428[0...n]	Encoder SSI monoflop time / Enc SSI t_monoflop
p0429[0...n]	Encoder SSI configuration / Enc SSI config
p0430[0...n]	Sensor Module configuration / SM config
p0431[0...n]	Angular commutation offset / Ang_com offset
p0432[0...n]	Gearbox factor encoder revolutions / Grbx_fact enc_rev
p0433[0...n]	Gearbox factor motor/load revolutions / Grbx_fact mot_rev
p0434[0...n]	Encoder SSI error bit / Enc SSI error bit
p0435[0...n]	Encoder SSI alarm bit / Enc SSI alarm bit
p0436[0...n]	Encoder SSI parity bit / Enc SSI parity bit
p0437[0...n]	Sensor Module configuration extended / SM config ext

p0438[0...n]	Squarewave encoder filter time / Enc t_filt
p0439[0...n]	Encoder ramp-up time / Enc ramp-up time
p0440[0...n]	Copy encoder serial number / Copy enc ser_no
p0441[0...n]	Encoder commissioning serial number part 1 / Enc comm ser_no 1
p0442[0...n]	Encoder commissioning serial number part 2 / Enc comm ser_no 2
p0443[0...n]	Encoder commissioning serial number part 3 / Enc comm ser_no 3
p0444[0...n]	Encoder commissioning serial number part 4 / Enc comm ser_no 4
p0445[0...n]	Encoder commissioning serial number part 5 / Enc comm ser_no 5
p0453[0...n]	Pulse encoder evaluation zero speed measuring time / Enc_ev n_0 t_meas
p4678[0...n]	Analog sensor LVDT ratio / An_sens LVDT ratio
p4679[0...n]	Analog sensor LVDT phase / An_sens LVDT ph
p4680[0...n]	Zero mark monitoring tolerance permissible / ZM_monit tol perm
p4681[0...n]	Zero mark monitoring tolerance window limit 1 positive / ZM tol lim 1 pos
p4682[0...n]	Zero mark monitoring tolerance window limit 1 negative / ZM tol lim 1 neg
p4683[0...n]	Zero mark monitoring tolerance window alarm threshold positive / ZM tol A_thr pos
p4684[0...n]	Zero mark monitoring tolerance window alarm threshold negative / ZM tol A_thr neg
p4685[0...n]	Speed actual value mean value generation / n_act mean val
p4686[0...n]	Zero mark minimum length / ZM min length

## 1.4 Parameters for write protection and know-how protection

### 1.4.1 Parameters with "WRITE\_NO\_LOCK"

The following list contains the parameters with the "WRITE\_NO\_LOCK" attribute.

These parameters are not affected by the write protection.

Product: SINAMICS DC MASTER, Version: 4601800, Language: eng, Type: WRITE\_NO\_LOCK

p0003	BOP access level / BOP acc_level
p0009	Device commissioning parameter filter / Dev comm par_filt
p0124[0...23]	Main component detection using LED / M_comp detect LED
p0144[0...n]	Sensor Module detection via LED / SM detection LED
p0154	Terminal Module detection via LED / TM detection LED
p0972	Drive unit reset / Drv_unit reset
p0976	Reset and load all parameters / Reset load all par
p0977	Save all parameters / Save all par
p2035	Fieldbus interface USS PIV drive object number / Fieldbus USS DO_no
p2102	BI: Acknowledge all faults / Ackn all faults
p2111	Alarm counter / Alarm counter
p3100	RTC time stamp mode / RTC t_stamp mode
p3101[0...1]	RTC set UTC time / RTC set UTC
p3103	RTC synchronization source / RTC sync_source
p3950	Service parameter / Serv. par.
p3981	Faults acknowledge drive object / Faults ackn DO
p3985	Master control mode selection / PcCtrl mode select
p4700[0...1]	Trace control / Trace control
p4701	Measuring function control / Meas fct ctrl
p4703[0...1]	Trace options / Trace options
p4707	Measurement function configuration / Meas fct config
p4710[0...1]	Trace trigger condition / Trace Trig_cond
p4711[0...5]	Trace trigger signal / Trace trig_signal
p4712[0...1]	Trace trigger threshold / Trace trig_thresh
p4713[0...1]	Trace tolerance band trigger threshold 1 / Trace trig thr 1
p4714[0...1]	Trace tolerance band trigger threshold 2 / Trace trig thr 2
p4715[0...1]	Trace bit mask trigger, bit mask / Trace trig mask
p4716[0...1]	Trace bit mask trigger trigger condition / Trace Trig_cond
p4720[0...1]	Trace recording cycle / Trace record_cyc
p4721[0...1]	Trace recording time / Trace record_time
p4722[0...1]	Trace trigger delay / Trace trig_delay
p4723[0...1]	Trace time slice cycle / Trace cycle
p4724[0...1]	Trace average in the time range / Trace average
p4730[0...5]	Trace record signal 0 / Trace record sig 0
p4731[0...5]	Trace record signal 1 / Trace record sig 1
p4732[0...5]	Trace record signal 2 / Trace record sig 2
p4733[0...5]	Trace record signal 3 / Trace record sig 3
p4734[0...5]	Trace record signal 4 / Trace record sig 4
p4735[0...5]	Trace record signal 5 / Trace record sig 5
p4736[0...5]	Trace record signal 6 / Trace record sig 6
p4737[0...5]	Trace record signal 7 / Trace record sig 7
p4780[0...1]	Trace physical address signal 0 / Trace PhyAddr Sig0
p4781[0...1]	Trace physical address signal 1 / Trace PhyAddr Sig1

p4782[0...1]	Trace physical address signal 2 / Trace PhyAddr Sig2
p4783[0...1]	Trace physical address signal 3 / Trace PhyAddr Sig3
p4784[0...1]	Trace physical address signal 4 / Trace PhyAddr Sig4
p4785[0...1]	Trace physical address signal 5 / Trace PhyAddr Sig5
p4786[0...1]	Trace physical address signal 6 / Trace PhyAddr Sig6
p4787[0...1]	Trace physical address signal 7 / Trace PhyAddr Sig7
p4789[0...1]	Trace physical address trigger signal / Trace PhyAddr Trig
p4795	Trace memory bank changeover / Trace mem changeov
p4800	Function generator control / FG control
p4810	Function generator mode / FG operating mode
p4812	Function generator physical address / FG phys address
p4813	Function generator physical address reference value / FG phys addr ref
p4816	Function generator output signal integer number scaling / FG outp integ scal
p4819	BI: Function generator control / FG control
p4820	Function generator signal shape / FG signal shape
p4821	Function generator period / FG period duration
p4822	Function generator pulse width / FG pulse width
p4823	Function generator bandwidth / FG bandwidth
p4824	Function generator amplitude / FG amplitude
p4825	Function generator 2nd amplitude / FG 2nd amplitude
p4826	Function generator offset / FG offset
p4827	Function generator ramp-up time to offset / FG ramp-up offset
p4828	Function generator lower limit / FG lower limit
p4829	Function generator upper limit / FG upper limit
p4830	Function generator time slice cycle / FG time slice
p4831	Function generator amplitude scaling / FG amplitude scal
p4832[0...2]	Function generator amplitude scaling / FG amplitude scal
p4833[0...2]	Function generator offset scaling / FG offset scal
p4835[0...4]	Function generator free measurement function scaling / FG fr MeasFct scal
p4840[0...1]	MTrace cycle number setting / Cycle number
p7761	Write protection / Write protection
p7770	NVRAM action / NVRAM action
p8550	AOP LOCAL/REMOTE / AOP LOCAL/REMOTE
p8829	CBE20 remote controller number / CBE20 rem ctrl num
p9210	Flashing component number / Flash comp_no
p9211	Flash function / Flash fct.
p9400	Safely remove memory card / Mem_card rem
p9484	BICO interconnections search signal source / BICO S_src srch



## 1.4.2 Parameters with "KHP\_WRITE\_NO\_LOCK"

The following list contains the parameters with the "KHP\_WRITE\_NO\_LOCK" attribute.

These parameters are not affected by the know-how protection.

Product: SINAMICS DC MASTER, Version: 4601800, Language: eng, Type: KHP\_WRITE\_NO\_LOCK

p0003	BOP access level / BOP acc_level
p0009	Device commissioning parameter filter / Dev comm par_filt
p0124[0...23]	Main component detection using LED / M_comp detect LED
p0144[0...n]	Sensor Module detection via LED / SM detection LED
p0154	Terminal Module detection via LED / TM detection LED
p0972	Drive unit reset / Drv_unit reset
p0976	Reset and load all parameters / Reset load all par
p0977	Save all parameters / Save all par
p2035	Fieldbus interface USS PIV drive object number / Fieldbus USS DO_no
p2040	Fieldbus interface monitoring time / Fieldbus t_monit
p2102	BI: Acknowledge all faults / Ackn all faults
p2111	Alarm counter / Alarm counter
p3100	RTC time stamp mode / RTC t_stamp mode
p3101[0...1]	RTC set UTC time / RTC set UTC
p3103	RTC synchronization source / RTC sync_source
p3950	Service parameter / Serv. par.
p3981	Faults acknowledge drive object / Faults ackn DO
p3985	Master control mode selection / PcCtrl mode select
p7761	Write protection / Write protection
p7770	NVRAM action / NVRAM action
p8550	AOP LOCAL/REMOTE / AOP LOCAL/REMOTE
p8829	CBE20 remote controller number / CBE20 rem ctrl num
p8835	CBE20 firmware selection / CBE20 FW sel
p8839[0...1]	PZD interface hardware assignment / PZD IF HW assign
p8840	COMM BOARD monitoring time / CB t_monit
p9210	Flashing component number / Flash comp_no
p9211	Flash function / Flash fct.
p9400	Safely remove memory card / Mem_card rem
p9484	BICO interconnections search signal source / BICO S_src srch

### 1.4.3 Parameters with "KHP\_ACTIVE\_READ"

The following list contains the parameters with the "KHP\_ACTIVE\_READ" attribute.

These parameters can also be read with activated know-how protection.

Product: SINAMICS DC MASTER, Version: 4601800, Language: eng, Type: KHP\_ACTIVE\_READ

p0015	Macro drive unit / Macro drv unit
p0015	Macro drive object / Macro DO
p0101[0...23]	Drive object numbers / DO numbers
p0103[0...23]	Application-specific view / Appl_spec view
p0105	Activate/de-activate drive object / DO act/deact
p0107[0...23]	Drive object type / DO type
p0108[0...23]	Drive objects function module / DO function module
p0121[0...n]	Power unit component number / PU comp_no
p0125[0...n]	Activate/de-activate power unit components / PU_comp act/deact
p0140	Number of Encoder Data Sets (EDS) / EDS count
p0141[0...n]	Encoder interface (Sensor Module) component number / Enc_intf comp_no
p0142[0...n]	Encoder component number / Encoder comp_no
p0145[0...n]	Activate/de-activate encoder interface / Enc_intf act/deact
p0151	Terminal Module component number / TM comp_no
p0170	Number of Command Data Sets (CDS) / CDS count
p0180	Number of Drive Data Sets (DDS) / DDS count
p0199[0...24]	Drive object name / DO name
p0400[0...n]	Encoder type selection / Enc_typ sel
p0595	Technological unit selection / Tech unit select
p0806	BI: Inhibit master control / PcCtrl inhibit
p0922	IF1 PROFIdrive PZD telegram selection / IF1 PZD telegr
p0978[0...24]	List of drive objects / List of the DO
p2000	Reference speed / n_ref
p2001	Reference voltage / Reference voltage
p2002	Reference current / I_ref
p2003	Reference torque / M_ref
p2005	Reference angle / Reference angle
p2006	Reference temp / Ref temp
p2007	Reference acceleration / a_ref
p2030	Field bus int protocol selection / Field bus protocol
p2038	IF1 PROFIdrive STW/ZSW interface mode / PD STW/ZSW IF mode
p2079	IF1 PROFIdrive PZD telegram selection extended / IF1 PZD telegr ext
p4956[0...n]	OA application activation / OA act
p7763	KHP OEM exception list number of indices for p7764 / KHP OEM qty p7764
p7764[0...n]	KHP OEM exception list / KHP OEM excep list
p7852	Number of indices for r7853 / Qty indices r7853
p9902	Target topology number of indices / TargetTopo indices

# Function diagrams

# 2

## Content

2.1	Table of contents	2-660
2.2	Explanation of the function diagrams	2-666
2.3	Overviews	2-671
2.4	CUD input/output terminals	2-679
2.5	PROFIdrive	2-690
2.6	Internal control/status words	2-715
2.7	Sequence control	2-722
2.8	Brake control	2-727
2.9	Setpoint channel	2-729
2.10	Encoder evaluation	2-743
2.11	Armature circuit closed-loop control	2-751
2.12	Field circuit closed-loop control	2-774
2.13	Power unit	2-783
2.14	Technology controller	2-792
2.15	Signals and monitoring functions	2-794
2.16	Faults and alarms	2-811
2.17	Data sets	2-816
2.18	Communication between devices	2-820
2.19	Terminal Module 15 for SINAMICS (TM15DI/DO)	2-826
2.20	Terminal Module 31 (TM31)	2-830
2.21	Terminal Module 150 (TM150)	2-841
2.22	Basic Operator Panel 20 (BOP20)	2-845

## 2.1 Table of contents

<b>2.2 Explanation of the function diagrams</b>	2-666
1020 – Explanation of the symbols (part 1)	2-667
1021 – Explanation of the symbols (part 2)	2-668
1022 – Explanation of the symbols (part 3)	2-669
1030 – Handling BICO technology	2-670
<b>2.3 Overviews</b>	2-671
1520 – PROFIdrive	2-672
1580 – Encoder evaluations (position, speed)	2-673
1720 – Closed-loop control	2-674
1721 – Activation/deactivation of closed-loop control functions	2-675
1722 – CUD left, CUD right	2-676
1781 – Terminal Module 15 for SINAMICS (TM15DI/DO)	2-677
1840 – Terminal Module 31 (TM31)	2-678
<b>2.4 CUD input/output terminals</b>	2-679
2050 – Digital inputs (DI 0 ... DI 3)	2-680
2055 – Digital outputs (DO 0 ... DO 3)	2-681
2060 – Digital inputs/outputs, bidirectional (DI/DO 4 ... DI/DO 5)	2-682
2065 – Digital inputs/outputs, bidirectional (DI/DO 6 ... DI/DO 7)	2-683
2070 – E stop (emergency stop), relay output main contactor	2-684
2075 – Analog inputs (AI 0 and XT1.103/104)	2-685
2080 – Analog inputs (AI 1 ... AI 2)	2-686
2085 – Analog inputs (AI 3 ... AI 4)	2-687
2090 – Analog inputs (AI 5 ... AI 6)	2-688
2095 – Analog outputs (AO 0 ... AO 1)	2-689
<b>2.5 PROFIdrive</b>	2-690
2410 – PROFIBUS (PB) / PROFINET (PN) / USS, addresses and diagnostics	2-691
2420 – Telegrams and process data (PZD)	2-692
2425 – STW1_BM control word metal industry interconnection	2-693
2426 – STW2_BM control word metal industry interconnection	2-694
2428 – ZSW1_BM status word metal industry interconnection	2-695
2429 – ZSW2_BM status word metal industry interconnection	2-696
2440 – PZD receive signals interconnection	2-697

2442 – STW1 control word interconnection . . . . .	2-698
2444 – STW2 control word interconnection . . . . .	2-699
2450 – PZD send signals interconnection . . . . .	2-700
2452 – ZSW1 status word interconnection . . . . .	2-701
2454 – ZSW2 status word interconnection . . . . .	2-702
2460 – IF1 receive telegram, free interconnection via BICO (p0922 = 999) . . . . .	2-703
2470 – IF1 send telegram, free interconnection via BICO (p0922 = 999) . . . . .	2-704
2472 – IF1 status words, free interconnection . . . . .	2-705
2481 – IF1 receive telegram, free interconnection via BICO (p0922 = 999) . . . . .	2-706
2483 – IF1 send telegram, free interconnection via BICO (p0922 = 999) . . . . .	2-707
2485 – IF2 receive telegram, free interconnection via BICO (p0922 = 999) . . . . .	2-708
2487 – IF2 send telegram, free interconnection via BICO (p0922 = 999) . . . . .	2-709
2489 – IF2 status words, free interconnection . . . . .	2-710
2495 – CU_STW1 control word 1, Control Unit interconnection . . . . .	2-711
2496 – CU_ZSW1 status word 1, Control Unit interconnection . . . . .	2-712
2497 – A_DIGITAL interconnection . . . . .	2-713
2498 – E_DIGITAL interconnection . . . . .	2-714
<b>2.6 Internal control/status words . . . . .</b>	<b>2-715</b>
2534 – Status word, monitoring functions 1 . . . . .	2-716
2537 – Status word, monitoring functions 3 . . . . .	2-717
2546 – Control word faults/alarms . . . . .	2-718
2548 – Status word faults/alarms 1 and 2 . . . . .	2-719
2580 – Control word sequence control . . . . .	2-720
2585 – Status word sequence control . . . . .	2-721
<b>2.7 Sequence control . . . . .</b>	<b>2-722</b>
2650 – Sequencer (Part 1) . . . . .	2-723
2651 – Sequencer (Part 2) . . . . .	2-724
2655 – Missing enable signals, logic operations . . . . .	2-725
2660 – Optimization runs . . . . .	2-726
<b>2.8 Brake control . . . . .</b>	<b>2-727</b>
2750 – Brake control . . . . .	2-728

<b>2.9 Setpoint channel</b>	2-729
3100 – Fixed values	2-730
3105 – 4-stage joystick switch	2-731
3110 – Motorized potentiometer	2-732
3113 – AOP30 display and control unit	2-733
3115 – Fixed setpoint	2-734
3120 – Oscillation/square-wave generator	2-735
3125 – Jog setpoint	2-736
3130 – Creep setpoint	2-737
3135 – Setpoint processing	2-738
3150 – Ramp-function generator (Part 1)	2-739
3151 – Ramp-function generator (Part 2)	2-740
3152 – Ramp-function generator (Part 3)	2-741
3155 – Limitation after ramp-function generator	2-742
<b>2.10 Encoder evaluation</b>	2-743
4704 – Position sensing, encoders 1 ... 2	2-744
4710 – Actual speed value measurement, motor encoder (encoder 1)	2-745
4711 – Actual speed value measurement, encoder 2	2-746
4720 – Encoder interface, receive signals, encoders 1 ... 2	2-747
4730 – Encoder interface, send signals, encoders 1 ... 2	2-748
4735 – Reference mark search, encoders 1 ... 2	2-749
4750 – Absolute value for incremental encoder	2-750
<b>2.11 Armature circuit closed-loop control</b>	2-751
6800 – Speed controller start pulse	2-752
6805 – Speed controller (Part 1)	2-753
6810 – Speed controller (Part 2)	2-754
6812 – Speed controller (Part 3)	2-755
6815 – Speed controller (Part 4)	2-756
6820 – Friction/moment of inertia compensation	2-757
6825 – Torque limiting (Part 1)	2-758
6830 – Torque limiting (Part 2)	2-759
6835 – Speed limiting controller	2-760
6840 – Current limitation (Part 1)	2-761
6845 – Current limitation (Part 2)	2-762

6850 – Armature current actual value sensing (Part 1) . . . . .	2-763
6851 – Armature current actual value sensing (Part 2) . . . . .	2-764
6852 – EMF actual value selection for armature current precontrol . . . . .	2-765
6853 – Armature current controller adaptation . . . . .	2-766
6854 – Armature circuit model parameters . . . . .	2-767
6855 – Armature current closed-loop control . . . . .	2-768
6858 – Gating unit characteristic, linearization . . . . .	2-769
6860 – Auto-reversing stage, armature gating unit . . . . .	2-770
6862 – Limitations, state . . . . .	2-771
6865 – Simulation mode/thyristor check/commutation monitoring . . . . .	2-772
6895 – Line-dependent EMF reduction . . . . .	2-773
<b>2.12 Field circuit closed-loop control . . . . .</b>	<b>2-774</b>
6900 – EMF closed-loop control . . . . .	2-775
6902 – Actual value acquisition, armature voltage/EMF . . . . .	2-776
6905 – Field current setpoint limiting . . . . .	2-777
6908 – Field current controller adaptation . . . . .	2-778
6910 – Field current closed-loop control . . . . .	2-779
6912 – Field current actual value sensing . . . . .	2-780
6915 – Field gating unit . . . . .	2-781
6920 – Field reversal . . . . .	2-782
<b>2.13 Power unit . . . . .</b>	<b>2-783</b>
6950 – Line analysis, armature . . . . .	2-784
6952 – Line analysis, field . . . . .	2-785
6954 – Line monitoring . . . . .	2-786
6956 – Fuse monitoring (DC converter) . . . . .	2-787
6957 – Fuse monitoring (Control Module) . . . . .	2-788
6960 – Power unit, properties . . . . .	2-789
6965 – Adaptation to external power unit (Control Module) . . . . .	2-790
6970 – Converter Commutation Protector (CCP) . . . . .	2-791
<b>2.14 Technology controller . . . . .</b>	<b>2-792</b>
7958 – Closed-loop control (r0108.16 = 1) . . . . .	2-793

<b>2.15 Signals and monitoring functions</b> .....	2-794
8020 – Messages (Part 1) .....	2-795
8025 – Messages (Part 2) .....	2-796
8030 – Motor interface (Part 1, X177.53/54/55) .....	2-797
8035 – Motor interface (Part 2) .....	2-798
8038 – I2t monitoring motor .....	2-799
8040 – Speed-dependent current limitation .....	2-800
8042 – I2t monitoring power unit .....	2-801
8044 – Field current monitoring .....	2-802
8045 – Device fan operating hours counter .....	2-803
8046 – Monitoring stall protection/tachometer break .....	2-804
8047 – Device fan (DC converter) .....	2-805
8048 – Internal device monitoring functions .....	2-806
8049 – Device fan (Control Module) .....	2-807
8050 – Trend recorder function .....	2-808
8052 – Diagnostic memory .....	2-809
8054 – Internal diagnostics .....	2-810
<b>2.16 Faults and alarms</b> .....	2-811
8060 – Fault buffer .....	2-812
8065 – Alarm buffer .....	2-813
8070 – Fault/alarm trigger word (r2129) .....	2-814
8075 – Fault/alarm configuration .....	2-815
<b>2.17 Data sets</b> .....	2-816
8560 – Command Data Sets (CDS) .....	2-817
8565 – Drive Data Sets (DDS) .....	2-818
8570 – Encoder Data Sets (EDS) .....	2-819
<b>2.18 Communication between devices</b> .....	2-820
9300 – Peer-to-peer interface .....	2-821
9350 – Paralleling interface (Part 1) .....	2-822
9352 – Paralleling interface (Part 2) .....	2-823
9355 – Paralleling interface (Part 3) .....	2-824
9360 – Switchover of the power unit topology .....	2-825



<b>2.19 Terminal Module 15 for SINAMICS (TM15DI/DO)</b> .....	2-826
9400 – Digital inputs/outputs, bidirectional (DI/DO 0 ... DI/DO 7) .....	2-827
9401 – Digital inputs/outputs, bidirectional (DI/DO 8 ... DI/DO 15) .....	2-828
9402 – Digital inputs/outputs, bidirectional (DI/DO 16 ... DI/DO 23) .....	2-829
<b>2.20 Terminal Module 31 (TM31)</b> .....	2-830
9550 – Digital inputs, isolated (DI 0 ... DI 3) .....	2-831
9552 – Digital inputs, isolated (DI 4 ... DI 7) .....	2-832
9556 – Digital relay outputs, isolated (DO 0 ... DO 1) .....	2-833
9560 – Digital inputs/outputs, bidirectional (DI/DO 8 ... DI/DO 9) .....	2-834
9562 – Digital inputs/outputs, bidirectional (DI/DO 10 ... DI/DO 11) .....	2-835
9566 – Analog input 0 (AI 0) .....	2-836
9568 – Analog input 1 (AI 1) .....	2-837
9572 – Analog outputs (AO 0 ... AO 1) .....	2-838
9576 – Temperature evaluation KTY/PTC .....	2-839
9577 – Sensor monitoring KTY/PTC .....	2-840
<b>2.21 Terminal Module 150 (TM150)</b> .....	2-841
9625 – Temperature evaluation structure (channels 0 ... 11) .....	2-842
9626 – Temperature evaluation 1x2, 3, 4-wire (channels 0 ... 5) .....	2-843
9627 – Temperature evaluation 2x2-wire (channels 0 ... 11) .....	2-844
<b>2.22 Basic Operator Panel 20 (BOP20)</b> .....	2-845
9912 – Control word interconnection .....	2-846

## **2.2 Explanation of the function diagrams**

### **Function diagrams**

1020 – Explanation of the symbols (part 1)	2-667
1021 – Explanation of the symbols (part 2)	2-668
1022 – Explanation of the symbols (part 3)	2-669
1030 – Handling BICO technology	2-670

































































































<h3>Parameter</h3> <table><thead><tr><th>Symbol</th><th>Meaning</th></tr></thead><tbody><tr><td></td><td>Display parameter (parameter may appear multiple times)</td></tr><tr><td></td><td>Display parameter with index (parameter may appear multiple times)</td></tr><tr><td></td><td>Adjustable parameter (if parameter appears multiple times, diagram references are specified).</td></tr><tr><td></td><td>Adjustable parameter with index (if parameter appears multiple times, diagram references are specified).</td></tr></tbody></table>		Symbol	Meaning		Display parameter (parameter may appear multiple times)		Display parameter with index (parameter may appear multiple times)		Adjustable parameter (if parameter appears multiple times, diagram references are specified).		Adjustable parameter with index (if parameter appears multiple times, diagram references are specified).	<h3>Connectors</h3> <table><thead><tr><th>Symbol</th><th>Meaning</th></tr></thead><tbody><tr><td></td><td>Connector input CI with index range [y...z]</td></tr><tr><td></td><td>Connector input CI with index [y]</td></tr><tr><td></td><td>Connector output CO with [unit] and index range [y...z] (parameter may appear multiple times)</td></tr><tr><td></td><td>Connector output CO [unit] and with index [y] (parameter may appear multiple times)</td></tr></tbody></table>		Symbol	Meaning		Connector input CI with index range [y...z]		Connector input CI with index [y]		Connector output CO with [unit] and index range [y...z] (parameter may appear multiple times)		Connector output CO [unit] and with index [y] (parameter may appear multiple times)	<h3>Binectors</h3> <table><thead><tr><th>Symbol</th><th>Meaning</th></tr></thead><tbody><tr><td></td><td>Binector input BI with index range [y...z] and factory setting (Def.x) with bit x.</td></tr><tr><td></td><td>Binector input BI with index [y] and factory setting (Def.x) with bit x.</td></tr><tr><td></td><td>Binector output BO (parameter may appear multiple times)</td></tr><tr><td></td><td>Binector output BO with bit yy (parameter may appear multiple times)</td></tr></tbody></table>		Symbol	Meaning		Binector input BI with index range [y...z] and factory setting (Def.x) with bit x.		Binector input BI with index [y] and factory setting (Def.x) with bit x.		Binector output BO (parameter may appear multiple times)		Binector output BO with bit yy (parameter may appear multiple times)	<h3>Connectors/Binectors</h3> <table><thead><tr><th>Symbol</th><th>Meaning</th></tr></thead><tbody><tr><td></td><td>Connector/binector output CO/BO</td></tr></tbody></table> <h3>Cross-references between diagrams</h3> <table><thead><tr><th>Symbol</th><th>Meaning</th></tr></thead><tbody><tr><td></td><td>The function diagrams are divided into eight signal paths (signal path 1 ... 8) to enable quicker orientation.</td></tr><tr><td></td><td>Text = Unique signal name aaaa = Signal goes to destination diagram</td></tr><tr><td></td><td>b = Signal goes to signal path b Text = Unique signal name cccc = Signal comes from source diagram</td></tr><tr><td></td><td>d = Signal comes from signal path d</td></tr></tbody></table> <p>To "Function diagram name" [aaaa.b] = For binectors</p> <h3>Cross-references for control bits</h3> <table><thead><tr><th>Symbol</th><th>Meaning</th></tr></thead><tbody><tr><td></td><td>pxxxx = Original parameter of signal</td></tr><tr><td></td><td>aaaa = Signal comes from source diagram aaaa</td></tr><tr><td></td><td>b = Signal comes from signal path b</td></tr></tbody></table>		Symbol	Meaning		Connector/binector output CO/BO	Symbol	Meaning		The function diagrams are divided into eight signal paths (signal path 1 ... 8) to enable quicker orientation.		Text = Unique signal name aaaa = Signal goes to destination diagram		b = Signal goes to signal path b Text = Unique signal name cccc = Signal comes from source diagram		d = Signal comes from signal path d	Symbol	Meaning		pxxxx = Original parameter of signal		aaaa = Signal comes from source diagram aaaa		b = Signal comes from signal path b
Symbol	Meaning																																																										
	Display parameter (parameter may appear multiple times)																																																										
	Display parameter with index (parameter may appear multiple times)																																																										
	Adjustable parameter (if parameter appears multiple times, diagram references are specified).																																																										
	Adjustable parameter with index (if parameter appears multiple times, diagram references are specified).																																																										
Symbol	Meaning																																																										
	Connector input CI with index range [y...z]																																																										
	Connector input CI with index [y]																																																										
	Connector output CO with [unit] and index range [y...z] (parameter may appear multiple times)																																																										
	Connector output CO [unit] and with index [y] (parameter may appear multiple times)																																																										
Symbol	Meaning																																																										
	Binector input BI with index range [y...z] and factory setting (Def.x) with bit x.																																																										
	Binector input BI with index [y] and factory setting (Def.x) with bit x.																																																										
	Binector output BO (parameter may appear multiple times)																																																										
	Binector output BO with bit yy (parameter may appear multiple times)																																																										
Symbol	Meaning																																																										
	Connector/binector output CO/BO																																																										
Symbol	Meaning																																																										
	The function diagrams are divided into eight signal paths (signal path 1 ... 8) to enable quicker orientation.																																																										
	Text = Unique signal name aaaa = Signal goes to destination diagram																																																										
	b = Signal goes to signal path b Text = Unique signal name cccc = Signal comes from source diagram																																																										
	d = Signal comes from signal path d																																																										
Symbol	Meaning																																																										
	pxxxx = Original parameter of signal																																																										
	aaaa = Signal comes from source diagram aaaa																																																										
	b = Signal comes from signal path b																																																										
<h3>Data sets</h3> <table><thead><tr><th>Symbol</th><th>Meaning</th></tr></thead><tbody><tr><td></td><td>Parameter belongs to Command Data Set (CDS).</td></tr><tr><td></td><td>Parameter belongs to Drive Data Set (DDS).</td></tr><tr><td></td><td>Parameter belongs to Encoder Data Set (EDS).</td></tr><tr><td></td><td>Parameter belongs to Motor Data Set (MDS).</td></tr><tr><td></td><td>Parameter belongs to Power Unit Data Set (PDS)</td></tr></tbody></table>		Symbol	Meaning		Parameter belongs to Command Data Set (CDS).		Parameter belongs to Drive Data Set (DDS).		Parameter belongs to Encoder Data Set (EDS).		Parameter belongs to Motor Data Set (MDS).		Parameter belongs to Power Unit Data Set (PDS)	<h3>Explanations for parameters, binectors, connectors</h3> <table><thead><tr><th>Symbol</th><th>Meaning</th></tr></thead><tbody><tr><td>Parameter name</td><td>Name of parameter (max. 18 characters)</td></tr><tr><td>[Unit]</td><td>[Unit]</td></tr><tr><td></td><td>"r" = Display parameter. Parameters of this type are read-only. "xxxx" stands for the parameter number. "[y]" specifies the valid index, while "[y...z]" specifies the applicable index range. ".ww" specifies the bit number (e.g. 0...15).</td></tr><tr><td></td><td>"p" = Adjustable parameter. Parameters of this type may be changed. "xxxx" stands for the parameter number. "[y]" specifies the applicable index, while "[y...z]" specifies the applicable index range. ".ww" specifies the bit number (e.g. 0...15).</td></tr><tr><td>from ... to</td><td>Value range.</td></tr><tr><td>(xxxx[y].ww)</td><td>Parameter number (xxxx) with index number [y] and bit number .ww.</td></tr><tr><td>(Def)</td><td>Factory setting.</td></tr><tr><td>(Def.w)</td><td>Factory setting with default bit number.</td></tr><tr><td>[aaaa.b]</td><td>Diagram references for adjustable parameters that occur multiple times. [Function block diagram, signal path]</td></tr></tbody></table>						Symbol	Meaning	Parameter name	Name of parameter (max. 18 characters)	[Unit]	[Unit]		"r" = Display parameter. Parameters of this type are read-only. "xxxx" stands for the parameter number. "[y]" specifies the valid index, while "[y...z]" specifies the applicable index range. ".ww" specifies the bit number (e.g. 0...15).		"p" = Adjustable parameter. Parameters of this type may be changed. "xxxx" stands for the parameter number. "[y]" specifies the applicable index, while "[y...z]" specifies the applicable index range. ".ww" specifies the bit number (e.g. 0...15).	from ... to	Value range.	(xxxx[y].ww)	Parameter number (xxxx) with index number [y] and bit number .ww.	(Def)	Factory setting.	(Def.w)	Factory setting with default bit number.	[aaaa.b]	Diagram references for adjustable parameters that occur multiple times. [Function block diagram, signal path]	<h3>Samplings times</h3> <table><thead><tr><th>Symbol</th><th>Meaning</th></tr></thead><tbody><tr><td></td><td>Adjustable parameter with factory setting for selecting time slice.</td></tr><tr><td></td><td>Default in p2048.</td></tr><tr><td></td><td>Time slice 4,000.00 μs.</td></tr><tr><td></td><td>There is no fixed sampling time for this function. Processing takes place in the background. The cycle time depends on the Control Unit's computational load.</td></tr><tr><td></td><td>A static state is represented here. The sampling time data is not relevant.</td></tr></tbody></table>		Symbol	Meaning		Adjustable parameter with factory setting for selecting time slice.		Default in p2048.		Time slice 4,000.00 μs.		There is no fixed sampling time for this function. Processing takes place in the background. The cycle time depends on the Control Unit's computational load.		A static state is represented here. The sampling time data is not relevant.						
Symbol	Meaning																																																										
	Parameter belongs to Command Data Set (CDS).																																																										
	Parameter belongs to Drive Data Set (DDS).																																																										
	Parameter belongs to Encoder Data Set (EDS).																																																										
	Parameter belongs to Motor Data Set (MDS).																																																										
	Parameter belongs to Power Unit Data Set (PDS)																																																										
Symbol	Meaning																																																										
Parameter name	Name of parameter (max. 18 characters)																																																										
[Unit]	[Unit]																																																										
	"r" = Display parameter. Parameters of this type are read-only. "xxxx" stands for the parameter number. "[y]" specifies the valid index, while "[y...z]" specifies the applicable index range. ".ww" specifies the bit number (e.g. 0...15).																																																										
	"p" = Adjustable parameter. Parameters of this type may be changed. "xxxx" stands for the parameter number. "[y]" specifies the applicable index, while "[y...z]" specifies the applicable index range. ".ww" specifies the bit number (e.g. 0...15).																																																										
from ... to	Value range.																																																										
(xxxx[y].ww)	Parameter number (xxxx) with index number [y] and bit number .ww.																																																										
(Def)	Factory setting.																																																										
(Def.w)	Factory setting with default bit number.																																																										
[aaaa.b]	Diagram references for adjustable parameters that occur multiple times. [Function block diagram, signal path]																																																										
Symbol	Meaning																																																										
	Adjustable parameter with factory setting for selecting time slice.																																																										
	Default in p2048.																																																										
	Time slice 4,000.00 μs.																																																										
	There is no fixed sampling time for this function. Processing takes place in the background. The cycle time depends on the Control Unit's computational load.																																																										
	A static state is represented here. The sampling time data is not relevant.																																																										
1		2		3		4		5		6		7		8																																													
DO: All Objects								SIEMENS		fp_1020_96_VSD		Function diagram		- 1020 -																																													
Explanations for the function diagrams - Explanation of the symbols (part 1)										2013-05-14 v 1.4		SINAMICS DCM																																															

Fig. 2-1

1020 – Explanation of the symbols (part 1)


















<div><div>Symbol for switch</div><div><div></div><div><div>Simple change-over switch</div><div>The factory setting for the switch position is displayed (in this case, the delivery state is switch position 1).</div></div></div></div>			<div><div>Symbols for logic functions</div><div><div></div><div>Logical inversion</div></div><div><div></div><div>AND element with logical inversion of an input signal</div></div><div><div></div><div>R/S flip-flop</div><div>S = Input for setting R = Input for resetting Q = Non-inverted output Q̄ = Inverted output</div></div><div><div></div><div>Exclusive OR/XOR</div><div>y = 1 if x1 != x2.</div></div></div>			<div><div>Symbols for arithmetic and control functions</div><div><div></div><div>Threshold switch 1/0</div><div>Outputs a logical "1" at output y if x &lt; S.</div></div><div><div></div><div>Threshold switch 0/1</div><div>Outputs a logical "1" at output y if x &gt; S.</div></div><div><div></div><div>Threshold 1/0 with hysteresis</div><div>Outputs a logical "1" at output y if x &lt; S. If x &gt;= S + H, y returns to 0.</div></div><div><div></div><div>Threshold 0/1 with hysteresis</div><div>Outputs a logical "1" at output y if x &gt; S. If x &lt;= S - H, y returns to 0.</div></div><div><div></div><div>Limiter</div><div>x is limited to the upper limit value LU and the lower limit value LL and is output at output y. The binary signals MLU and MLL have the value "1" if upper or lower limiting is active.</div></div><div><div></div><div>Sample &amp; hold element</div><div>Sample and hold element. y = x if SET = 1 (no retentive memory during POWER OFF)</div></div></div>		
<div><div>Symbol for monitoring</div><div><div></div><div>Monitoring</div><div>Positioning in sheet at bottom right.</div></div></div>			<div><div>Symbols for arithmetic and control functions</div><div><div></div><div>Sign reversal</div><div>y = -x</div></div><div><div></div><div>Absolute-value generator</div><div>y =  x </div></div><div><div></div><div>Divider</div><div><math>y = \frac{x_1}{x_2}</math></div></div><div><div></div><div>Comparator greater than 0</div><div>Output y = logical "1" if output signal x &gt; 0, i.e. if it is positive.</div></div><div><div></div><div>Differentiator</div><div><math>y = \frac{dx}{dt}</math></div></div></div>					
1	2	3	4	5	6	7	8	
DO: All Objects					SIEMENS	fp_1021_96_VSD	Function diagram	- 1021 -
Explanations for the function diagrams - Explanation of the symbols (part 2)						2013-05-14	v 1.4	
						SINAMICS DCM		

Fig. 2-2

1021 – Explanation of the symbols (part 2)


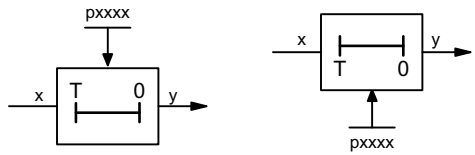
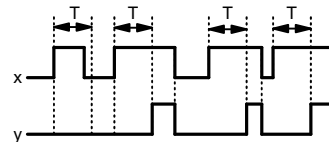


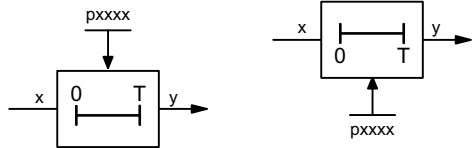
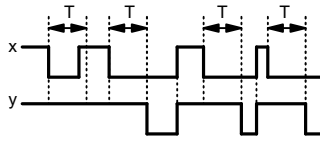
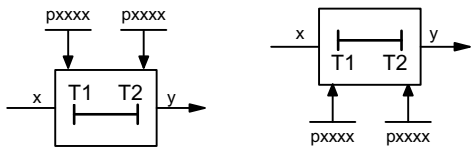
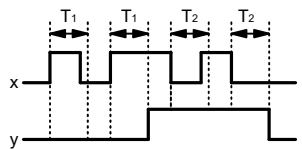
<div><h3>ON delay</h3><div></div><p>Digital signal x must retain the value "1" without interruption during time T, before output y switches to "1".</p><div></div></div>			<div><h3>PT1 element</h3><div></div><p>First-order delay element.</p><p>pxxxx = Time constant</p></div>			<div><h3>Band-stop filter</h3><div></div><p>pxxxx = Resonant frequency pyyyy = Filter quality</p></div>		
<div><h3>OFF delay</h3><div></div><p>Digital signal x must retain the value "0" without interruption during time T, before output y switches to "0".</p><div></div></div>			<div><h3>Delay (switching on and switching off)</h3><div></div><p>Digital signal x must retain the value "1" without interruption during time T1 or the value "0" during time T2, before output y switches its signal state.</p><div></div></div>					
1	2	3	4	5	6	7	8	
DO: All Objects				SIEMENS	fp_1022_96_VSD	Function diagram		
Explanations for the function diagrams - Explanation of the symbols (part 3)					2013-05-14	v 1.4	SINAMICS DCM	
							- 1022 -	

Fig. 2-3 1022 – Explanation of the symbols (part 3)


## Handling BICO technology

### Binector:



Binectors are binary signals that can be freely interconnected (BO = Binector Output). They represent a bit of a "BO:" display parameter (e.g. bit 15 of r0723).

### Connector:



Connectors are "analog signals" that can be freely interconnected (e.g. percentages, speeds, or torques). Connectors are simultaneously "CO:" display parameters (CO = Connector Output).

### Parameter assignment:

At the signal destination, the required binector/connector is selected using the appropriate parameters:

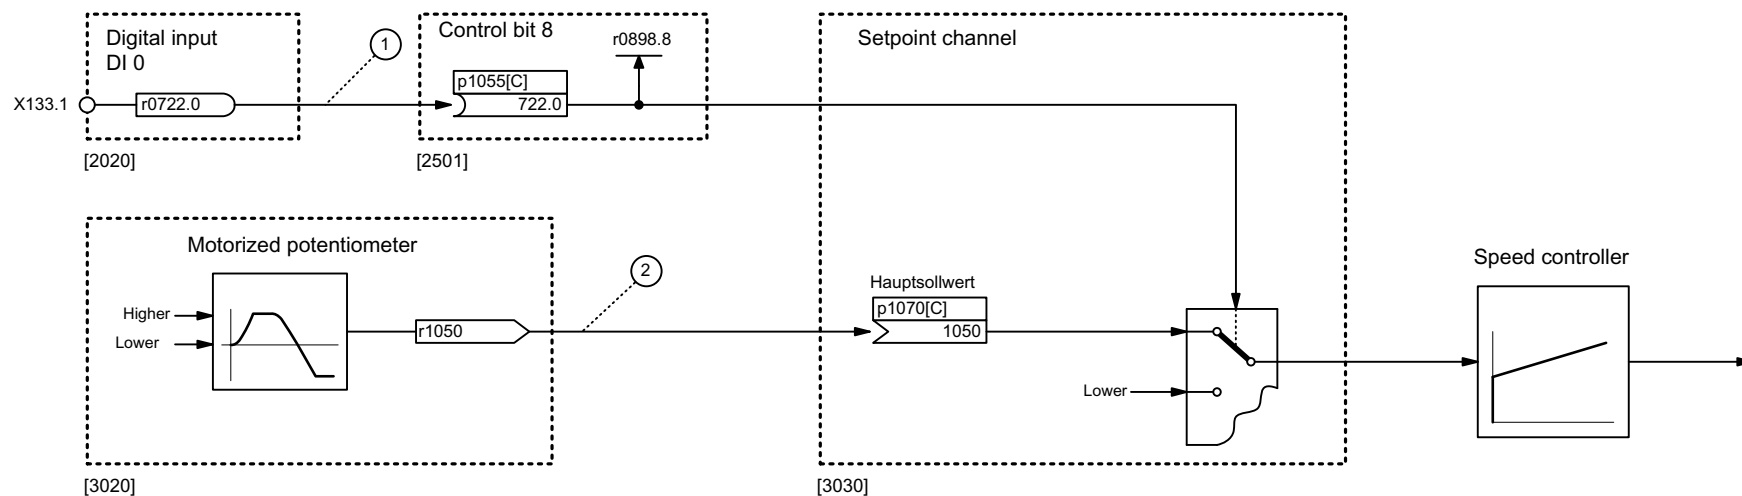
"BI:" parameters for binectors (BI = Binector Input)

or

"CI:" parameters for connectors (CI = Connector Input)

### Example:

The main setpoint for the speed controller (CI: p1070) should come from the motorized potentiometer output (CO: r1050) and the "Jog" command (BI: p1055) from digital input DI 0 (BO: r0722.0, terminal X122.1) on the CU320.



### Parameterization steps:

- ① p1055[0] = 722.0      Terminal X122.1 acts as "Jog bit 0".
- ② p1070[0] = 1050      The motorized potentiometer output acts as the main setpoint for the speed controller.

1	2	3	4	5	6	7	8
DO: All Objects				<b>SIEMENS</b>	fp_1030_96_VSD	Function diagram	- 1030 -
Explanations for the function diagrams - Handling BICO technology					2013-05-14      v 1.4	SINAMICS DCM	

## 2.3 Overviews

### Function diagrams

1520 – PROFIdrive	2-672
1580 – Encoder evaluations (position, speed)	2-673
1720 – Closed-loop control	2-674
1721 – Activation/deactivation of closed-loop control functions	2-675
1722 – CUD left, CUD right	2-676
1781 – Terminal Module 15 for SINAMICS (TM15DI/DO)	2-677
1840 – Terminal Module 31 (TM31)	2-678

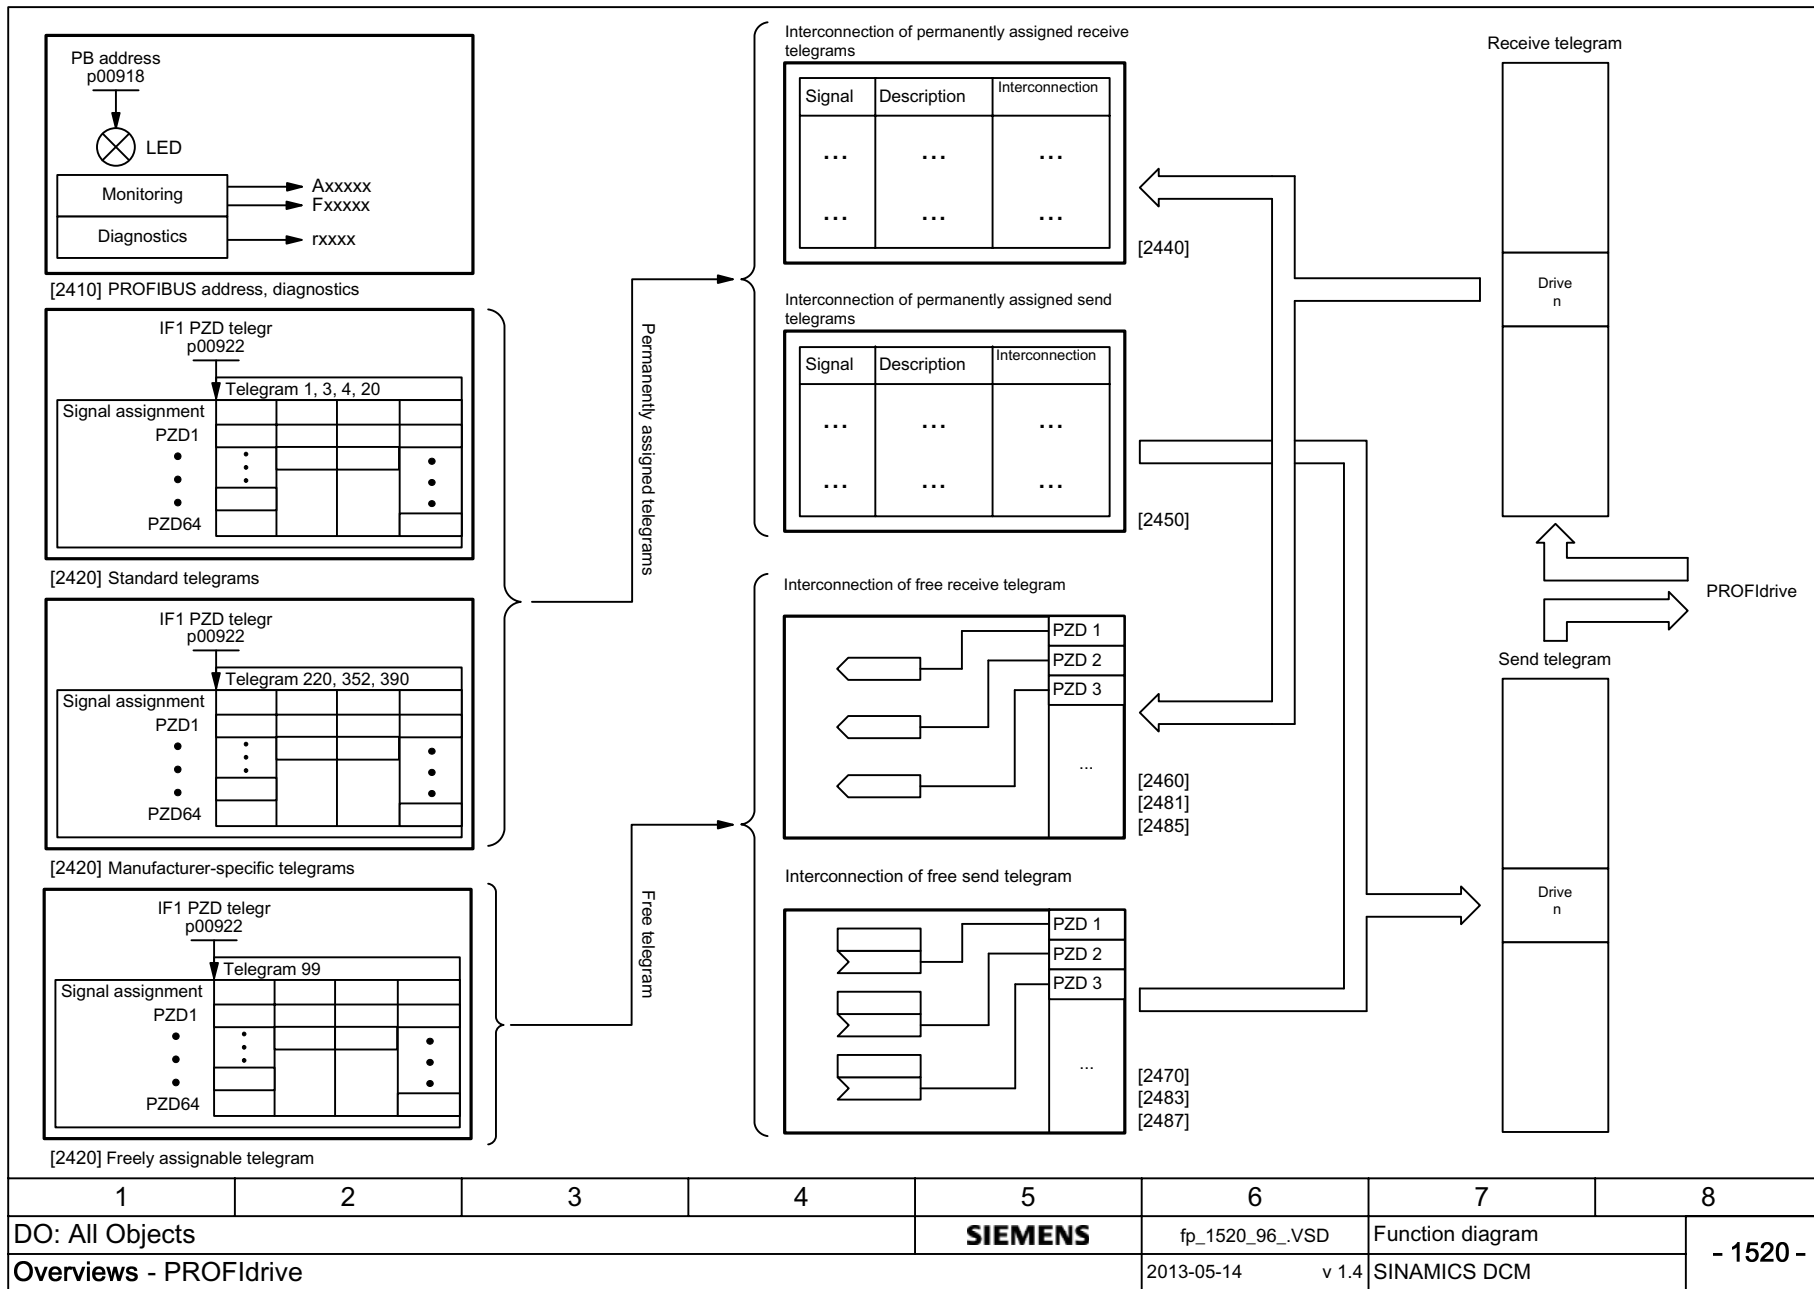


Fig. 2-5

1520 – PROFdrive




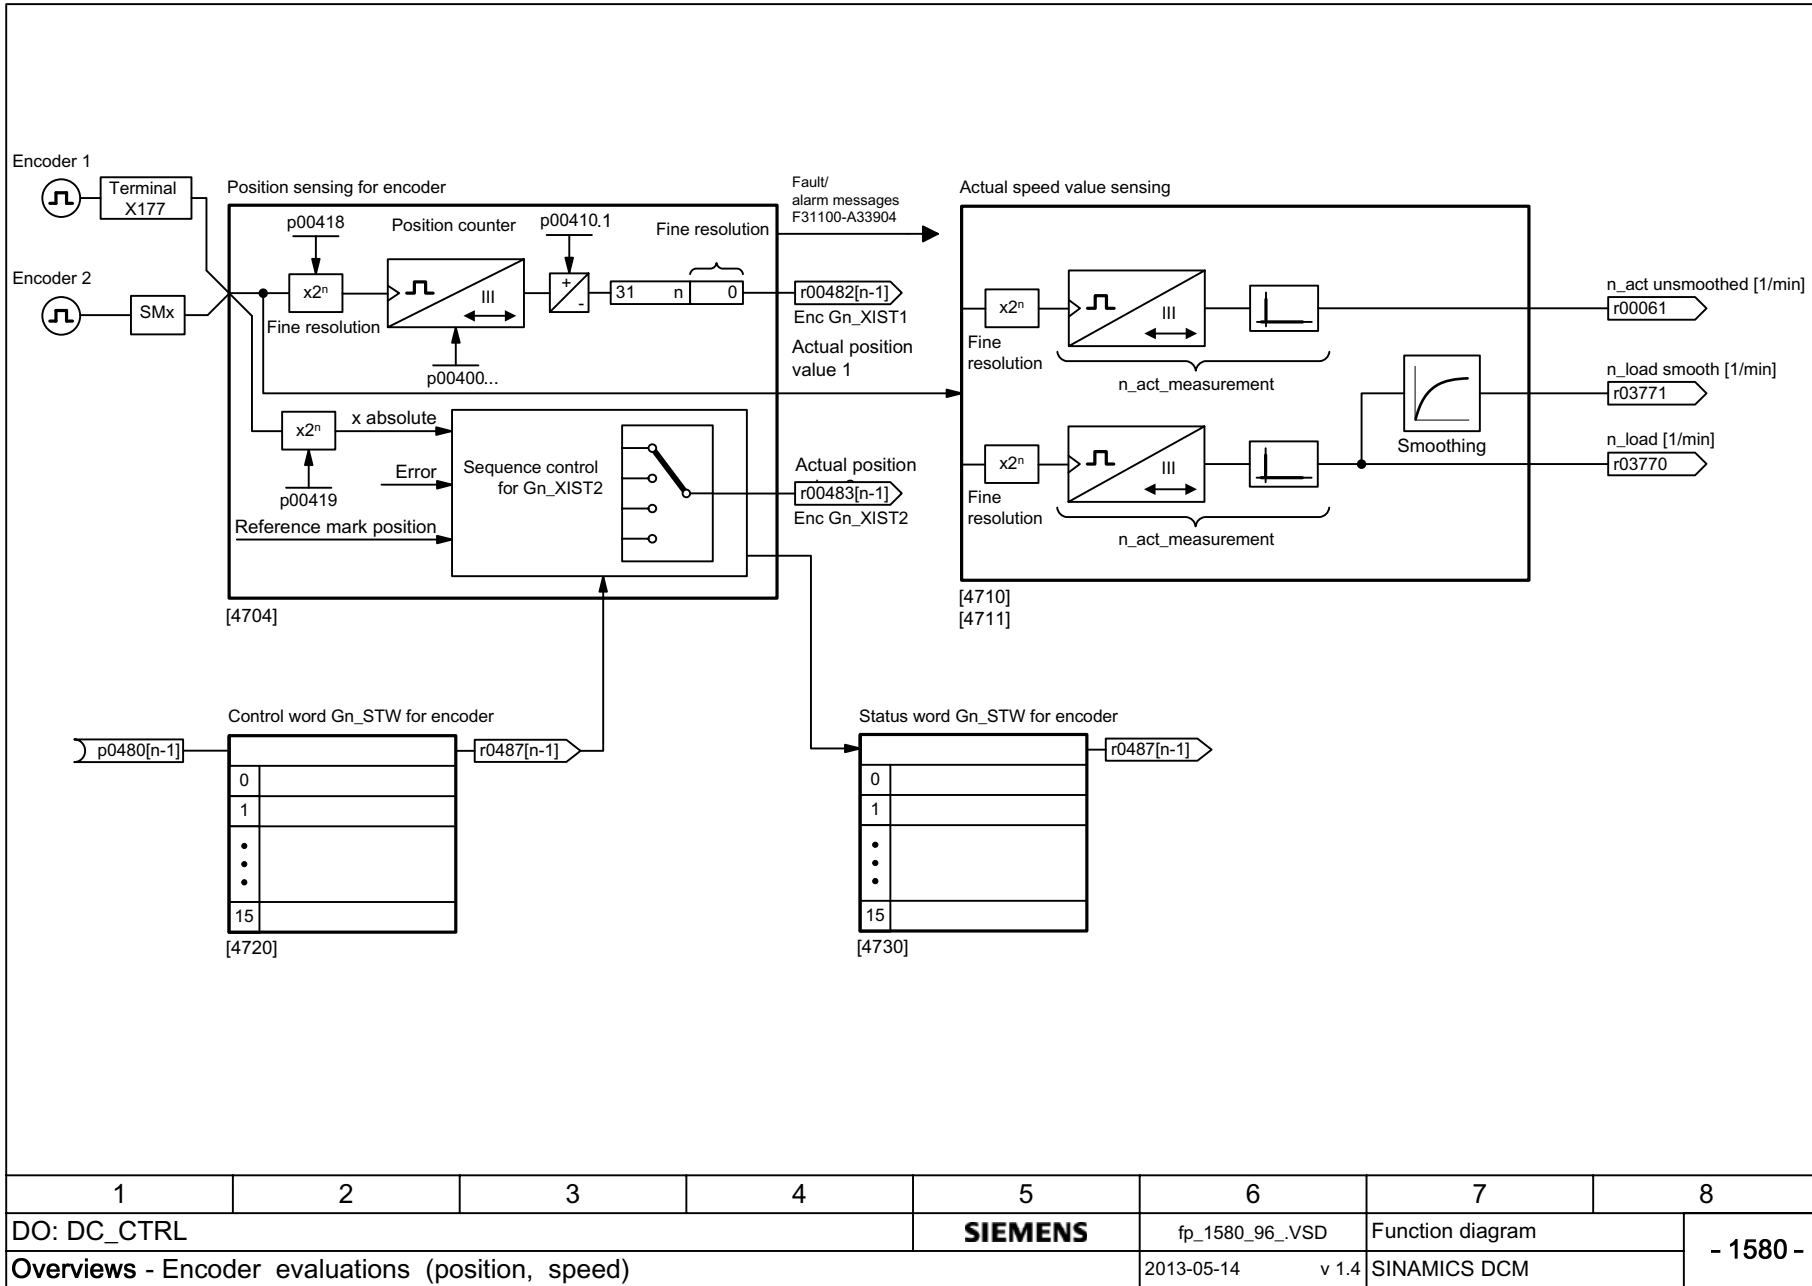


Fig. 2-6 1580 – Encoder evaluations (position, speed)

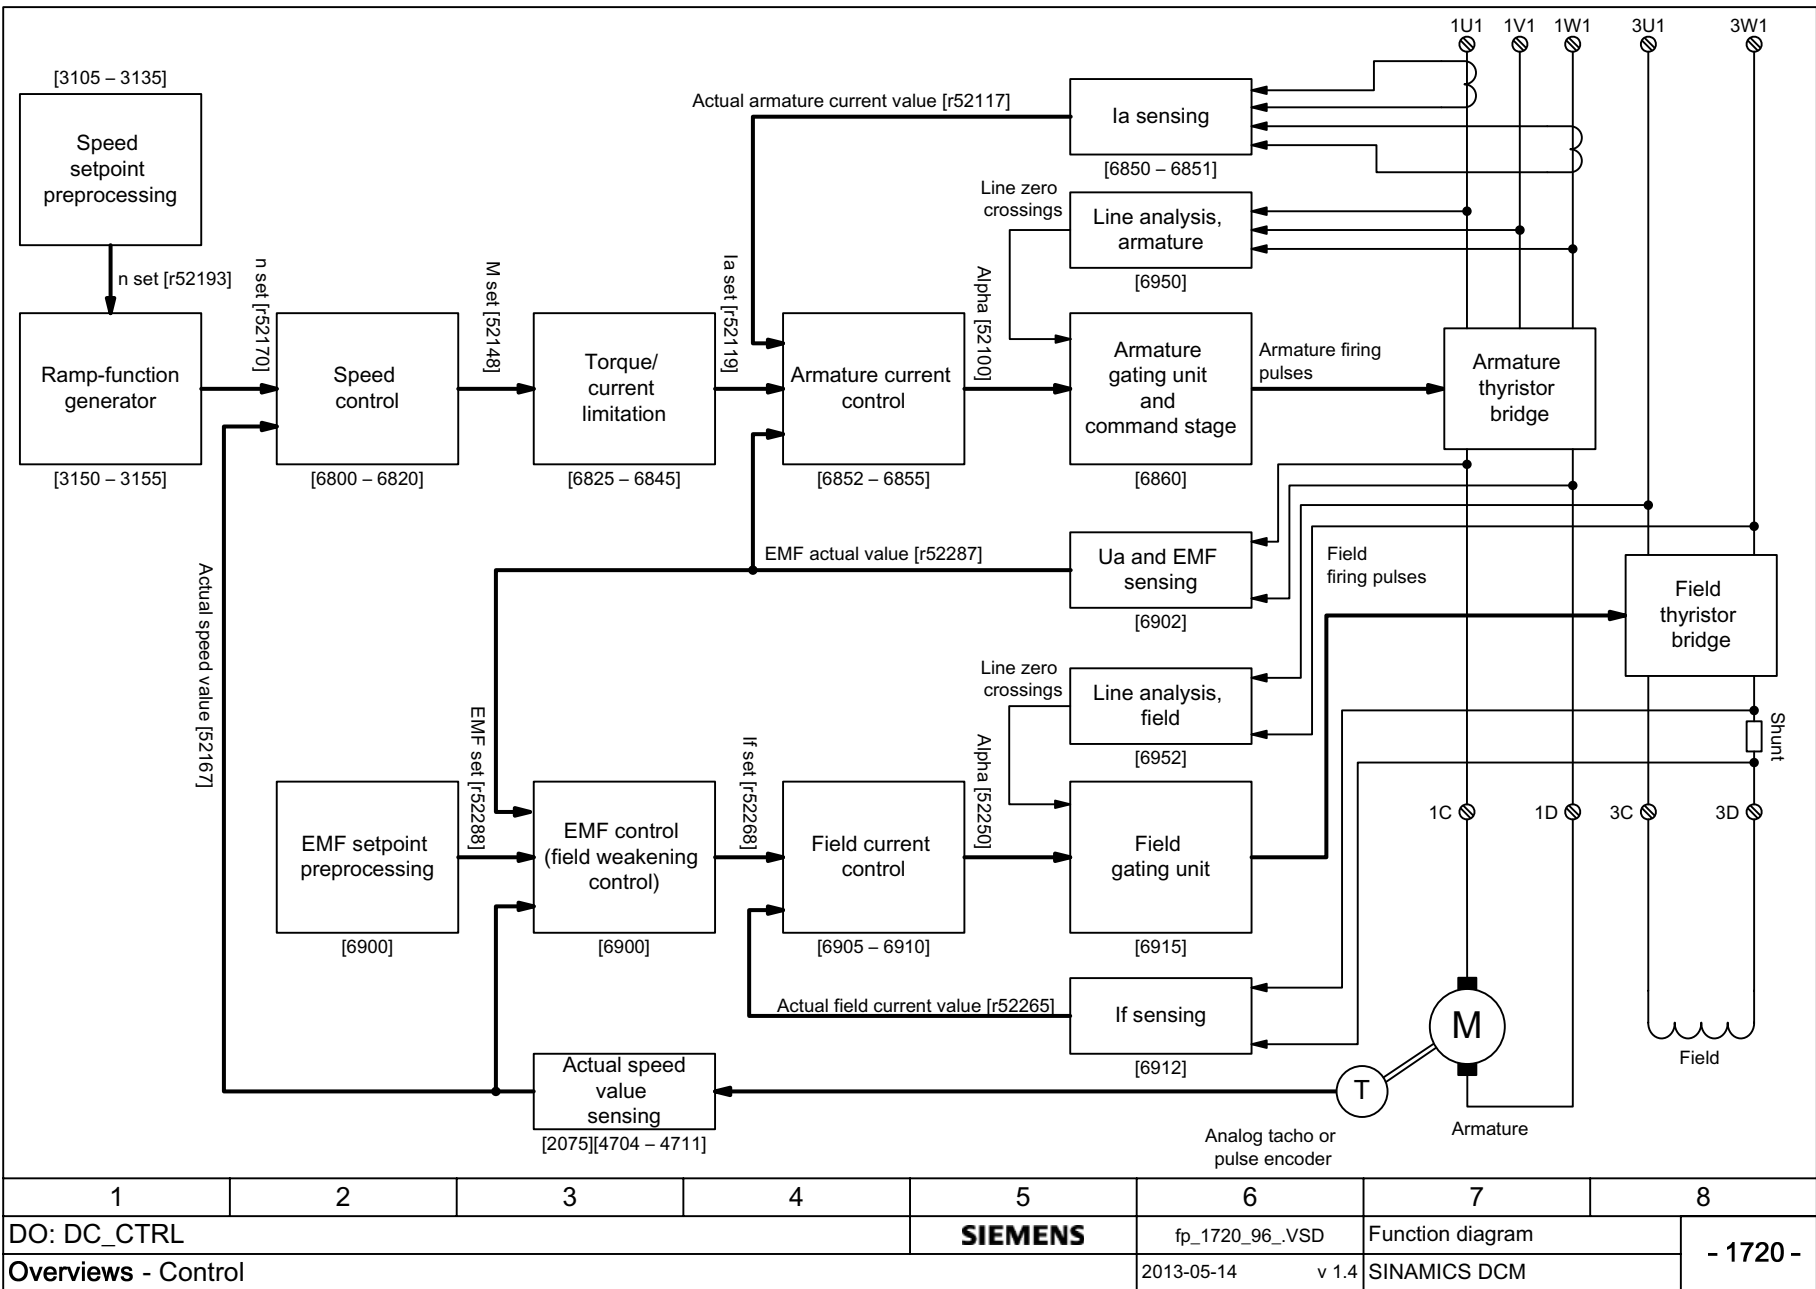

The most important control blocks can be activated/deactivated using parameter p50899.

p50899[0...6] = 0: Block is deactivated

p50899[0...6] = 1: Block is activated

Note 1:

This parameter is evaluated only once during a ramp-up, meaning that a change only becomes effective after a POWER ON or after a ramp-up with saved parameters (p0976 = 11).

Note 2:

The ability to deactivate control function blocks is intended for all users who wish to configure their own control system using DCC, e.g. because they are using the SINAMICS DC MASTER to operate something other than a motor (such as the excitation winding of a synchronous generator). Deactivating control function blocks that are not required frees up CPU time for the DCC function blocks.

Index	Meaning	
0	Speed setpoint preprocessing (FP3105 - FP3135)	<1>
1	Ramp-function generator (FP3150 - FP3155)	
2	Speed control (FP6800 - FP6820)	<2>
3	Torque limitation/current limitation (FP6825 - FP6845, FP8040)	
4	Armature current control (FP6852 - FP6855)	
5	EMF setpoint preprocessing and EMF control (FP6900)	
6	Field current control (FP6905 - FP6910)	

<1> Exception:

FP3130: The switch-on command and the intervention of r0807.0 and r53010.2 are always active.

<2> Exception:

FP6810: The "Selection of the actual speed value" is always active.

1	2	3	4	5	6	7	8
DO: DC_CTRL				<b>SIEMENS</b>	fp_1721_96_VSD	Function diagram	
Overviews - Control functions activation/deactivation					2013-05-14 v 1.4	SINAMICS DCM	
							- 1721 -

Fig. 2-8 1721 – Activation/deactivation of closed-loop control functions



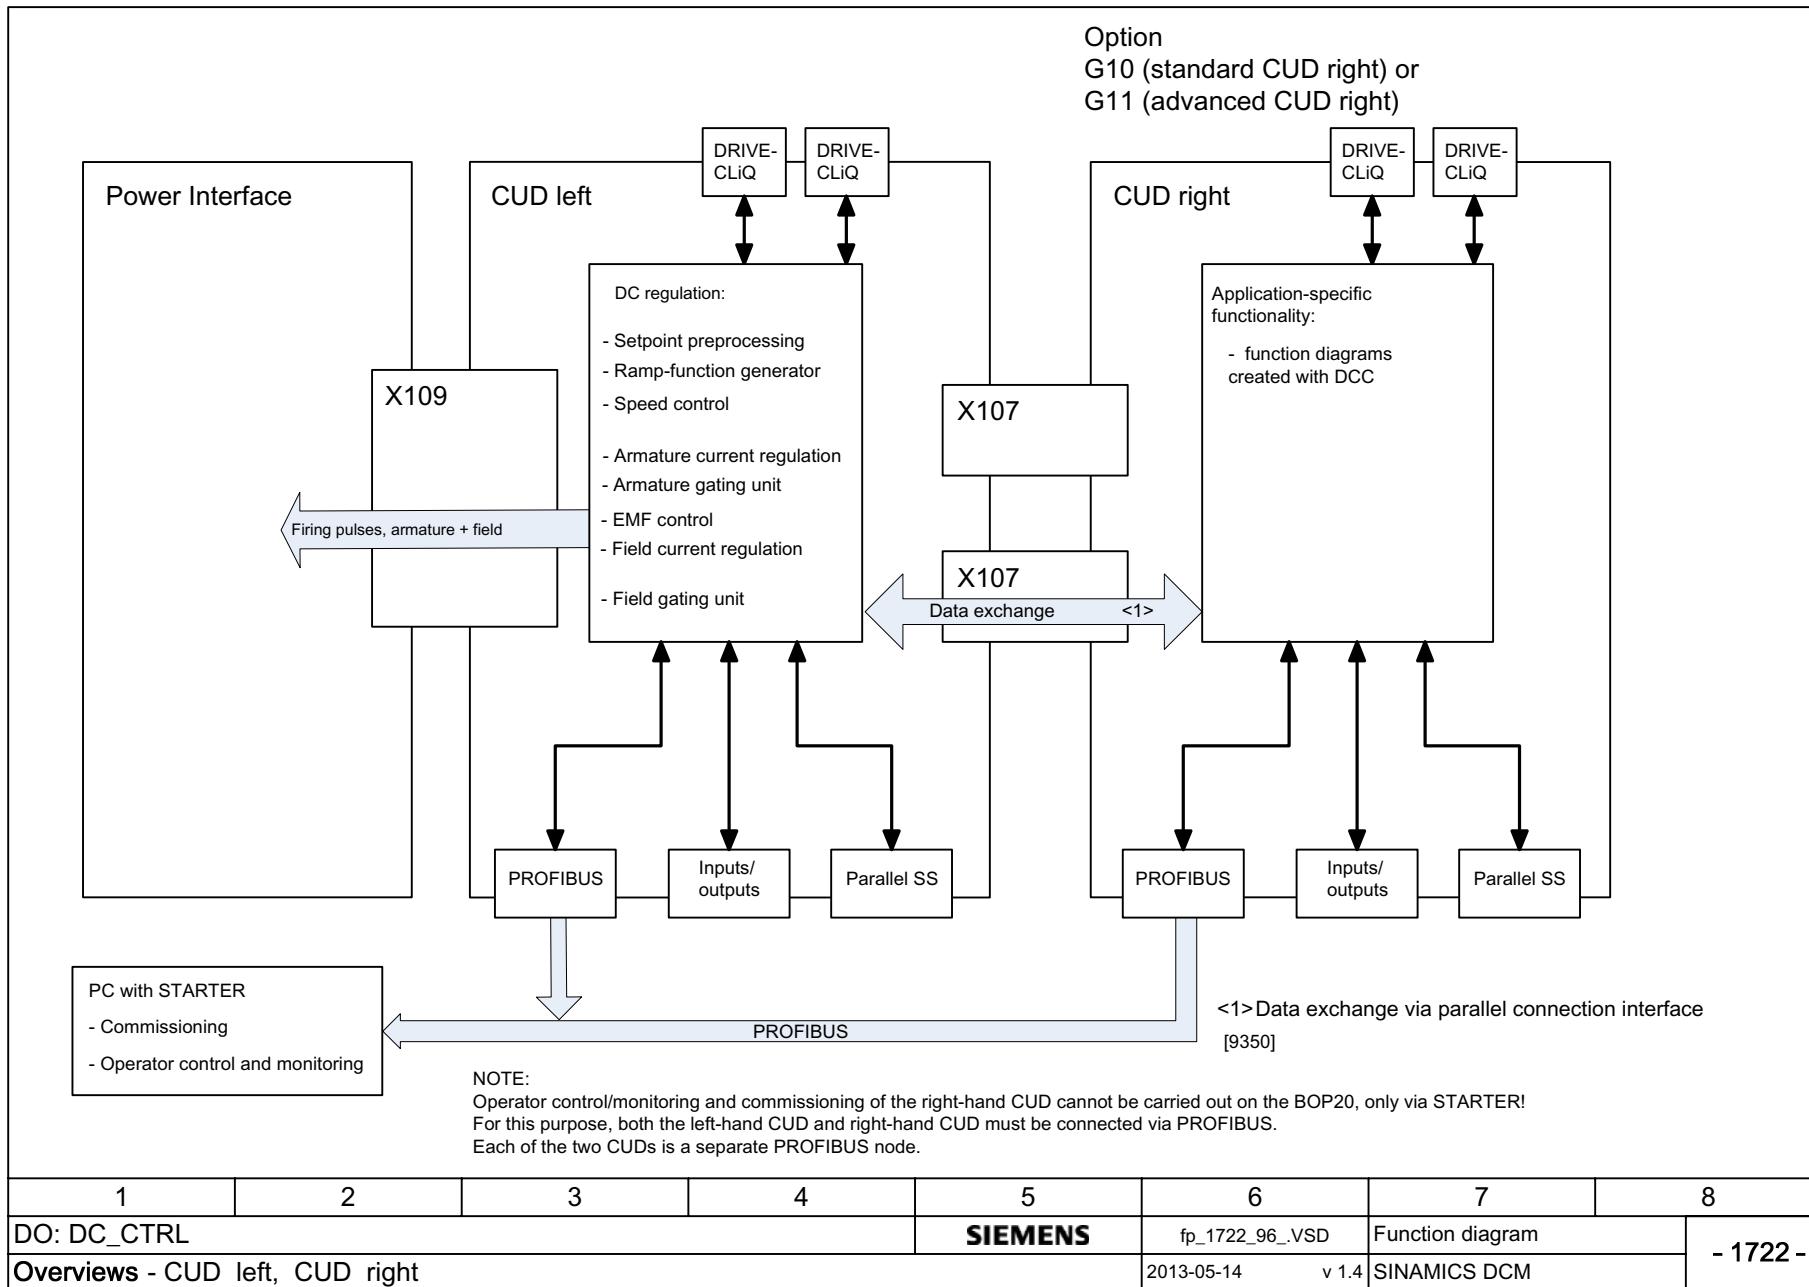


Fig. 2-9 1722 – CUD left, CUD right

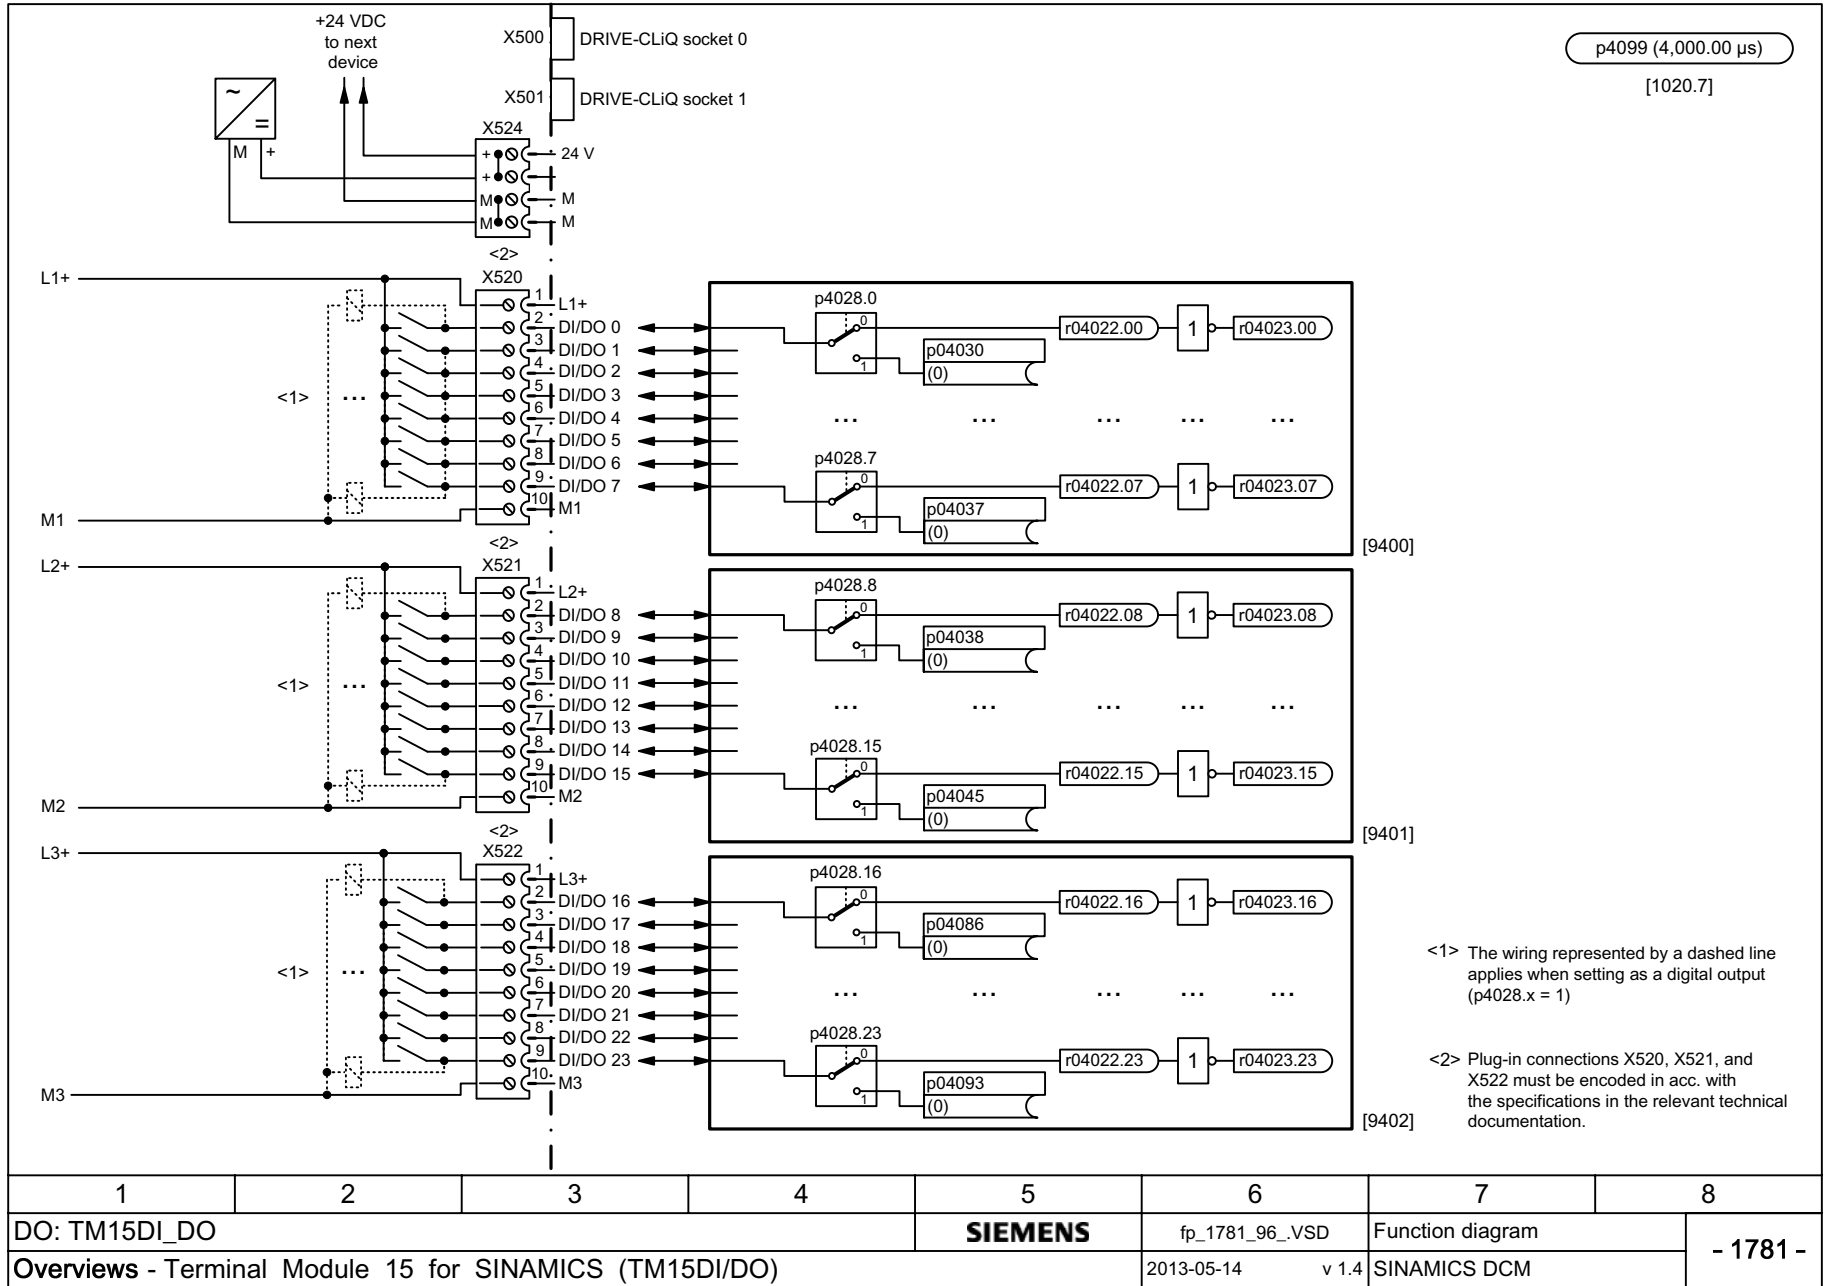

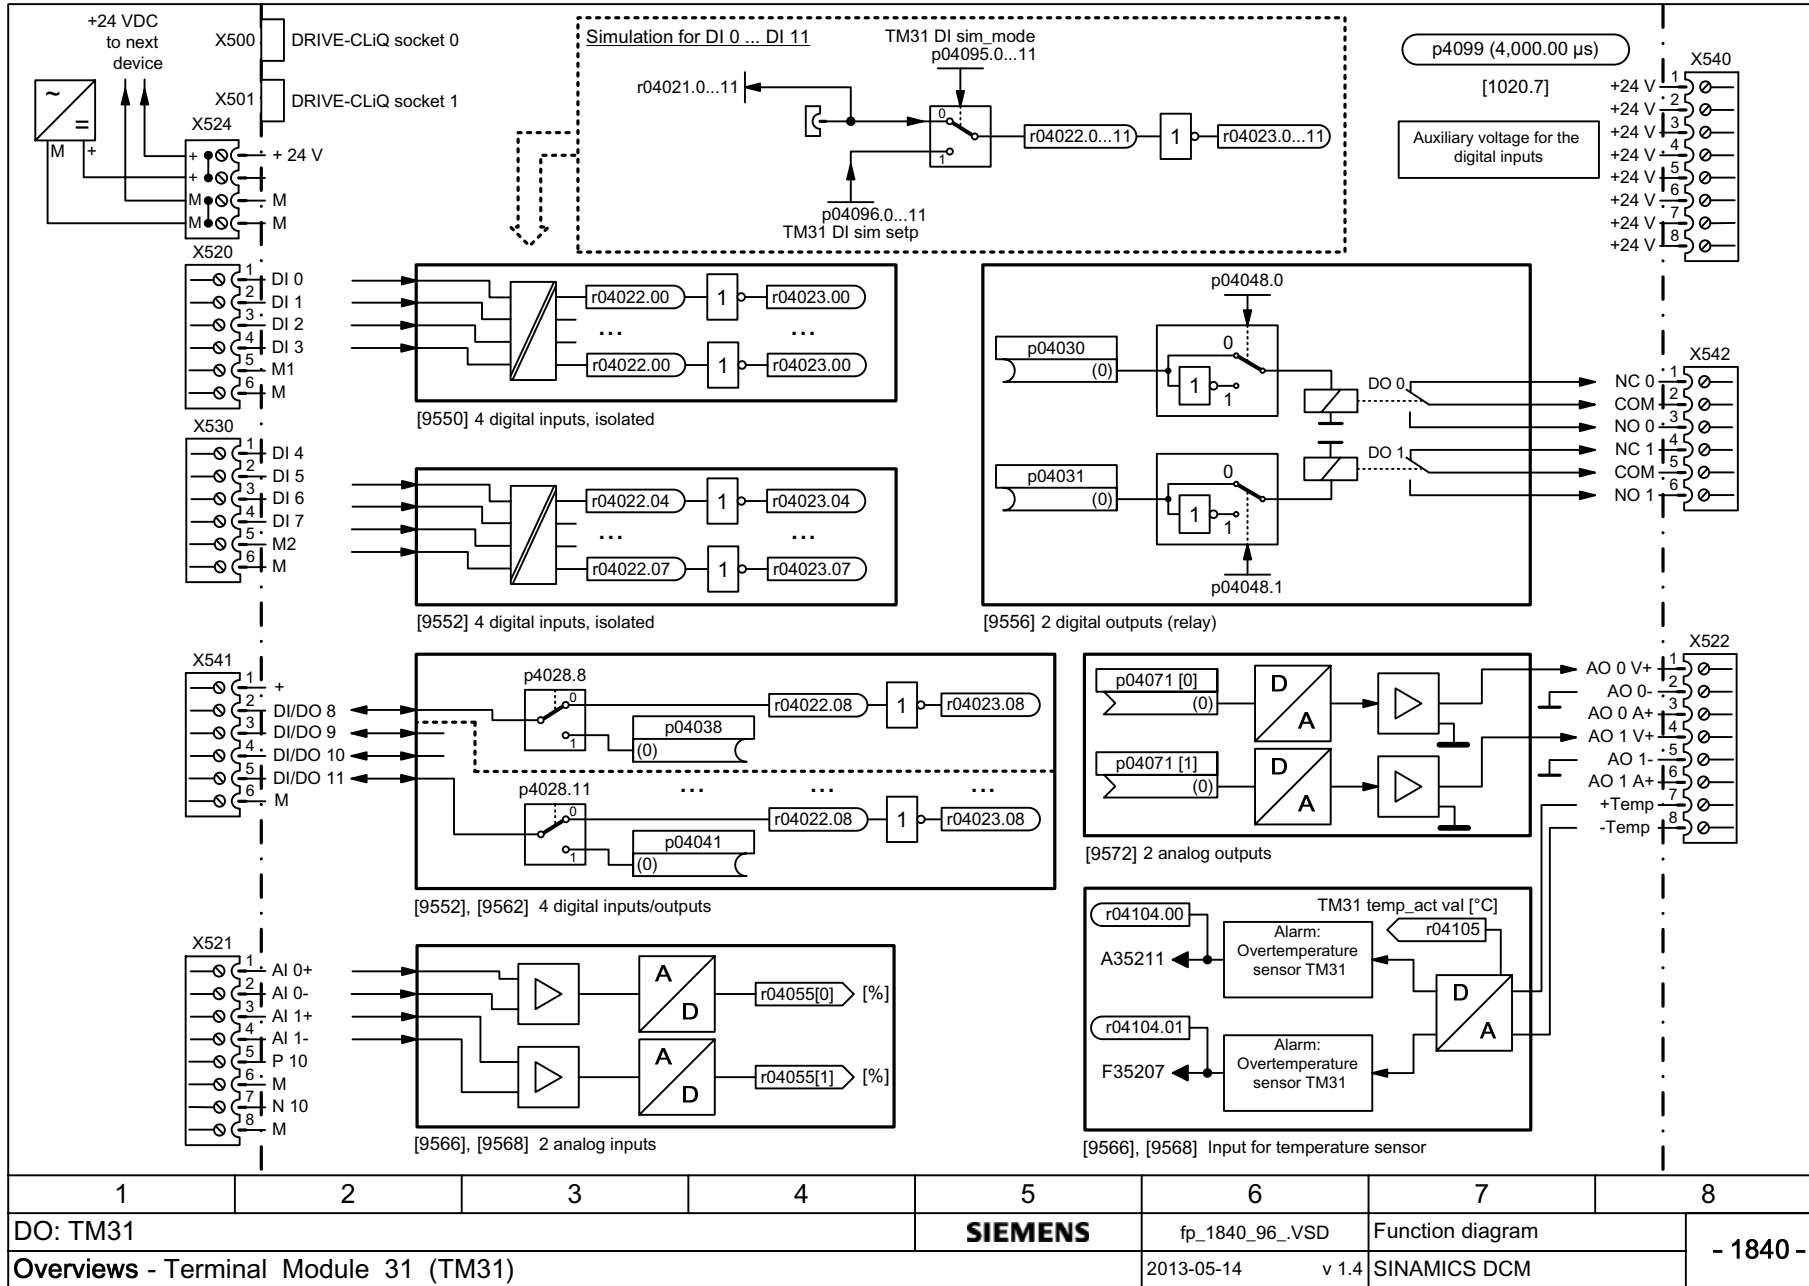

1	2	3	4	5	6	7	8
DO: TM31				<b>SIEMENS</b>	fp_1840_96_VSD	Function diagram	
Overviews - Terminal Module 31 (TM31)					2013-05-14 v 1.4	SINAMICS DCM	

Fig. 2-11 1840 – Terminal Module 31 (TM31)

## 2.4 CUD input/output terminals

### Function diagrams

2050 – Digital inputs (DI 0 ... DI 3)	2-680
2055 – Digital outputs (DO 0 ... DO 3)	2-681
2060 – Digital inputs/outputs, bidirectional (DI/DO 4 ... DI/DO 5)	2-682
2065 – Digital inputs/outputs, bidirectional (DI/DO 6 ... DI/DO 7)	2-683
2070 – E stop (emergency stop), relay output main contactor	2-684
2075 – Analog inputs (AI 0 and XT1.103/104)	2-685
2080 – Analog inputs (AI 1 ... AI 2)	2-686
2085 – Analog inputs (AI 3 ... AI 4)	2-687
2090 – Analog inputs (AI 5 ... AI 6)	2-688
2095 – Analog outputs (AO 0 ... AO 1)	2-689



Fig. 2-12

1	2	3	4	5	6	7	8
DO: DC_CTRL				<b>SIEMENS</b>	fp_2050_96_VSD	Function diagram	
CUD input/output terminals - Digital inputs (DI 0 ... DI 3)					2013-05-14 v 1.4	SINAMICS DCM	
- 2050 -							



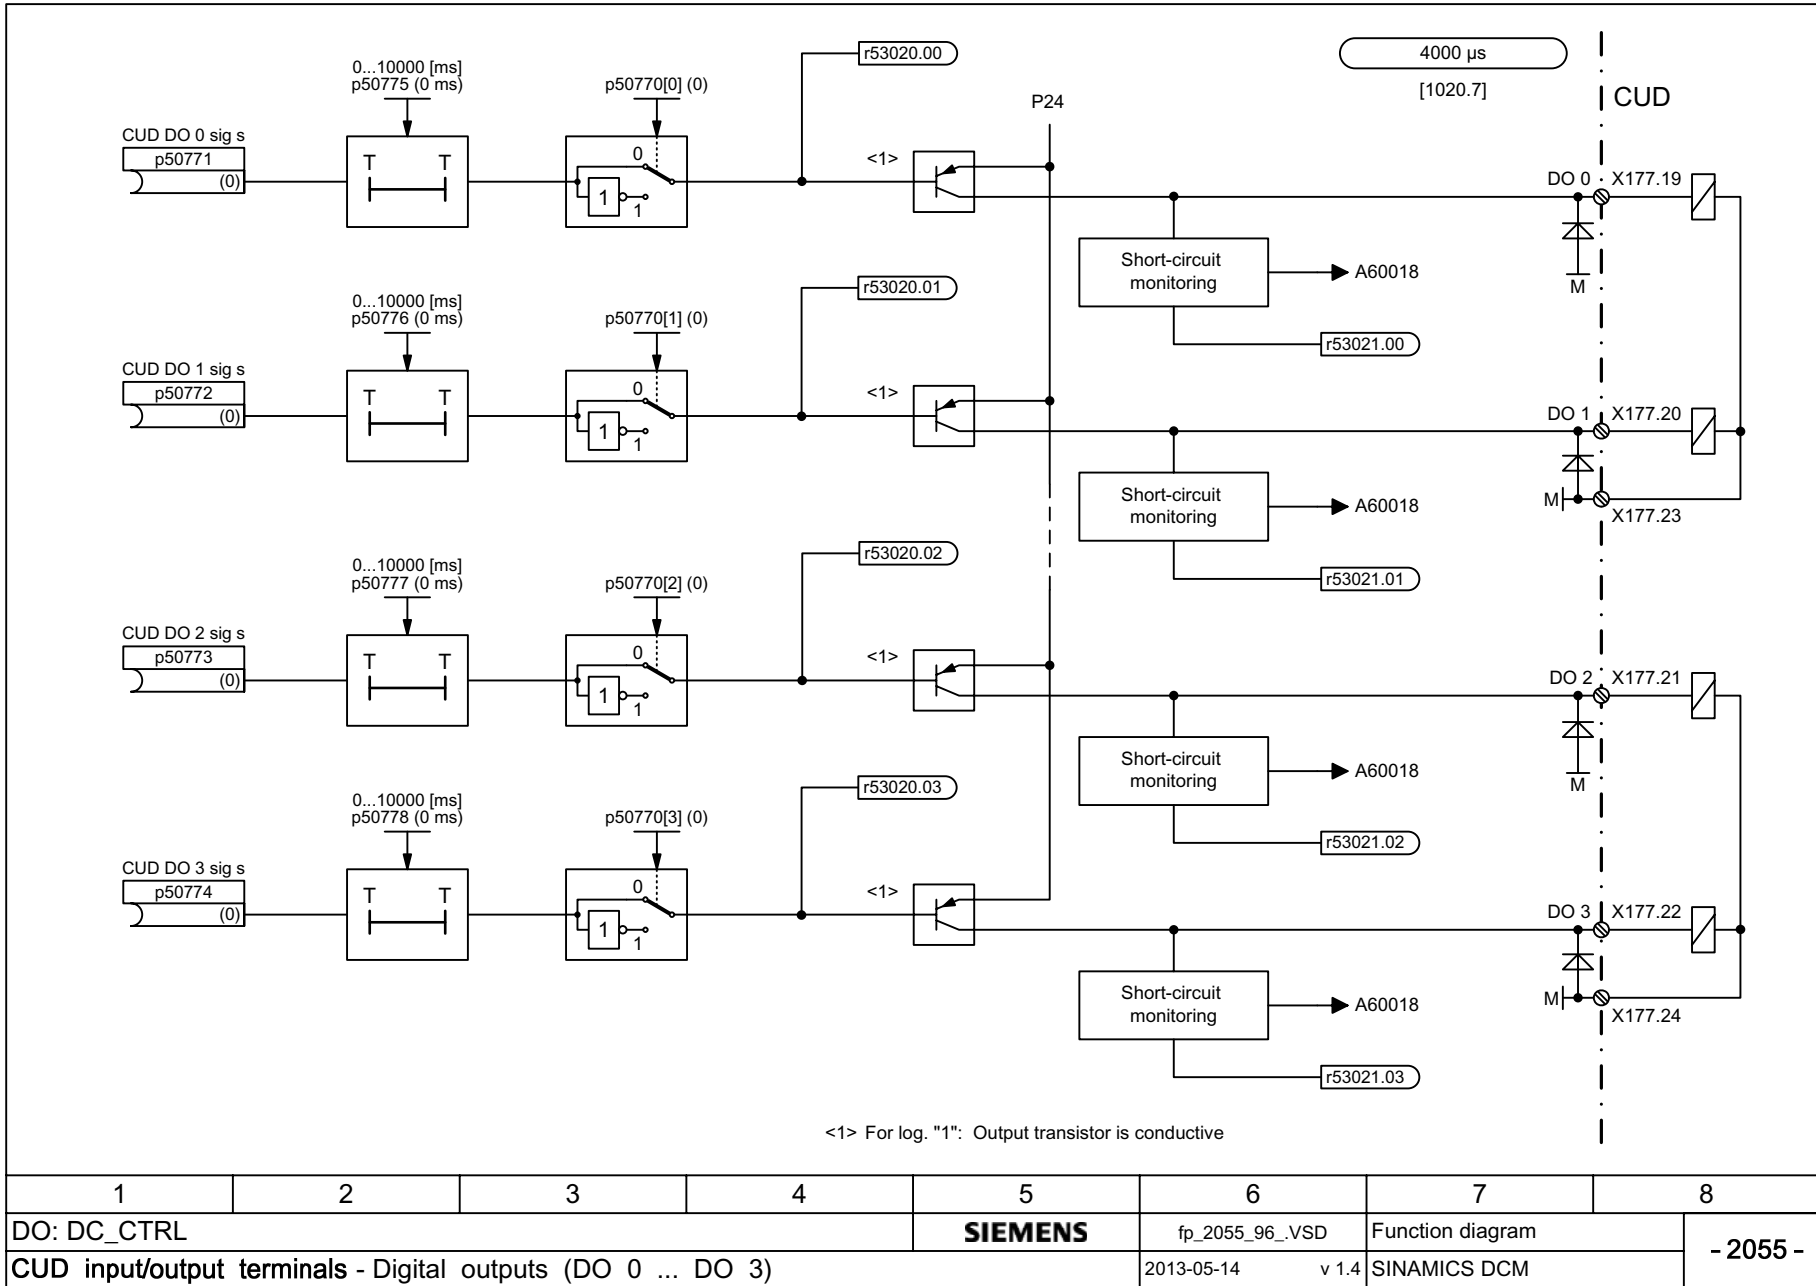


Fig. 2-13 2055 – Digital outputs (DO 0 ... DO 3)

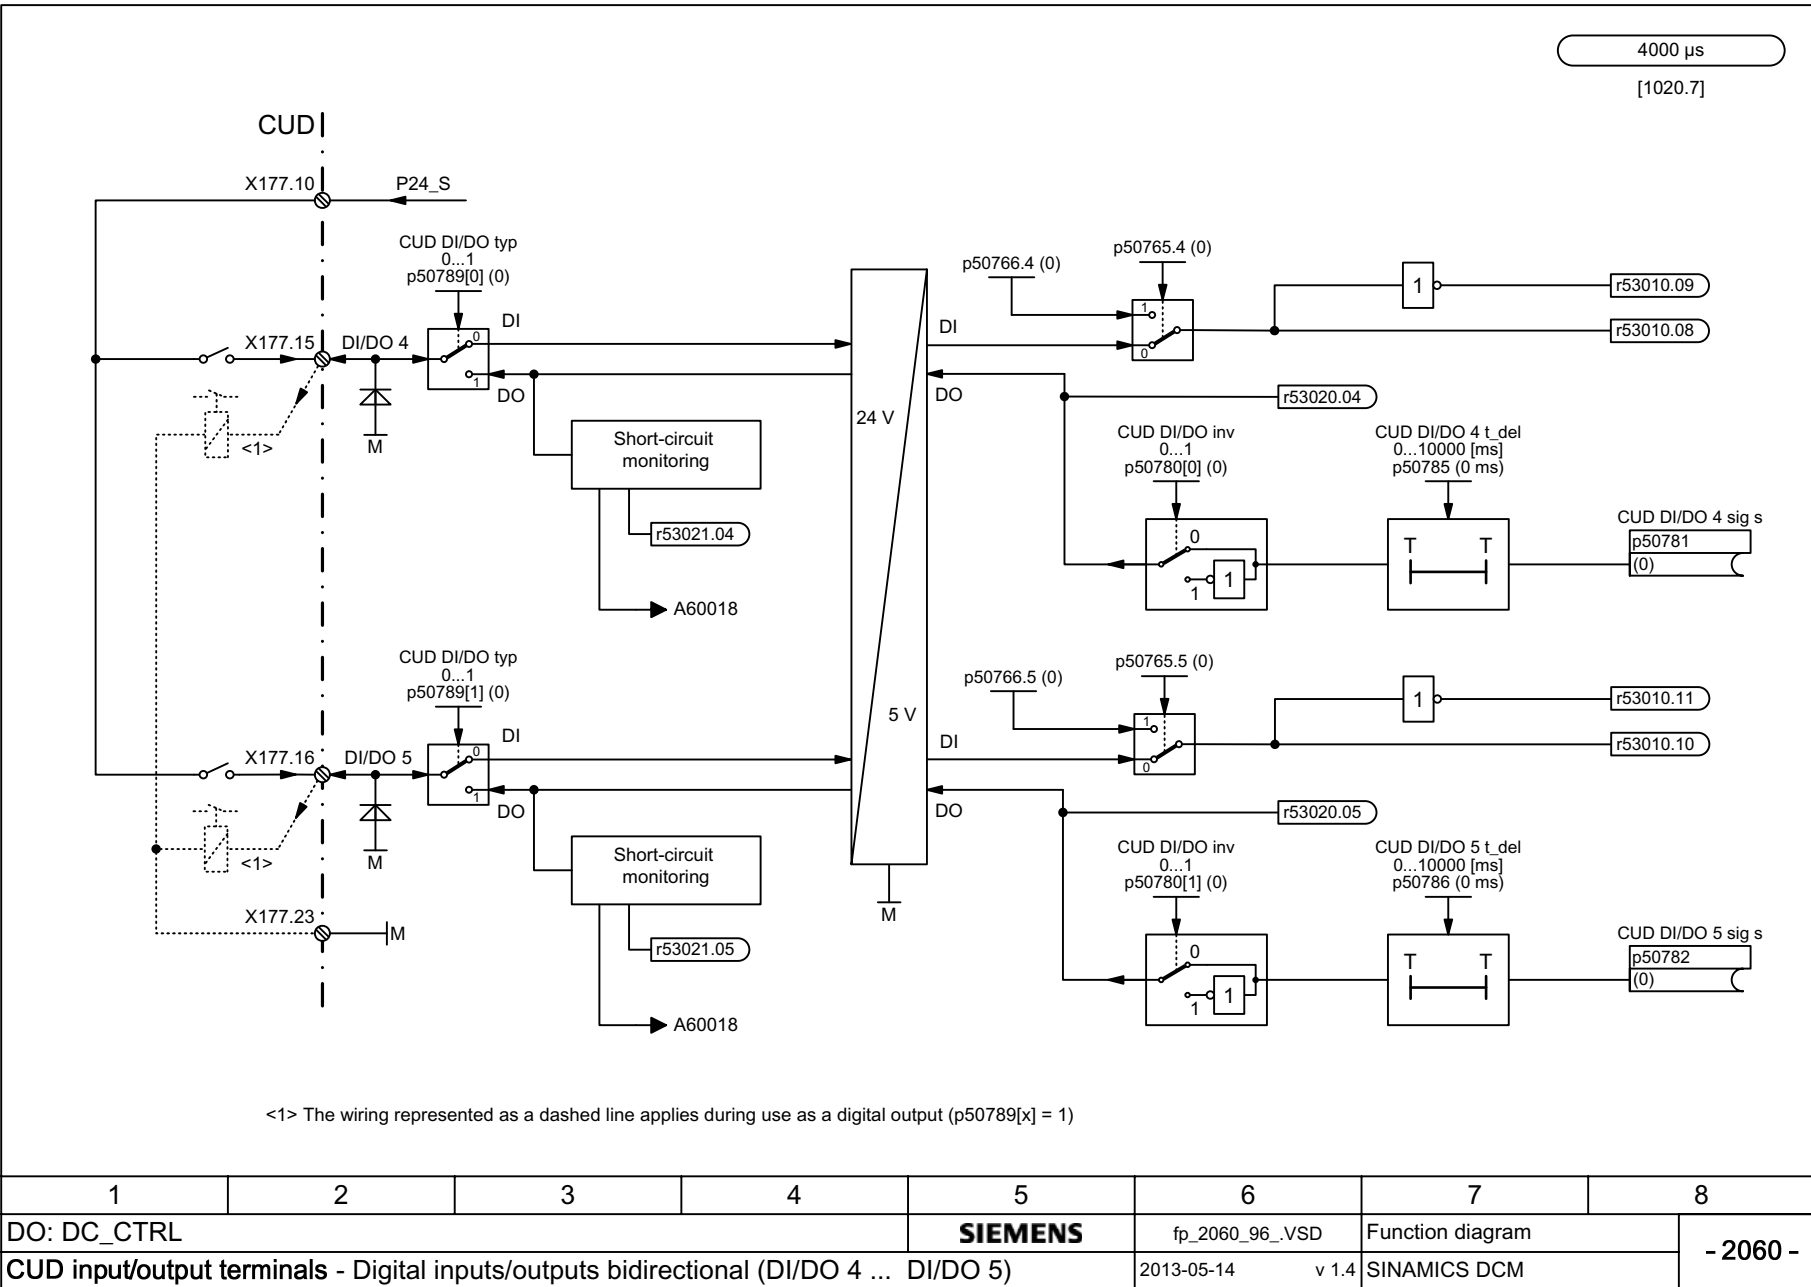


Fig. 2-14




Fig. 2-15

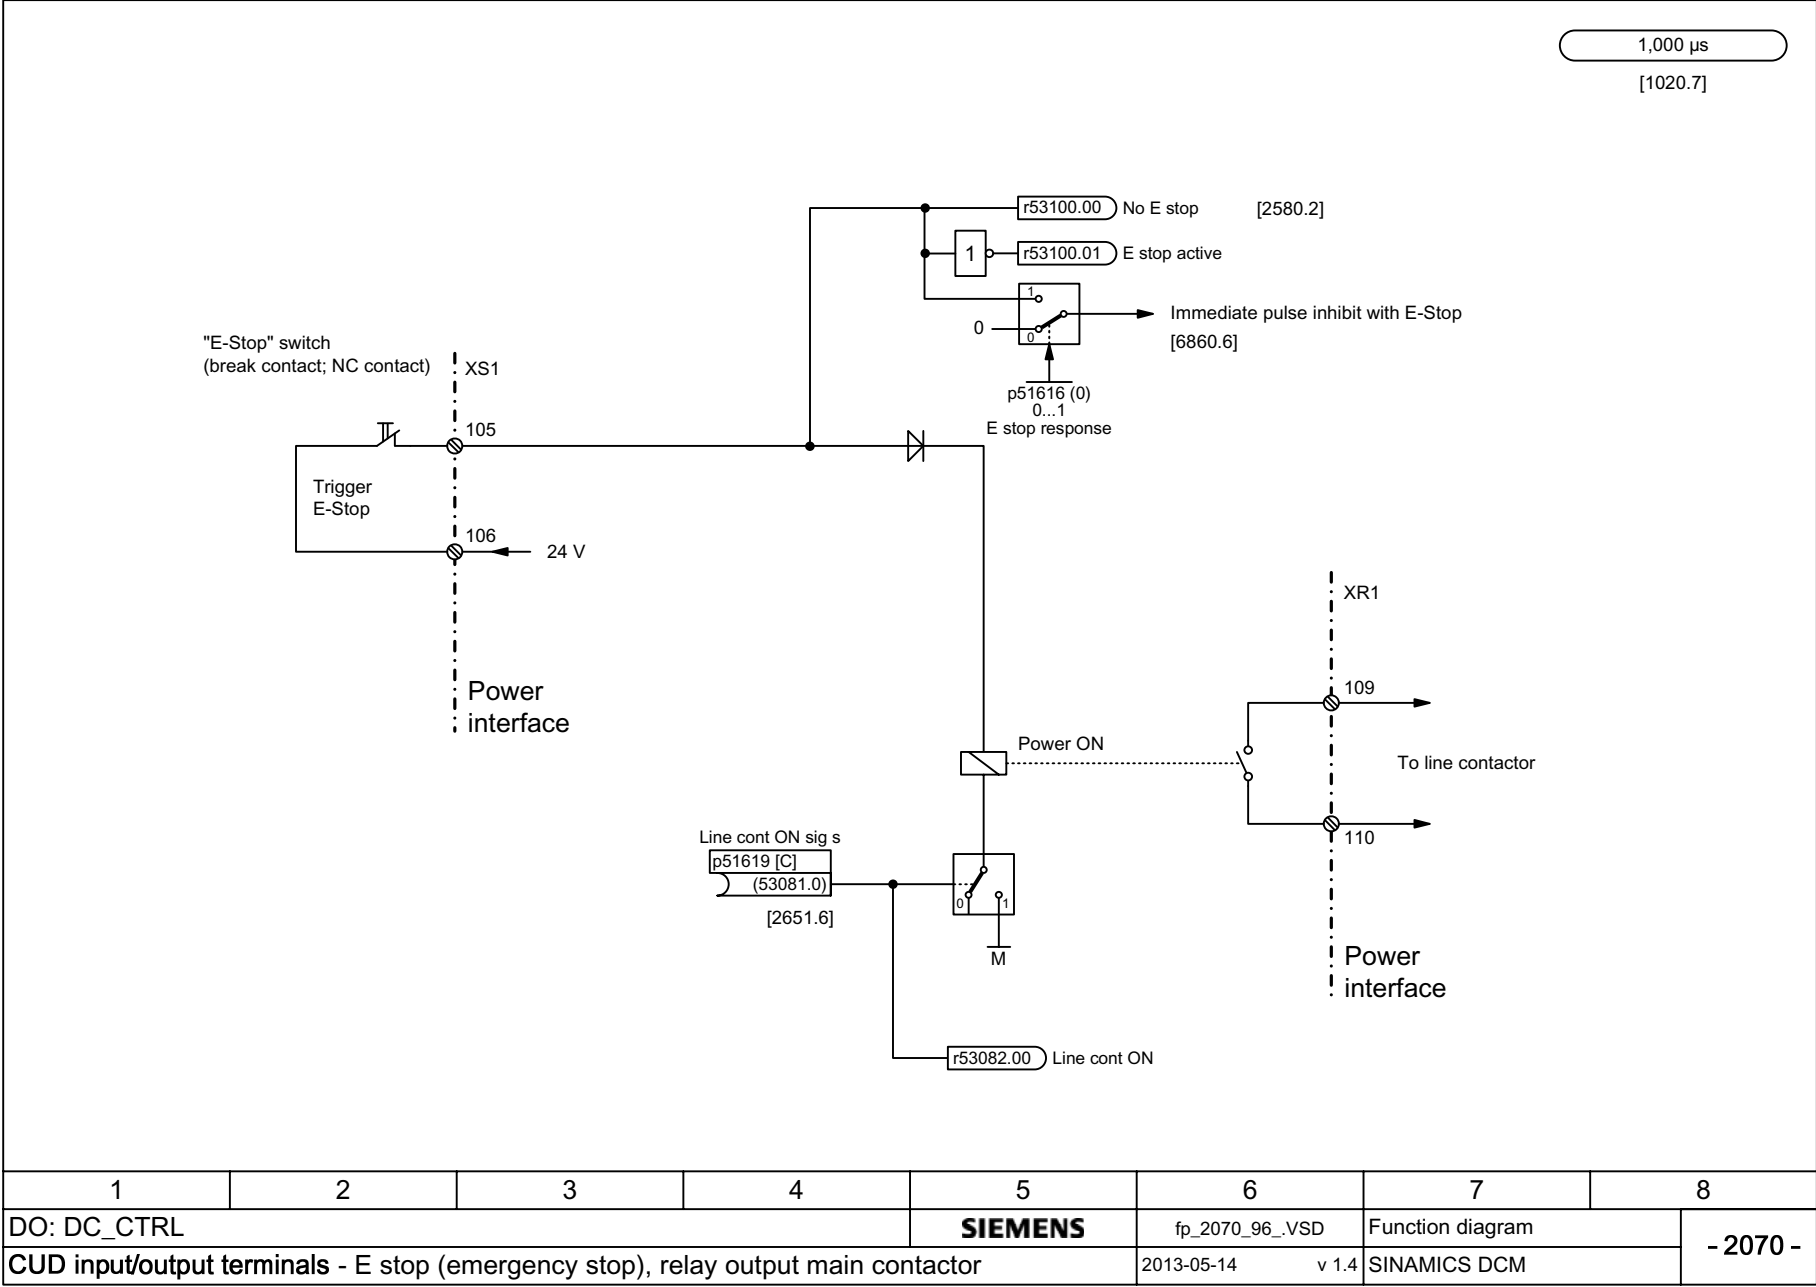


Fig. 2-16 2070 – E stop (emergency stop), relay output main contactor

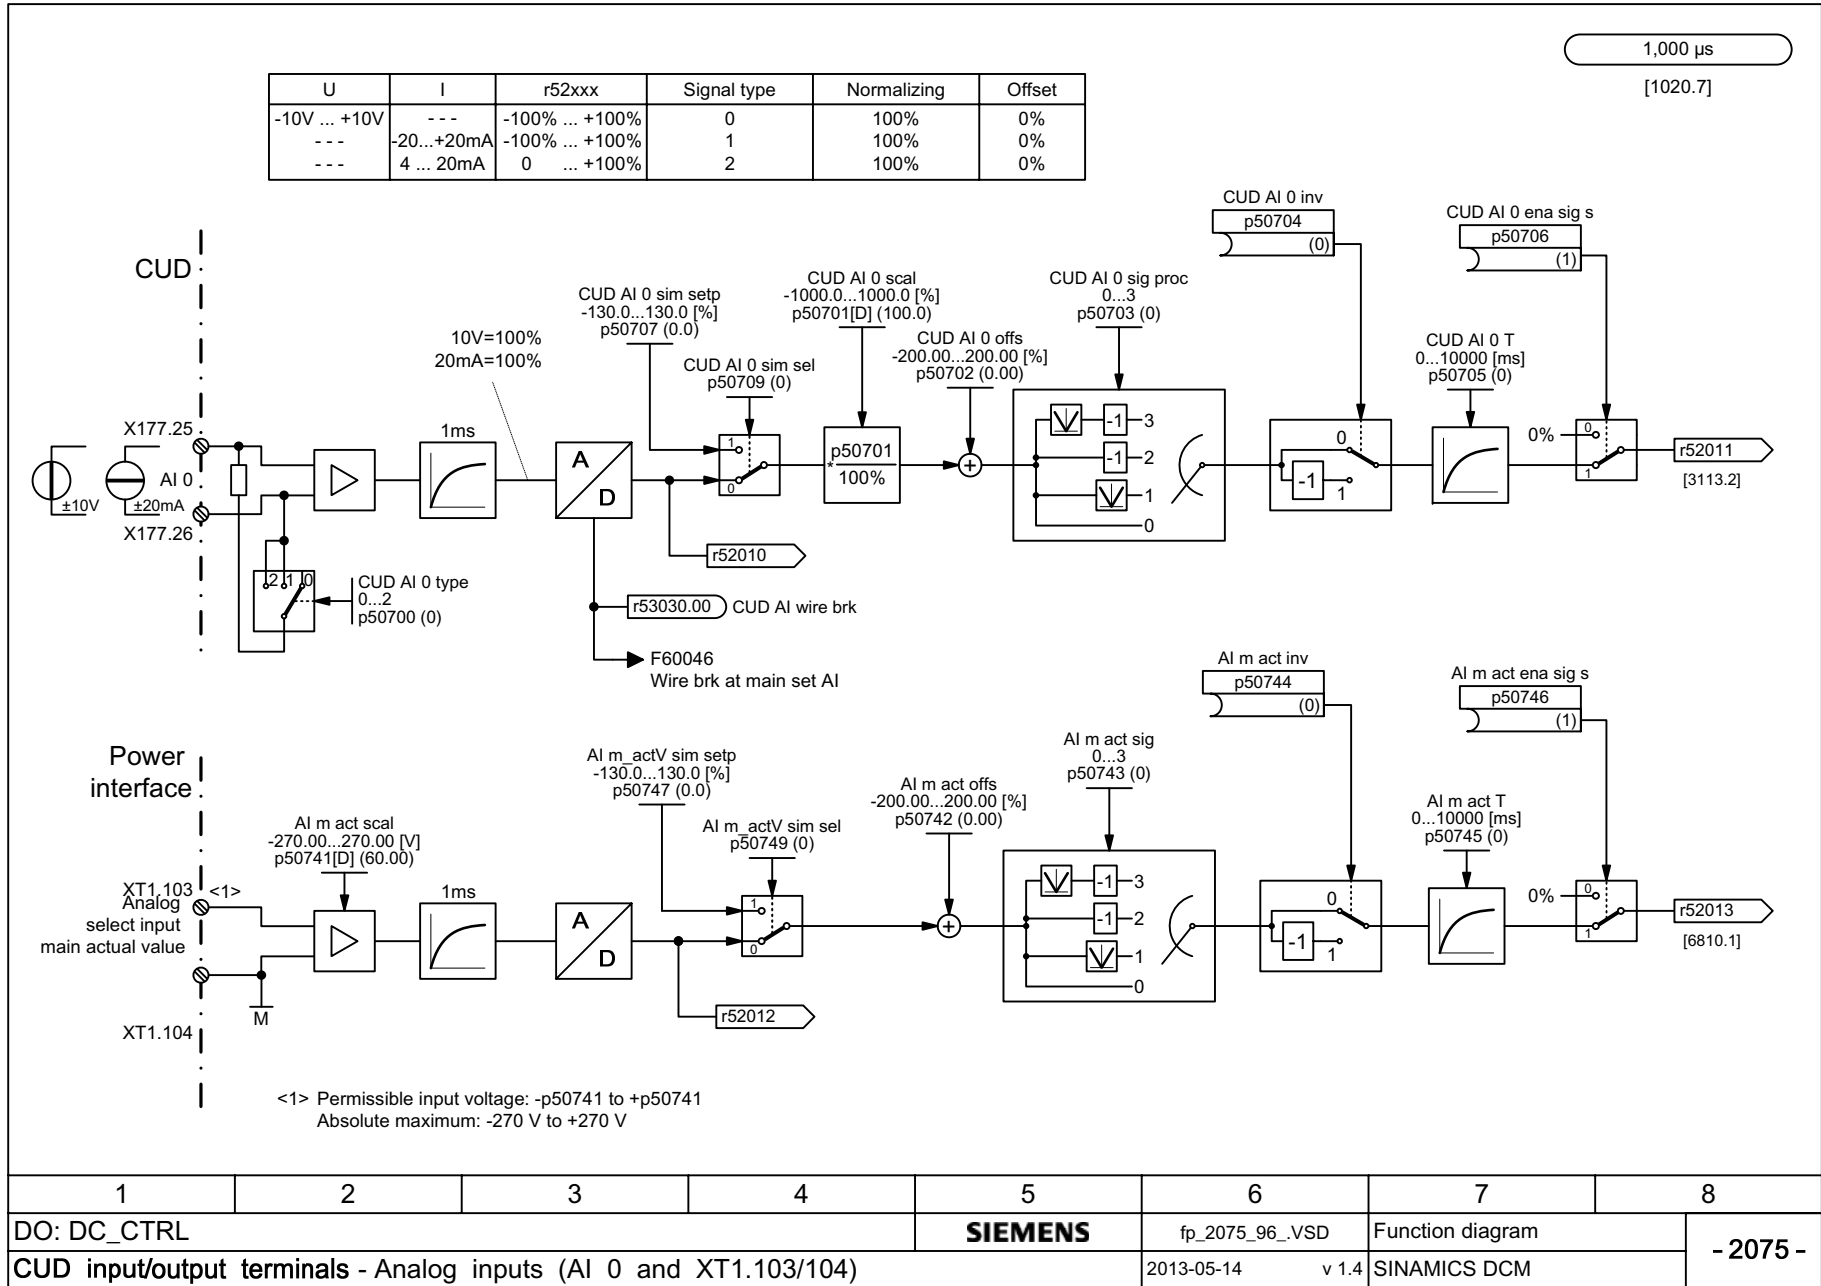


Fig. 2-17 2075 – Analog inputs (AI 0 and XT1.103/104)

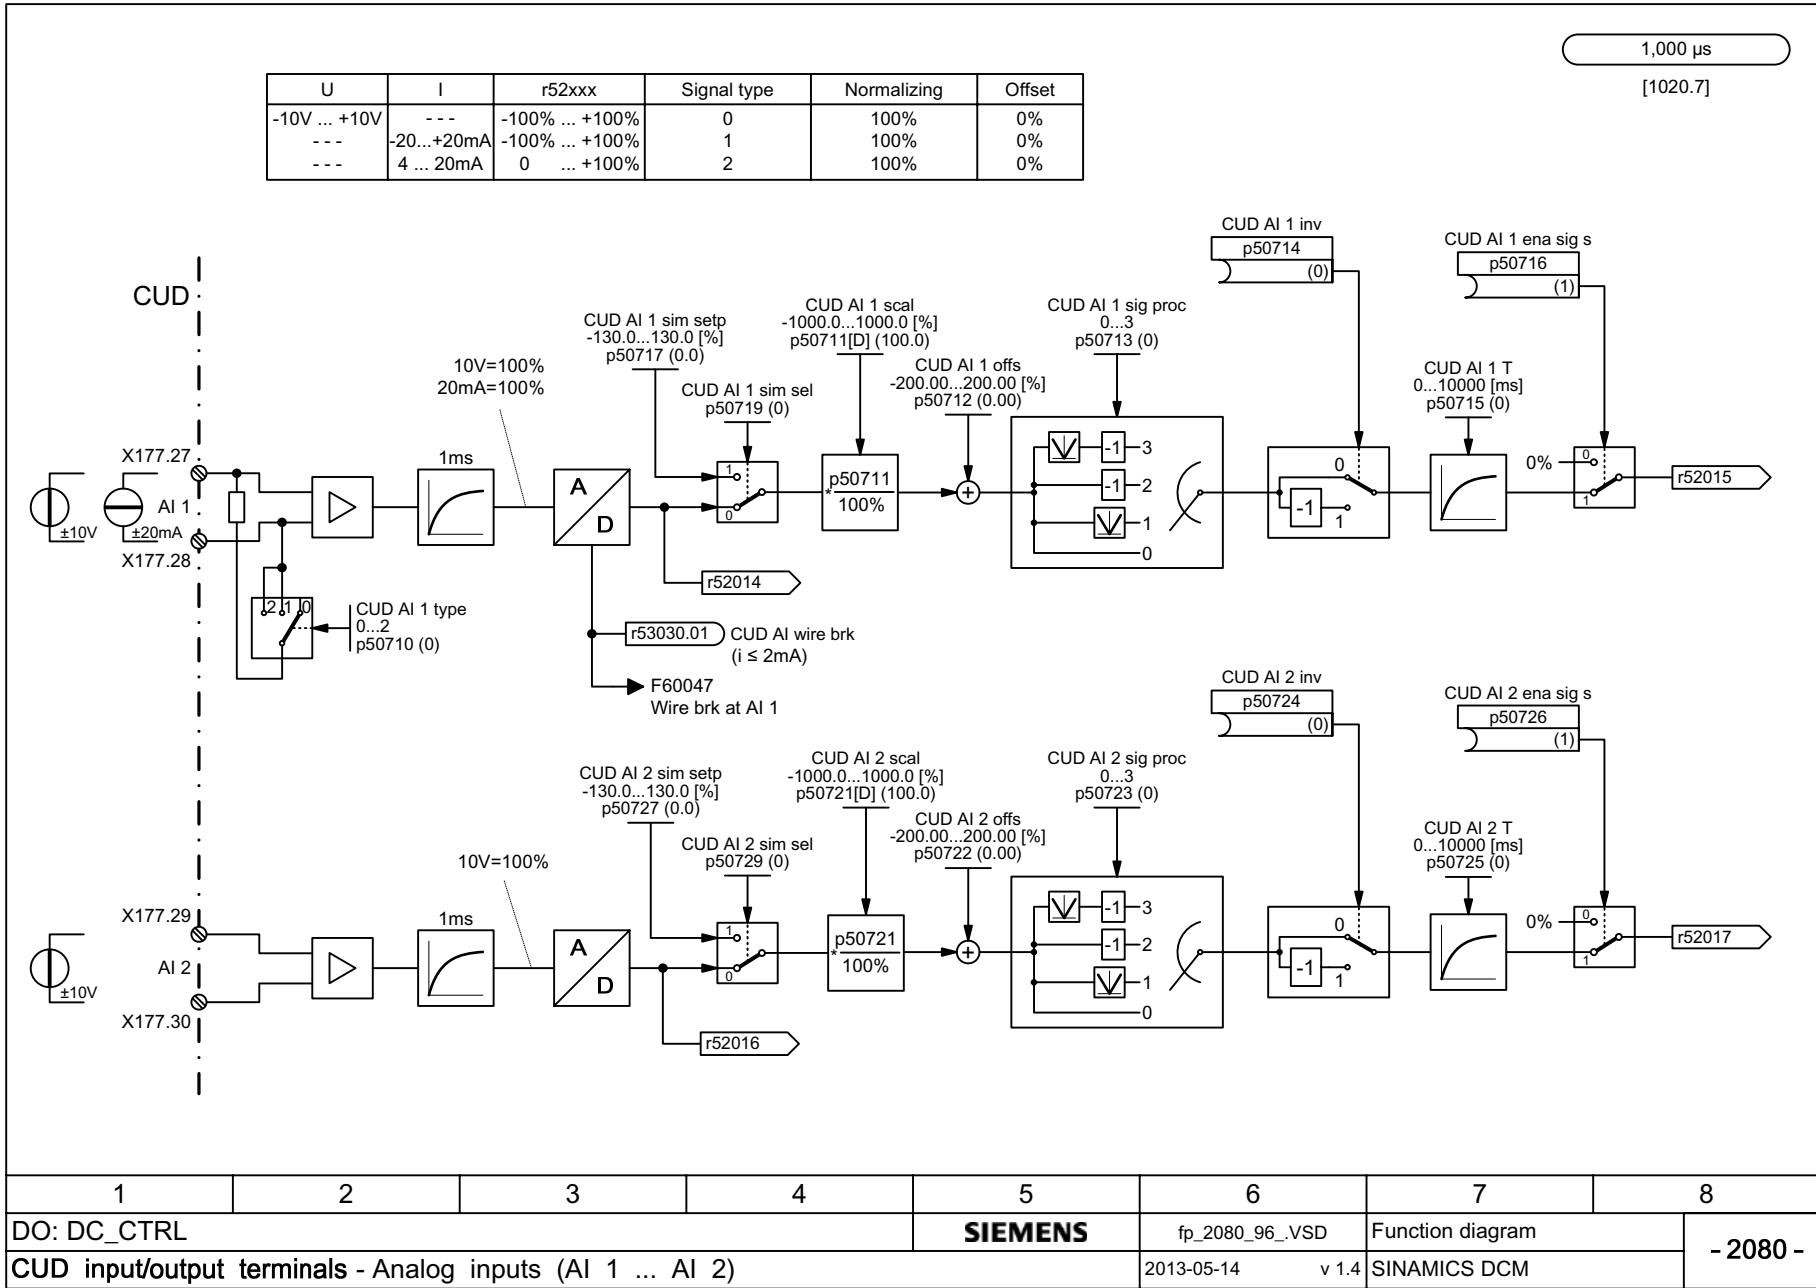


Fig. 2-18 2080 – Analog inputs (AI 1 ... AI 2)

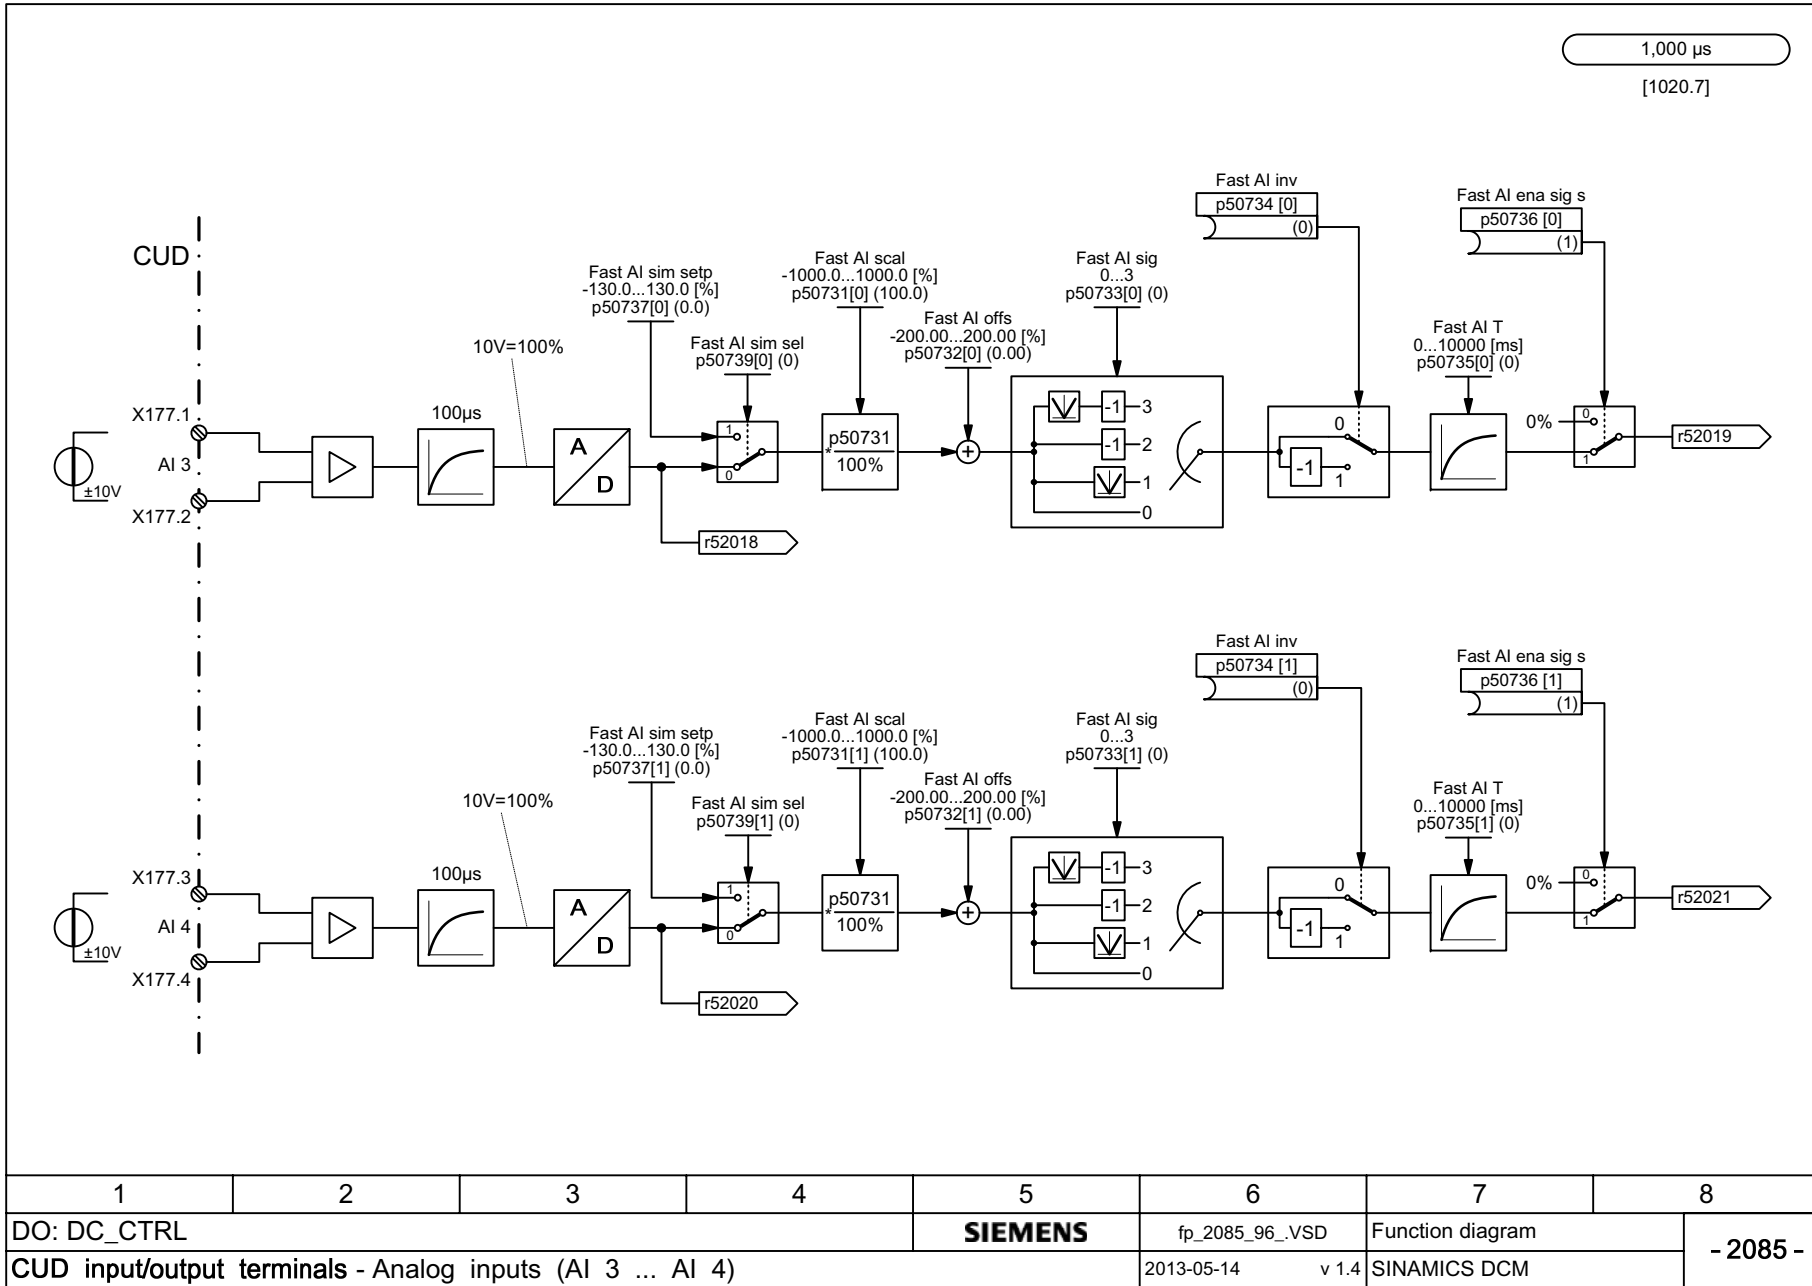


Fig. 2-19 2085 – Analog inputs (AI 3 ... AI 4)

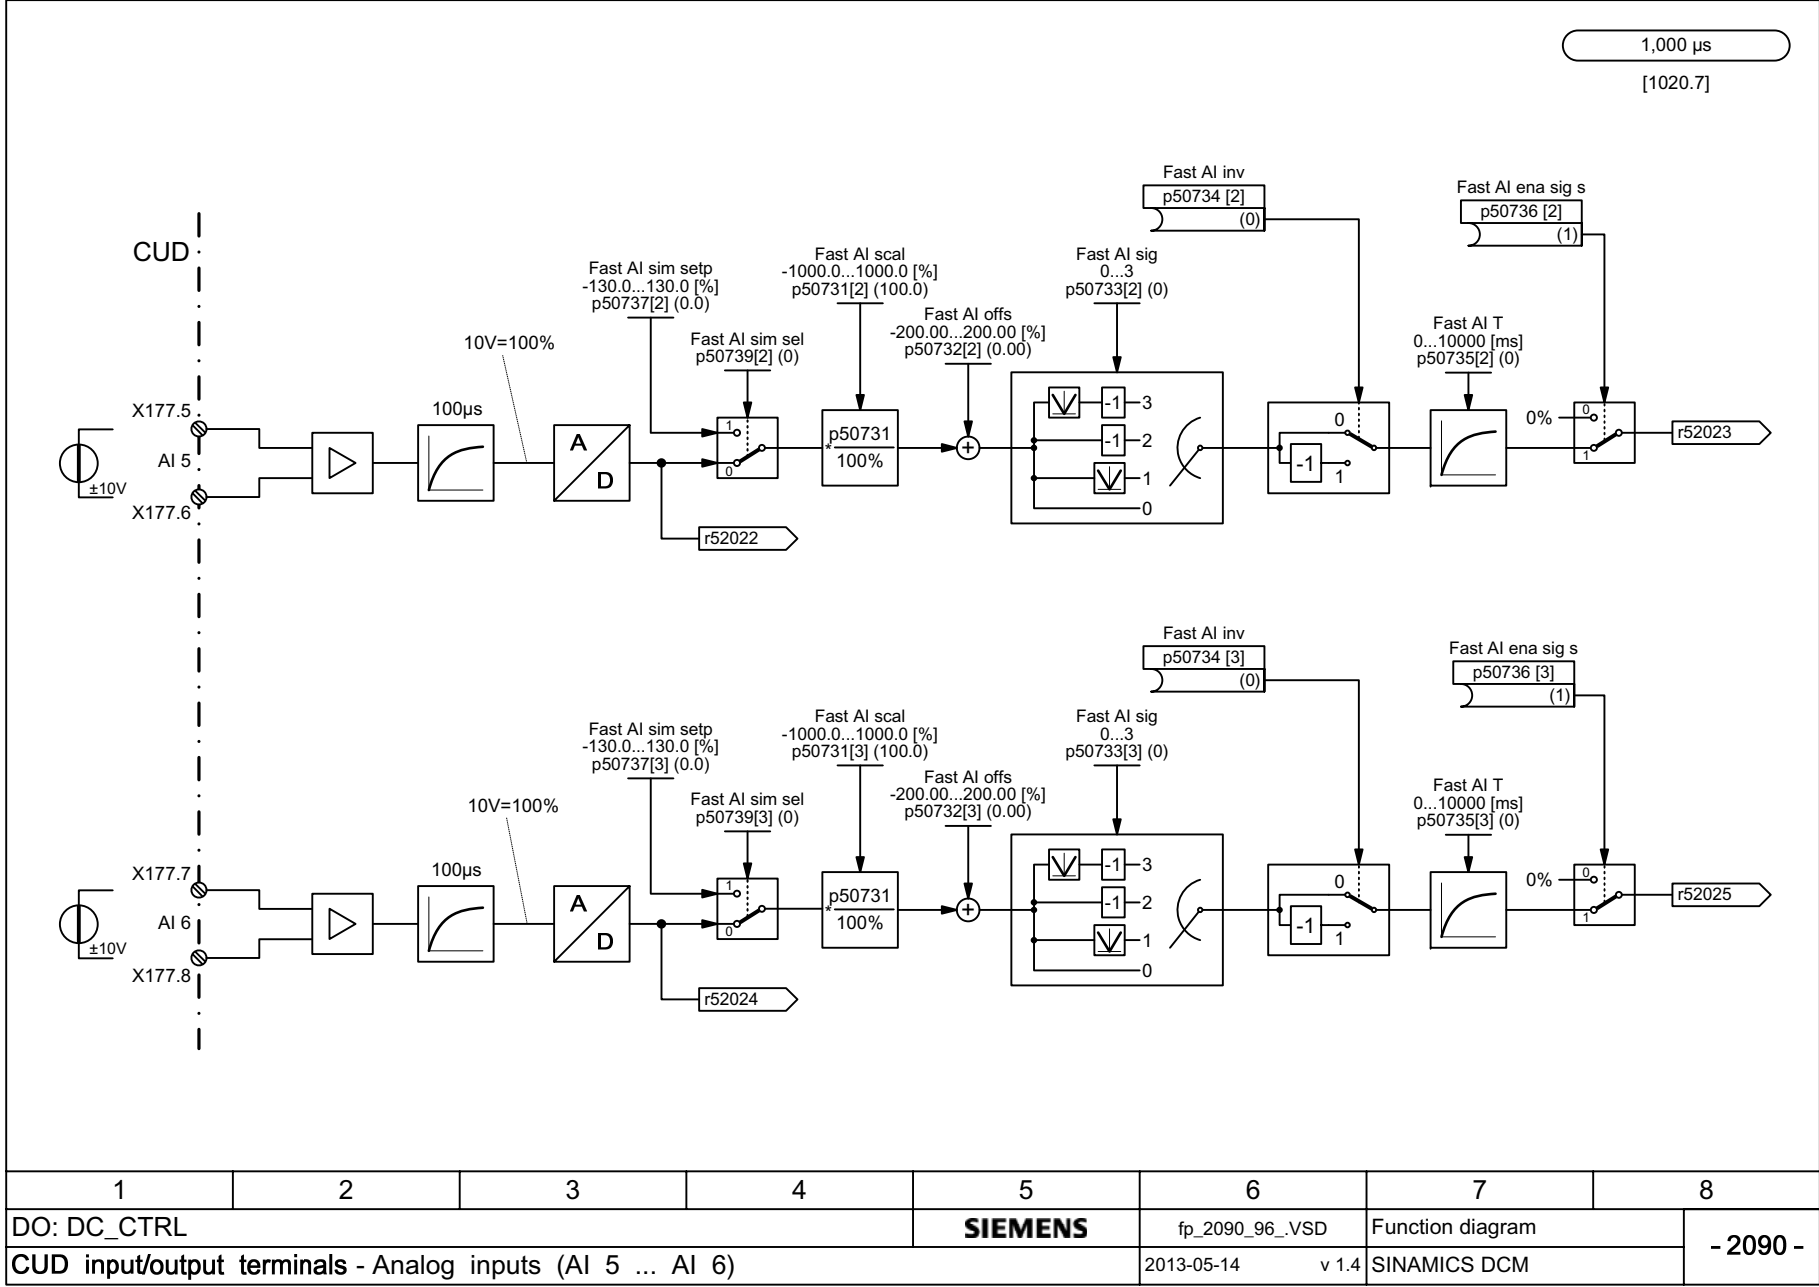


Fig. 2-20 2090 – Analog inputs (AI 5 ... AI 6)



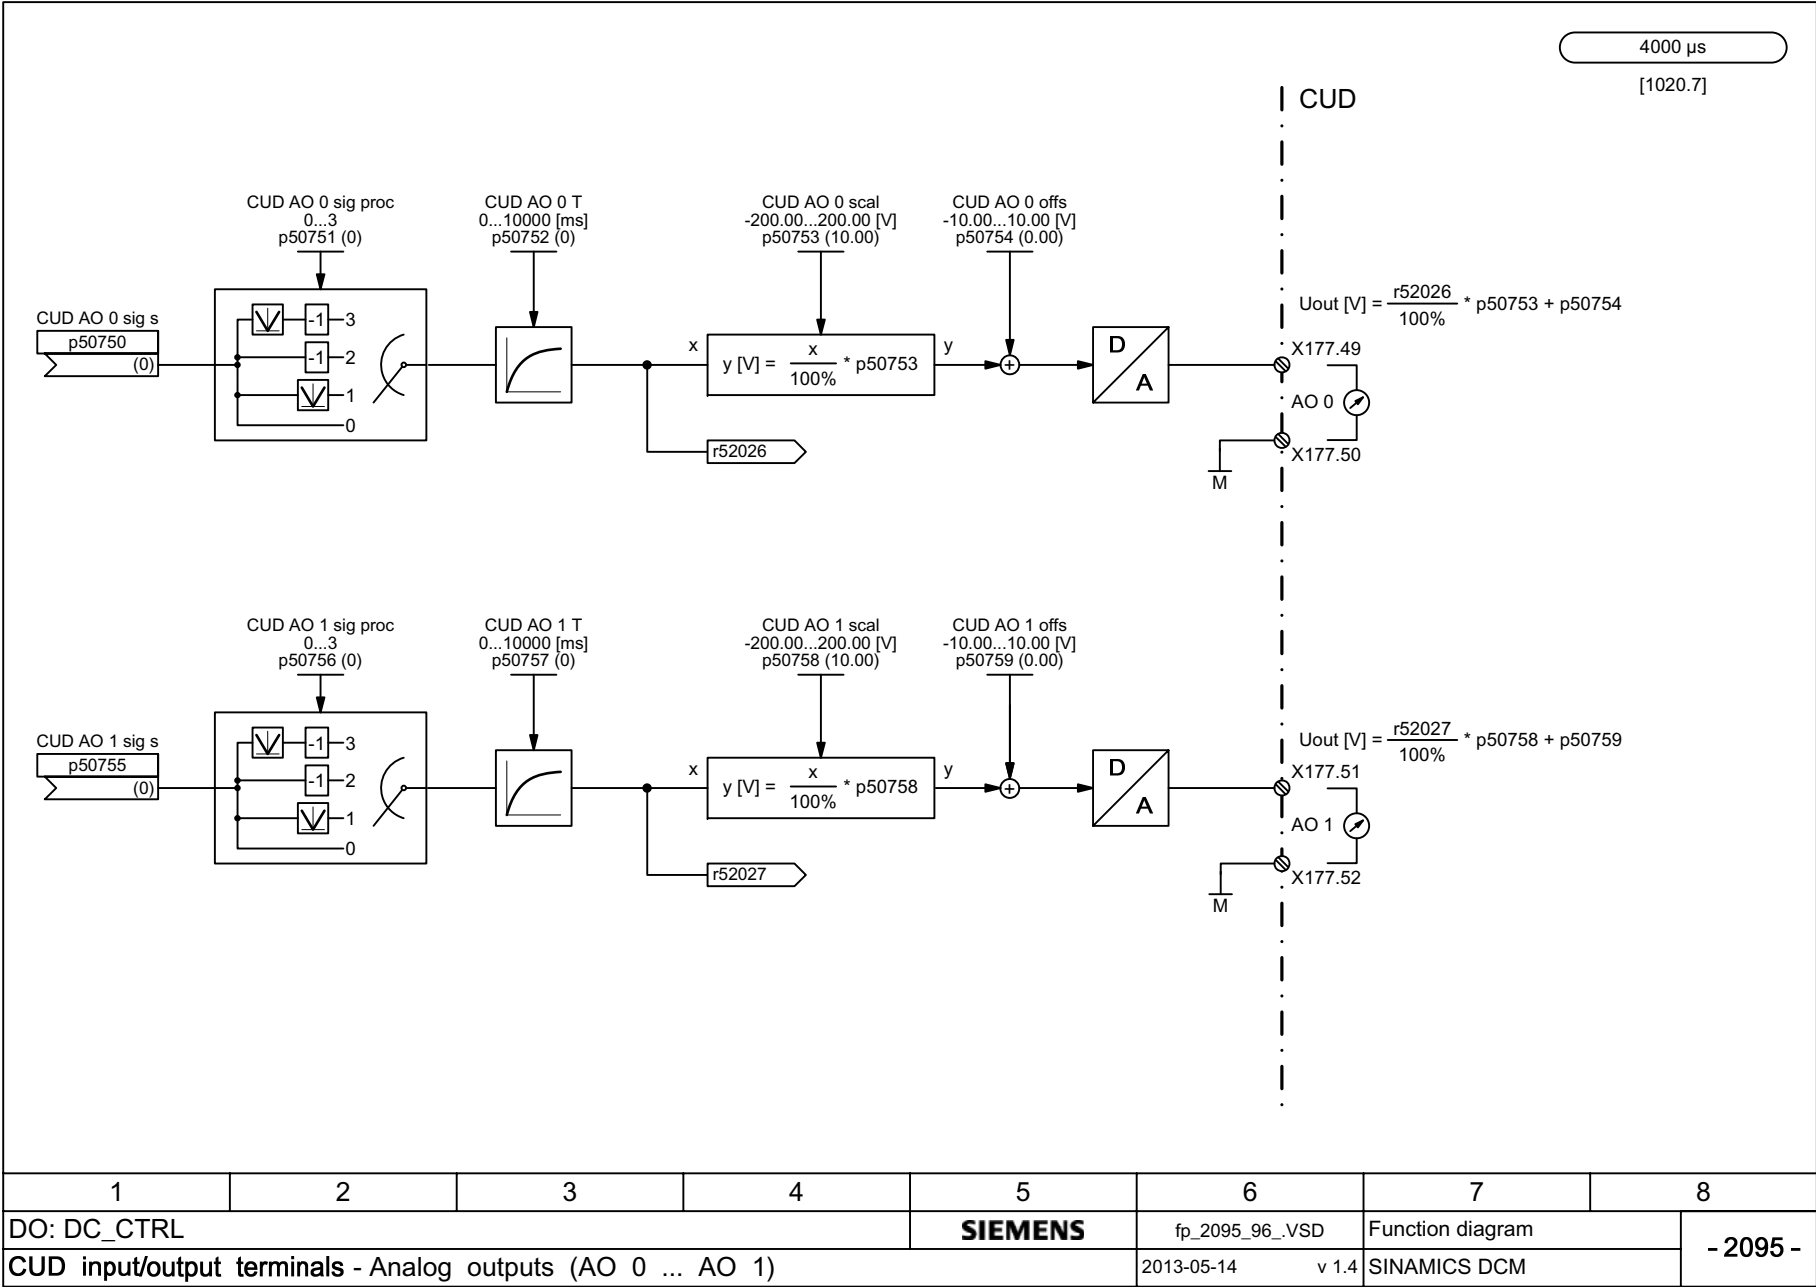



Fig. 2-21 2095 – Analog outputs (AO 0 ... AO 1)

## 2.5 PROFIdrive

### Function diagrams

2410 – PROFIBUS (PB) / PROFINET (PN) / USS, addresses and diagnostics	2-691
2420 – Telegrams and process data (PZD)	2-692
2425 – STW1_BM control word metal industry interconnection	2-693
2426 – STW2_BM control word metal industry interconnection	2-694
2428 – ZSW1_BM status word metal industry interconnection	2-695
2429 – ZSW2_BM status word metal industry interconnection	2-696
2440 – PZD receive signals interconnection	2-697
2442 – STW1 control word interconnection	2-698
2444 – STW2 control word interconnection	2-699
2450 – PZD send signals interconnection	2-700
2452 – ZSW1 status word interconnection	2-701
2454 – ZSW2 status word interconnection	2-702
2460 – IF1 receive telegram, free interconnection via BICO (p0922 = 999)	2-703
2470 – IF1 send telegram, free interconnection via BICO (p0922 = 999)	2-704
2472 – IF1 status words, free interconnection	2-705
2481 – IF1 receive telegram, free interconnection via BICO (p0922 = 999)	2-706
2483 – IF1 send telegram, free interconnection via BICO (p0922 = 999)	2-707
2485 – IF2 receive telegram, free interconnection via BICO (p0922 = 999)	2-708
2487 – IF2 send telegram, free interconnection via BICO (p0922 = 999)	2-709
2489 – IF2 status words, free interconnection	2-710
2495 – CU_STW1 control word 1, Control Unit interconnection	2-711
2496 – CU_ZSW1 status word 1, Control Unit interconnection	2-712
2497 – A_DIGITAL interconnection	2-713
2498 – E_DIGITAL interconnection	2-714

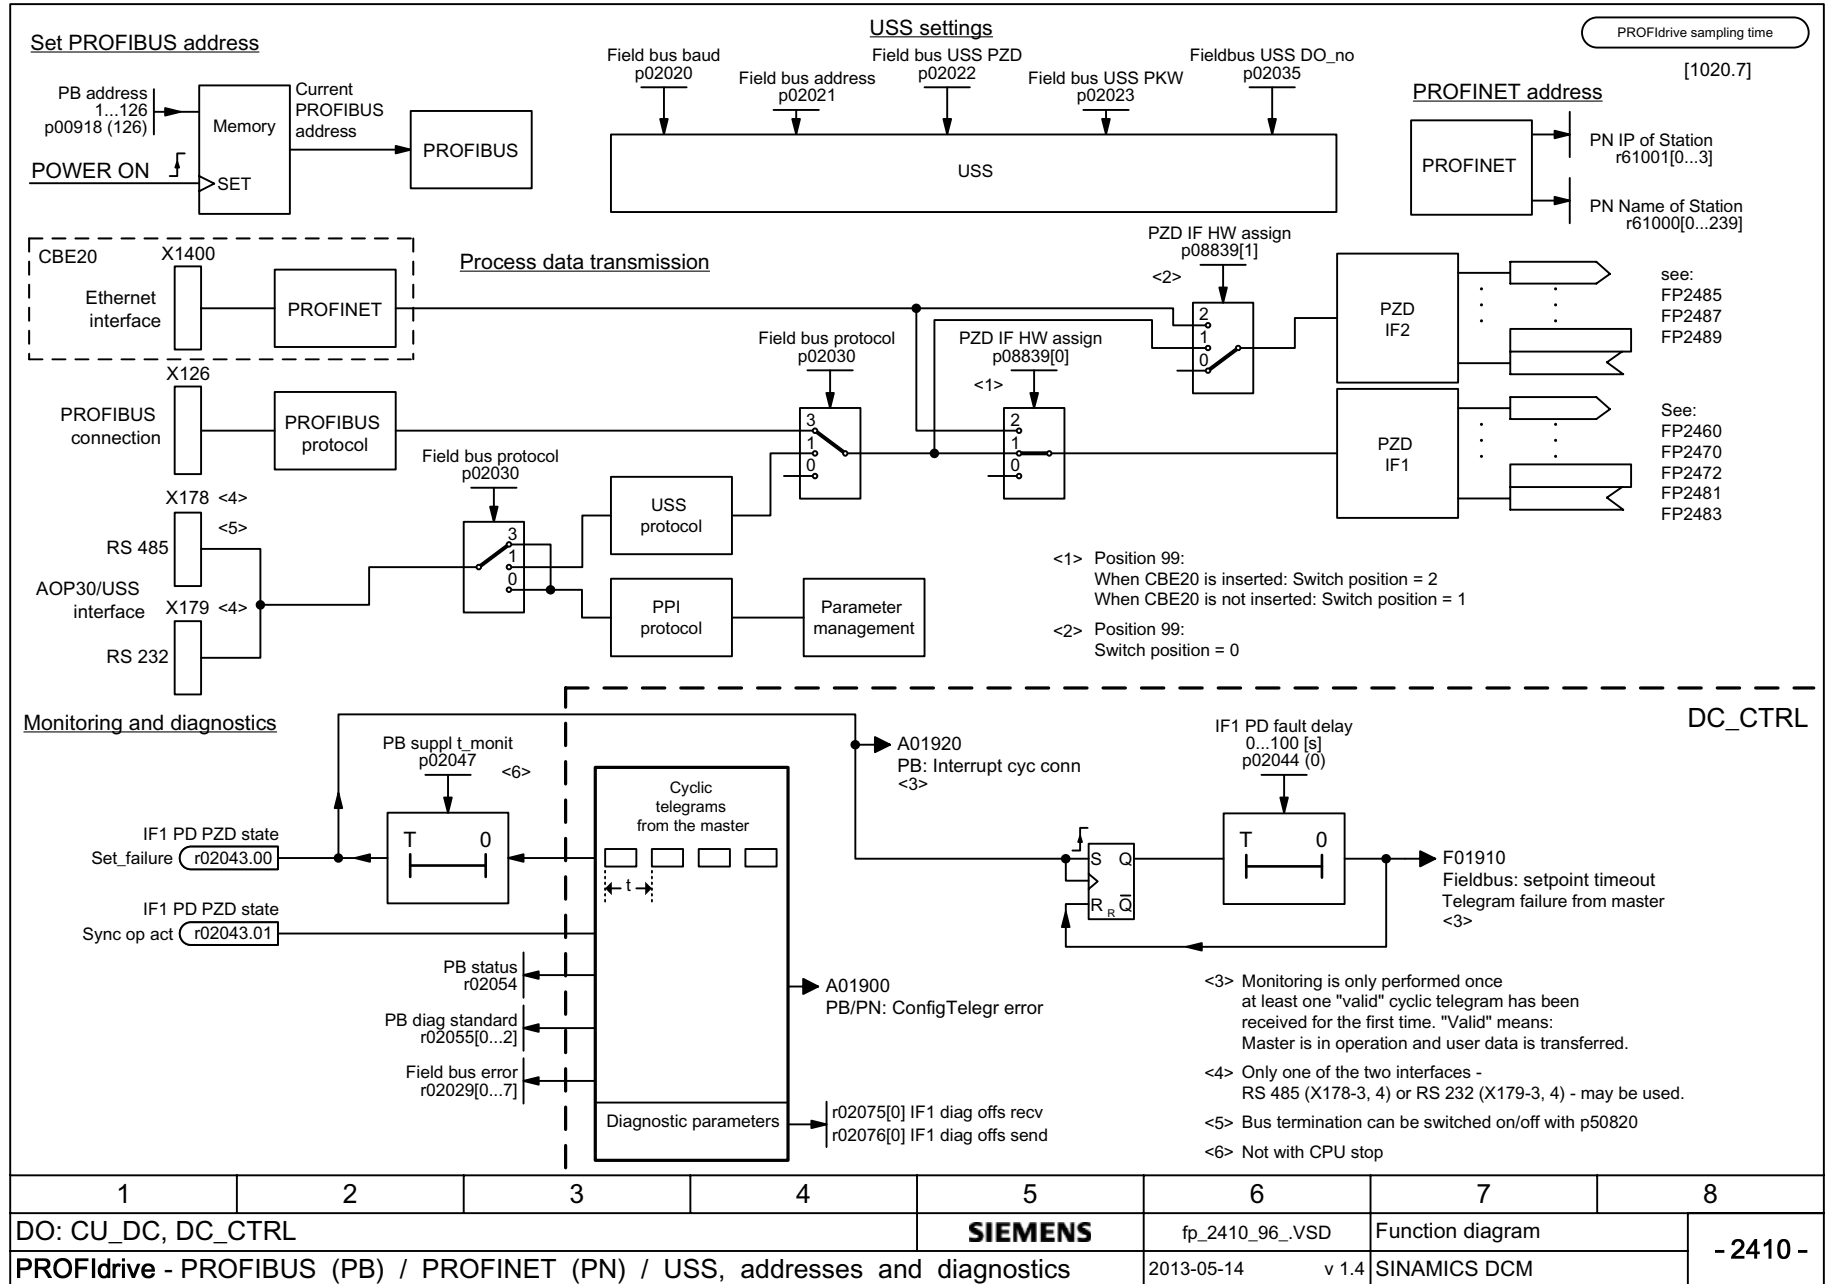Fig. 2-22 2410 – PROFIBUS (PB) / PROFINET (PN) / USS, addresses and diagnostics



PROFdrive sampling time																[1020.7]	
<1> <4> IF1 PZD telegr p00922 (999)																	
Interconnection made in acc. with																	
[2440][2450] Automatic <2>																	
[2460] [2470] [2481] [2483]																	
Telegram																	
1																	
Appl. class																	
1																	
1																	
3																	
4																	
20																	
220																	
352																	
390 <8>																	
999																	
-																	
-																	
STW1 <3> ZSW1 <3>																	
NSOLL_A NSOLL_B																	
ZSW1 NIST_A NIST_B																	
NSOLL_B NIST_B																	
IAIST_GLATT																	
NSOLL_B <6> IAIST_GLATT																	
NSOLL_A NIST_A_GLATT																	
IAIST_GLATT <3> IAIST_GLATT																	
STW2 MIST_GLATT																	
STW2_BM MIST_GLATT <3> MIST_GLATT																	
G1_STW G1_ZSW																	
G1_STW G1_ZSW																	
PIST_GLATT M_ADD <6> WARN_CODE <3> WARN_CODE																	
G2_STW user <7> M_LIM <6> FAULT_CODE <3> FAULT_CODE																	
user <5> ZSW2_BM																	
user <5> r52162																	
user <5> user <5>																	
user <5> user <5>																	
G2_ZSW																	
G2_XIST1																	
G2_XIST2																	
Receive telegram from PROFIBUS/PROFINET																	
Send telegram to PROFIBUS/PROFINET																	
Receive telegram length freely selectable via central PROFdrive configuration in master																	
Send telegram length freely selectable via central PROFdrive configuration in master																	
...																	
...																	
...																	
PZD 62																	
PZD 63																	
PZD 64																	
<1> When changing p0922 = 999 to a different value, the telegram assignment is made automatically in accordance with [2420]. When changing p0922 not = 999 to p0922 = 999, the "old" telegram assignment as per [2420] remains unchanged.																	
<2> Only telegrams 390 and 999 are supported on DO CU_DC.																	
<3> To comply with the PROFdrive profile, PZD1 must be used as control word 1 (STW1) or status word 1 (ZSW1). If STW1 according to the PROFdrive profile is not transferred with PZD1, p2037 = 2 must be set.																	
<4> The maximum PZD number depends on the drive object type.																	
<5> Can be freely interconnected (default: 0).																	
<6> Default not inhibited																	
<7> Can be freely interconnected (default: MESS_NAMUR)																	
<8> Telegram 390 is only supported on DO CU_DC.																	
= Position encoder signal																	
1																	
2																	
3																	
4																	
5																	
6																	
7																	
8																	
DO: DC_CTRL, CU_DC																	
SIEMENS																	
fp_2420_96_VSD																	
Function diagram																	
PROFdrive - Telegrams and process data (PZD)																	
2013-05-14 v 1.4 SINAMICS DCM																	
- 2420 -																	

PROFdrive sampling time

[1020.7]

## Signal destinations for STW1\_BM for telegram 220

Signal	Meaning	Interconnection parameter	Function diagram	Inverted
STW1.0	0 = OFF (OFF1) 1 = ON	p0840[0] = r2090.0	[2580.1]	-
STW1.1	0 = OFF2 (immediate pulse suppression and switching on inhibited) 1 = No OFF2 (enable possible)	p0844[0] = r2090.1	[2580.1]	-
STW1.2	0 = OFF3 (braking along the OFF3 ramp, then pulse suppression and switching on inhibited) 1 = No OFF3 (enable possible)	p0848[0] = r2090.2	[2580.1]	-
STW1.3	0 = Inhibit operation 1 = Enable operation	p2816[0] = r2090.3	[2655.6]	-
STW1.4	0 = Set ramp-function generator zero 1 = Enable ramp-function generator	p1140[0] = r2090.4	[2580.3]	-
STW1.5	0 = Freeze ramp-function generator 1 = Continue ramp-function generator	p1141[0] = r2090.5	[2580.3]	-
STW1.6	0 = Speed setpoint = 0 1 = Speed setpoint enable	p1142[0] = r2090.6	[2580.3]	-
STW1.7	1 = Acknowledge fault	p2103[0] = r2090.7	[2546.1]	-
STW1.8	Reserved	-	-	-
STW1.9	Reserved	-	-	-
STW1.10	1 = Control via PLC	p0854[0] = r2090.10	[2580.3]	-
STW1.11	Reserved	-	-	-
STW1.12	Reserved	-	-	-
STW1.13	Reserved	-	-	-
STW1.14	Reserved	-	-	-
STW1.15	Reserved	-	-	-

&lt;1&gt; STW1.10 must be set in order for the drive object to accept the process data (PZD).

&lt;2&gt; Interconnection is not inhibited.

1	2	3	4	5	6	7	8
DO: DC_CTRL				<b>SIEMENS</b>	fp_2425_96_VSD	Function diagram	<b>- 2425 -</b>
PROFdrive - STW1_BM control word sector metal interconnection					2013-05-14 v 1.4	SINAMICS DCM	

Fig. 2-24 2425 – STW1\_BM control word metal industry interconnection

PROFdrive sampling time

[1020.7]

## Signal destinations for STW2\_BM for telegram 220

Signal	Meaning	Interconnection parameter	Function diagram	Inverted
STW2.0	Command data set selection CDS bit 0	p0810 = r2093.0	[8560.3]	-
STW2.1	Reserved; bit must always be set to 0.	-	-	-
STW2.2	Command data set selection DDS bit 0 <1>	p0820[0] = r2093.2	[8565.3]	-
STW2.3	Command data set selection DDS bit 1 <1>	p0821[0] = r2093.3	[8565.3]	-
STW2.4	Reserved; bit must always be set to 0.	-	-	-
STW2.5	1 = Bridge ramp-function generator	p50641[0] = r2093.5	[3152.2]	-
STW2.6	Reserved	-	-	-
STW2.7	1 = Speed controller integration value set	p50695[0] = r2093.7	[6815.1]	-
STW2.8	1 = Enable droop	p50684[0] = r2093.8	[6805.3]	-
STW2.9	1 = Enable speed controller <1>	p0856[0] = r2093.9	[2580.3]	-
STW2.10	Reserved <1>	-	-	-
STW2.11	0 = Speed-controlled operation 1 = Torque-controlled operation	p50687[0] = r2093.11	[6830.2]	-
STW2.12	Reserved <1>	-	-	-
STW2.13	Reserved <1>	-	-	-
STW2.14	Reserved <1>	-	-	-
STW2.15	Controller sign-of-life toggle bit	p2081[15] = r2093.15	[2472.1]	-

&lt;1&gt; Interconnection is not inhibited.

1	2	3	4	5	6	7	8
DO: DC_CTRL				<b>SIEMENS</b>	fp_2426_96_VSD	Function diagram	- 2426 -
PROFdrive - STW2_BM control word sector metal interconnection					2013-05-14 v 1.4	SINAMICS DCM	

Fig. 2-25 2426 – STW2\_BM control word metal industry interconnection

PROFdrive sampling time

[1020.7]

## Signal destinations for ZSW1\_BM for telegram 220

		<1>		
Signal	Meaning	Interconnection parameter	Function diagram	Inverted
ZSW1.0	1 = Ready to switch on	p2080[0] = r0899.0	[2585.7]	-
ZSW1.1	1 = Ready	p2080[1] = r0899.1	[2585.7]	-
ZSW1.2	1 = Operation enabled	p2080[2] = r2811.0	[2655.8]	-
ZSW1.3	1 = Fault effective	p2080[3] = r2139.3	[2548.7]	-
ZSW1.4	0 = Coasting down active (OFF2)	p2080[4] = r0899.4	[2585.7]	-
ZSW1.5	0 = Quick stop active (OFF3)	p2080[5] = r0899.5	[2585.7]	-
ZSW1.6	1 = Switching on inhibited active	p2080[6] = r0899.6	[2585.7]	-
ZSW1.7	1 = Alarm effective	p2080[7] = r2139.7	[2548.7]	-
ZSW1.8	1 = Speed setpoint - actual value deviation within tolerance	p2080[8] = r2197.7	[2534.6]	-
ZSW1.9	1 = Control requested <2>	p2080[9] = r0899.9	[2585.7]	-
ZSW1.10	1 = n comparison value reached or exceeded	p2080[10] = r2199.1	[2537.6]	-
ZSW1.11	1 = Torque limit not reached	p2080[11] = r1407.7	-	✓
ZSW1.12	1 = Open holding brake	p2080[12] = r0899.12	[2585.7]	-
ZSW1.13	Reserved <3>	-	-	-
ZSW1.14	Reserved <3>	-	-	-
ZSW1.15	Reserved <3>	-	-	-

&lt;1&gt; ZSW1\_BM is formed via binector-connector converter (BI: p2080[0...15], inversion: p2088[0].0...p2088[0].15).

&lt;3&gt; Interconnection is not inhibited.

&lt;2&gt; The drive object is ready for acceptance.

1	2	3	4	5	6	7	8
DO: DC_CTRL				<b>SIEMENS</b>	fp_2428_96_VSD	Function diagram	- 2428 -
PROFdrive - ZSW1_BM status word sector metal interconnection					2013-05-14 v 1.4	SINAMICS DCM	

Fig. 2-26 2428 – ZSW1\_BM status word metal industry interconnection

PROFdrive sampling time

[1020.7]

## Signal destinations for ZSW2\_BM for telegram 220

Signal	Meaning	Interconnection parameter	Function diagram	Inverted
ZSW2.0	Reserved	<1>	-	-
ZSW2.1	Reserved	<1>	-	-
ZSW2.2	Reserved	<1>	-	-
ZSW2.3	Reserved	<1>	-	-
ZSW2.4	Reserved	<1>	-	-
ZSW2.5	1 = Alarm class bit 0	p2081[5] = r2139.11	[2548.7]	-
ZSW2.6	1 = Alarm class bit 0	p2081[6] = r2139.12	[2548.7]	-
ZSW2.7	Reserved	-	-	-
ZSW2.8	Reserved	-	-	-
ZSW2.9	1 = Speed setpoint limited	p2081[9] = r1407.11	-	-
ZSW2.10	1 = Upper torque limit reached	p2081[10] = r1407.8	-	-
ZSW2.11	1 = Lower torque limit reached	p2081[11] = r1407.9	-	-
ZSW2.12	1 = Encoderless operation because of fault	p2081[12] = r1407.13	-	-
ZSW2.13	Reserved	p2081[13] = r53110.1	-	-
ZSW2.14	Reserved	p2081[14] = r53110.0	-	-
ZSW2.15	Controller sign-of-life toggle bit	p2081[15] = r2093.15	[2460.6]	-

&lt;1&gt; Interconnection is not inhibited.

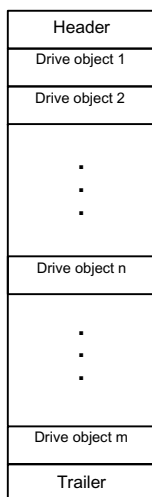
1	2	3	4	5	6	7	8
DO: DC_CTRL				<b>SIEMENS</b>	fp_2429_96_.VSD	Function diagram	- 2429 -
PROFdrive - ZSW2_BM status word sector metal interconnection					2013-05-14 v 1.4	SINAMICS DCM	

Fig. 2-27 2429 – ZSW2\_BM status word metal industry interconnection



PROFdrive sampling time

[1020.7]

PROFIBUS  
PROFINET  
USSPROFdrive  
receive telegram[2460], [2481]  
r2090...r2095 Bit  
r2050[0...n] WORD  
r2060[0...30] DWORDTelegram assignment  
acc. to p0922  
[2420]

## Signal sinks for PZD receive signals

Signal	Meaning	PROFdrive signal no.	<2>		<1>	
			Interconnection parameter	Function diagram	Data type	Normalizing
STW1	Control word 1 for telegram 1, 3, 4, 20, 352	1	(bit by bit)	[2442]	U16	-
STW2	Control word 2 for telegram 3, 4	3	(bit by bit)	[2444]	U16	-
NSOLL_A	Speed setpoint A (16-bit)	5	p1070 p50433[0]	- [3113.2]	I16	4000 hex $\hat{=}$ 100%
NSOLL_B	Speed setpoint B (32-bit)	7	p50621	[6812.2]	I32	4000 0000 hex $\hat{=}$ 100%
G1_STW	Encoder 1 control word	9	p0480[0]	[4720.1]	U16	-
G2_STW	Encoder 2 control word	13	p0480[1]	[4720.1]	U16	-
A_DIGITAL	Digital output (16-bit)	22	(bit by bit)	[2497]	U16	-
M_LIM	Torque limit	310	p50605[0] p50500[0]	[6825.2] [6830.1]	U16	-
M_ADD	Additional torque	311	p50619	[6820.4]	U16	-
STW1_BM	Control word 1, variant for BM	322	(bit by bit)	[2425]	U16	-
STW2_BM	Control word 2, variant for BM	324	(bit by bit)	[2426]	U16	-
CU_STW1	Control word 1 for Control Unit	500	(bit by bit)	[2495]	U16	-

&lt;1&gt; Data type in acc. with PROFdrive profile: I16 = Integer16, I32 = Integer32, U16 = Unsigned16, U32 = Unsigned32.

&lt;2&gt; When selecting a standard telegram or a manufacturer-specific telegram (telegram number &lt;&gt; 992) via p0922, these interconnection parameters of command data set CDS0 are set automatically.

1	2	3	4	5	6	7	8
DO: DC_CTRL, CU_DC				<b>SIEMENS</b>	fp_2440_96_VSD	Function diagram	- 2440 -
PROFdrive - PZD receive signals interconnection					2013-05-14 v 1.4	SINAMICS DCM	

Fig. 2-28 2440 – PZD receive signals interconnection

PROdrive sampling time

[1020.7]

## Signal destinations for STW1 for telegrams 1, 3, 4, 20, 352

Signal	Meaning	Interconnection parameter	[Function diagram] Internal control word	Inverted
STW1.0	$\int$ = ON (pulses can be enabled) 0 = OFF1 (braking with ramp-function generator, then pulse suppression and ready to switch on)	p0840[0] = r2090.0	[2580.1]	-
STW1.1	1 = OC (enable possible) <4> 0 = OFF2 (immediate pulse suppression and switching on inhibited)	p0844[0] = r2090.1	[2580.1]	-
STW1.2	1 = OC (enable possible) <4> 0 = OFF3 (braking along the OFF3 ramp, then pulse suppression and switching on inhibited)	p0848[0] = r2090.2	[2580.1]	-
STW1.3	1 = Enable operation (pulses can be enabled) 0 = Inhibit operation (suppress pulses)	p0852[0] = r2090.3	[2580.1]	-
STW1.4	1 = Enable ramp-function generator 0 = Inhibit ramp-function generator (set ramp-function generator output to zero)	p1140[0] = r2090.4	[2580.3]	-
STW1.5	1 = Start ramp-function generator 0 = Stop ramp-function generator (freeze ramp-function generator output)	p1141[0] = r2090.5	[2580.3]	-
STW1.6	1 = Enable speed setpoint 0 = Inhibit speed setpoint (set ramp-function generator input to zero)	p1142[0] = r2090.6	[2580.3]	-
STW1.7	$\int$ = Acknowledge fault	p2103[0] = r2090.7	[2546.1]	-
STW1.8	Reserved	-	-	-
STW1.9	Reserved	-	-	-
STW1.10	1 = Control via PLC <2>	p0854[0] = r2090.10	[2580.3]	-
STW1.11	1 = setpoint inversion	p1113[0] = r2090.11	[3113.6]	-
STW1.12	Reserved	-	-	-
STW1.13	1 = Motorized potentiometer, higher <3>	p1035[0] = r2090.13	[3110.1]	-
STW1.14	1 = Motorized potentiometer, lower <3>	p1036[0] = r2090.14	[3110.1]	-
STW1.15	1 = Command data set selection CDS bit 0 <1> <5>	p0810[0] = 2090.15	[8560.3]	-

&lt;1&gt; Only for telegram 20

&lt;2&gt; STW1.10 must be set in order for the drive object to accept the process data (PZD).

&lt;3&gt; Only for telegram 1, 3, 4 and 352

&lt;4&gt; OC = Operating condition

&lt;5&gt; Interconnection is not inhibited.

1	2	3	4	5	6	7	8
DO: DC_CTRL				<b>SIEMENS</b>	fp_2442_96_VSD	Function diagram	<b>- 2442 -</b>
PROdrive - STW1 control word interconnection					2013-05-14 v 1.4	SINAMICS DCM	

Fig. 2-29

2442 – STW1 control word interconnection

PROFdrive sampling time

[1020.7]

## Signal destinations for STW2 for telegrams 3, 4

Signal	Meaning	Interconnection parameter	Function diagram	Inverted
STW2.0	Drive data set selection DDS bit 0	p0820[0] = r2093.0	[8565.3]	-
STW2.1	Drive data set selection DDS bit 1	p0821[0] = r2093.1	[8565.3]	-
STW2.2	Reserved	-	-	-
STW2.3	Reserved	-	-	-
STW2.4	Reserved	-	-	-
STW2.5	Reserved	-	-	-
STW2.6	Reserved	-	-	-
STW2.7	Reserved	-	-	-
STW2.8	Reserved	-	-	-
STW2.9	Reserved	-	-	-
STW2.10	Reserved	-	-	-
STW2.11	Reserved	-	-	-
STW2.12	Master sign-of-life bit 0	p2045 = r2050[3]	-	-
STW2.13	Master sign-of-life bit 1			
STW2.14	Master sign-of-life bit 2			
STW2.15	Master sign-of-life bit 3			

1	2	3	4	5	6	7	8
DO: DC_CTRL				<b>SIEMENS</b>	fp_2444_96_VSD	Function diagram	- 2444 -
PROFdrive - STW2 control word interconnection					2013-05-14 v 1.4	SINAMICS DCM	

Fig. 2-30 2444 – STW2 control word interconnection


Fig. 2-31 2450 – PZD send signals interconnection

Signal sources for PZD send signals						
Signal	Description	PROFdrive signal no.	<2> Interconnection parameter	<1> Function diagram	Data type	Normalizing
ZSW1	Status word 1	2	r2089[0]	[2452]	U16	-
ZSW2	Status word 2	4	r2089[1]	[2454]	U16	-
NIST_A	Actual speed value A (16-bit)	6	r0063[0]	[6810.4]	I16	4000 hex $\hat{=}$ 100% = p2000
G1_ZSW	Encoder 1 status word	10	r0481[0]	[4730.5]	U16	-
G1_XIST1	Encoder 1 actual position value 1	11	r0482[0]	[4704.8]	U32	-
G1_XIST2	Encoder 1 actual position value 2	12	r0483[0]	[4704.8]	U32	-
G2_ZSW	Encoder 2 status word	14	r0481[1]	[4730.5]	U16	-
G2_XIST1	Encoder 2 actual position value 1	15	r0482[1]	[4704.8]	U32	-
G2_XIST2	Encoder 2 actual position value 2	16	r0483[1]	[4704.8]	U32	-
E_DIGITAL	Digital input (16-bit)	21	r2089[2]	[2498]	U16	-
IAIST_GLATT	Absolute actual current value smoothed	51	r0027	[6851.6]	I16	4000 hex $\hat{=}$ 100% = p2002
MIST_GLATT	Actual torque value smoothed	<3> 53	r0080	[6851.7]	I16	4000 hex $\hat{=}$ 100% = p2003
PIST_GLATT	Active power smoothed	<4> 54	r0032	-	I16	4000 hex $\hat{=}$ 100% = r2004
NIST_A_GLATT	Actual speed value smoothed	57	r0063[1]	[6810.5]	I16	4000 hex $\hat{=}$ 100% = p2000
MELD_NAMUR	VIK-NAMUR message bit bar	58	r3113	-	U16	-
FAULT_CODE	Fault code	301	r2131	[8060.3]	U16	-
WARN_CODE	Alarm code	303	r2132	[8065.3]	U16	-
ZSW1_BM	Status word 1, variant for BM	323	r2089[0]	[2428]	U16	-
ZSW2_BM	Status word 2, variant for BM	325	r2089[1]	[2429]	U16	-
CU_ZSW1	Status word 1 for Control Unit	501	r2089[1]	[2496]	U16	-

<1> "Data type according to PROFdrive profile: I16 = Integer16, I32 = Integer32, U16 = Unsigned16, U32 = Unsigned32"

<2> When selecting a standard telegram or a manufacturer-specific telegram (telegram number <> 999) via p0922, these interconnection parameters of command data set CDS0 are set automatically.
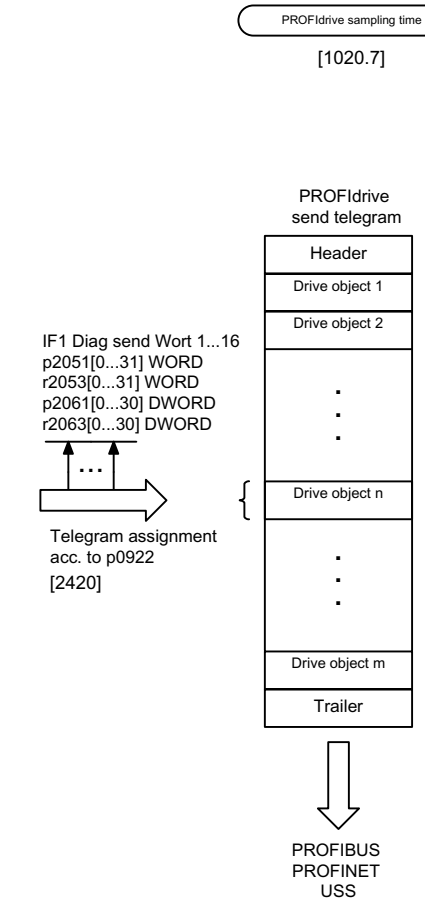
<3> Value refers to device data. I.e. 100% corresponds to p2003.



<4> Electric power output of the SINAMICS DCM

1	2	3	4	5	6	7	8
DO: DC_CTRL, CU_DC				<b>SIEMENS</b>	fp_2450_96_VSD	Function diagram	<b>- 2450 -</b>
PROFdrive - PZD send signals interconnection					2013-05-14 v 1.4	SINAMICS DCM	

PROFdrive sampling time

[1020.7]

## Signal sources for ZSW1 for telegrams 1, 3, 4, 20, 352

Signal	Meaning	Interconnection parameter	[Function diagram] internal status word	Inverted
ZSW1.0	1 = Ready to switch on	p2080[0] = r0899.0	[2585.7]	-
ZSW1.1	1 = Ready	p2080[1] = r0899.1	[2585.7]	-
ZSW1.2	1 = Operation enabled	p2080[2] = r0899.2	[2585.7]	-
ZSW1.3	1 = Fault effective	p2080[3] = r2139.3	[2548.7]	-
ZSW1.4	1 = No coasting down active (OFF2 inactive)	p2080[4] = r0899.4	[2585.7]	-
ZSW1.5	1 = No quick stop active (OFF3 inactive)	p2080[5] = r0899.5	[2585.7]	-
ZSW1.6	1 = Switching on inhibited active	p2080[6] = r0899.6	[2585.7]	-
ZSW1.7	1 = Alarm effective	p2080[7] = r2139.7	[2548.7]	-
ZSW1.8	1 = Speed setpoint - actual value deviation within tolerance t_off	p2080[8] = r2197.7	[2534.6]	-
ZSW1.9	1 = Control request <3>	p2080[9] = r0899.9	[2585.7]	-
ZSW1.10	1 = f or n comparison value reached or exceeded	p2080[10] = r2199.1	[2537.6]	-
ZSW1.11	1 = M limit not reached 1 = l or M limit not reached <1>	p2080[11] = r1407.7 p2080[11] = r0056.13	-	✓
ZSW1.12	1 = Holding brake open reserved (always value 0) <1>	p2080[12] = r0899.12	[2585.7]	-
ZSW1.13	1 = No warning overtemperature motor	p2080[13] = r2135.14	[2548.7]	✓
ZSW1.14	1 = Motor rotates forwards (n_act >= 0) 0 = Motor rotates backwards (n_act < 0)	p2080[14] = r2197.3	[2534.6]	-
ZSW1.15	No warning thermal overload power unit 1 = Command data set CDS effective bit 0 <1>	p2080[15] = r2135.15 p2080[15] = r836.0	[2548.7] [8560.7]	✓

&lt;1&gt; For telegram 20

&lt;2&gt; ZSW1 is formed via binector-connector converter (BI: p2080[0...15], inversion: p2088[0]...p2088[0].15).

&lt;3&gt; The drive object is ready for acceptance.

1	2	3	4	5	6	7	8
DO: DC_CTRL				<b>SIEMENS</b>	fp_2452_96_VSD	Function diagram	- 2452 -
PROFdrive - ZSW1 status word interconnection					2013-05-14 v 1.4	SINAMICS DCM	

Fig. 2-32 2452 – ZSW1 status word interconnection

PROFdrive sampling time


[1020.7]

### Signal destinations for ZSW2 for telegrams 3, 4

Signal	Meaning	Interconnection parameter	Function diagram	Inverted
ZSW2.0	1 = Drive data set selection DDS effective bit 0	p2081[0] = r0051.0	[8565.7]	-
ZSW2.1	1 = Drive data set selection DDS effective bit 1	p2081[1] = r0051.1	[8565.7]	-
ZSW2.2	Reserved	-	-	-
ZSW2.3	Reserved	-	-	-
ZSW2.4	Reserved	-	-	-
ZSW2.5	1 = Alarm class bit 0	p2081[5] = r2139.11	[2548.7]	-
ZSW2.6	1 = Alarm class bit 1	p2081[6] = r2139.12	[2548.7]	-
ZSW2.7	Reserved	-	-	-
ZSW2.8	Reserved	-	-	-
ZSW2.9	Reserved	-	-	-
ZSW2.10	1 = Pulses enabled	p2081[10] = r0899.11	[2585.7]	-
ZSW2.11	Reserved	-	-	-
ZSW2.12	Reserved	-	-	-
ZSW2.13	Reserved	-	-	-
ZSW2.14	Reserved	-	-	-
ZSW2.15	Reserved	-	-	-

1	2	3	4	5	6	7	8
DO: DC_CTRL				<b>SIEMENS</b>	fp_2454_96_VSD	Function diagram	<b>- 2454 -</b>
PROFdrive - ZSW2 status word interconnection					2013-05-14 v 1.4	SINAMICS DCM	

Fig. 2-33 2454 – ZSW2 status word interconnection

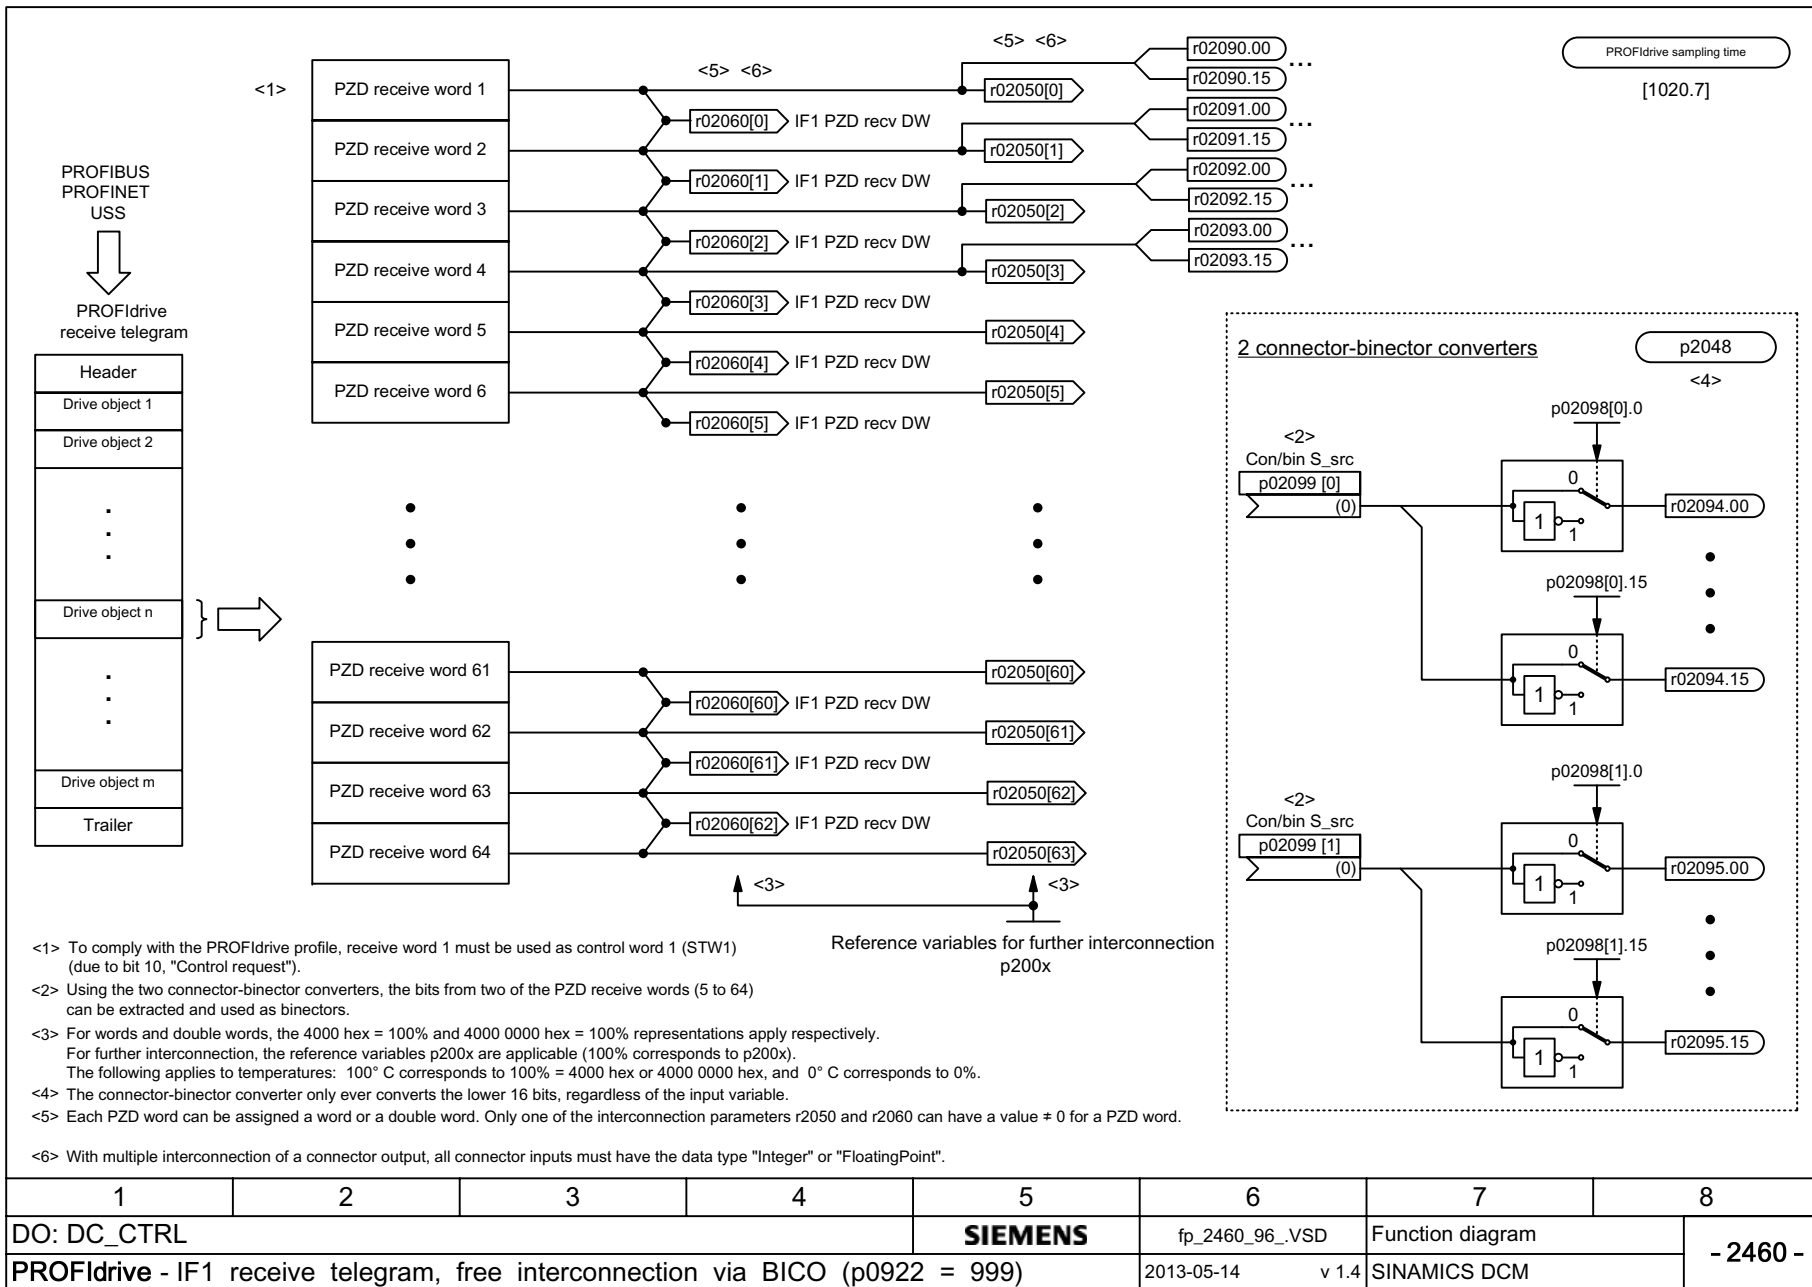

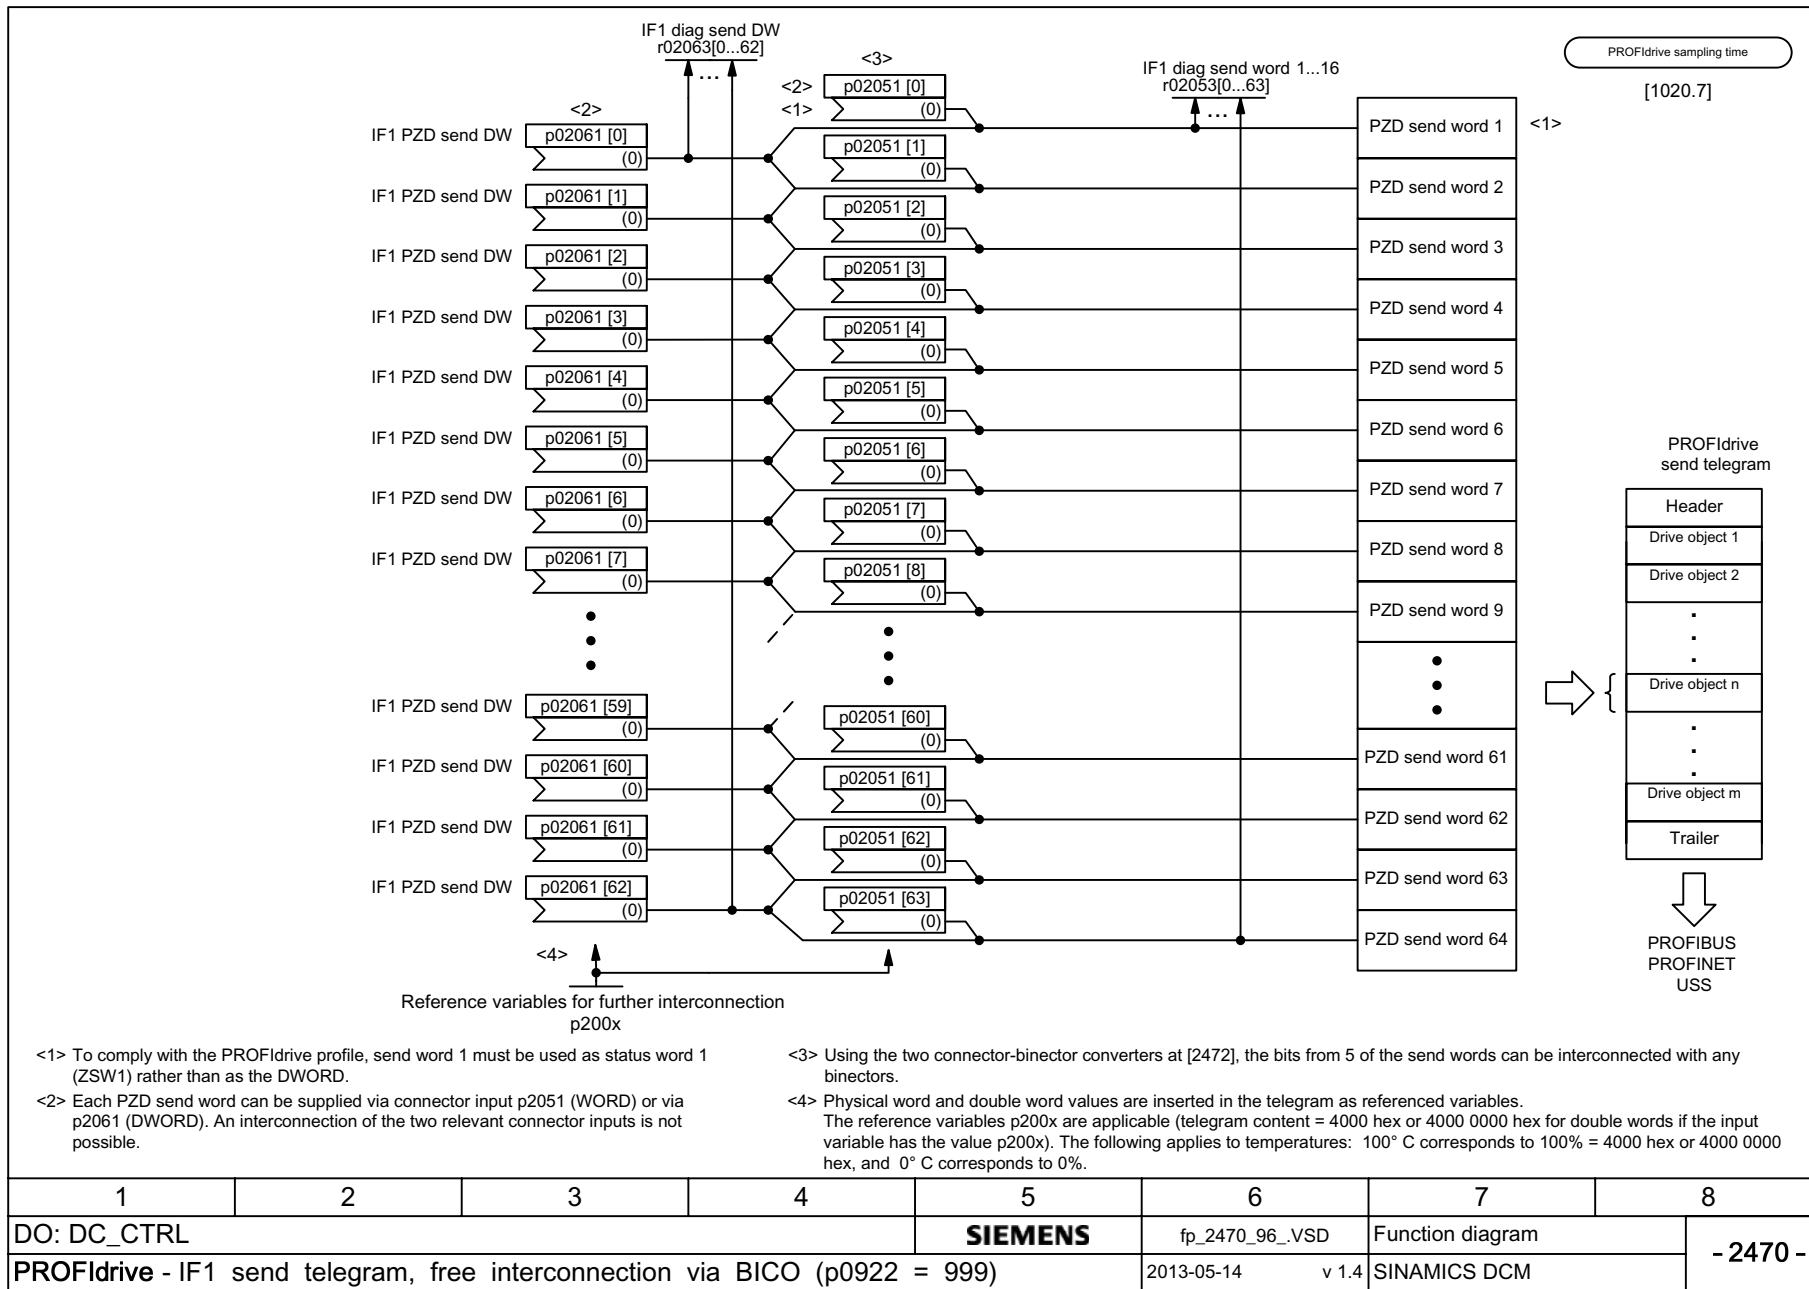
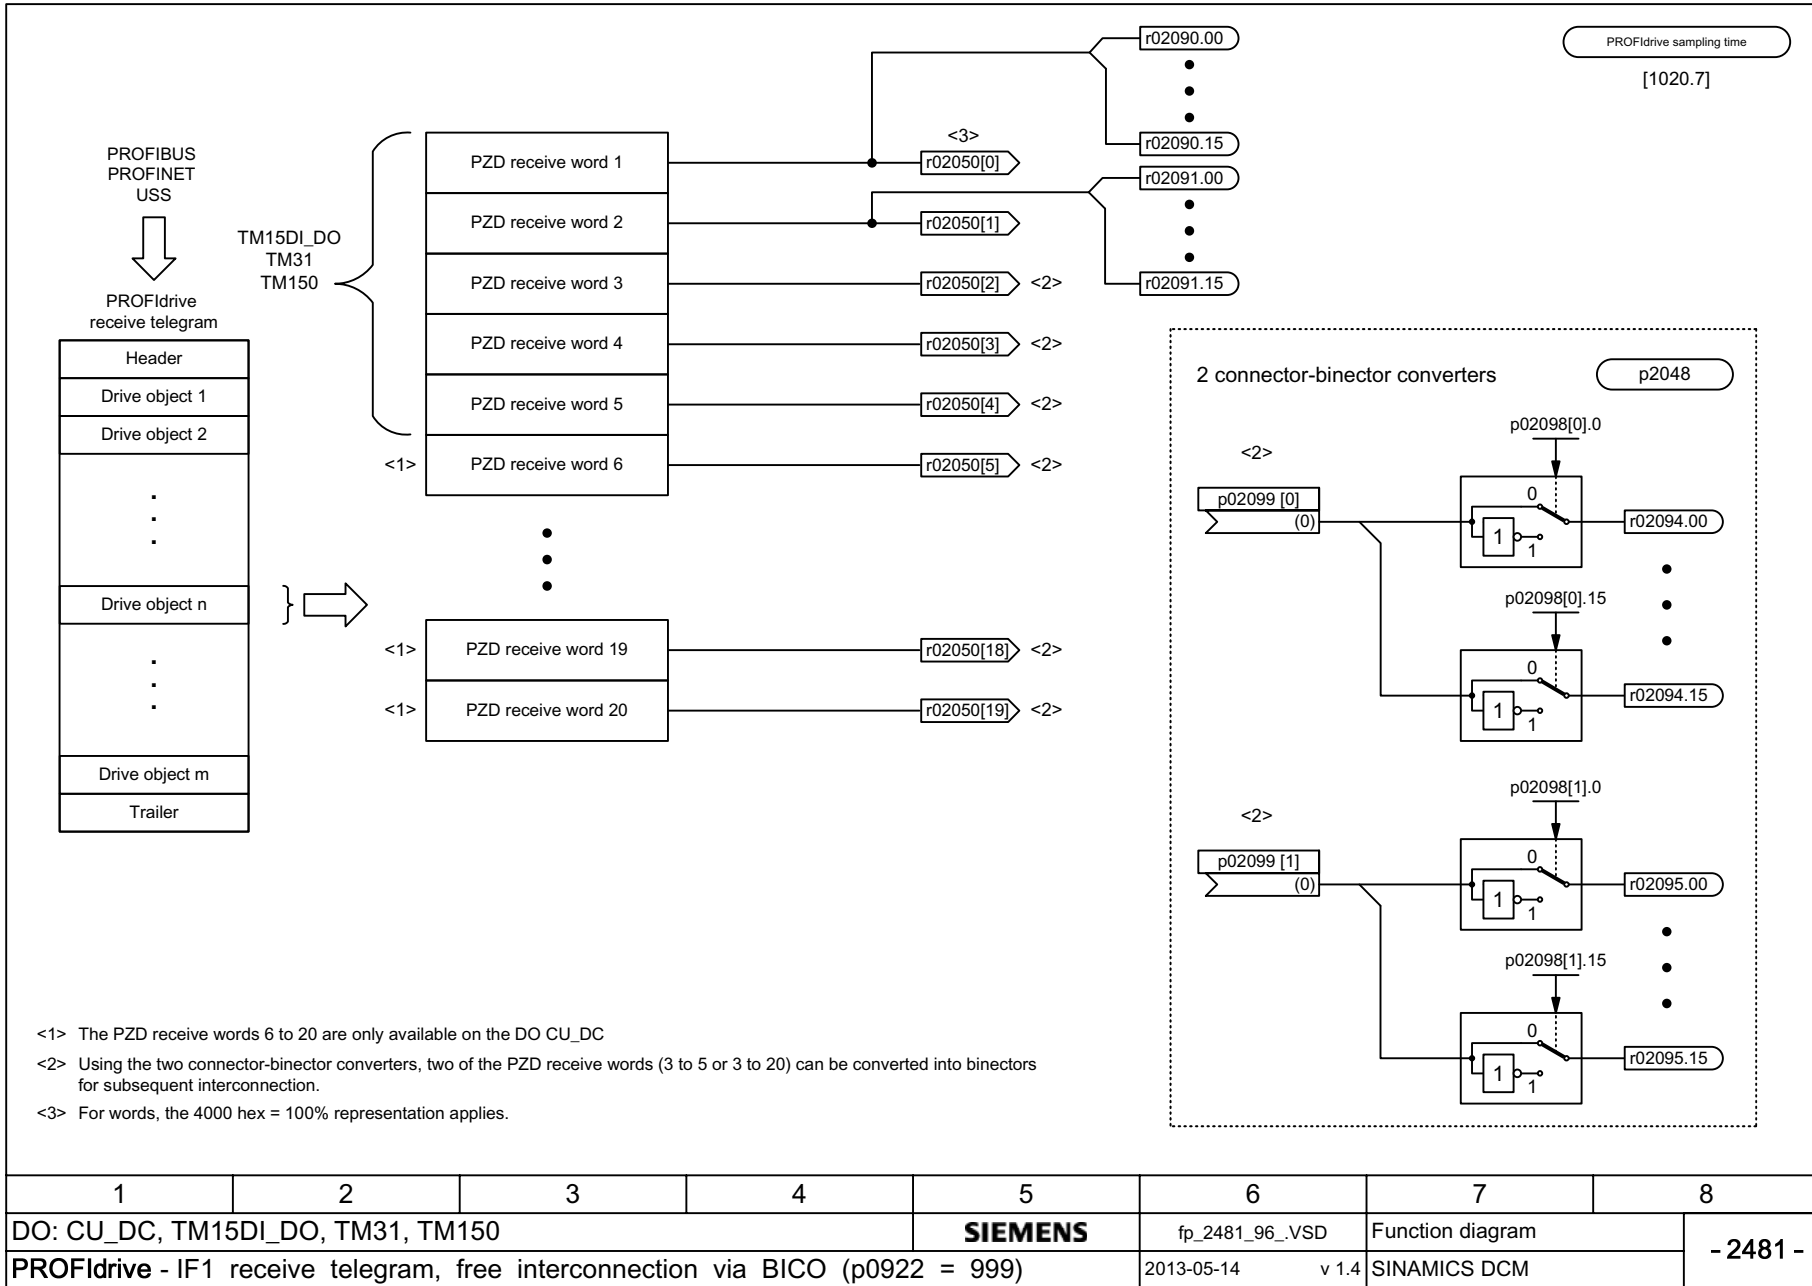
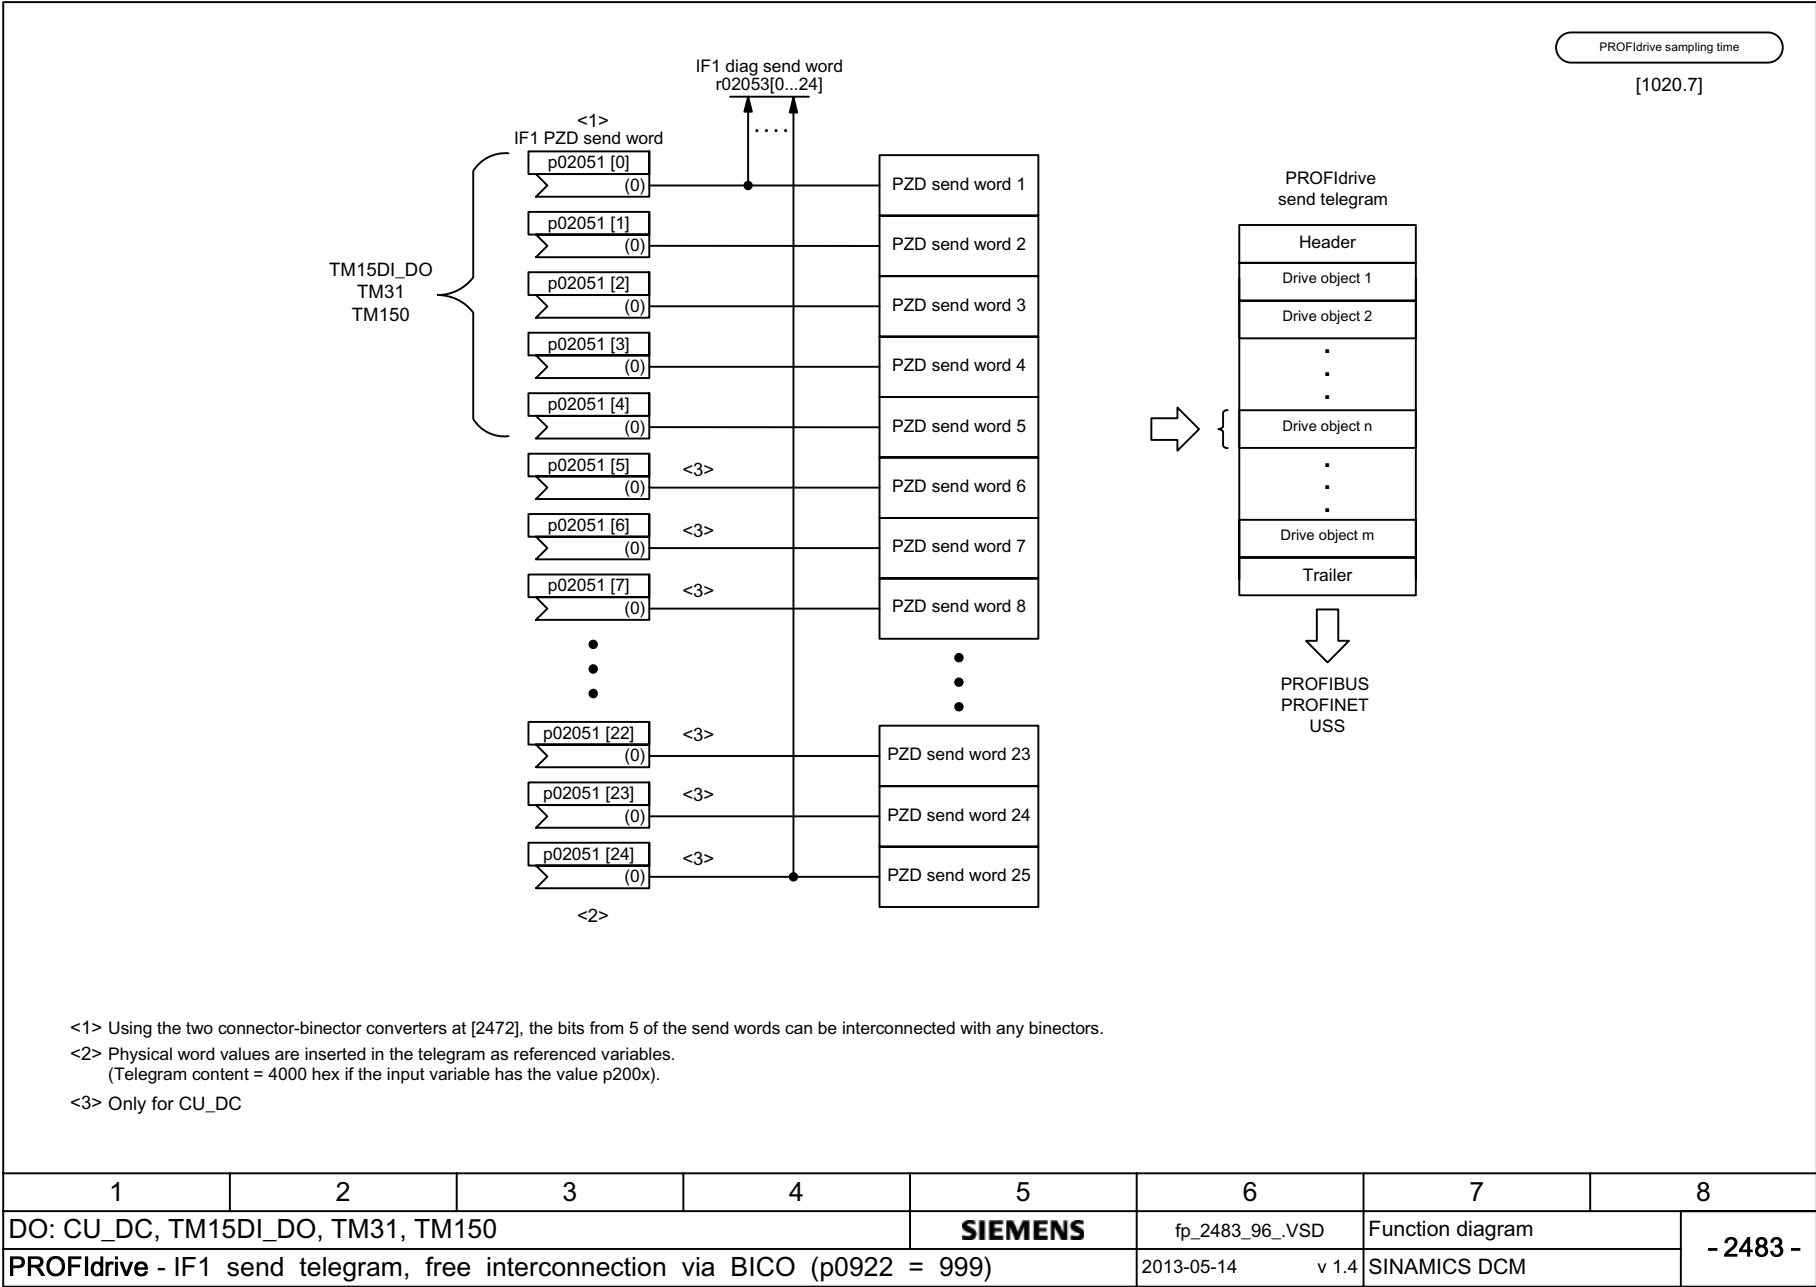
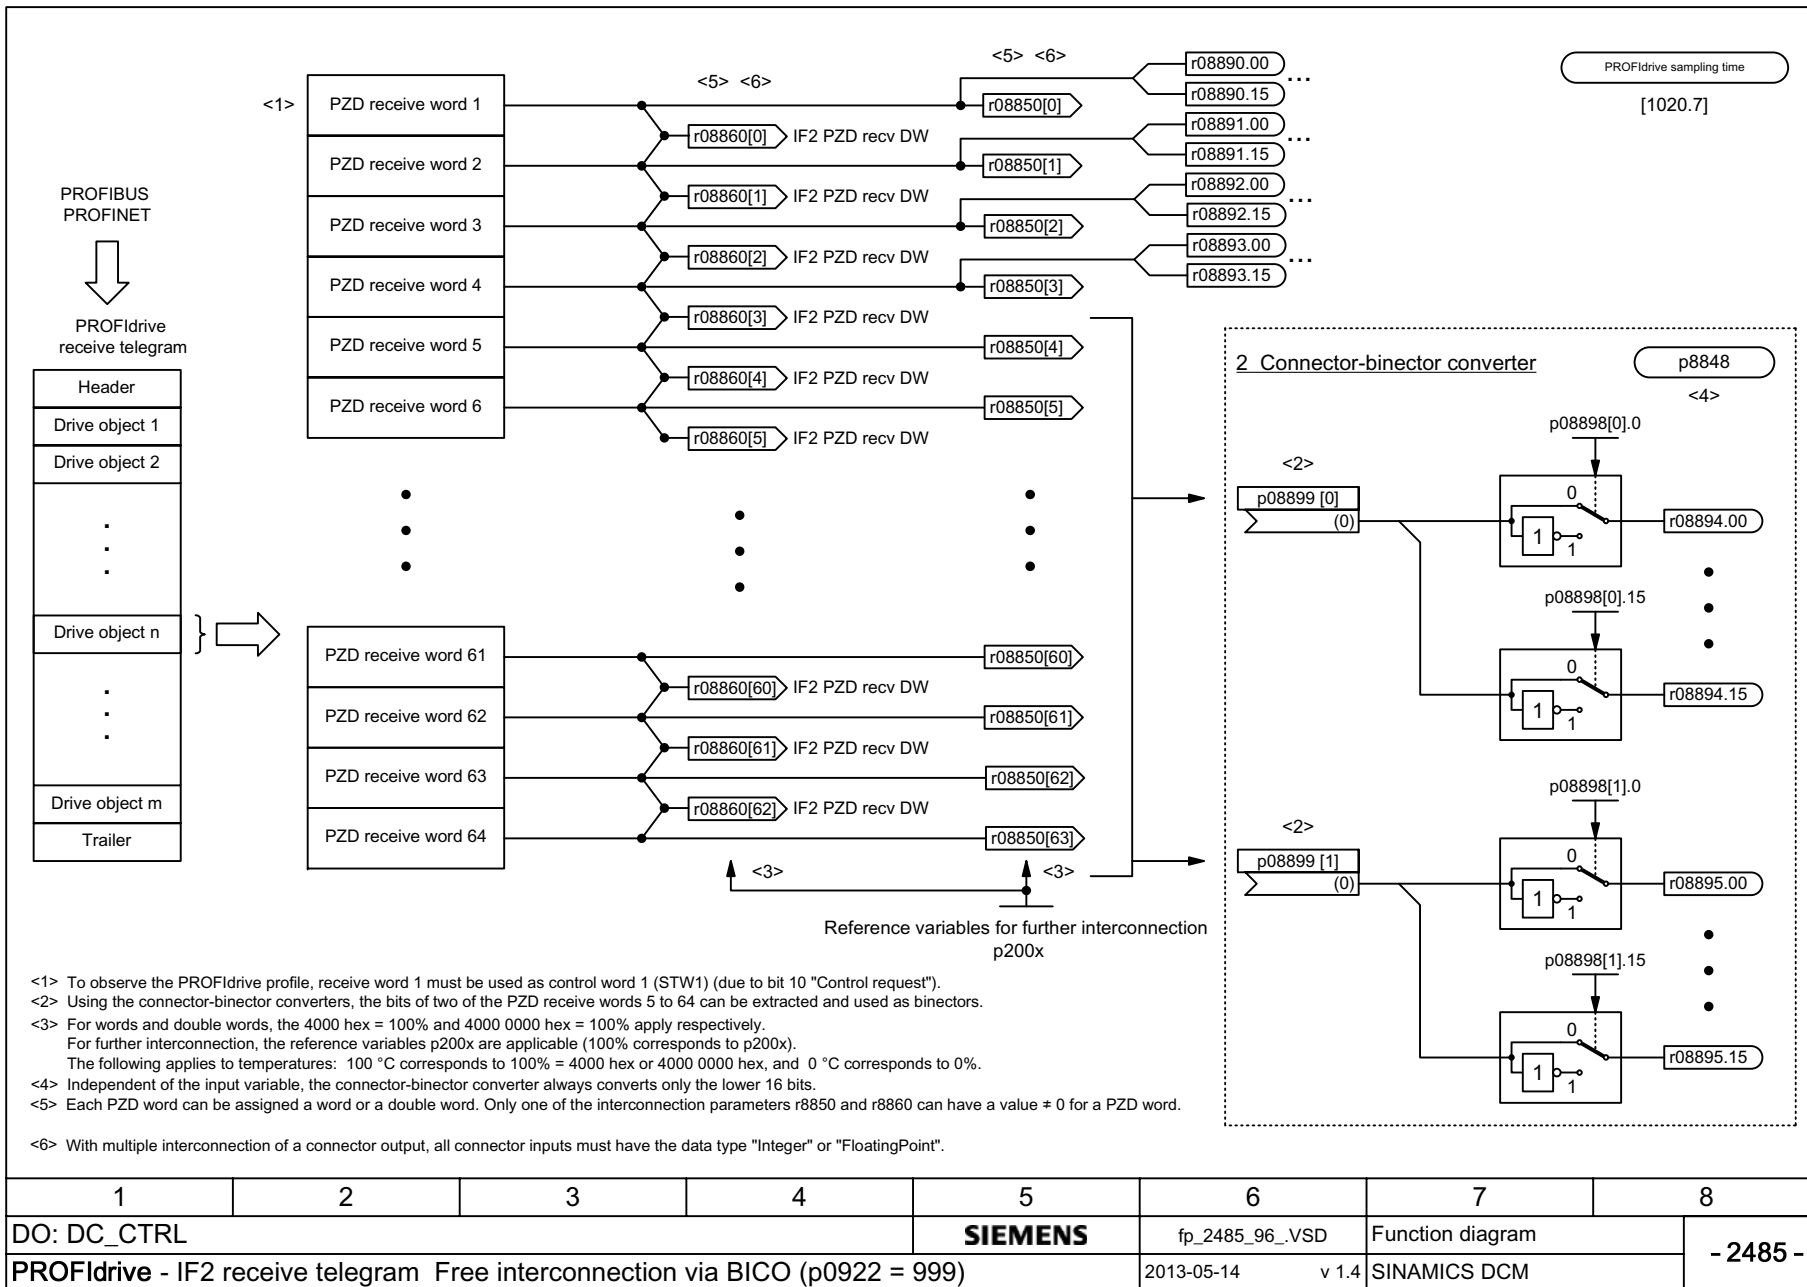


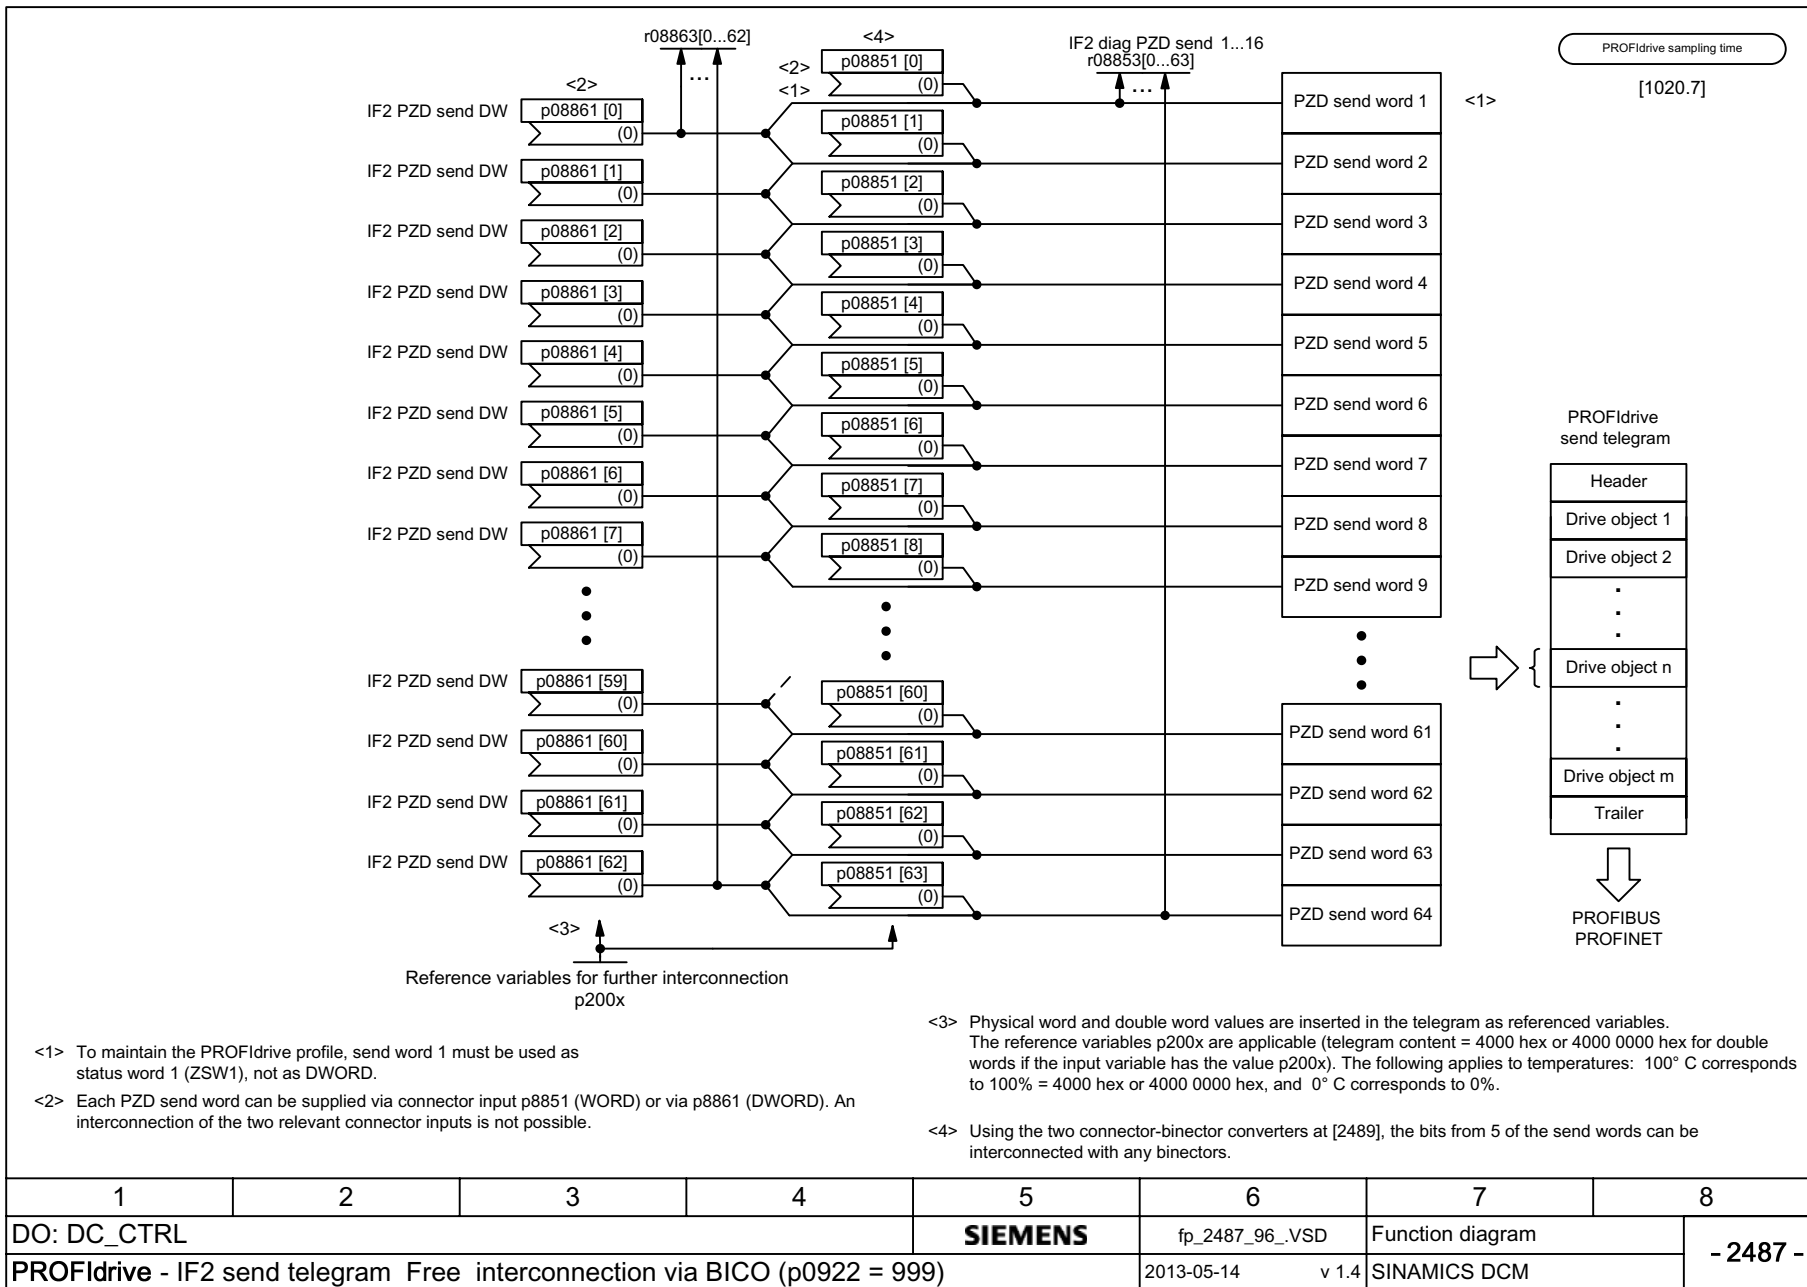


Fig. 2-36









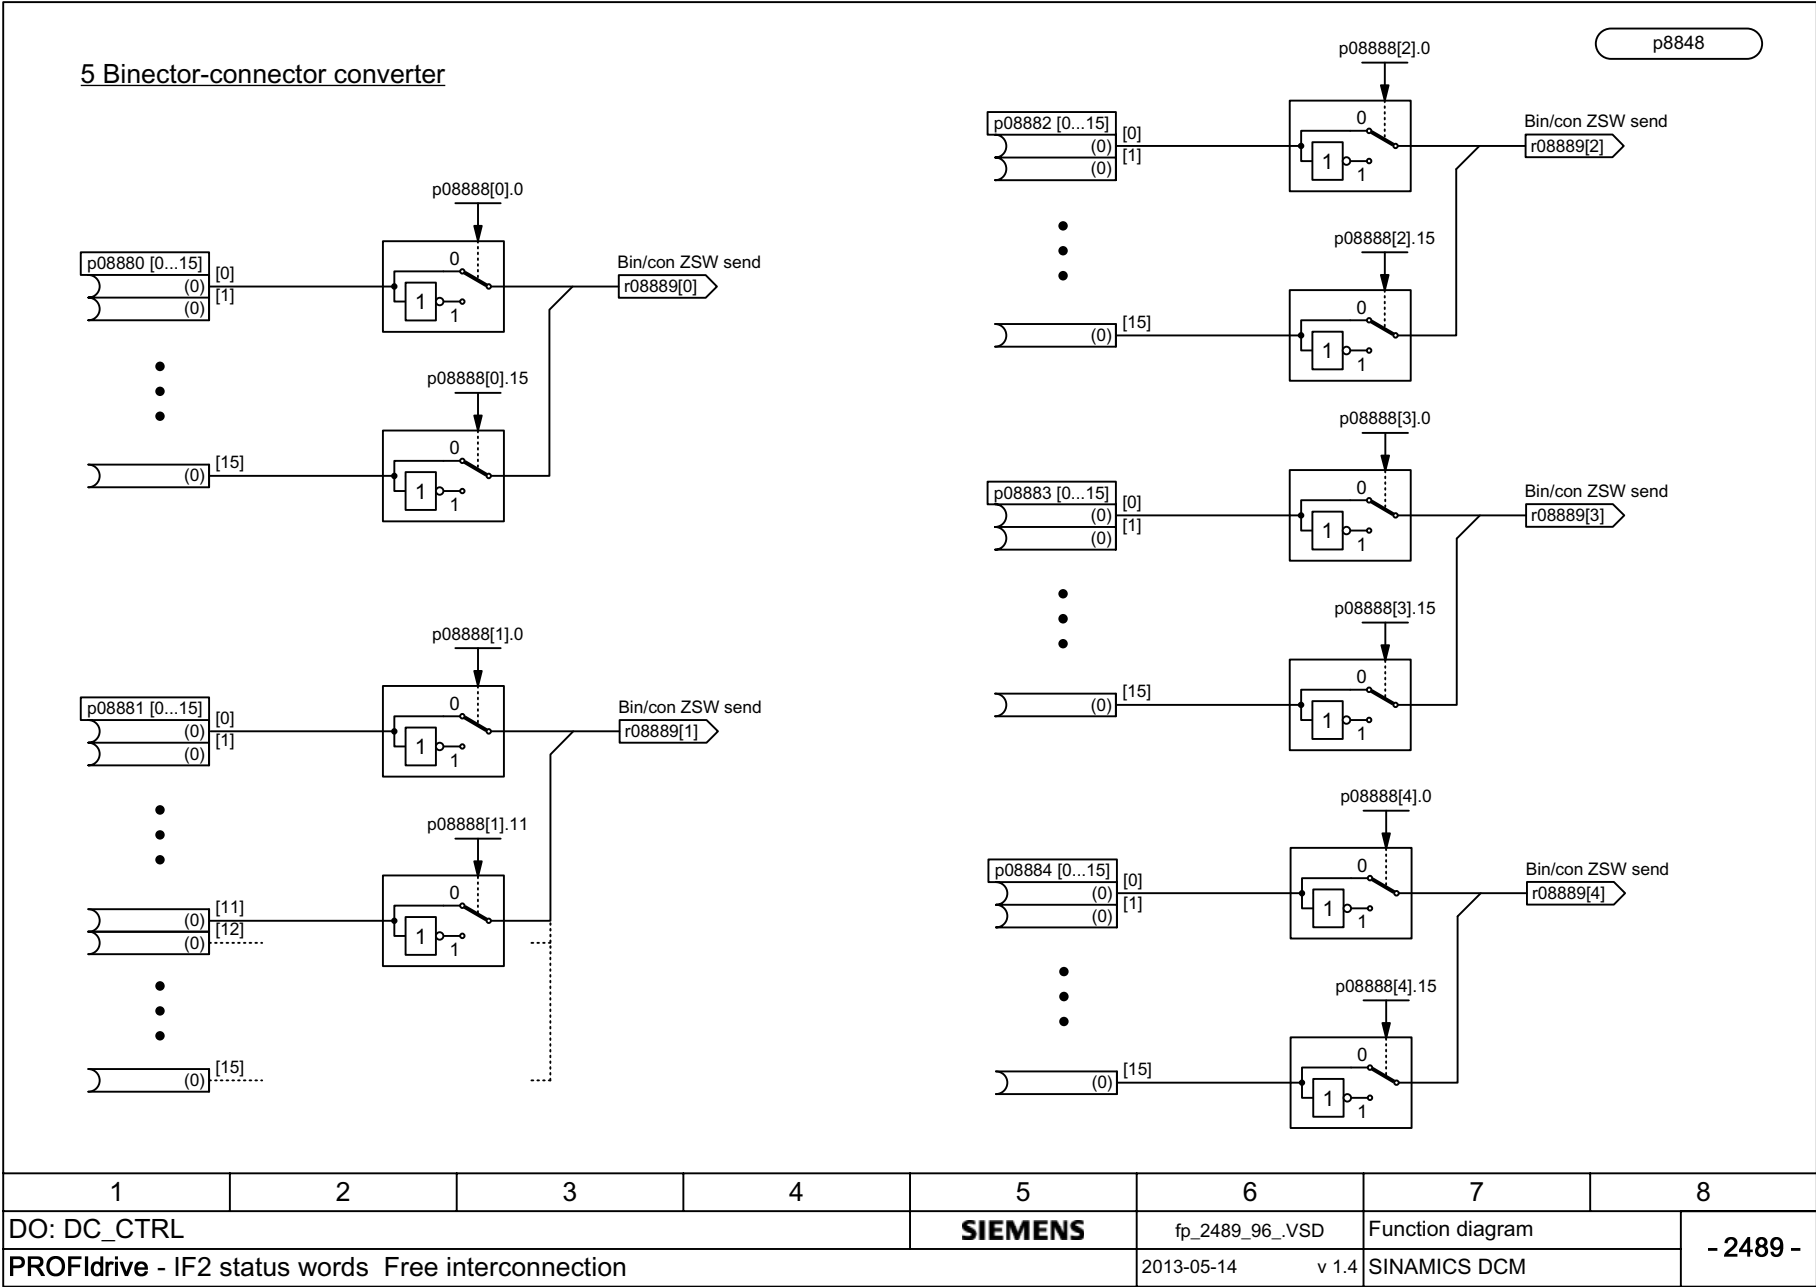



Fig. 2-41 2489 – IF2 status words, free interconnection

PROFdrive sampling time

[1020.7]

## Signal destinations for CU\_STW1 for telegram 390

Signal	Meaning	Interconnection parameter	Function diagram	Inverted
CU_STW1.0	Reserved	-	-	-
CU_STW1.1	RTC real-time synchronization PING	p3104 = r2090.1	-	-
CU_STW1.2	Reserved	-	-	-
CU_STW1.3	Reserved	-	-	-
CU_STW1.4	Reserved	-	-	-
CU_STW1.5	Reserved	-	-	-
CU_STW1.6	Reserved	-	-	-
CU_STW1.7	 = Acknowledge fault	p2103[0] = r2090.7	[2546.2]	-
CU_STW1.8	Reserved	-	-	-
CU_STW1.9	Reserved	-	-	-
CU_STW1.10	Control by PLC	p3116 = r2090.10	-	-
CU_STW1.11	Reserved	-	-	-
CU_STW1.12	Reserved	-	-	-
CU_STW1.13	Reserved	-	-	-
CU_STW1.14	Reserved	-	-	-
CU_STW1.15	Reserved	-	-	-

1	2	3	4	5	6	7	8
DO: CU_DC				<b>SIEMENS</b>	fp_2495_96_.VSD	Function diagram	<b>- 2495 -</b>
PROFdrive - CU_STW1 control word 1 Control Unit interconnection					2013-05-14 v 1.4	SINAMICS DCM	

Fig. 2-42 2495 – CU\_STW1 control word 1, Control Unit Interconnection

PROFdrive sampling time

[1020.7]

## Signal destinations for CU\_ZSW1 for telegram 390

&lt;1&gt;

Signal	Meaning	Interconnection parameter	Function diagram	Inverted
CU_ZSW1.0	Reserved	-	-	-
CU_ZSW1.1	Reserved	-	-	-
CU_ZSW1.2	Reserved	-	-	-
CU_ZSW1.3	1 = Fault effective	p2081[3] = r2139.3	[2548.7]	-
CU_ZSW1.4	Reserved	-	-	-
CU_ZSW1.5	Reserved	-	-	-
CU_ZSW1.6	Reserved	-	-	-
CU_ZSW1.7	1 = Alarm effective	p2081[7] = r2139.7	[2548.7]	-
CU_ZSW1.8	1 = Synchronize system time	p2081[8] = r0899.8	[2585.7]	-
CU_ZSW1.9	1 = No group alarm present	p2081[9] = r3114.9	[8065.7]	✓
CU_ZSW1.10	1 = No group fault present	p2081[10] = r3114.10	[8060.8]	✓
CU_ZSW1.11	Reserved	p2081[11] = r3114.11	-	✓
CU_ZSW1.12	Reserved	-	-	-
CU_ZSW1.13	Reserved	-	-	-
CU_ZSW1.14	Reserved	-	-	-
CU_ZSW1.15	Reserved	-	-	-

&lt;1&gt; CU\_ZSW1 is formed via binector-connector converter (BI: p2080[0...15], inversion: p2088[0]..p2088[0].15).

1	2	3	4	5	6	7	8
DO: CU_DC				<b>SIEMENS</b>	fp_2496_96_VSD	Function diagram	- 2496 -
PROFdrive - CU_ZSW1 status word 1 Control Unit interconnection					2013-05-14 v 1.4	SINAMICS DCM	

Fig. 2-43 2496 – CU\_ZSW1 status word 1, Control Unit interconnection



PROFdrive sampling time

[1020.7]

## Signal destinations for O\_DIGITAL for telegram 390

&lt;1&gt;

Signal	Meaning	Interconnection parameter	Function diagram	Inverted
A_DIGITAL.0	CUD digital output 0 (DO 0)	p50771[0] = r2091.0	[2055.1]	-
A_DIGITAL.1	CUD digital output 1 (DO 1)	p50772[0] = r2091.1	[2055.1]	-
A_DIGITAL.2	CUD digital output 2 (DO 2)	p50773[0] = r2091.2	[2055.1]	-
A_DIGITAL.3	CUD digital output 3 (DO 3)	p50774[0] = r2091.3	[2055.1]	-
A_DIGITAL.4	Reserved	-	-	-
A_DIGITAL.5	Reserved	-	-	-
A_DIGITAL.6	Reserved	-	-	-
A_DIGITAL.7	Reserved	-	-	-
A_DIGITAL.8	Reserved	-	-	-
A_DIGITAL.9	Reserved	-	-	-
A_DIGITAL.10	Reserved	-	-	-
A_DIGITAL.11	Reserved	-	-	-
A_DIGITAL.12	Reserved	-	-	-
A_DIGITAL.13	Reserved	-	-	-
A_DIGITAL.14	Reserved	-	-	-
A_DIGITAL.15	Reserved	-	-	-

&lt;1&gt; Default can be changed by user

1	2	3	4	5	6	7	8
DO: CU_DC				<b>SIEMENS</b>	fp_2497_96_.VSD	Function diagram	- 2497 -
PROFdrive - O_DIGITAL interconnection					2013-05-14 v 1.4	SINAMICS DCM	

Fig. 2-44 2497 – A\_DIGITAL interconnection

PROFdrive sampling time

[1020.7]

## Signal destinations for I\_DIGITAL for telegram 390

		<1>		
Signal	Meaning	Interconnection parameter	Function diagram	Inverted
E_DIGITAL.0	CUD digital input 4 (DI 4) <2>	p2082[0] = r53010.8	[2060.8]	-
E_DIGITAL.1	CUD digital input 5 (DI 5) <2>	p2082[1] = r53010.10	[2060.8]	-
E_DIGITAL.2	CUD digital input 6 (DI 6) <2>	p2082[2] = r53010.12	[2065.8]	-
E_DIGITAL.3	CUD digital input 7 (DI 7) <2>	p2082[3] = r53010.14	[2065.8]	-
E_DIGITAL.4	Reserved	-	-	-
E_DIGITAL.5	Reserved	-	-	-
E_DIGITAL.6	Reserved	-	-	-
E_DIGITAL.7	Reserved	-	-	-
E_DIGITAL.8	CUD digital input 0 (DI 0)	p2082[8] = r53010.0	[2050.7]	-
E_DIGITAL.9	CUD digital input 1 (DI 1)	p2082[9] = r53010.2	[2050.7]	-
E_DIGITAL.10	CUD digital input 2 (DI 2)	p2082[10] = r53010.4	[2050.7]	-
E_DIGITAL.11	CUD digital input 3 (DI 3)	p2082[11] = r53010.6	[2050.7]	-
E_DIGITAL.12	Reserved	-	-	-
E_DIGITAL.13	Reserved	-	-	-
E_DIGITAL.14	Reserved	-	-	-
E_DIGITAL.15	Reserved	-	-	-

&lt;1&gt; Default can be changed by user

&lt;2&gt; Can be set via p50789[0...3] as digital input or digital output.

1	2	3	4	5	6	7	8
DO: CU_DC				<b>SIEMENS</b>	fp_2498_96_VSD	Function diagram	
PROFdrive - I_DIGITAL interconnection					2013-05-14 v 1.4	SINAMICS DCM	
							- 2498 -

Fig. 2-45 2498 – E\_DIGITAL interconnection

## 2.6 Internal control/status words

### Function diagrams

---

2534 – Status word, monitoring functions 1	2-716
2537 – Status word, monitoring functions 3	2-717
2546 – Control word faults/alarms	2-718
2548 – Status word faults/alarms 1 and 2	2-719
2580 – Control word sequence control	2-720
2585 – Status word sequence control	2-721

---

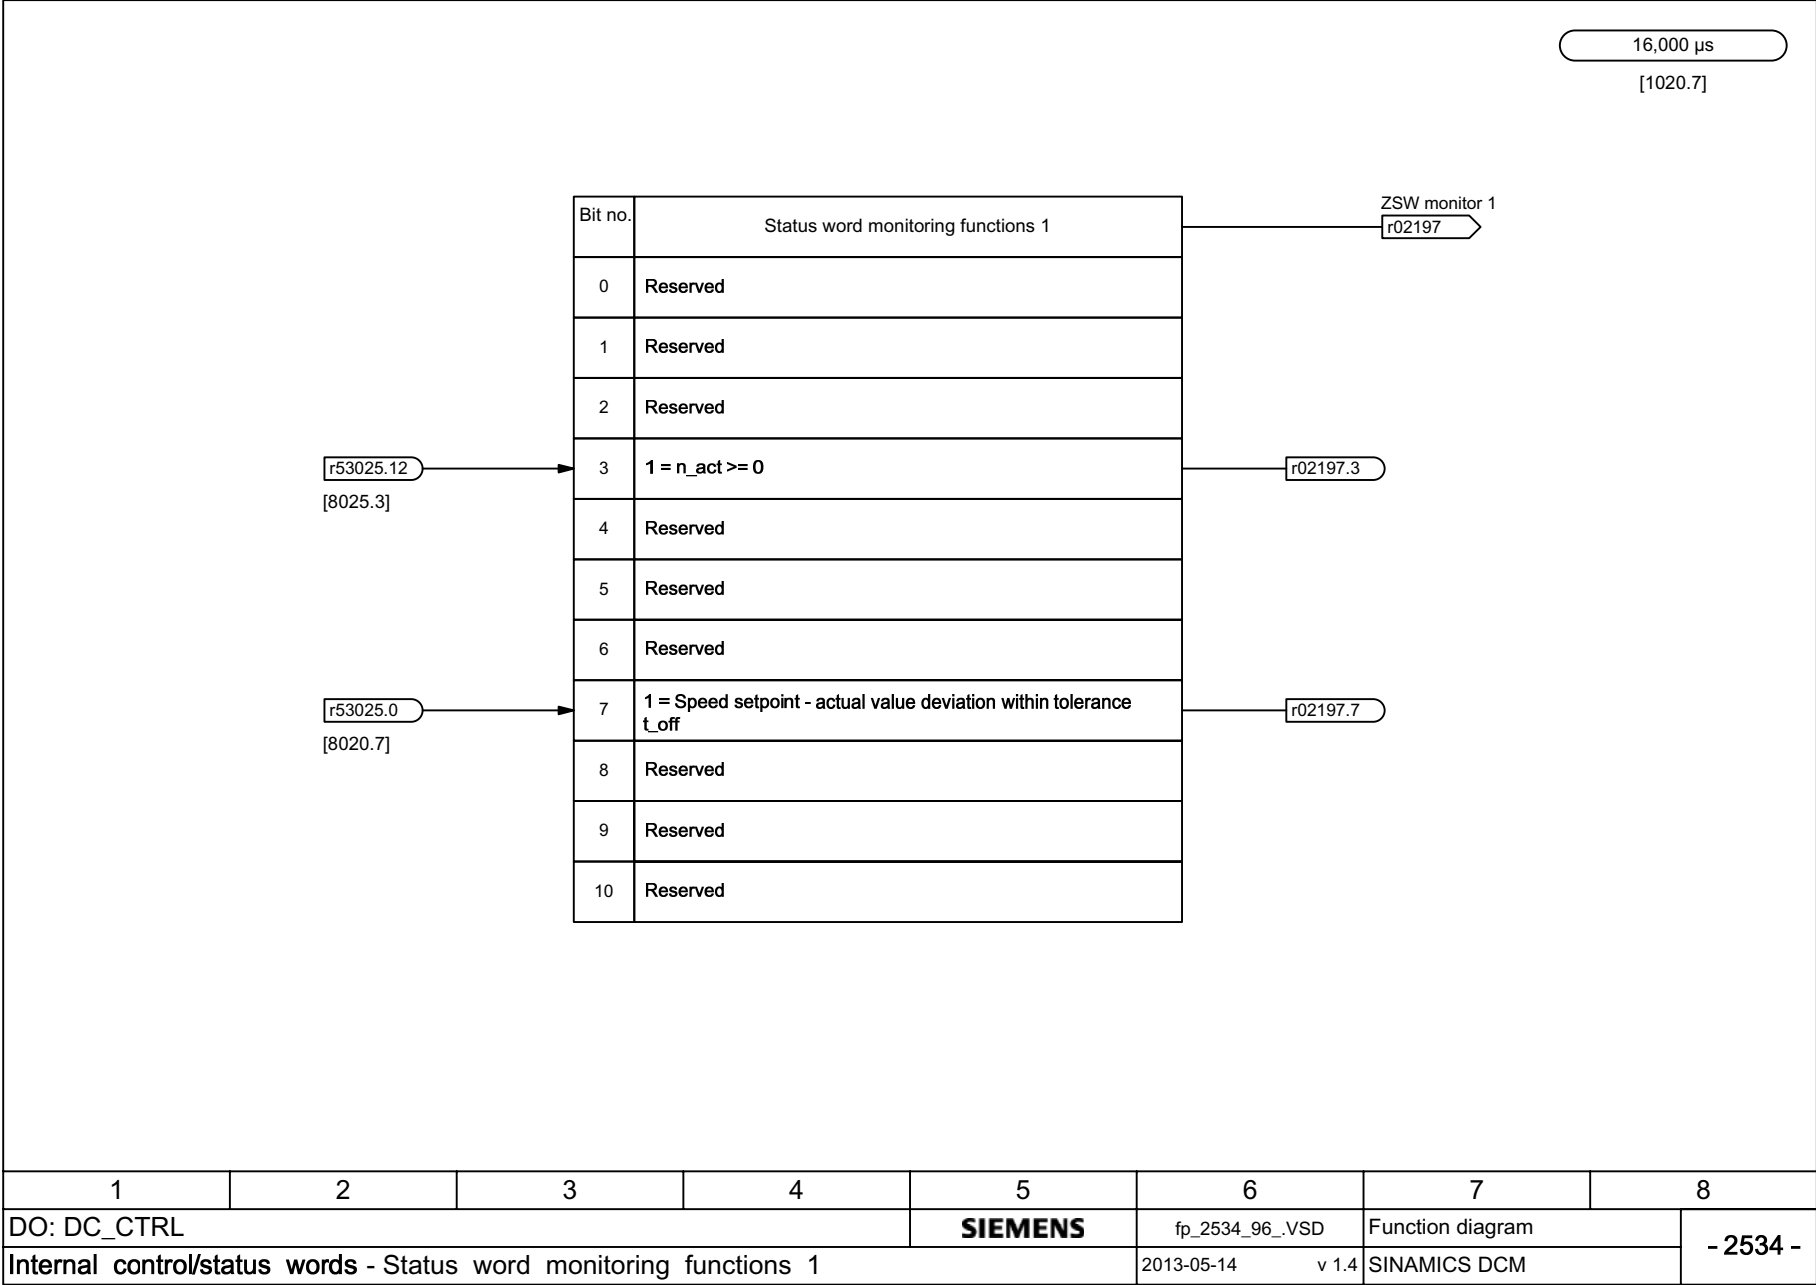


Fig. 2-46 2534 – Status word, monitoring functions 1

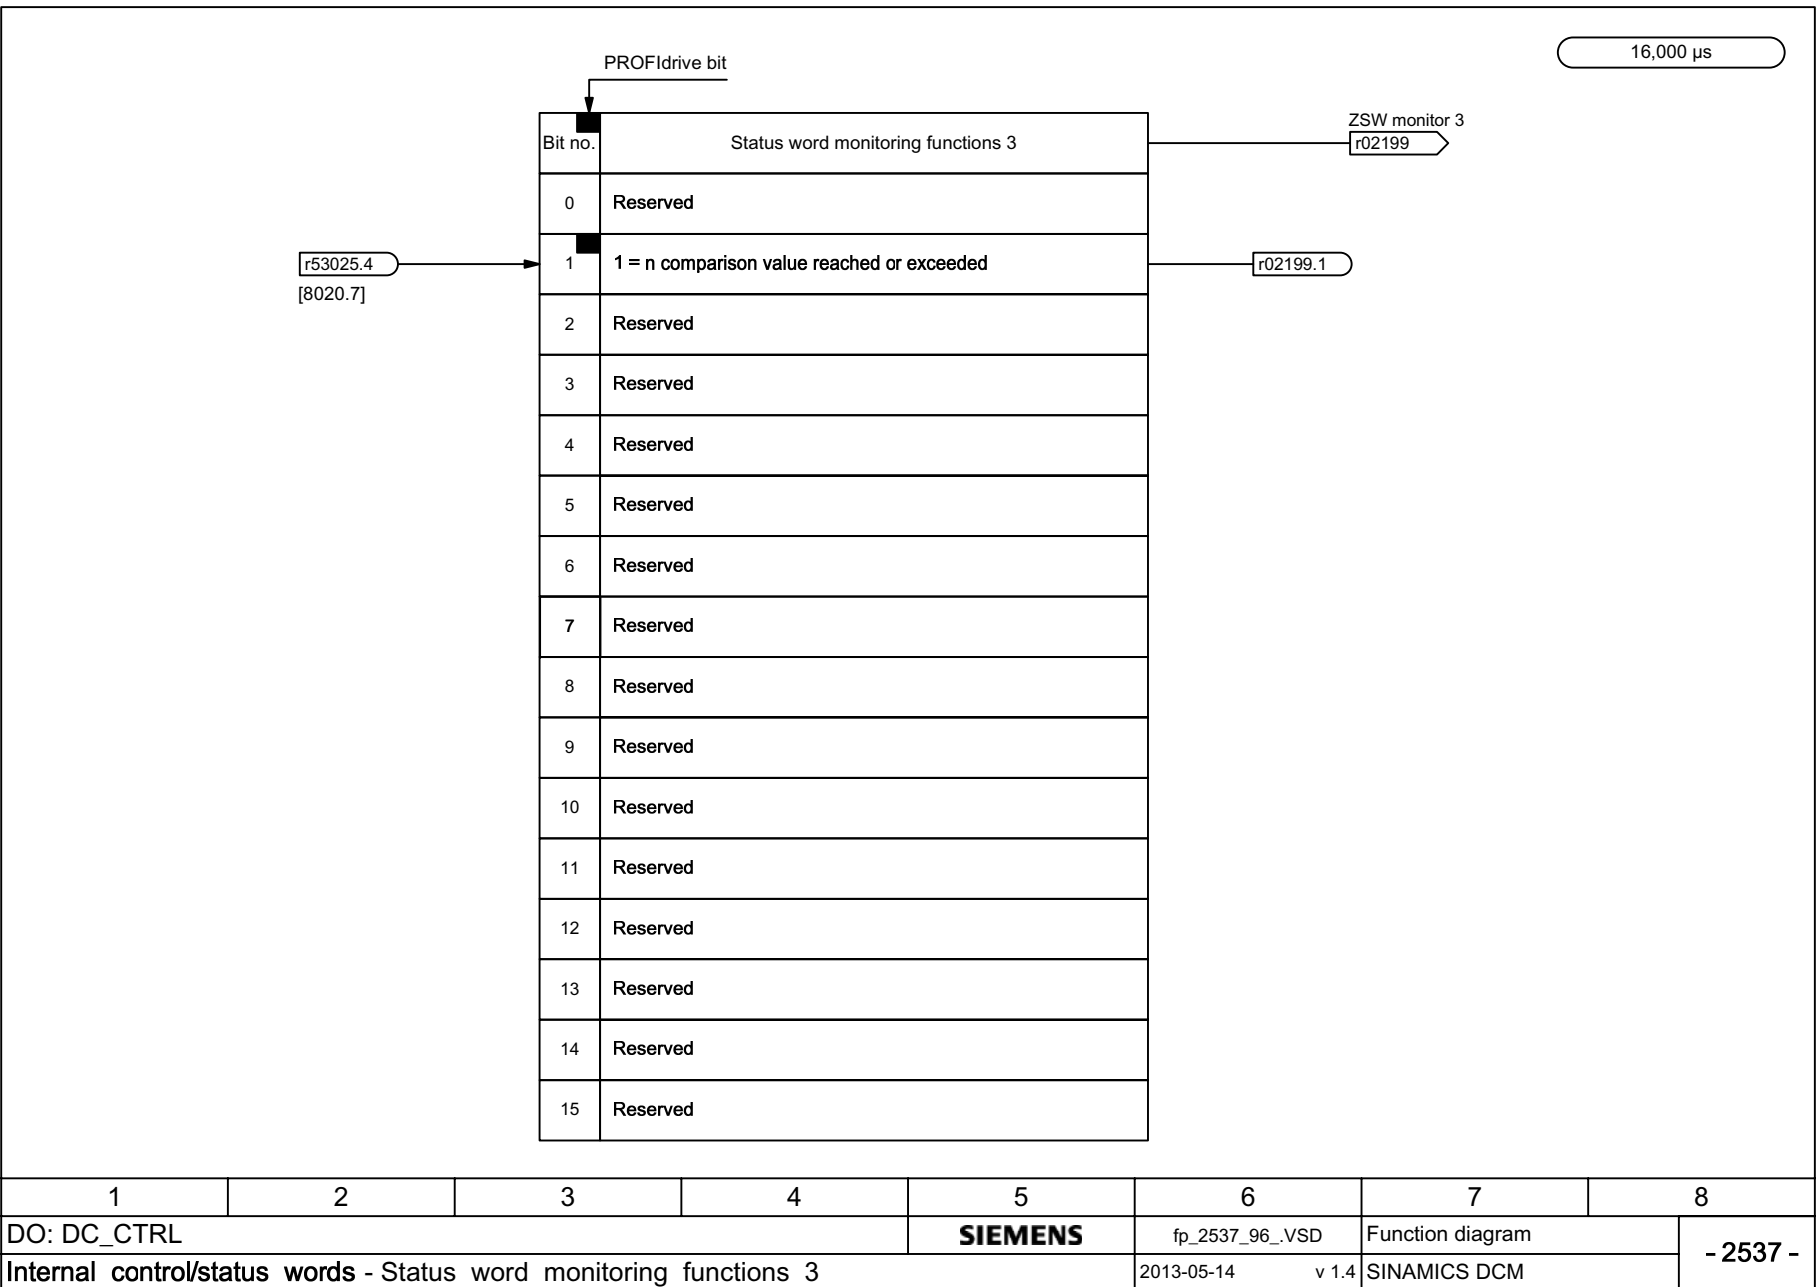


Fig. 2-47 2537 – Status word, monitoring functions 3



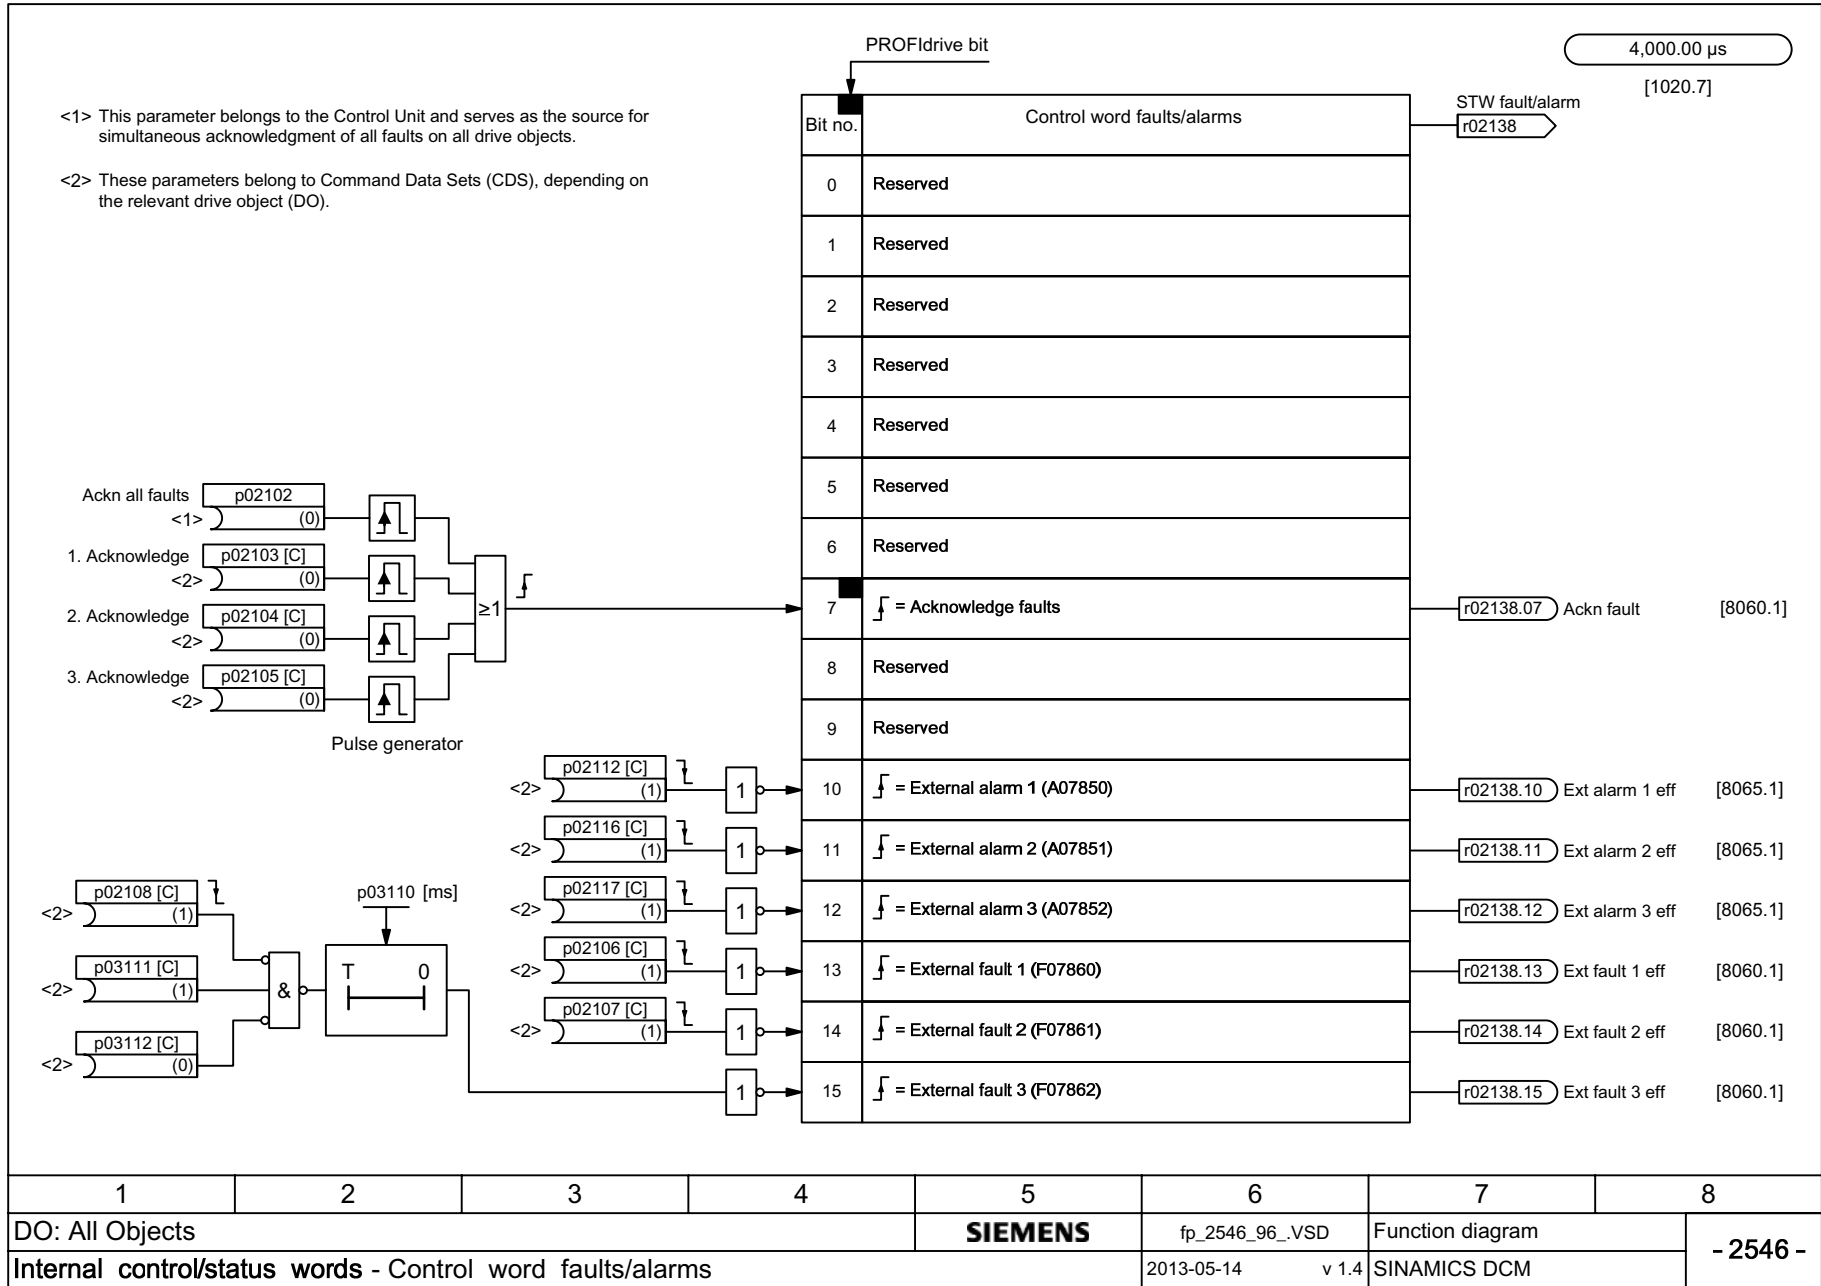


Fig. 2-48

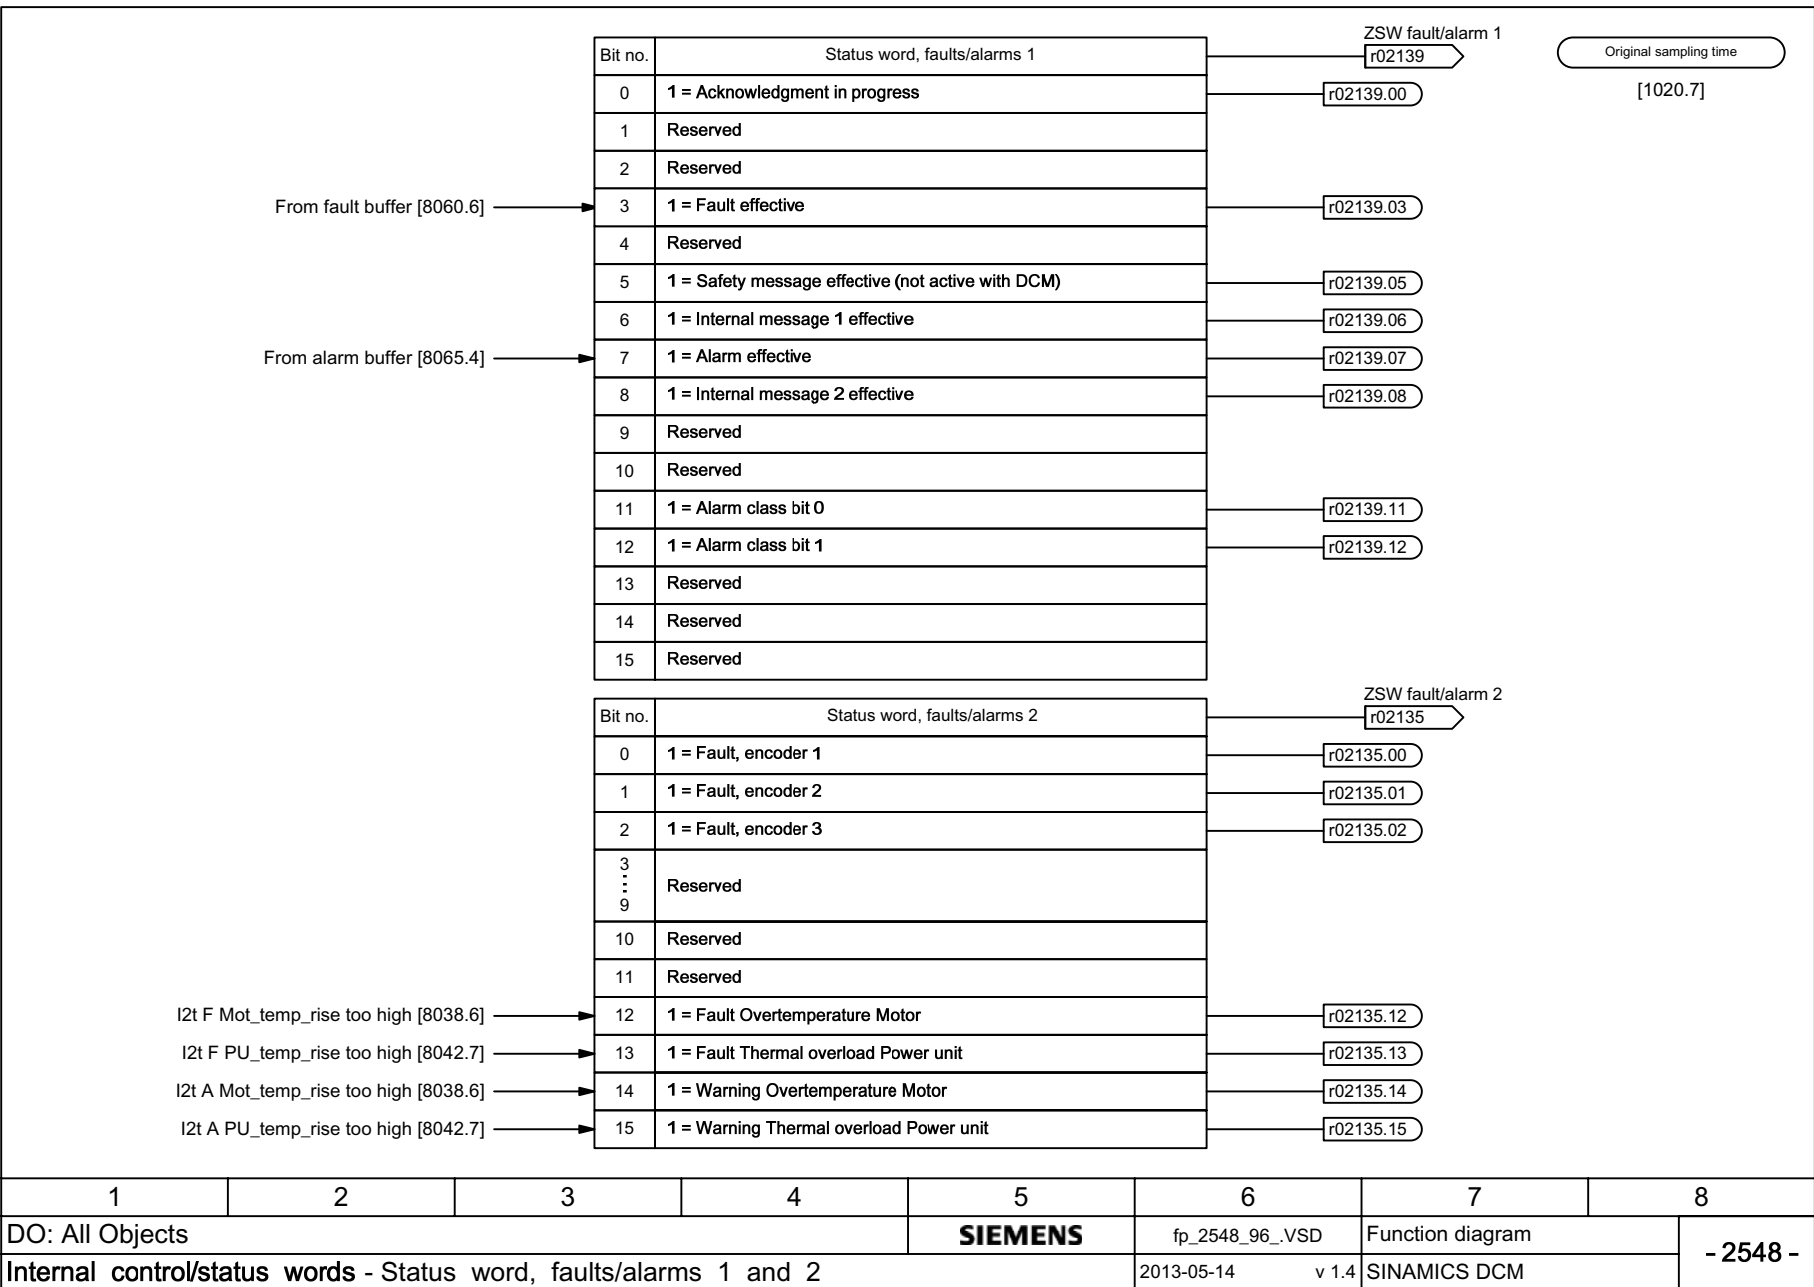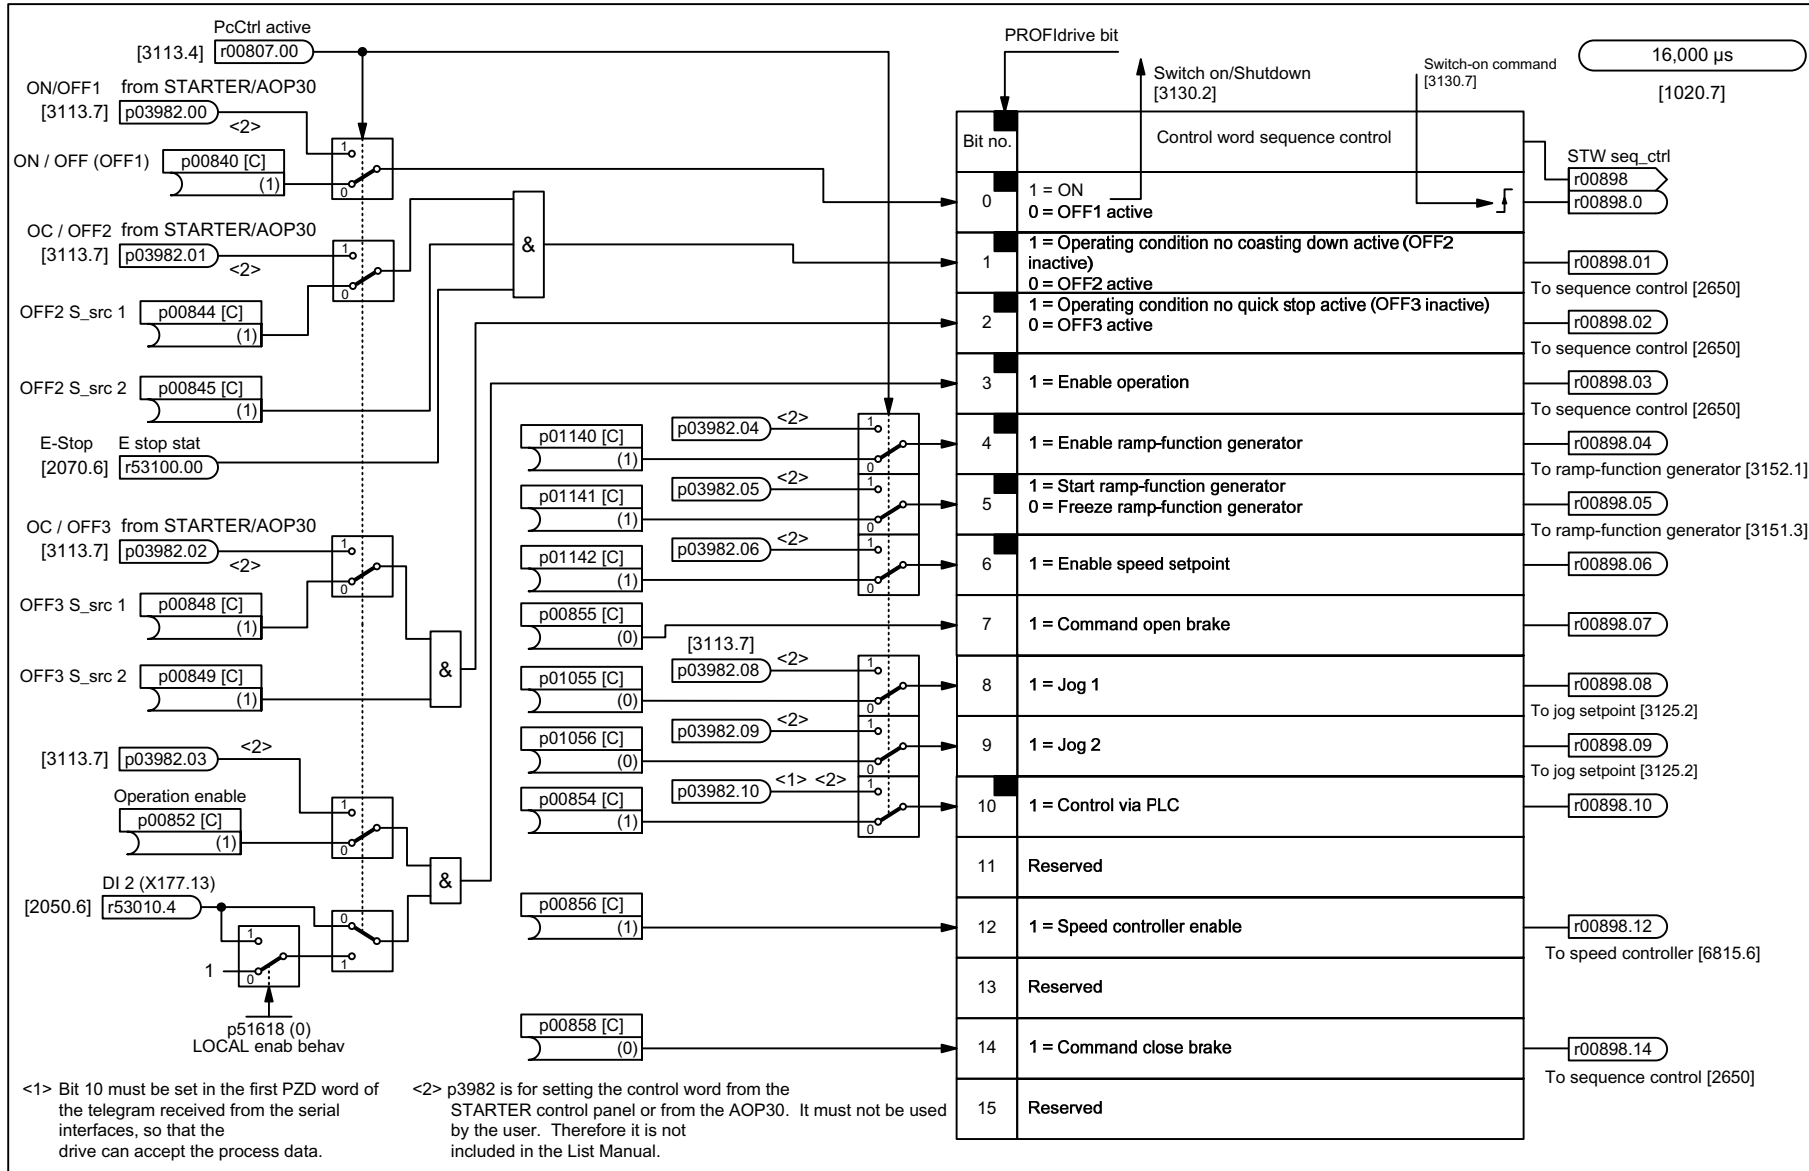2546 – Control word faults/alarms






1	2	3	4	5	6	7	8
DO: DC_CTRL				SIEMENS	fp_2580_96_VSD	Function diagram	
Internal control/status words - Control word sequence control					2013-05-14	v 1.4	SINAMICS DCM
							- 2580 -

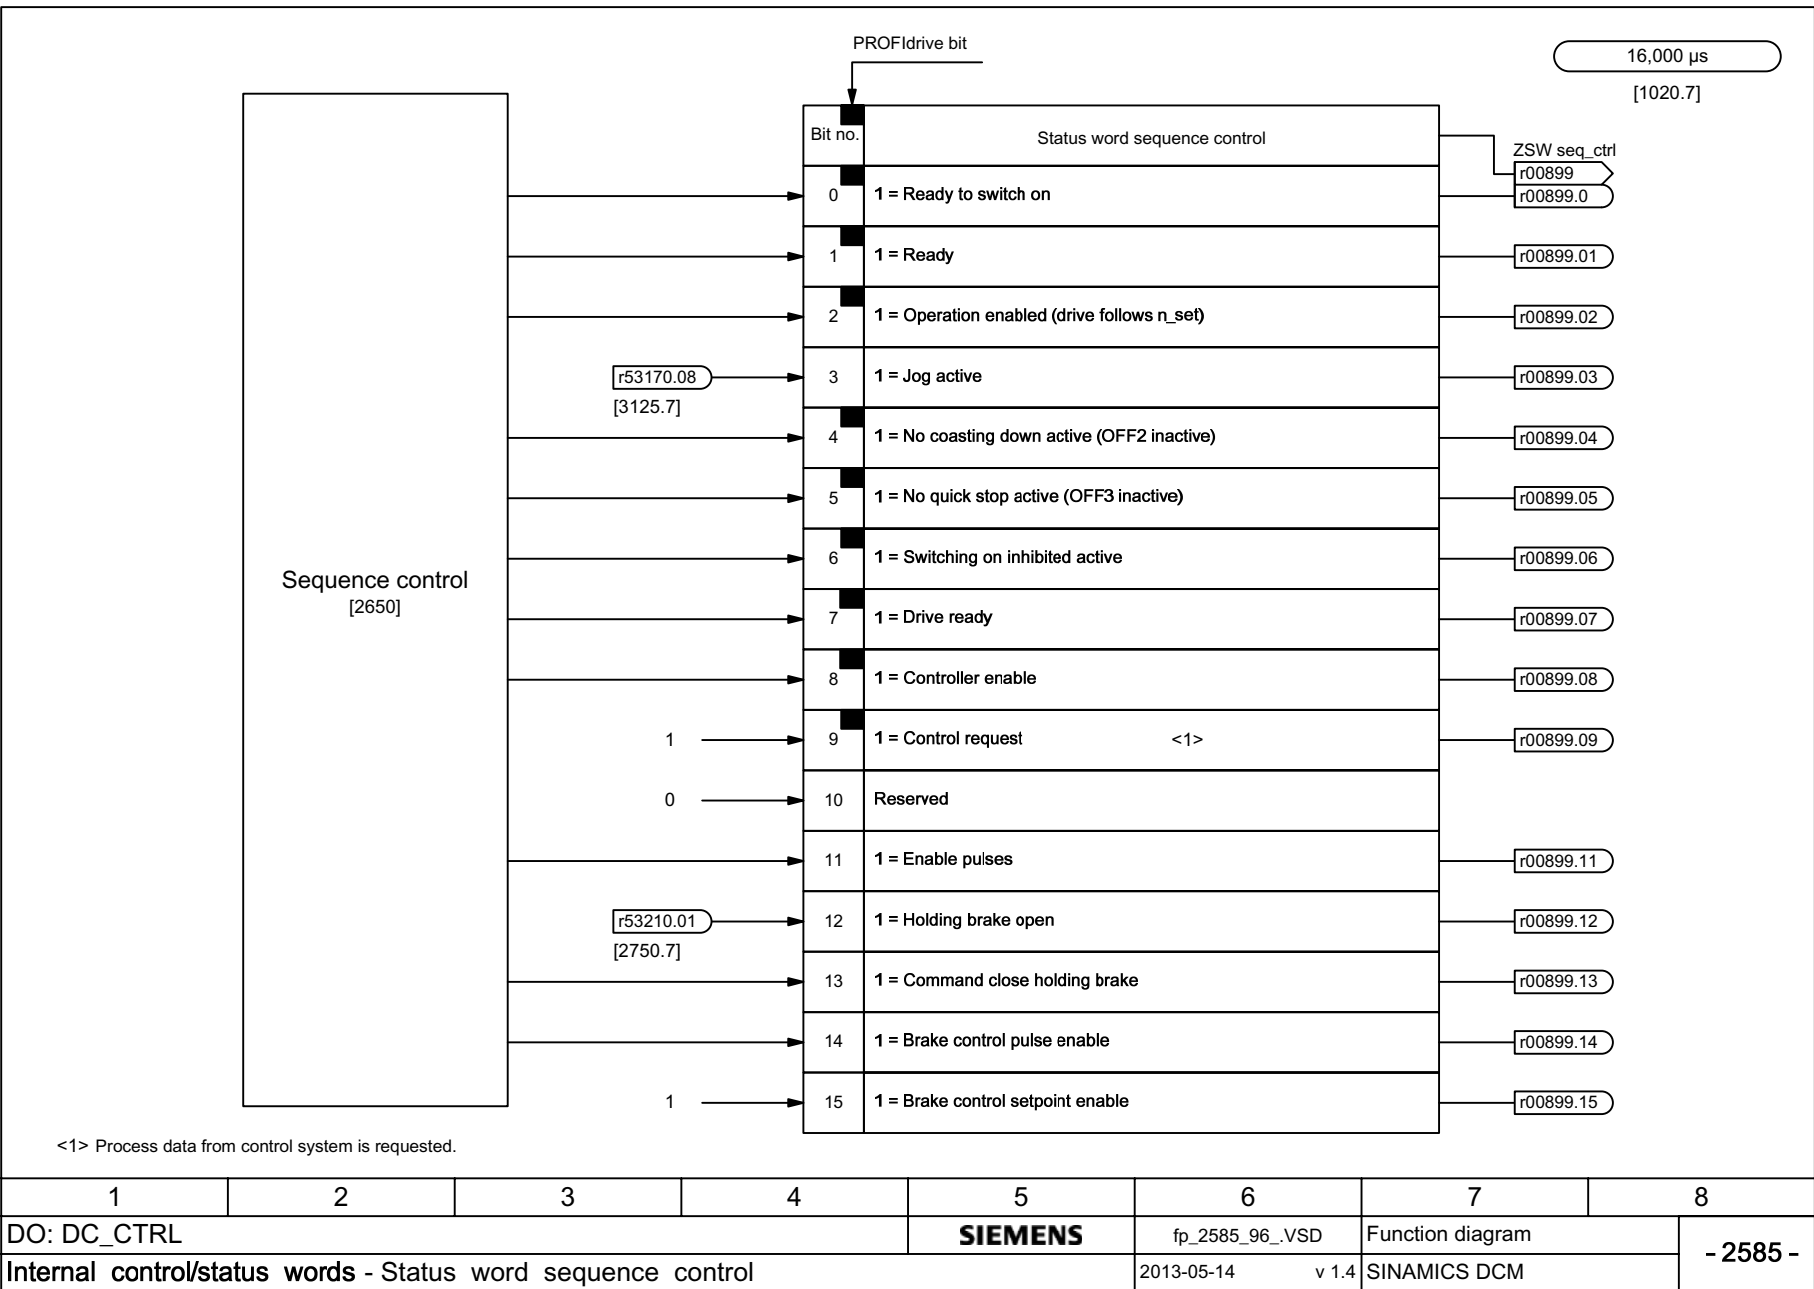Fig. 2-50 2580 – Control word sequence control





## **2.7            Sequence control**


### **Function diagrams**


---

2650 – Sequencer (Part 1)	2-723
2651 – Sequencer (Part 2)	2-724
2655 – Missing enable signals, logic operations	2-725
2660 – Optimization runs	2-726

---

Fig. 2-52 2650 – Sequencer (Part 1)

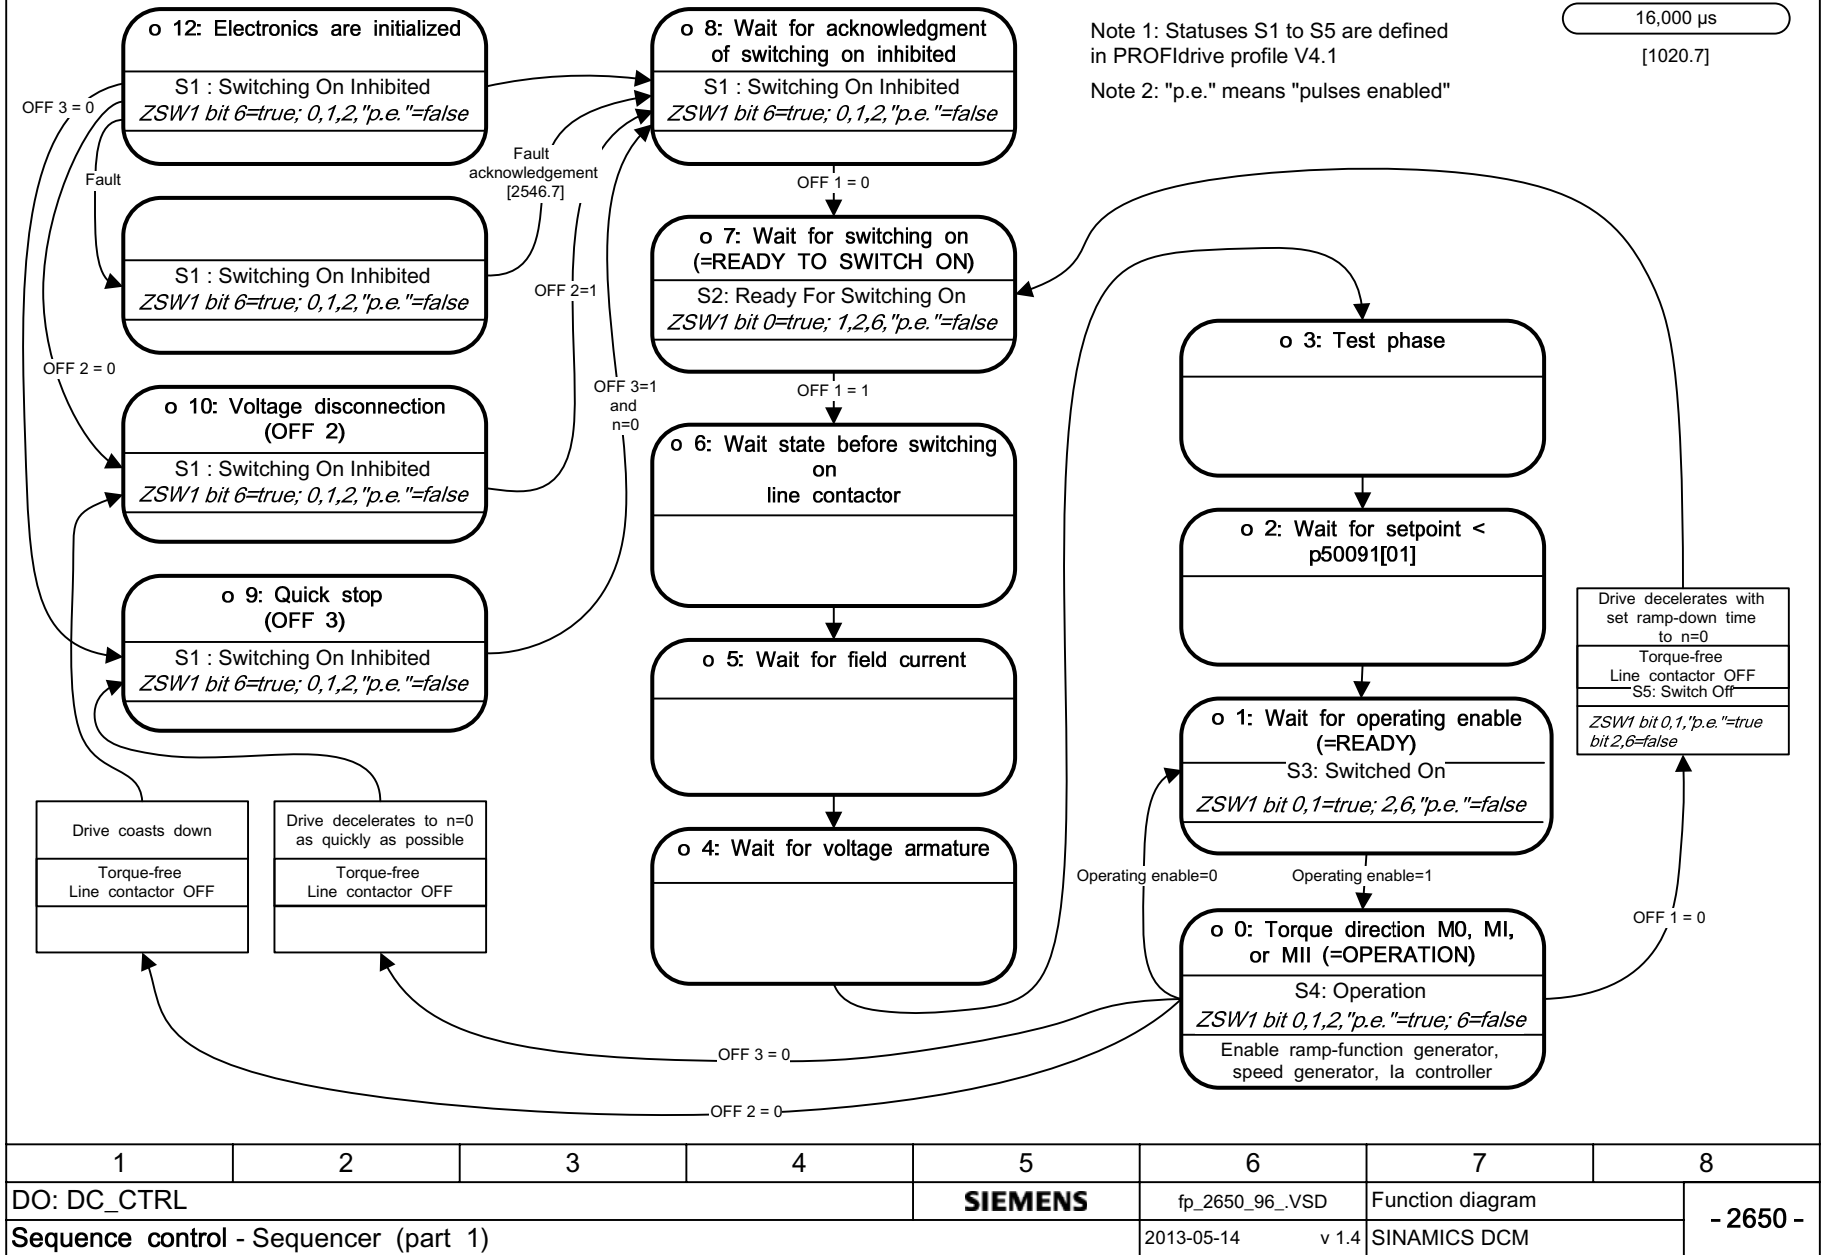

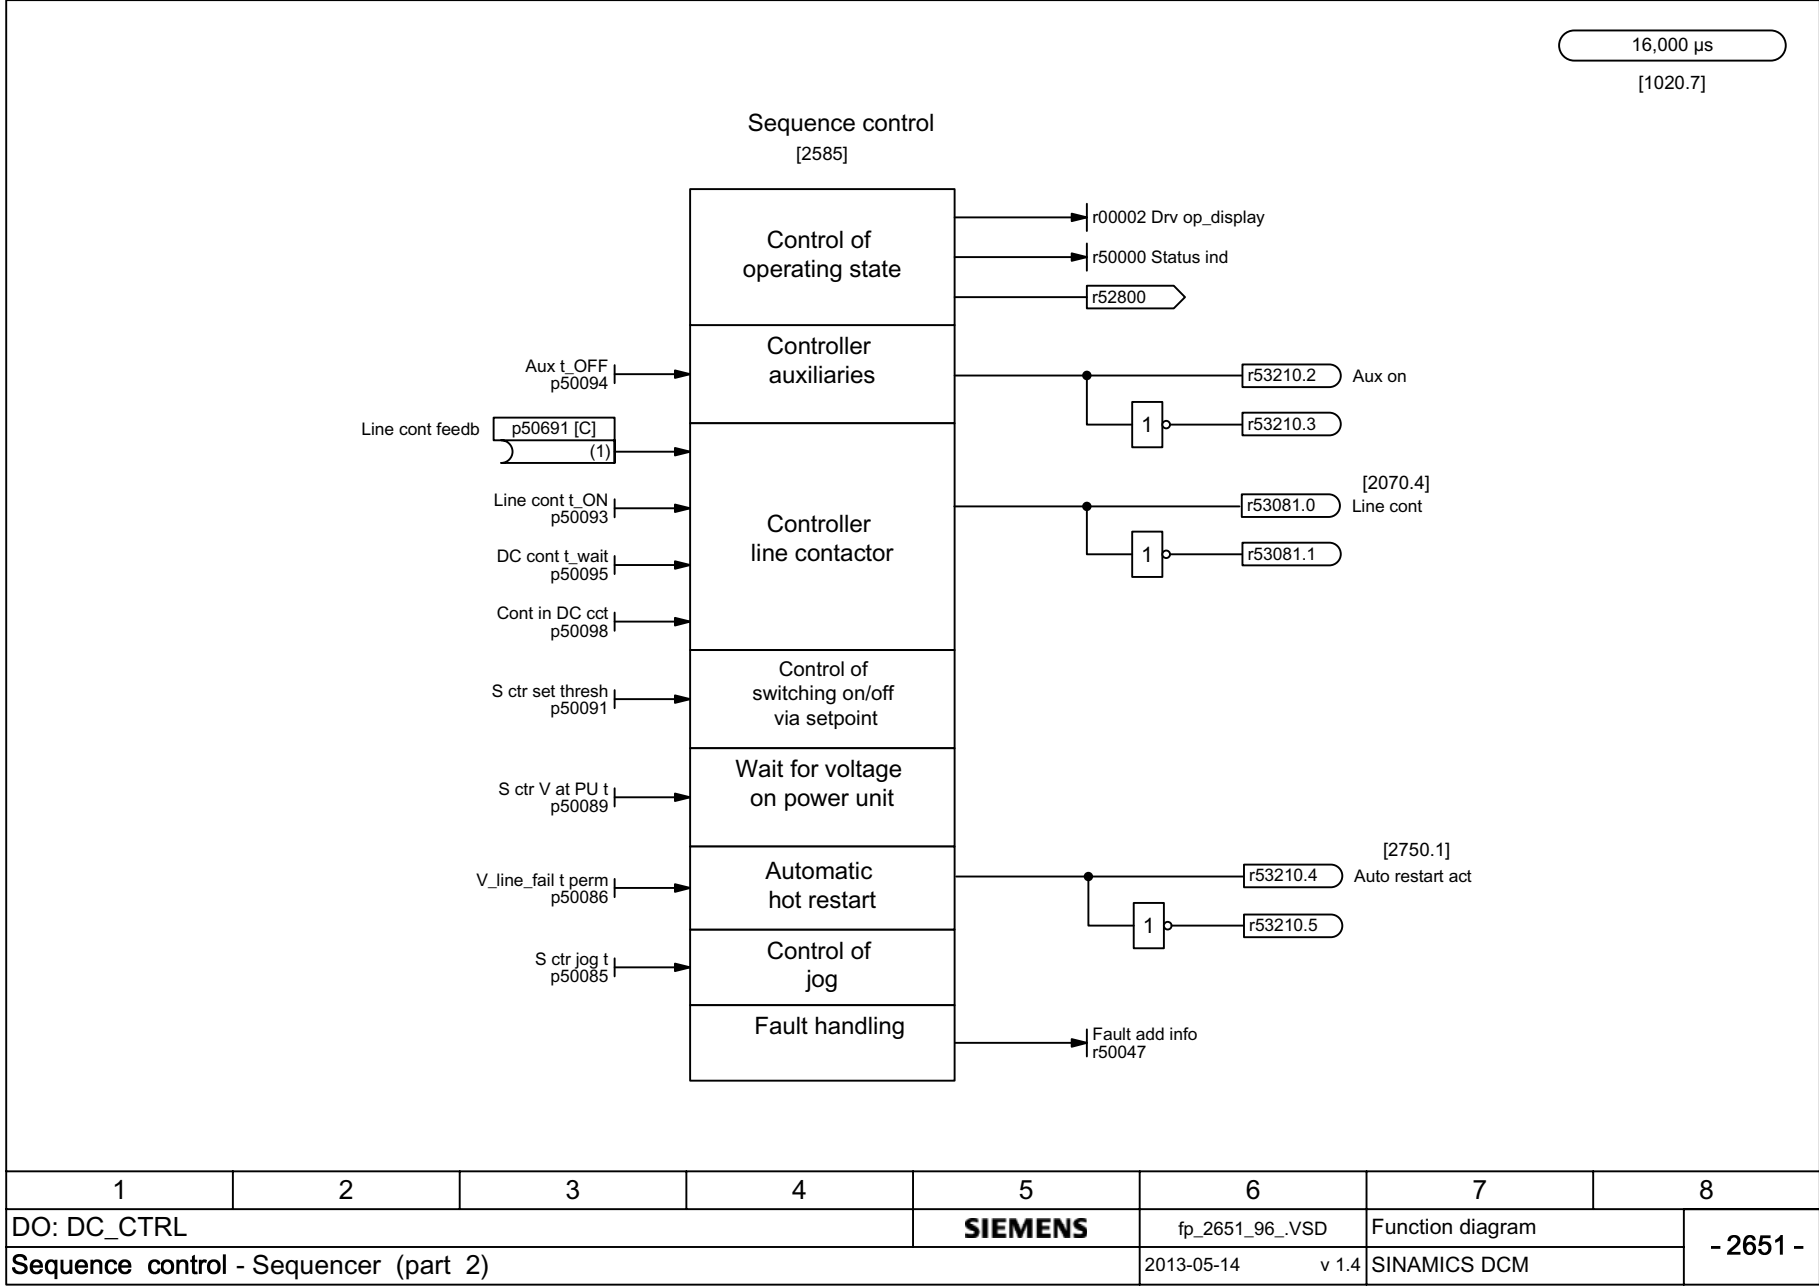

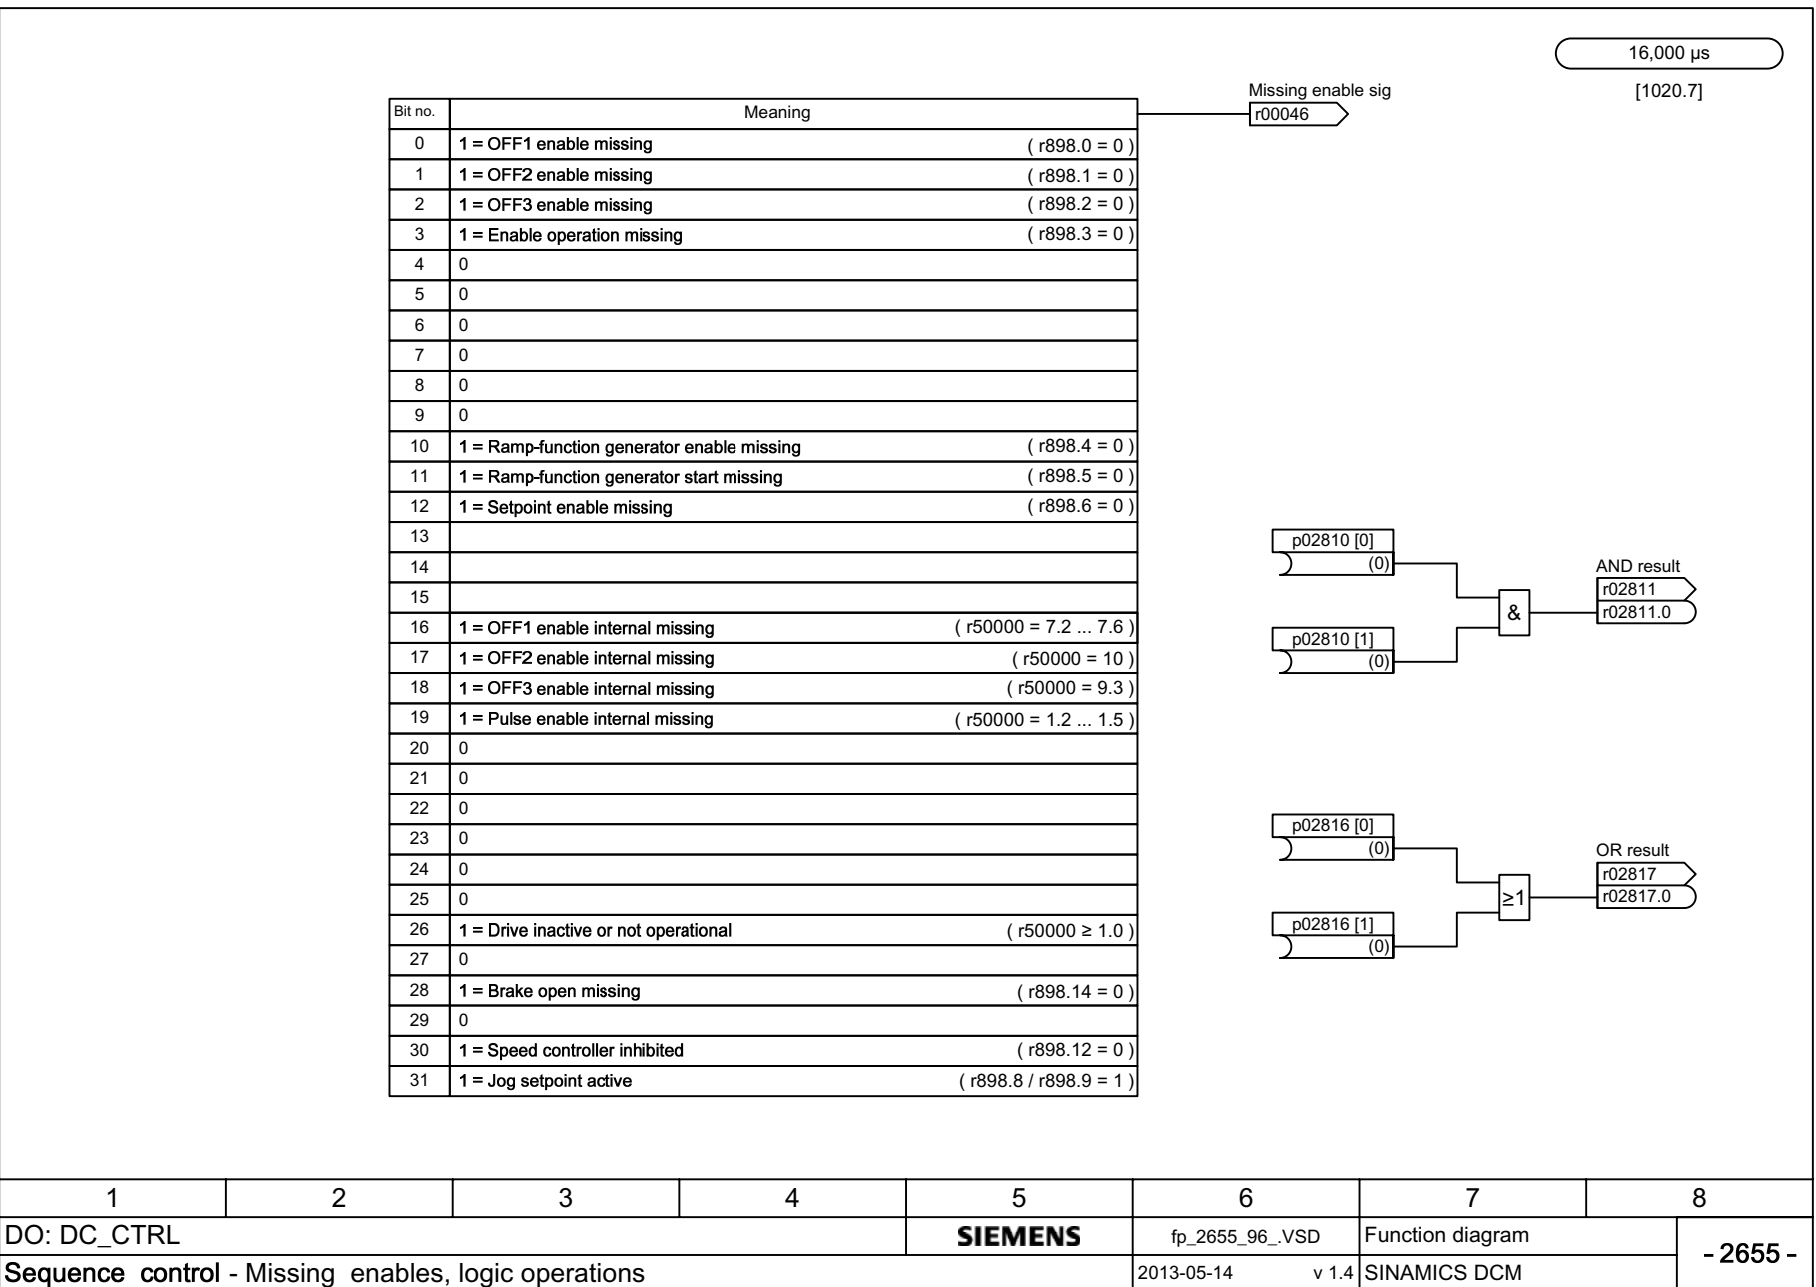


Fig. 2-54 2655 – Missing enable signals, logic operations

Background


[1020.7]

### Properties of optimization runs:

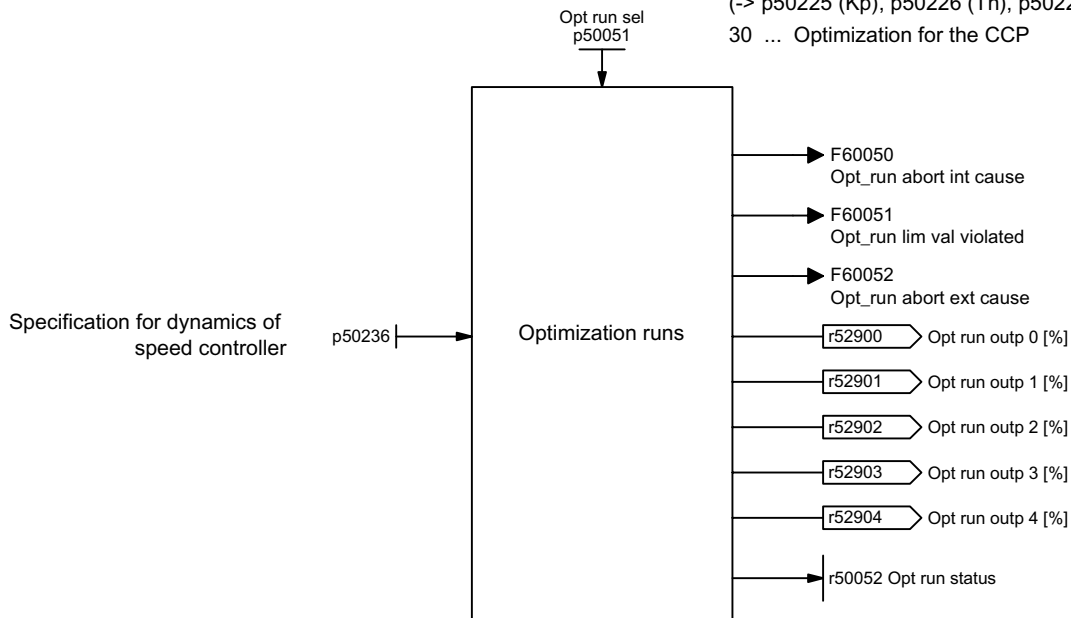- p50051 =
- 24 ... Optimization of field current regulation (duration up to 1 min)  
(-> p50112 (Rf), p50116 (Lf), p50255 (Kp), p50256 (Tn))
- 25 ... Optimization of armature current control (duration up to 1 min)  
(-> p50110 (Ra), p50111 (La), p50591 (La\_fak),  
p50594 (Ls), p50595 (Ls\_fak), p50155 (Kp), p50156 (Tn))
- 26 ... Optimization of speed control by means of step response (duration up to 1 min)  
(-> p50225 (Kp), p50226 (Tn), p50228 (T\_set,filter), p50540 (T\_accel))
- 27 ... Optimization of EMF control (incl. field characteristic recording) (duration up to 1 min)  
(-> p50117 to p50139 (field characteristic),  
p50275 (Kp), p50276 (Tn))
- 28 ... Optimization of compensation of friction (duration up to 1 min)  
(-> p50520 to 50530 (friction characteristic)) from V1.2
- 29 ... Optimization of closed-loop speed control for drives with a mechanical system  
capable of oscillation (time up to 10 min)  
(-> p50225 (Kp), p50226 (Tn), p50228 (T\_set,filter), p50540 (T\_accel))
- 30 ... Optimization for the CCP

### Carry out an optimization run:

- 1) Select required optimization run using p50051
- 2) Switch on drive (OFF1 0->1, not relevant for p50051 = 30)
- 3) Wait until optimization run is finished  
(drive enters state o8 of its own accord)
- 4) Check whether the results of the optimization run are viable



1	2	3	4	5	6	7	8
DO: DC_CTRL				SIEMENS	fp_2660_96_VSD	Function diagram	
Sequence control - Optimization runs					2013-05-14 v 1.4	SINAMICS DCM	
							- 2660 -

Fig. 2-55 2660 – Optimization runs

## 2.8 Brake control

### Function diagrams

---

2750 – Brake control

2-728

---

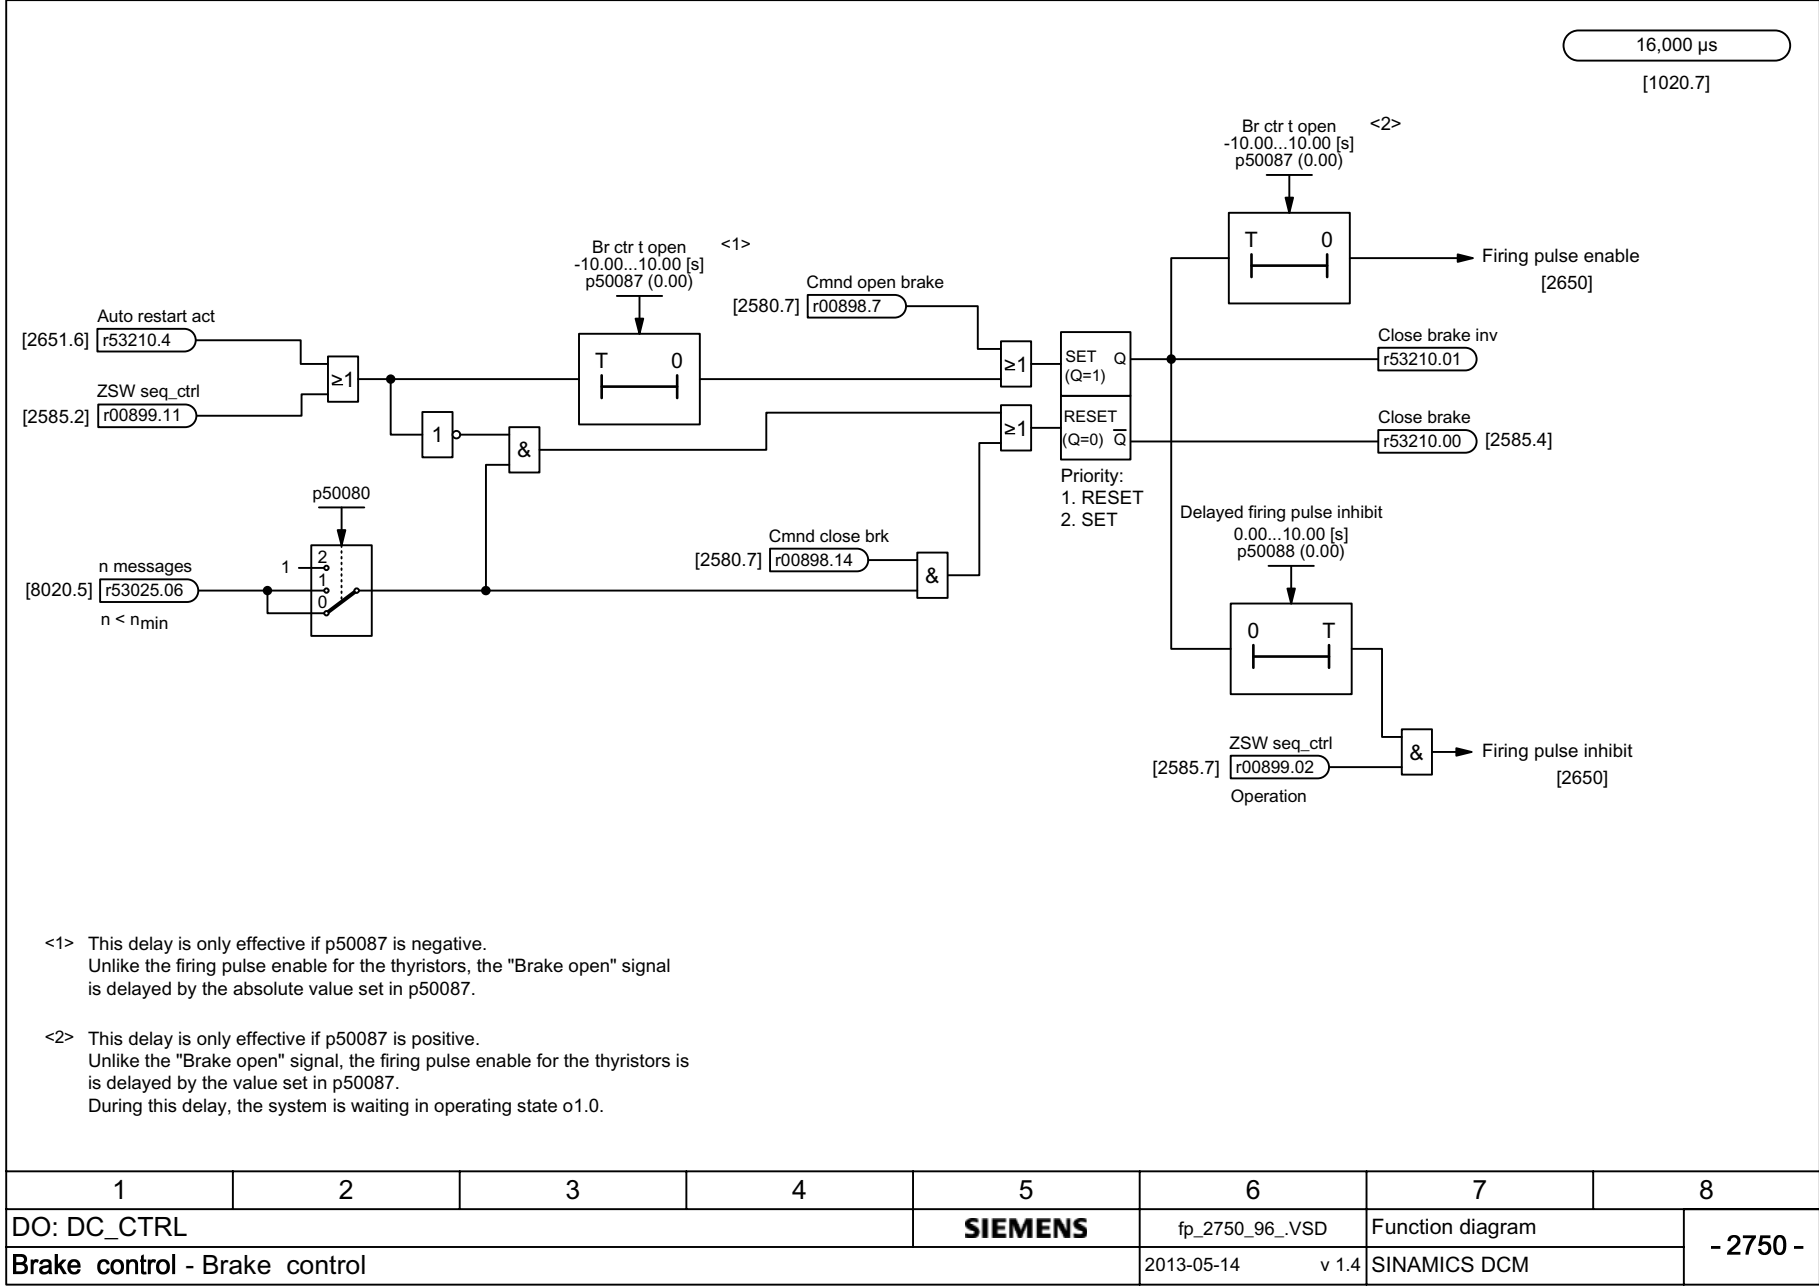


Fig. 2-56 2750 – Brake control



## 2.9 Setpoint channel

### Function diagrams

3100 – Fixed values	2-730
3105 – 4-stage joystick switch	2-731
3110 – Motorized potentiometer	2-732
3113 – AOP30 display and control unit	2-733
3115 – Fixed setpoint	2-734
3120 – Oscillation/square-wave generator	2-735
3125 – Jog setpoint	2-736
3130 – Creep setpoint	2-737
3135 – Setpoint processing	2-738
3150 – Ramp-function generator (Part 1)	2-739
3151 – Ramp-function generator (Part 2)	2-740
3152 – Ramp-function generator (Part 3)	2-741
3155 – Limitation after ramp-function generator	2-742

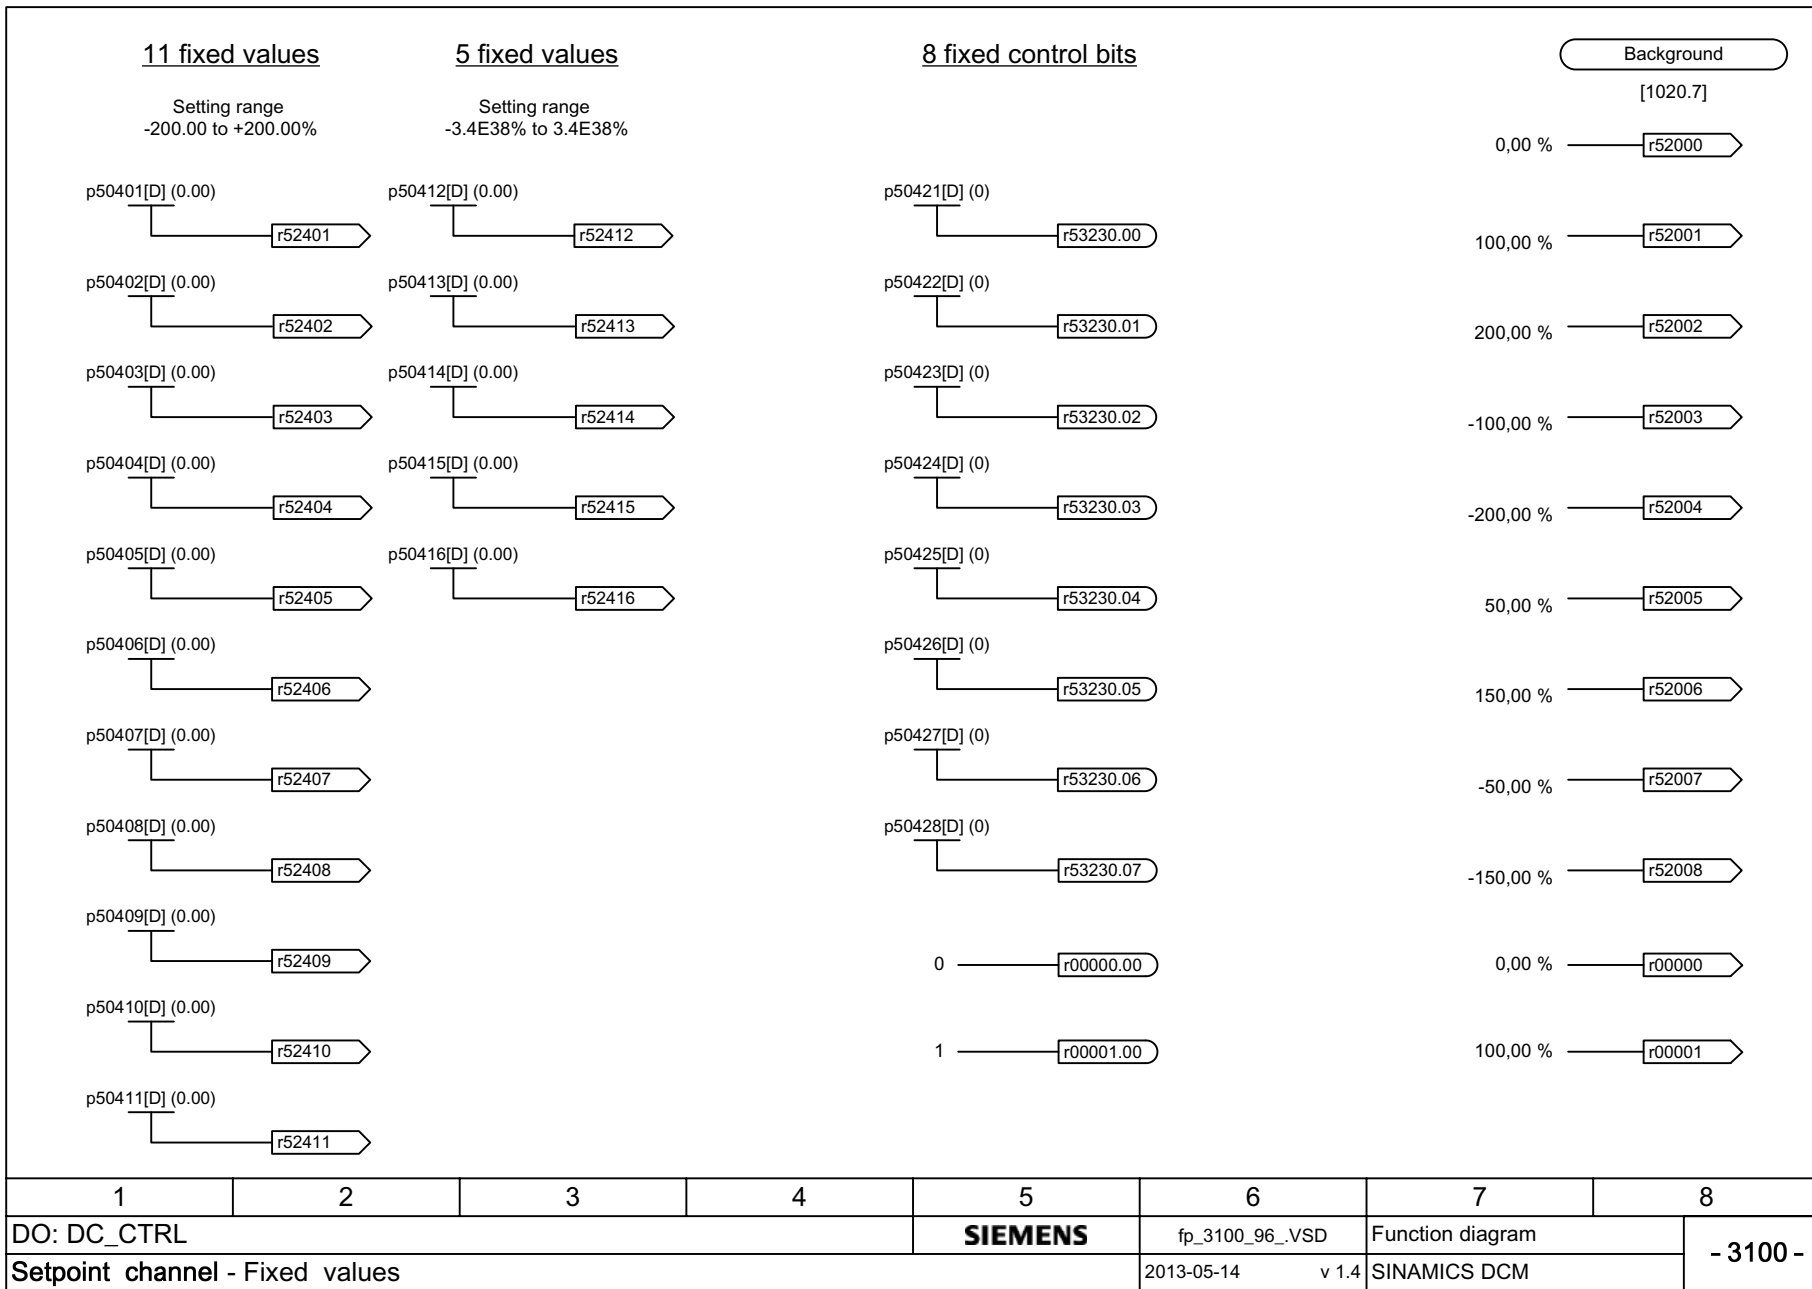


Fig. 2-57

3100 – Fixed values

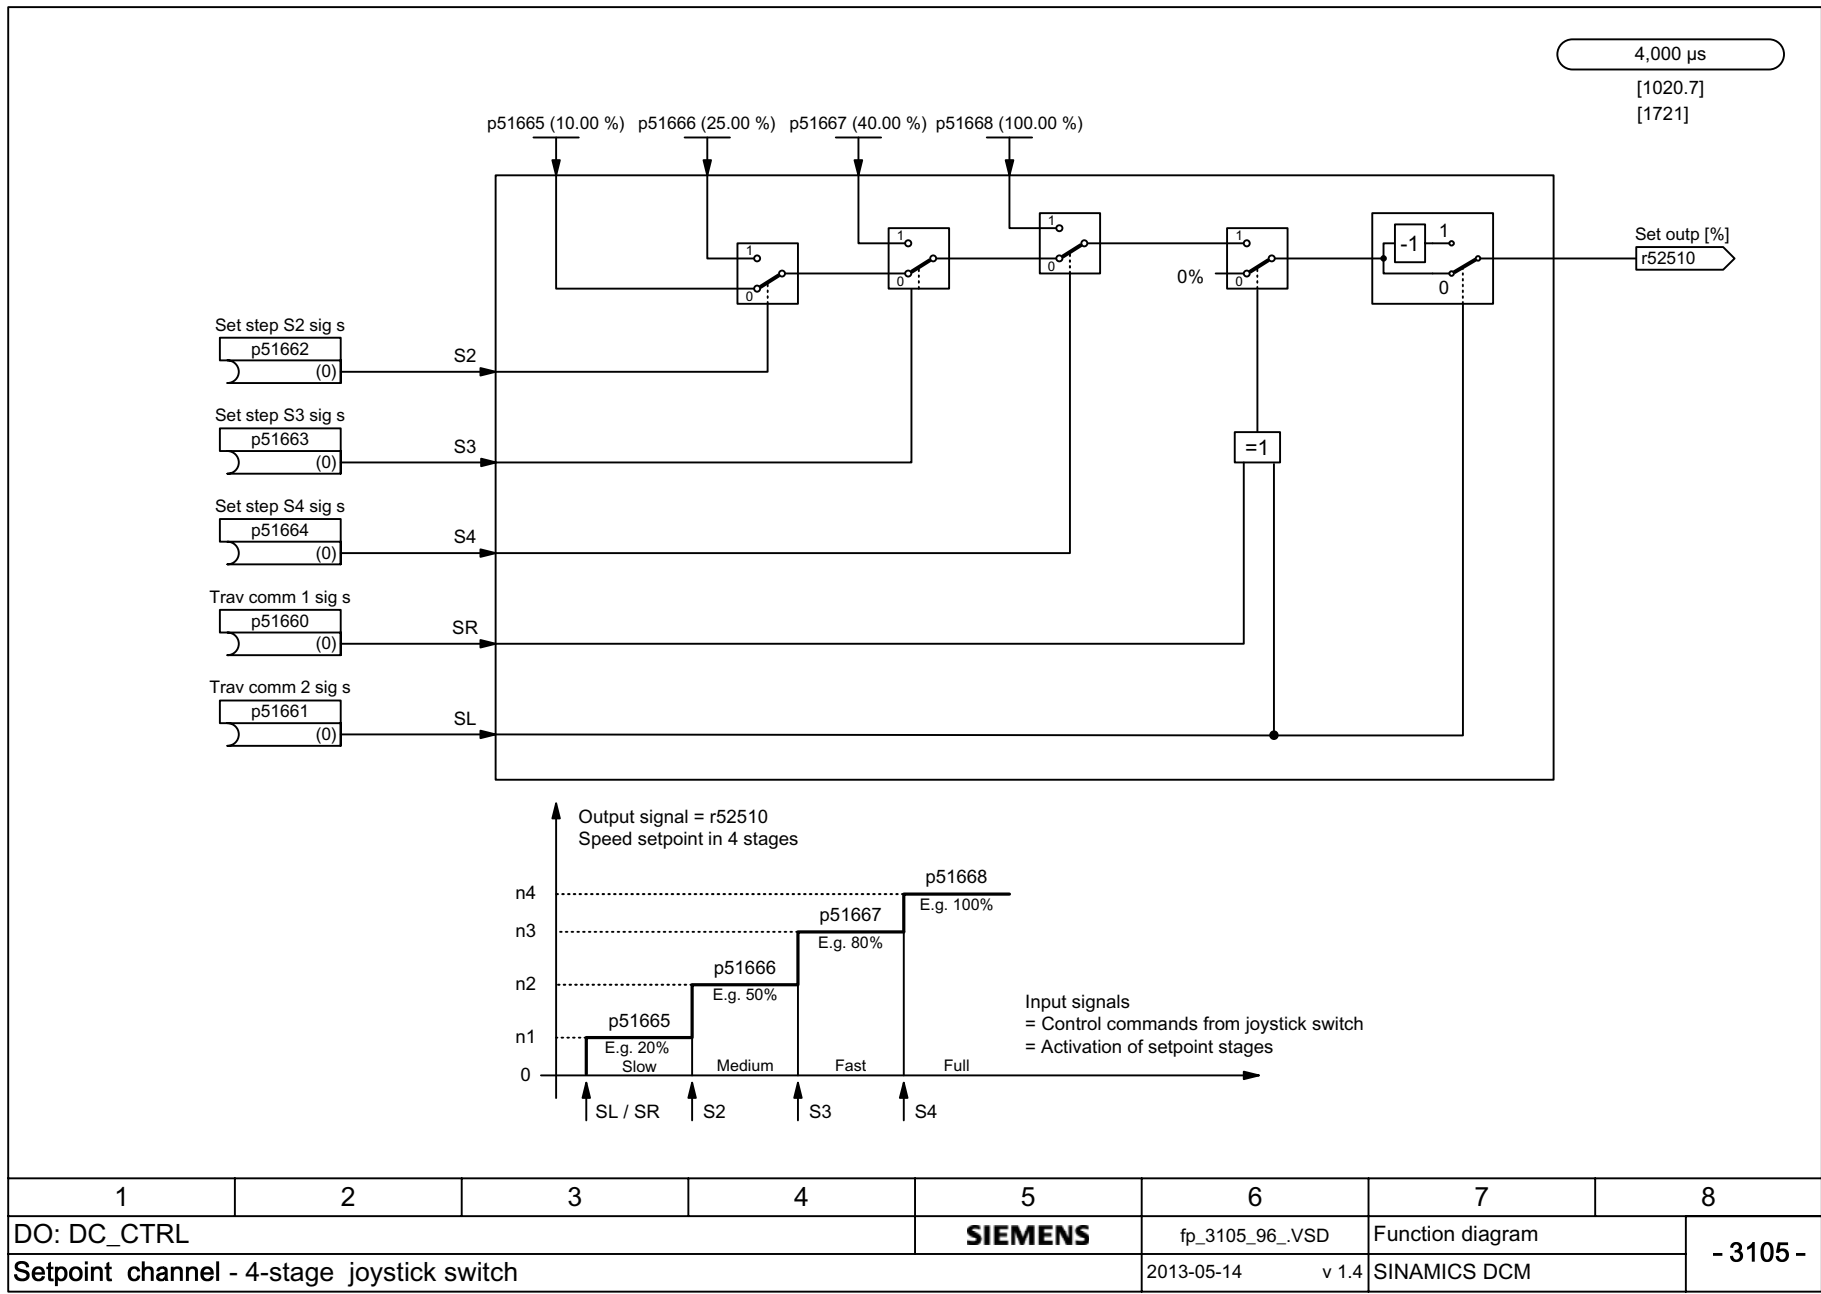


Fig. 2-58 3105 – 4-stage joystick switch

1	2	3	4	5	6	7	8
DO: DC_CTRL				<b>SIEMENS</b>	fp_3105_96_VSD	Function diagram	
Setpoint channel - 4-stage joystick switch					2013-05-14 v 1.4	SINAMICS DCM	
							- 3105 -

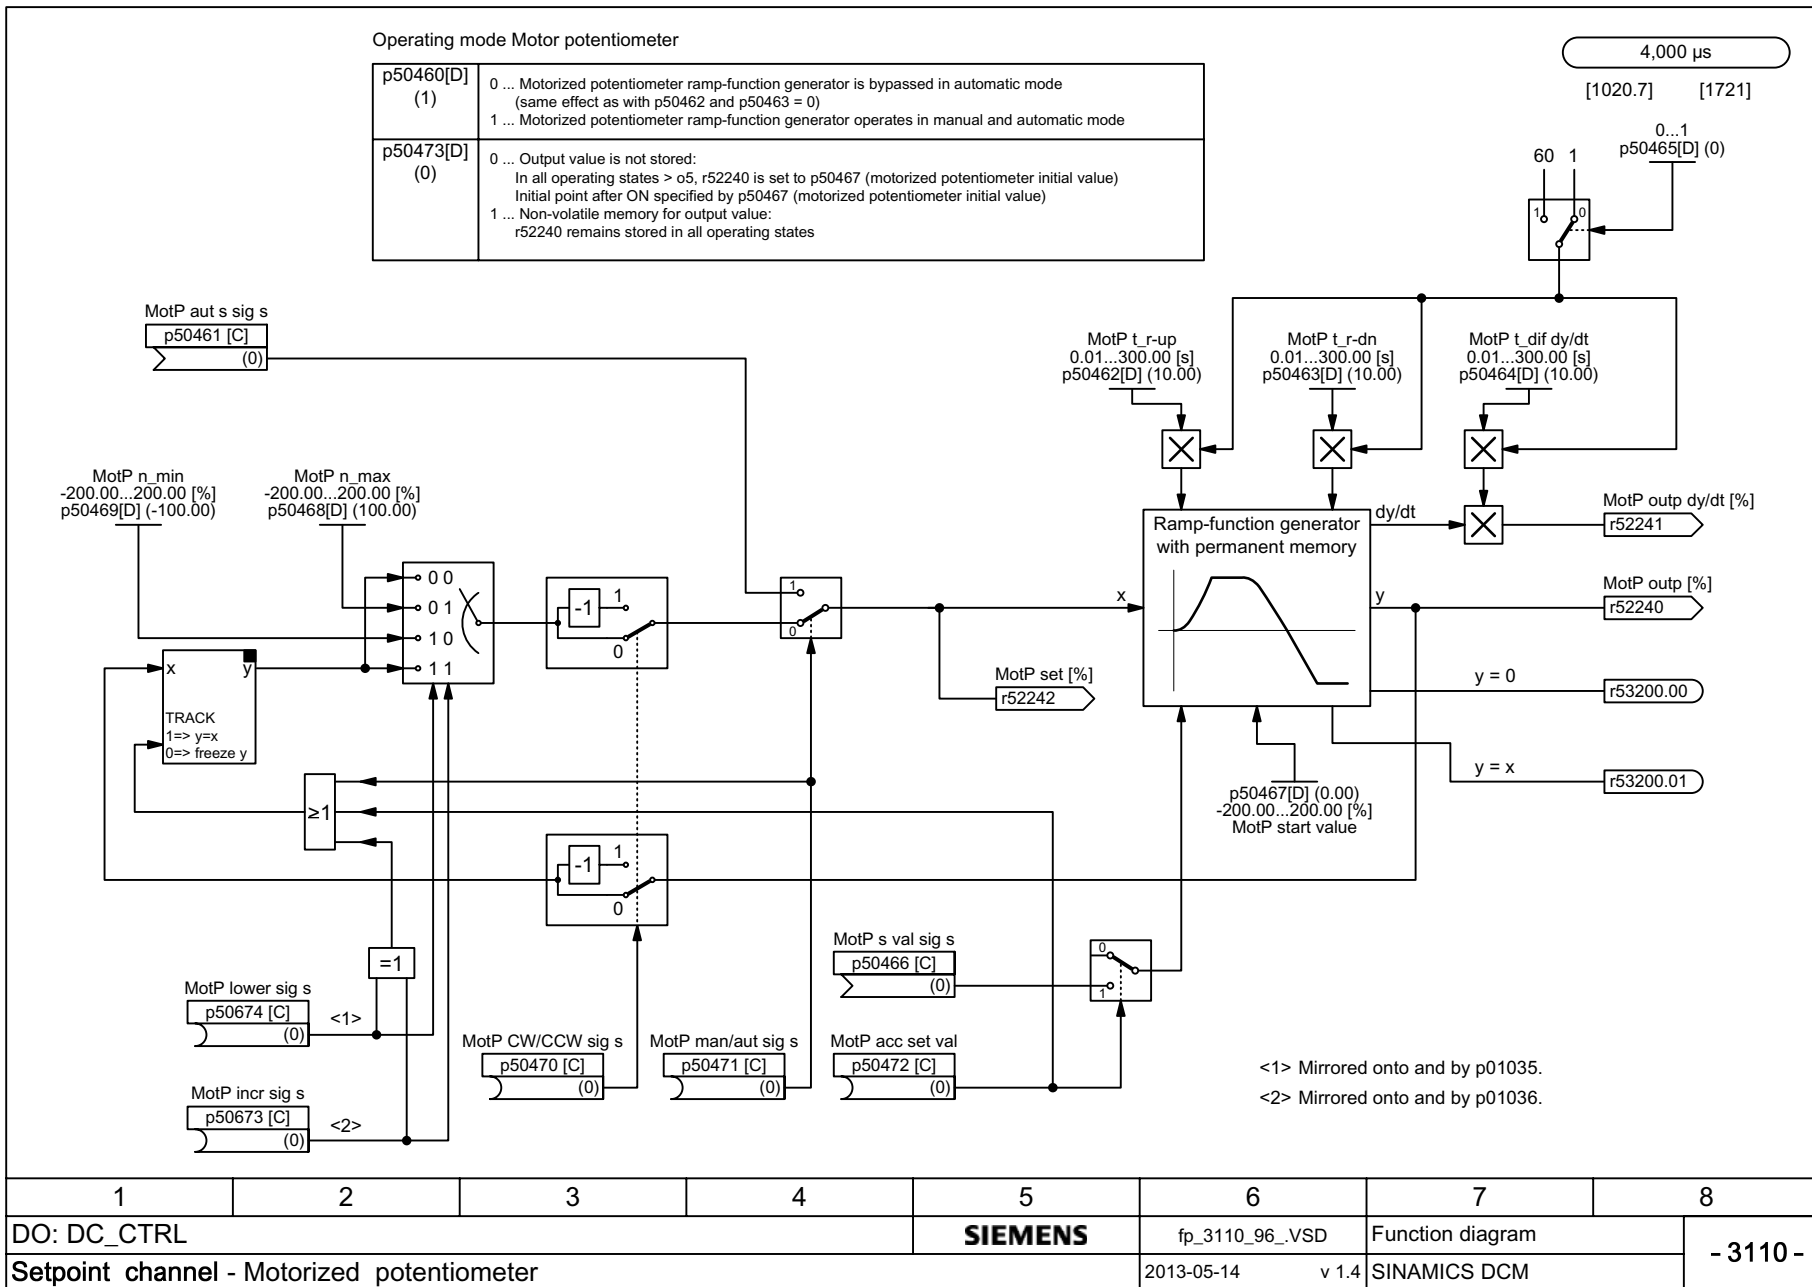


Fig. 2-59 3110 – Motorized potentiometer

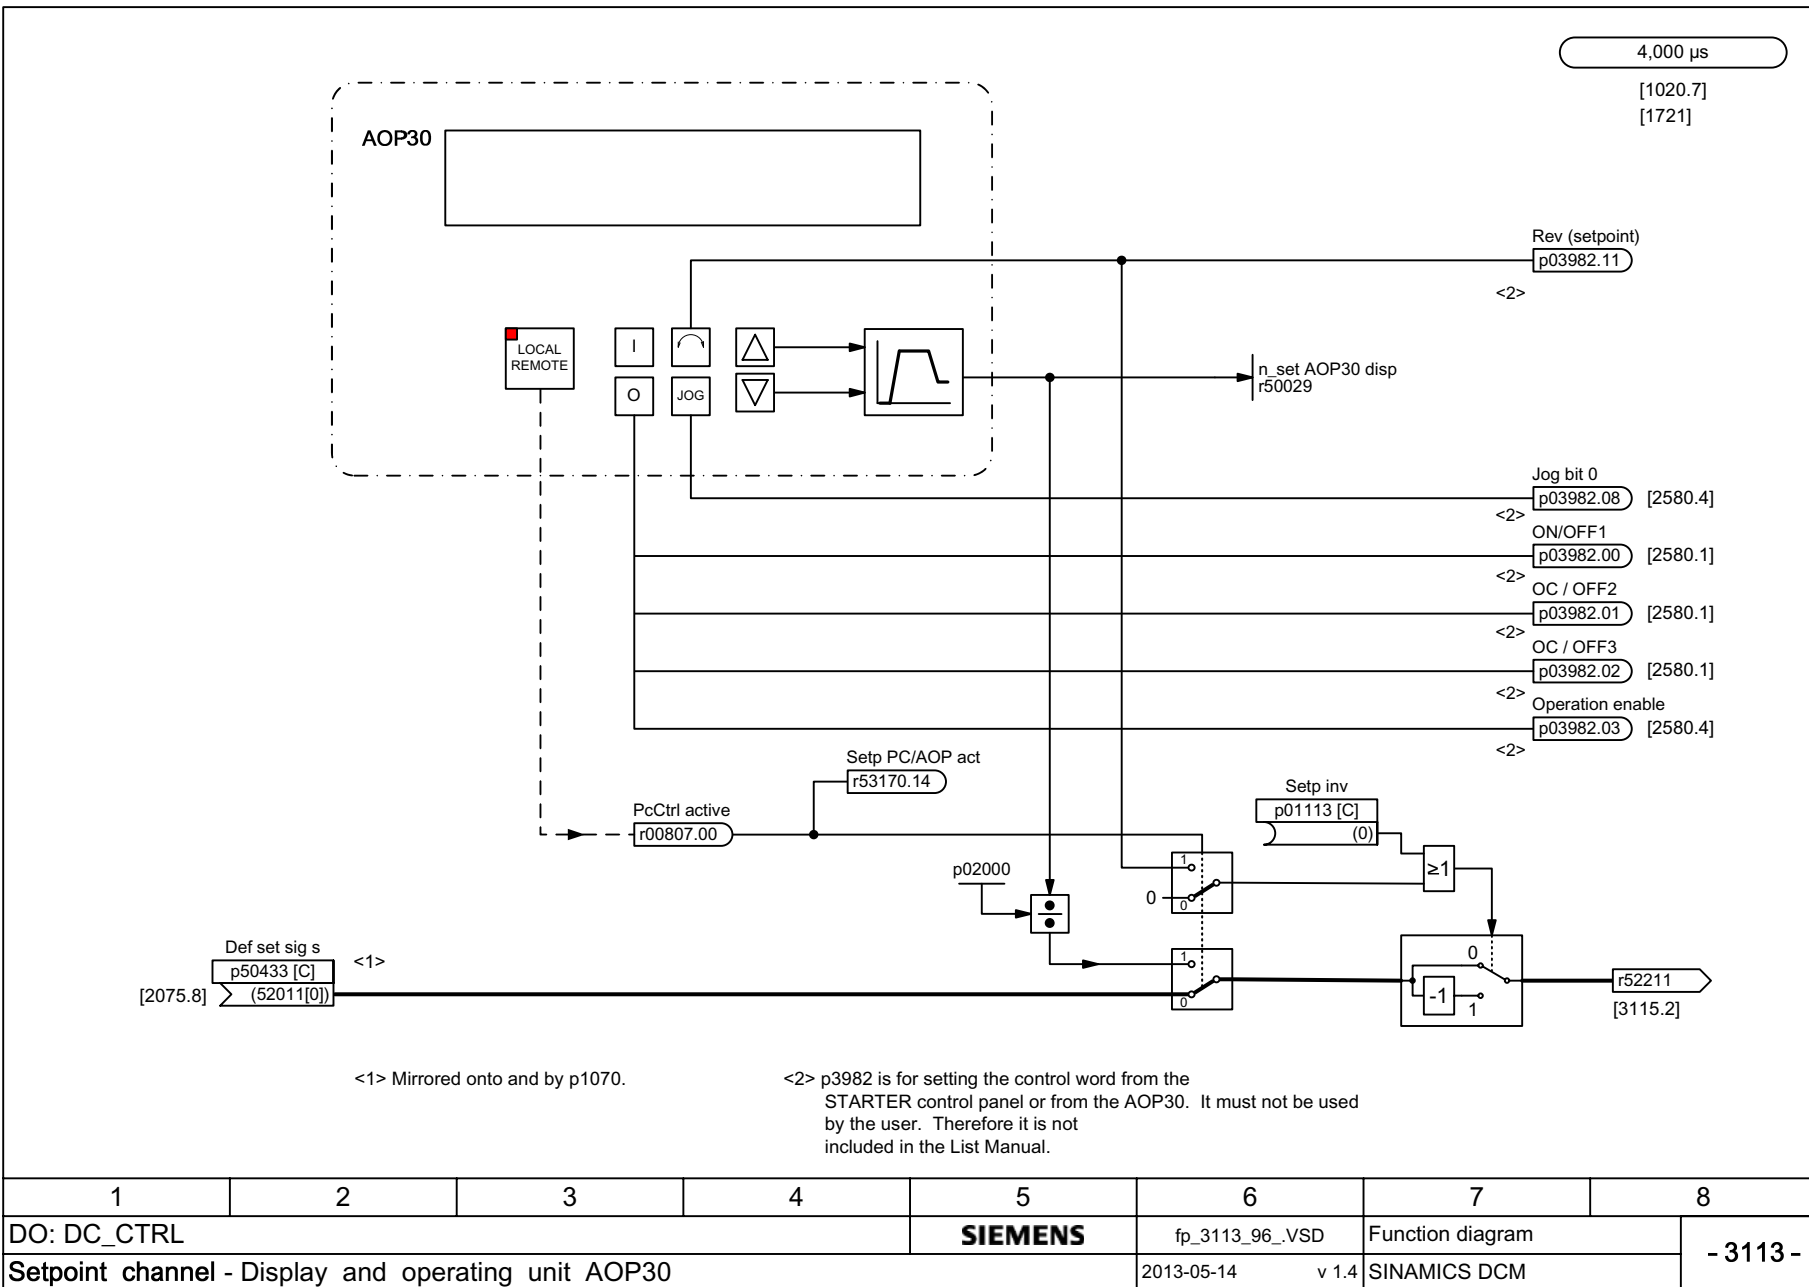


Fig. 2-60 3113 – AOP30 display and control unit

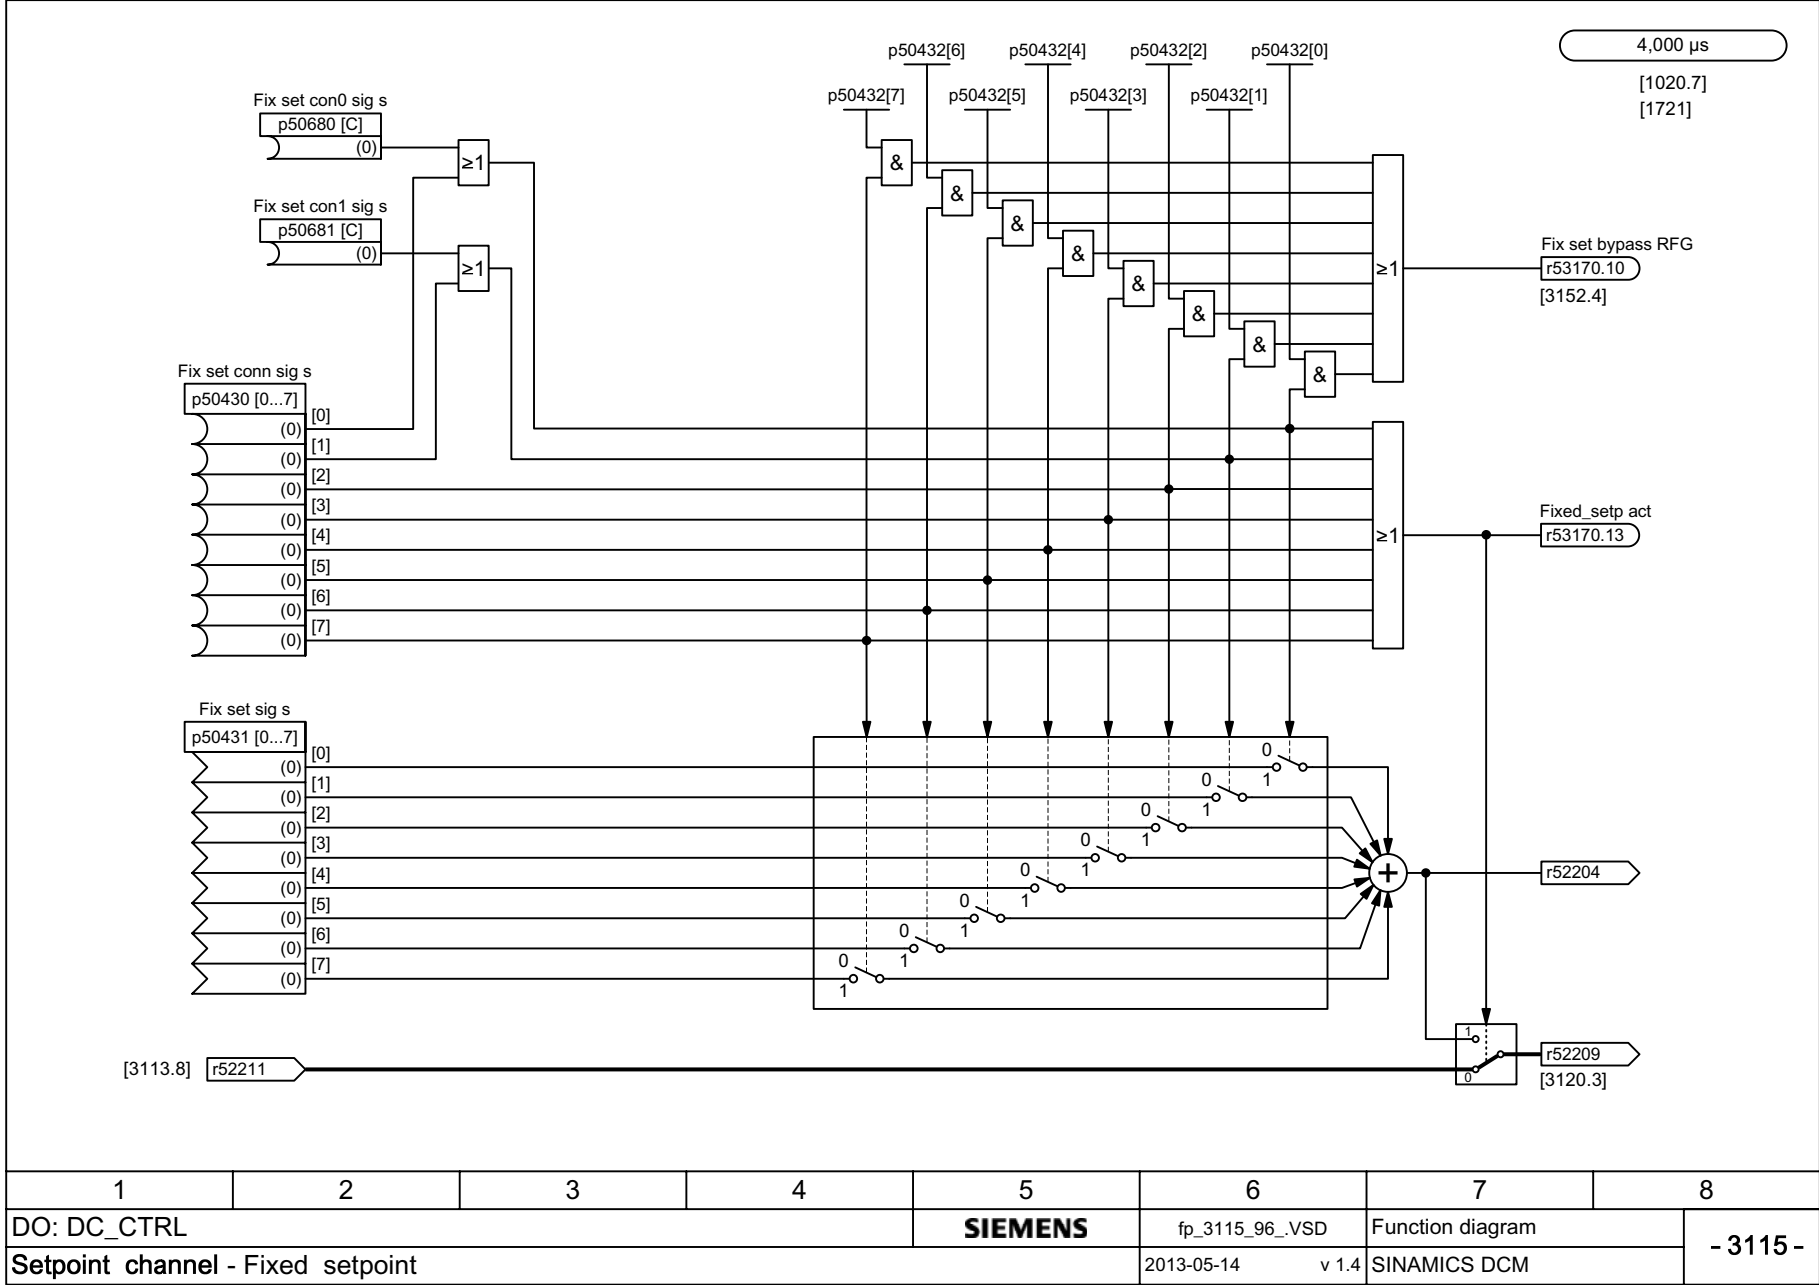


Fig. 2-61 3115 – Fixed setpoint


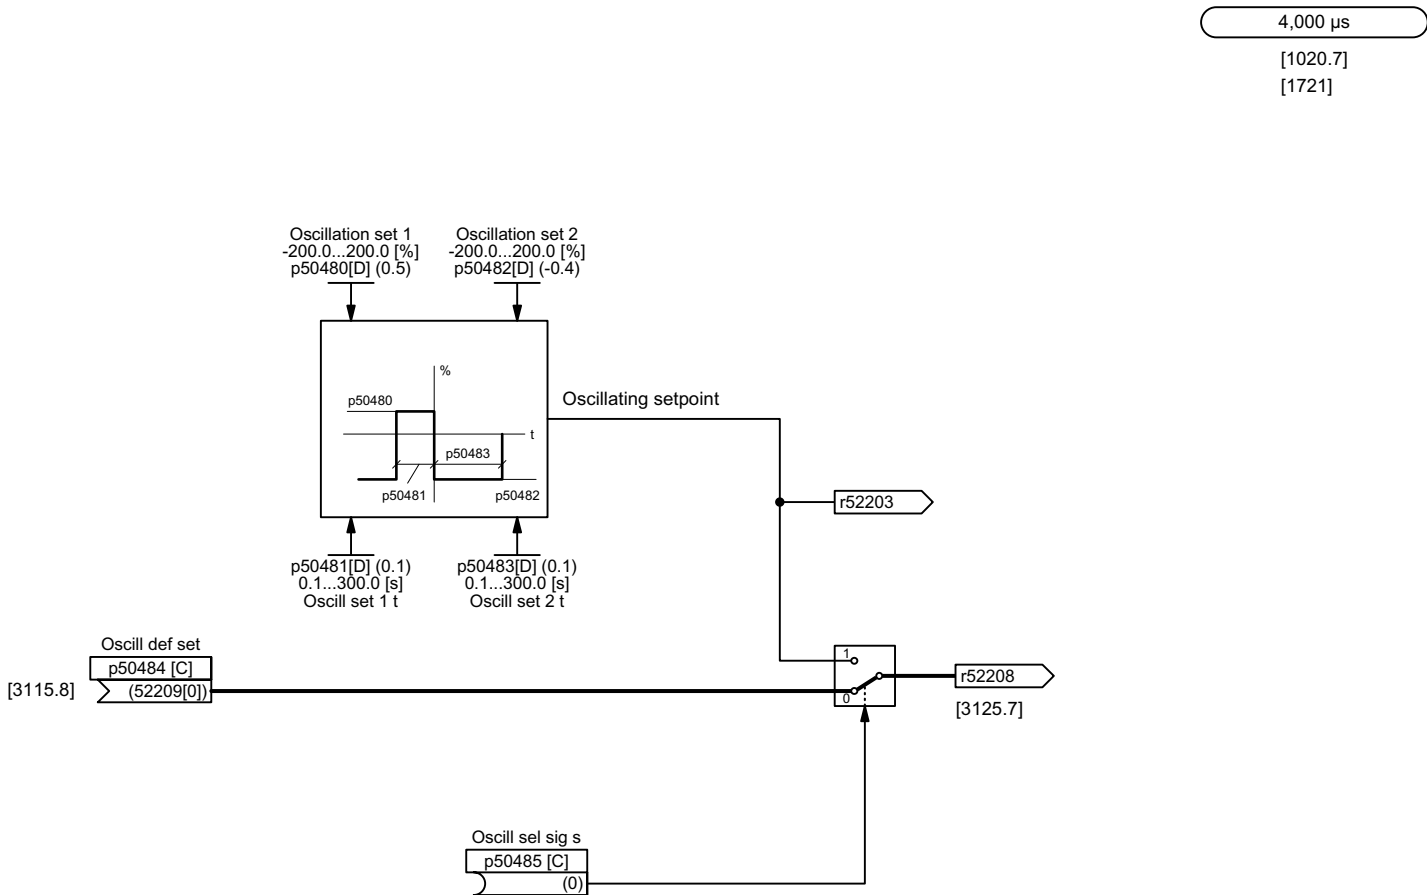


Fig. 2-62


1	2	3	4	5	6	7	8
DO: DC_CTRL				SIEMENS	fp_3120_96_VSD	Function diagram	
Setpoint channel - Oscillation/square-wave generator					2013-05-14 v 1.4	SINAMICS DCM	
- 3120 -							

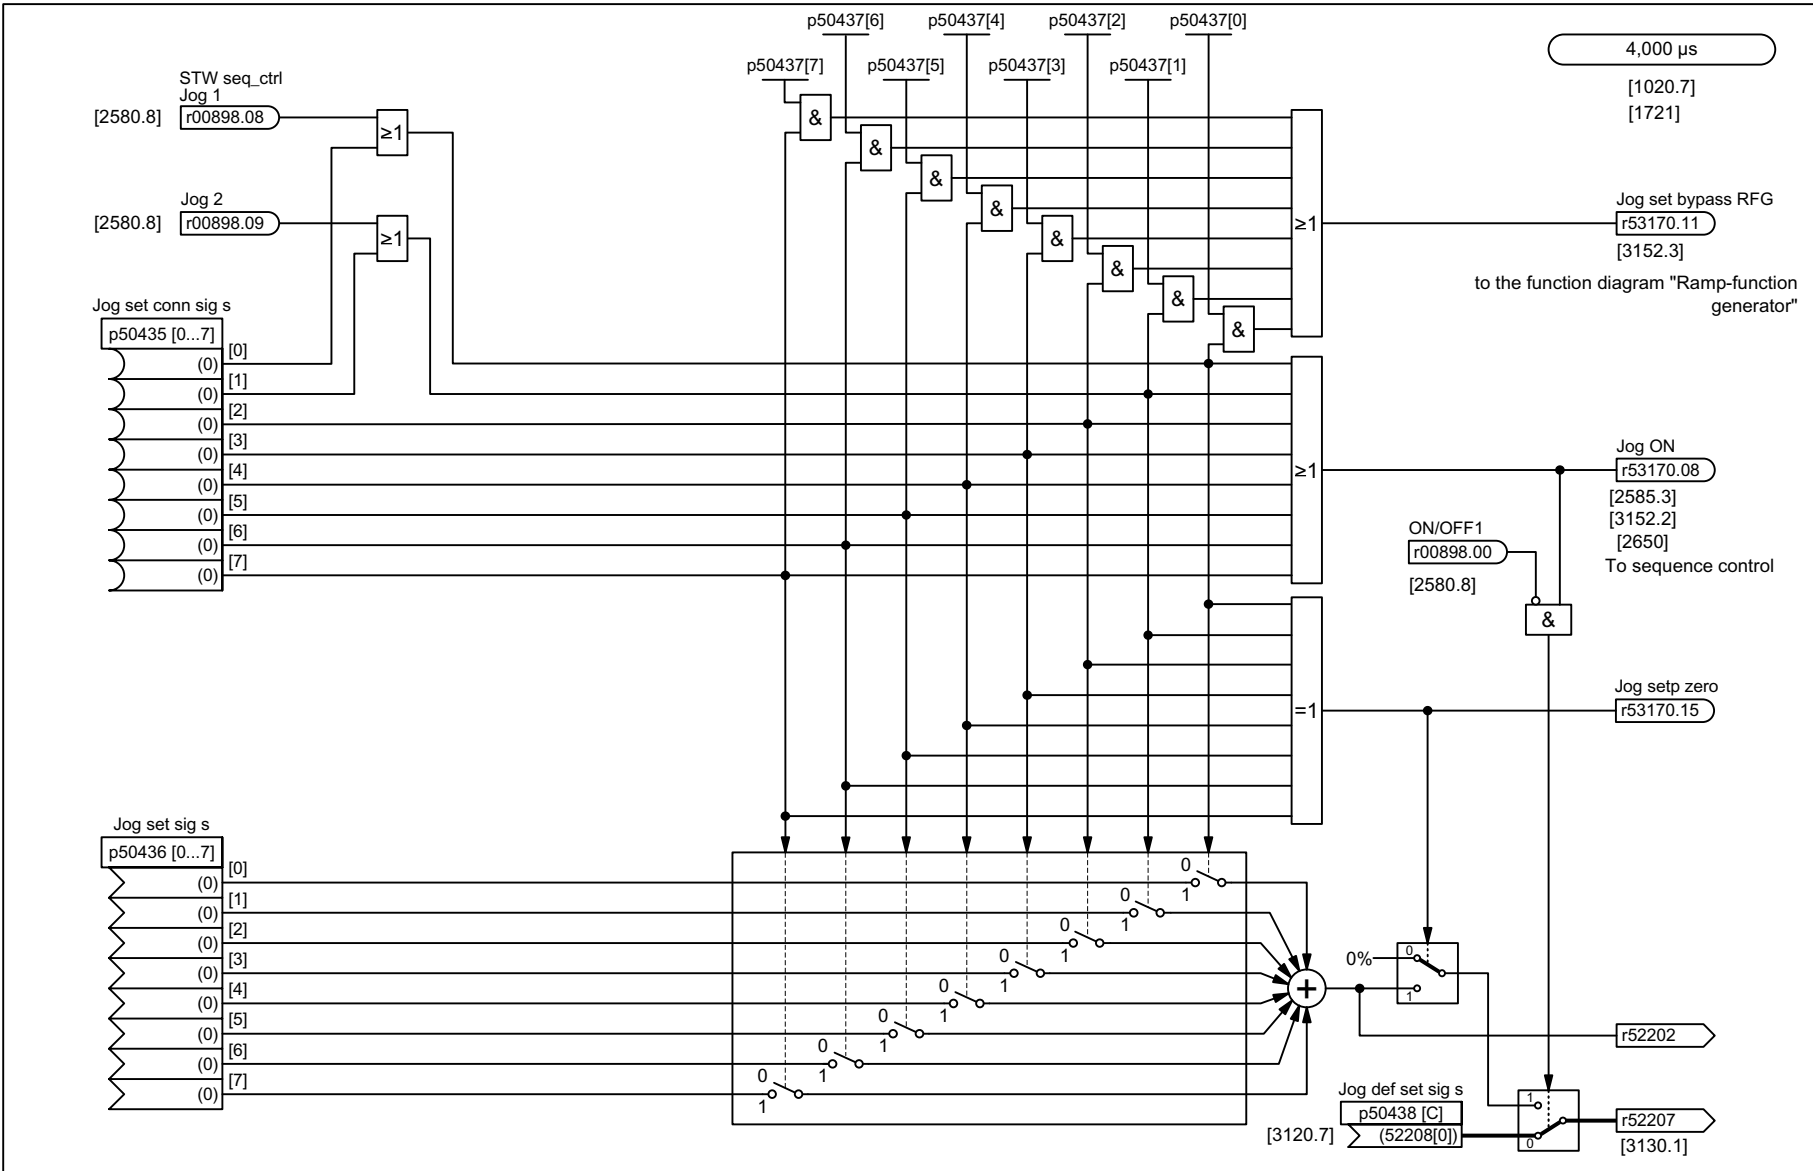


1	2	3	4	5	6	7	8
DO: DC_CTRL				<b>SIEMENS</b>	fp_3125_96_VSD	Function diagram	
Setpoint channel - Jog setpoint					2013-05-14 v 1.4	SINAMICS DCM	
							- 3125 -

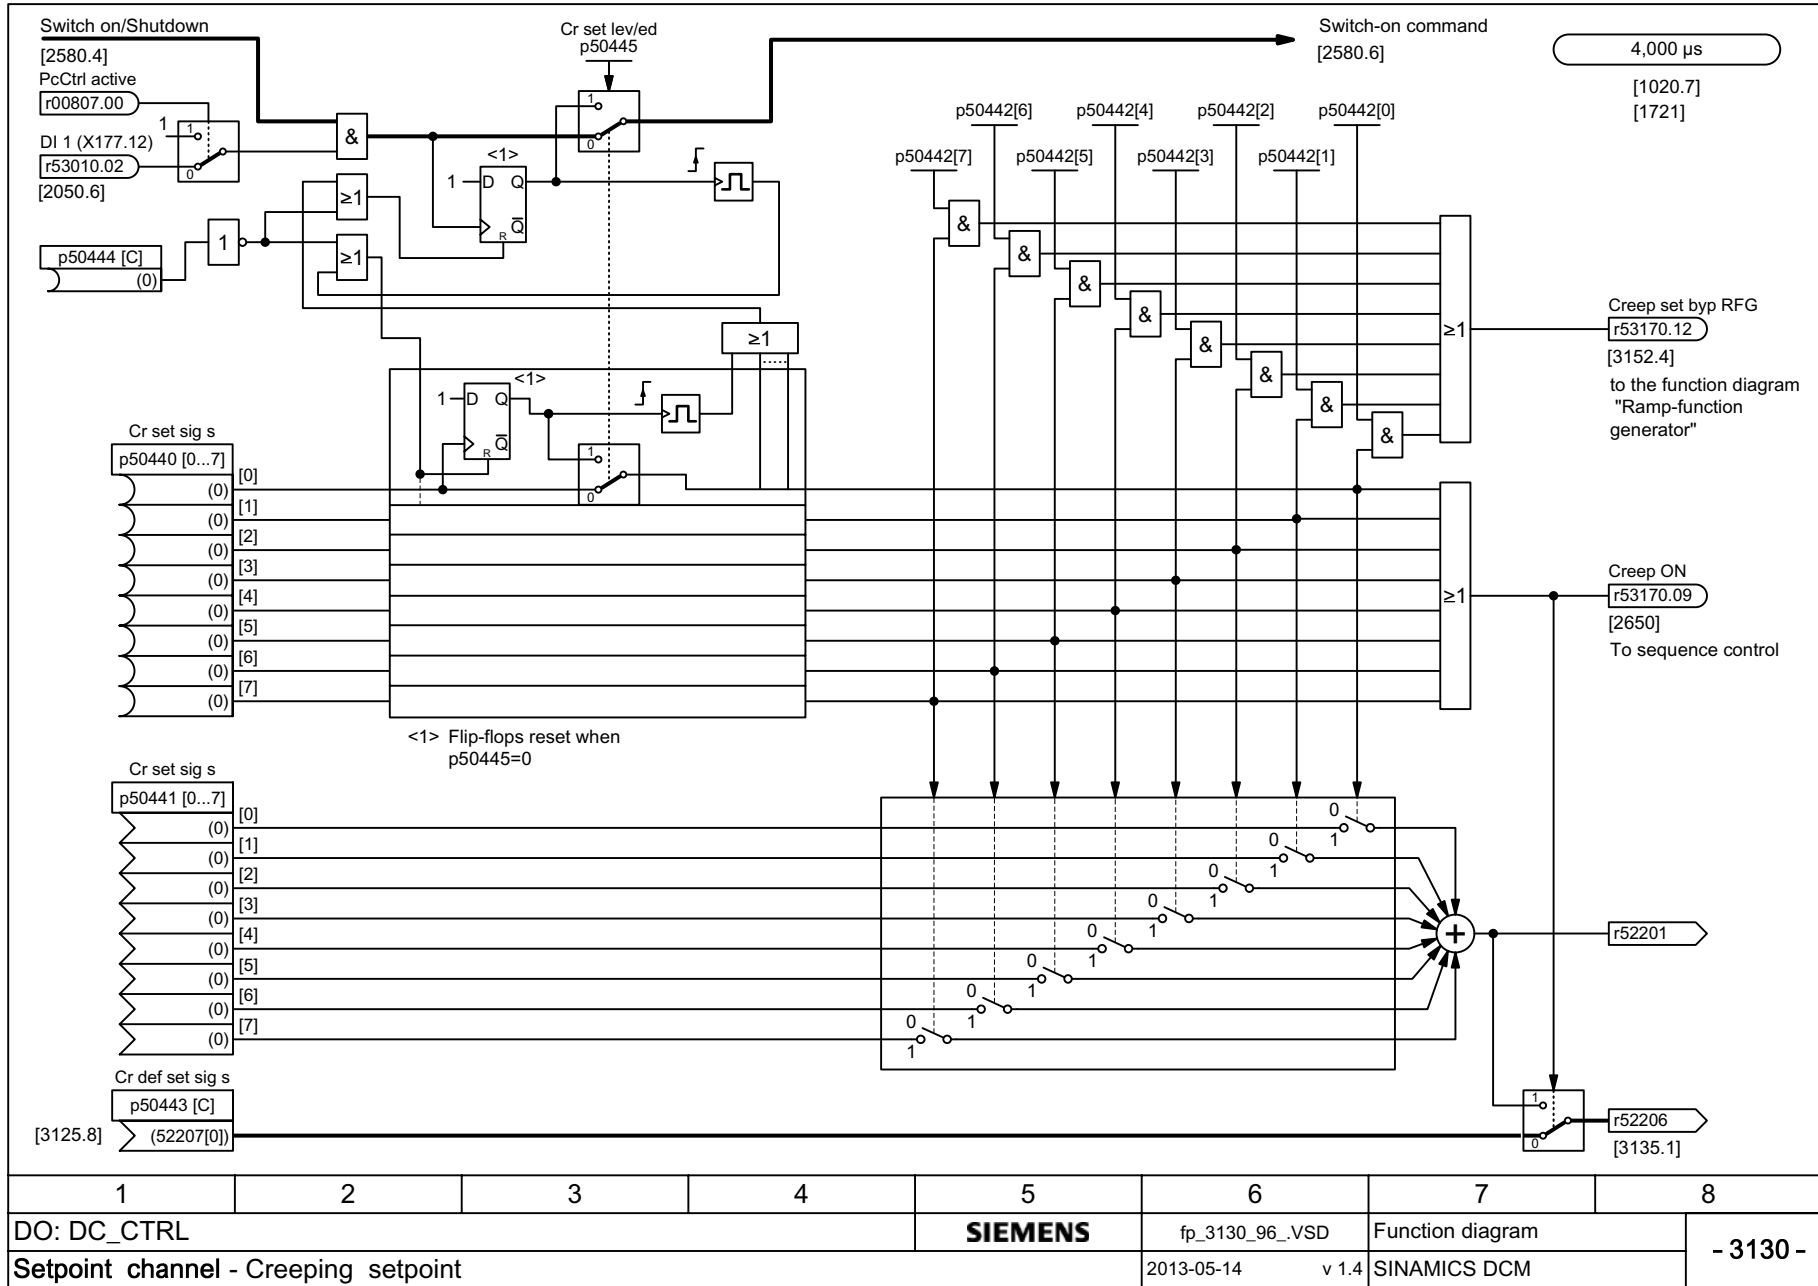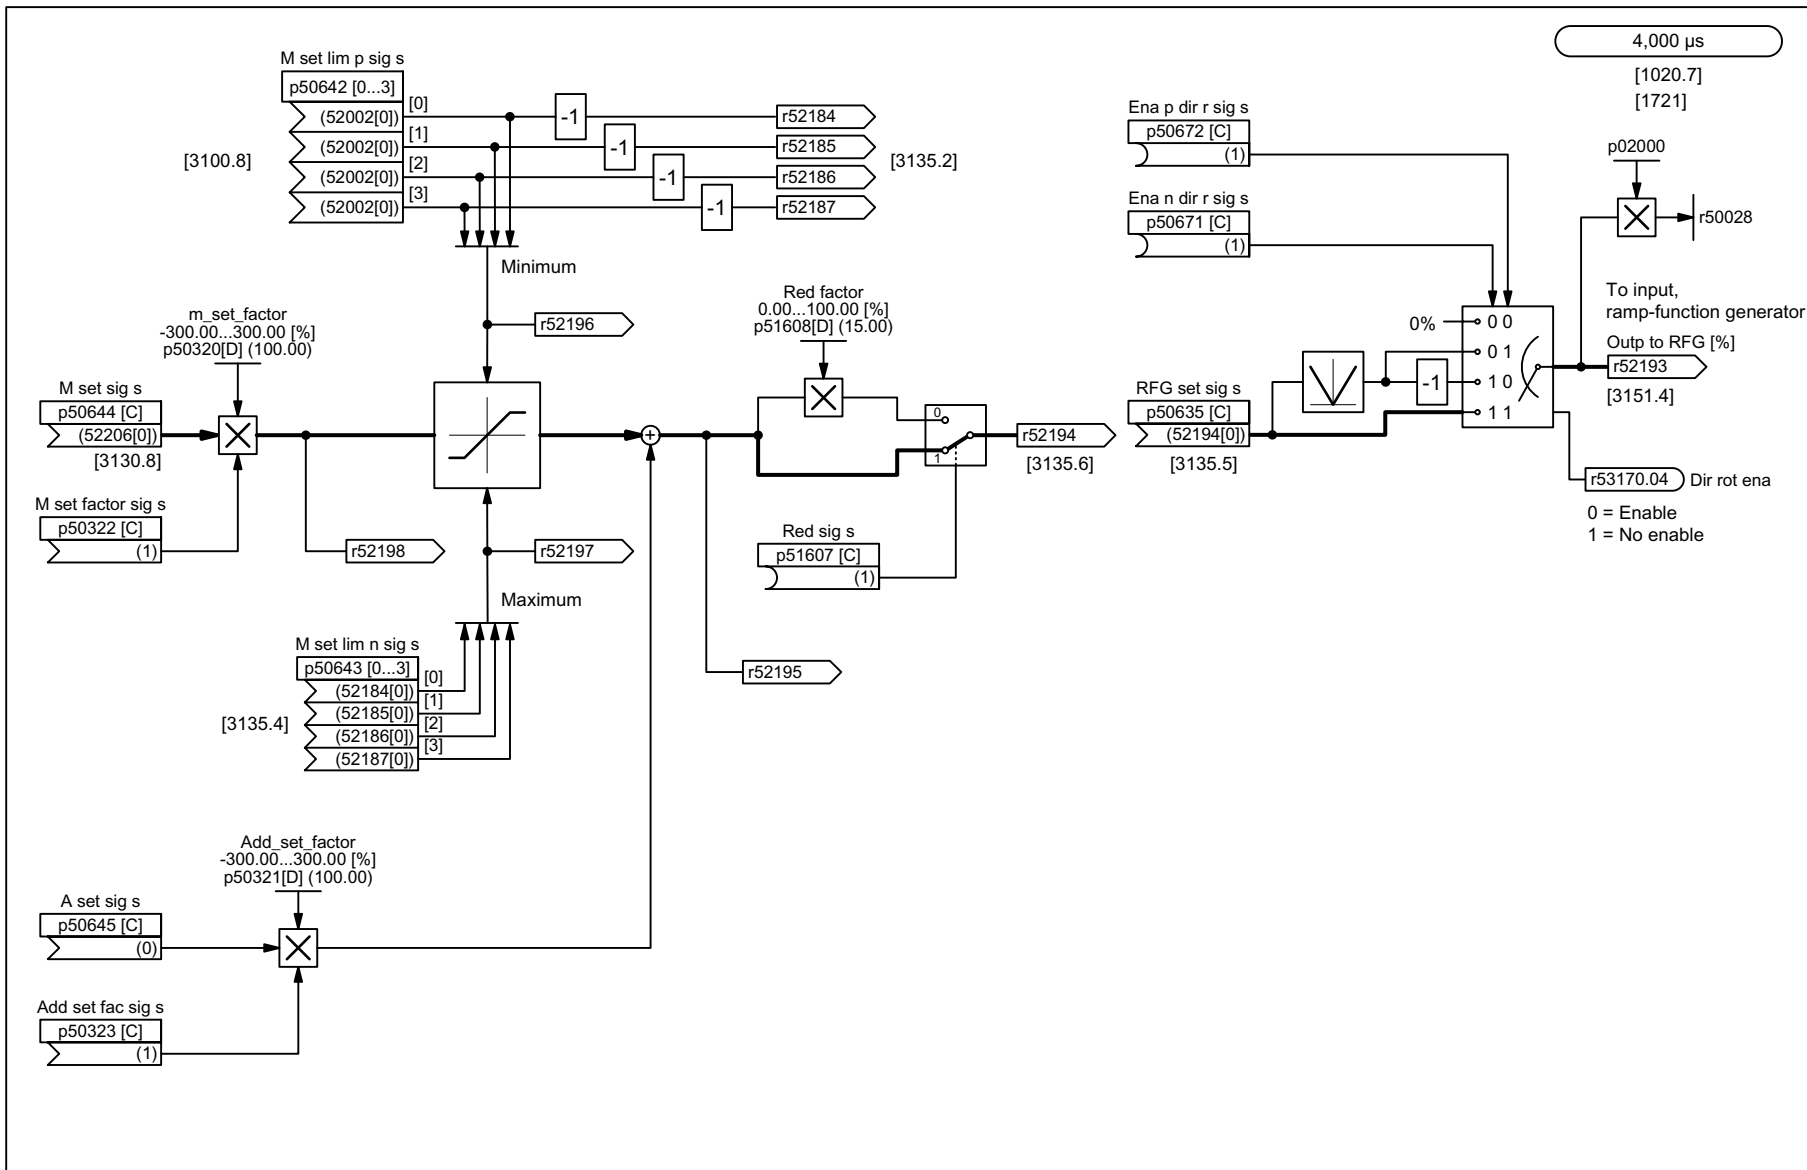Fig. 2-63 3125 – Jog setpoint








1	2	3	4	5	6	7	8
DO: DC_CTRL				<b>SIEMENS</b>	fp_3135_96_VSD	Function diagram	
Setpoint channel - Setpoint preprocessing					2013-05-14 v 1.4	SINAMICS DCM	
							- 3135 -

Fig. 2-65 3135 – Setpoint processing

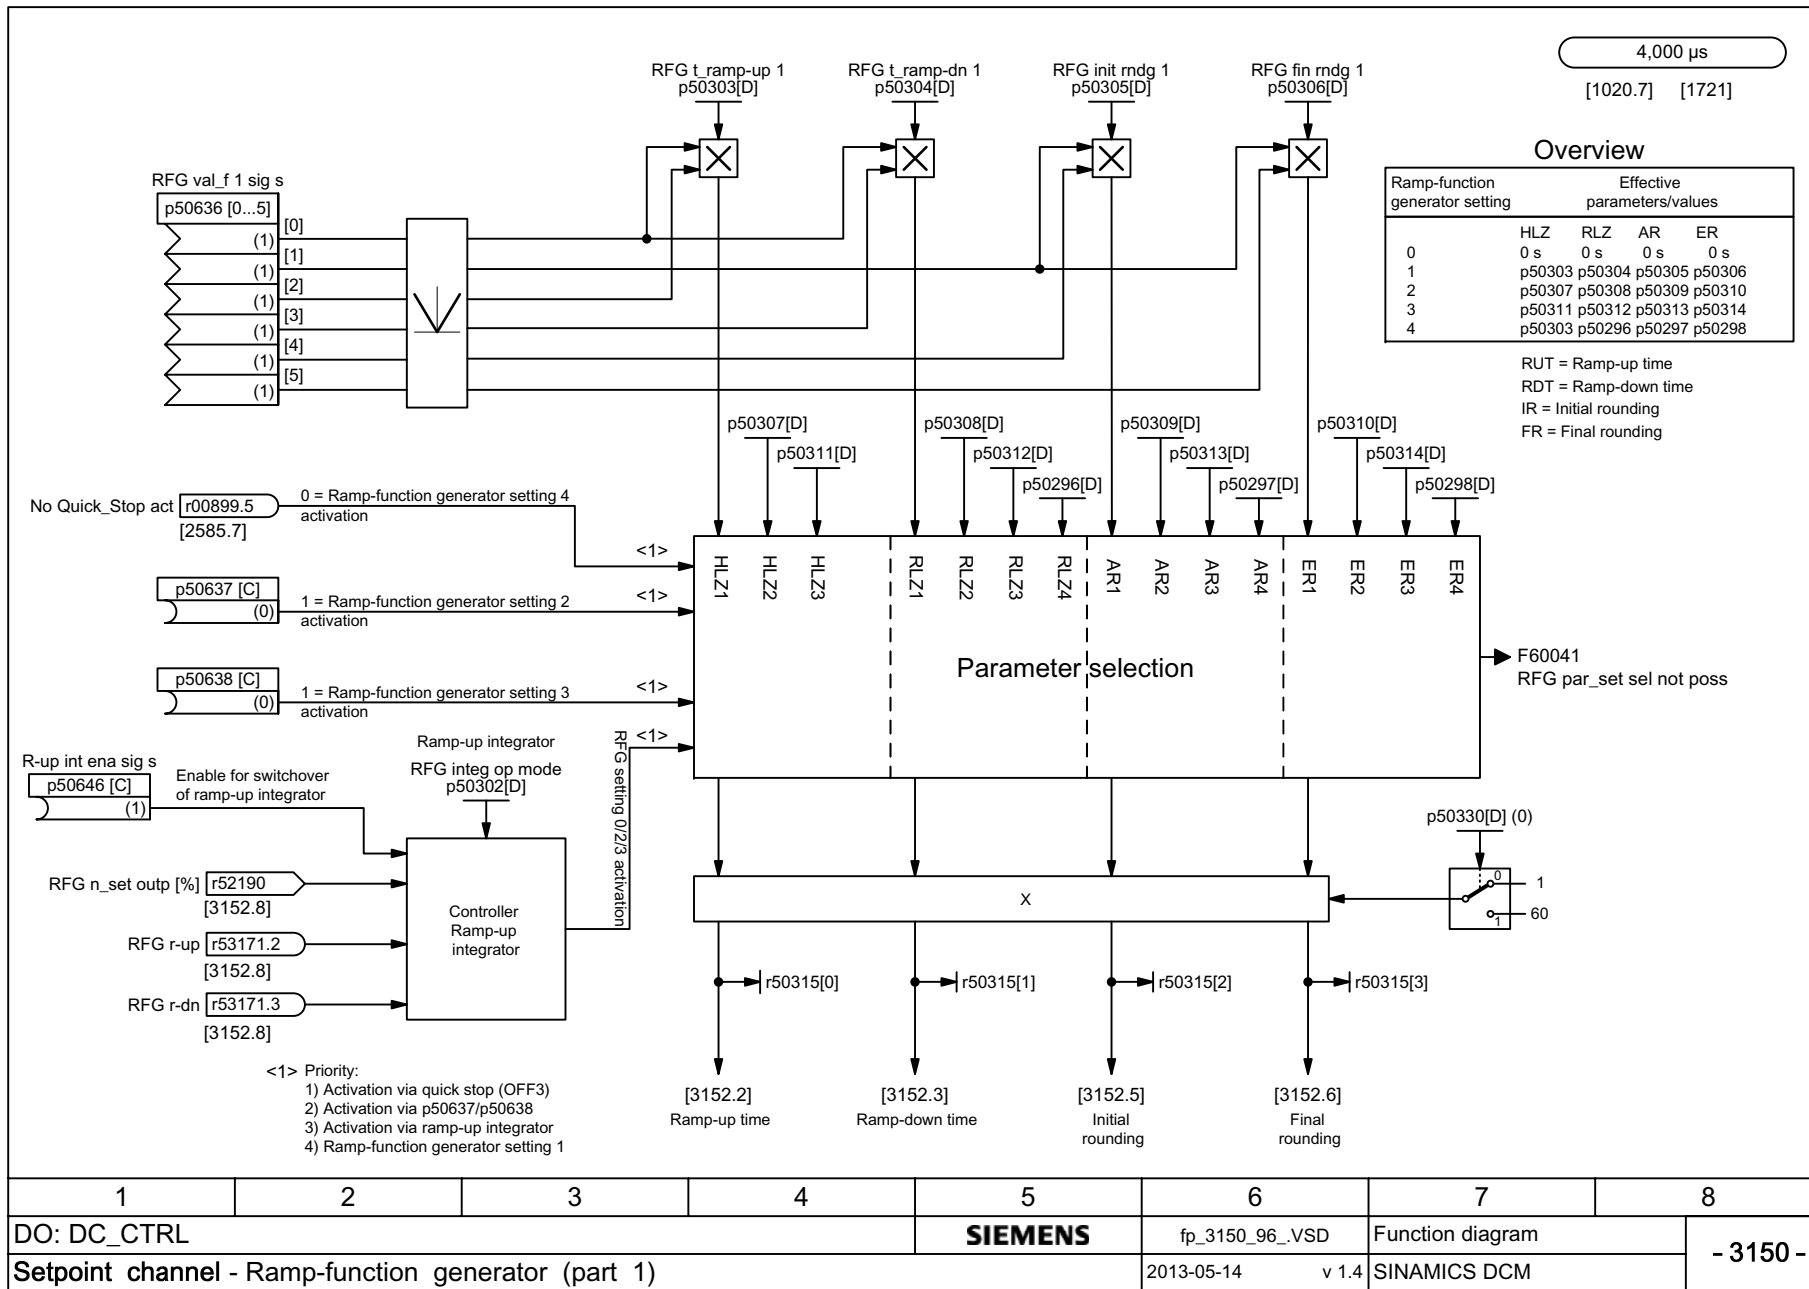


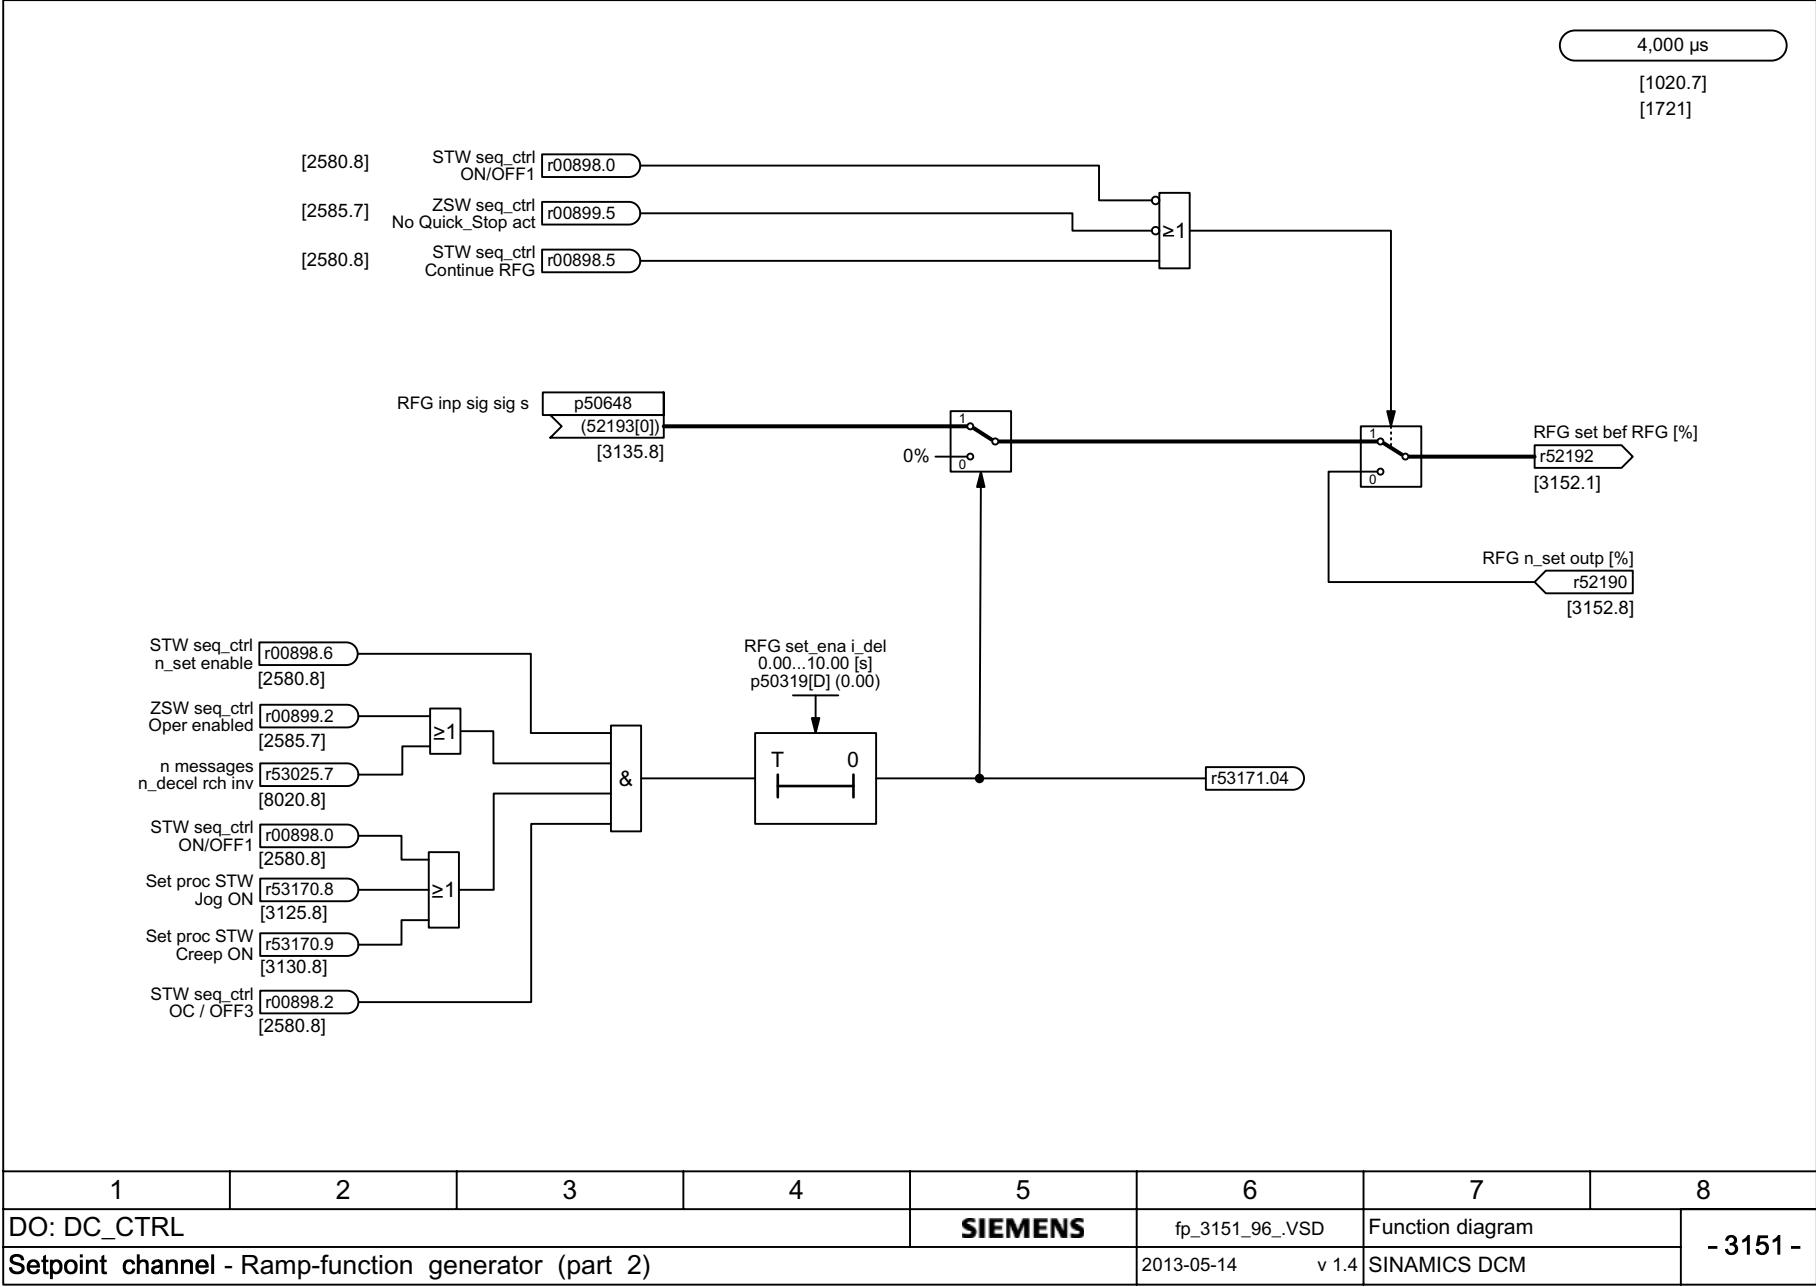


Fig. 2-67 3151 – Ramp-function generator (Part 2)

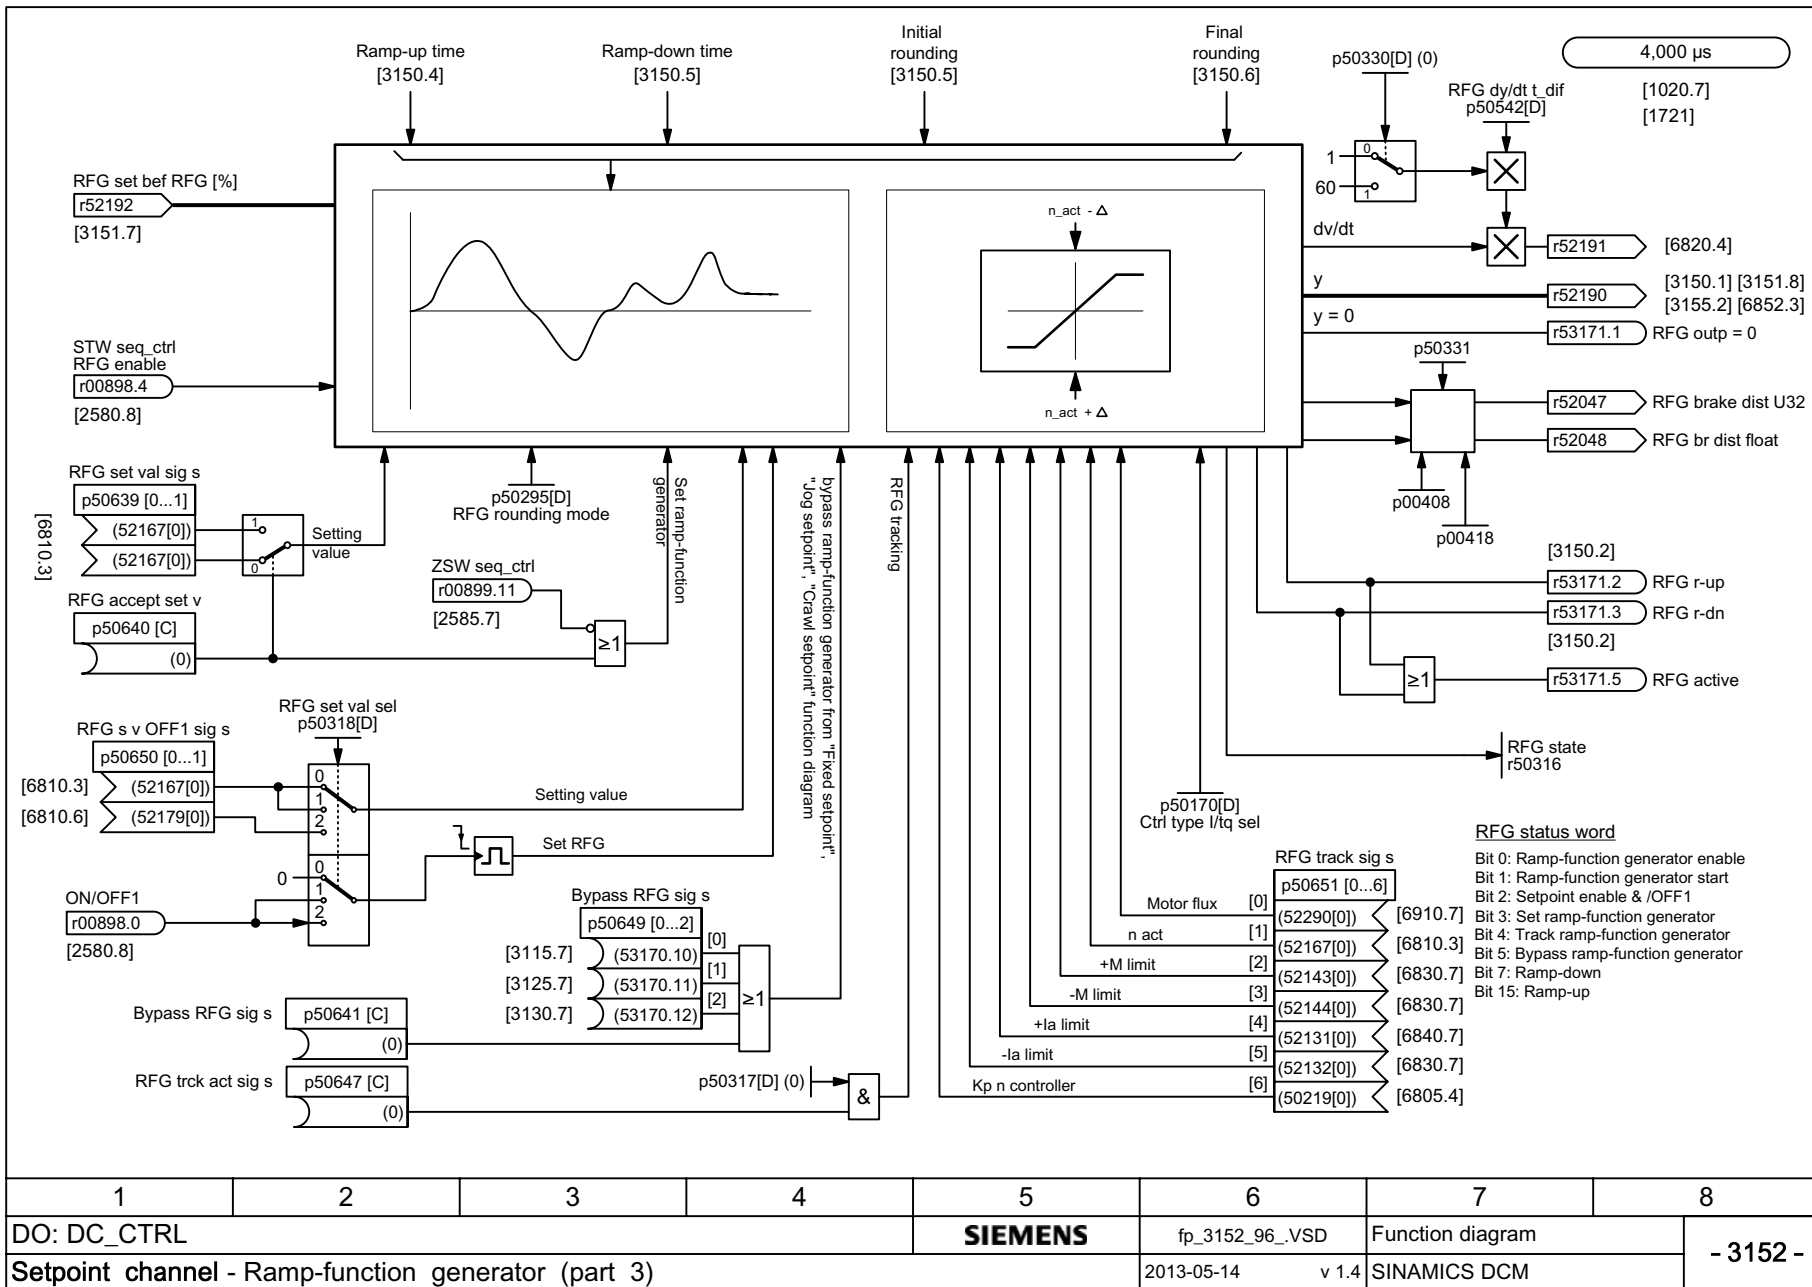

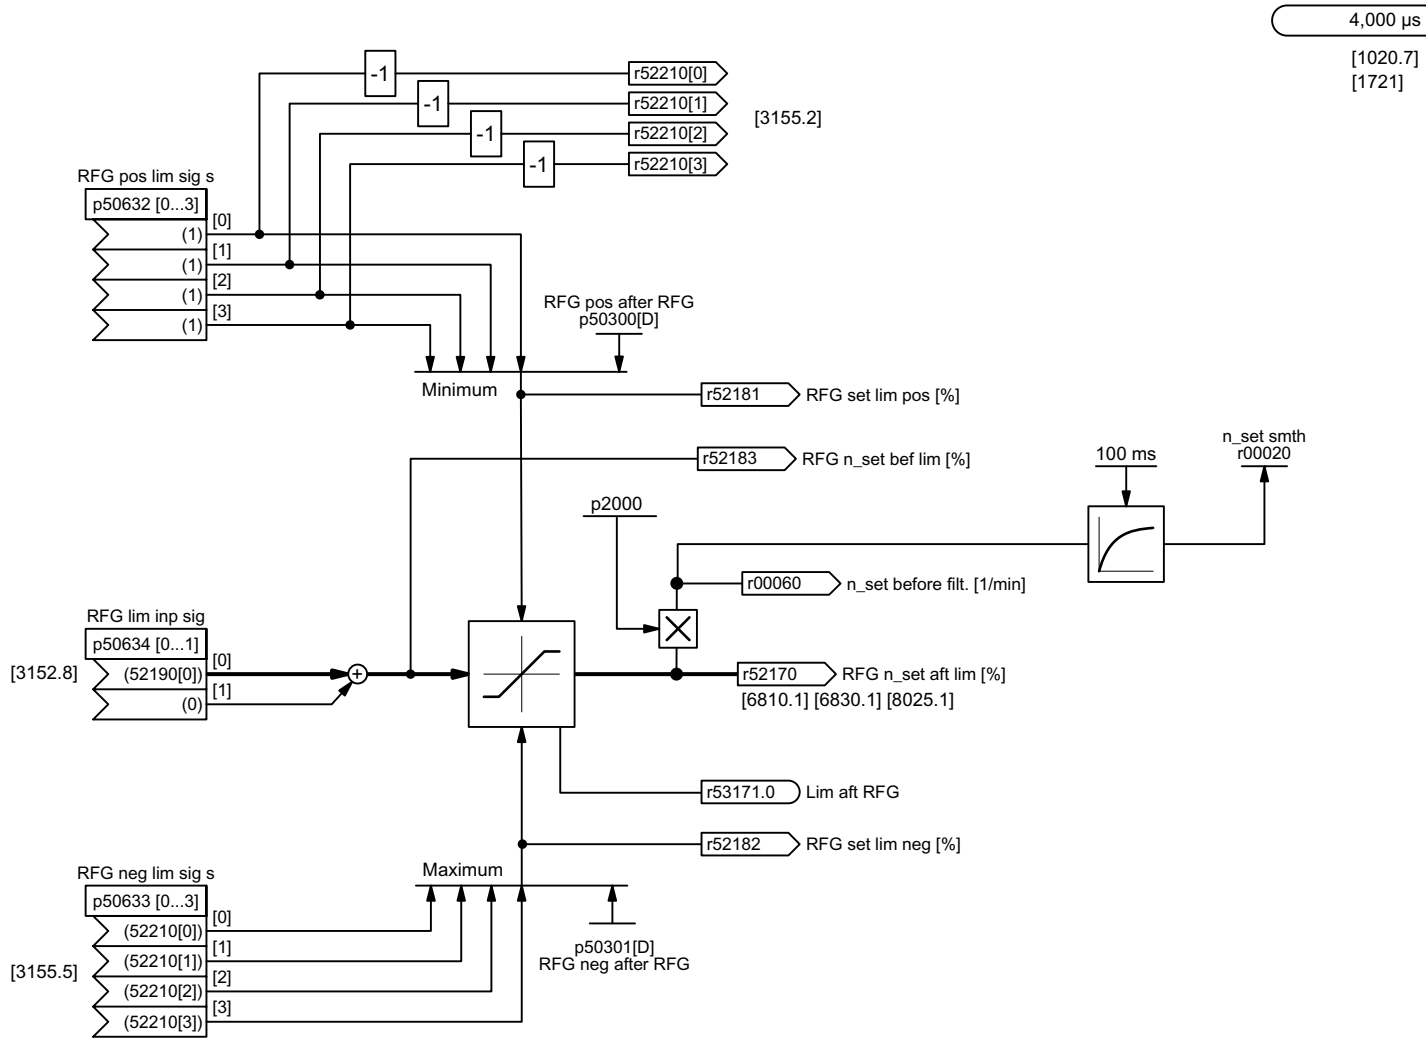


Fig. 2-69


1	2	3	4	5	6	7	8
DO: DC_CTRL				<b>SIEMENS</b>	fp_3155_96_VSD	Function diagram	
Setpoint channel - Limit behind ramp-function generator					2013-05-14 v 1.4	SINAMICS DCM	
						- 3155 -	

## 2.10 Encoder evaluation

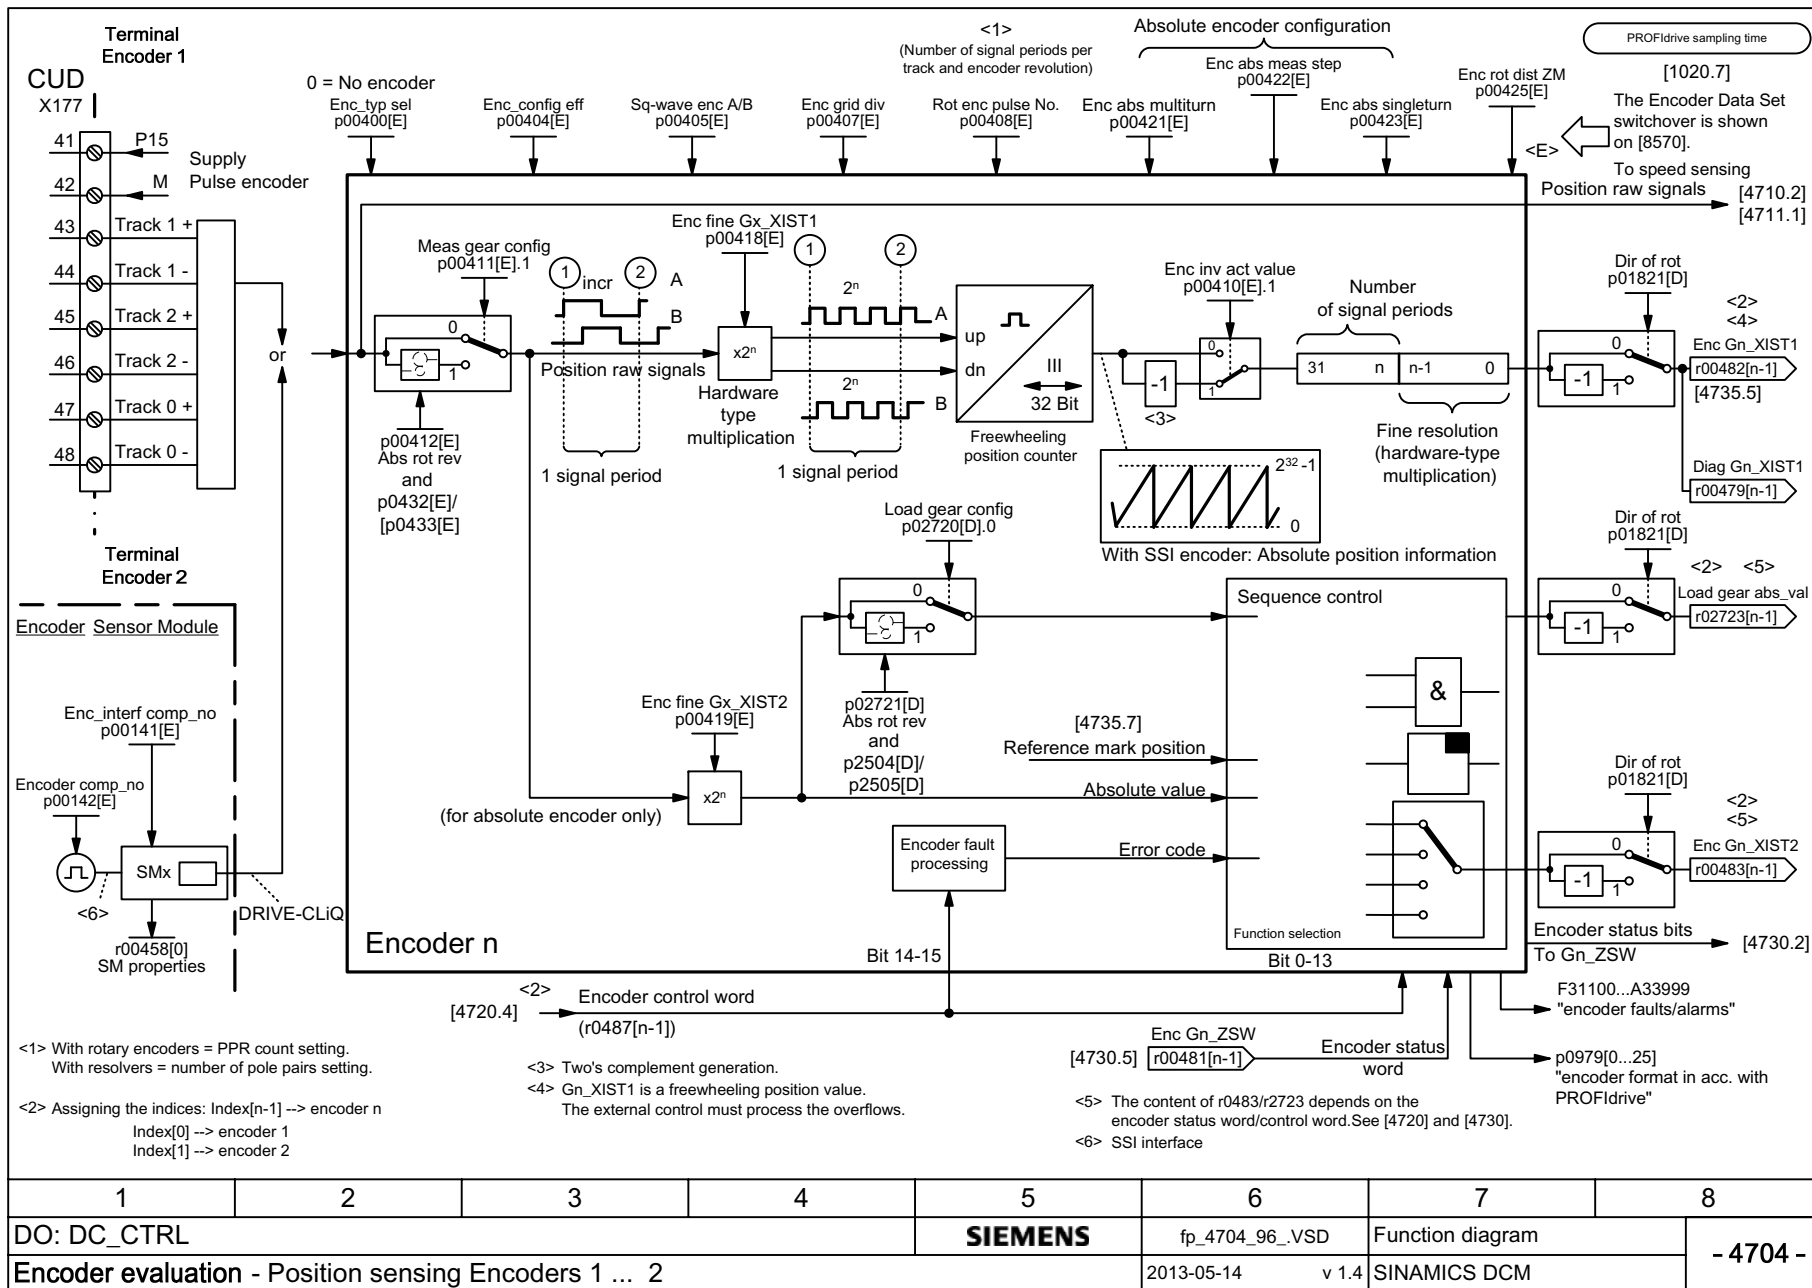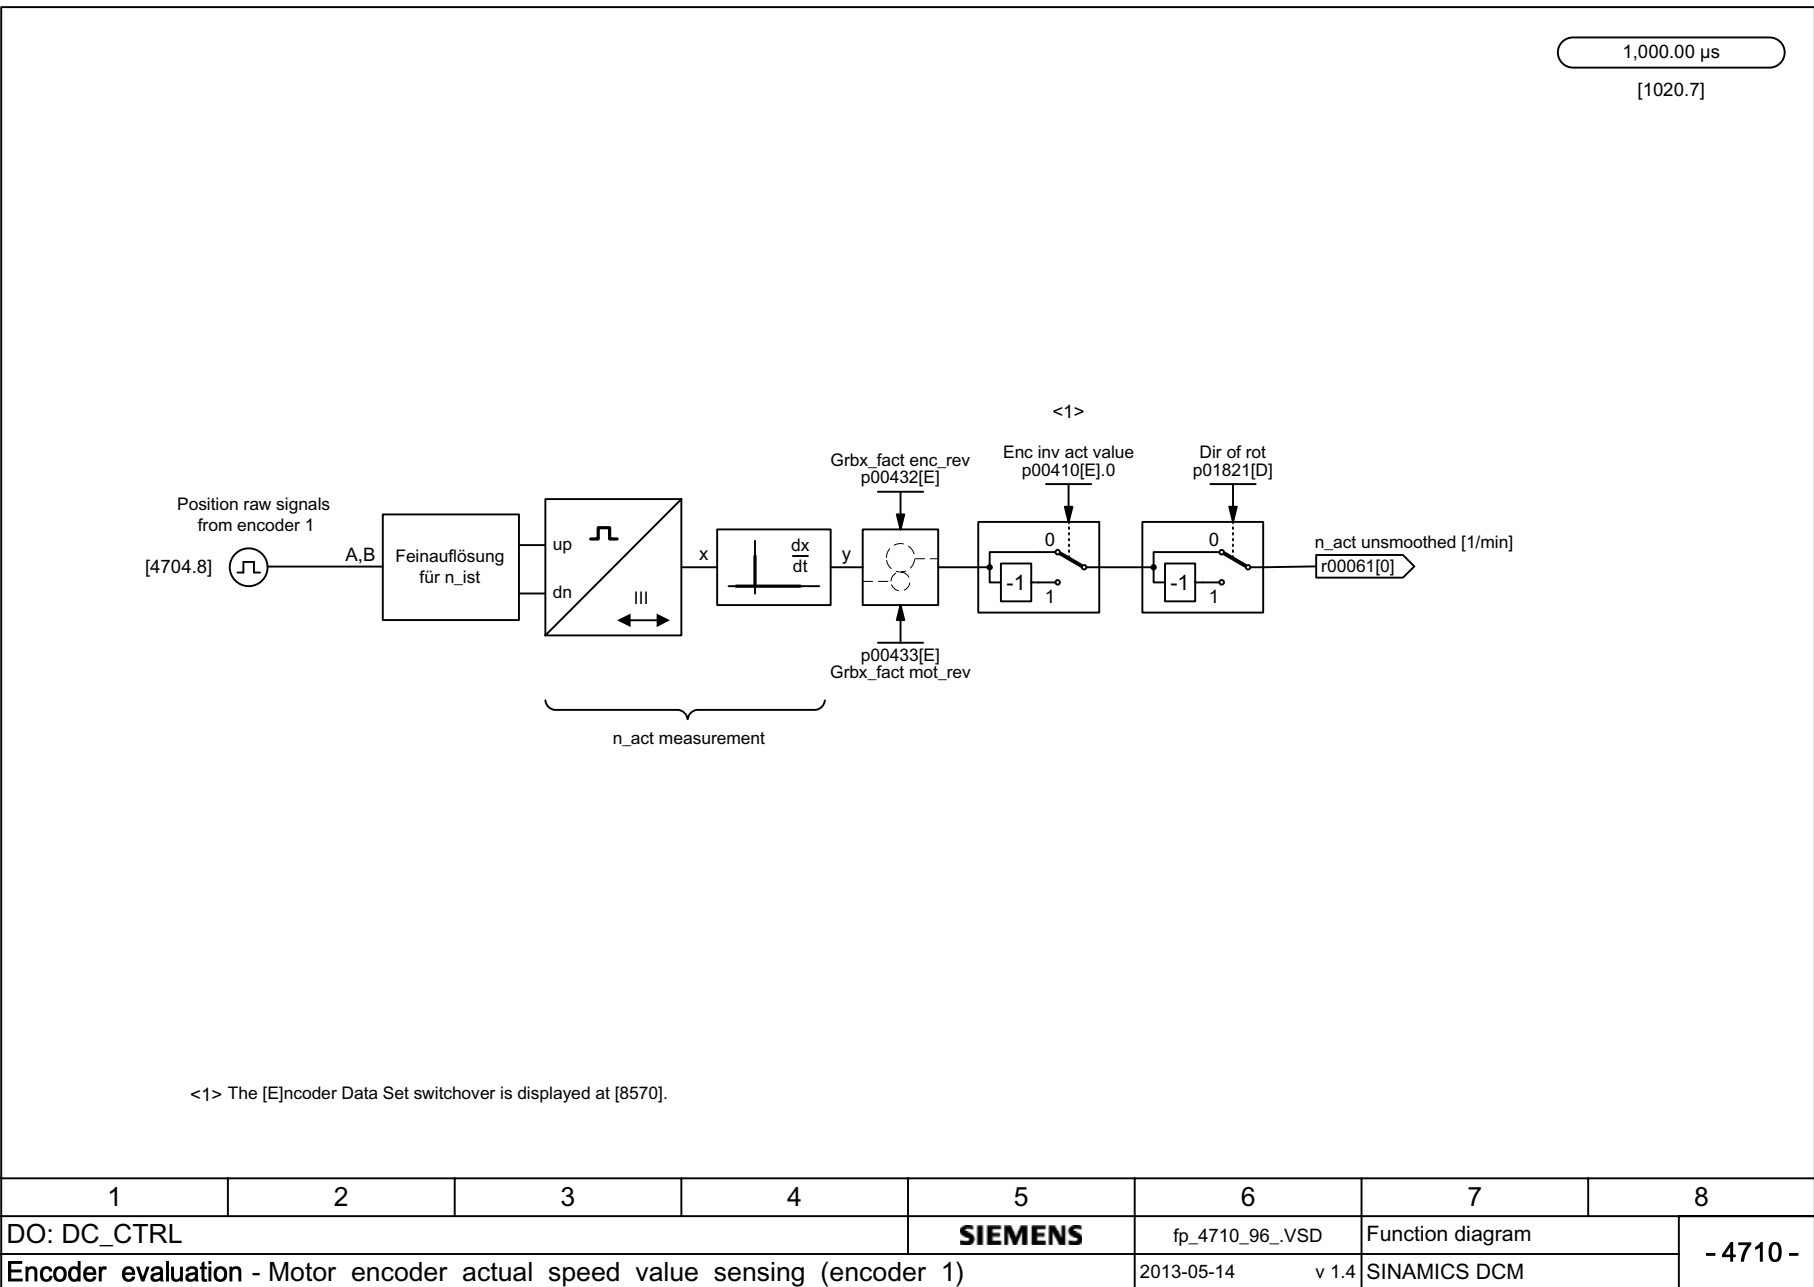
### Function diagrams

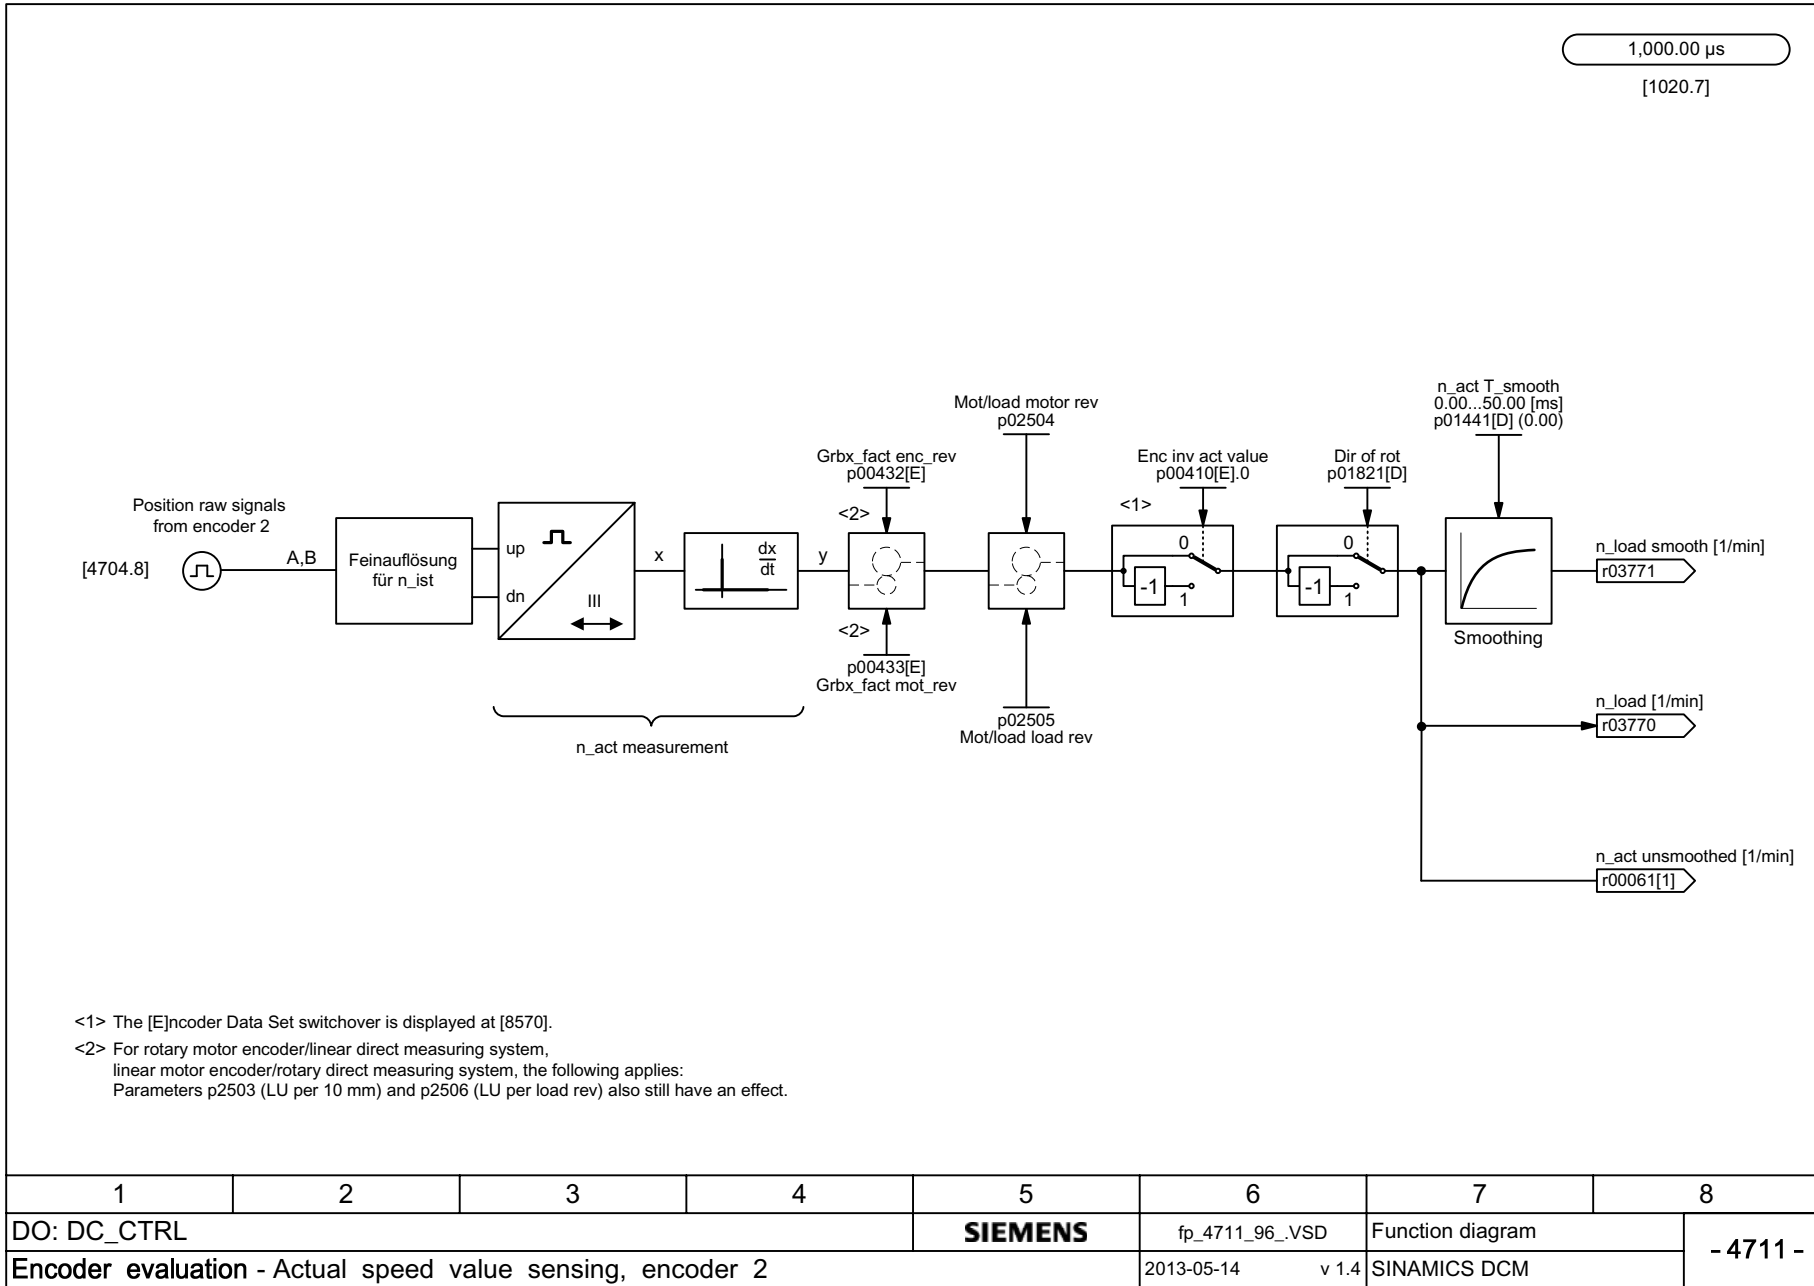
4704 – Position sensing, encoders 1 ... 2	2-744
4710 – Actual speed value measurement, motor encoder (encoder 1)	2-745
4711 – Actual speed value measurement, encoder 2	2-746
4720 – Encoder interface, receive signals, encoders 1 ... 2	2-747
4730 – Encoder interface, send signals, encoders 1 ... 2	2-748
4735 – Reference mark search, encoders 1 ... 2	2-749
4750 – Absolute value for incremental encoder	2-750

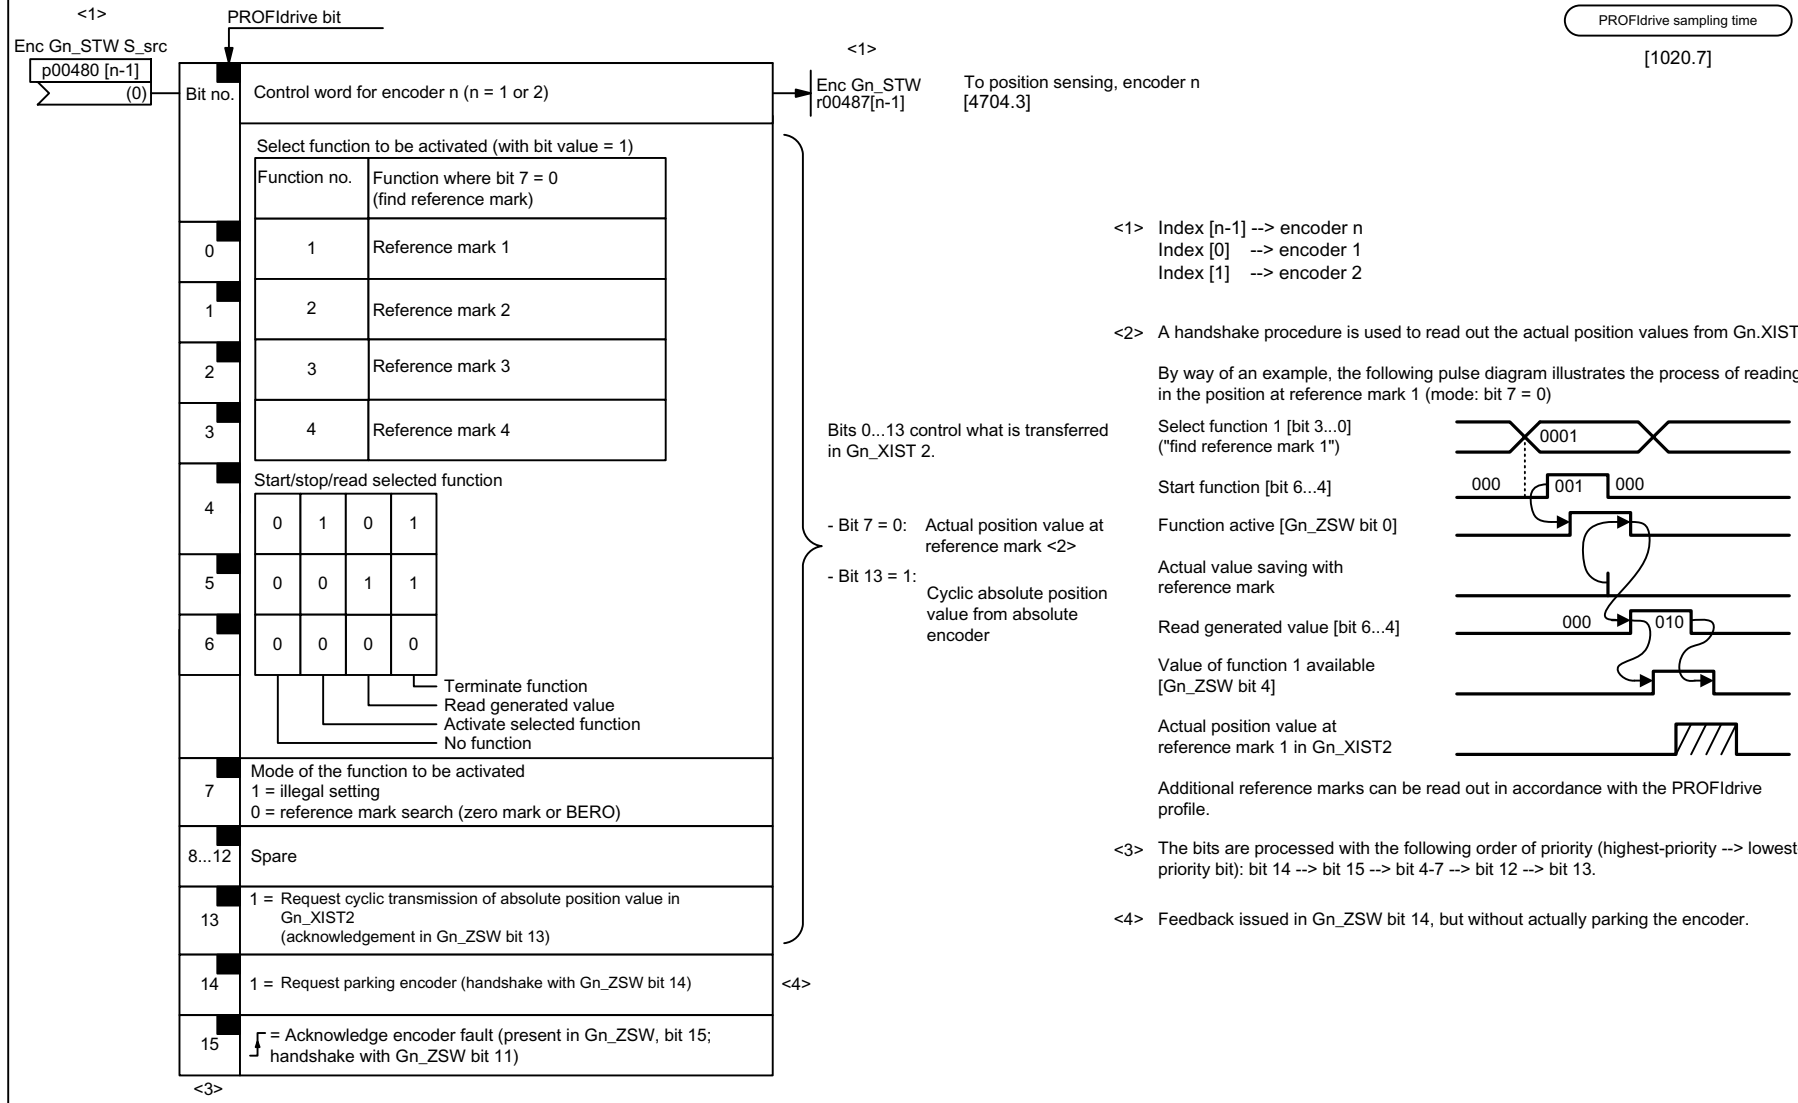
## 4704 – Position sensing, encoders 1 ... 2












1	2	3	4	5	6	7	8
DO: DC_CTRL				<b>SIEMENS</b>	fp_4720_96_VSD	Function diagram	
Encoder evaluation - Encoder interface, receive signals, encoders 1 ... 2					2013-05-14 v 1.4	SINAMICS DCM	
							- 4720 -

Fig. 2-73 4720 – Encoder interface, receive signals, encoders 1 ... 2

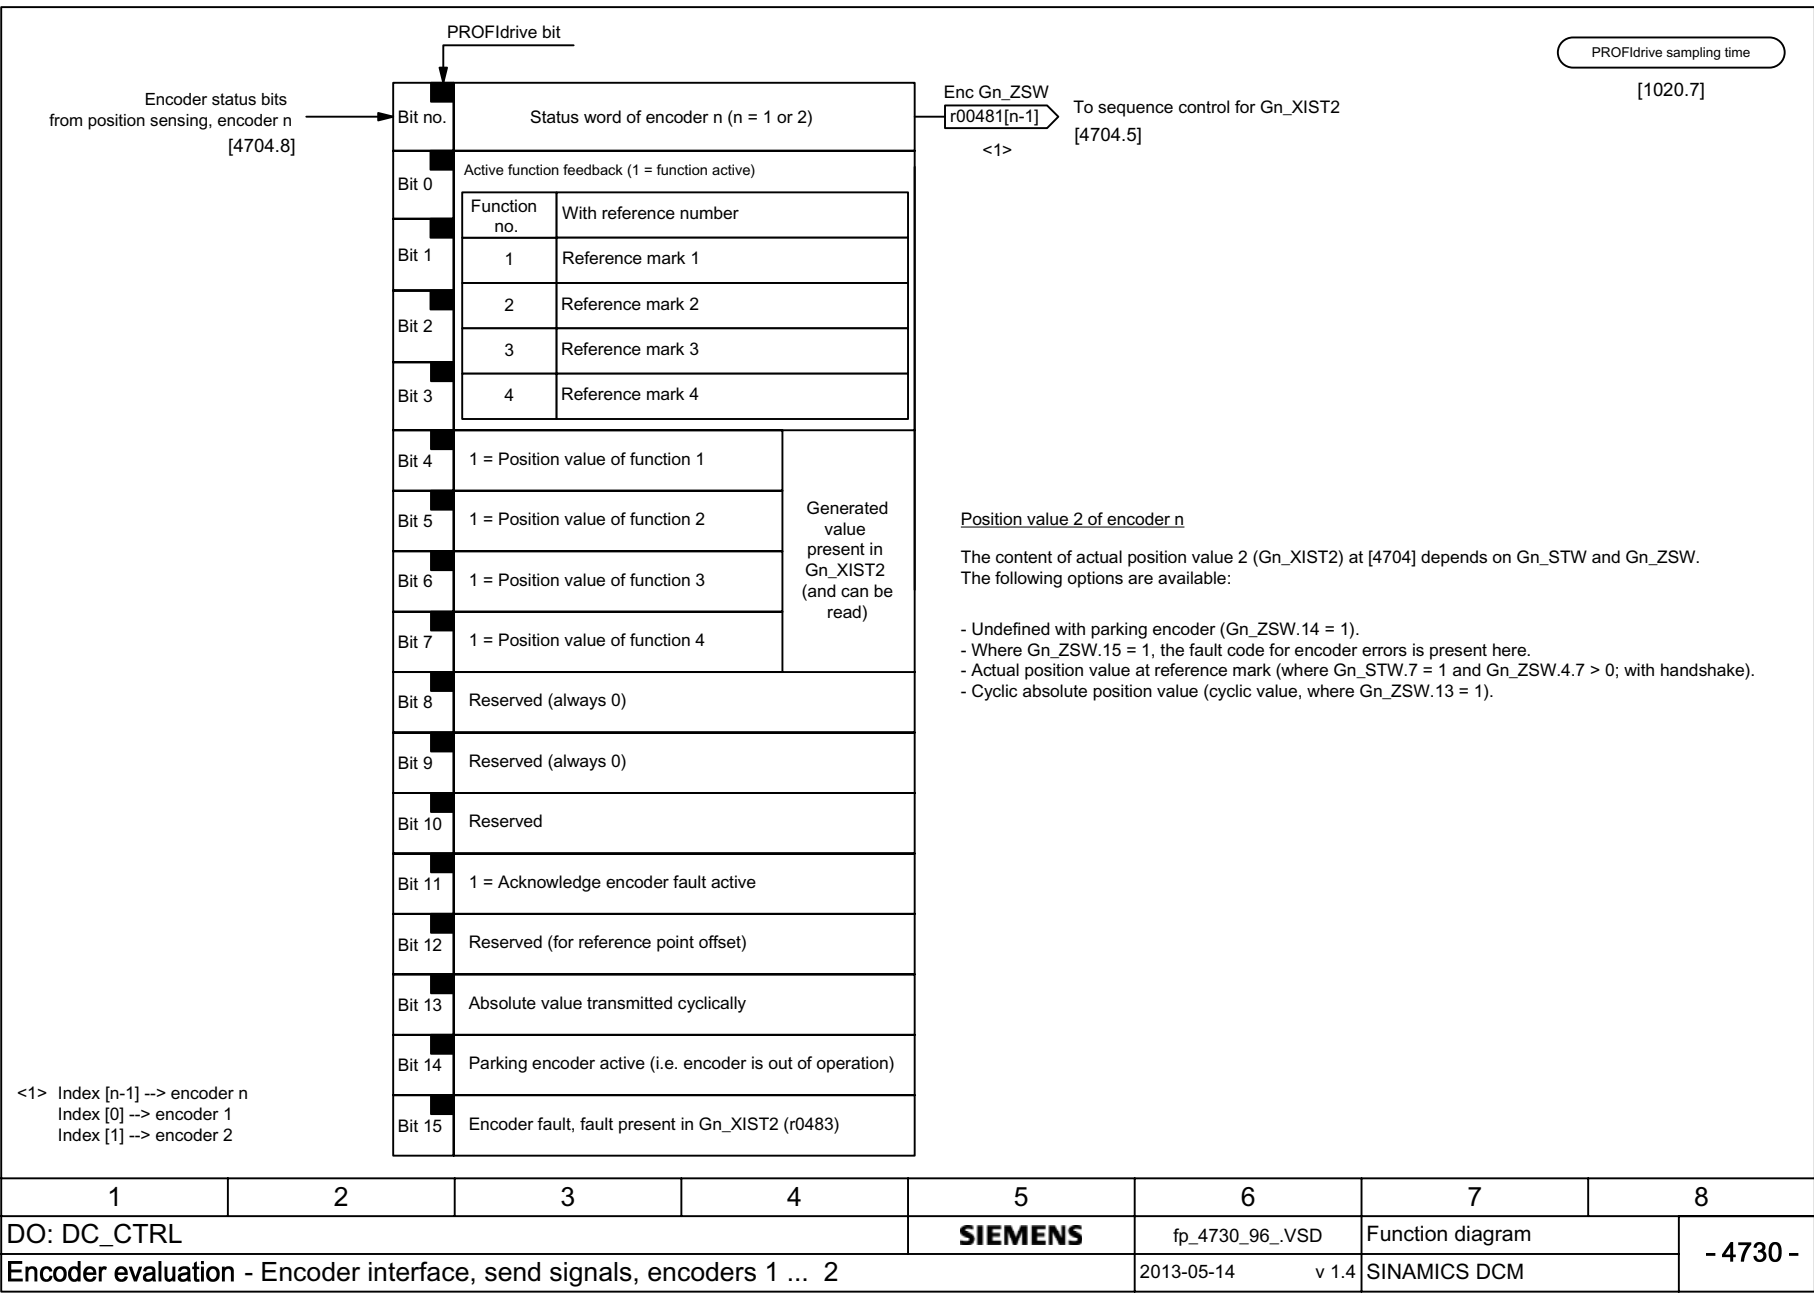


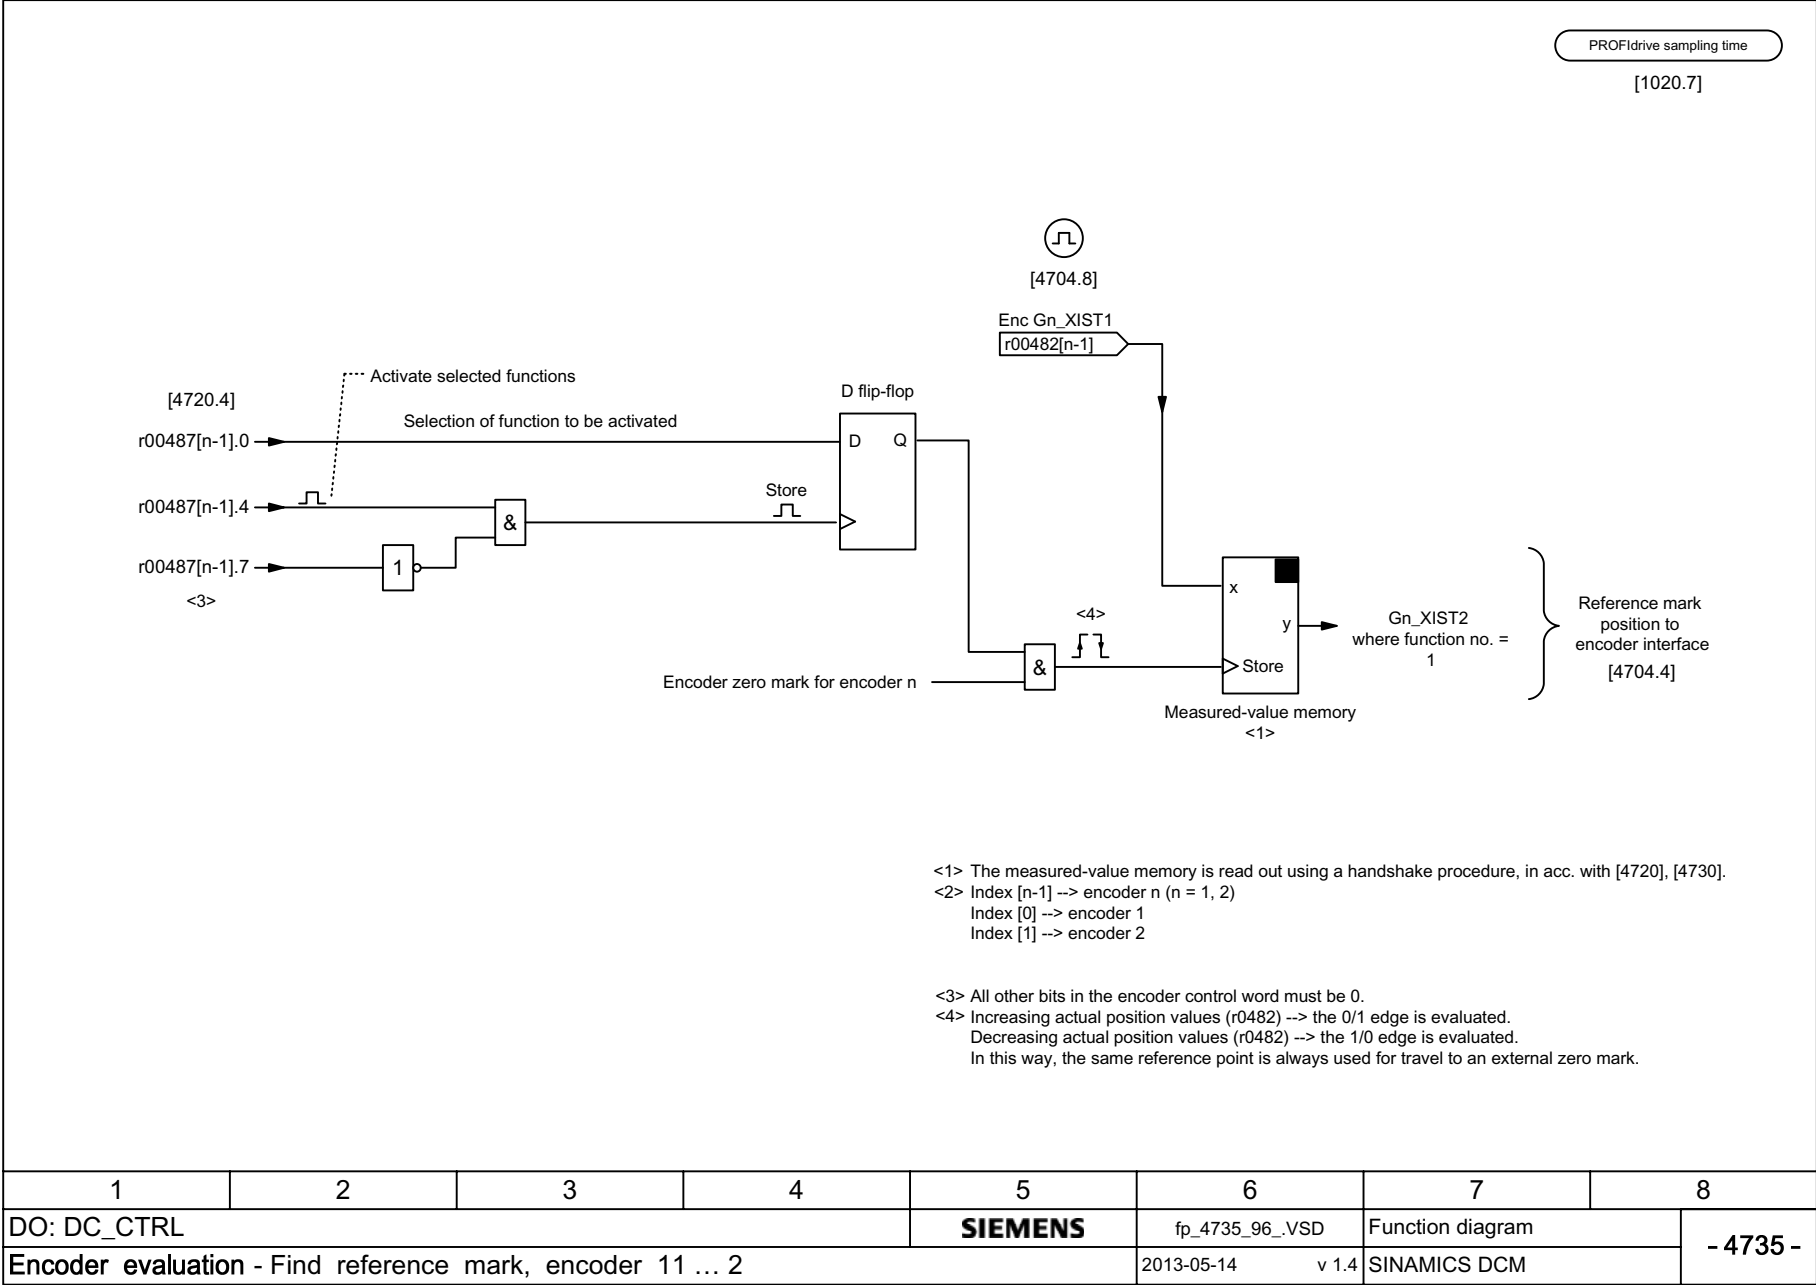


Fig. 2-75 4735 – Reference mark search, encoders 1 ... 2

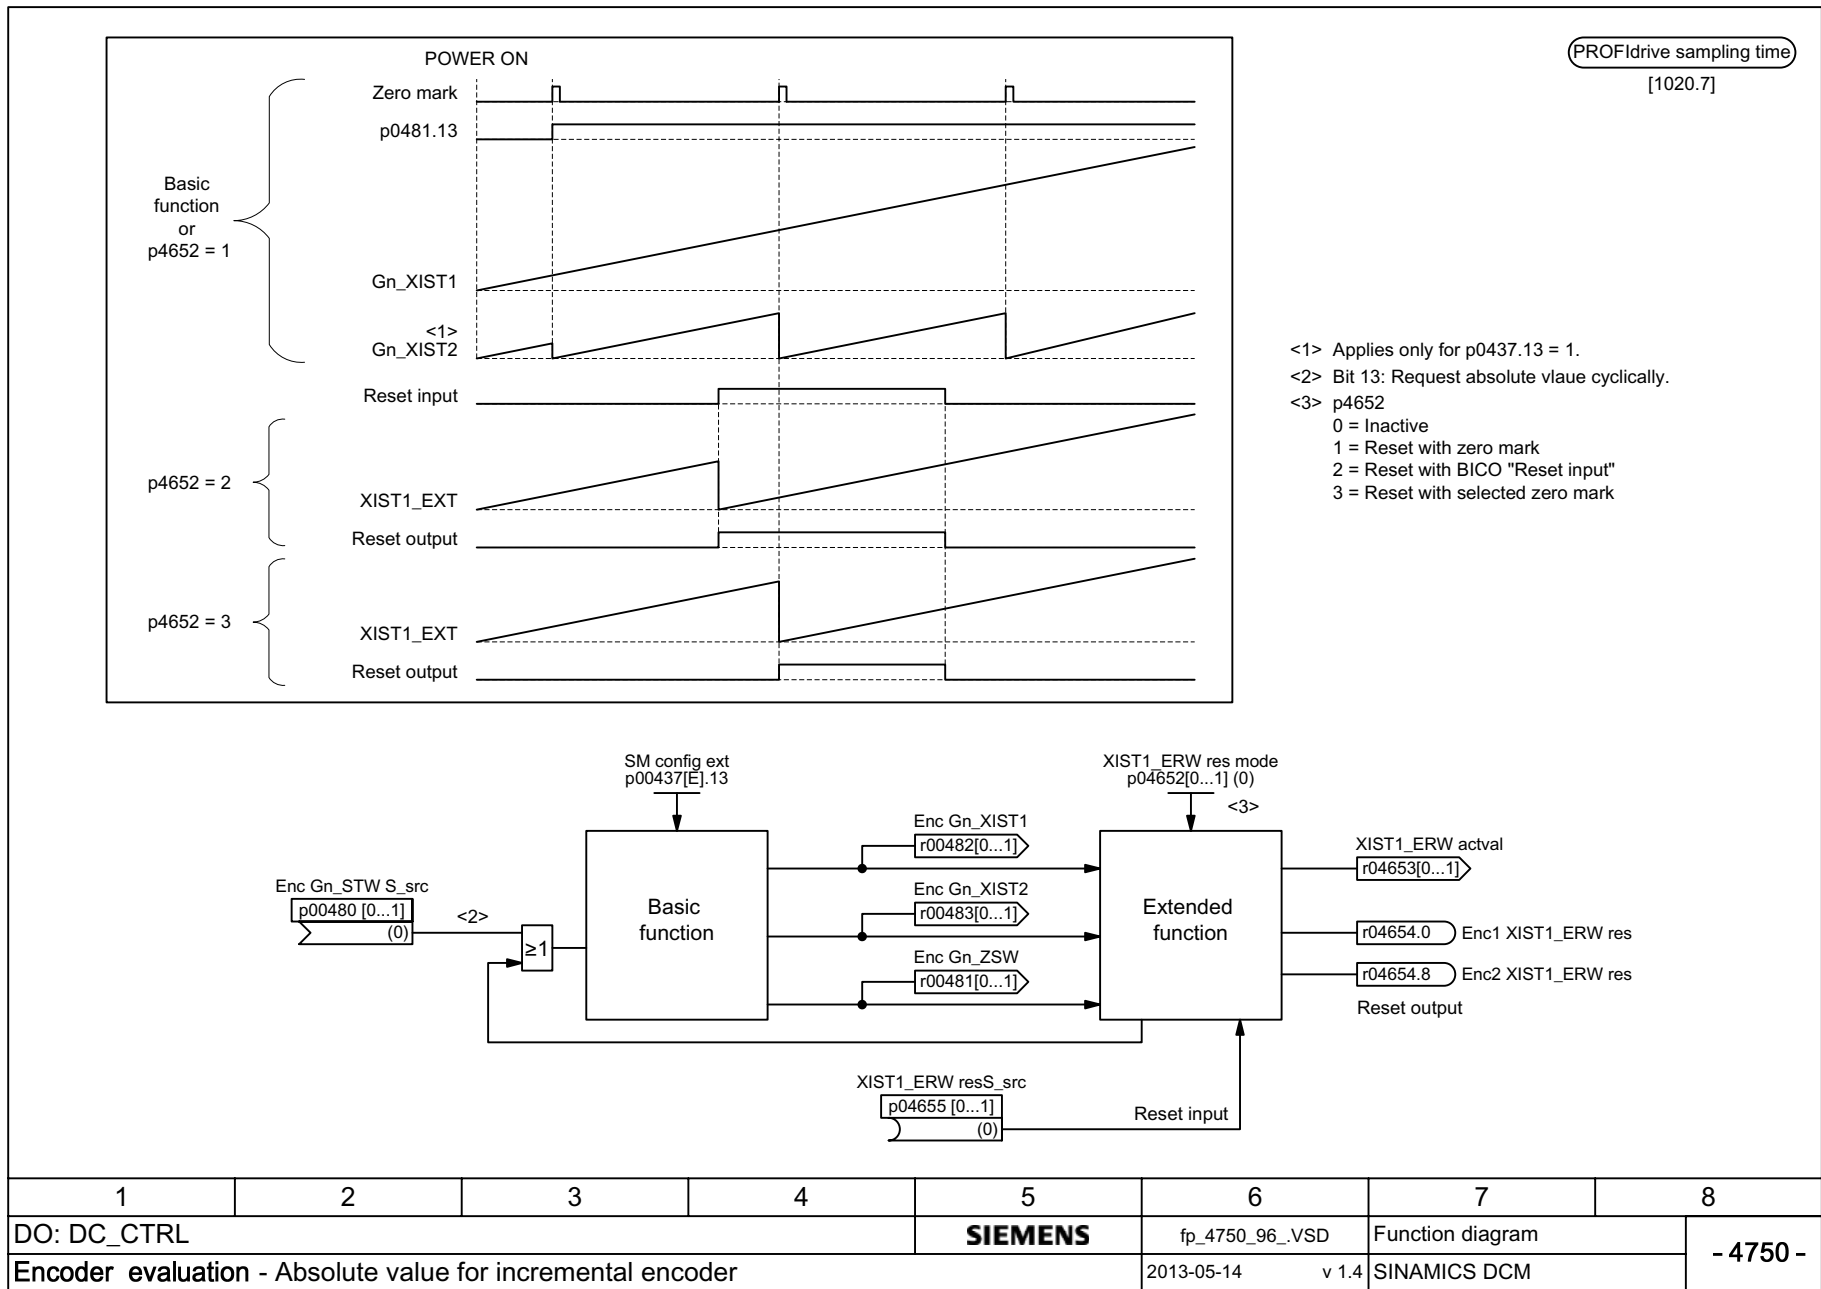

## 2.11 Armature circuit closed-loop control

### Function diagrams

6800 – Speed controller start pulse	2-752
6805 – Speed controller (Part 1)	2-753
6810 – Speed controller (Part 2)	2-754
6812 – Speed controller (Part 3)	2-755
6815 – Speed controller (Part 4)	2-756
6820 – Friction/moment of inertia compensation	2-757
6825 – Torque limiting (Part 1)	2-758
6830 – Torque limiting (Part 2)	2-759
6835 – Speed limiting controller	2-760
6840 – Current limitation (Part 1)	2-761
6845 – Current limitation (Part 2)	2-762
6850 – Armature current actual value sensing (Part 1)	2-763
6851 – Armature current actual value sensing (Part 2)	2-764
6852 – EMF actual value selection for armature current precontrol	2-765
6853 – Armature current controller adaptation	2-766
6854 – Armature circuit model parameters	2-767
6855 – Armature current closed-loop control	2-768
6858 – Gating unit characteristic, linearization	2-769
6860 – Auto-reversing stage, armature gating unit	2-770
6862 – Limitations, state	2-771
6865 – Simulation mode/thyristor check/commutation monitoring	2-772
6895 – Line-dependent EMF reduction	2-773

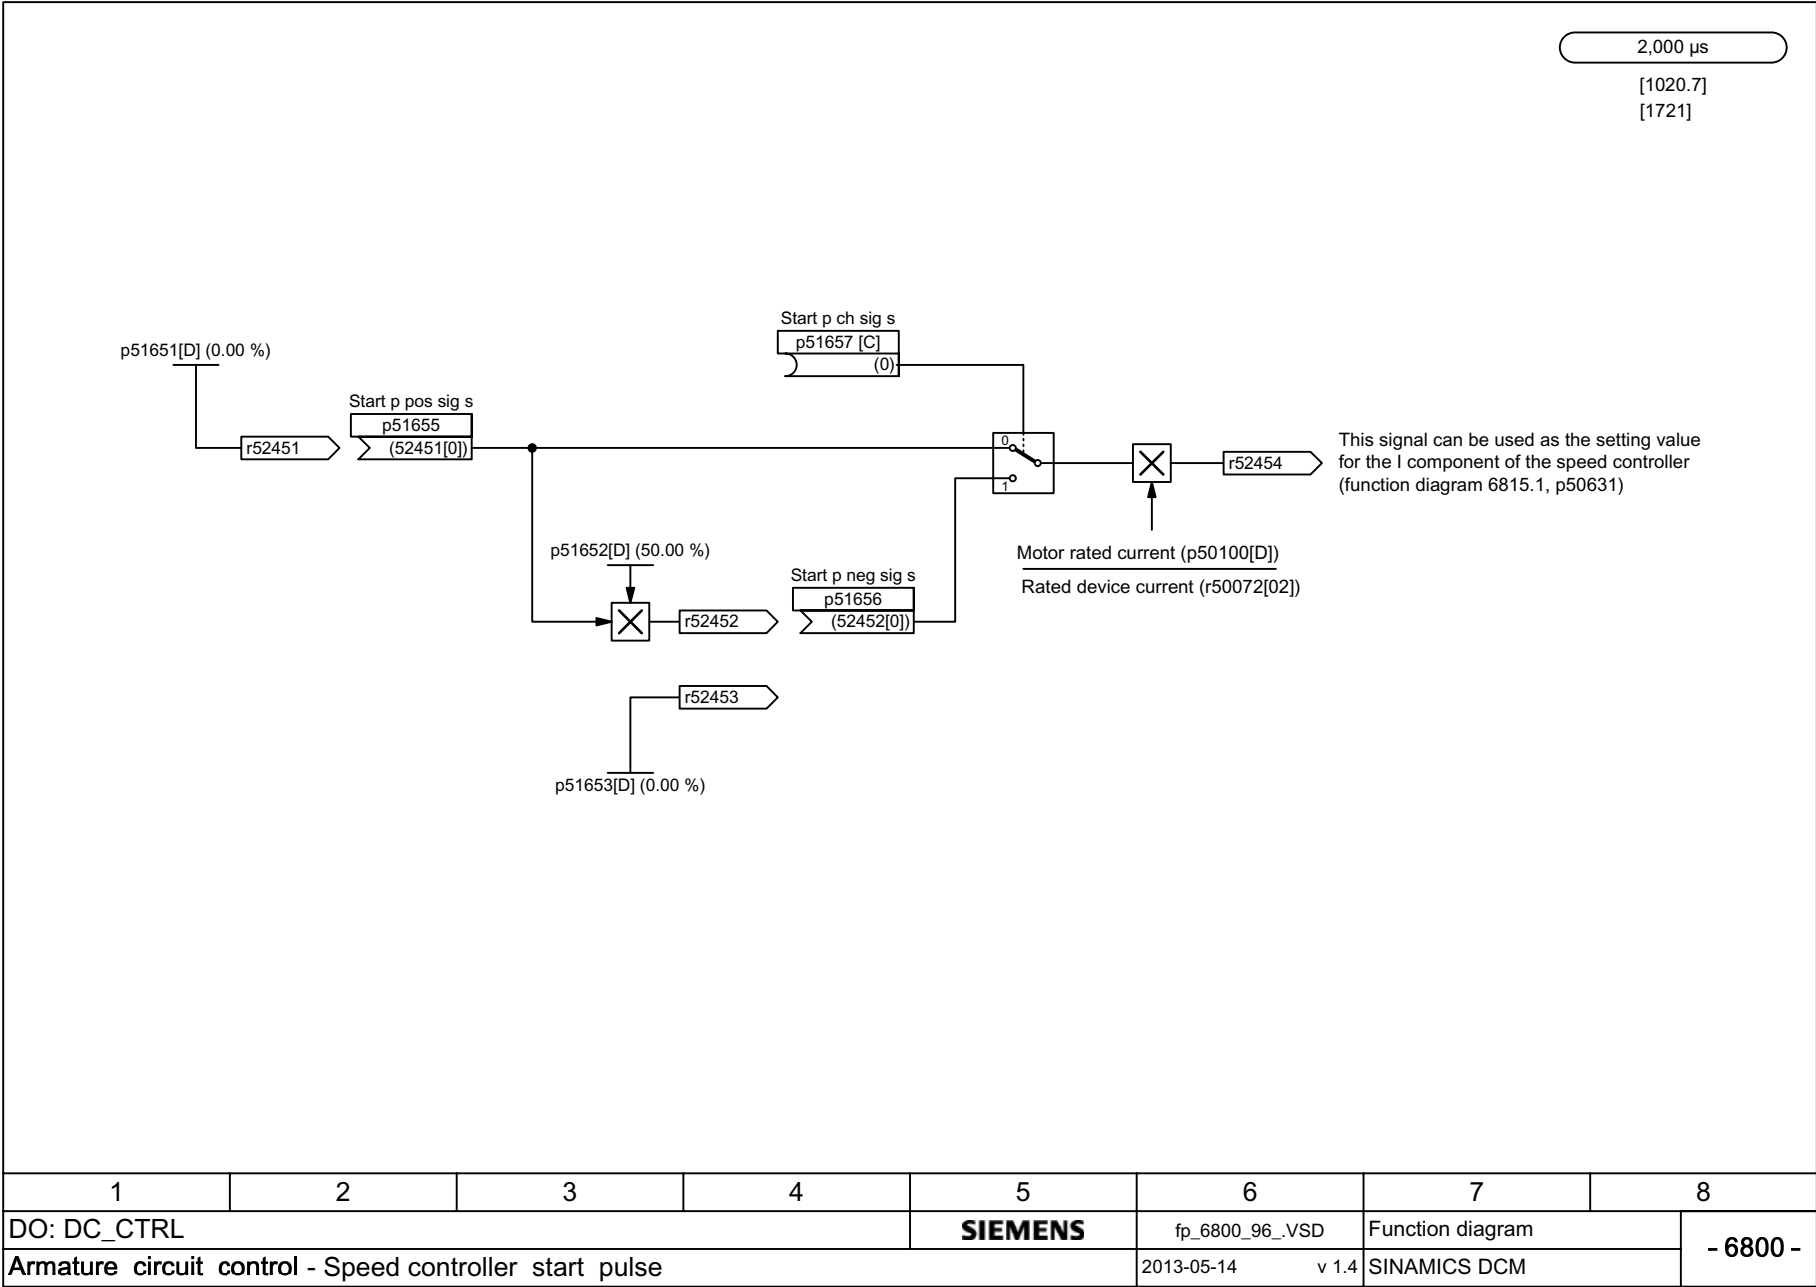


Fig. 2-77 6800 – Speed controller start pulse





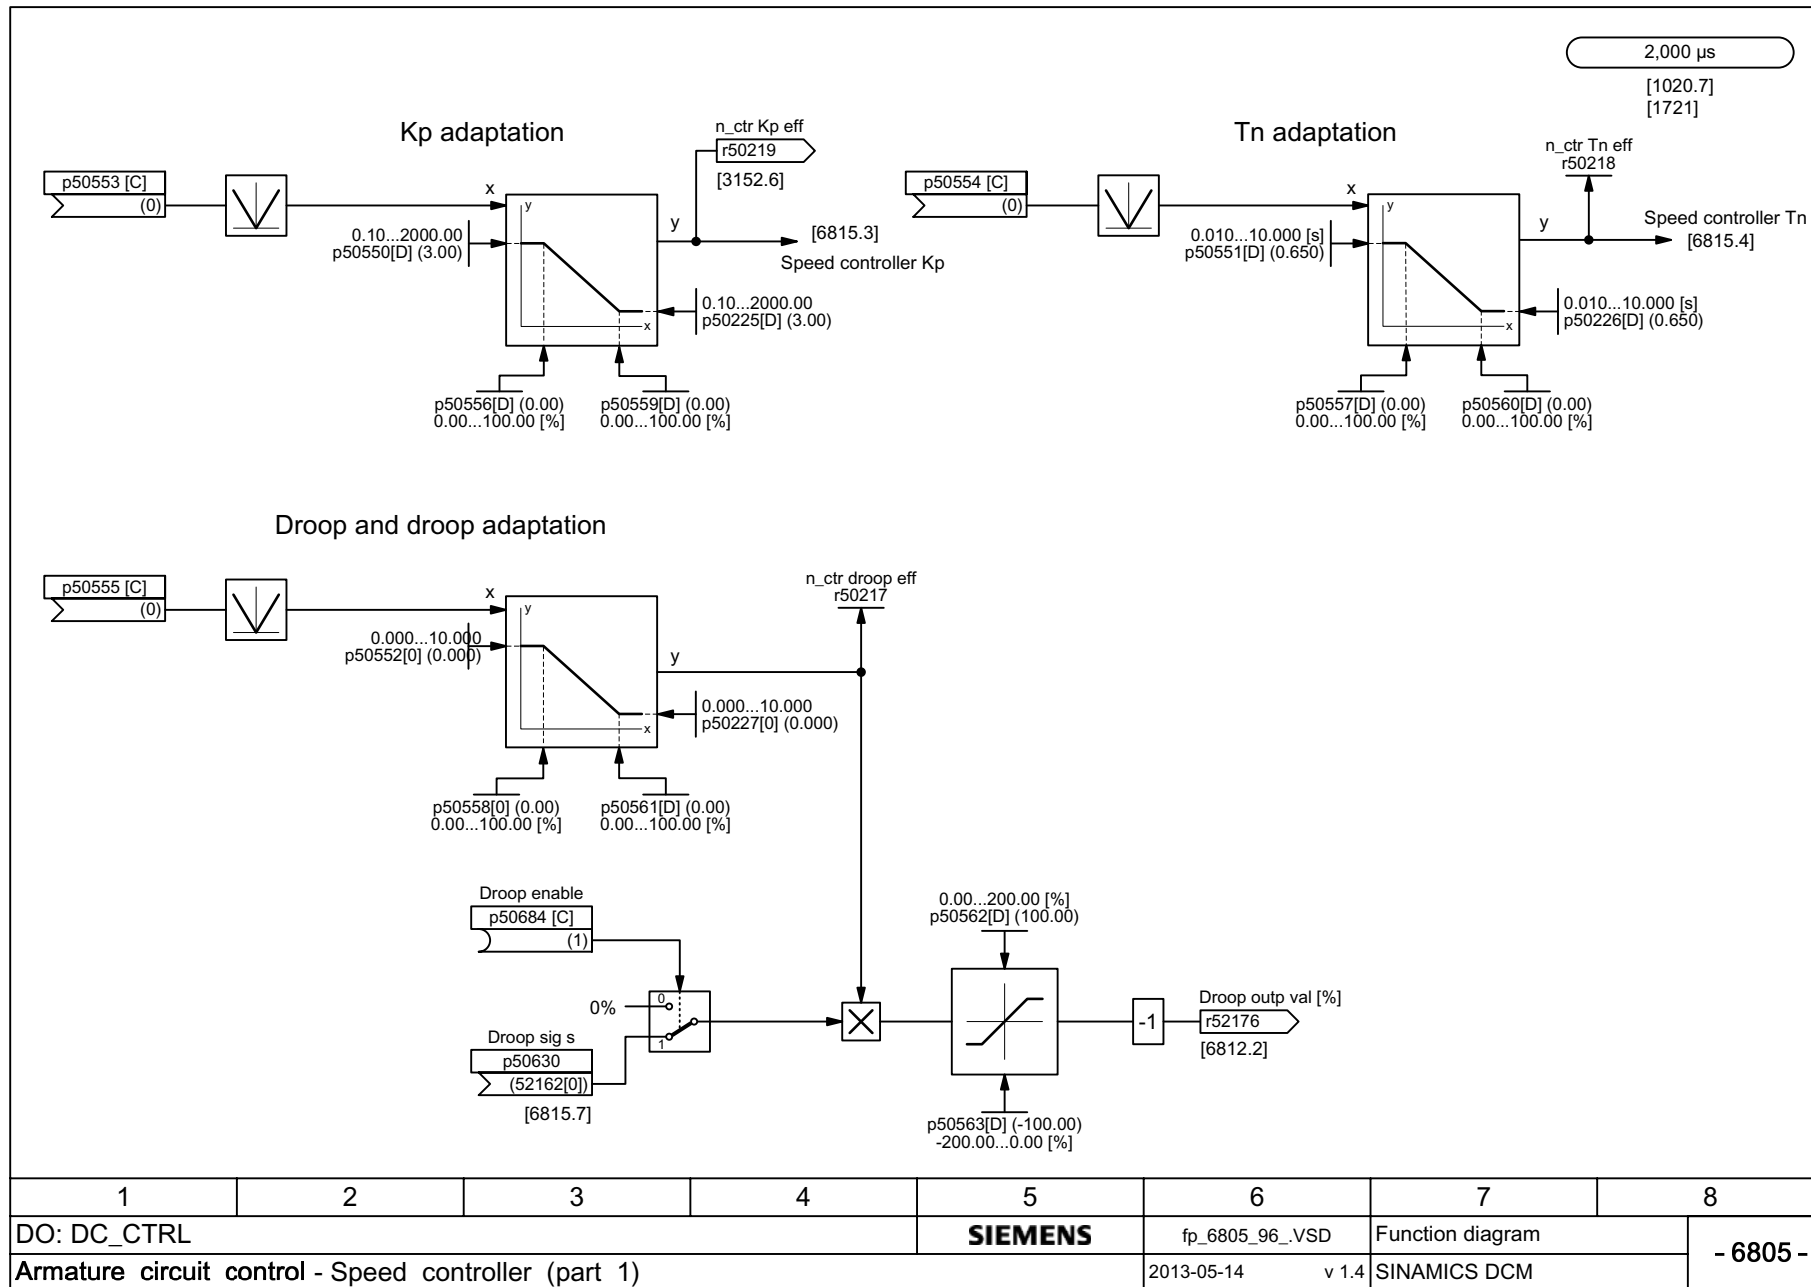


Fig. 2-78 6805 – Speed controller (Part 1)





## 6812 – Speed controller (Part 3)




Fig. 2-81 6815 – Speed controller (Part 4)

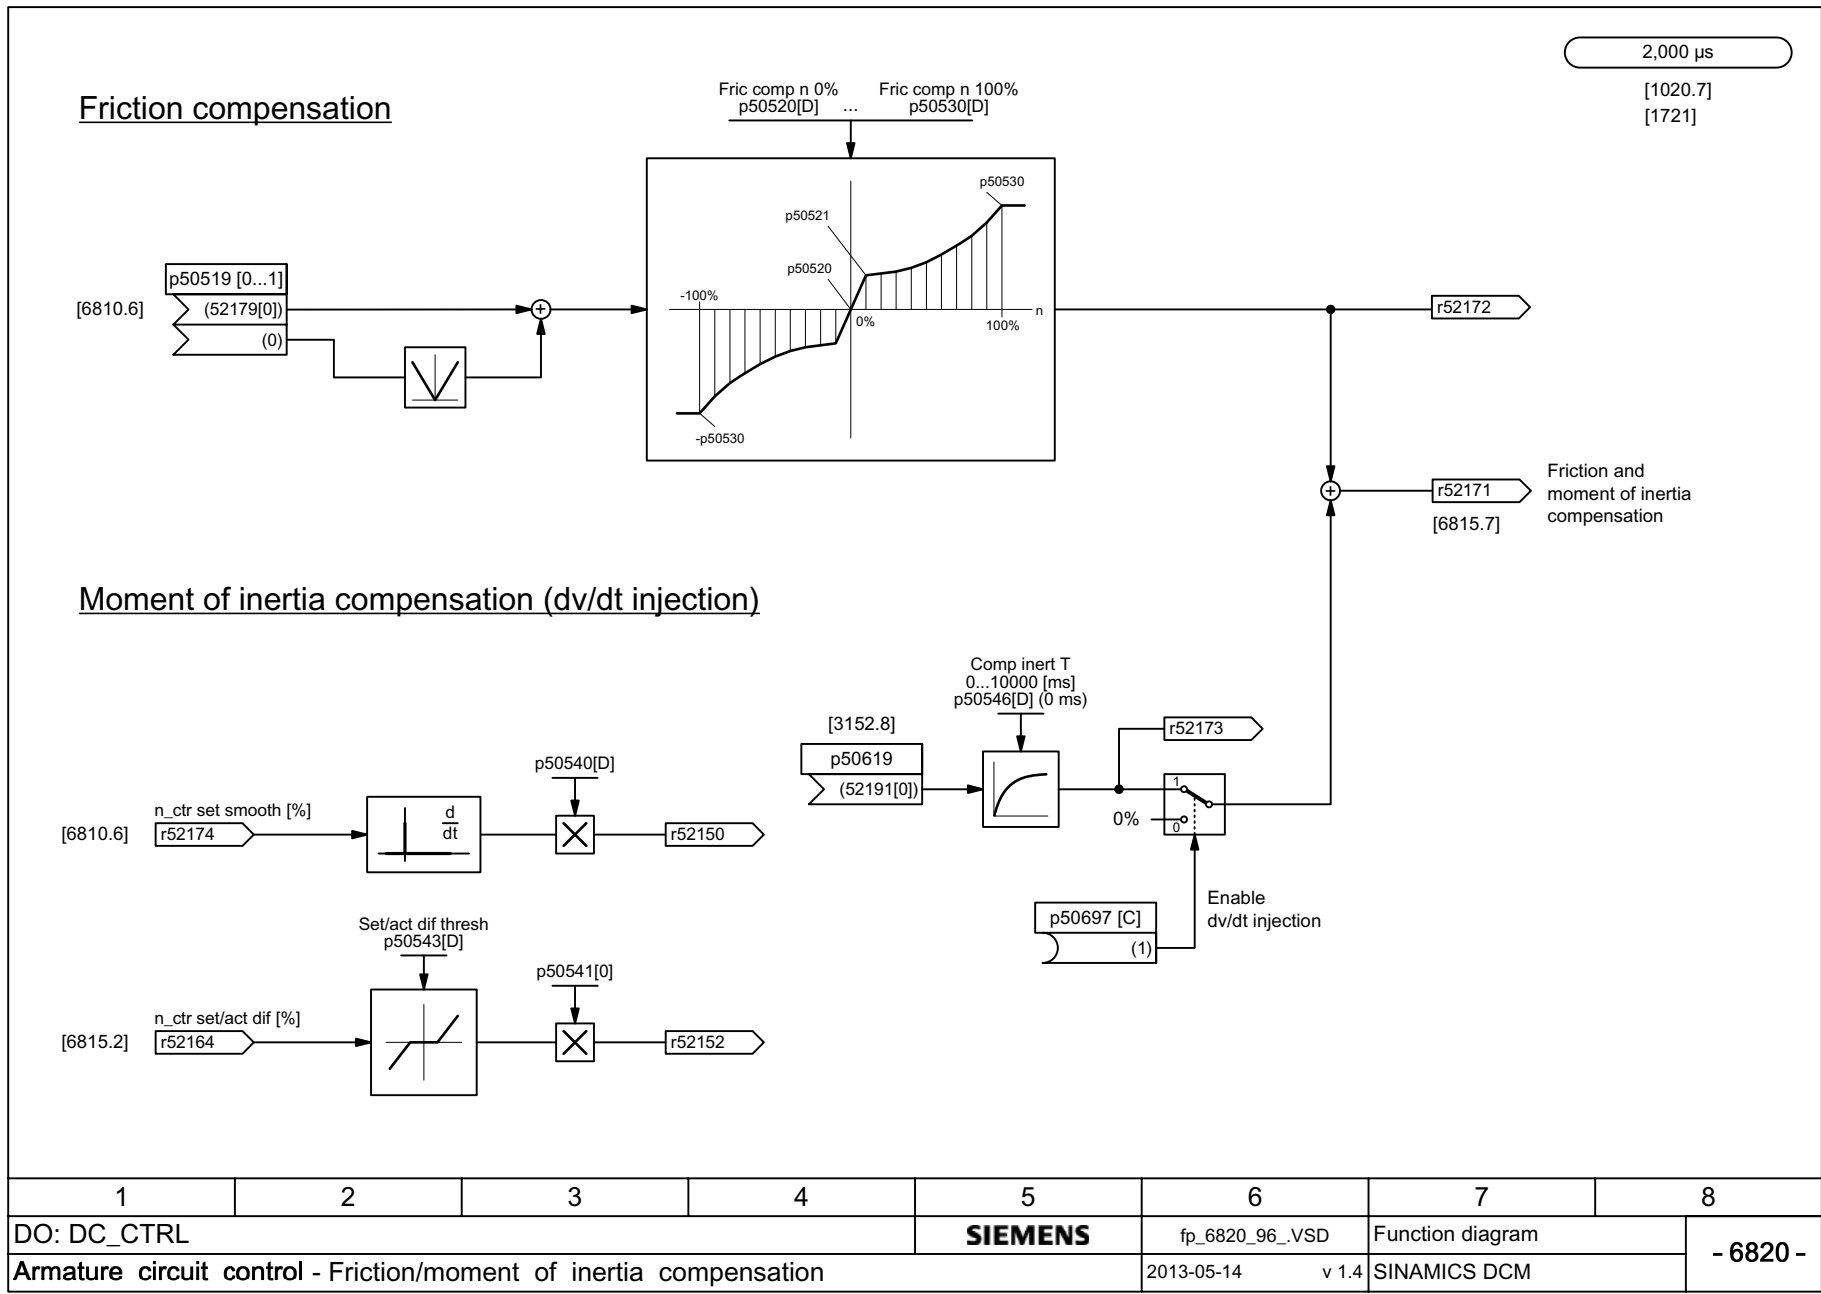


Fig. 2-82 6820 – Friction/moment of inertia compensation



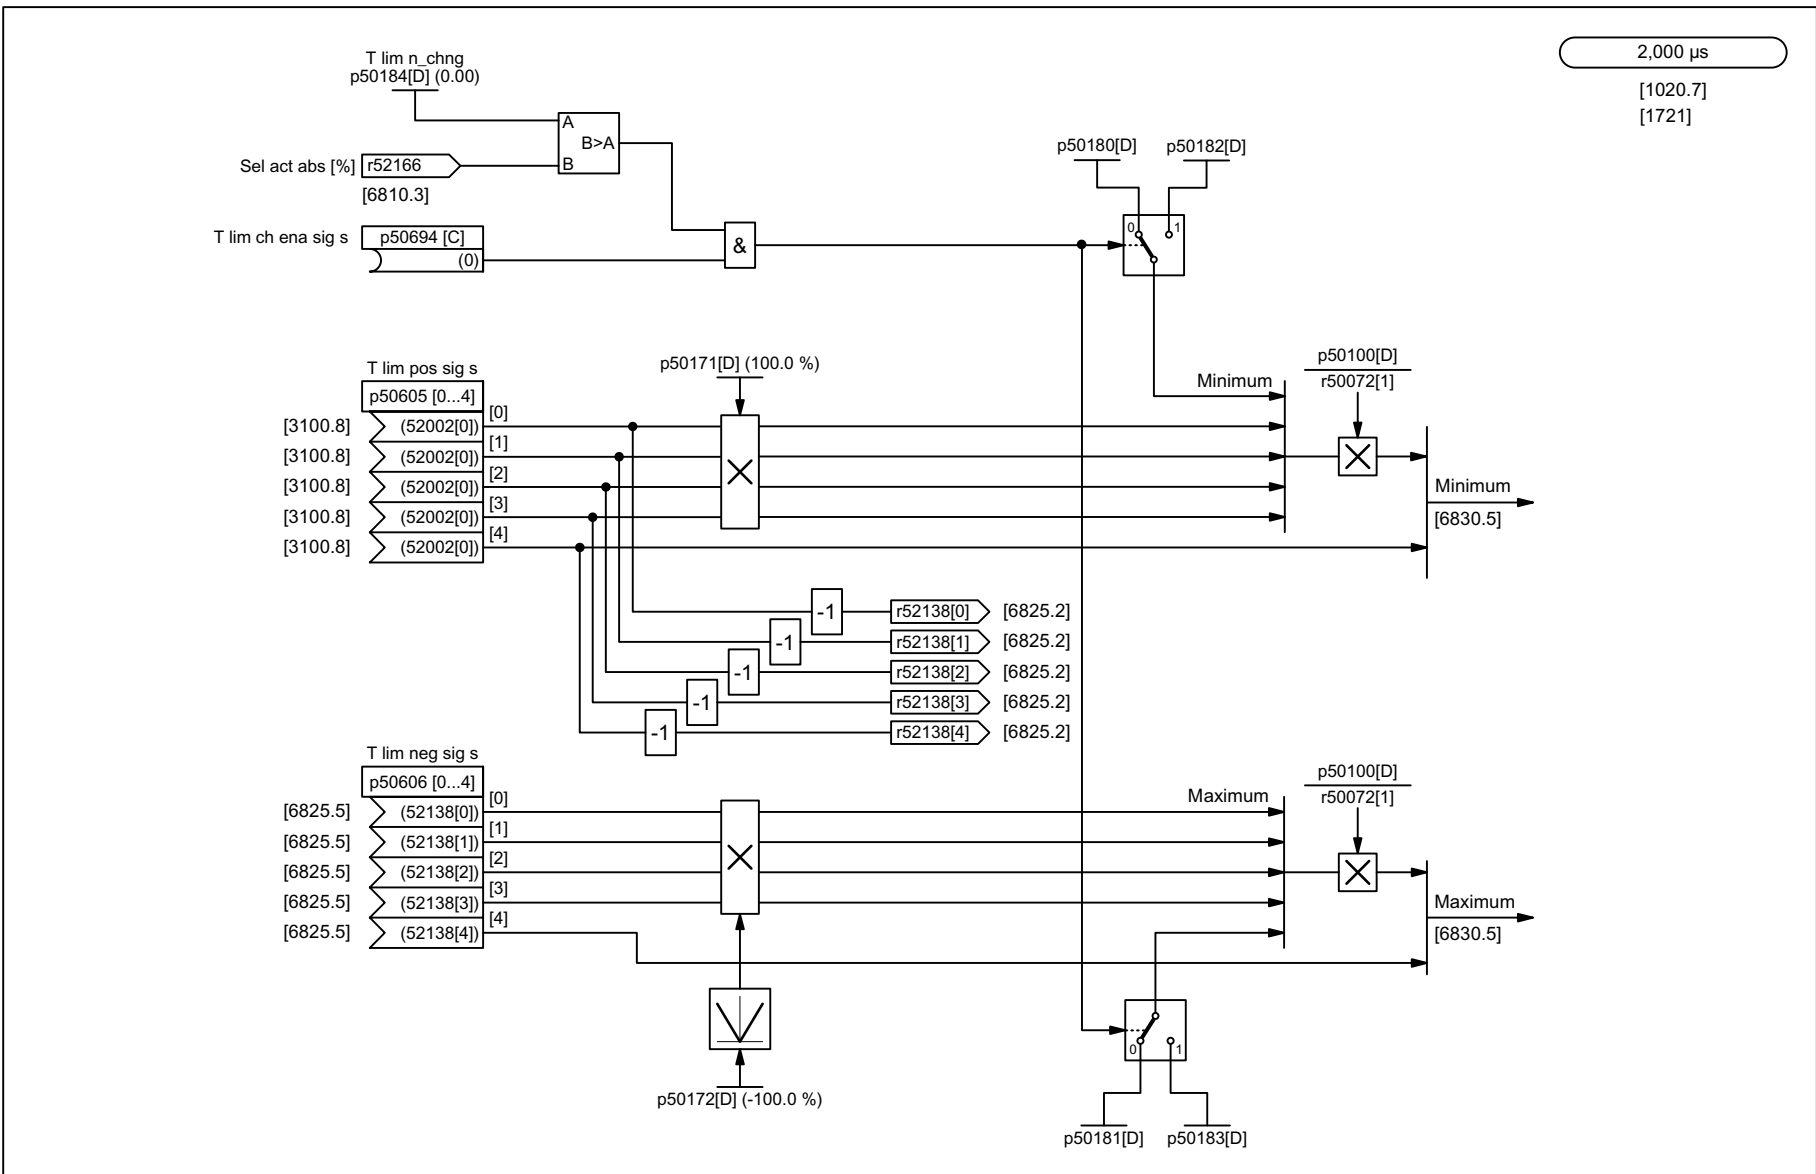


Fig. 2-83 6825 – Torque limiting (Part 1)

1	2	3	4	5	6	7	8
DO: DC_CTRL				<b>SIEMENS</b>	fp_6825_96_VSD	Function diagram	
Armature circuit control - Torque limitation (part 1)					2013-05-14 v 1.4	SINAMICS DCM	
							- 6825 -

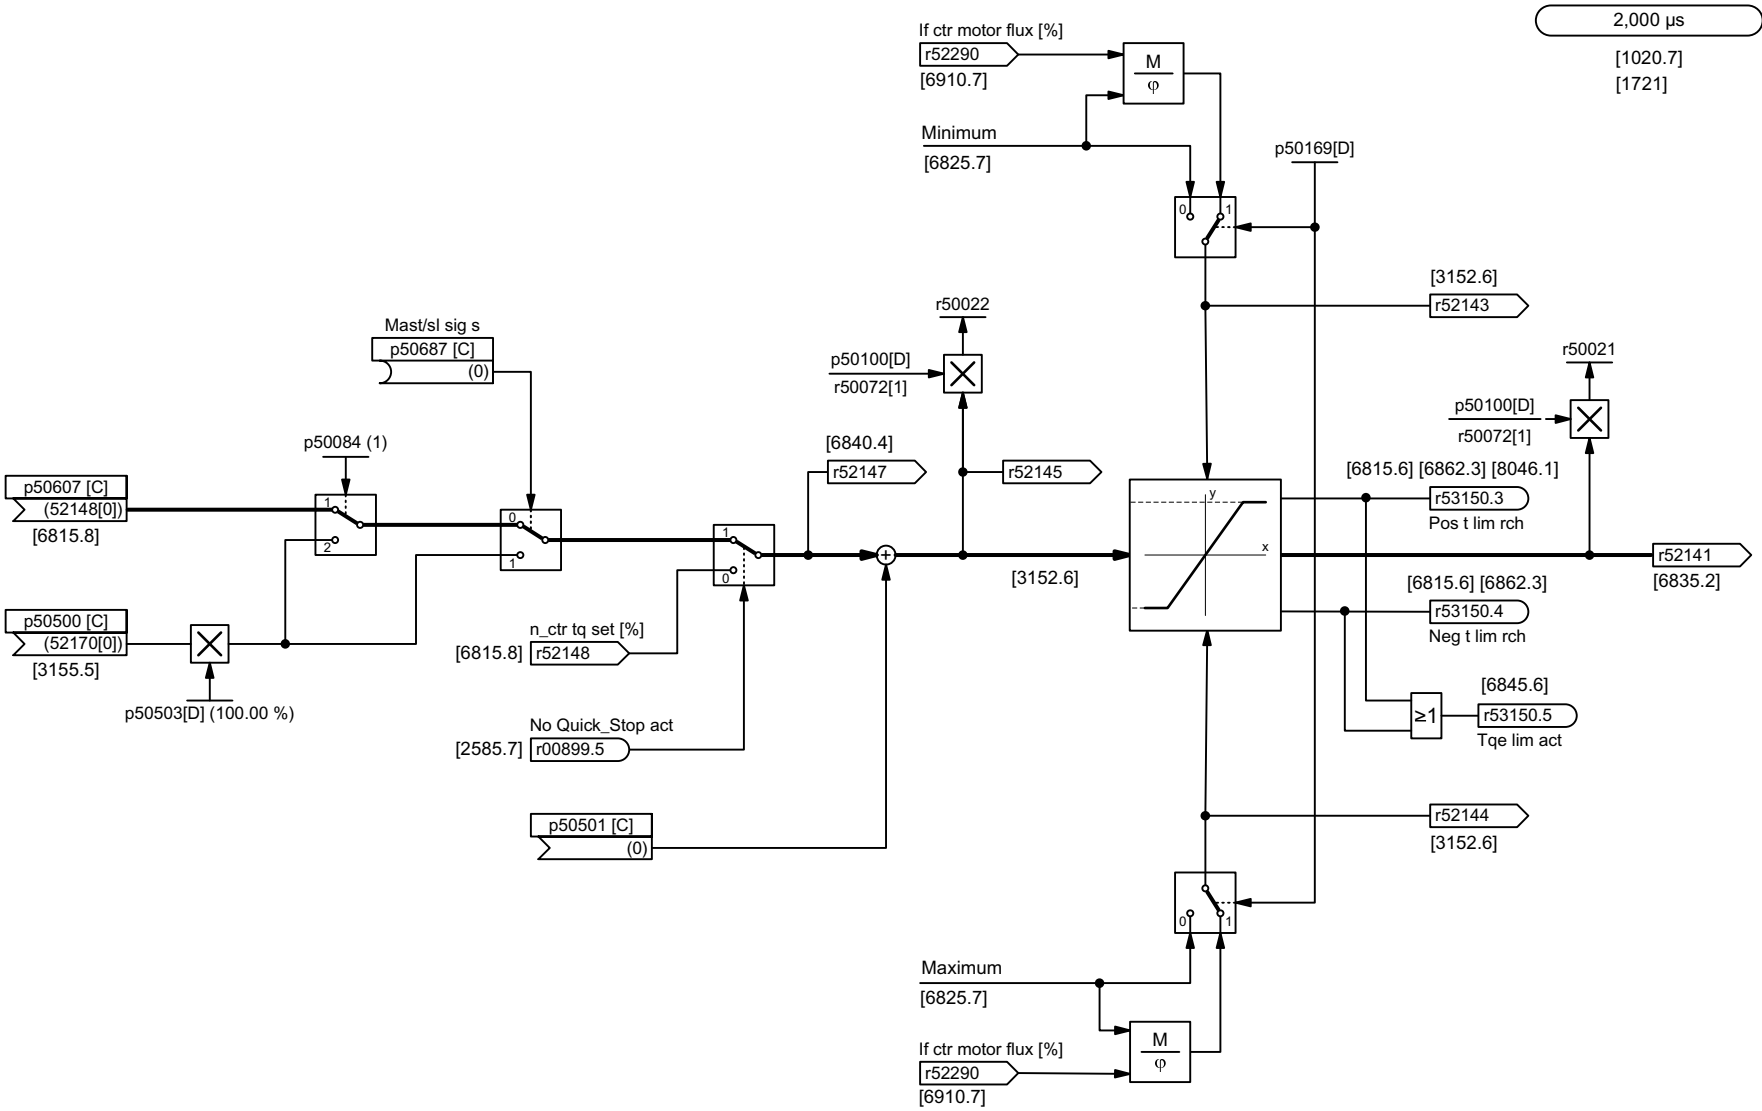


## 6830 – Torque limiting (Part 2)

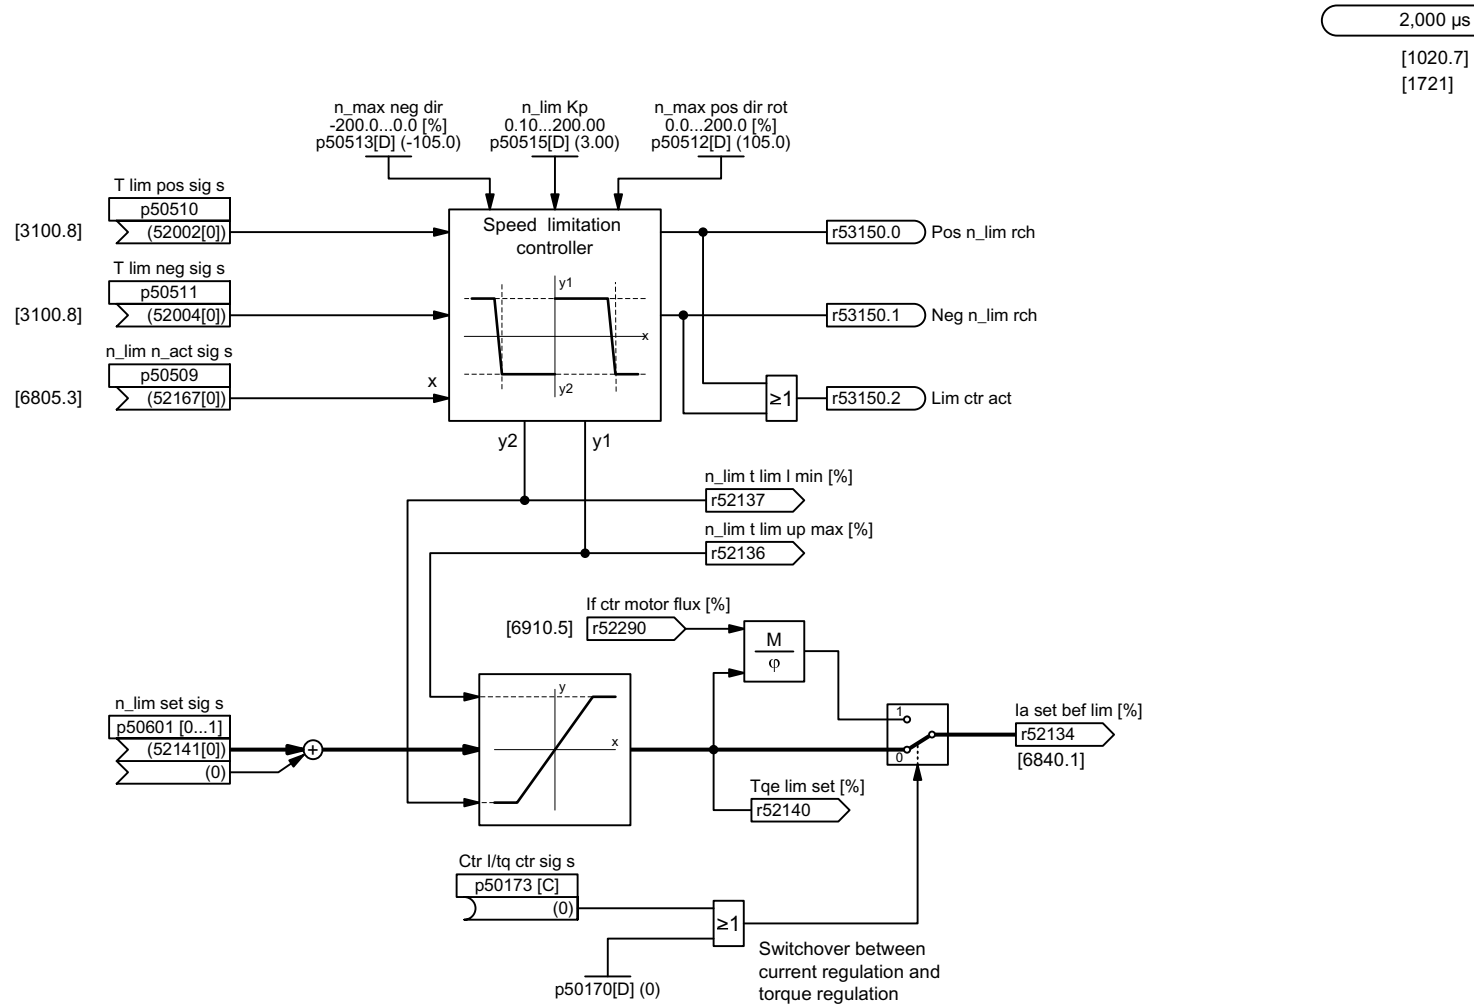

1	2	3	4	5	6	7	8
DO: DC_CTRL				<b>SIEMENS</b>	fp_6835_96_VSD	Function diagram	
Armature circuit control - Speed limitation controller					2013-05-14 v 1.4	SINAMICS DCM	
							- 6835 -

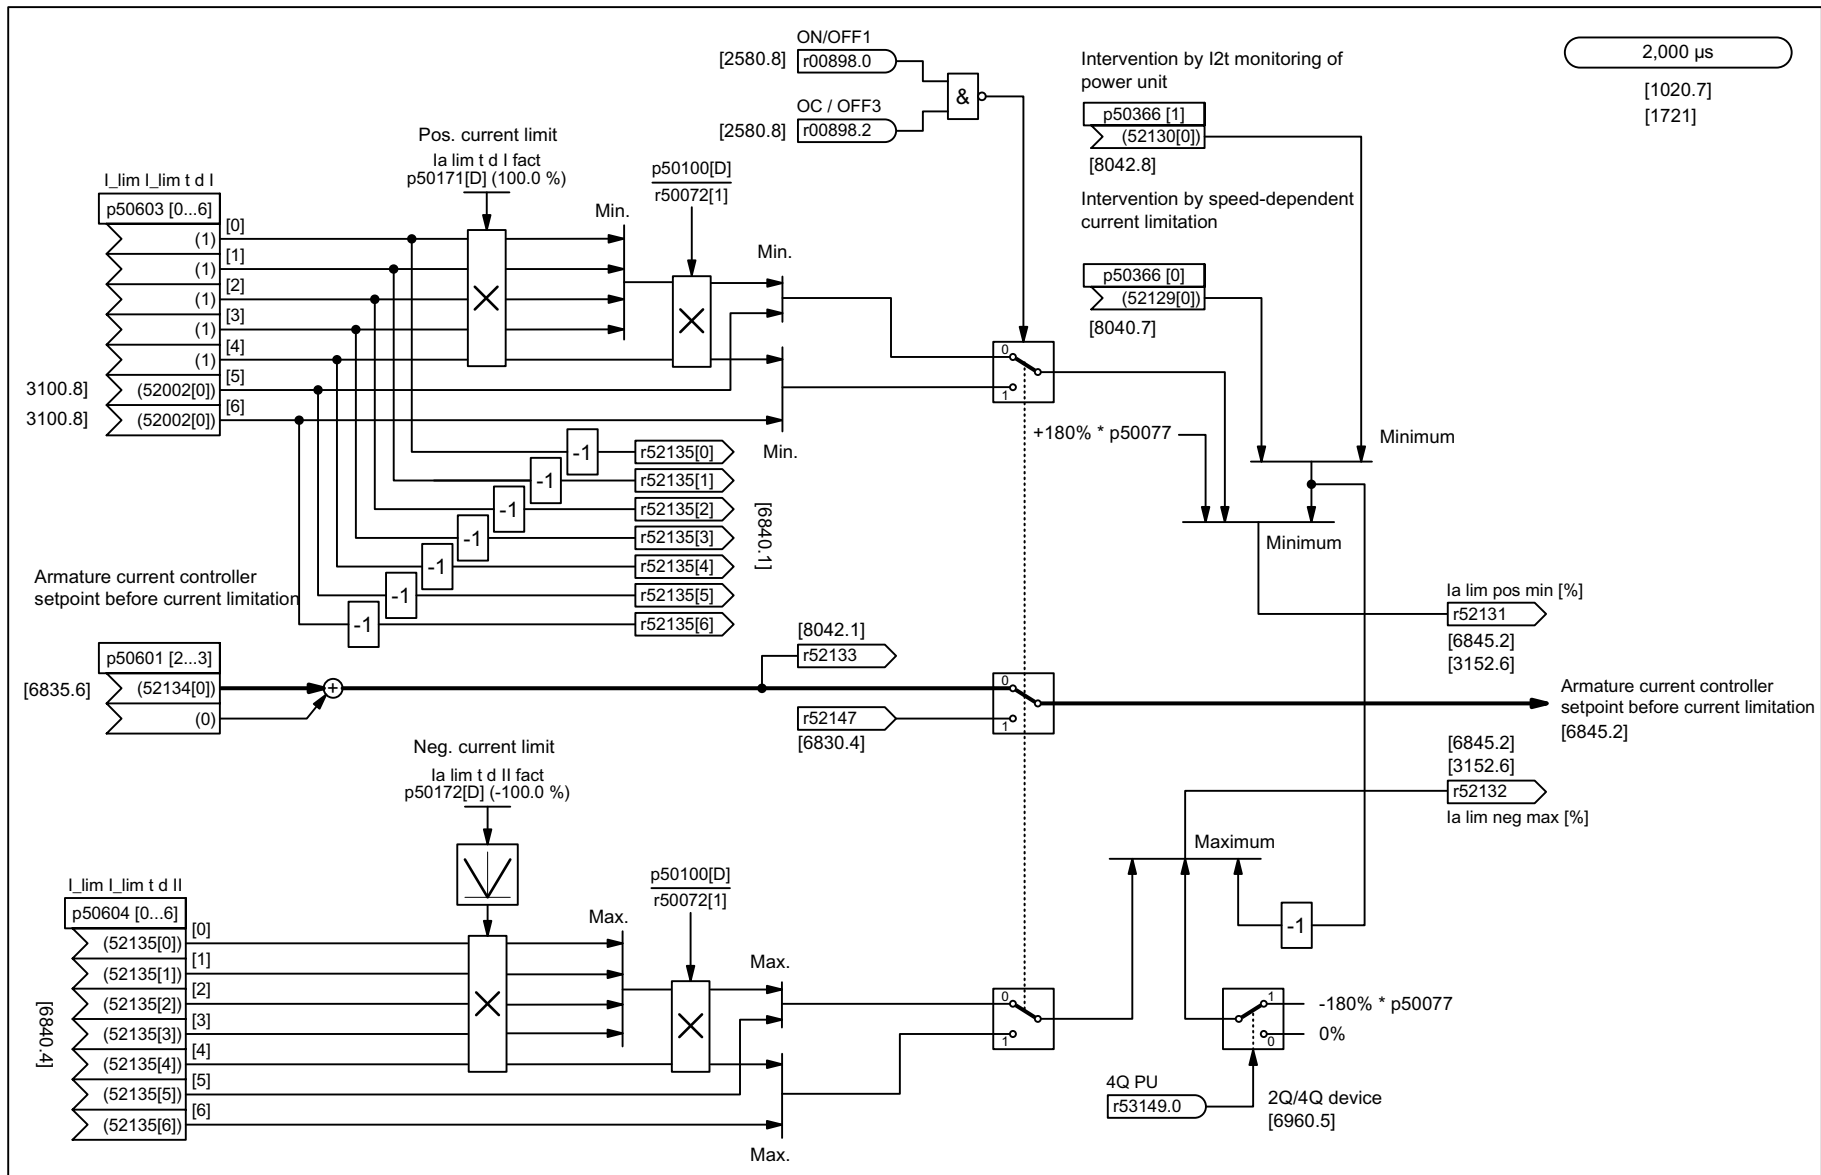Fig. 2-85 6835 – Speed limiting controller





1	2	3	4	5	6	7	8
DO: DC_CTRL				<b>SIEMENS</b>	fp_6840_96_VSD	Function diagram	- 6840 -
Armature circuit control - Current limitation (part 1)					2013-05-14	v 1.4	SINAMICS DCM

Fig. 2-86 6840 – Current limitation (Part 1)

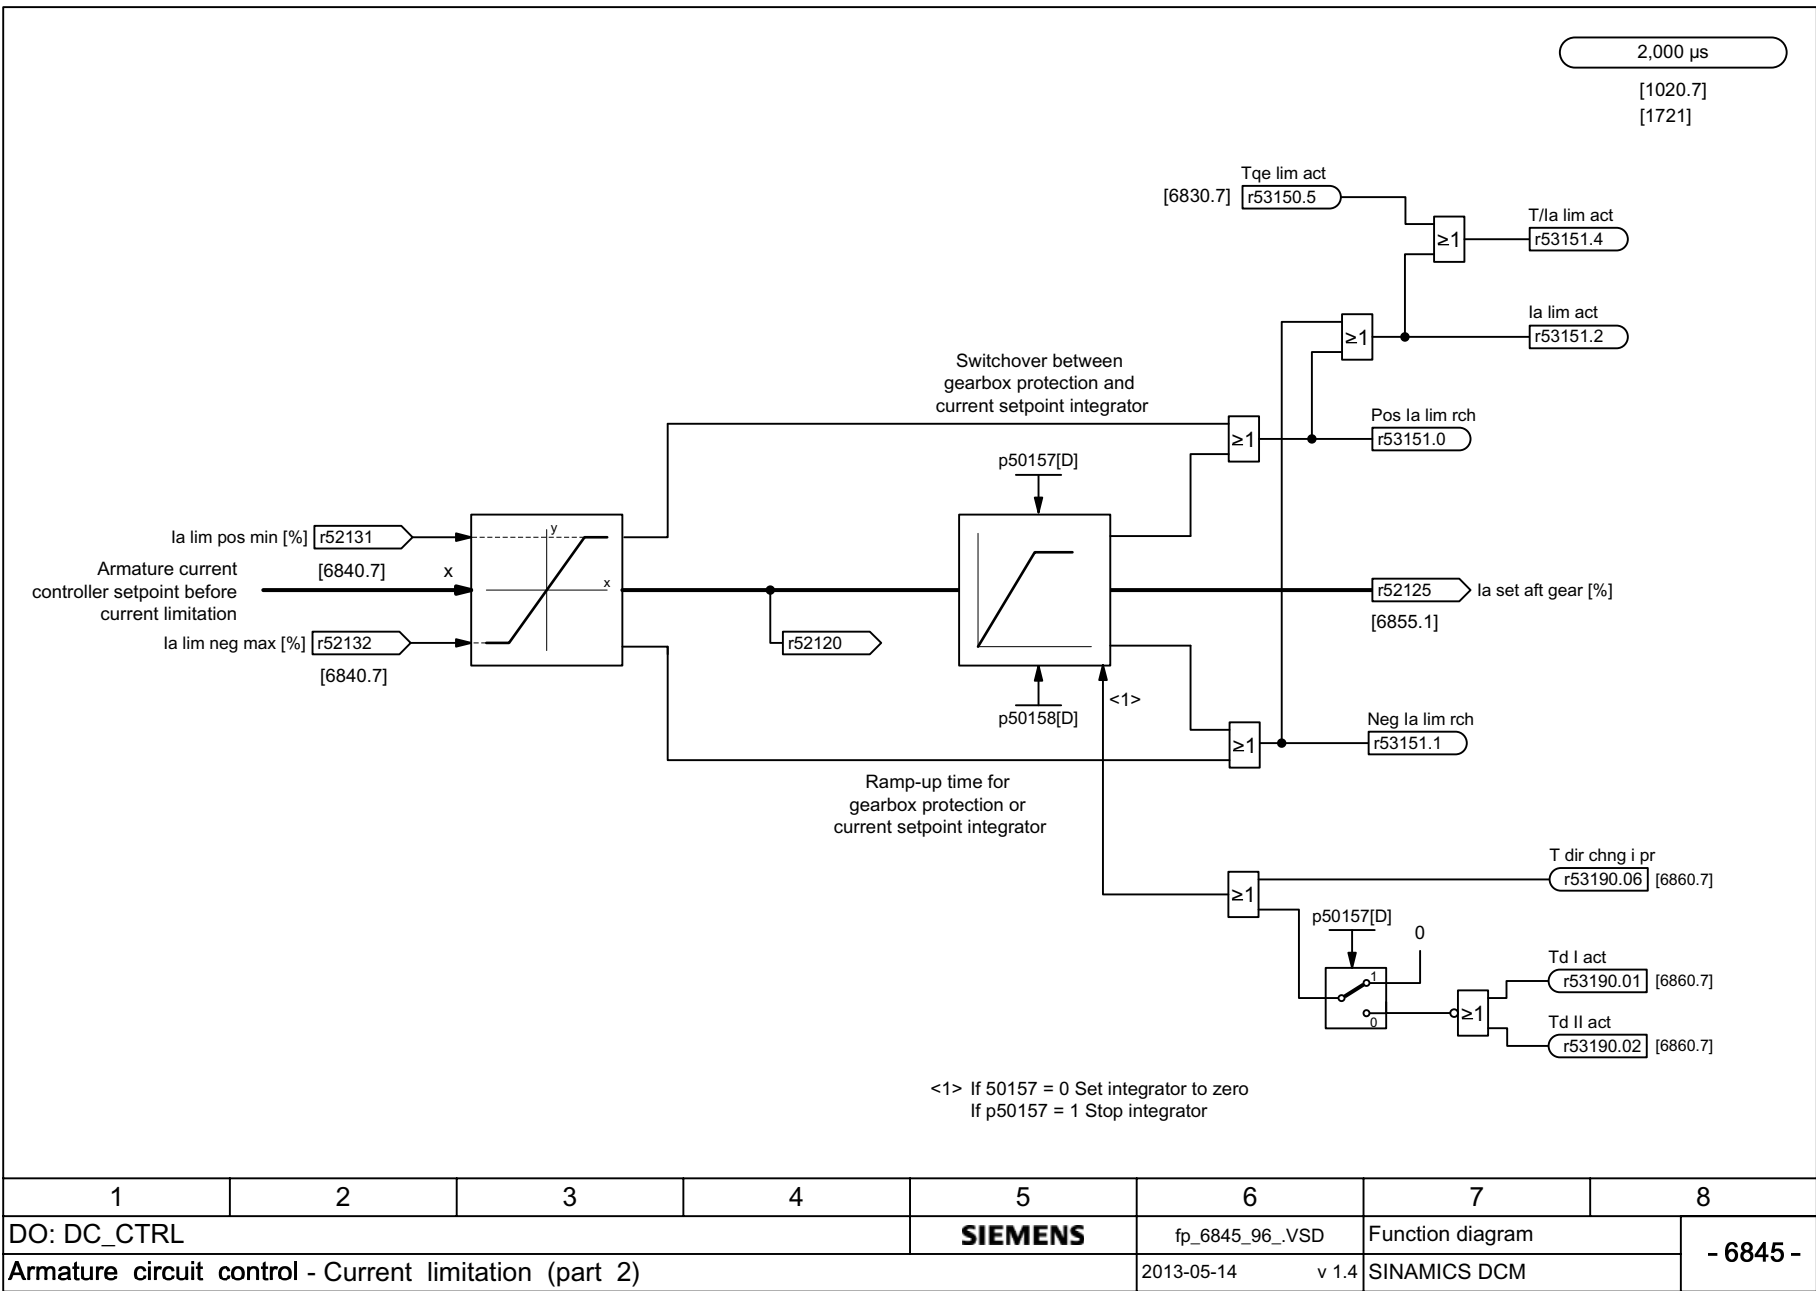


Fig. 2-87 6845 – Current limitation (Part 2)






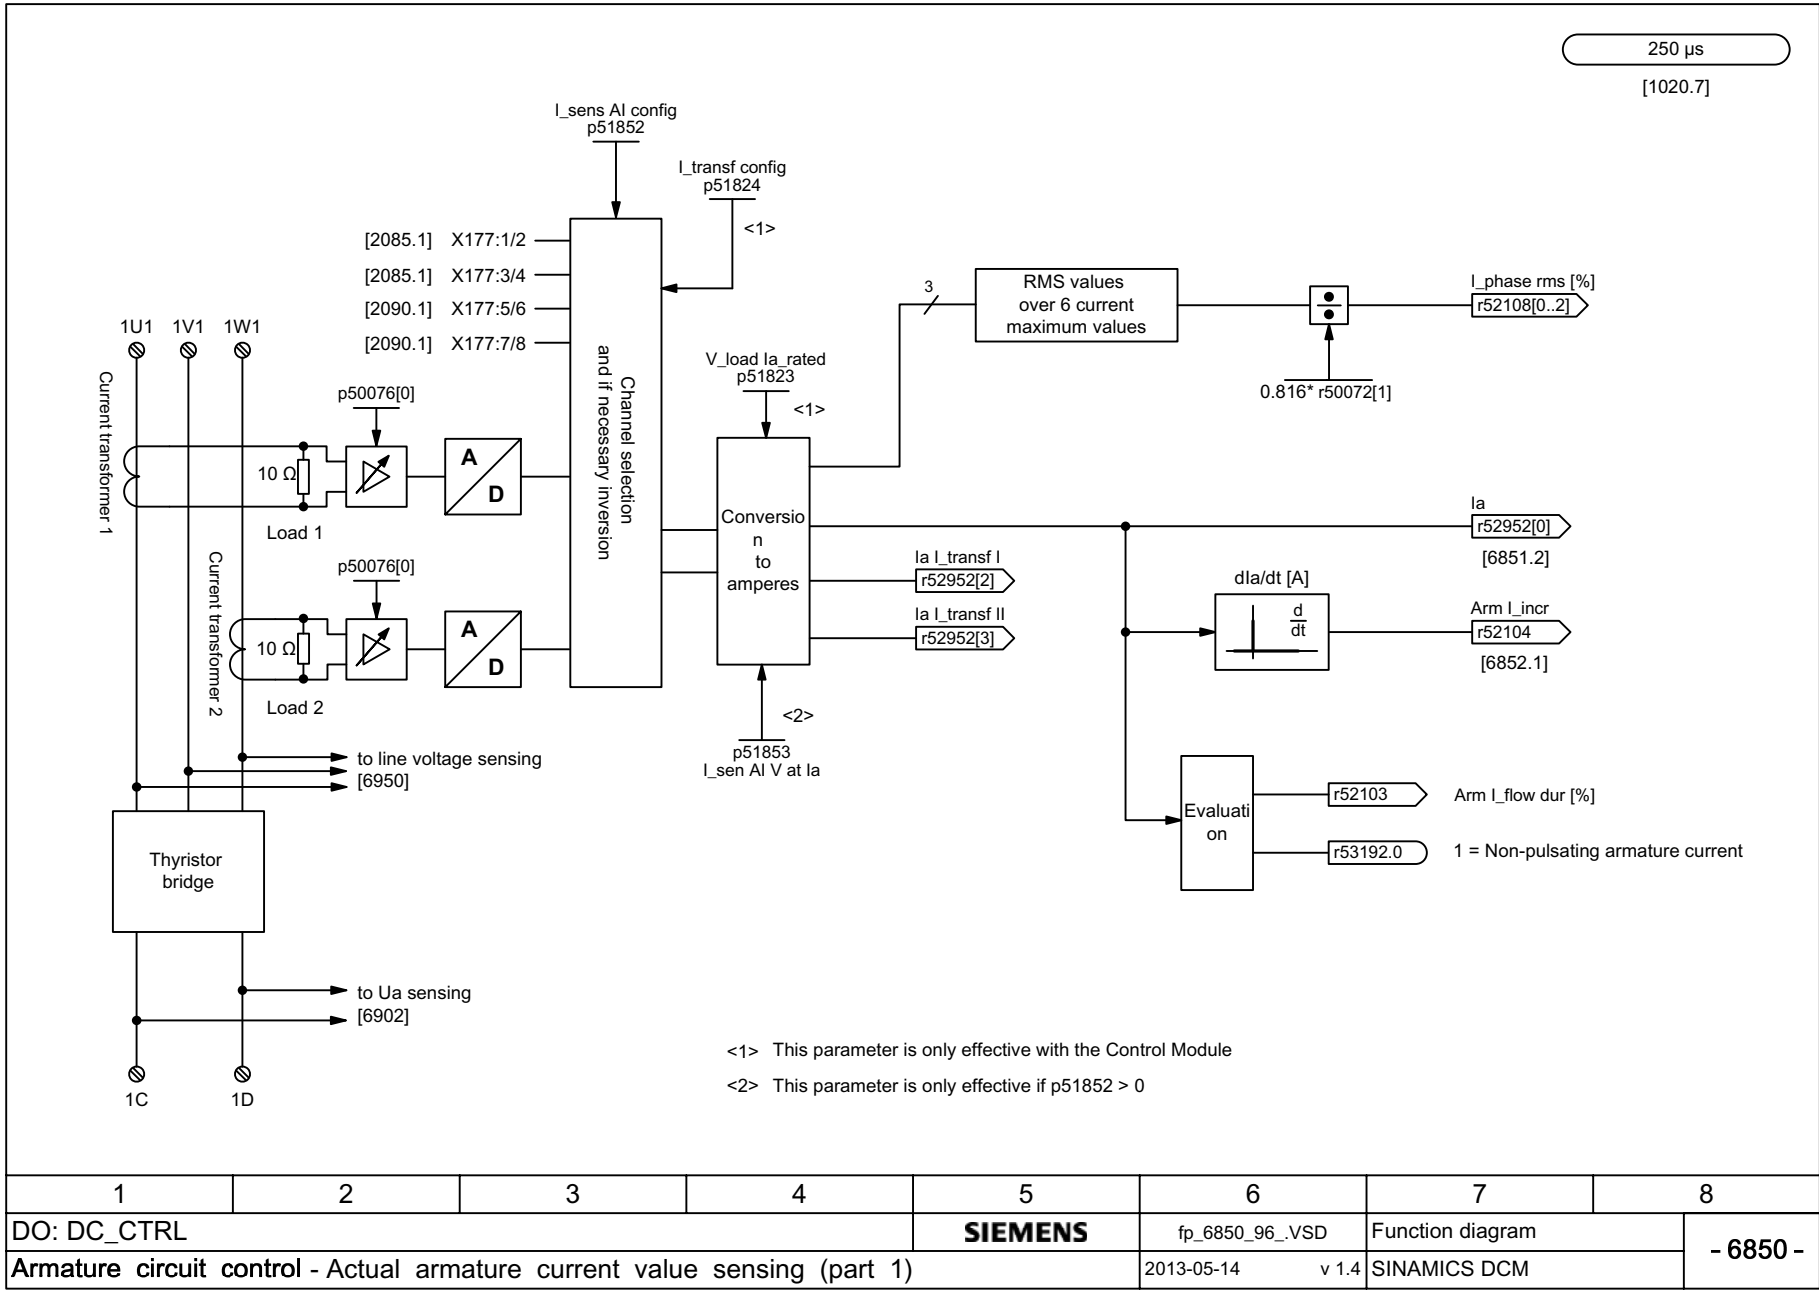Fig. 2-89 6851 – Armature current actual value sensing (Part 2)

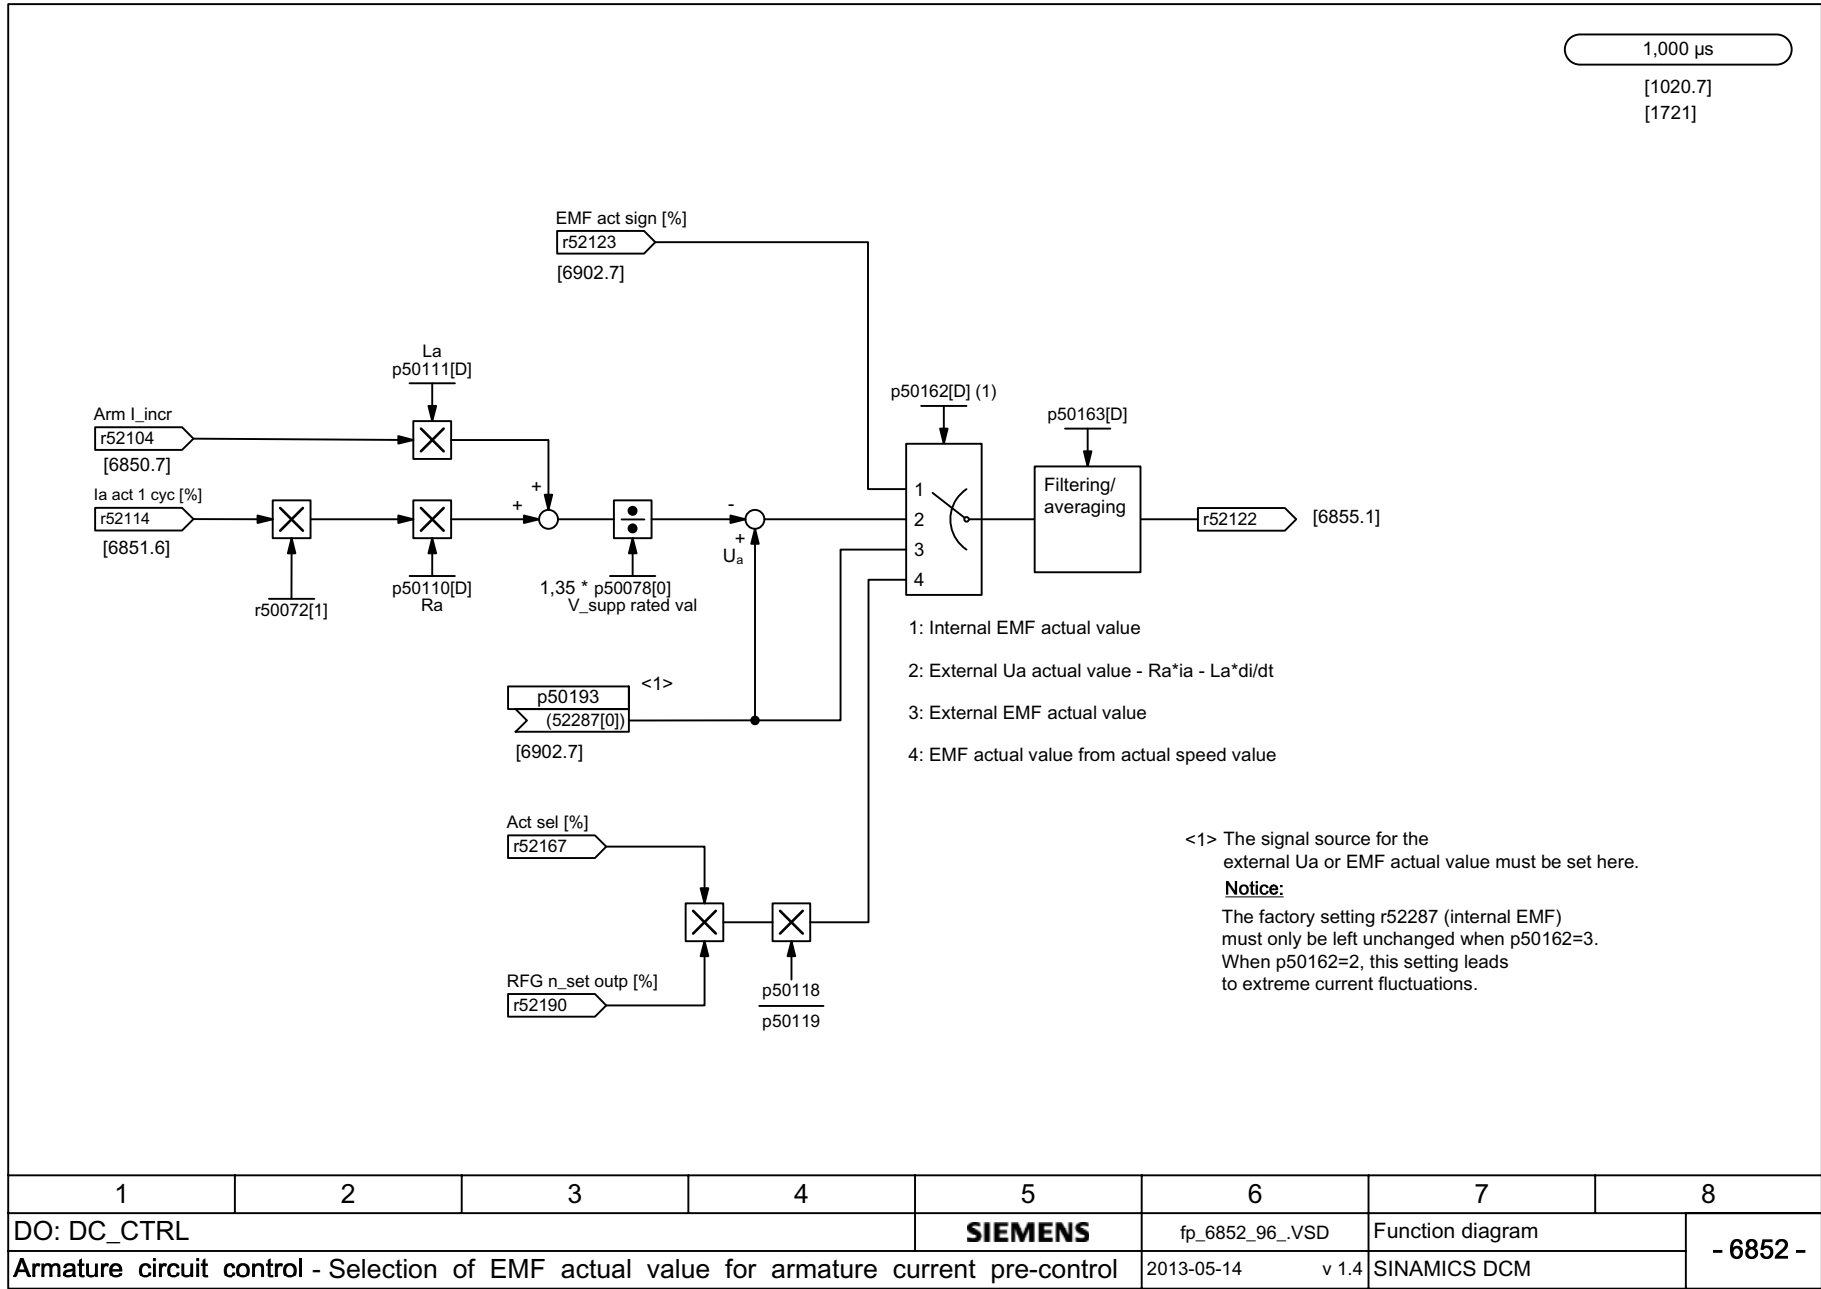


Fig. 2-90 6852 – EMF actual value selection for armature current precontrol

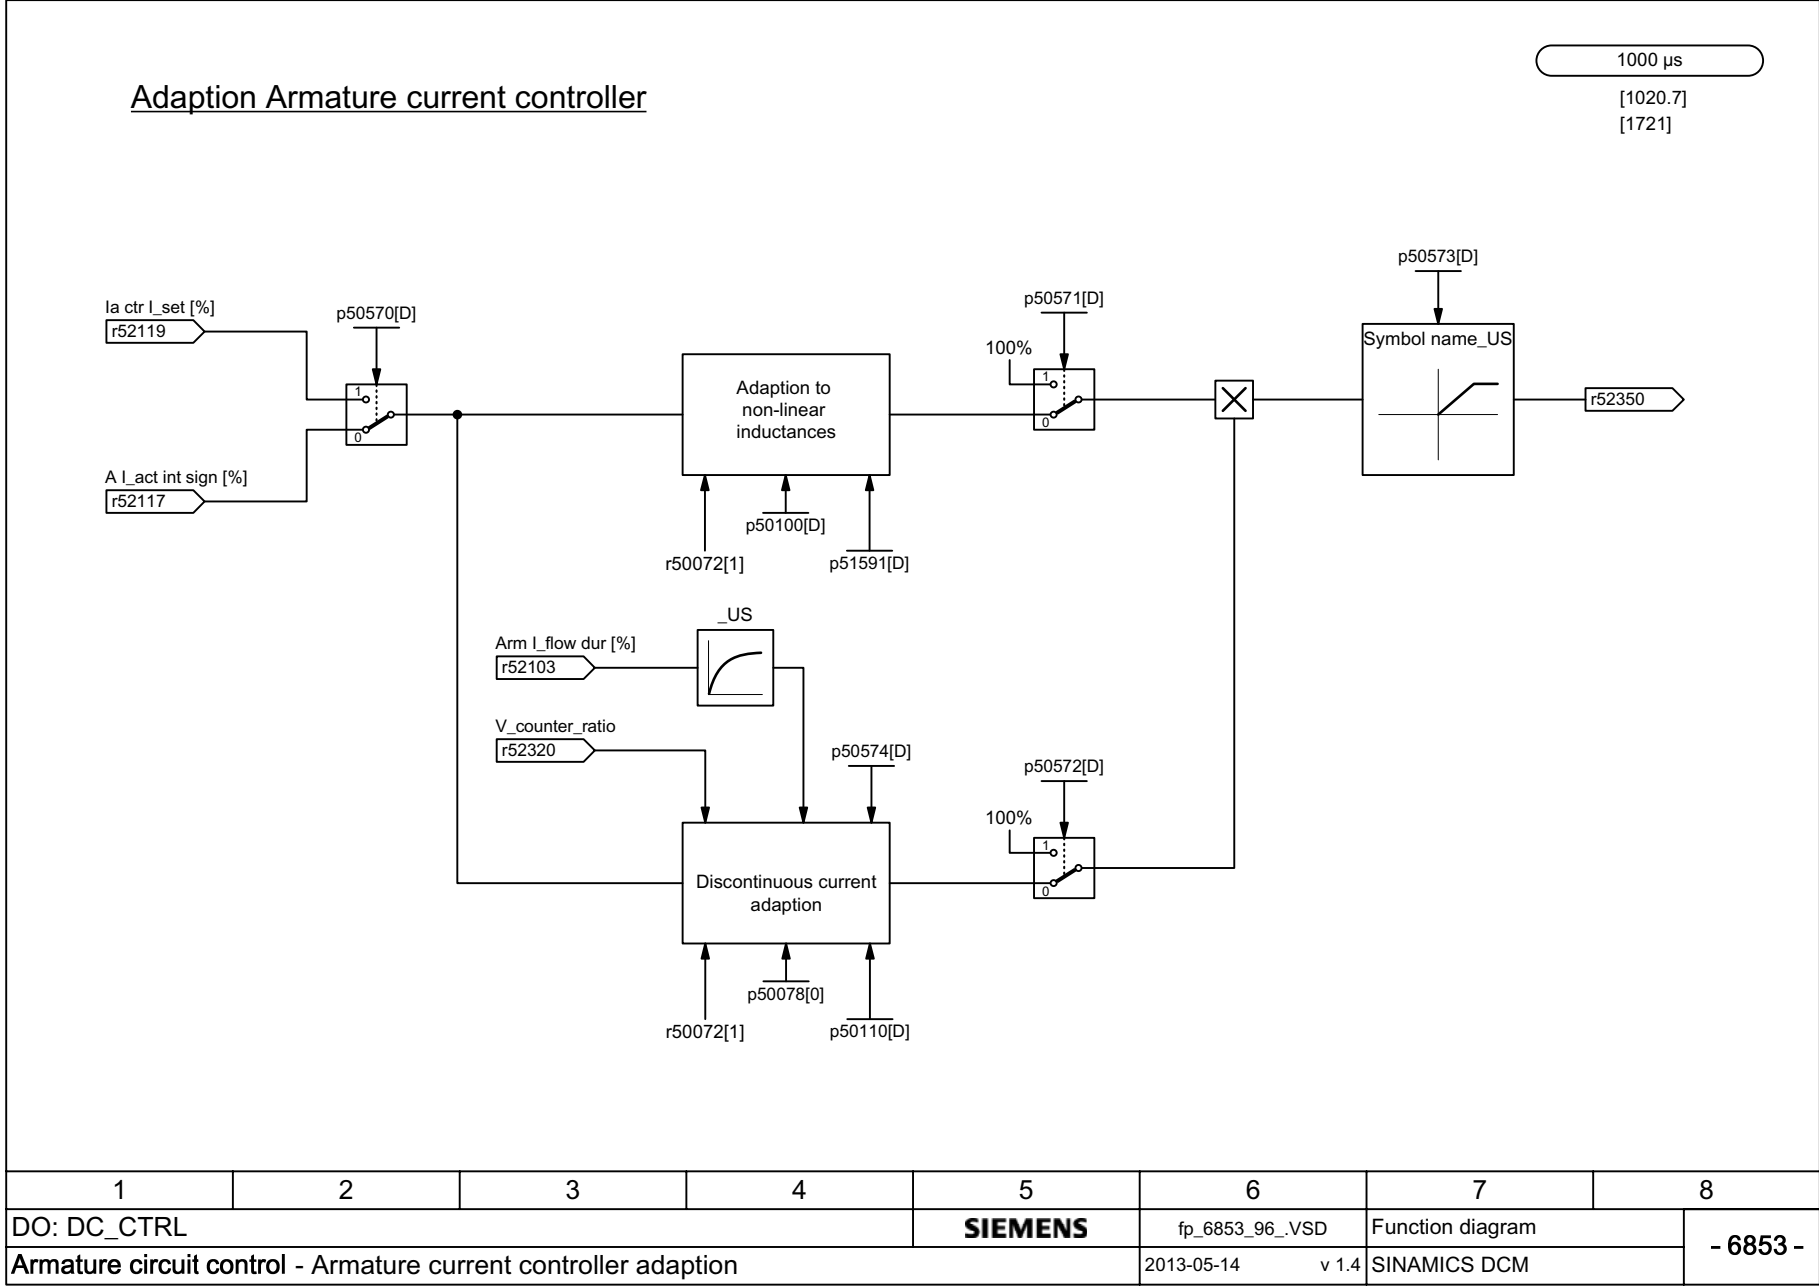


Fig. 2-91

6853 – Armature current controller adaptation

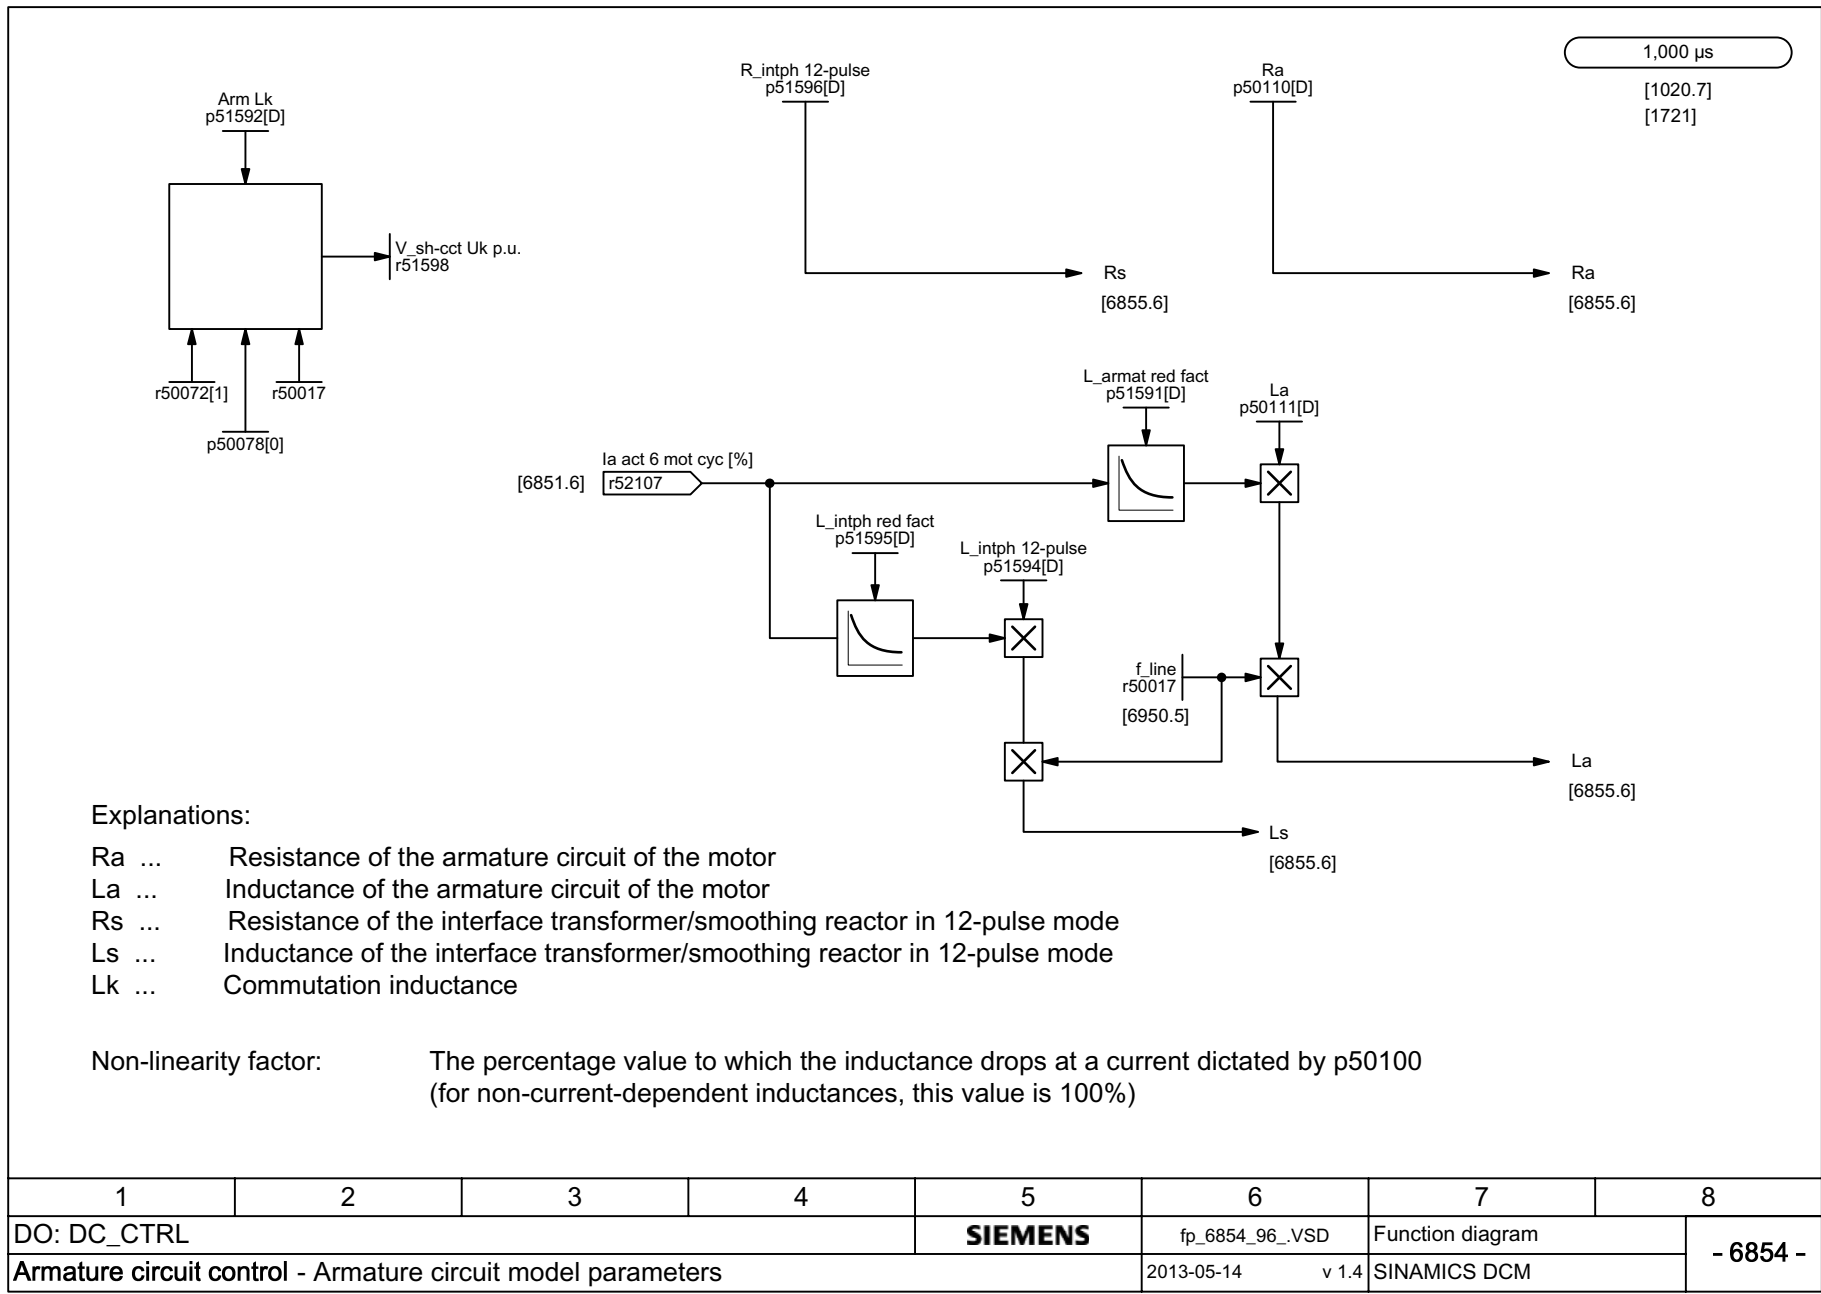


Fig. 2-92 6854 – Armature circuit model parameters



6855 – Armature current closed-loop control




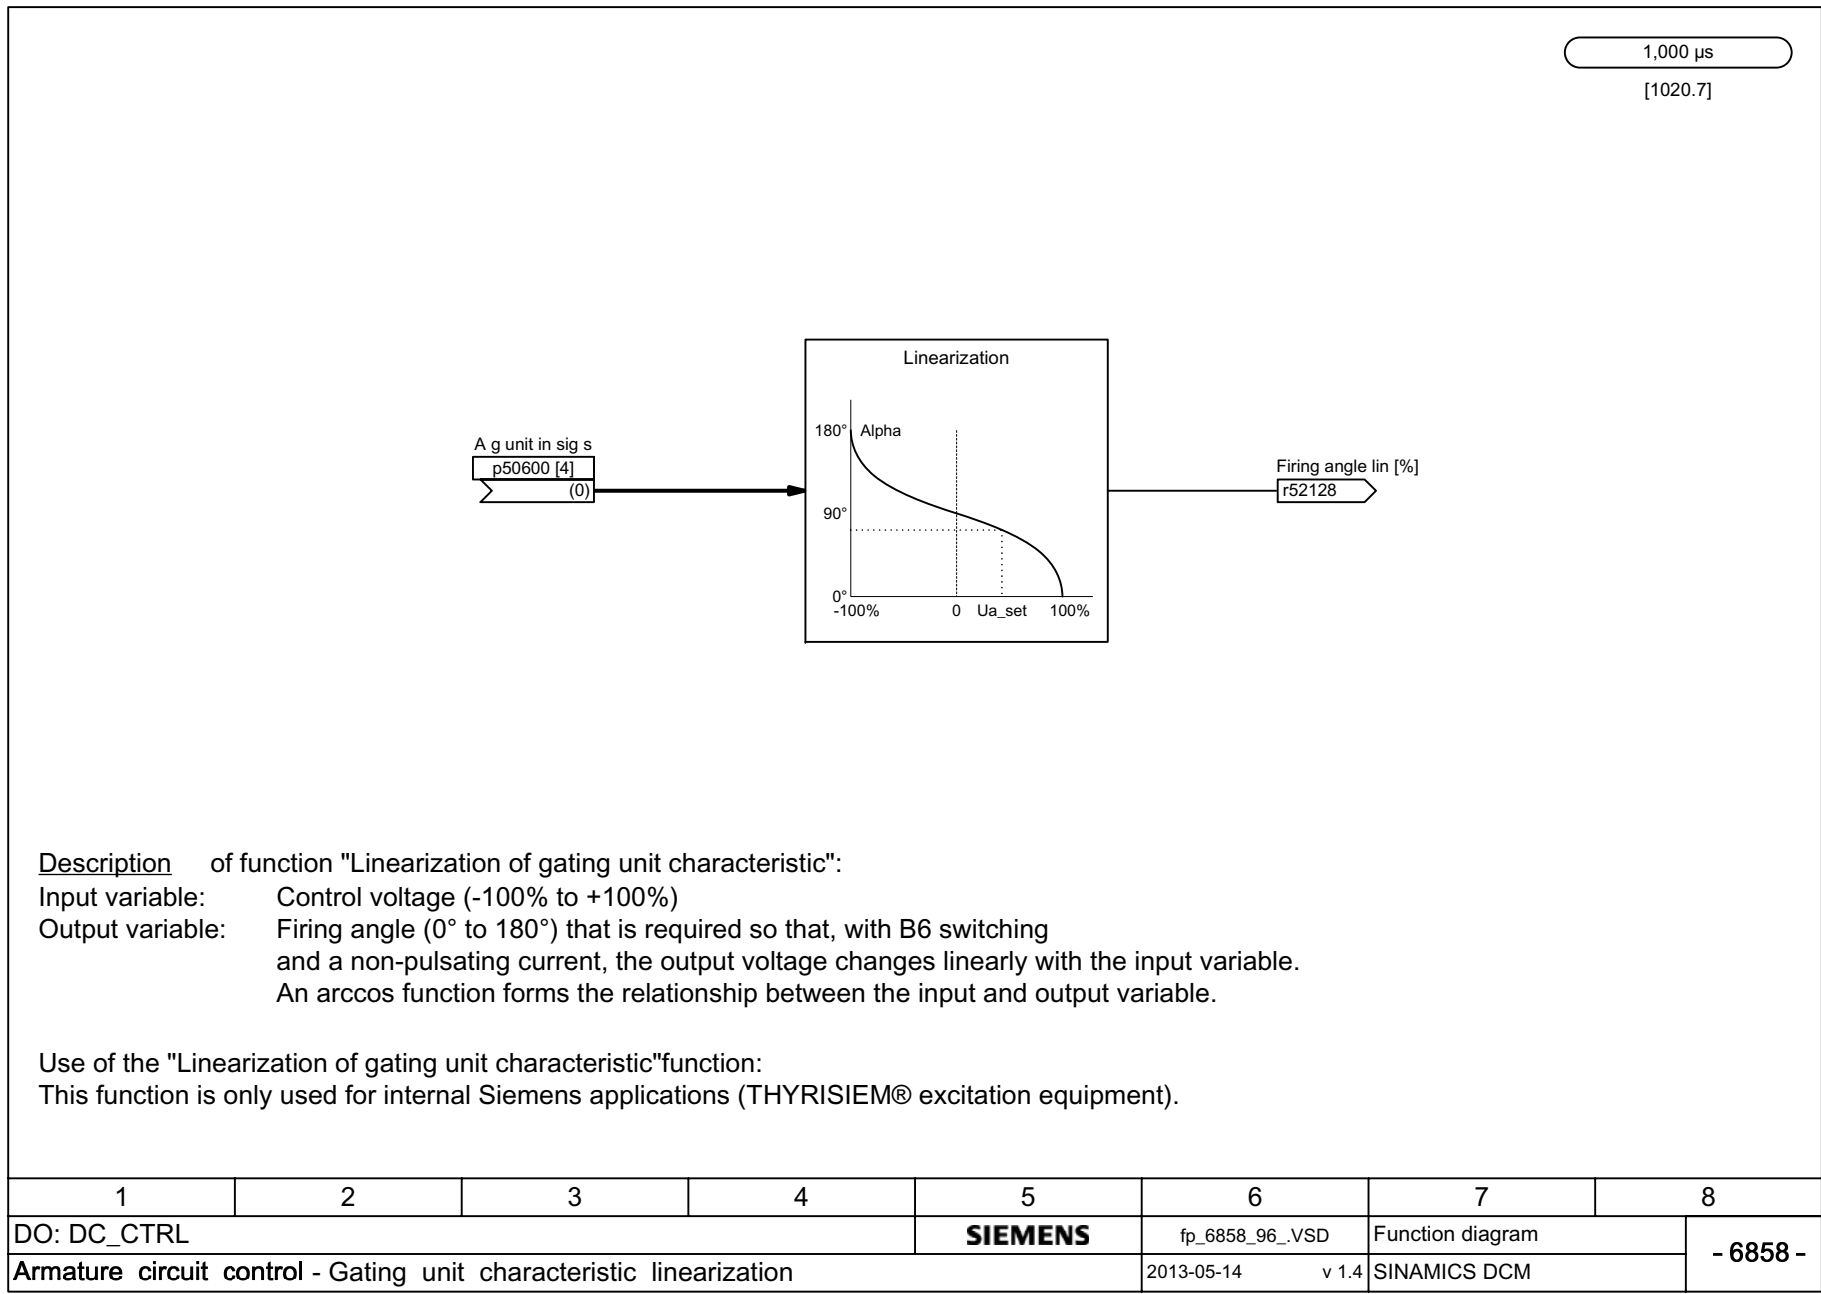


Fig. 2-94 6858 – Gating unit characteristic, linearization



6860 – Auto-reversing stage, armature gating unit

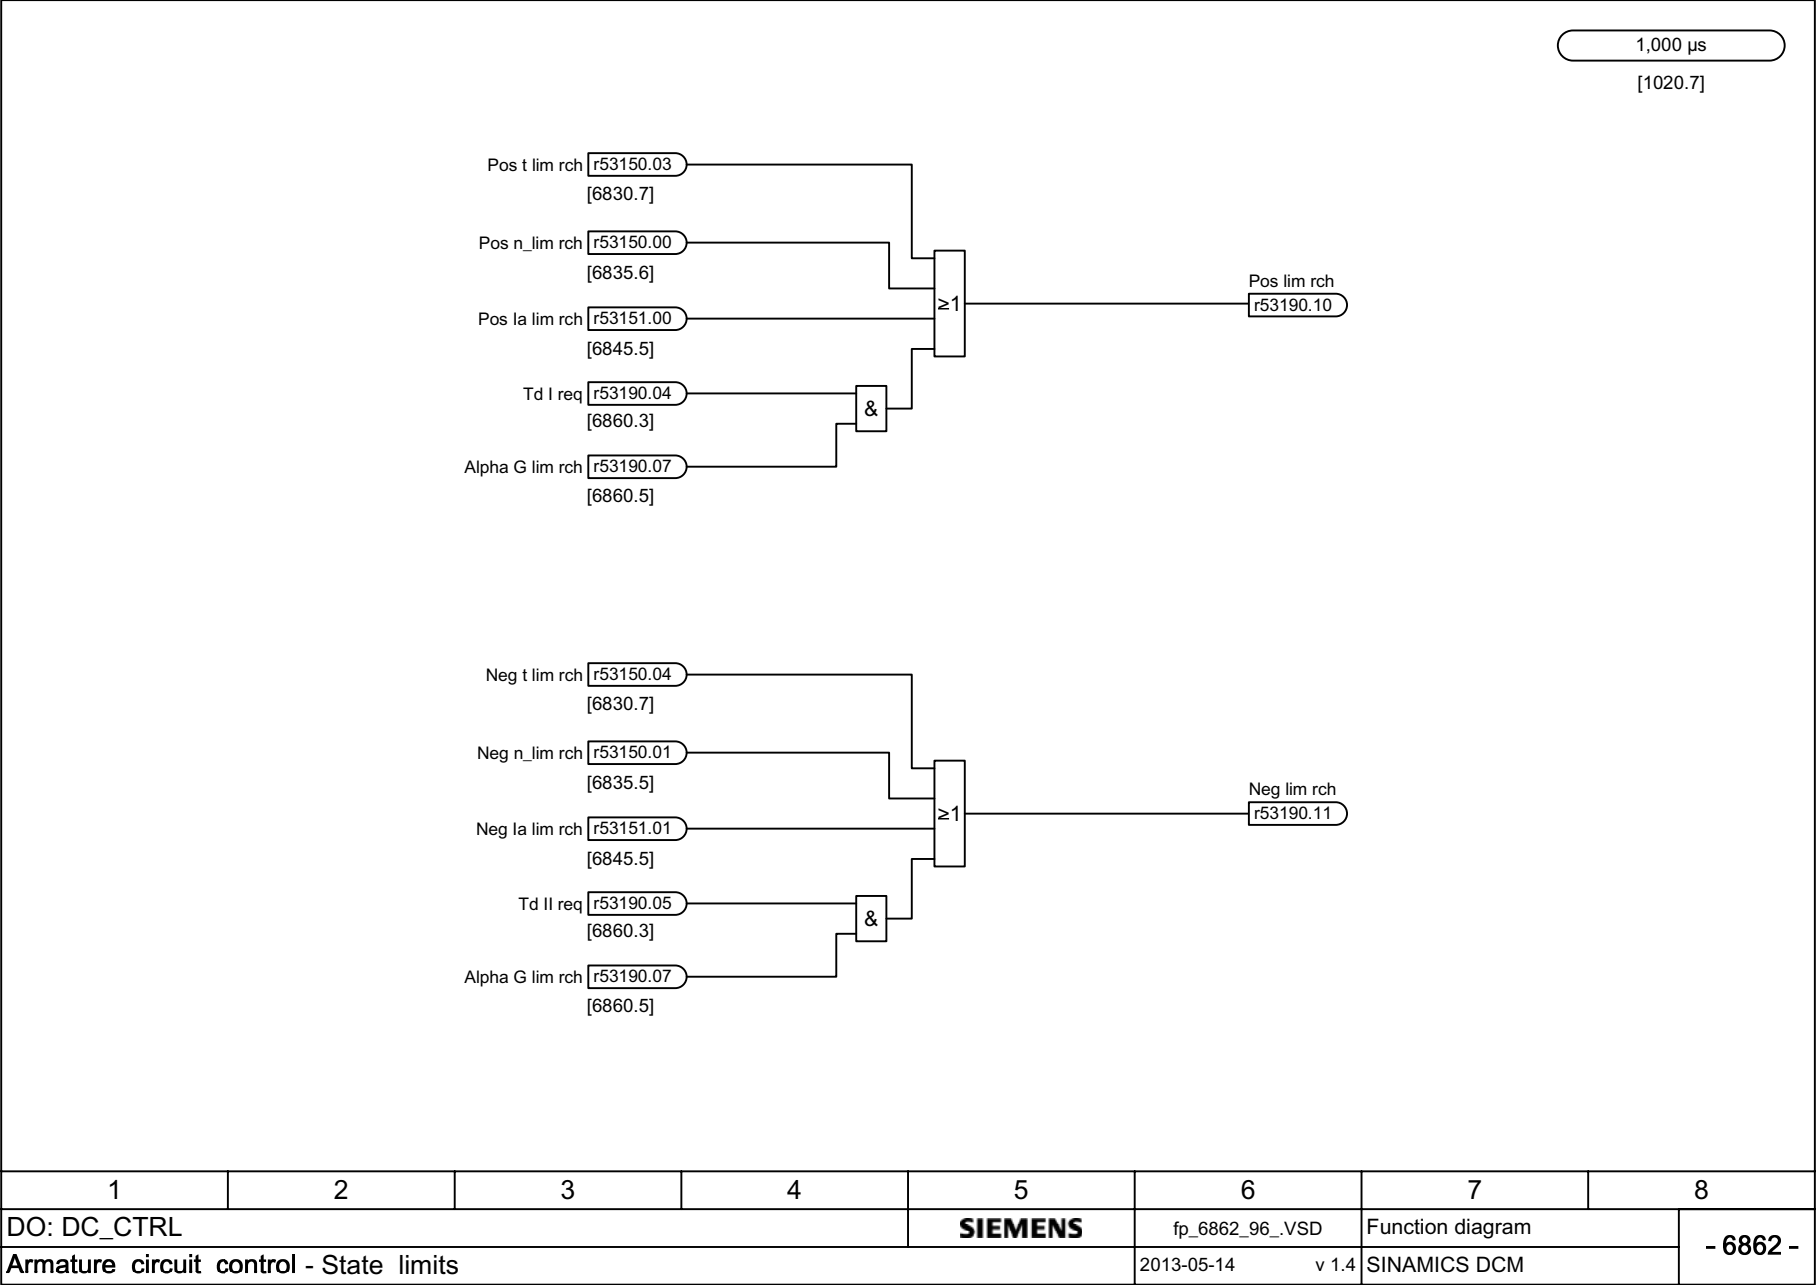


Fig. 2-96 6862 – Limitations, state

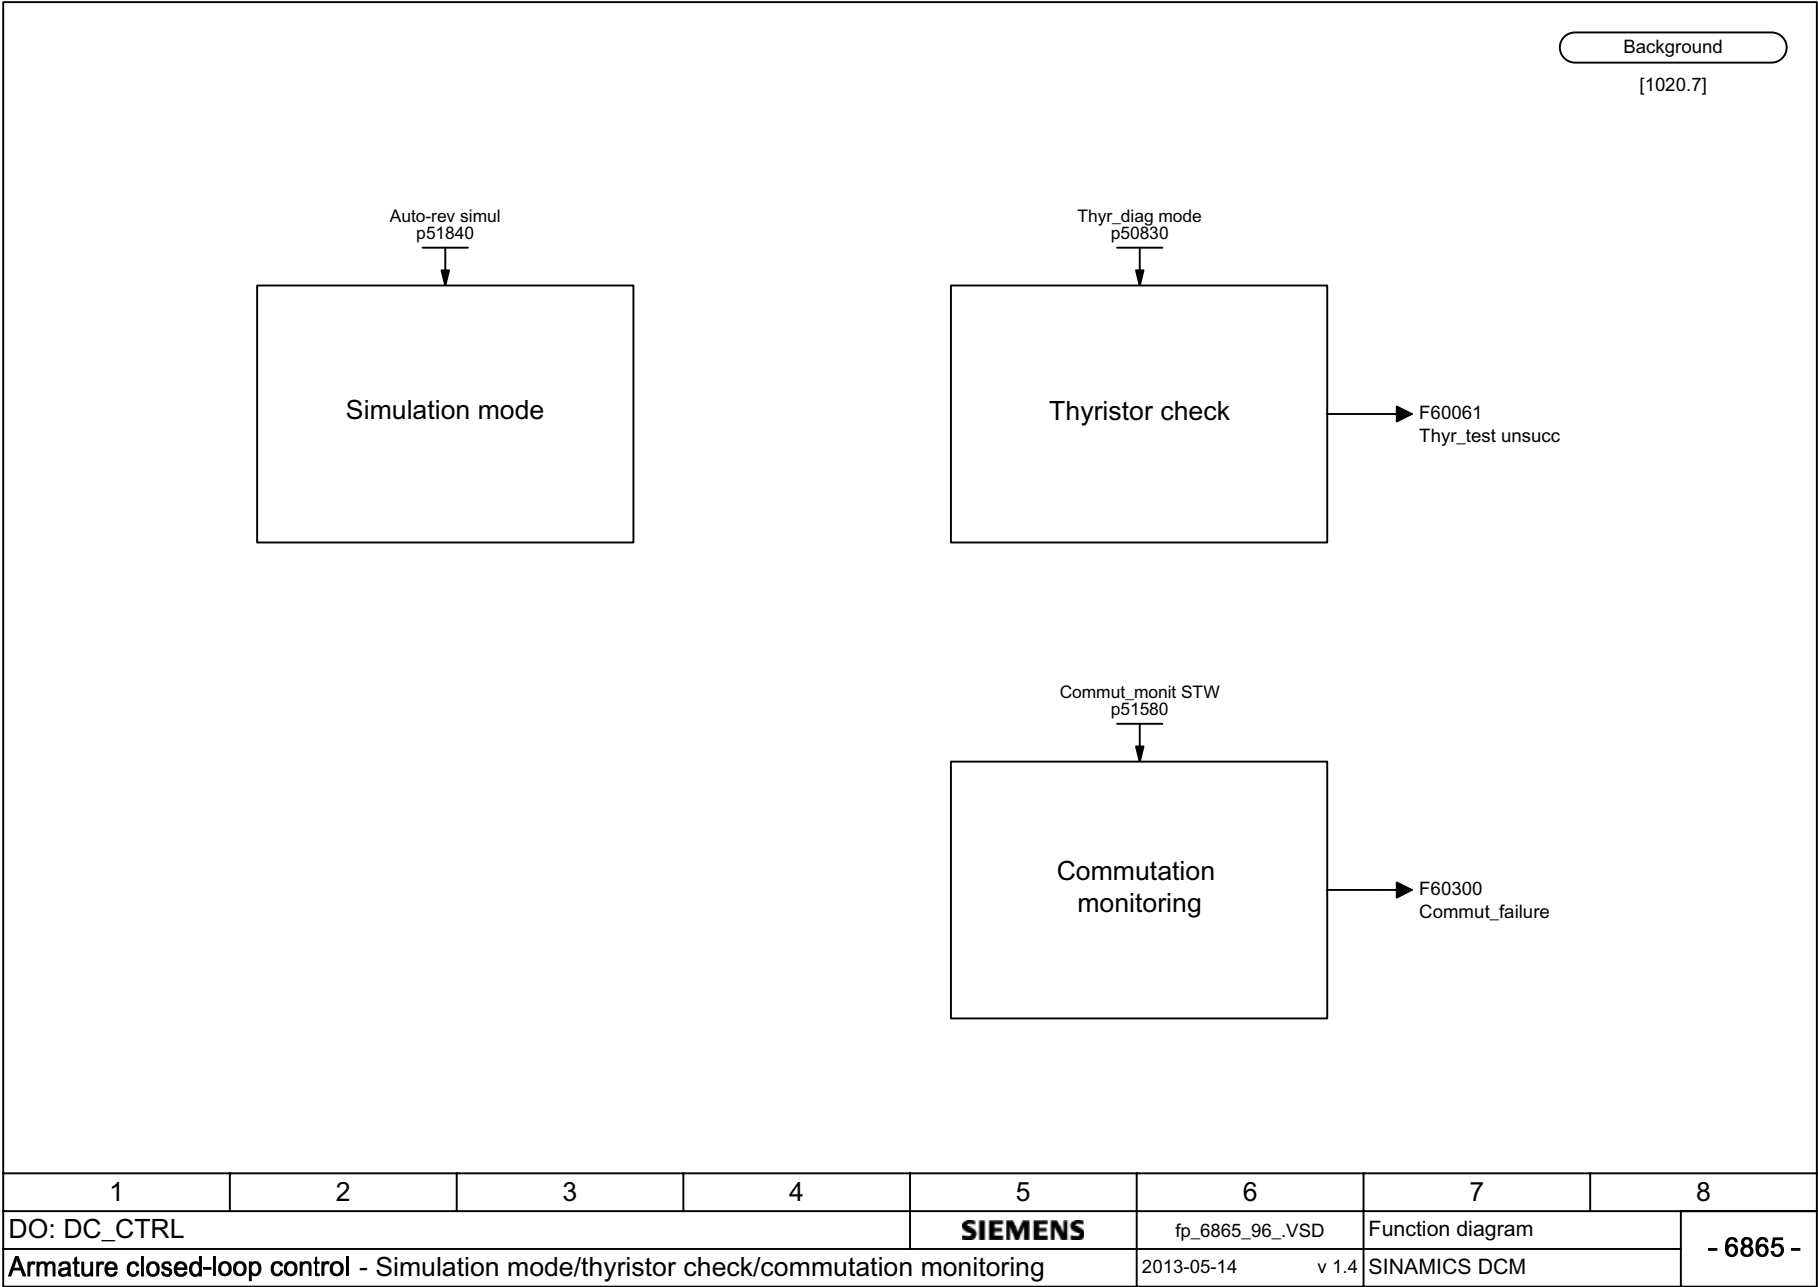


Fig. 2-97 6865 – Simulation mode/thyristor check/commutation monitoring

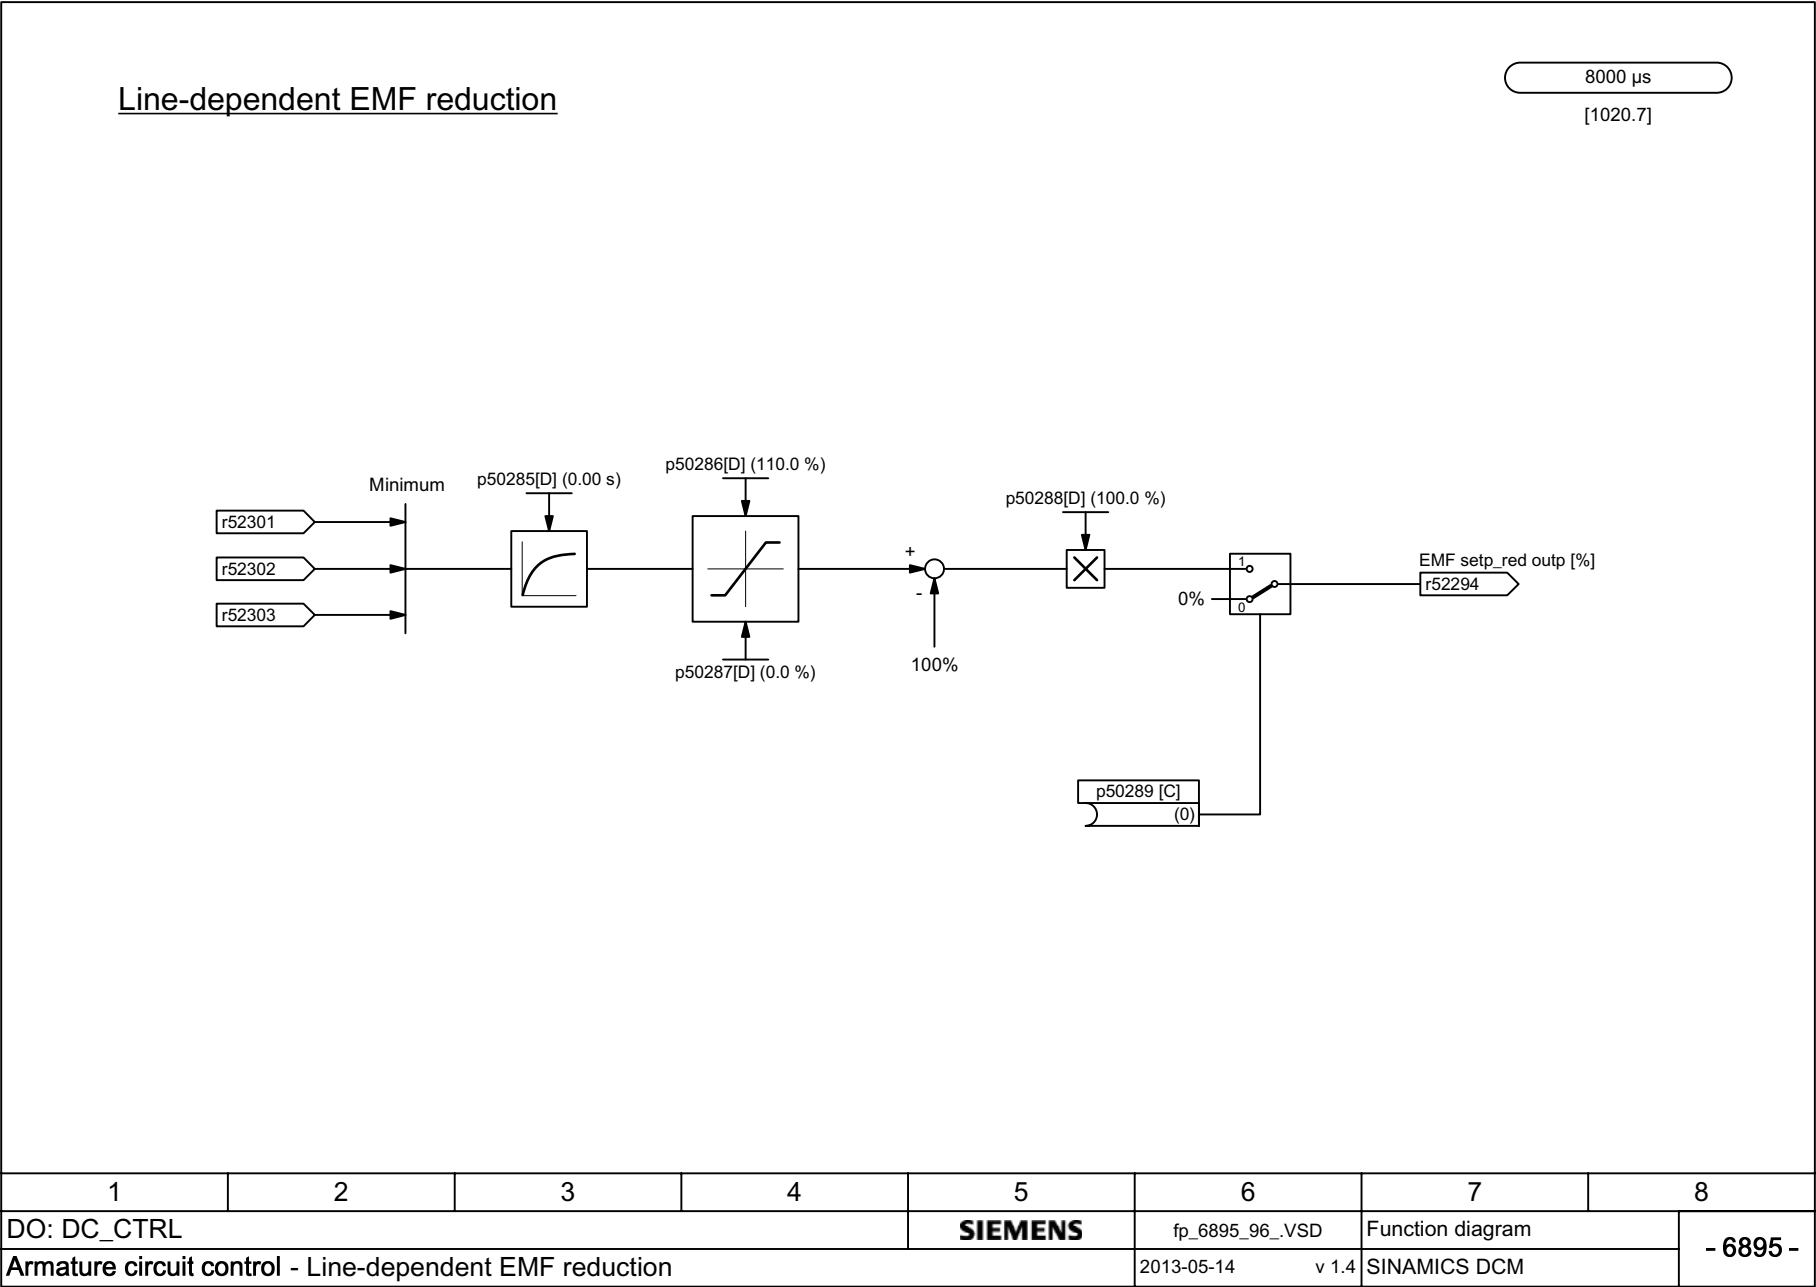



Fig. 2-98 6895 – Line-dependent EMF reduction

## 2.12 Field circuit closed-loop control

### Function diagrams

6900 – EMF closed-loop control	2-775
6902 – Actual value acquisition, armature voltage/EMF	2-776
6905 – Field current setpoint limiting	2-777
6908 – Field current controller adaptation	2-778
6910 – Field current closed-loop control	2-779
6912 – Field current actual value sensing	2-780
6915 – Field gating unit	2-781
6920 – Field reversal	2-782

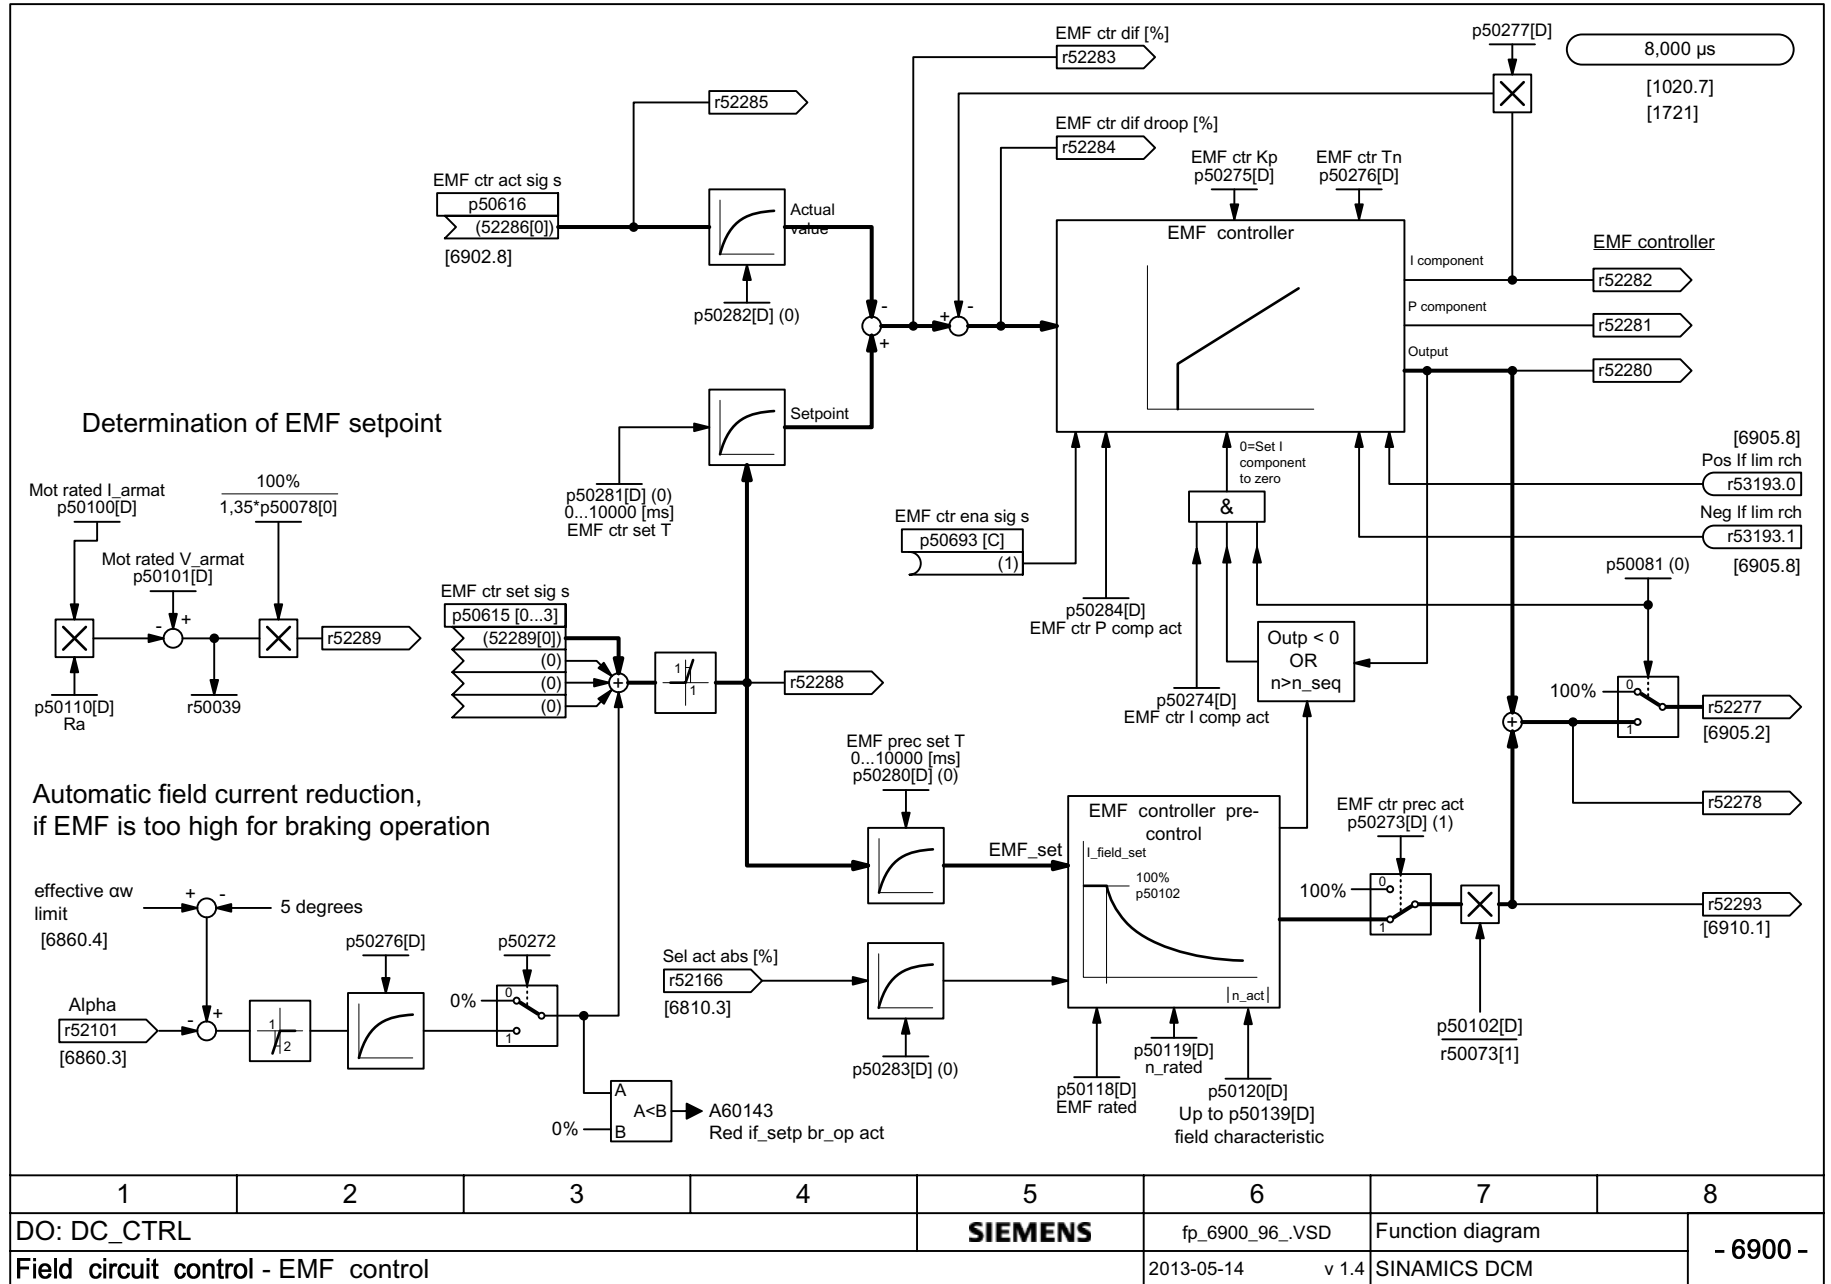Fig. 2-99 6900 – EMF closed-loop control



1	2	3	4	5	6	7	8
DO: DC_CTRL				<b>SIEMENS</b>	fp_6900_96_VSD	Function diagram	- 6900 -
Field circuit control - EMF control					2013-05-14 v 1.4	SINAMICS DCM	

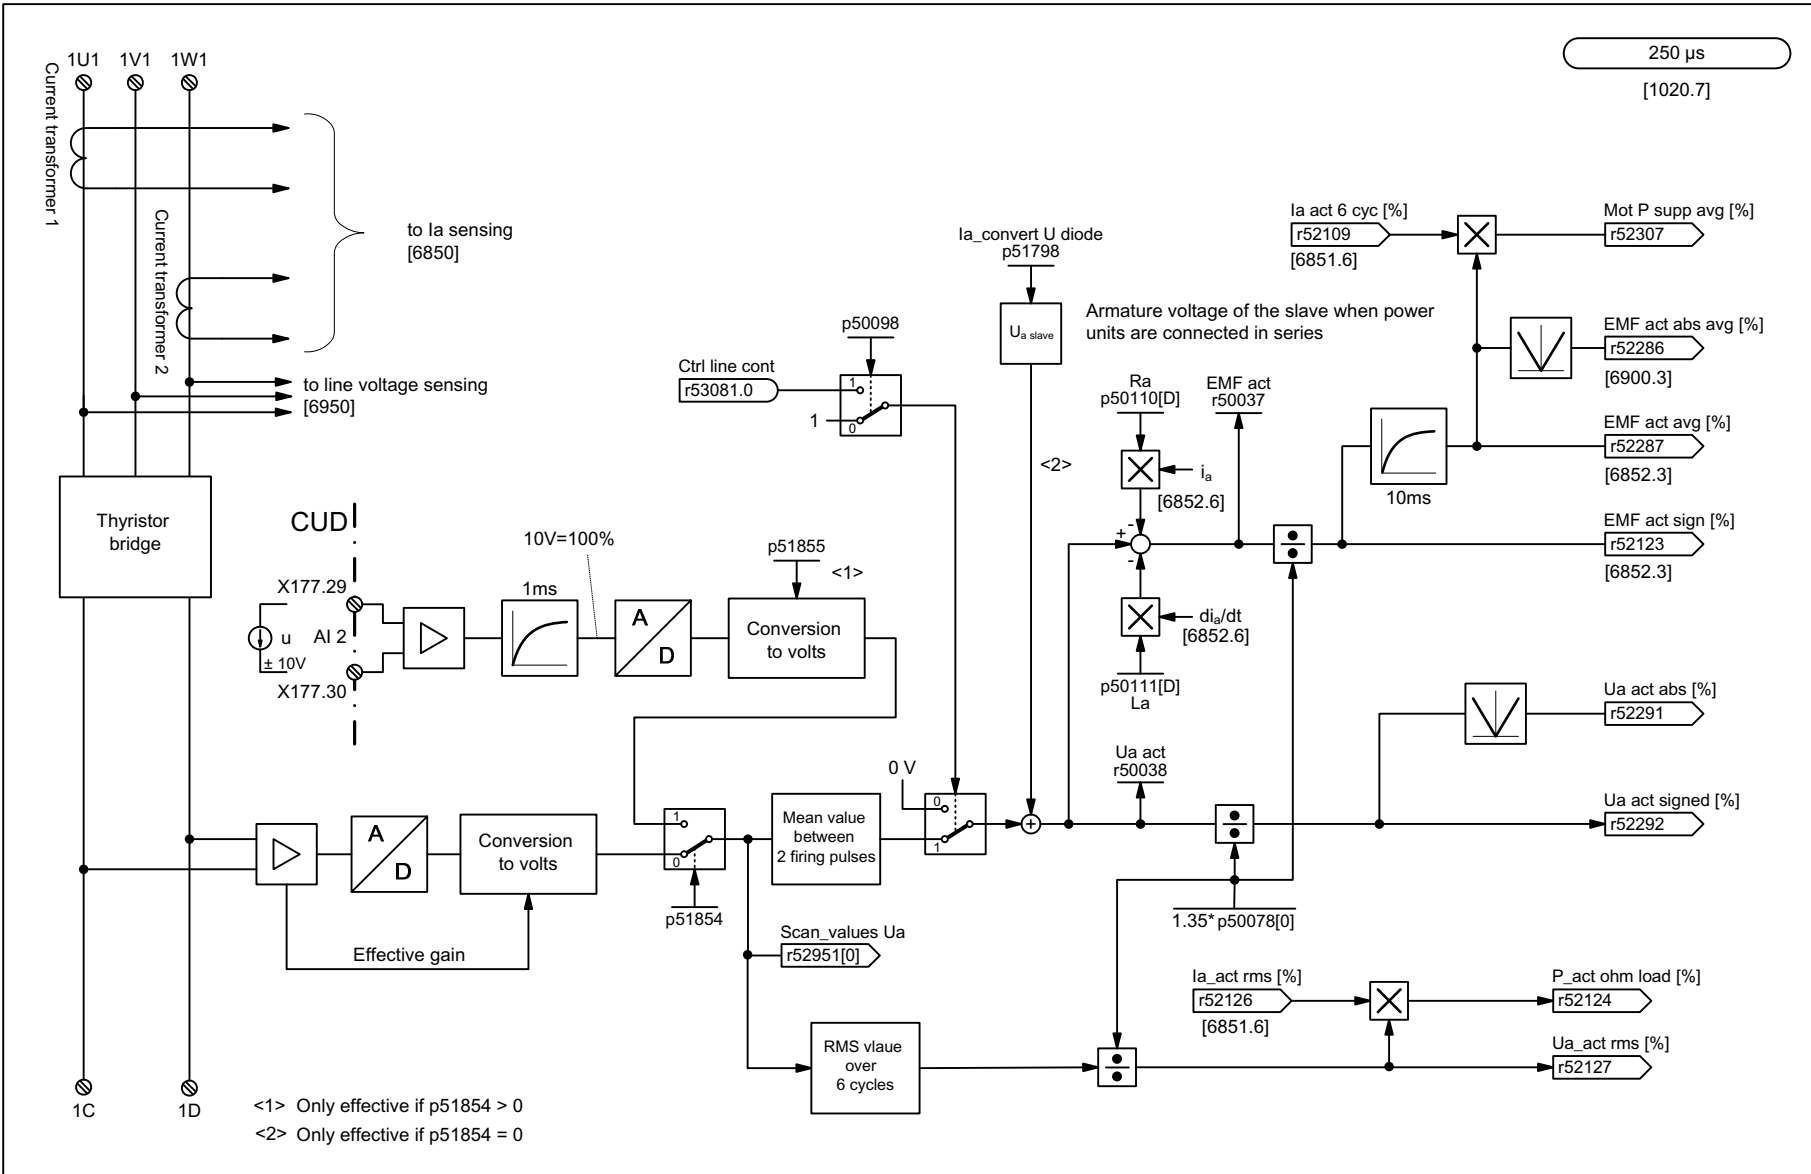


Fig. 2-100 6902 – Actual value acquisition, armature voltage/EMF





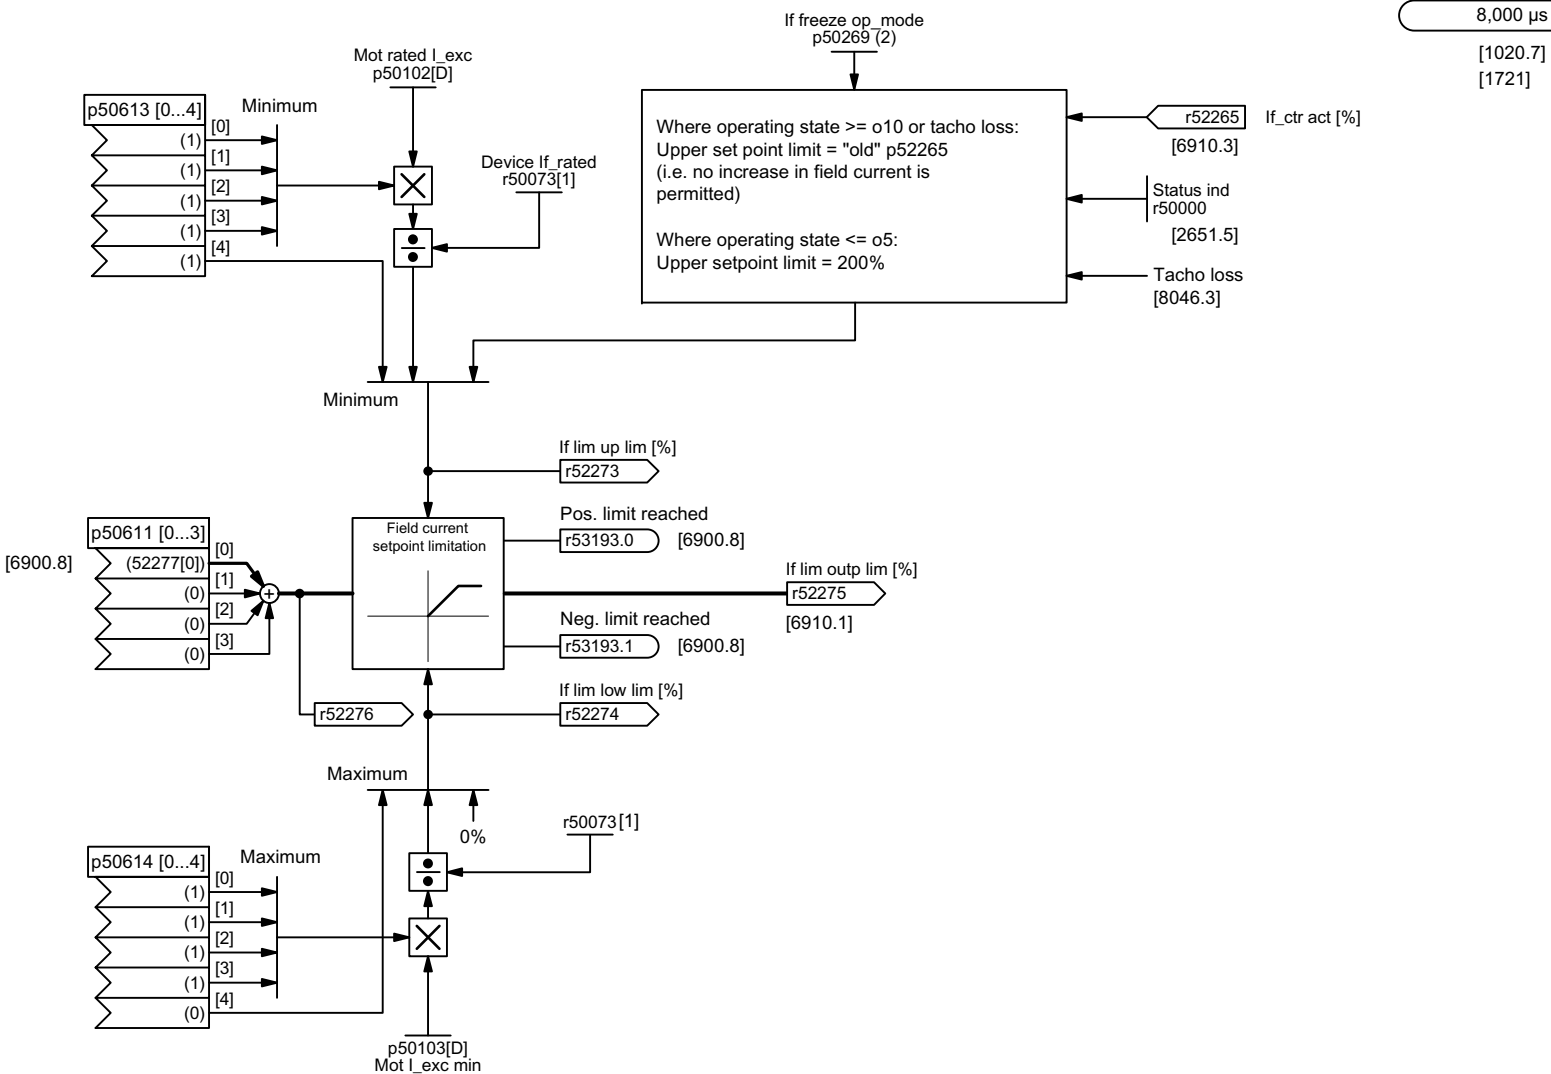



Fig. 2-101



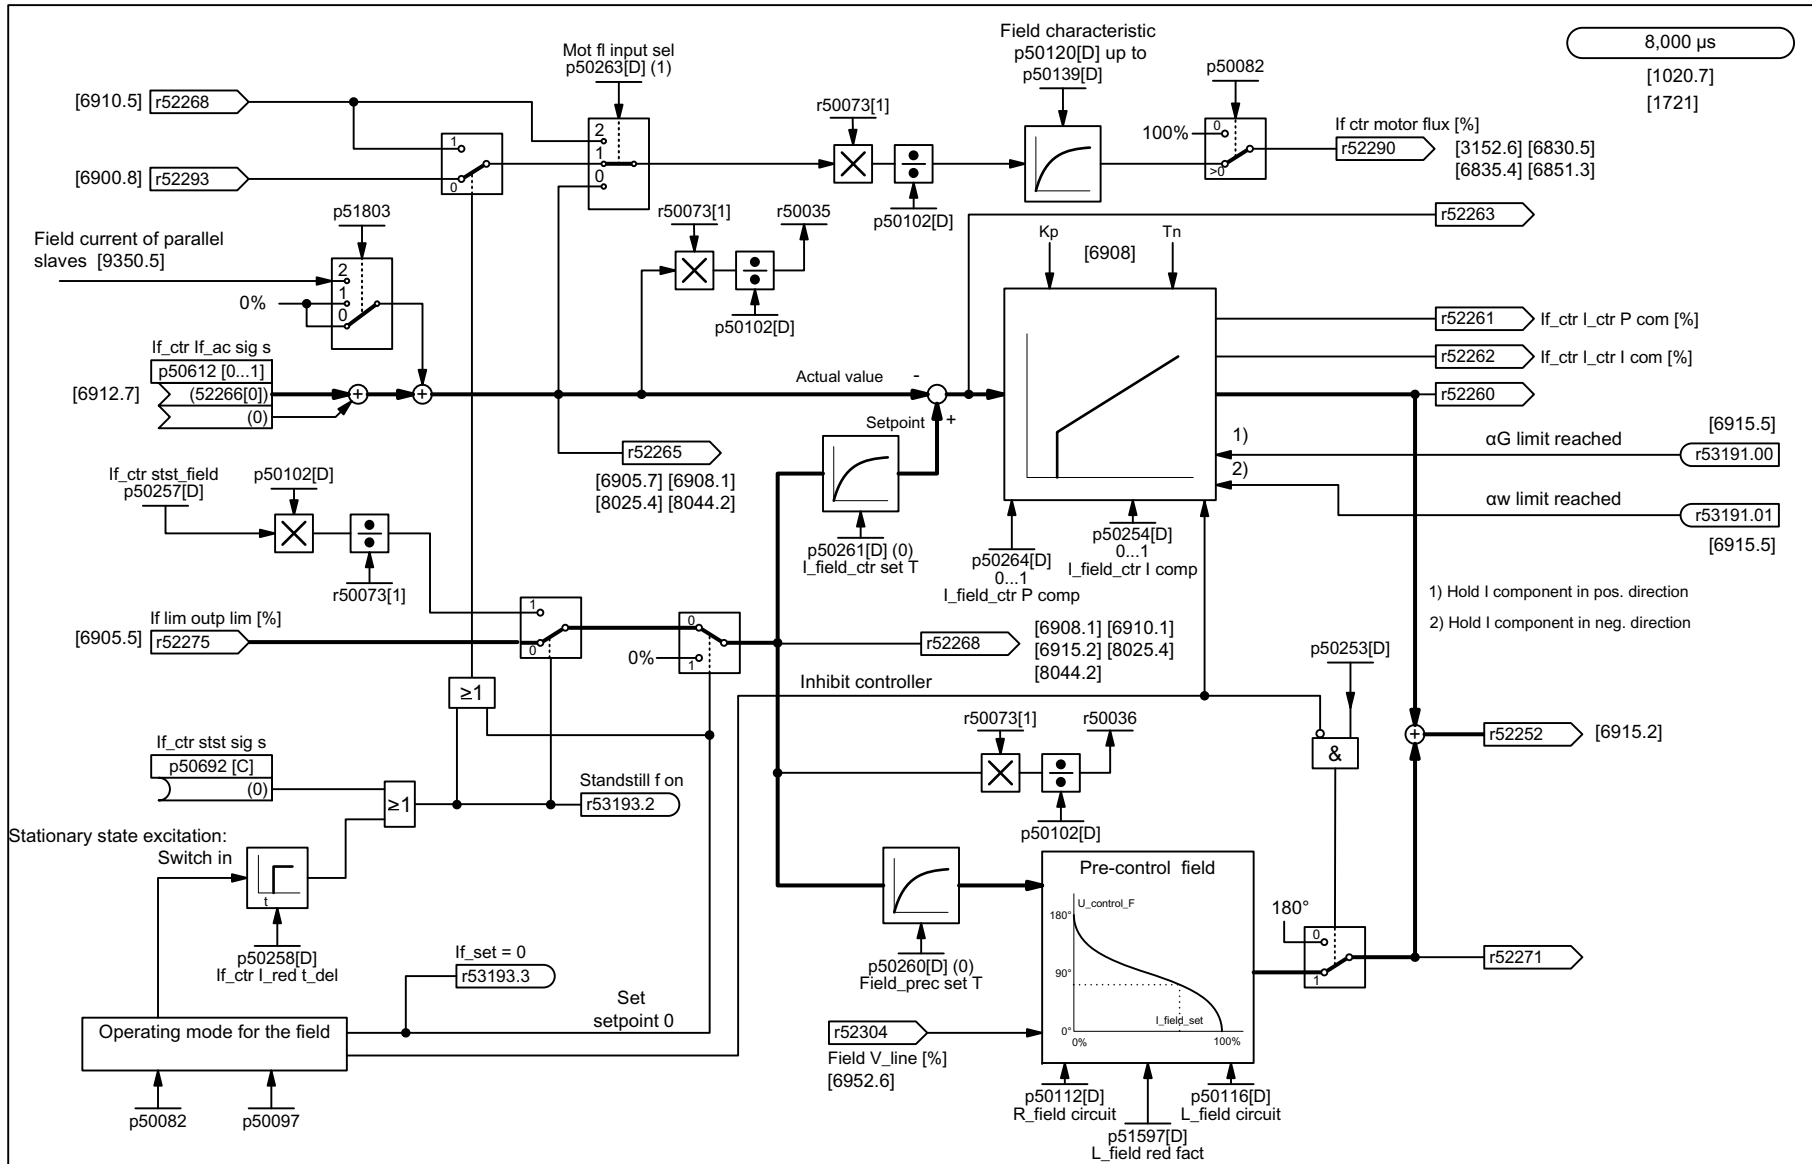6908 – Field current controller adaptation



6910 – Field current closed-loop control



2-780


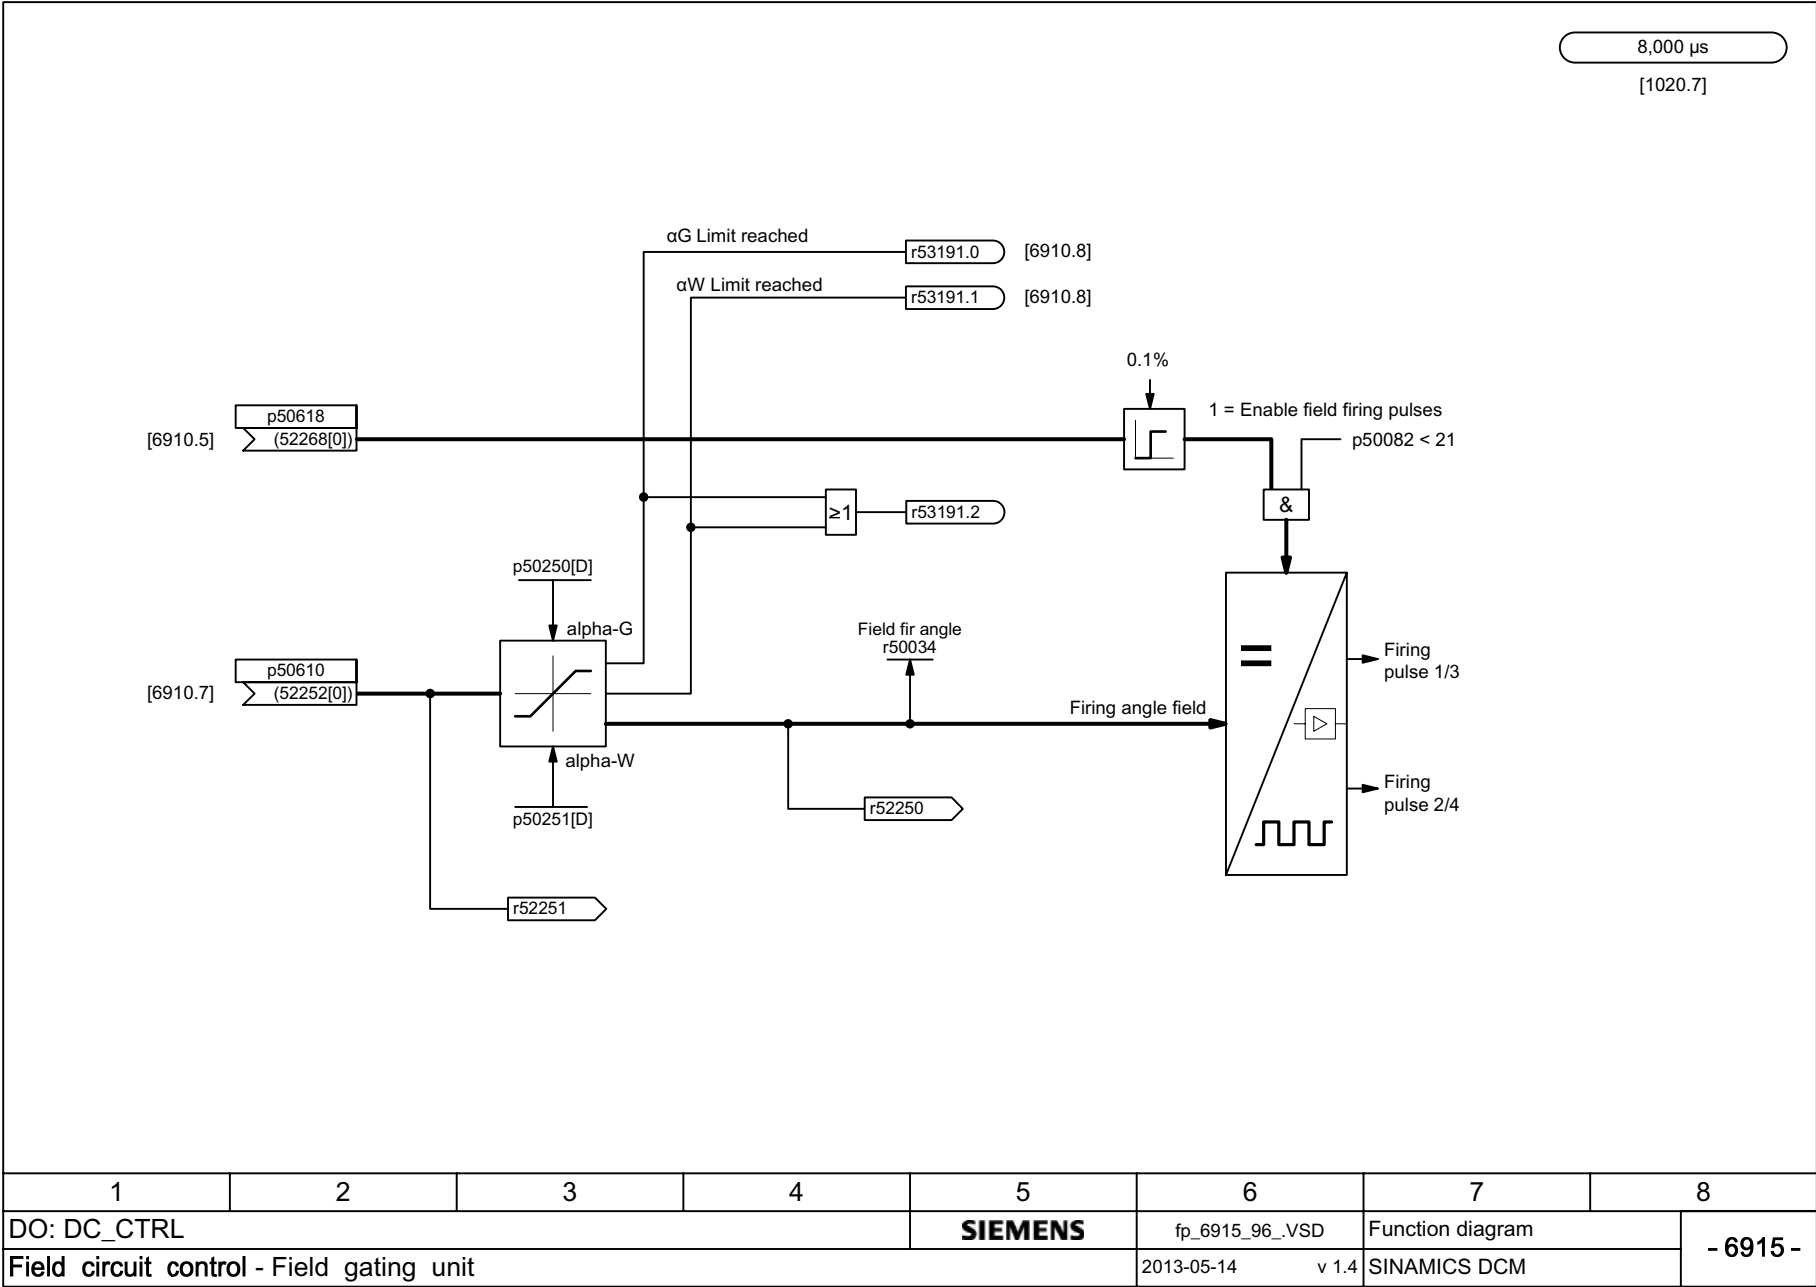


Fig. 2-105 6915 – Field gating unit

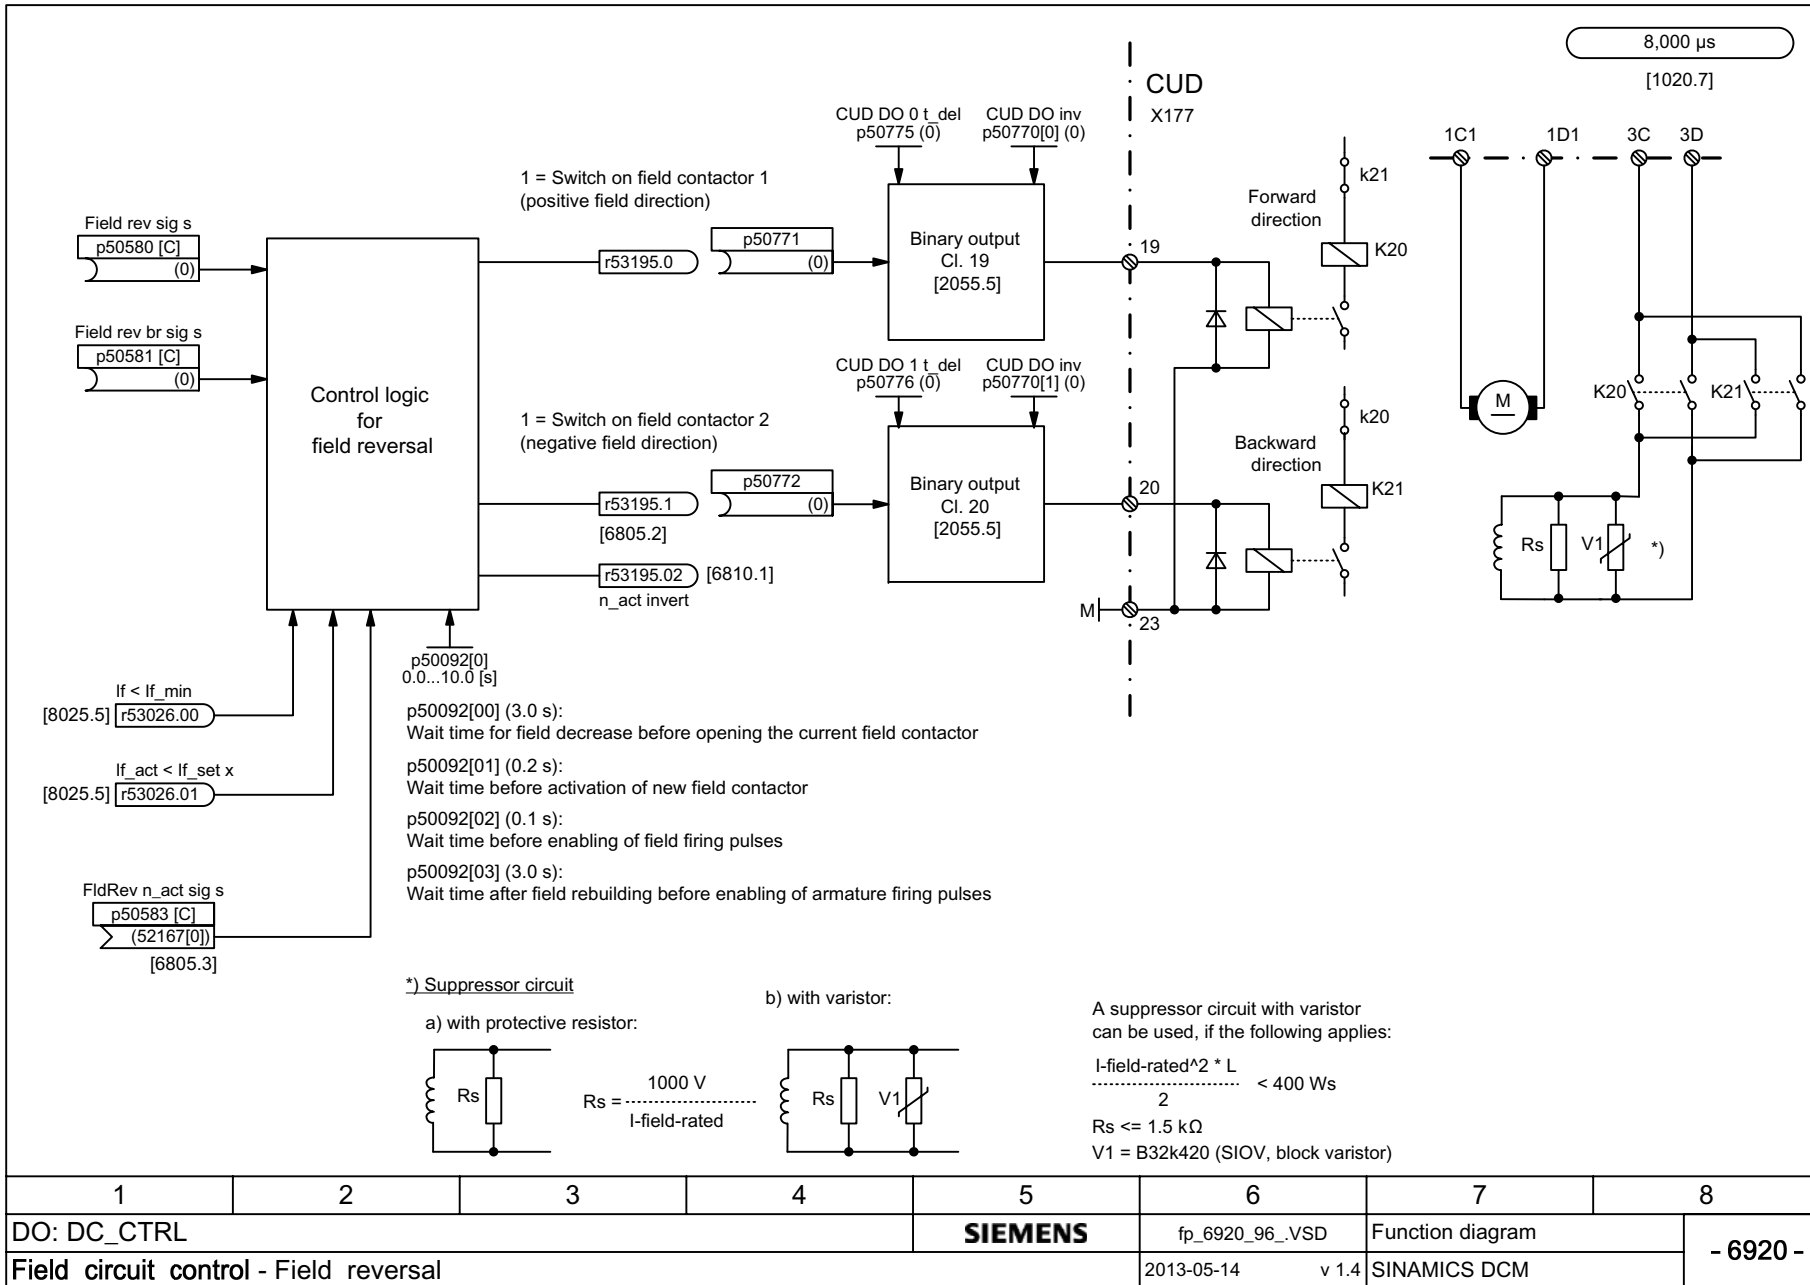
Fig. 2-106



## 2.13 Power unit

### Function diagrams

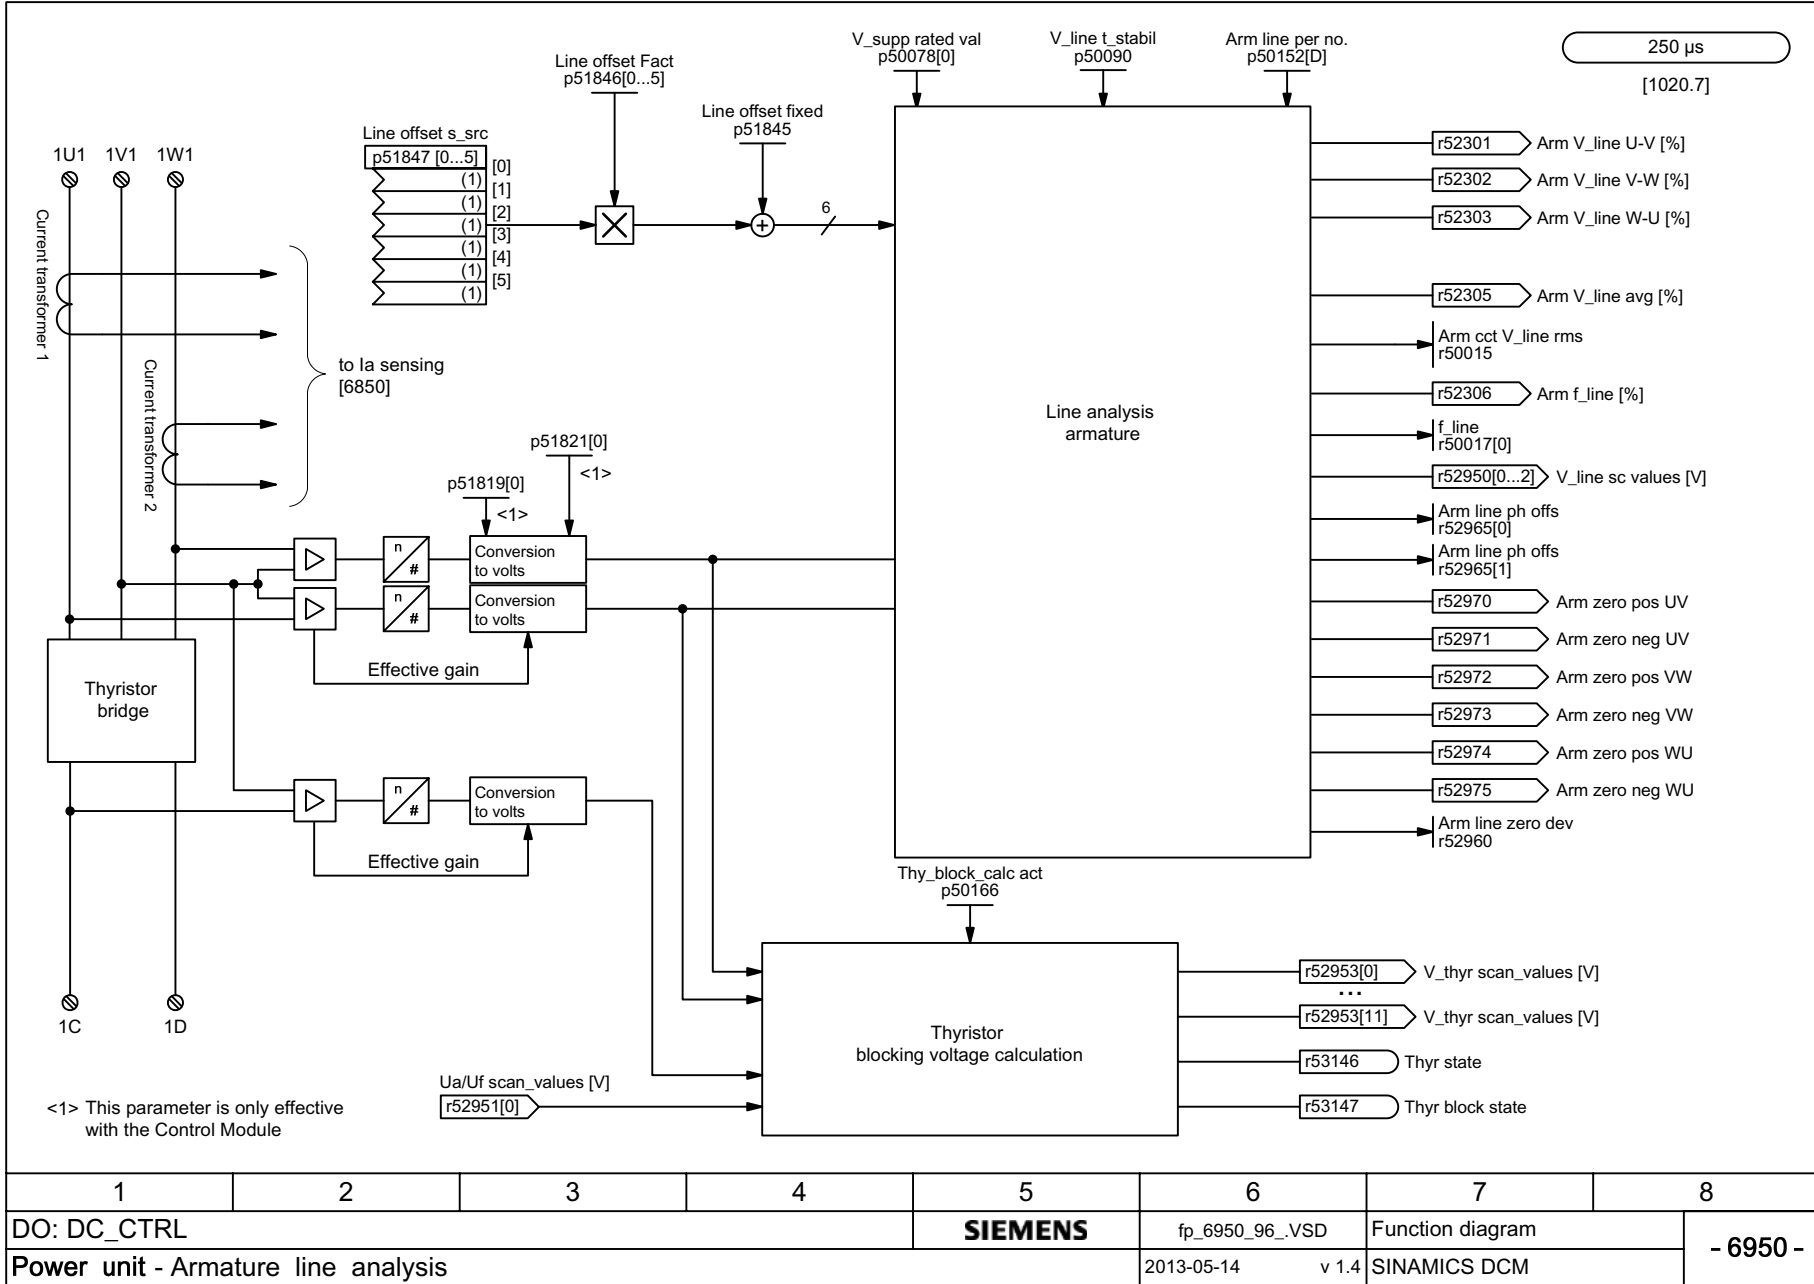6950 – Line analysis, armature	2-784
6952 – Line analysis, field	2-785
6954 – Line monitoring	2-786
6956 – Fuse monitoring (DC converter)	2-787
6957 – Fuse monitoring (Control Module)	2-788
6960 – Power unit, properties	2-789
6965 – Adaptation to external power unit (Control Module)	2-790
6970 – Converter Commutation Protector (CCP)	2-791



6950 – Line analysis, armature




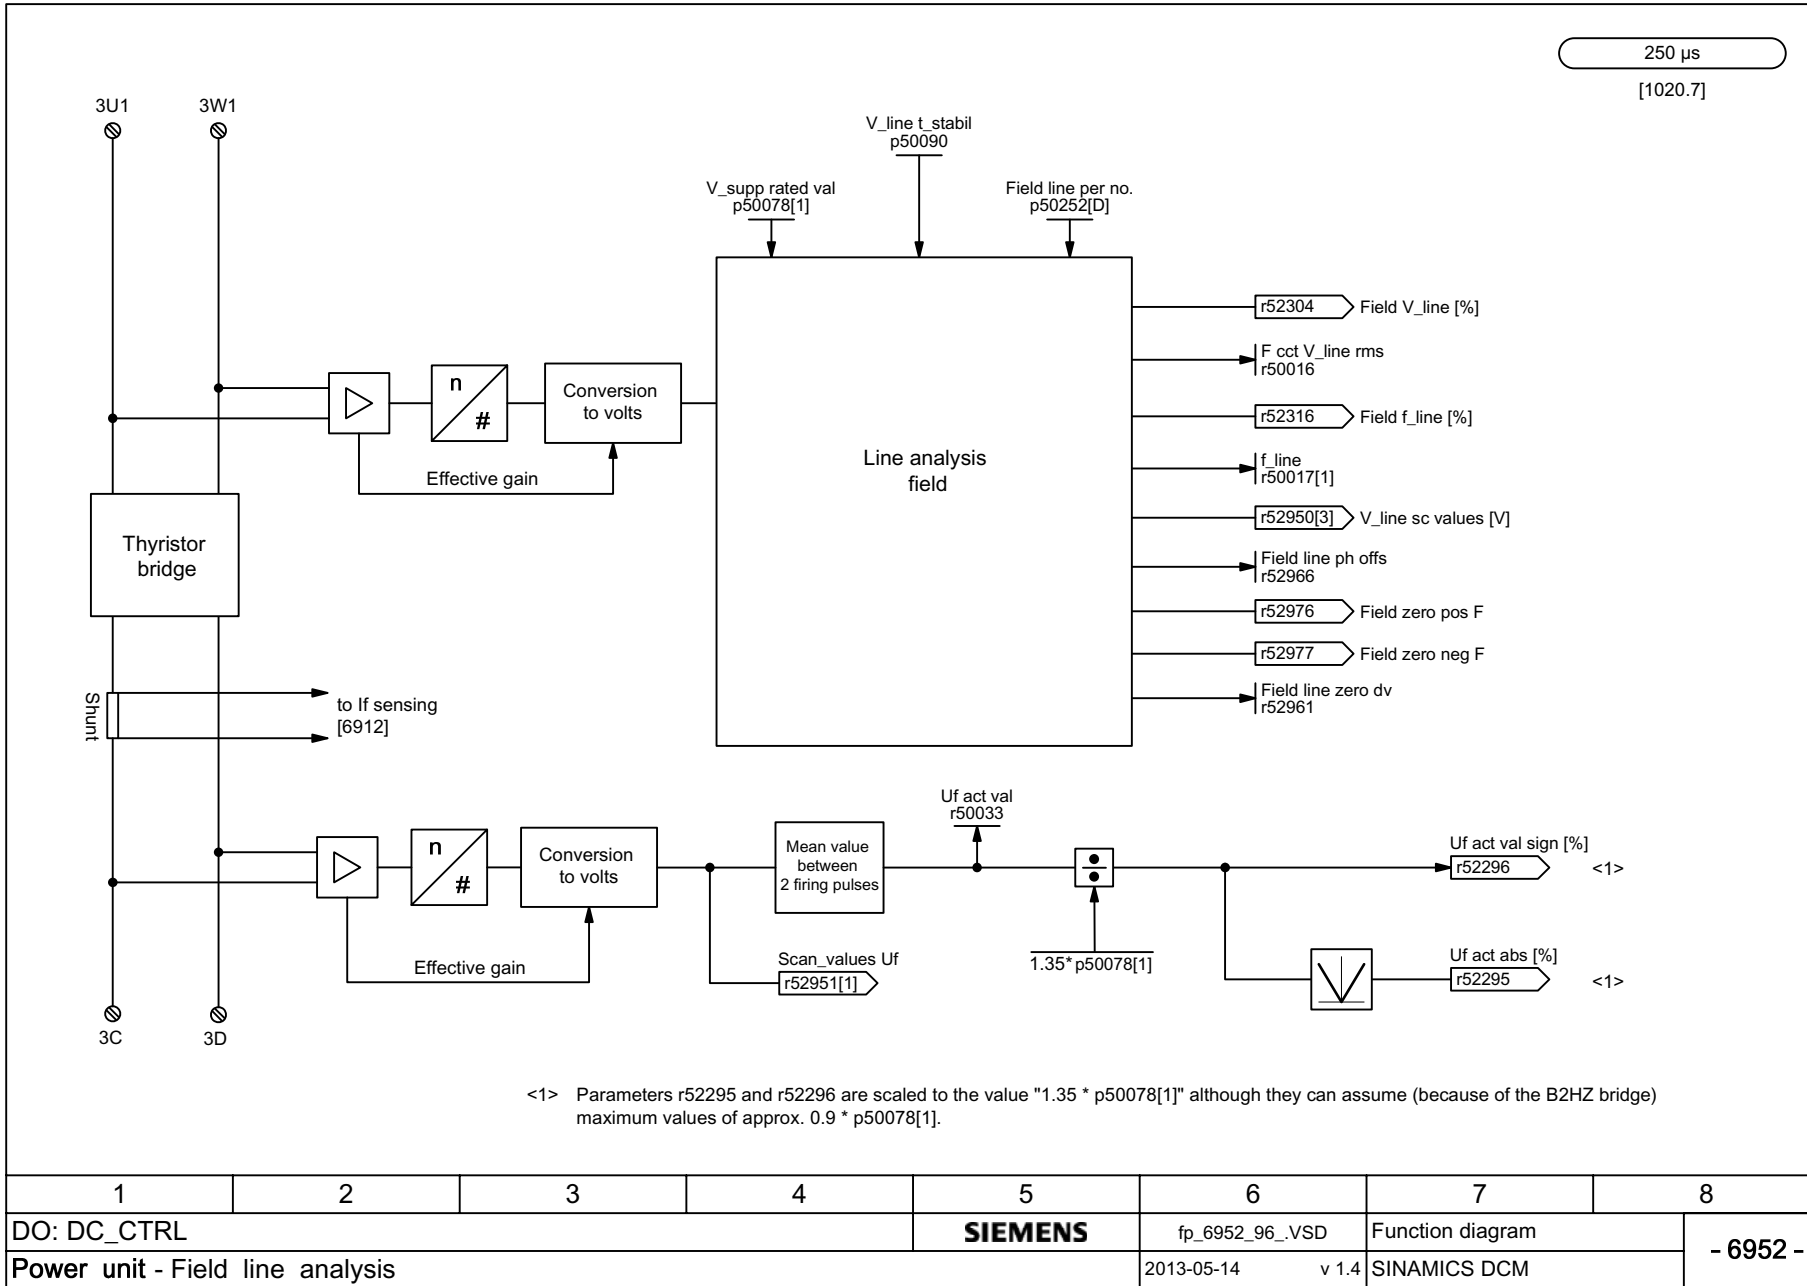


Fig. 2-108 6952 – Line analysis, field

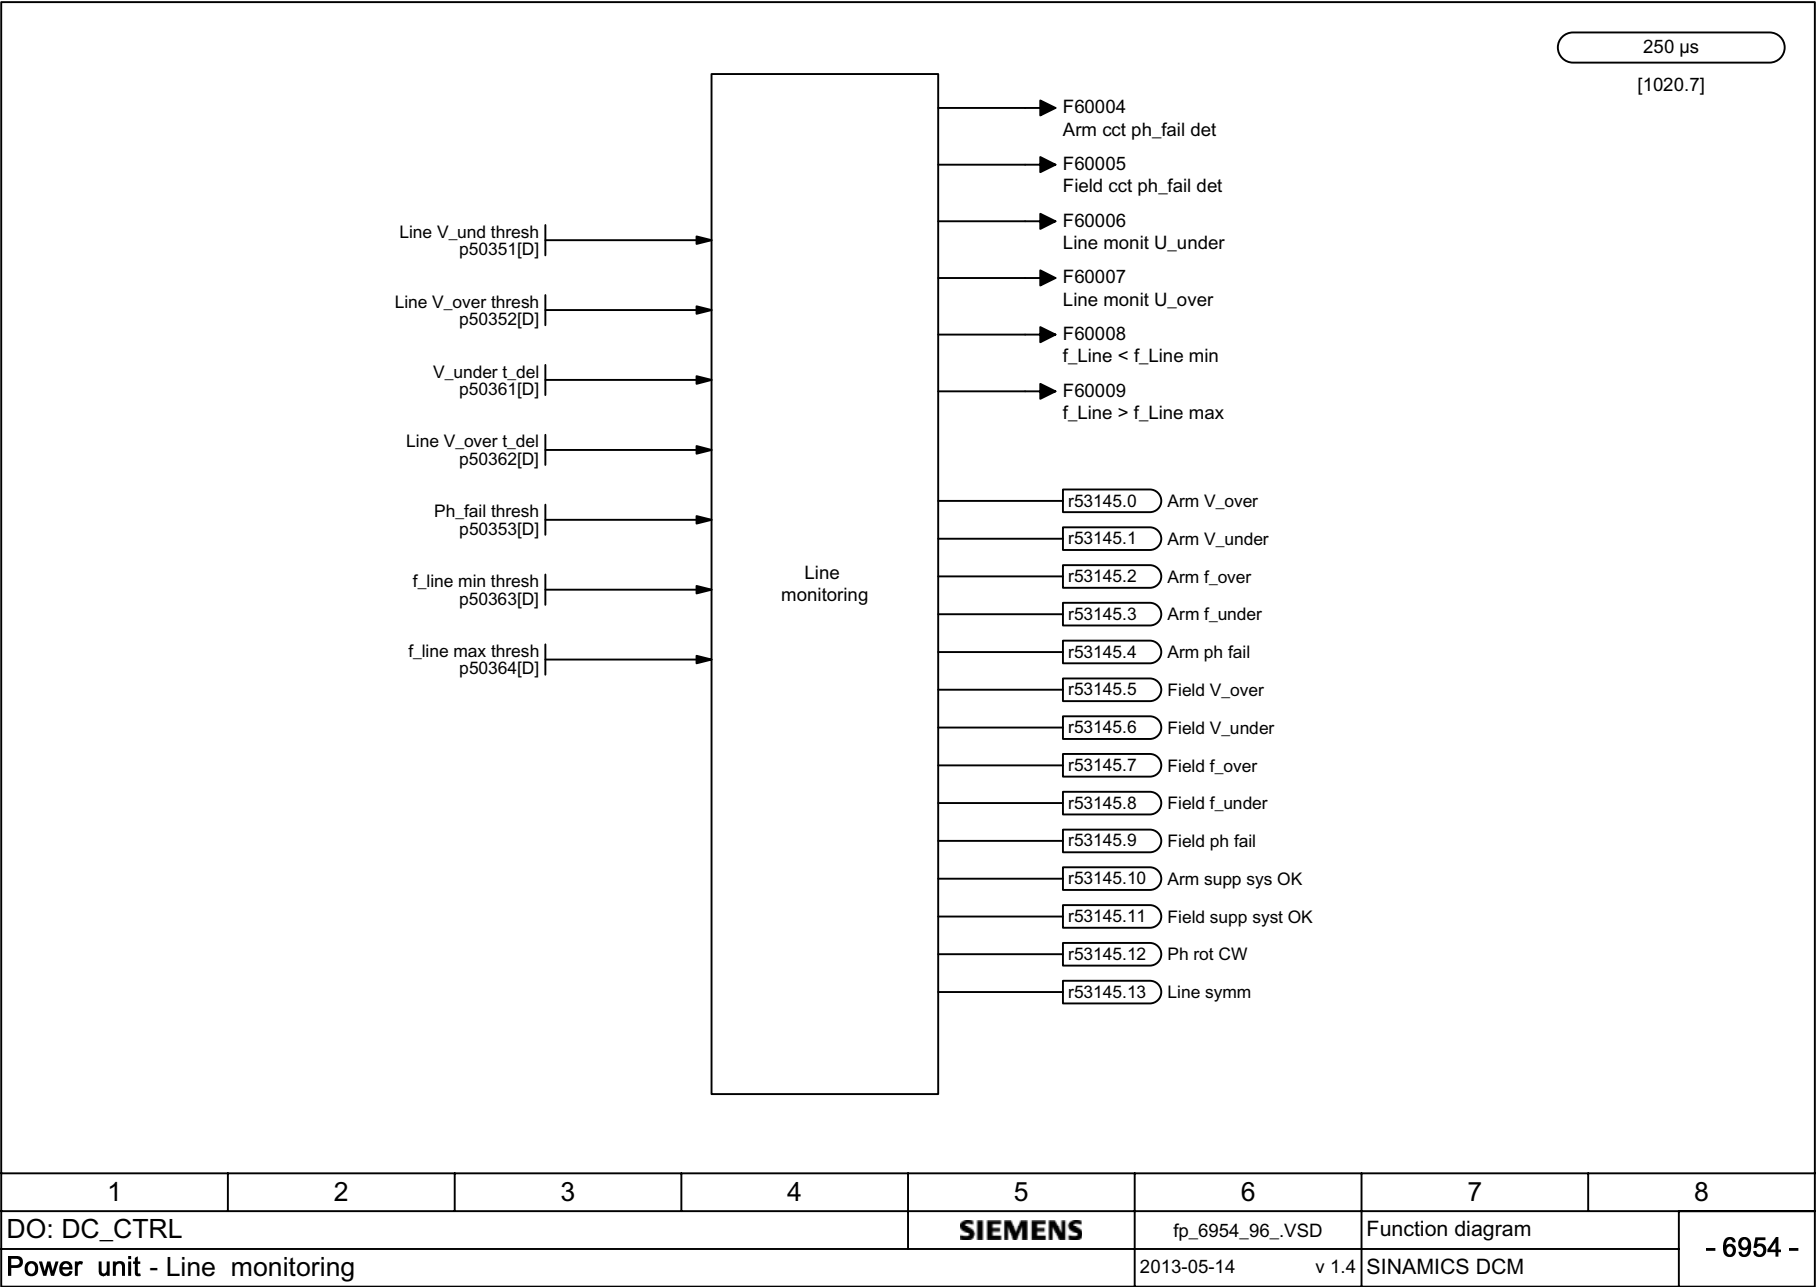

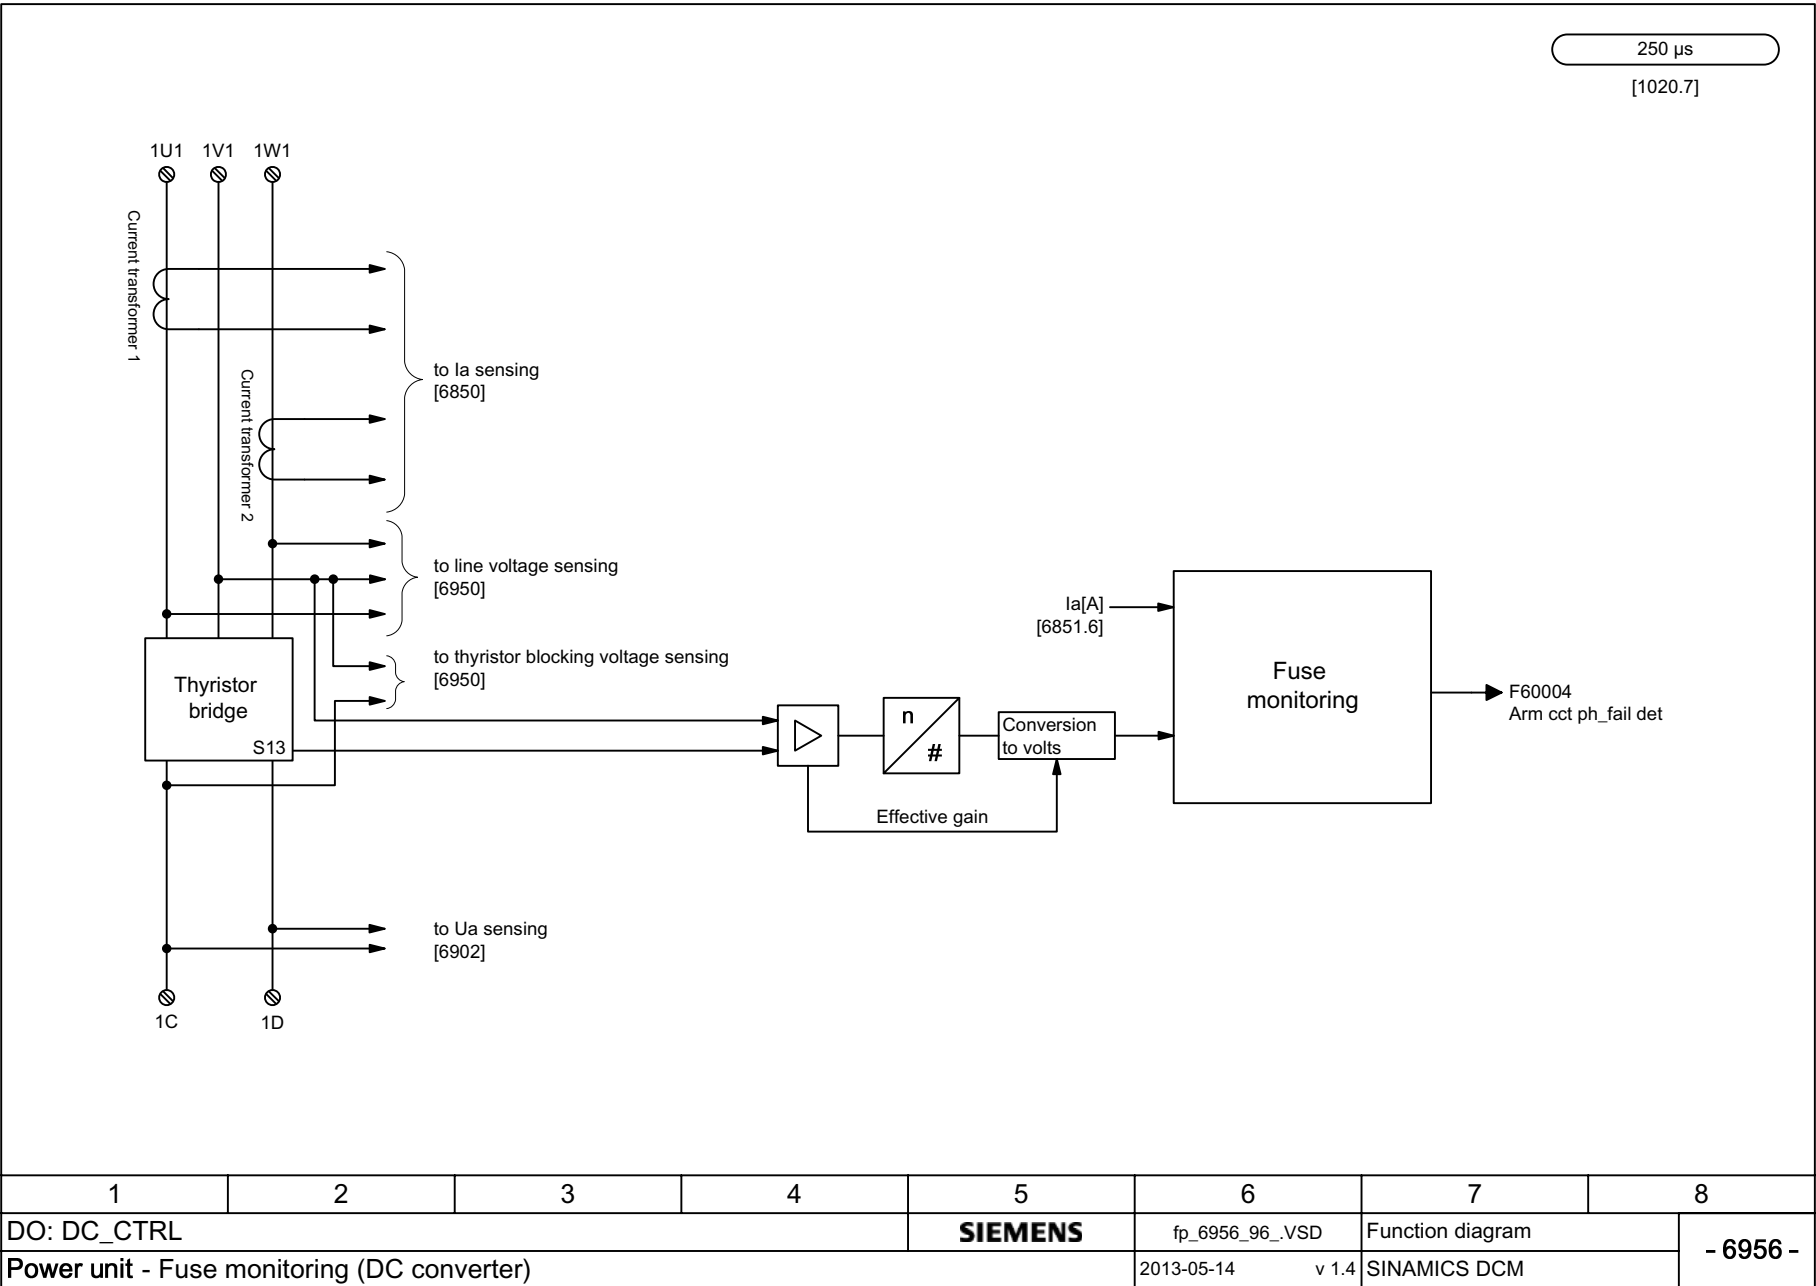


Fig. 2-110 6956 – Fuse monitoring (DC converter)

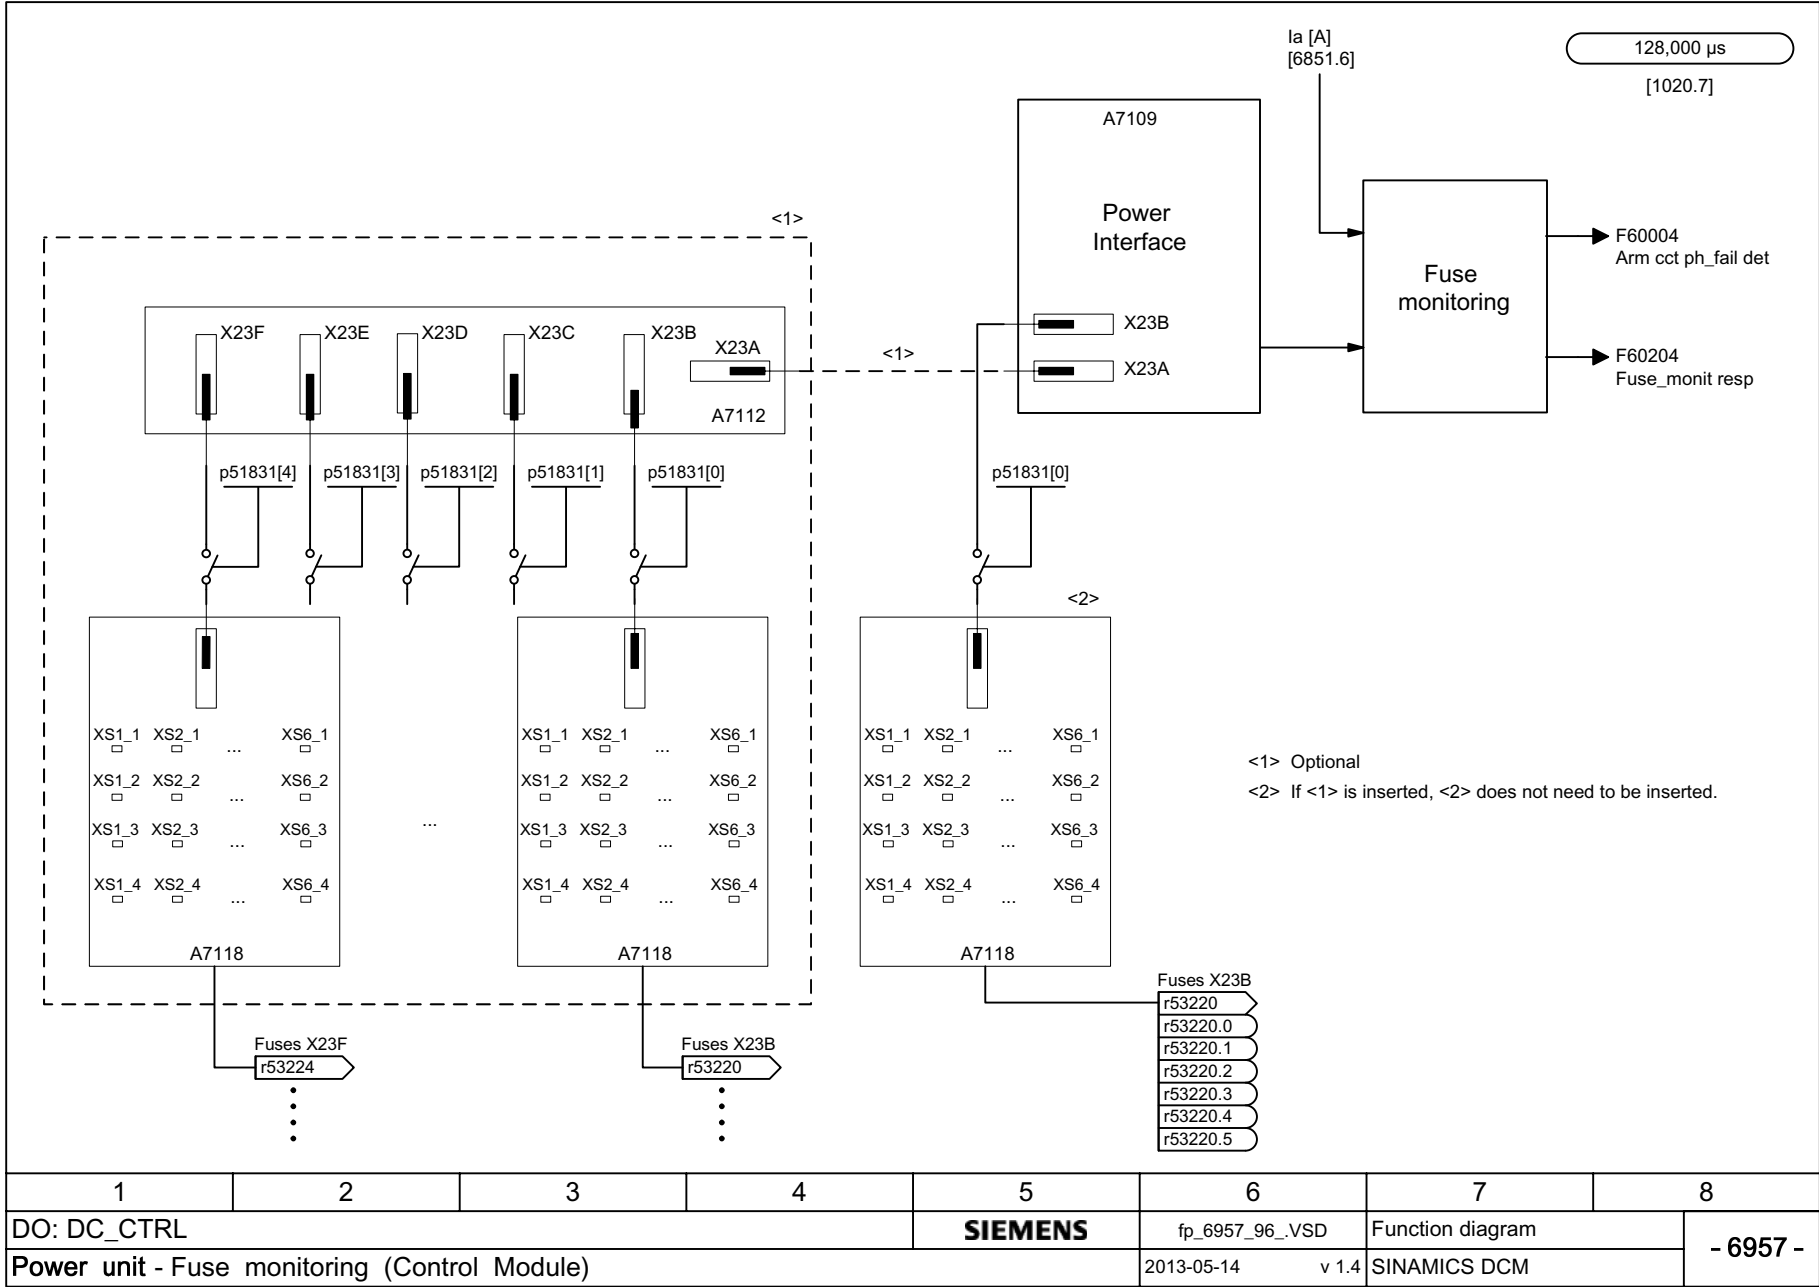


Fig. 2-111 6957 – Fuse monitoring (Control Module)

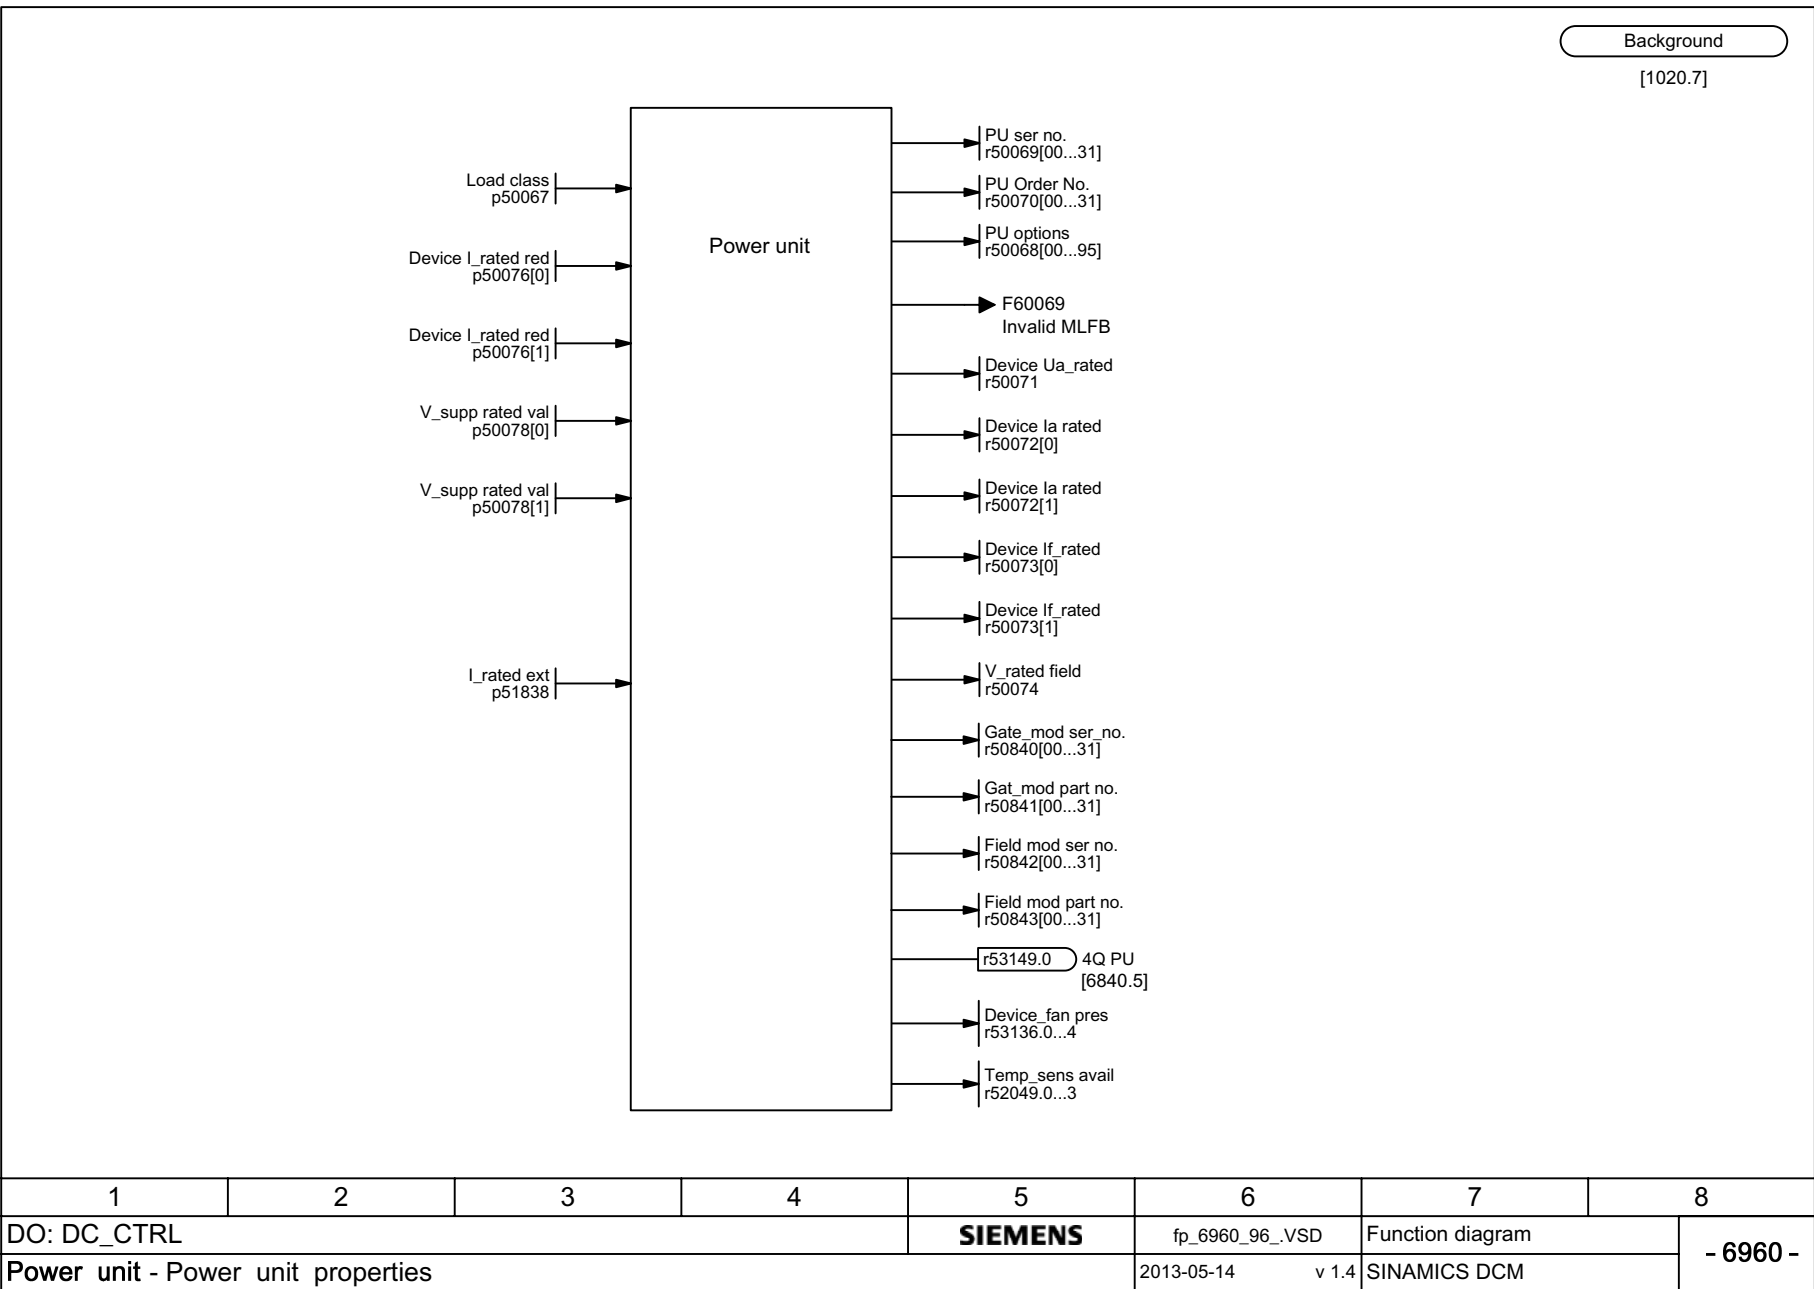


Fig. 2-112 6960 – Power unit, properties

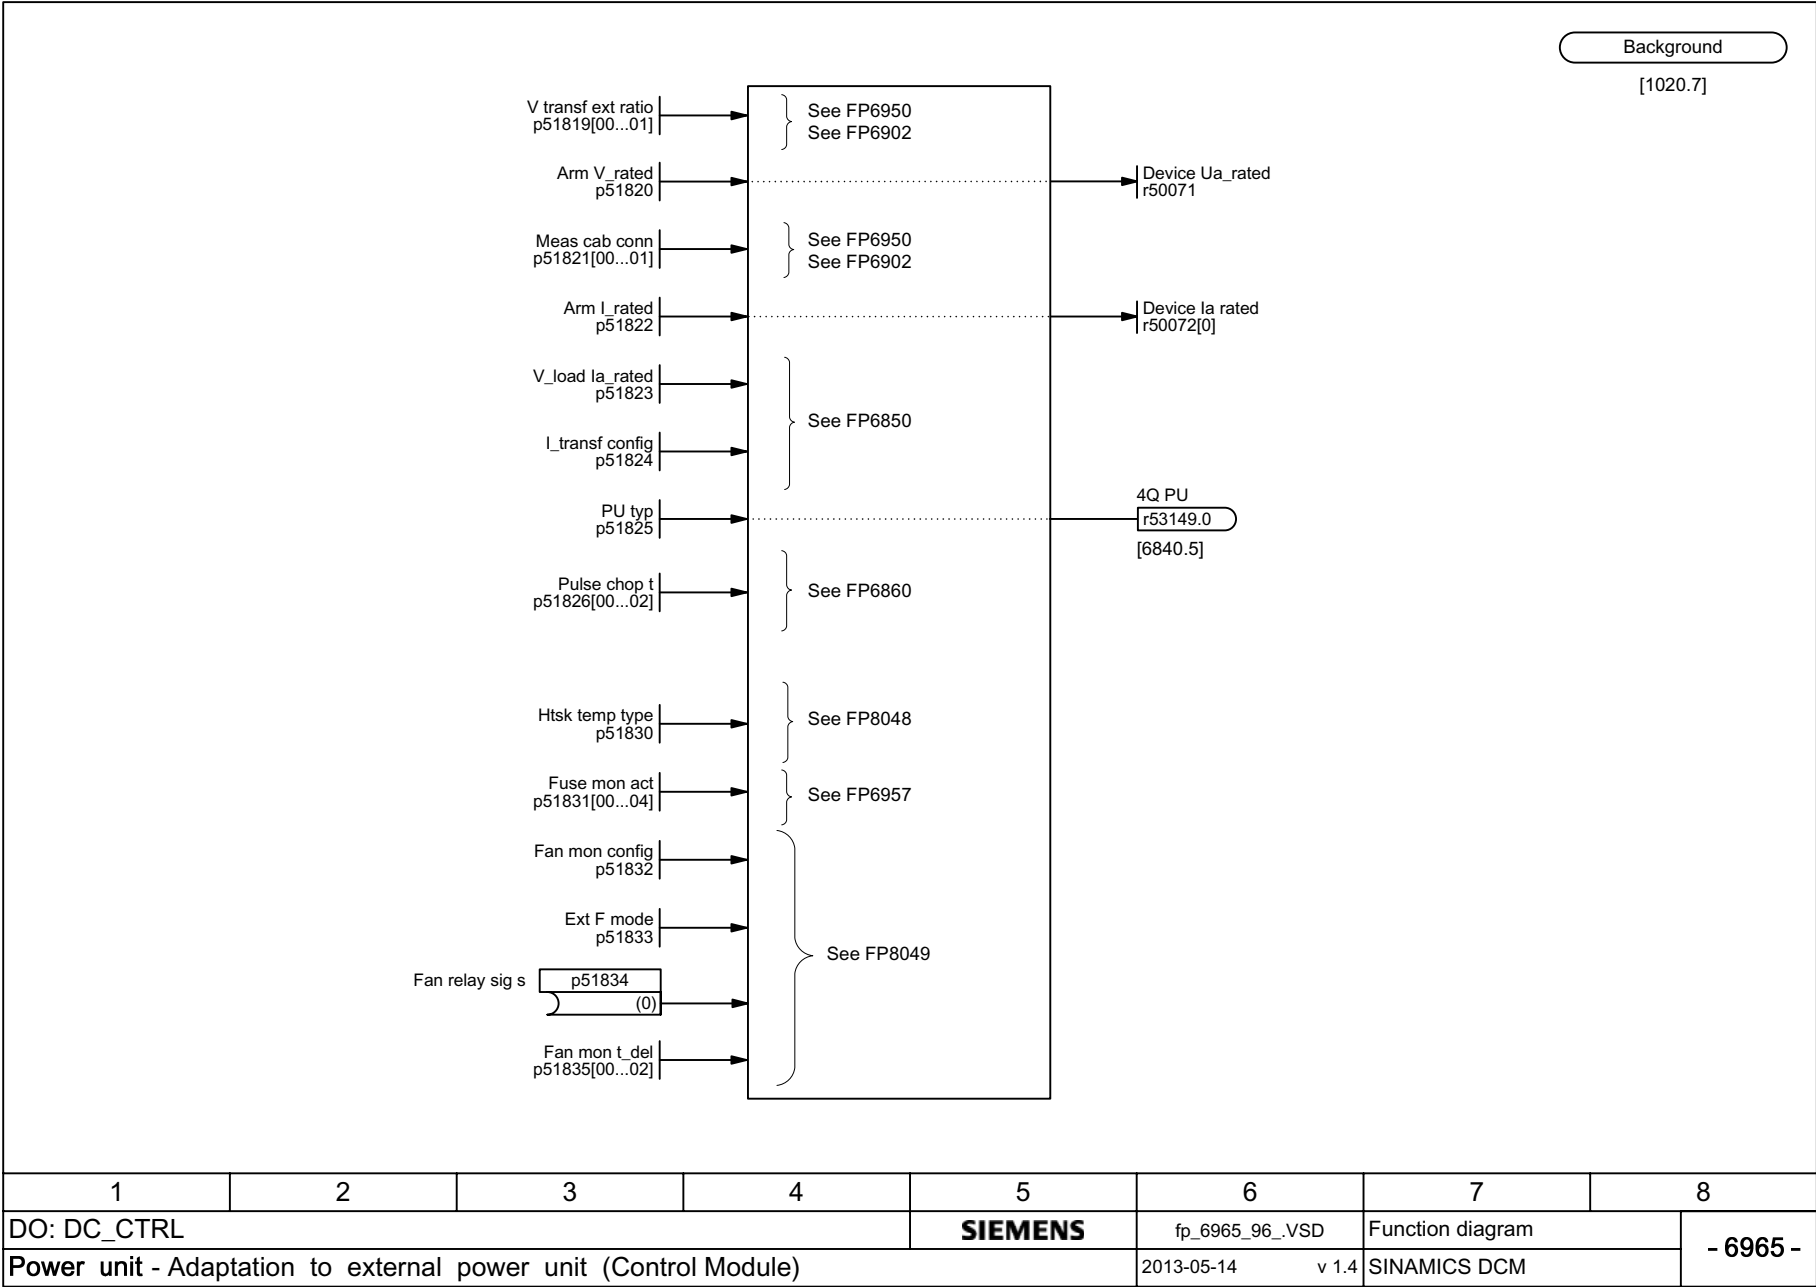


Fig. 2-113 6965 – Adaptation to external power unit (Control Module)

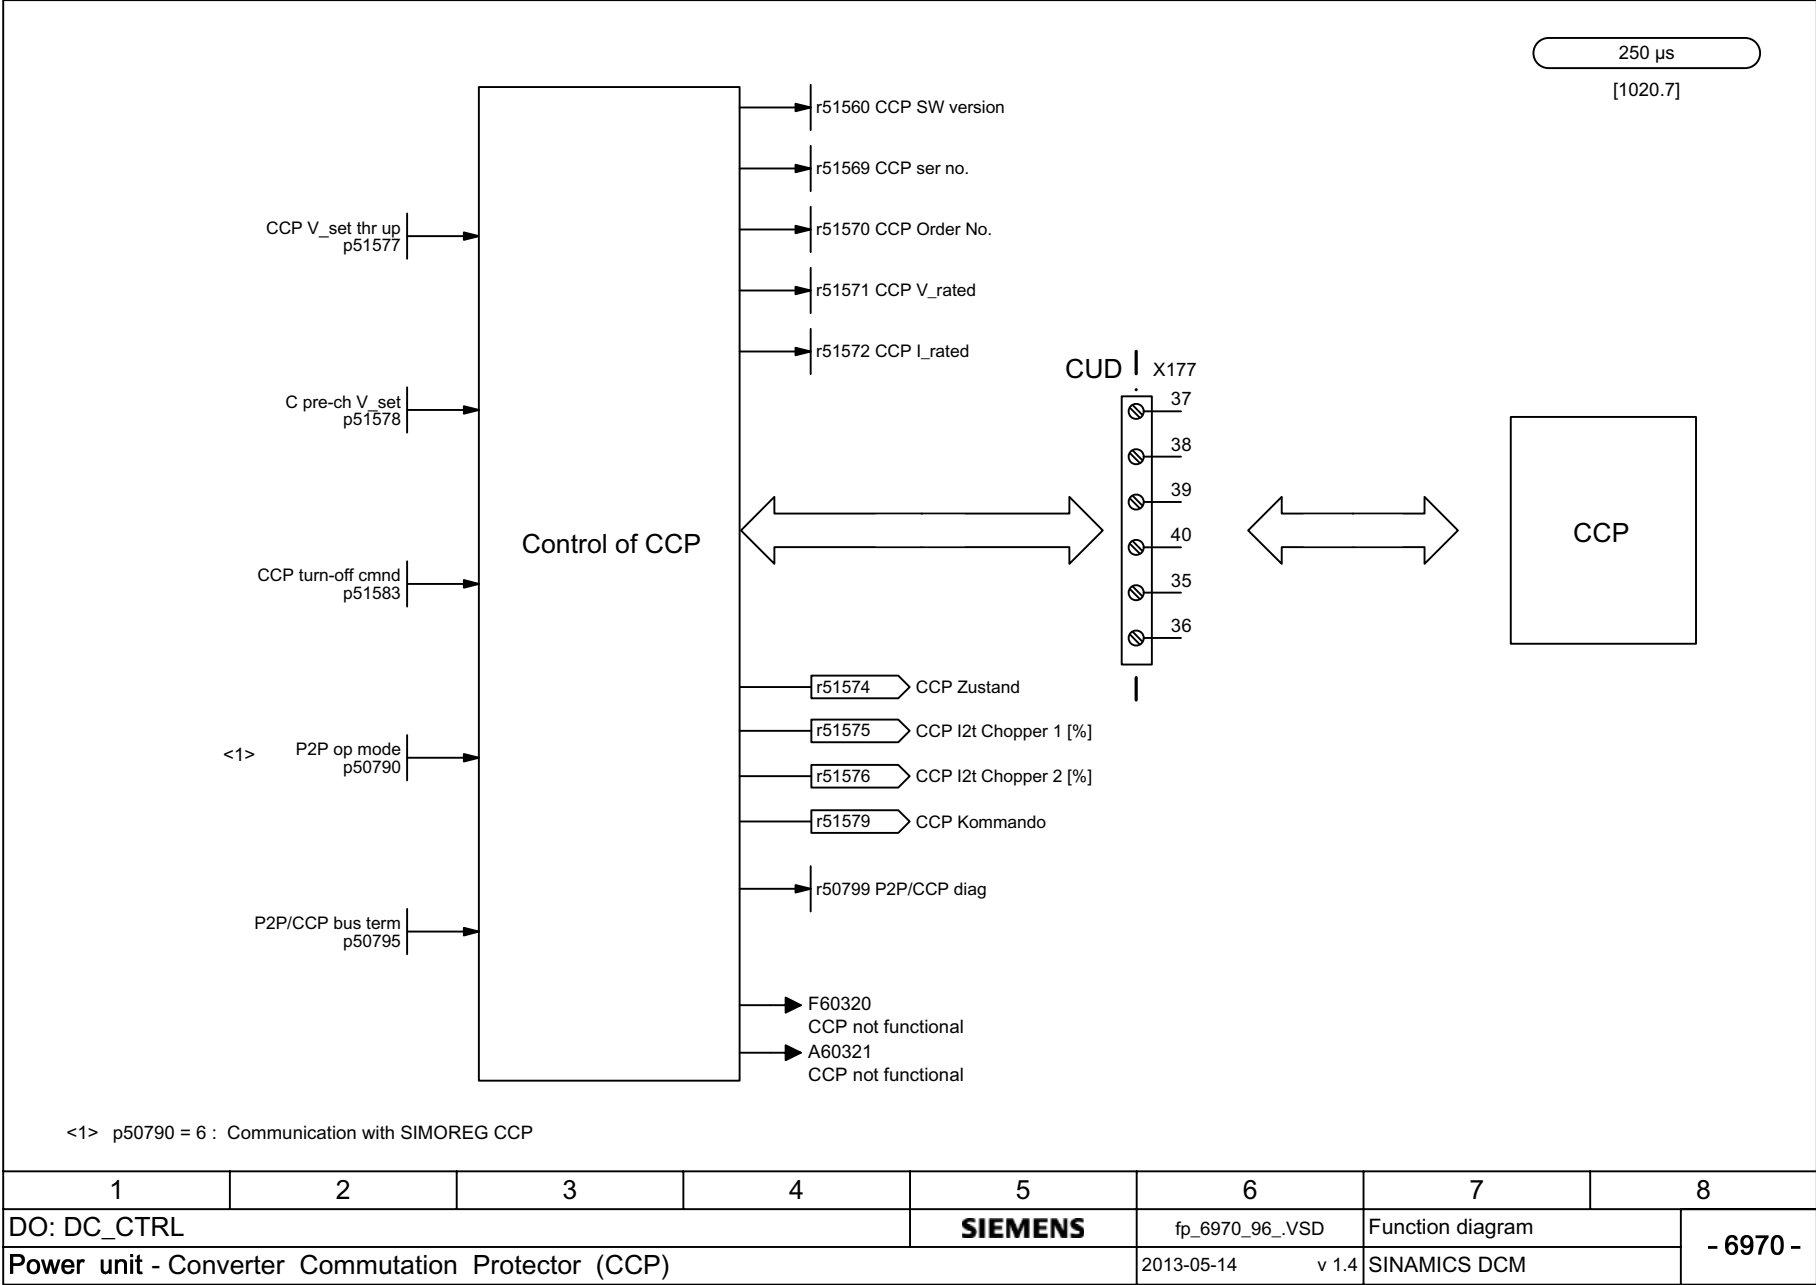


Fig. 2-114 6970 – Converter Commutation Protector (CCP)

## 2.14 Technology controller

### Function diagrams

---

7958 – Closed-loop control ( $r0108.16 = 1$ )

2-793

---



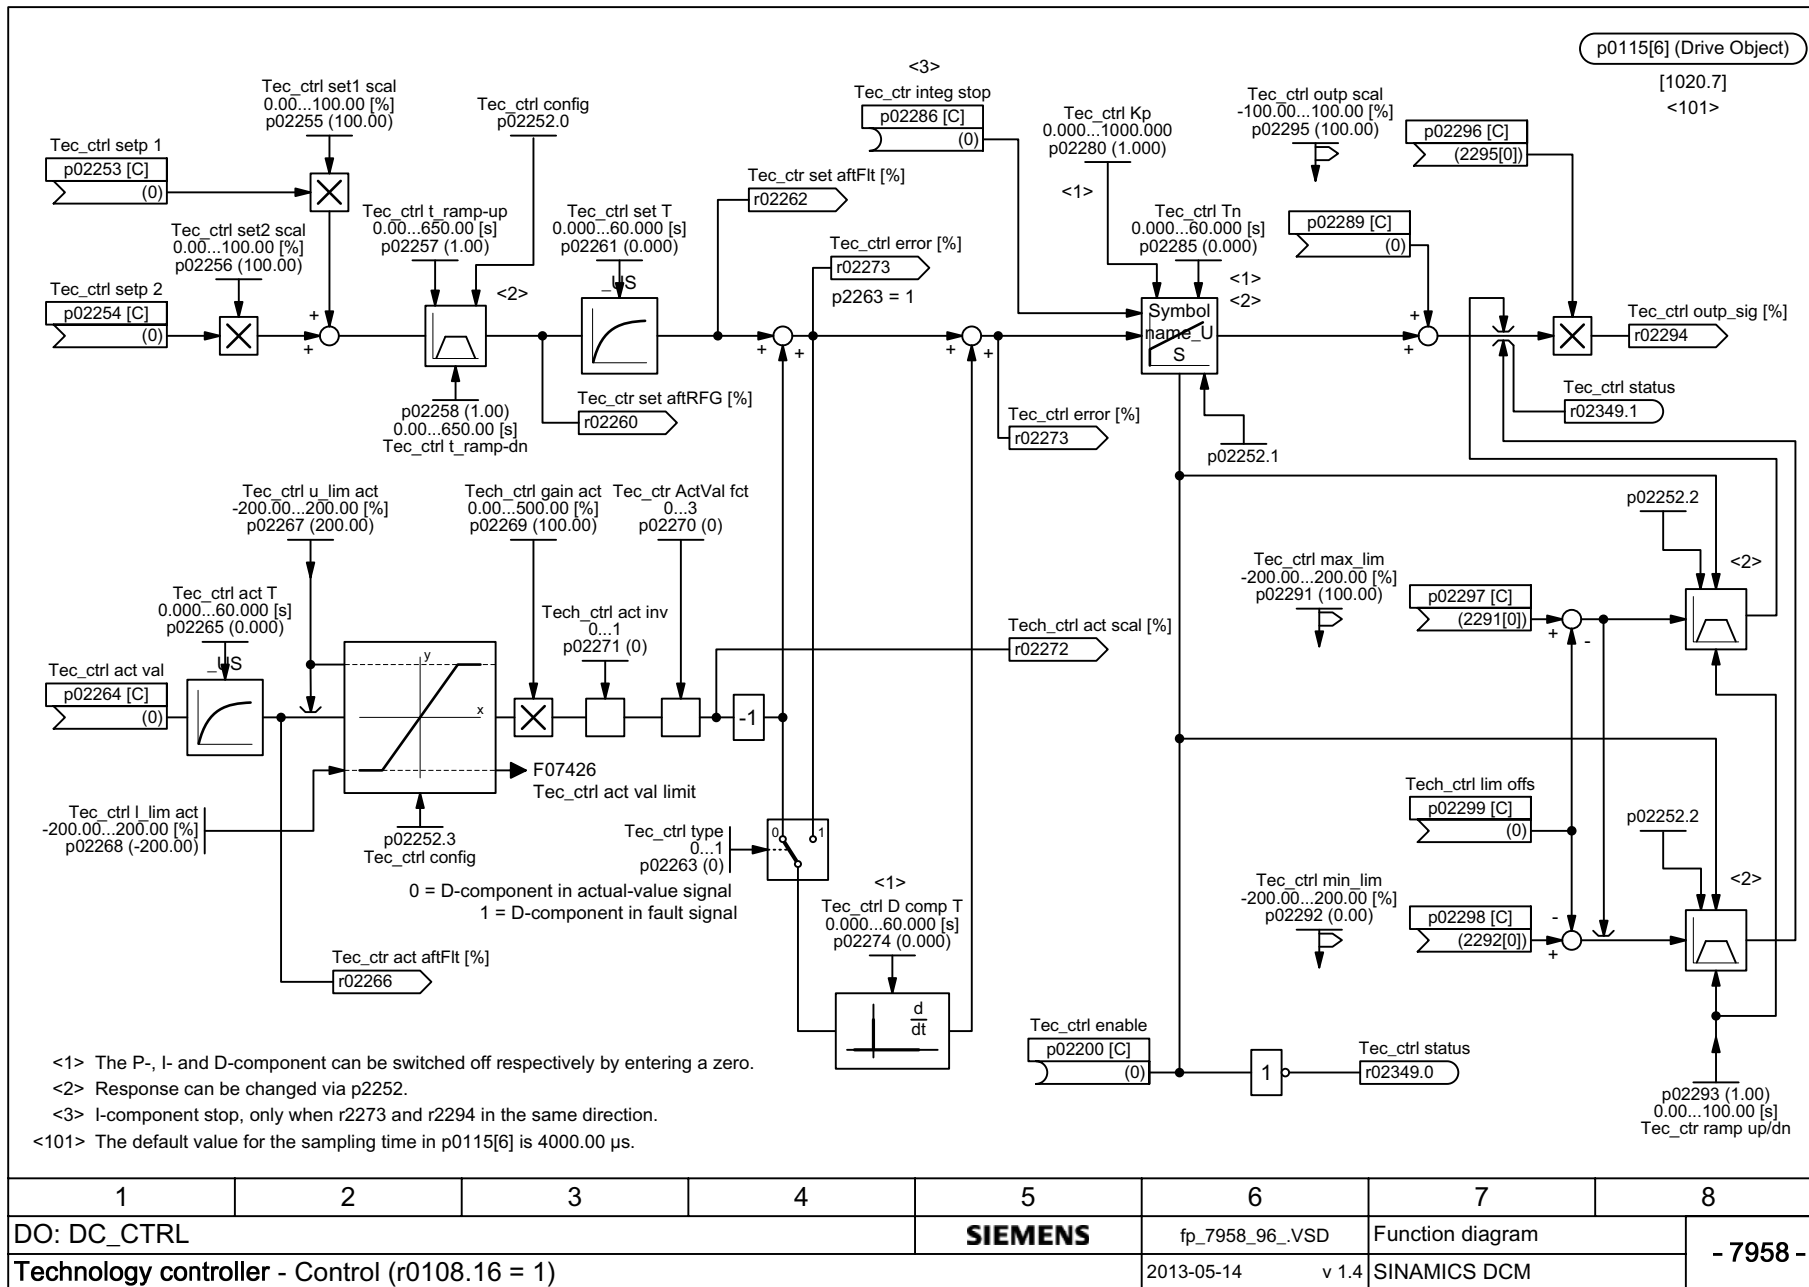


Fig. 2-115 7958 – Closed-loop control (r0108.16 = 1)

## 2.15 Signals and monitoring functions

### Function diagrams

8020 – Messages (Part 1)	2-795
8025 – Messages (Part 2)	2-796
8030 – Motor interface (Part 1, X177.53/54/55)	2-797
8035 – Motor interface (Part 2)	2-798
8038 – I2t monitoring motor	2-799
8040 – Speed-dependent current limitation	2-800
8042 – I2t monitoring power unit	2-801
8044 – Field current monitoring	2-802
8045 – Device fan operating hours counter	2-803
8046 – Monitoring stall protection/tachometer break	2-804
8047 – Device fan (DC converter)	2-805
8048 – Internal device monitoring functions	2-806
8049 – Device fan (Control Module)	2-807
8050 – Trend recorder function	2-808
8052 – Diagnostic memory	2-809
8054 – Internal diagnostics	2-810

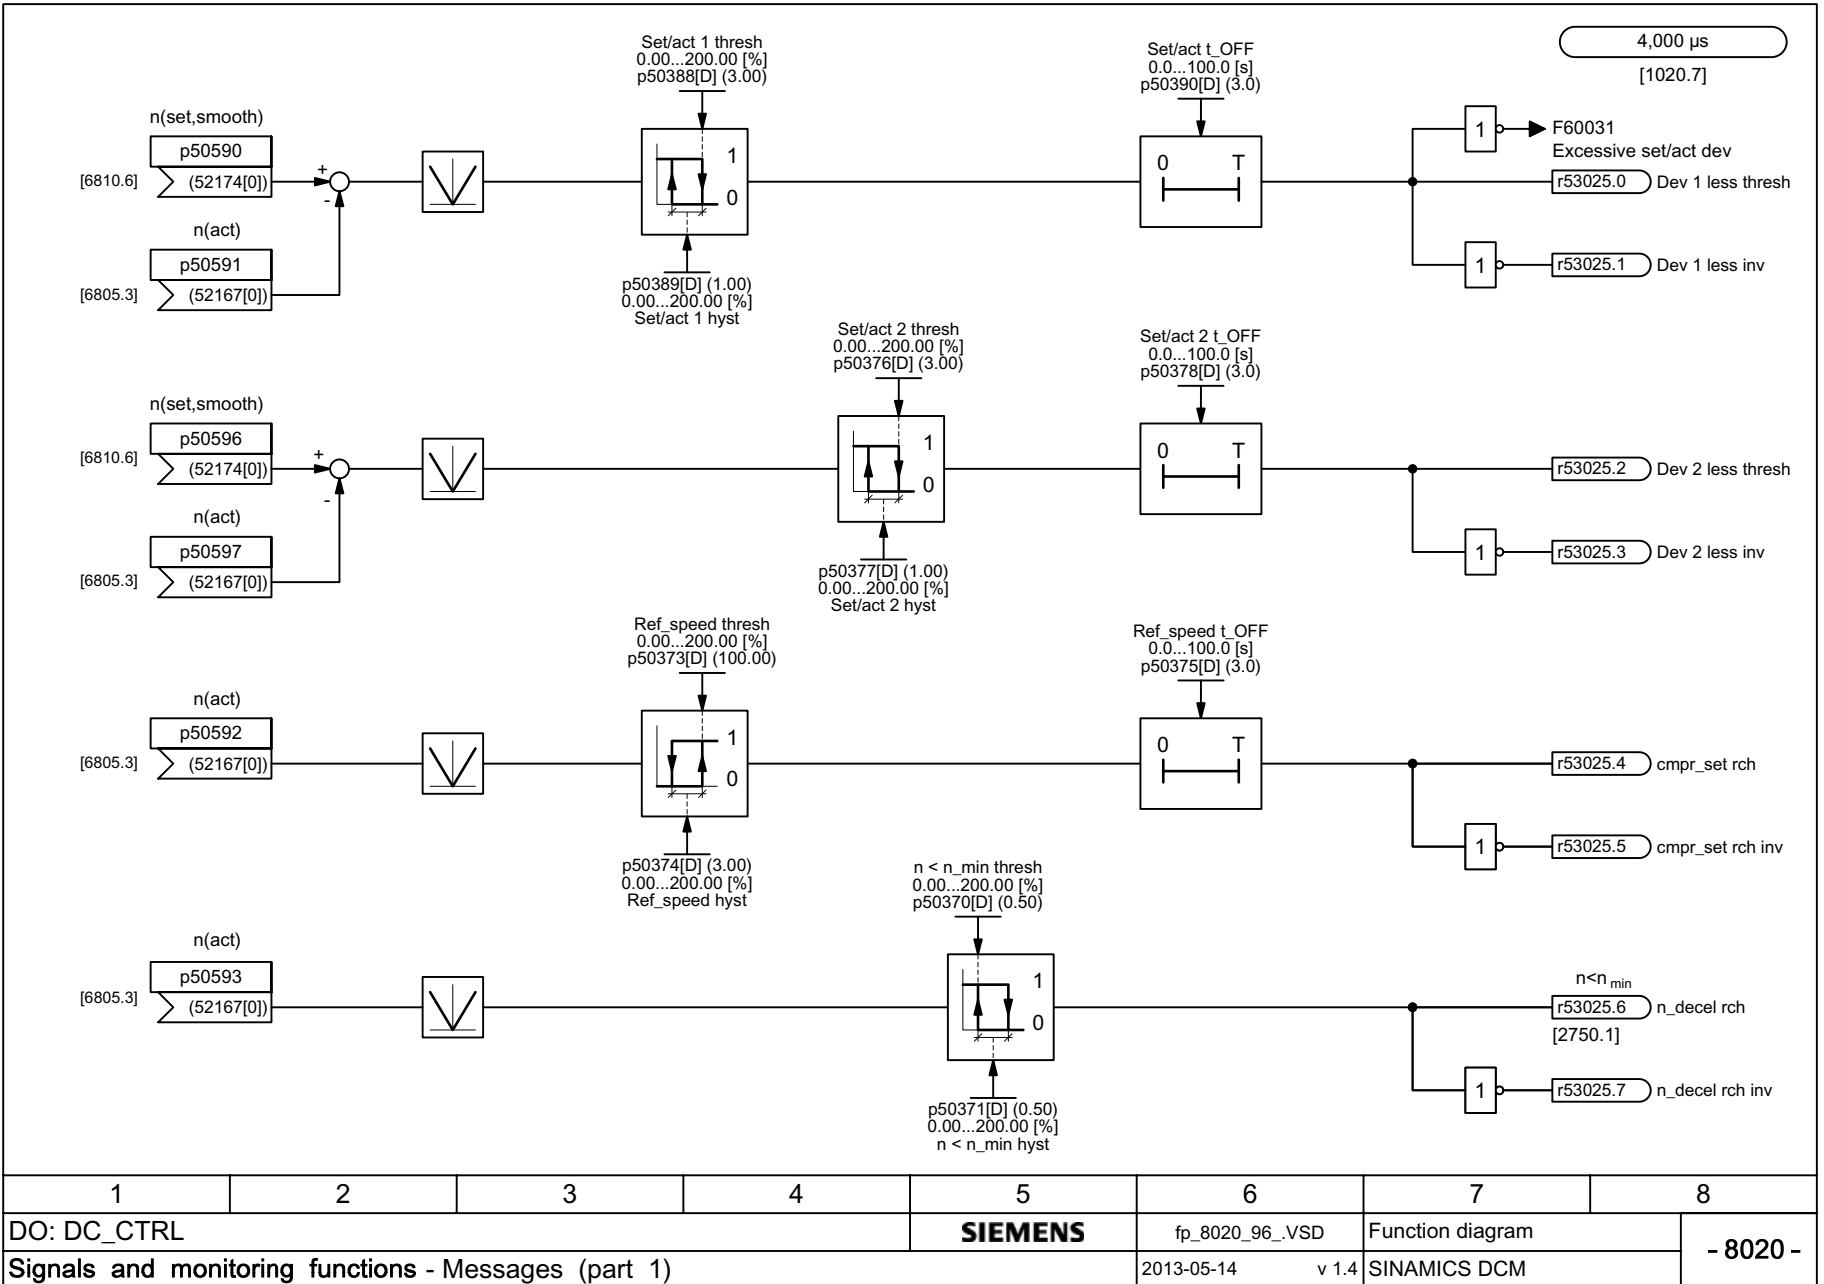


Fig. 2-116 8020 – Messages (Part 1)


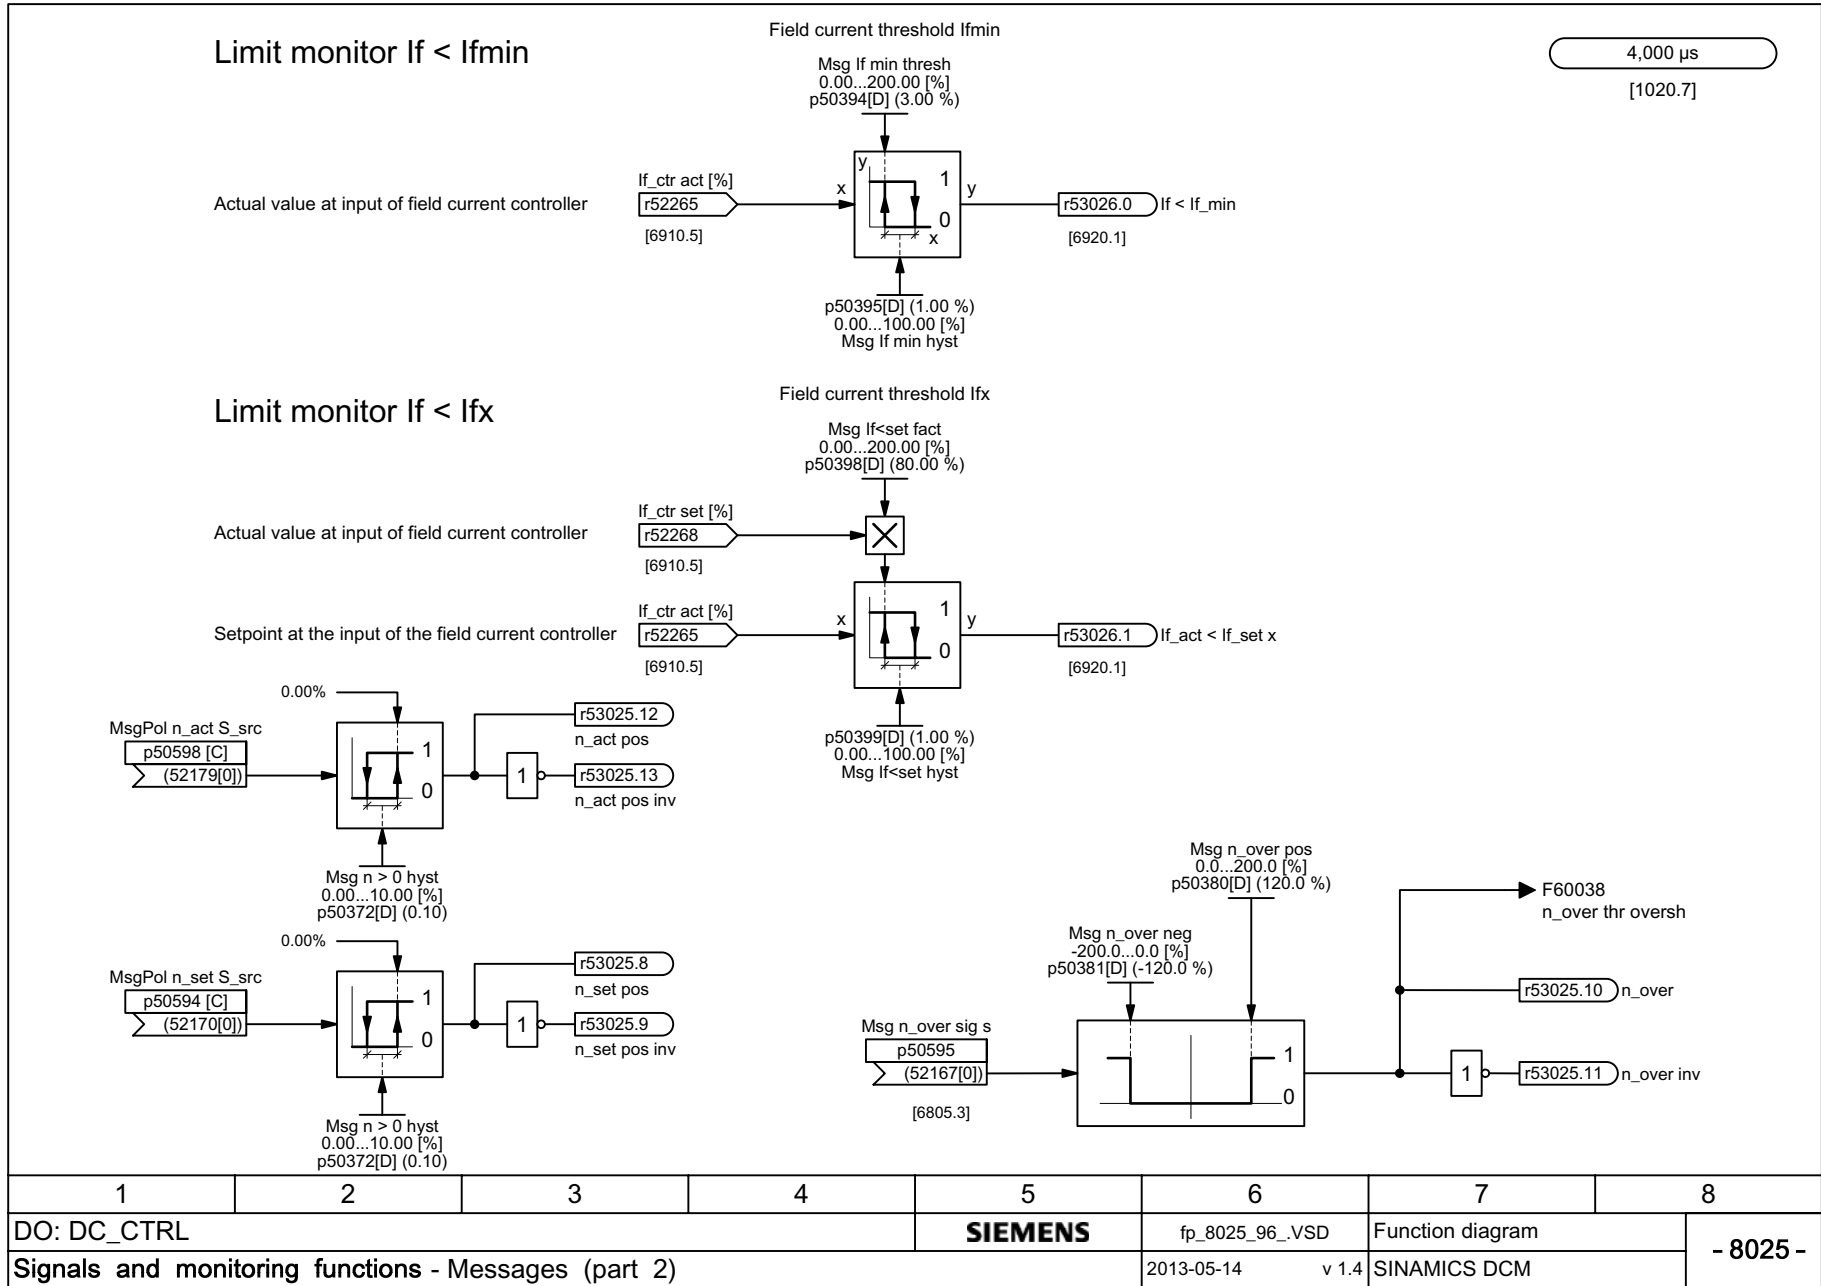


Fig. 2-117 8025 – Messages (Part 2)

- <1> For r50012 and r52051, the following applies:  
Value = temperature: for KTY84 (p50490=1), PT100 (p50490=6), NTC thermistor (p50490=7) or PT1000 (p50490=8)  
Value = 0: for PTC thermistor (p50490 = 2,3,4,5)
- <2> A...KTY84 (p50490=1), PT100 (p50490=6), NTC thermistor (p50490=7) or PT1000 (p50490=8)  
B...PTC thermistor (p50490 = 2,3,4,5)
- <3> Lay shielded cable,  
with shield connected to ground at both ends
- <4> Terminal 54 (sense) is used for compensating  
cable resistances; for this, the cable from terminal 53 to the  
temperature sensor and the cable from connection 54 to the  
temperature sensor should be around the same length.
- <5> If terminal 54 (sense) is not required, then  
terminal 54 must be connected to terminal 55.

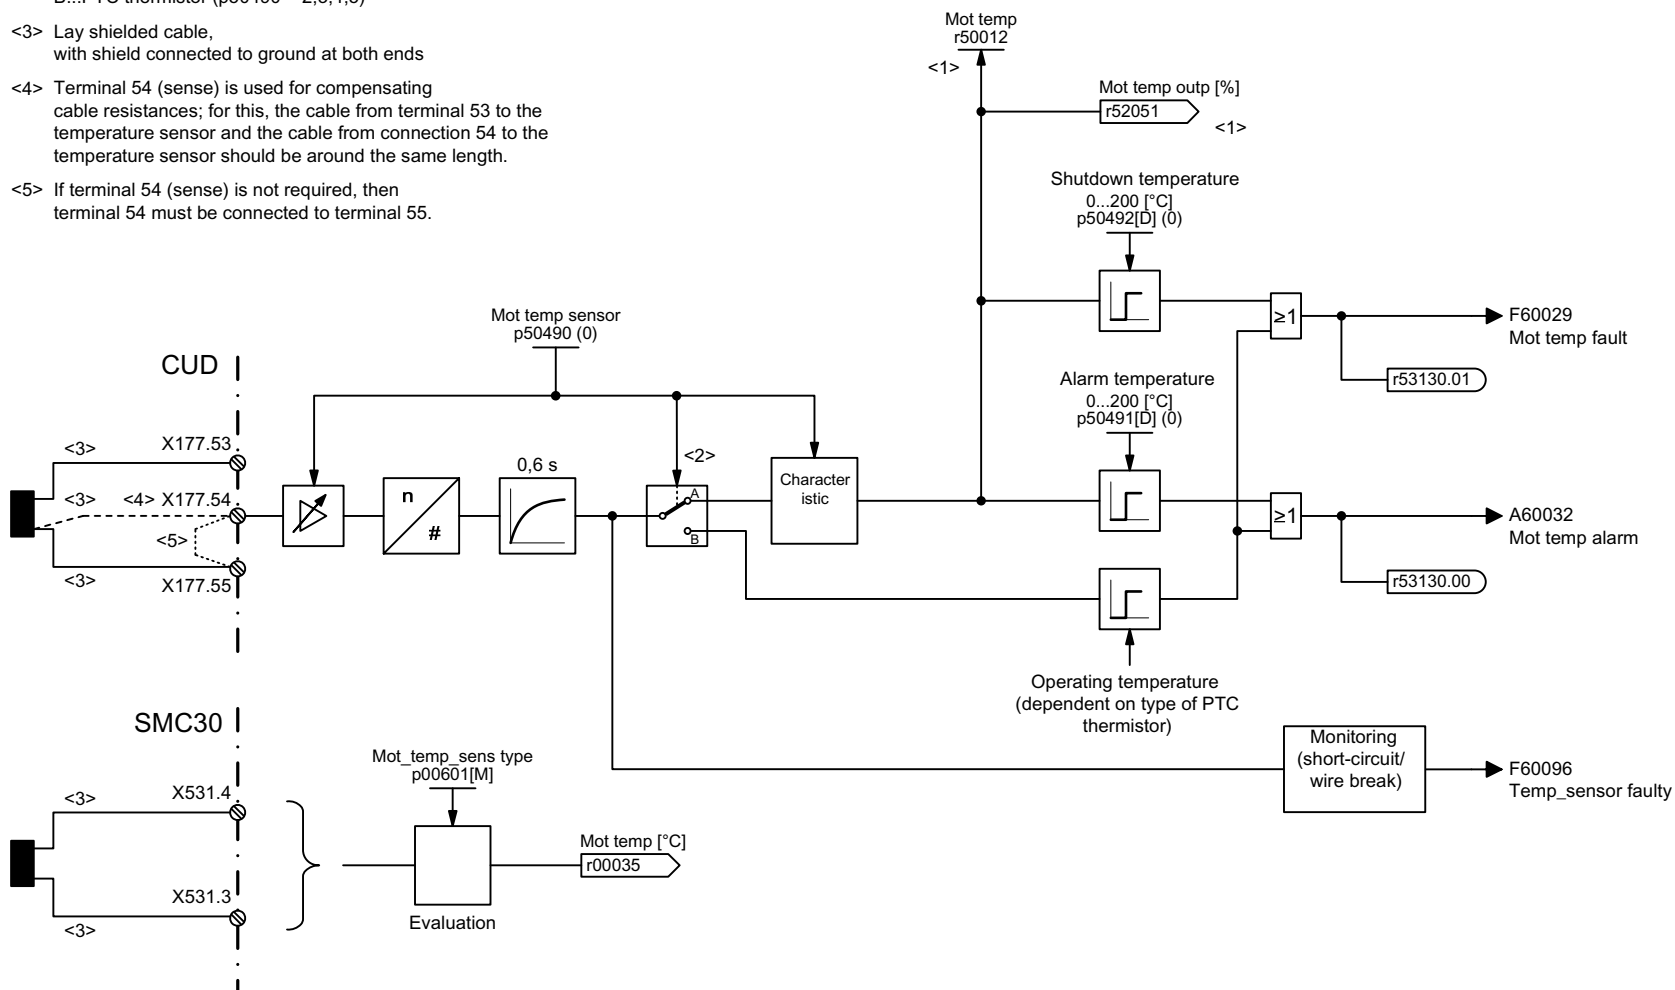8,000  $\mu$ s  
[1020.7]



1	2	3	4	5	6	7	8
DO: DC_CTRL				<b>SIEMENS</b>	fp_8030_96_VSD	Function diagram	
Signals and monitoring functions - Motor interface (part 1, X177.53/54/55)					2013-05-14 v 1.4	SINAMICS DCM	
							- 8030 -

Fig. 2-118 8030 – Motor interface (Part 1, X177.53/54/55)

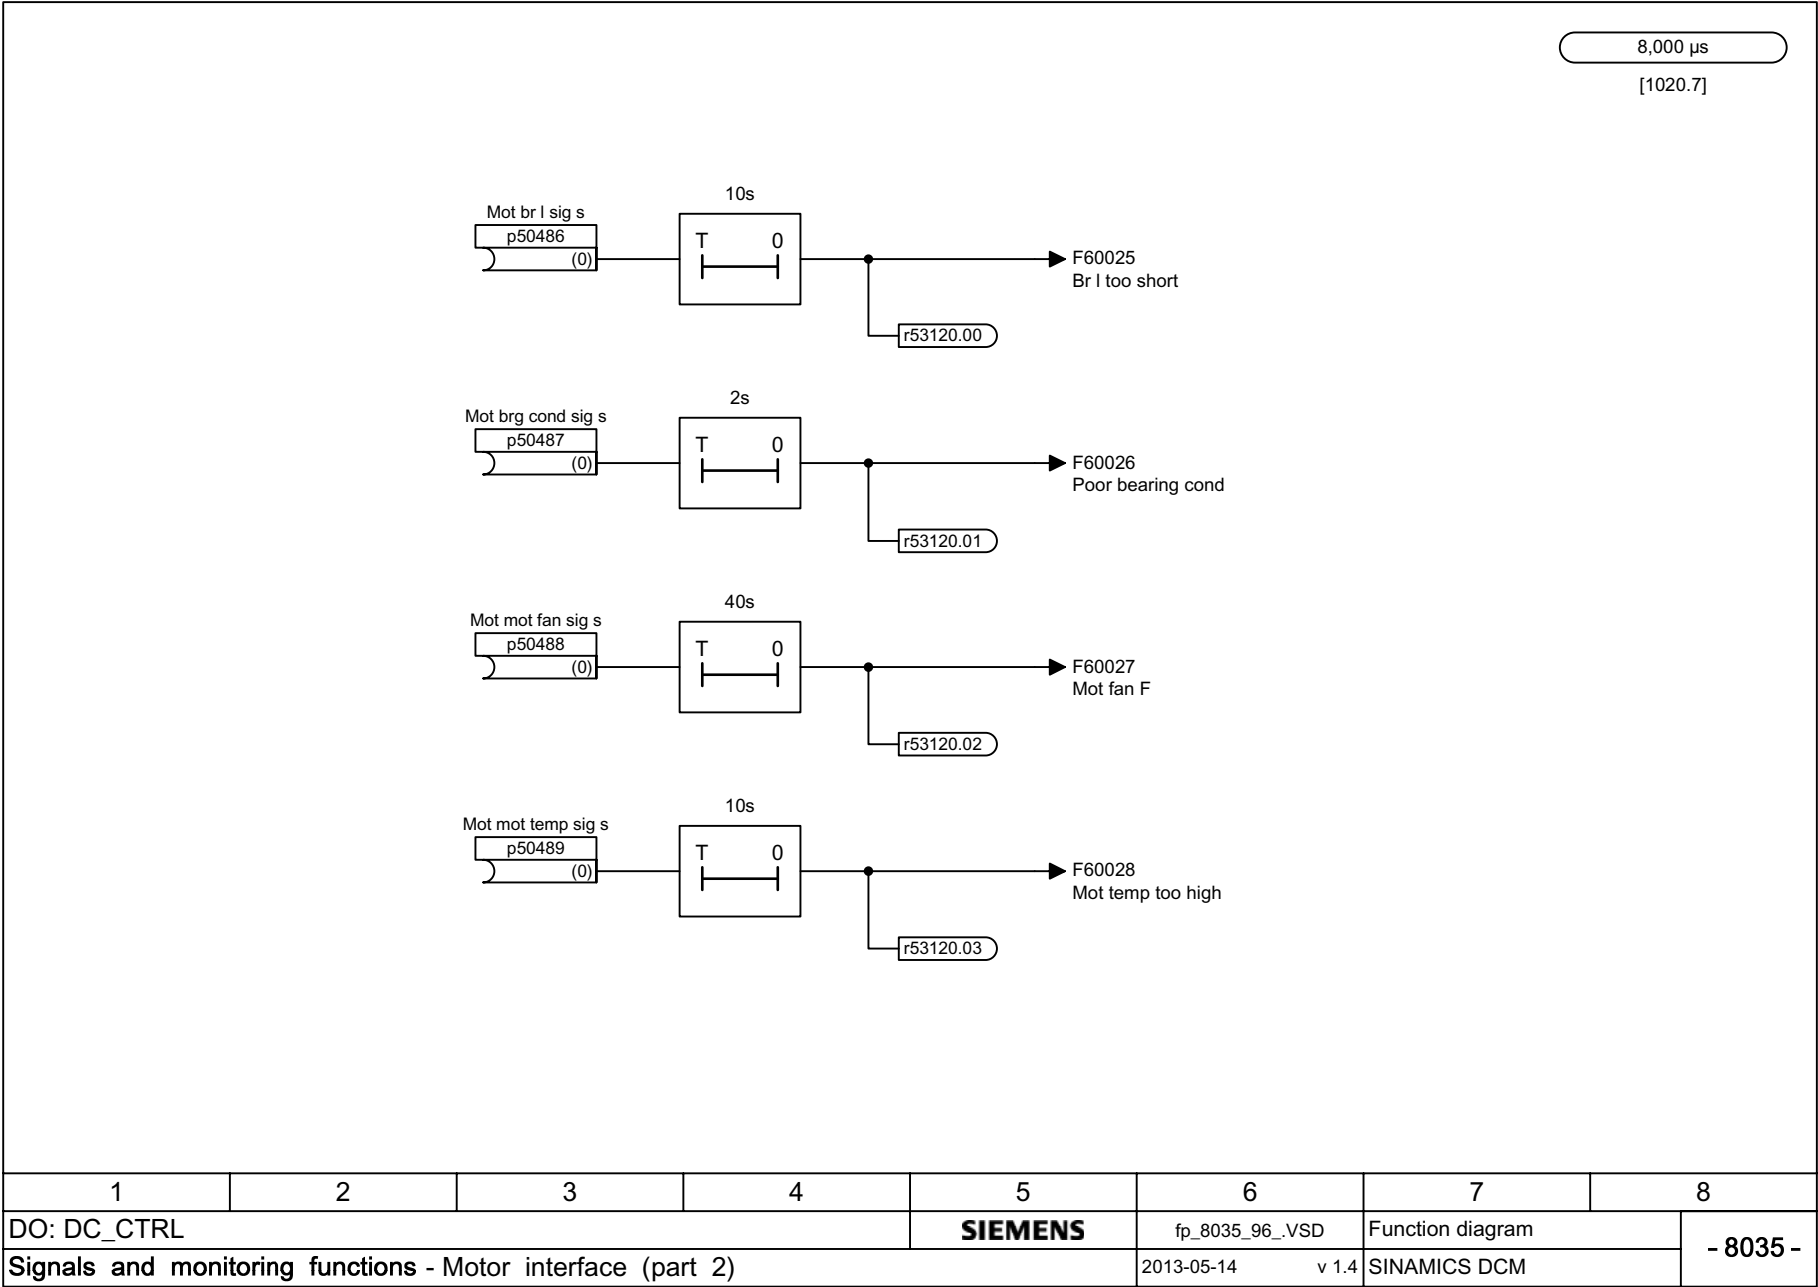


Fig. 2-119 8035 – Motor interface (Part 2)







Fig. 2-121 8040 – Speed-dependent current limitation


1	2	3	4	5	6	7	8	
DO: DC_CTRL				SIEMENS	fp_8040_96_VSD	Function diagram		- 8040 -
Signals and monitoring functions - Speed-dependent current limitation					2013-05-14 v 1.4	SINAMICS DCM		

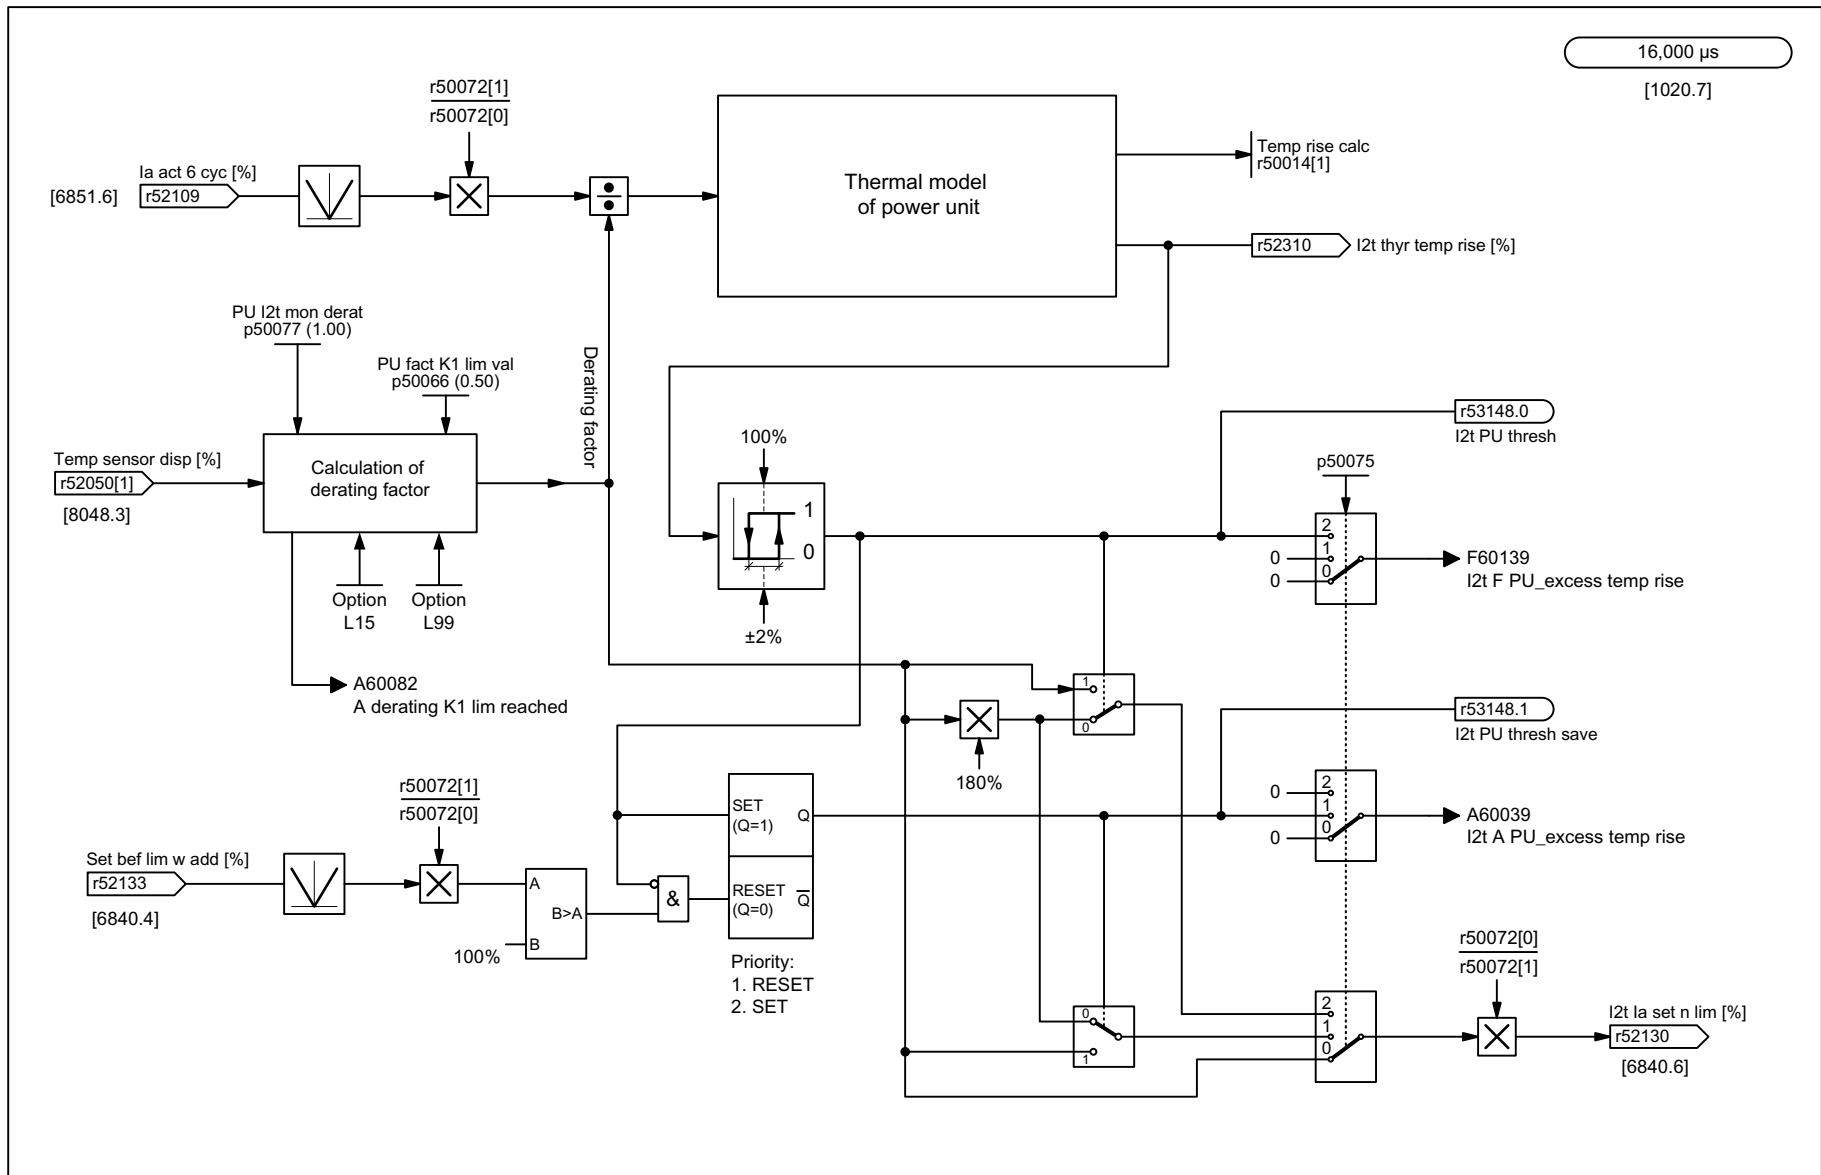



1	2	3	4	5	6	7	8
DO: DC_CTRL				<b>SIEMENS</b>	fp_8042_96_VSD	Function diagram	
Signals and monitoring functions - Power unit I2t monitoring					2013-05-14 v 1.4	SINAMICS DCM	
- 8042 -							

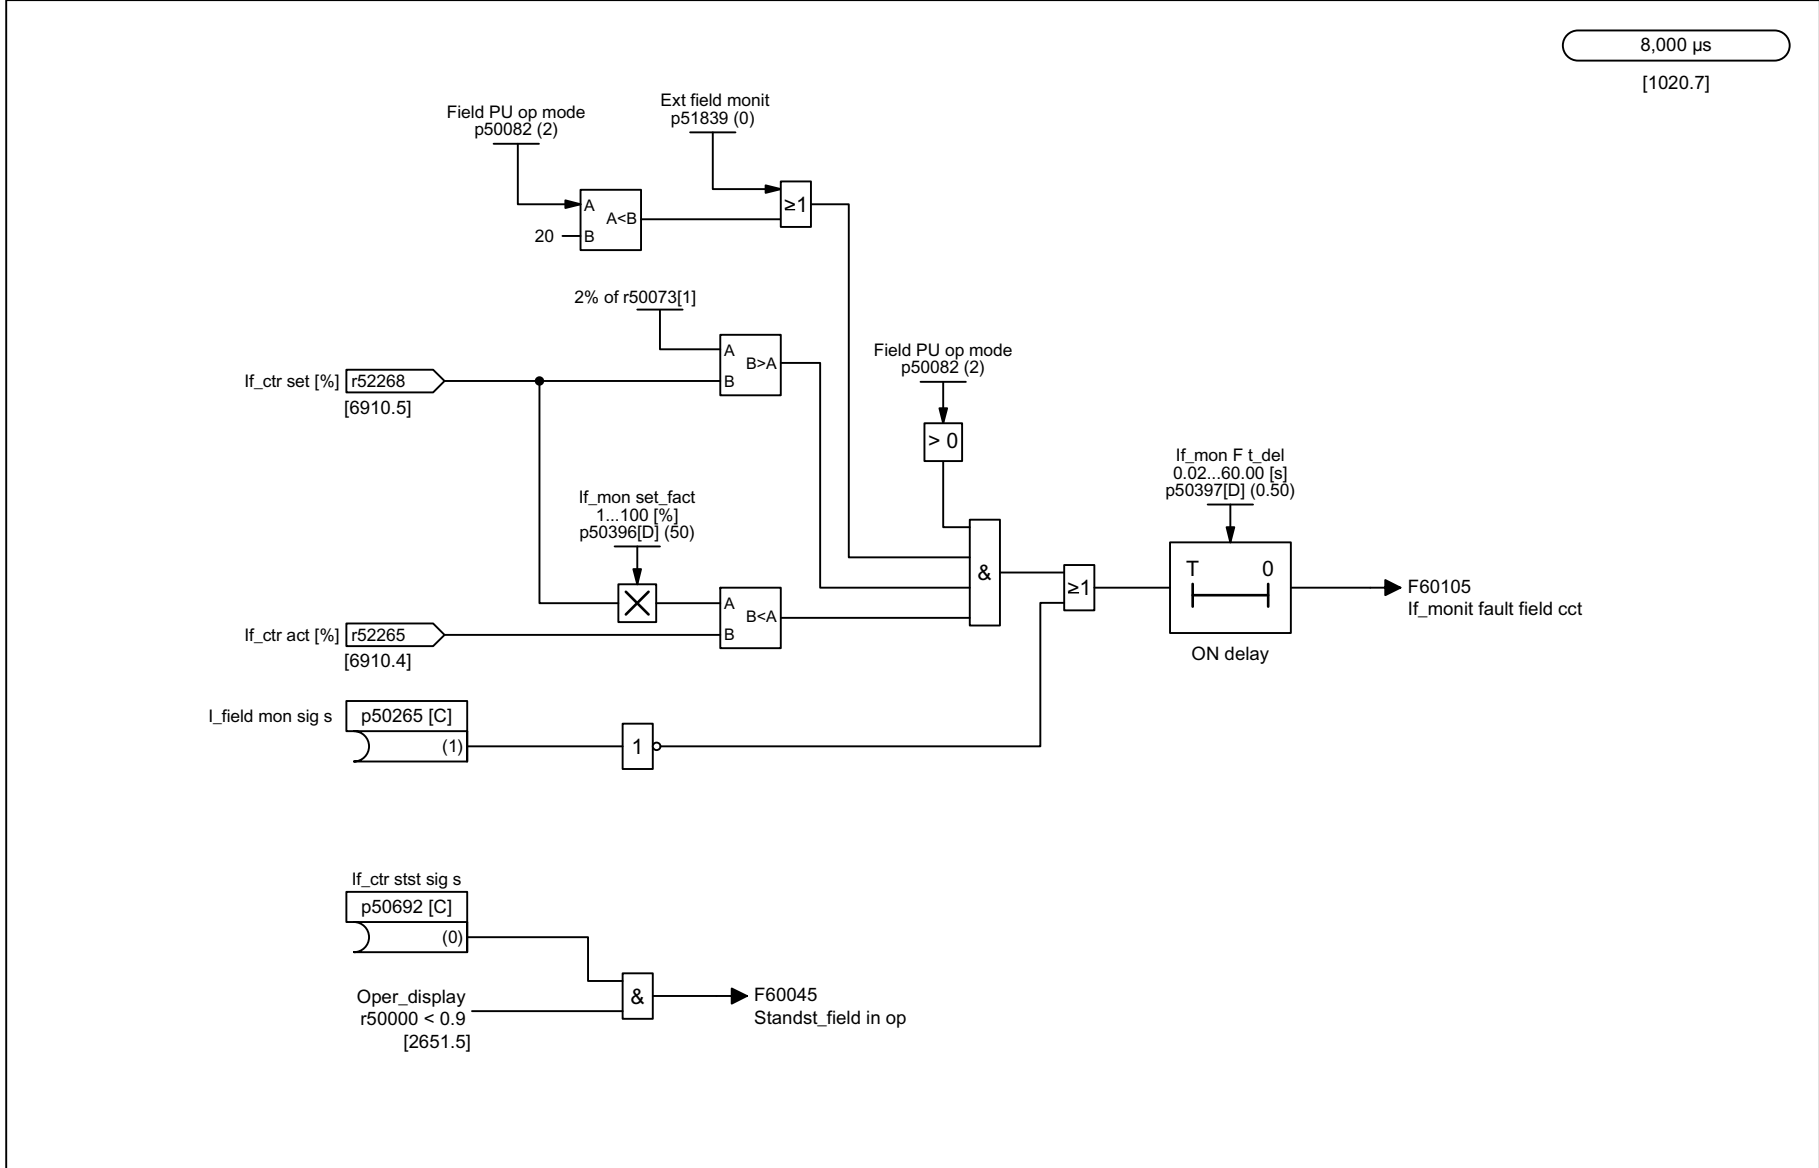Fig. 2-122 8042 – I2t monitoring power unit



1	2	3	4	5	6	7	8
DO: DC_CTRL				<b>SIEMENS</b>	fp_8044_96_VSD	Function diagram	
Signals and monitoring functions - Field current monitoring					2013-05-14	v 1.4	SINAMICS DCM
							- 8044 -

Fig. 2-123 8044 – Field current monitoring




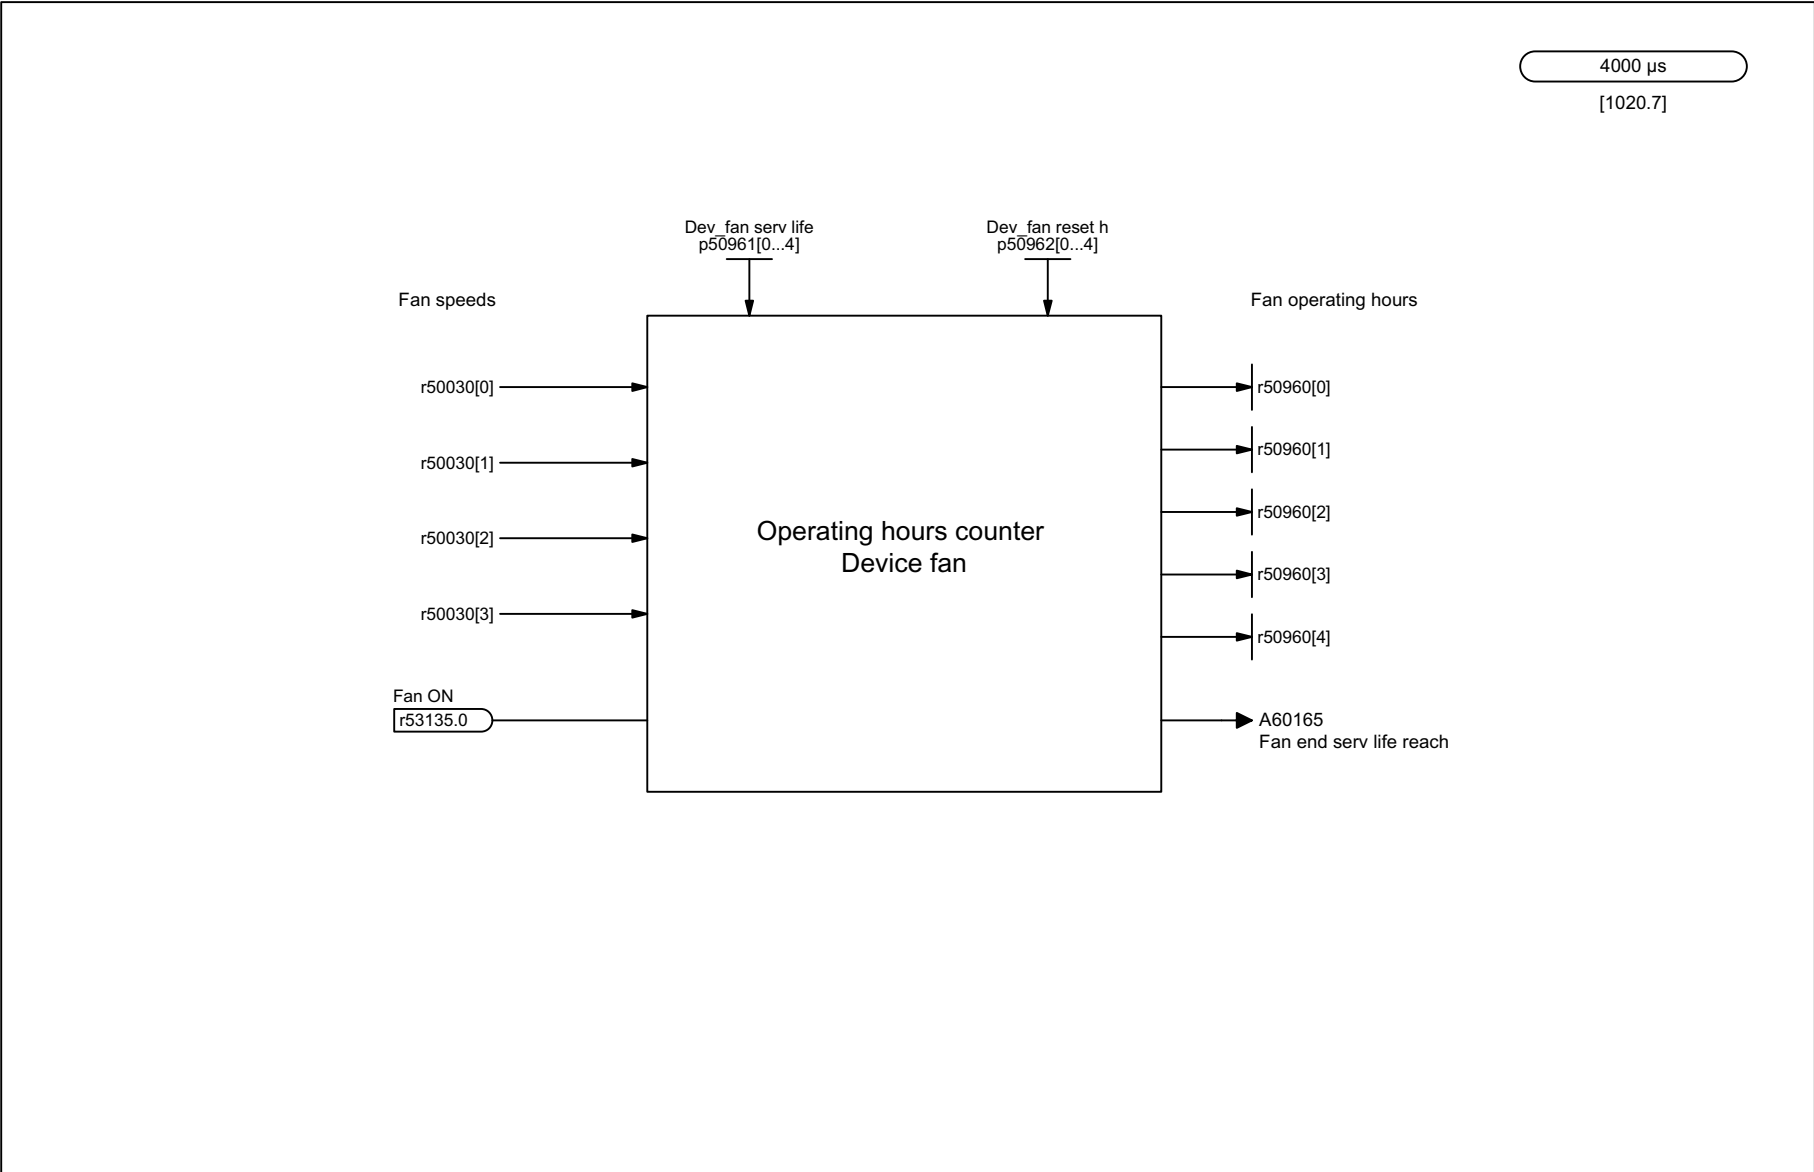



Fig. 2-124

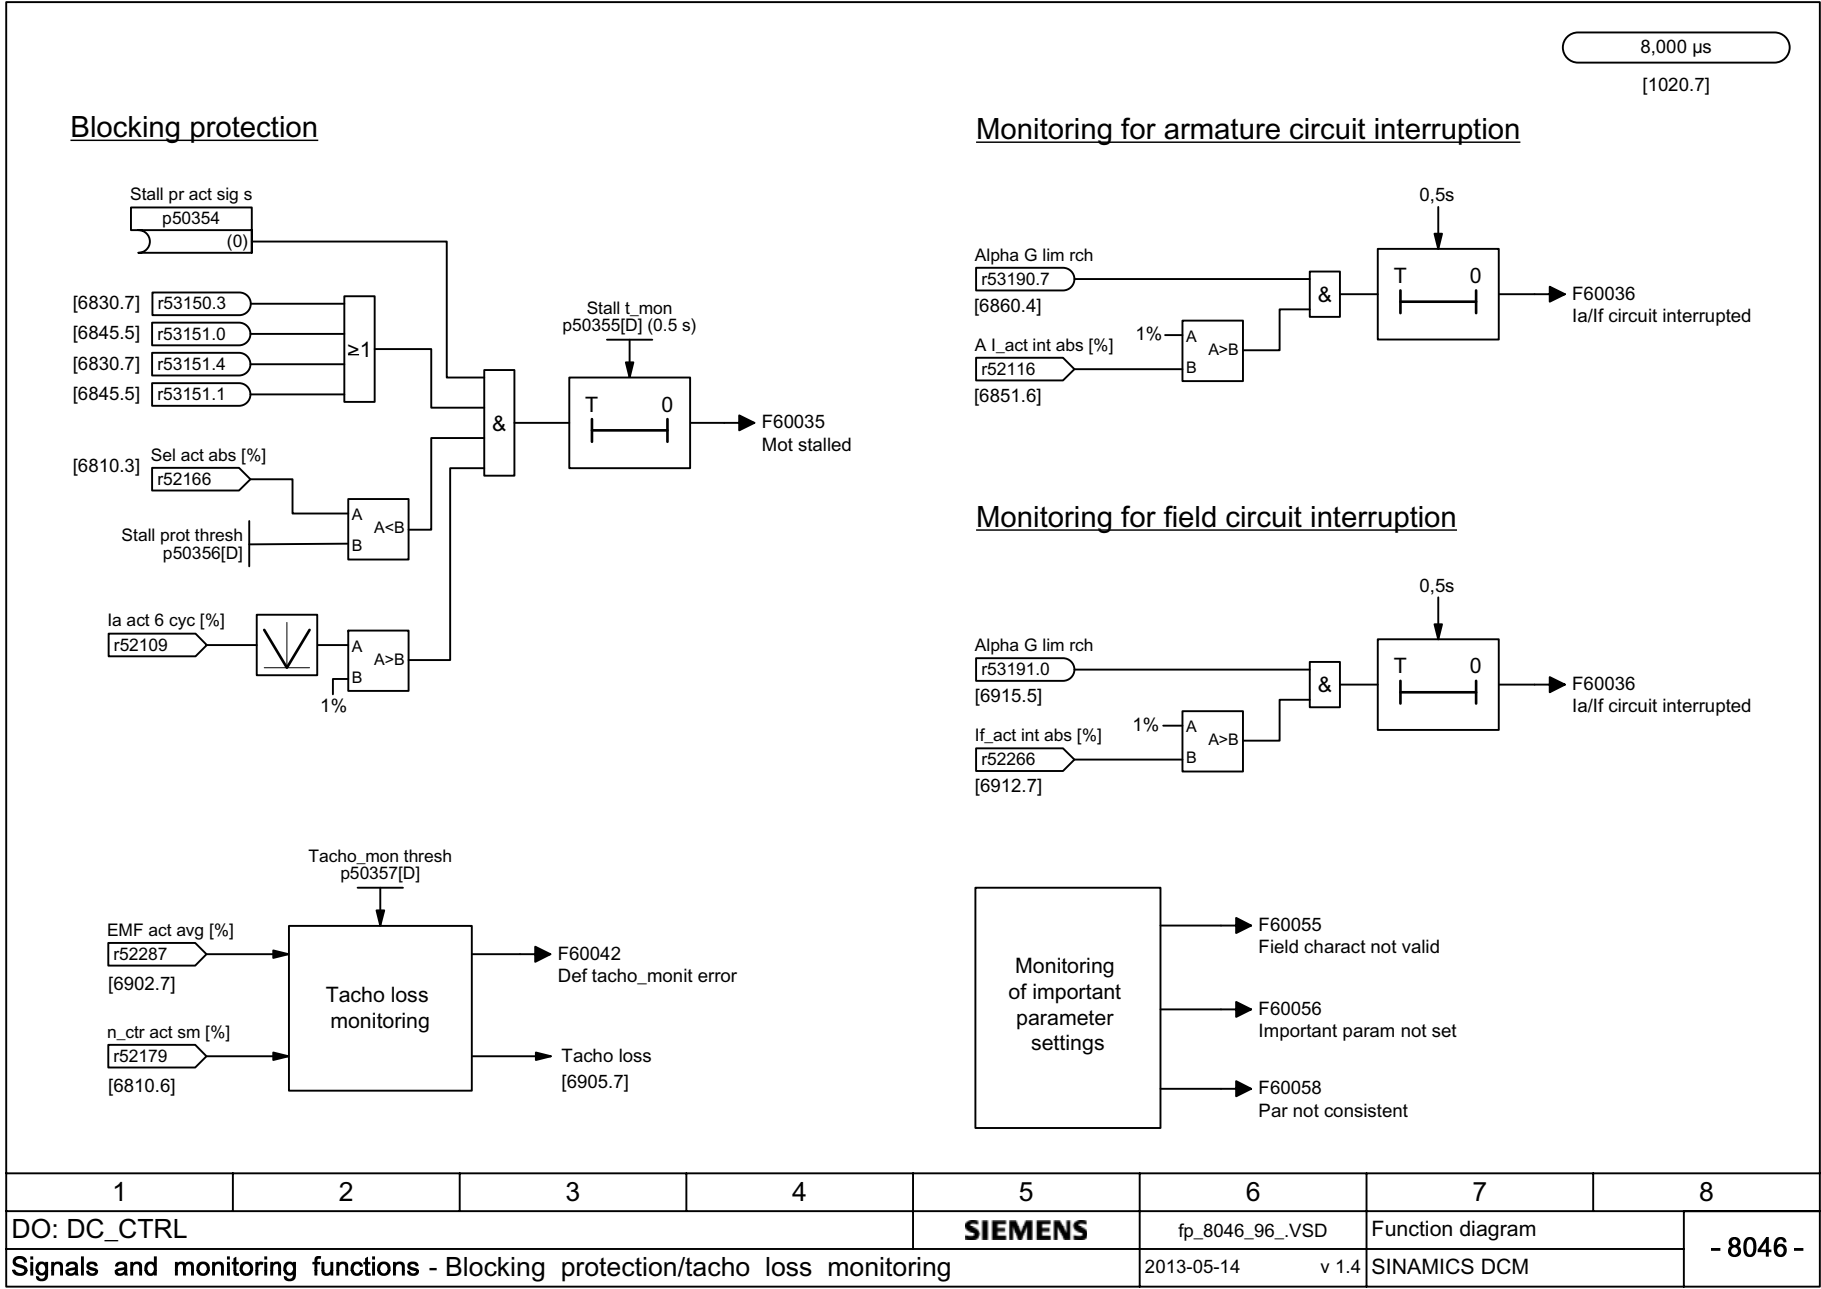



8047 – Device fan (DC converter)

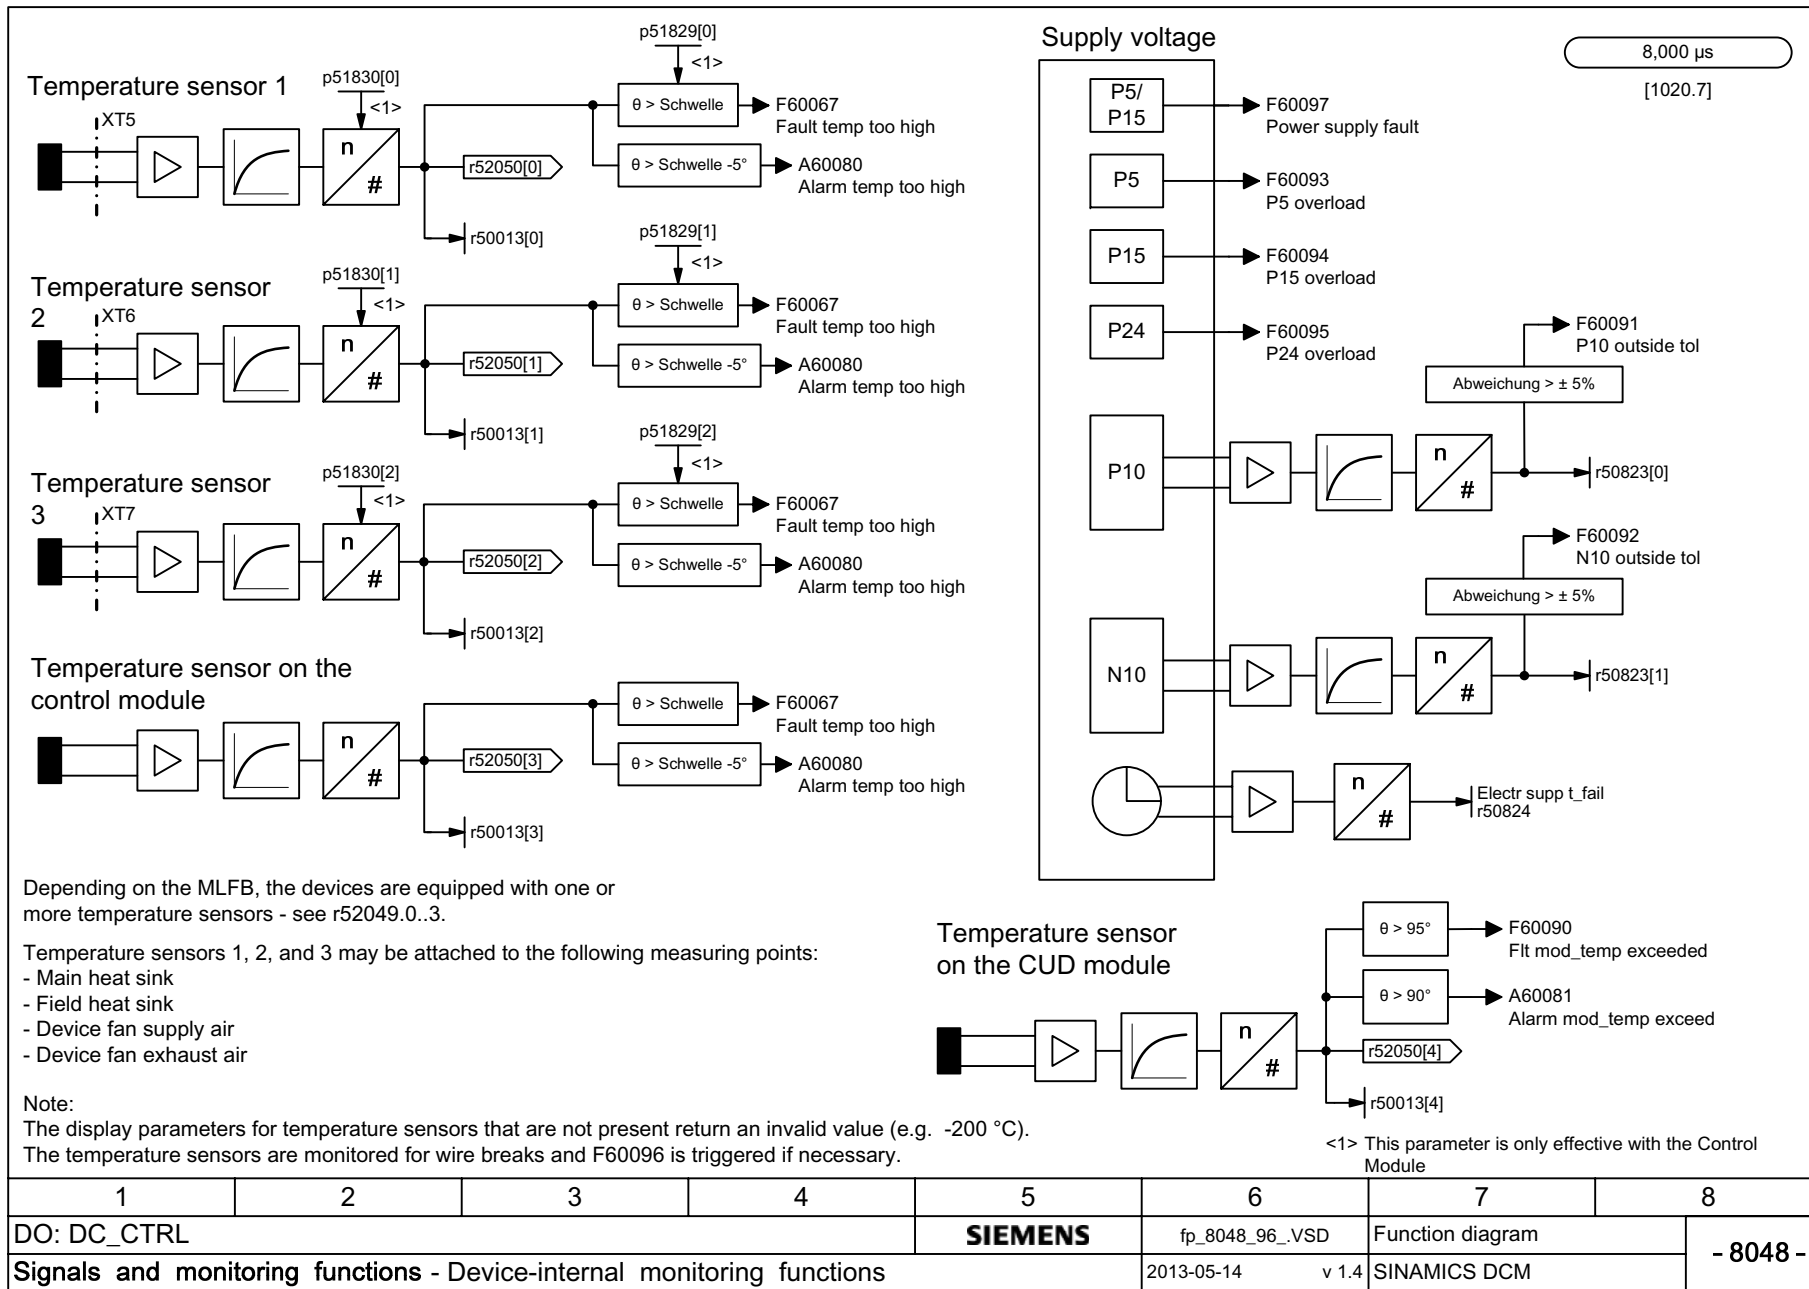

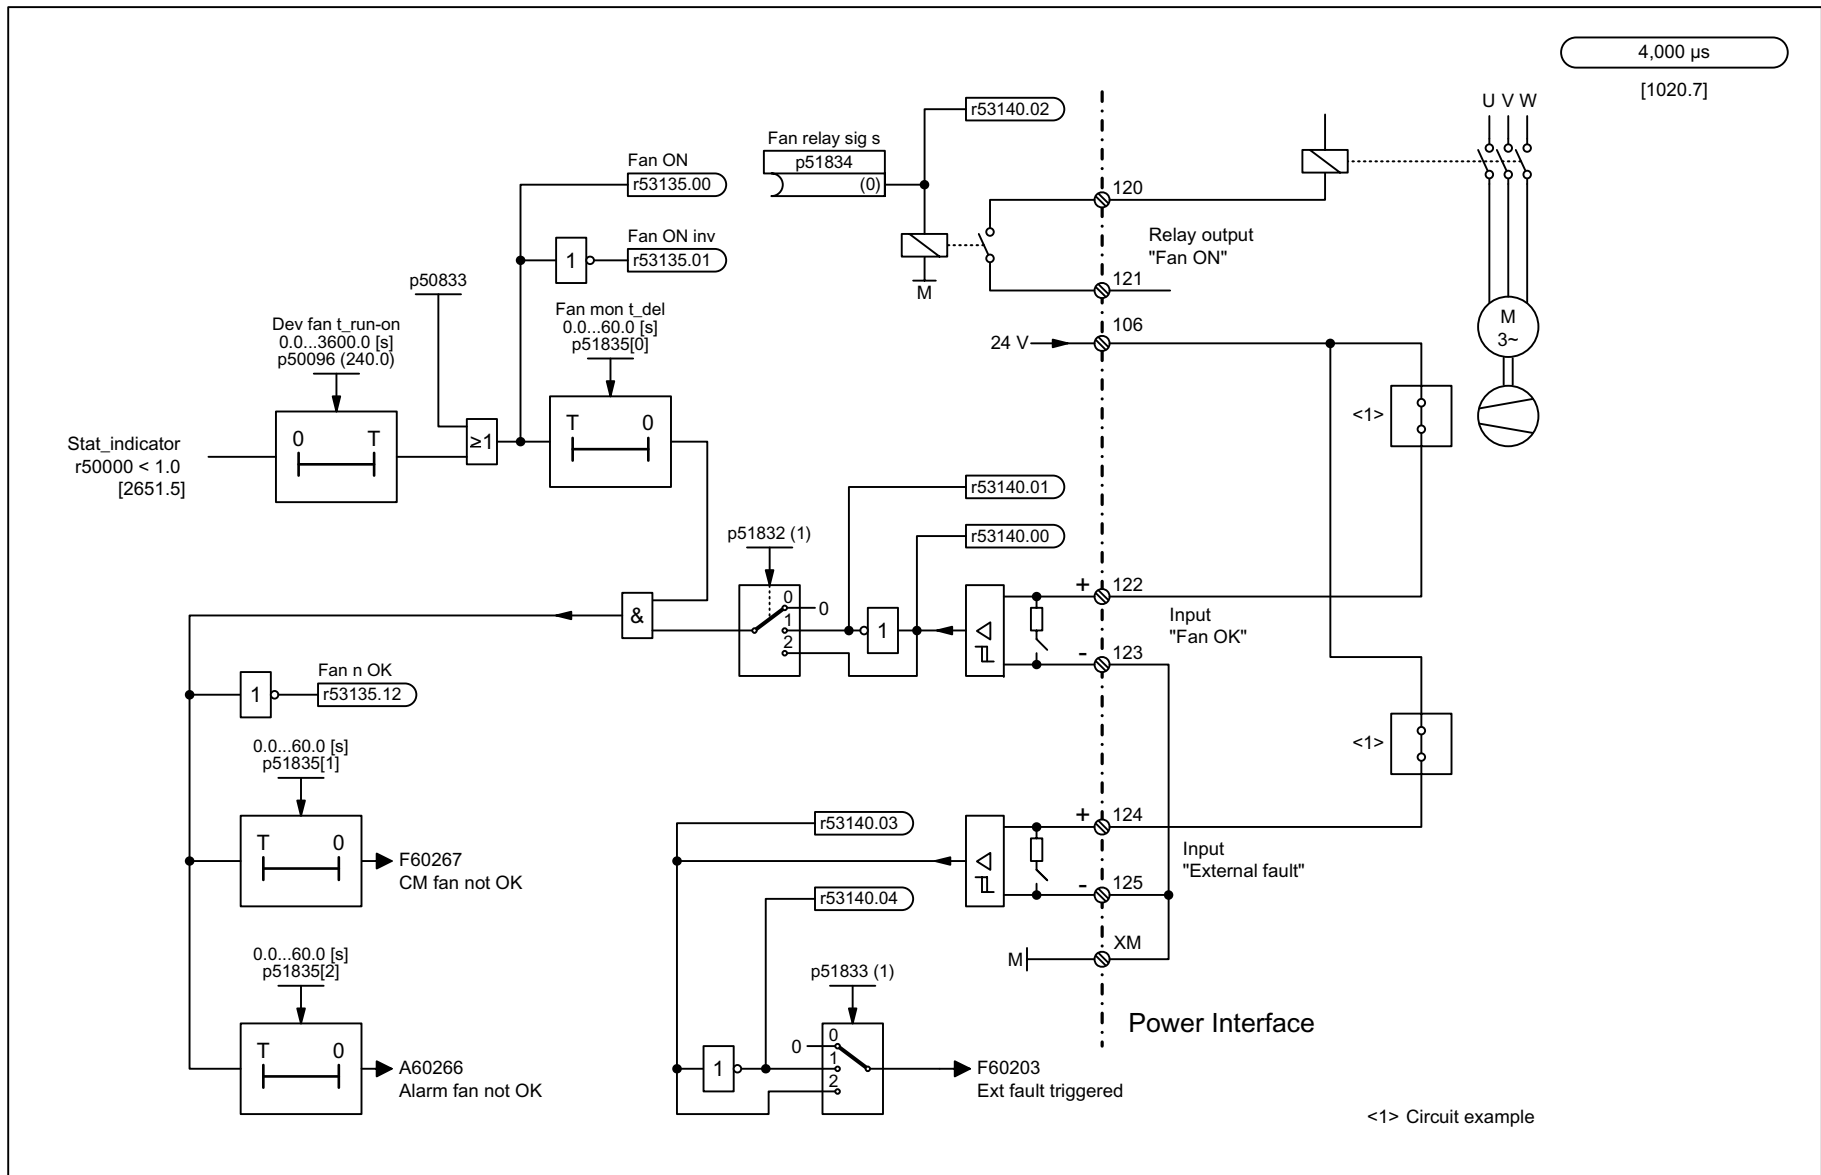

1	2	3	4	5	6	7	8
DO: DC_CTRL				<b>SIEMENS</b>	fp_8049_96_VSD	Function diagram	
Signals and monitoring functions - Device fan (Control Module)					2013-05-14 v 1.4	SINAMICS DCM	
							- 8049 -

Fig. 2-128 8049 – Device fan (Control Module)


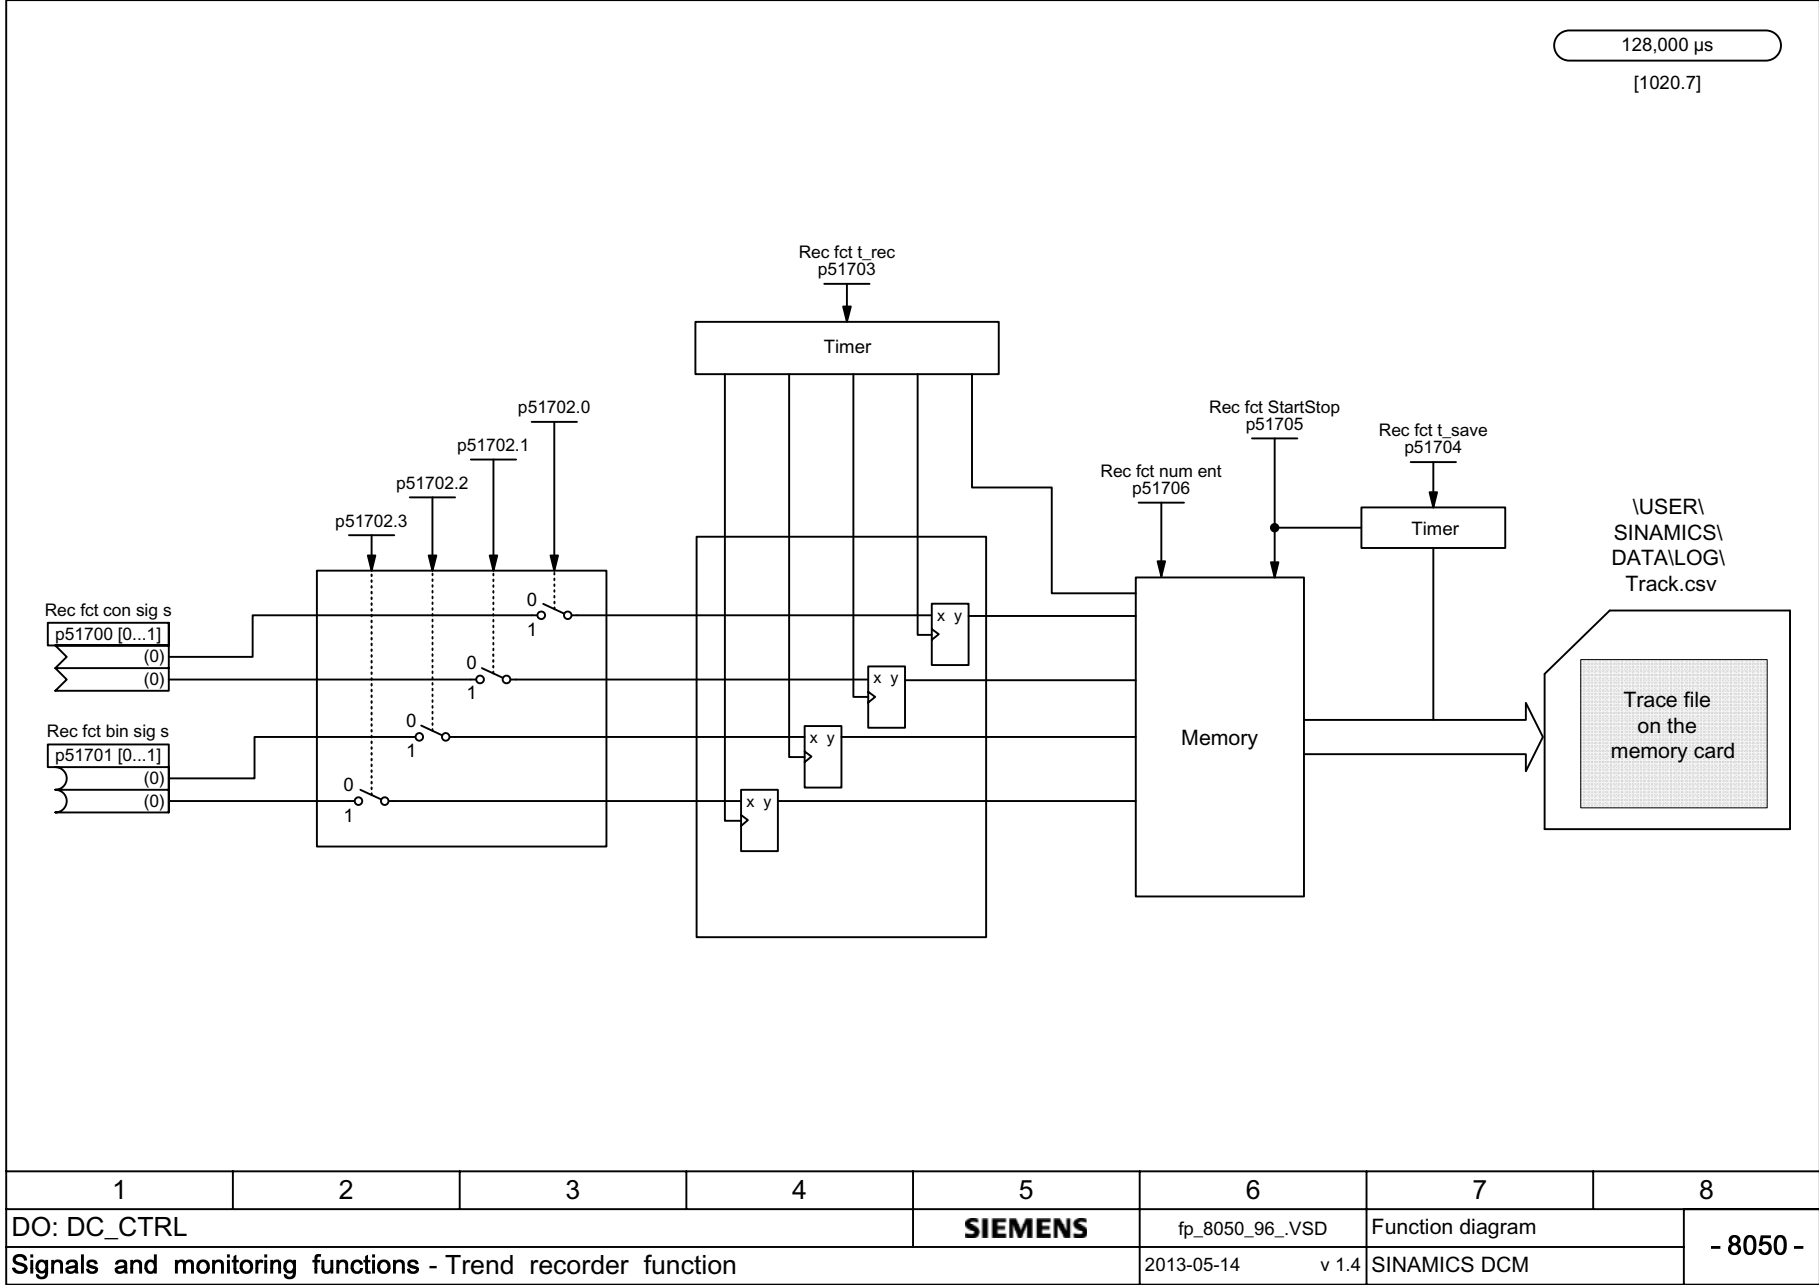


Fig. 2-129 8050 – Trend recorder function

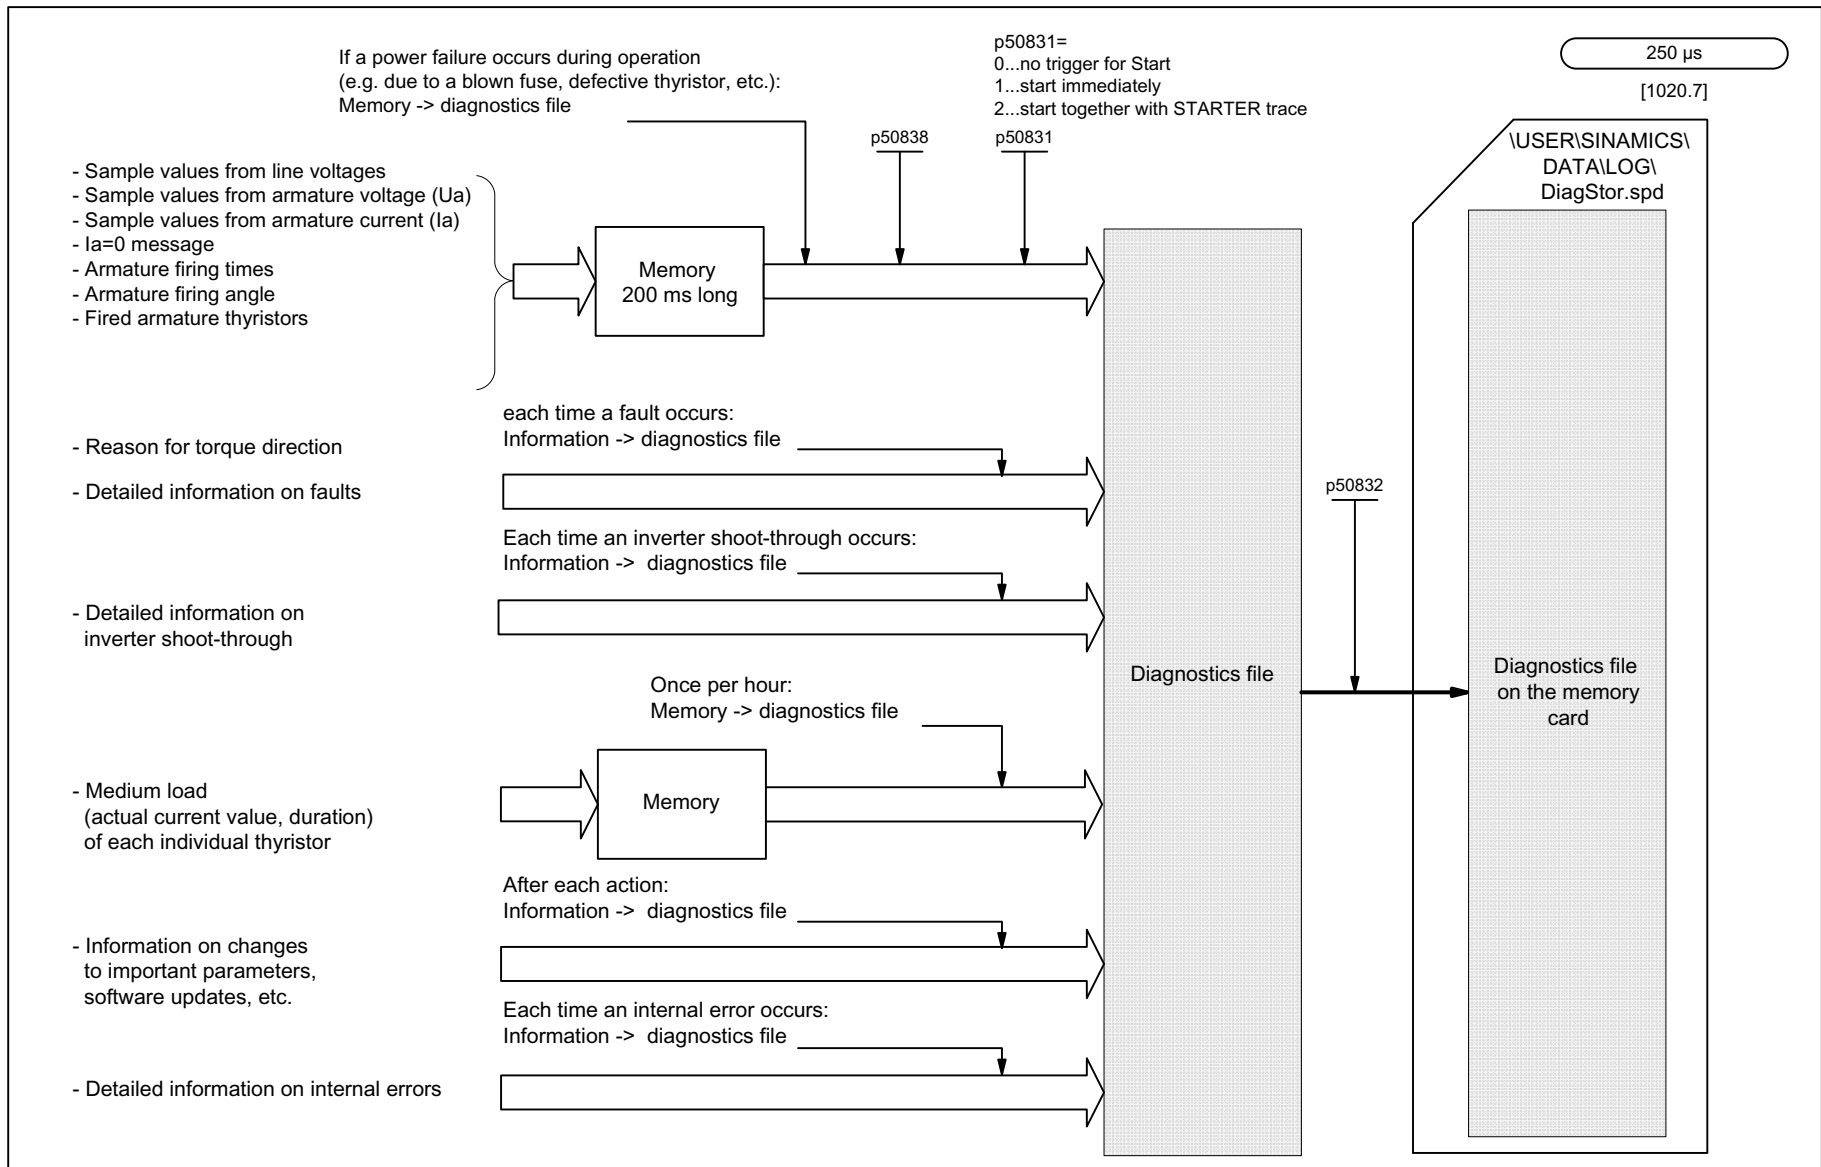



1	2	3	4	5	6	7	8
DO: DC_CTRL				<b>SIEMENS</b>	fp_8052_96_VSD	Function diagram	
Signals and monitoring functions - Diagnostic memory					2013-05-14 v 1.4	SINAMICS DCM	
							- 8052 -

Fig. 2-130 8052 – Diagnostic memory

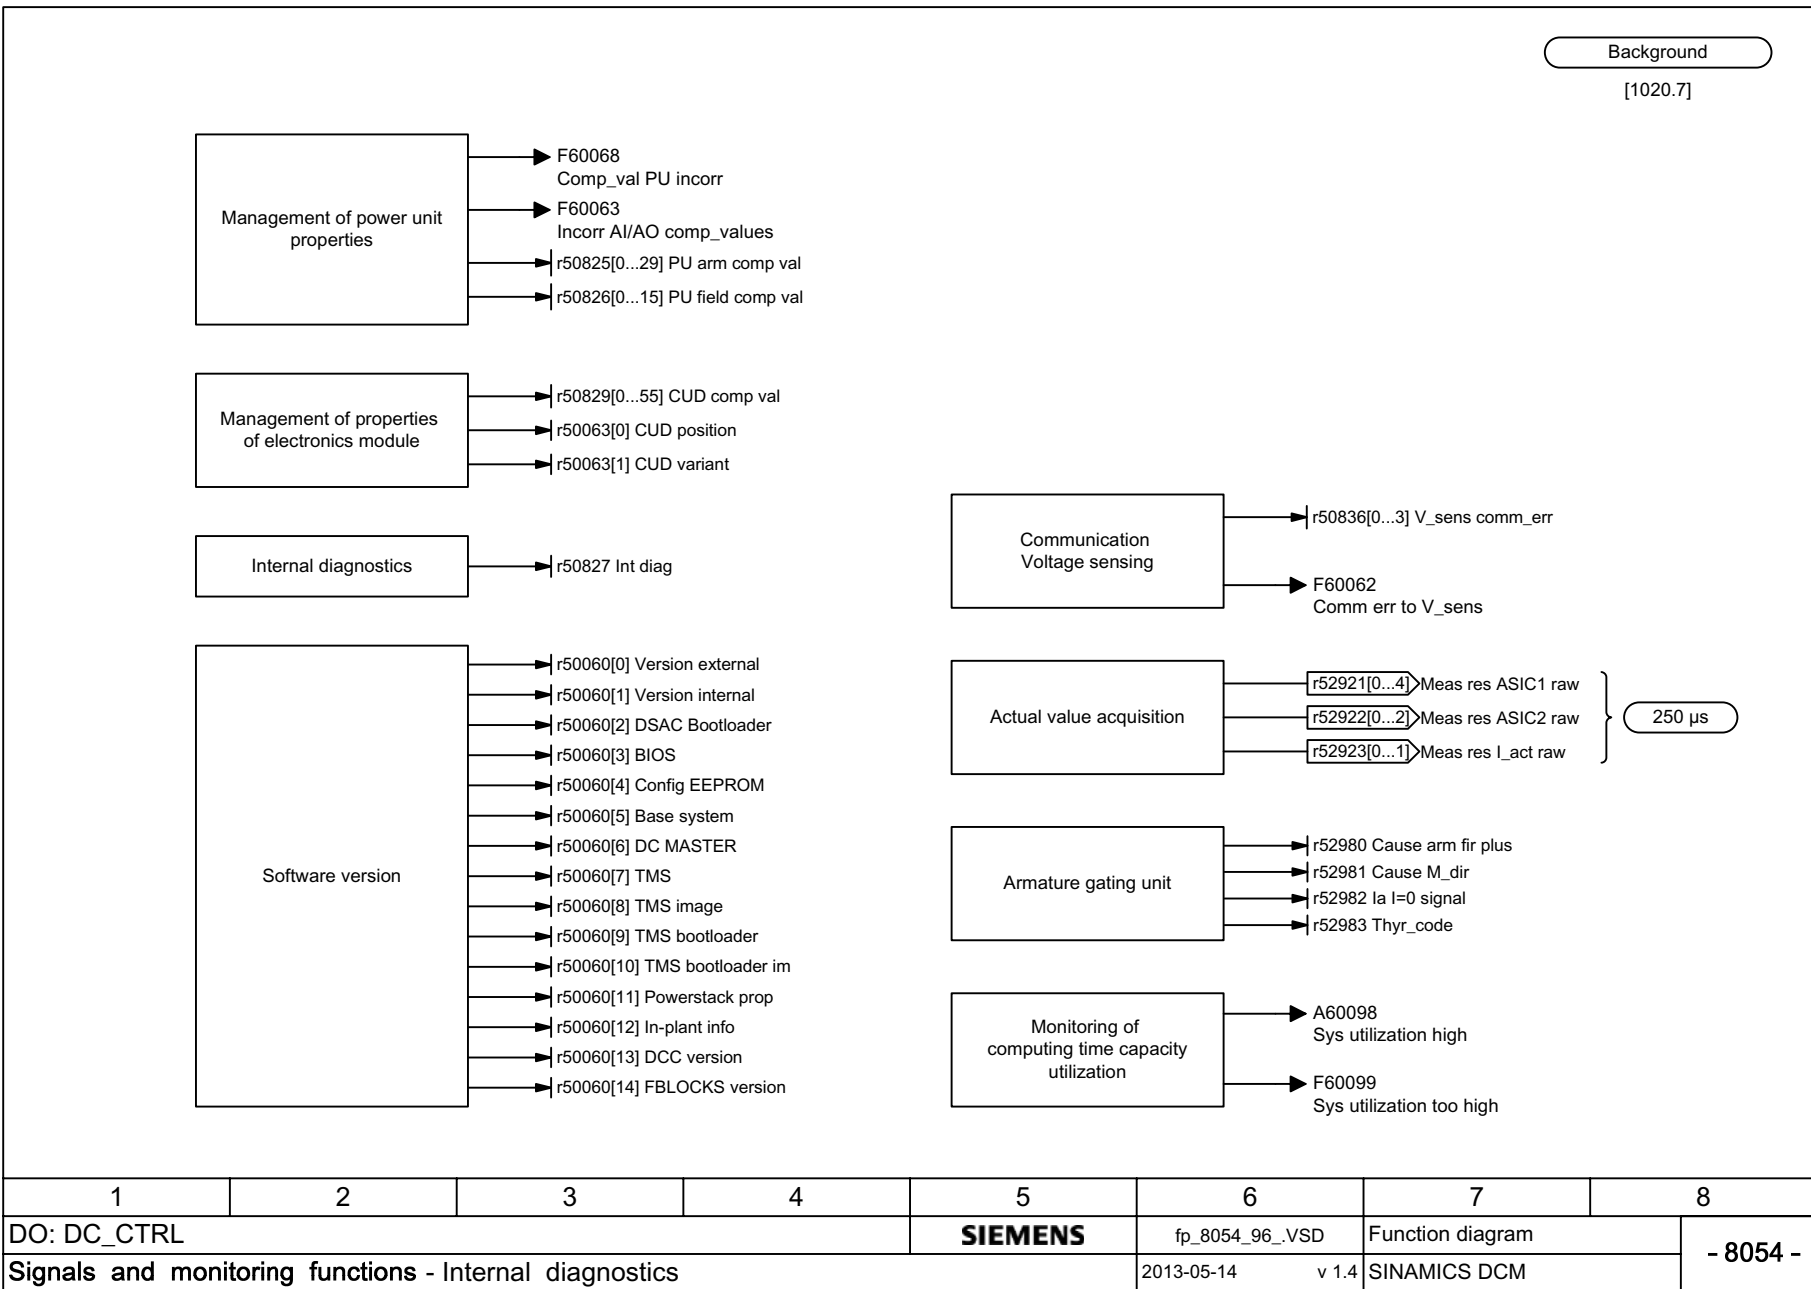


Fig. 2-131 8054 – Internal diagnostics


## 2.16        Faults and alarms


### Function diagrams

---

8060 – Fault buffer	2-812
8065 – Alarm buffer	2-813
8070 – Fault/alarm trigger word (r2129)	2-814
8075 – Fault/alarm configuration	2-815

---

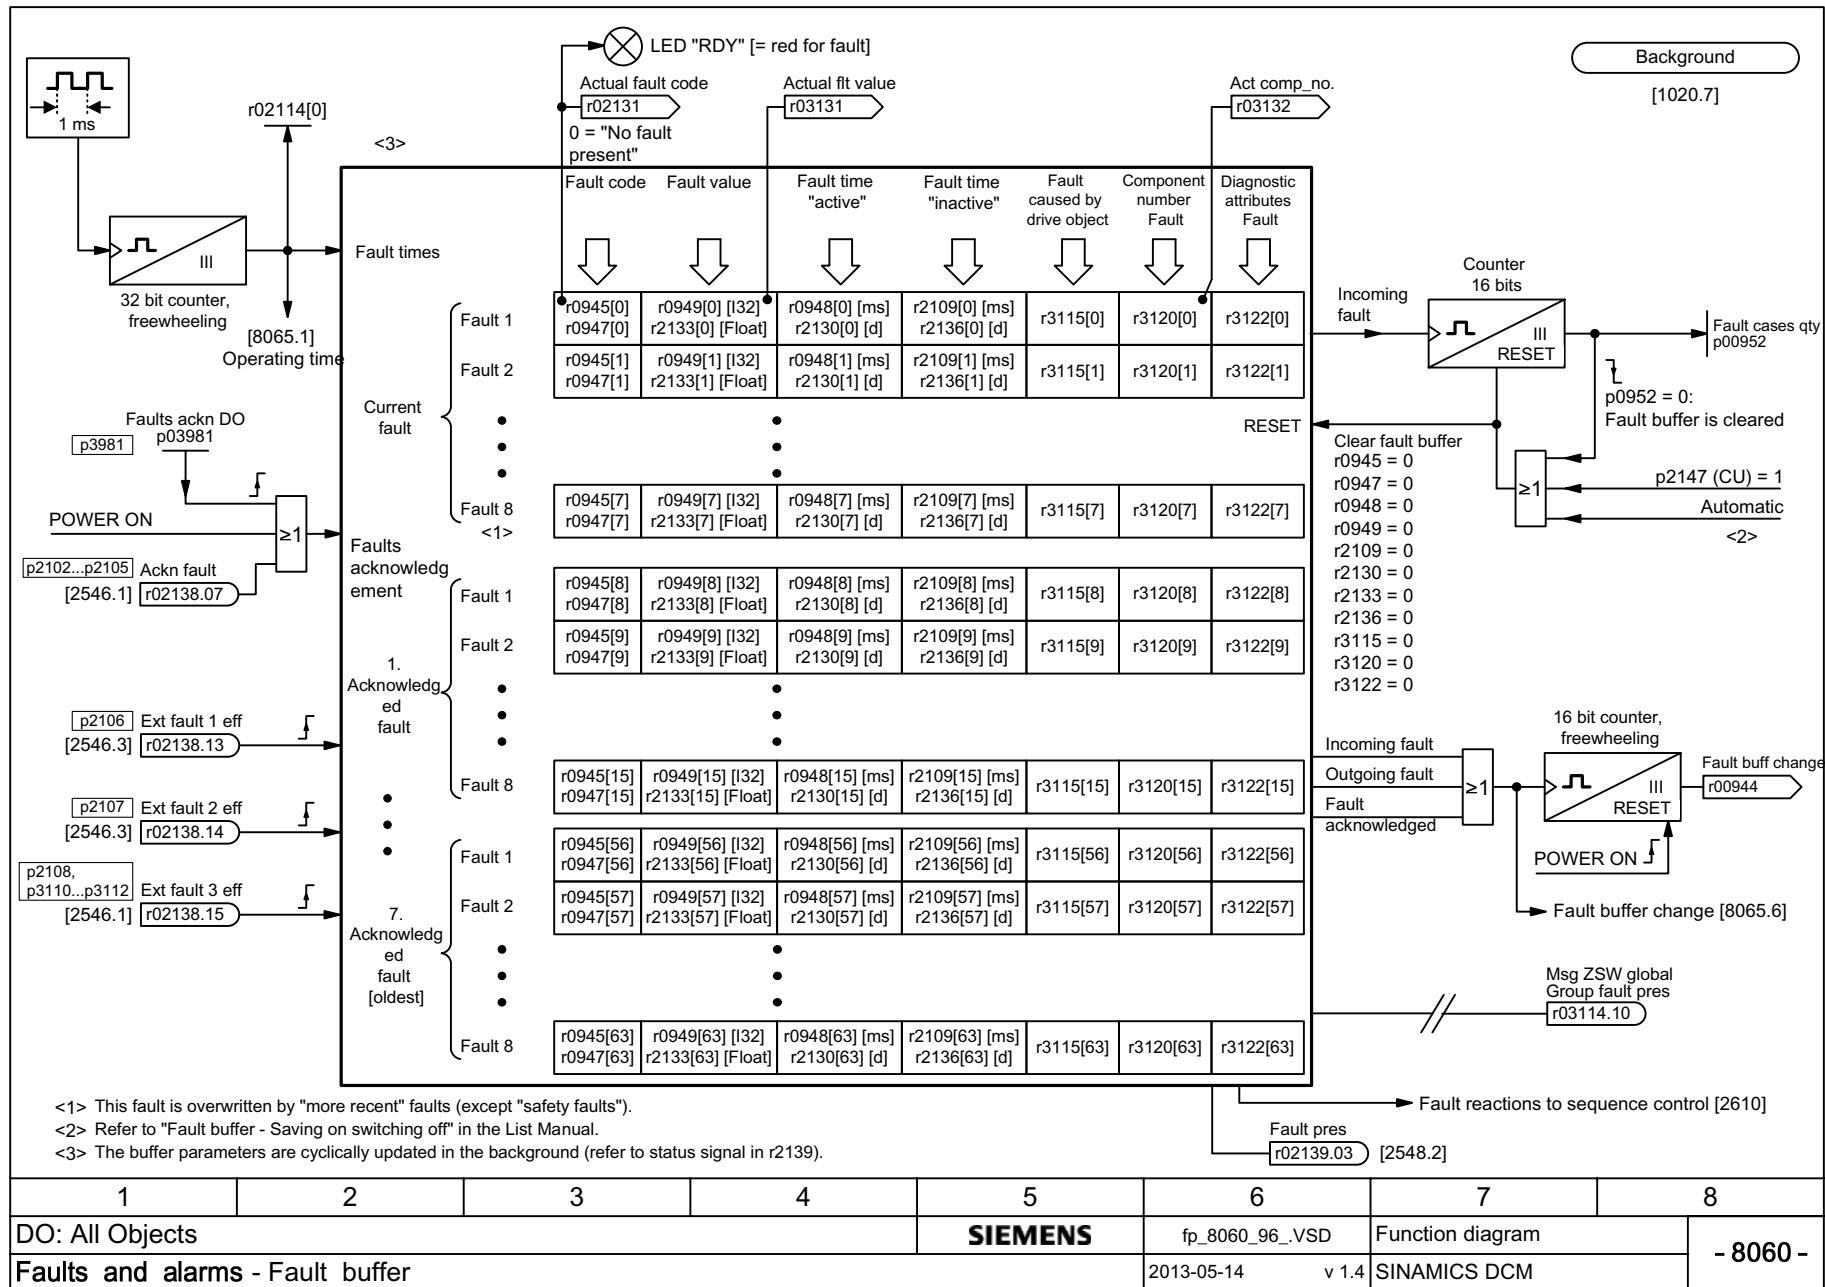

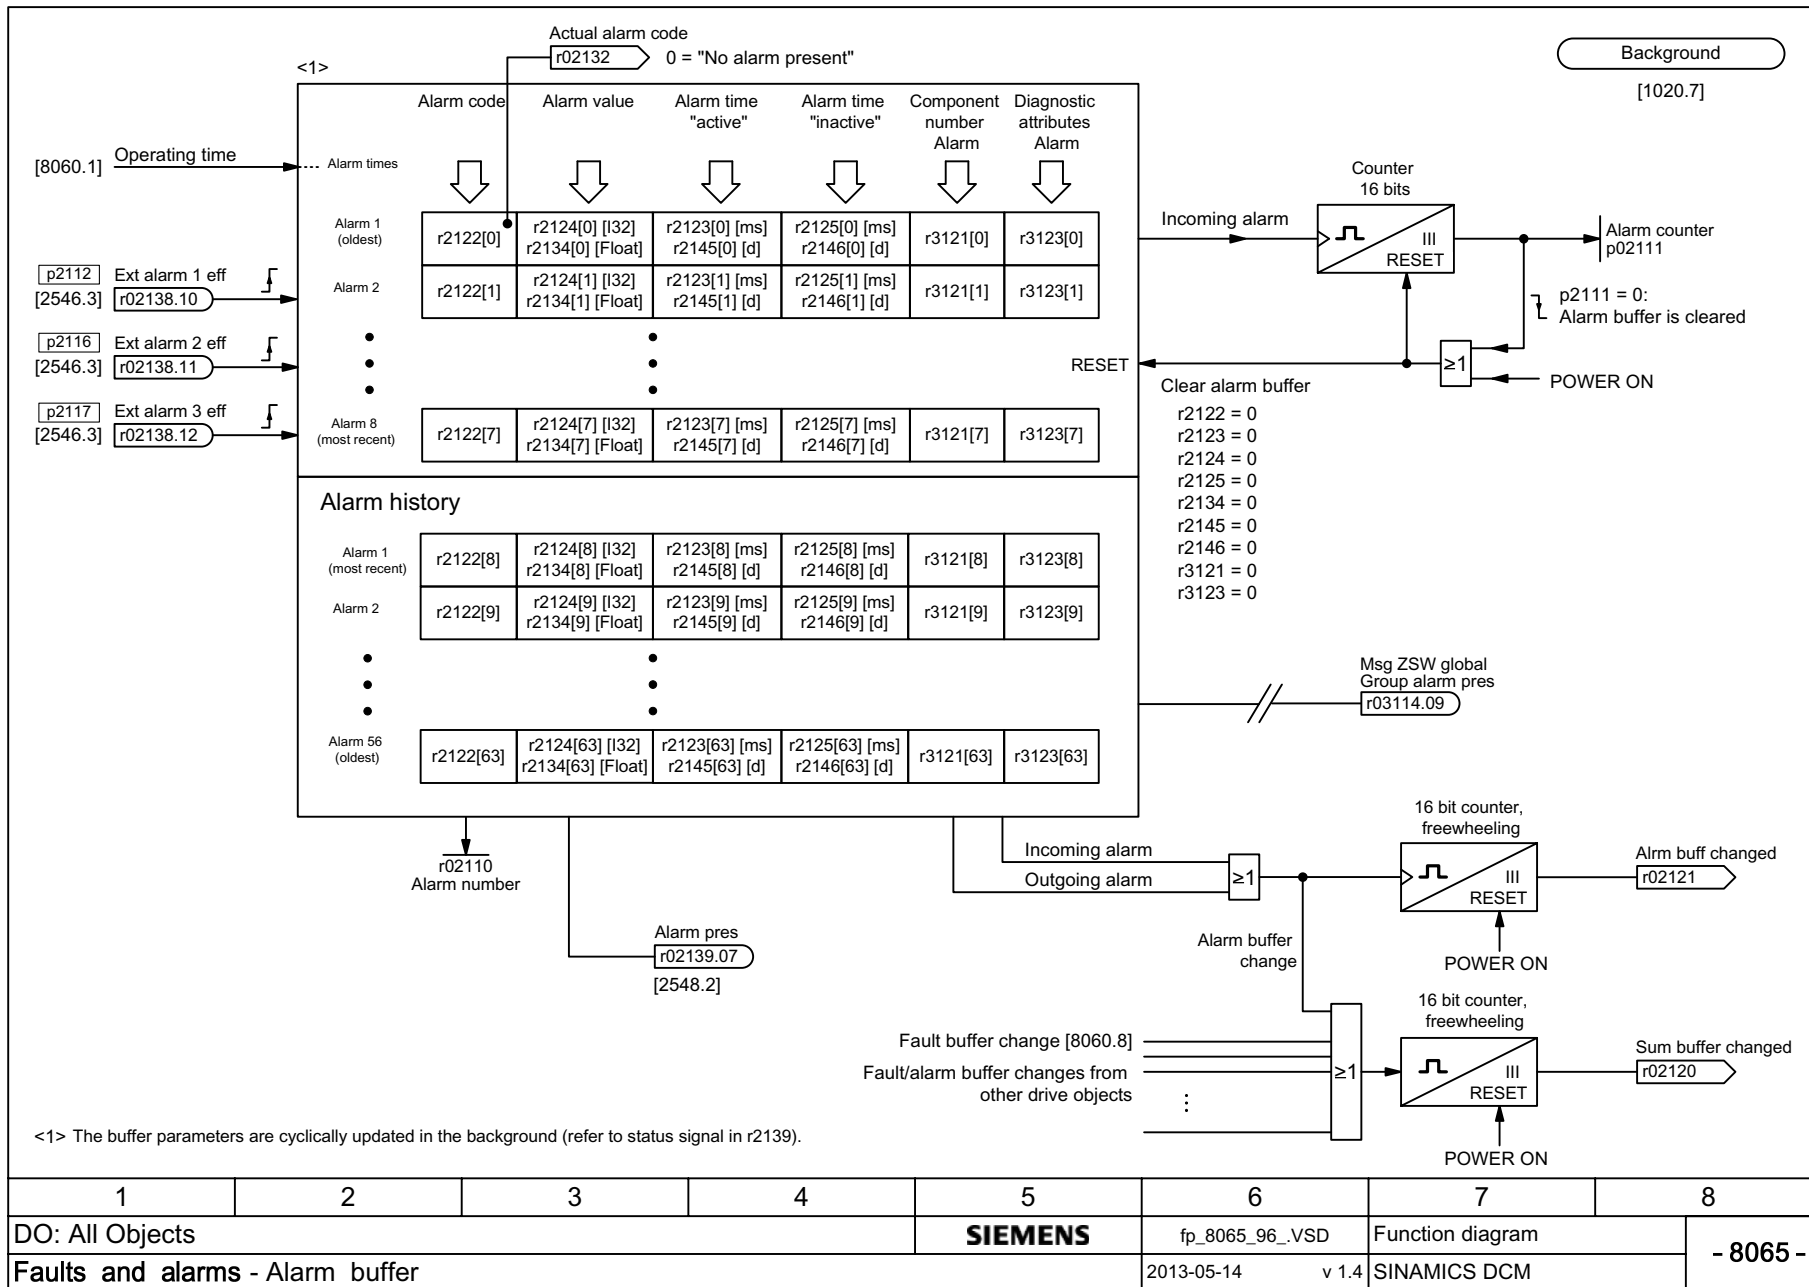


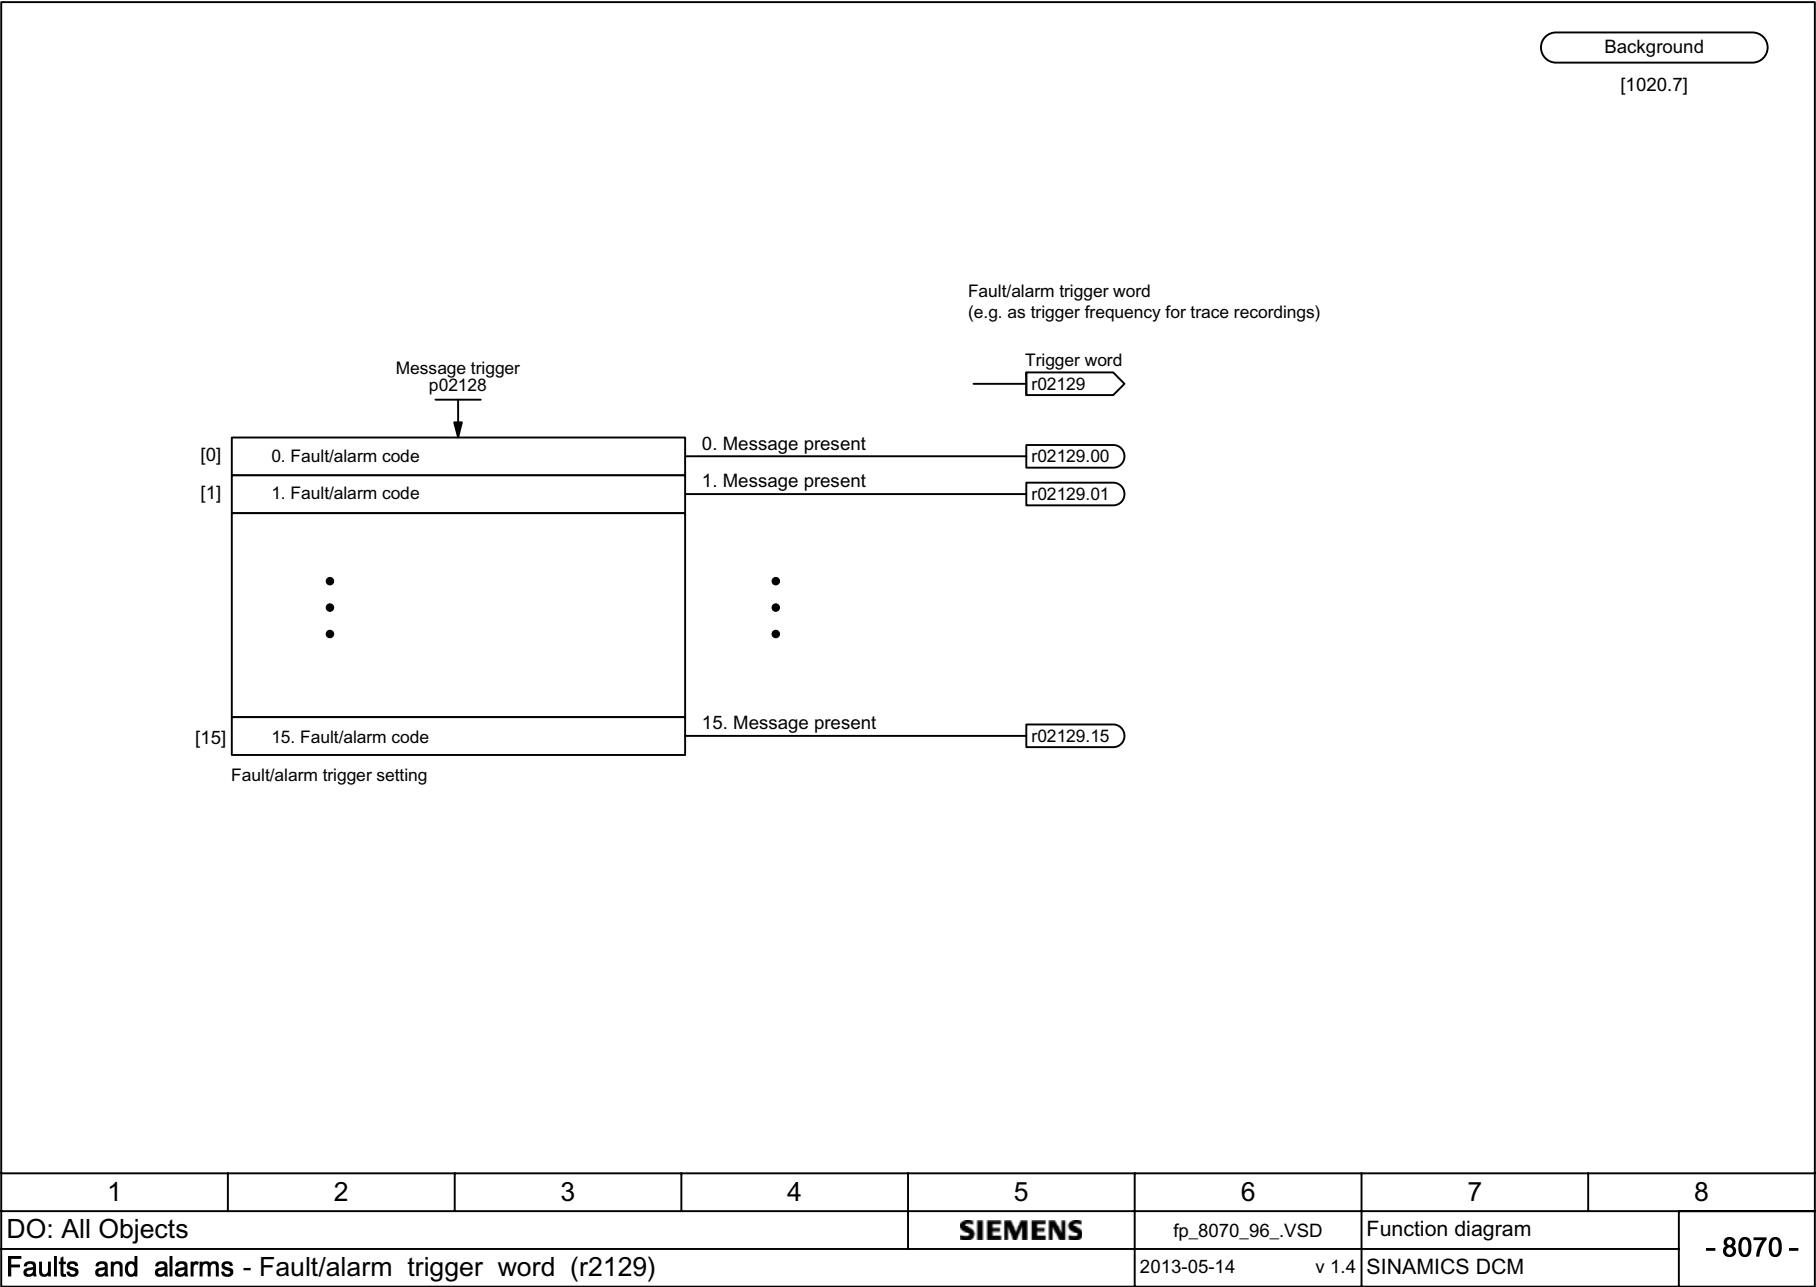


Fig. 2-134 8070 – Fault/alarm trigger word (r2129)

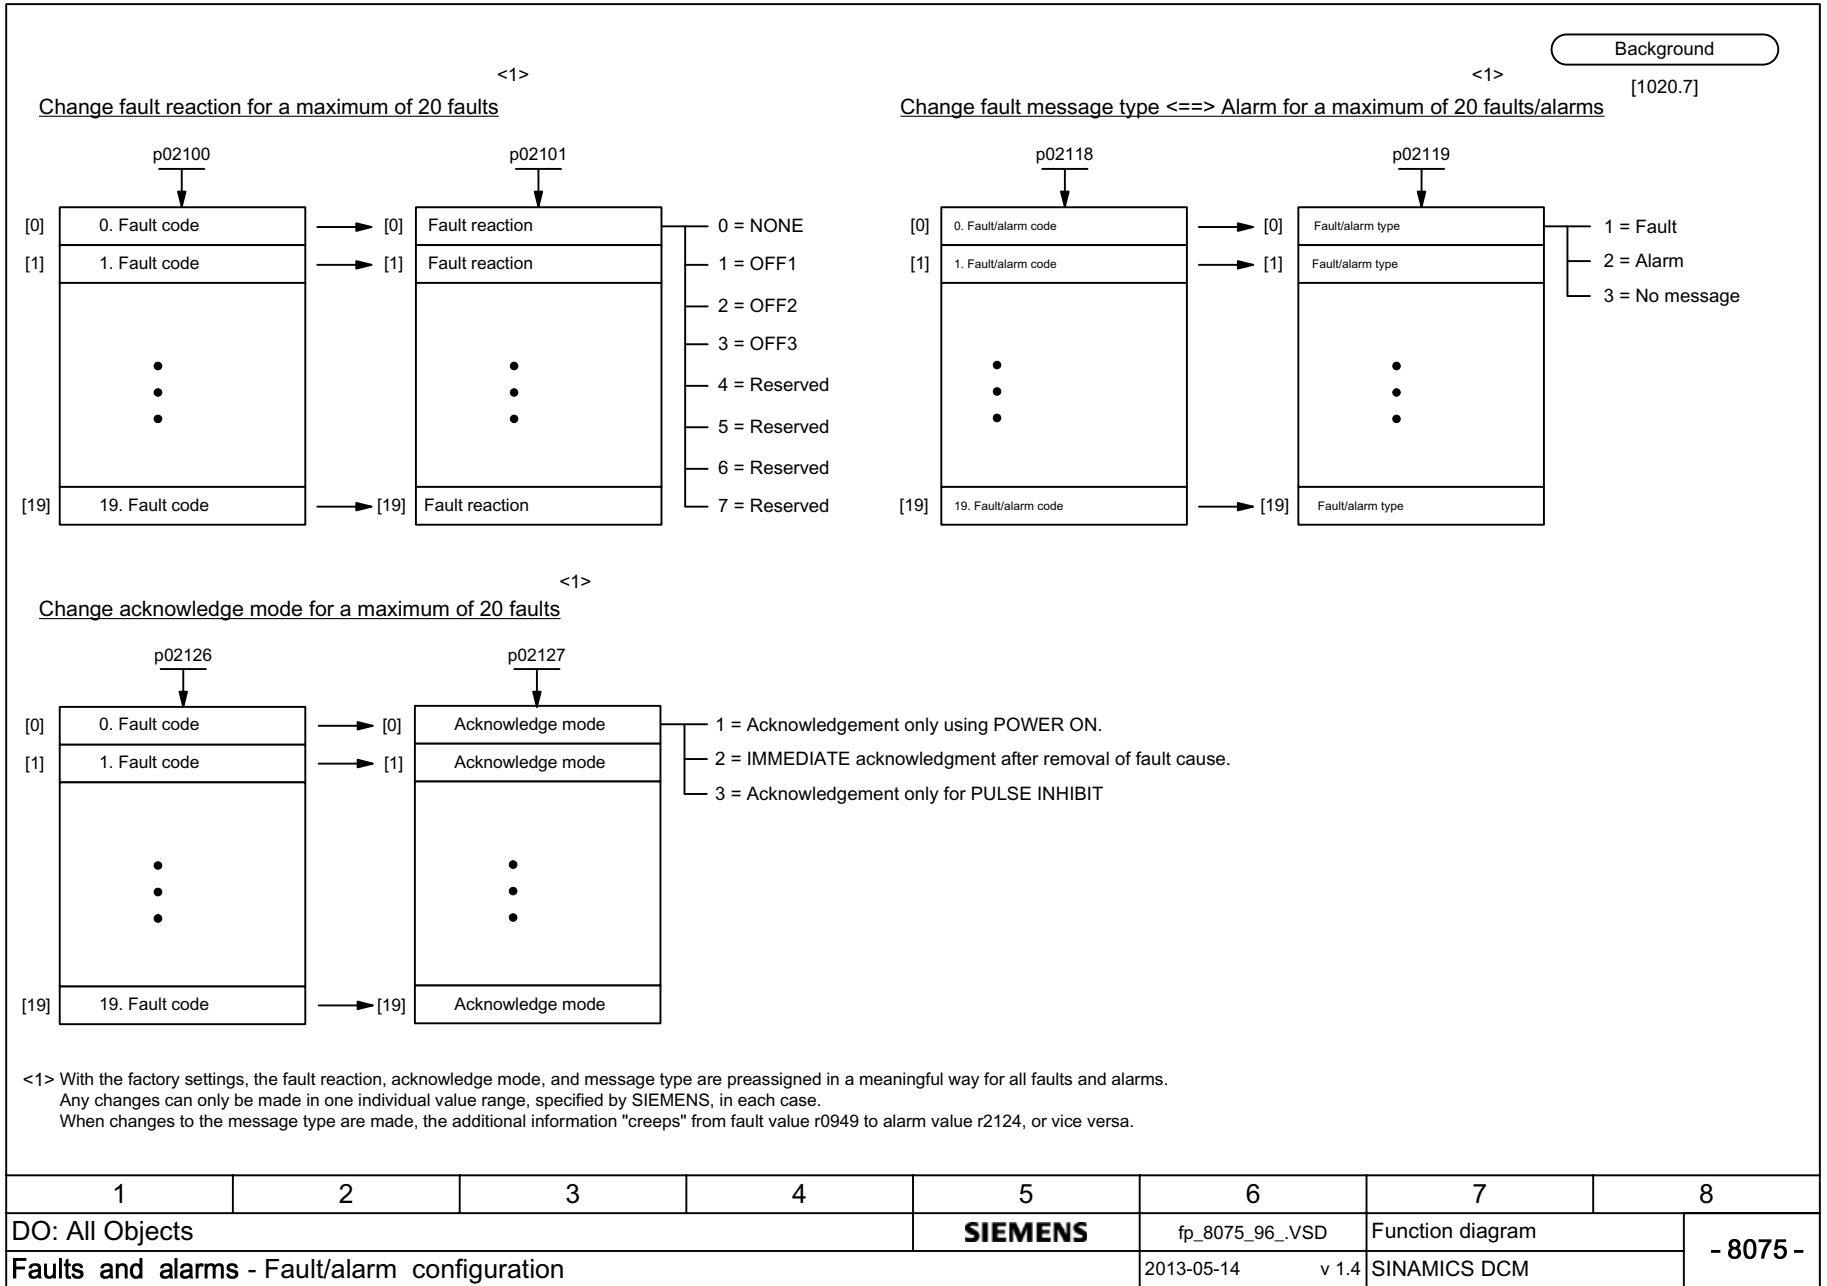

## 2.17 Data sets

### Function diagrams

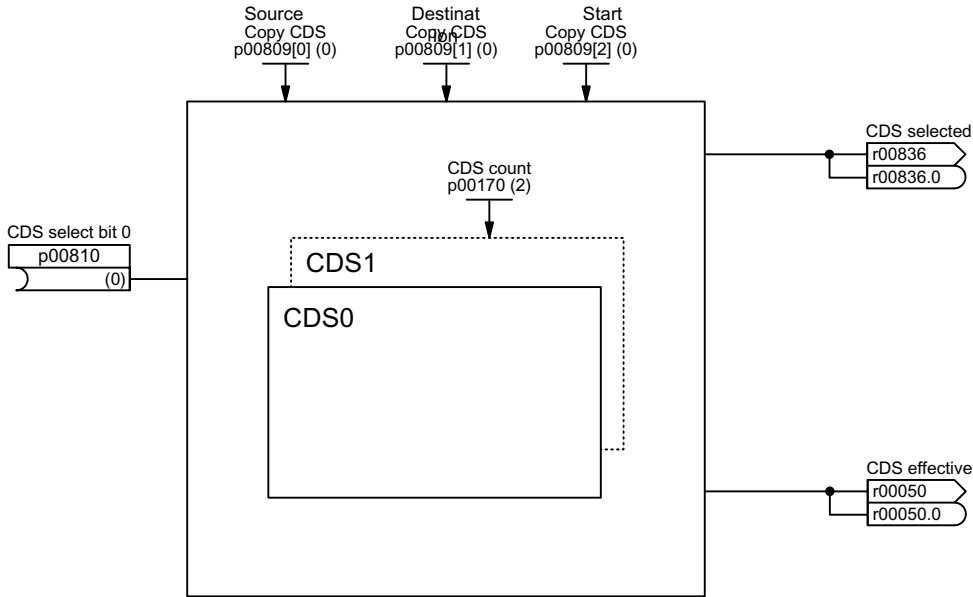
---

8560 – Command Data Sets (CDS)	2-817
8565 – Drive Data Sets (DDS)	2-818
8570 – Encoder Data Sets (EDS)	2-819


---



Not relevant  
[1020.7]



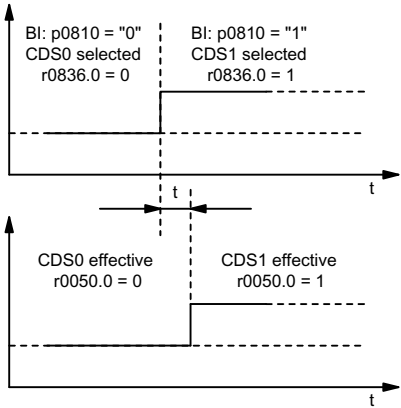Example:  
Switching Command Data Sets  
CDS0 --> CDS1



1	2	3	4	5	6	7	8
DO: DC_CTRL				SIEMENS	fp_8560_96_VSD	Function diagram	
Data sets - Command Data Sets (CDS)					2013-05-14 v 1.4	SINAMICS DCM	
							- 8560 -

Fig. 2-136 8560 – Command Data Sets (CDS)


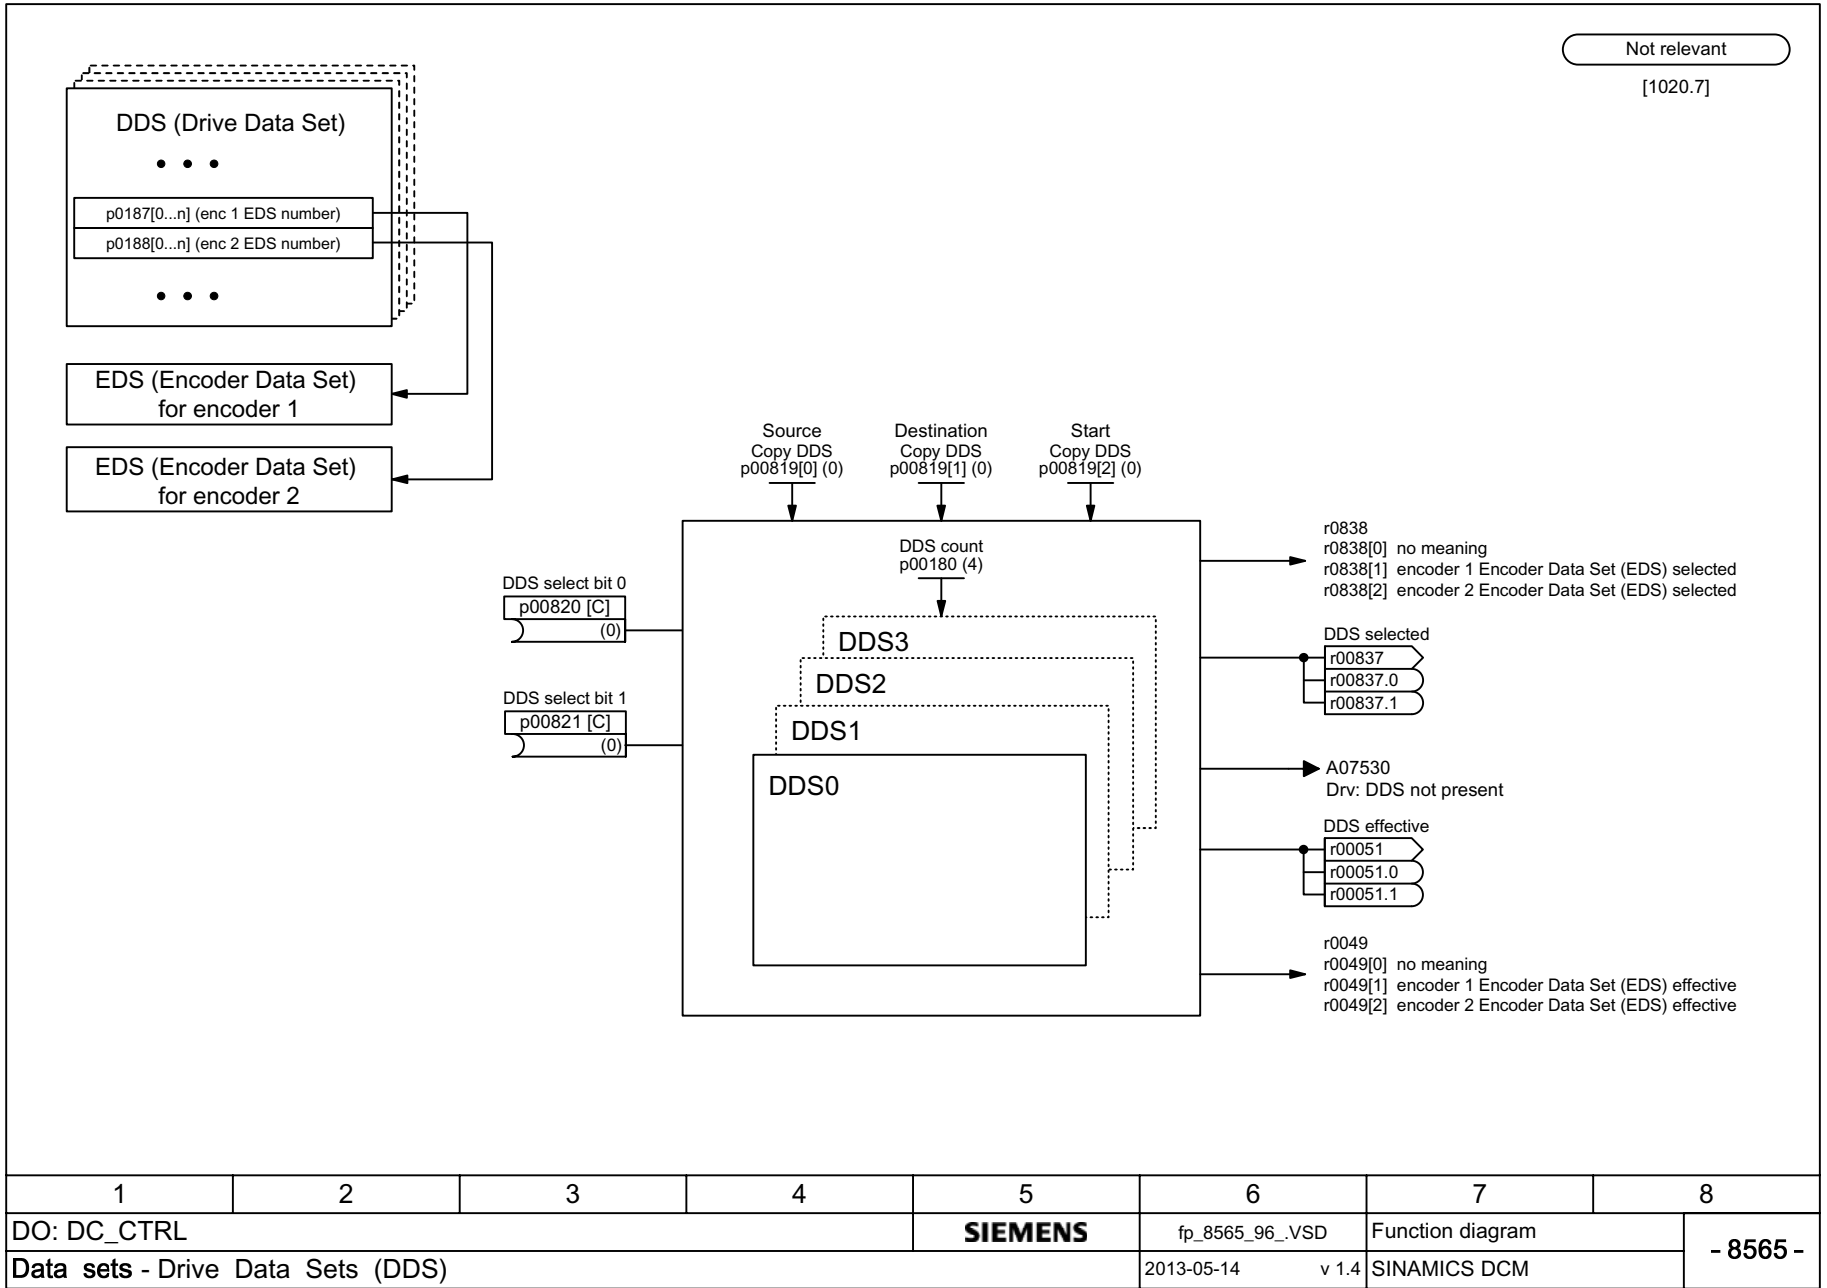


Fig. 2-137 8565 – Drive Data Sets (DDS)

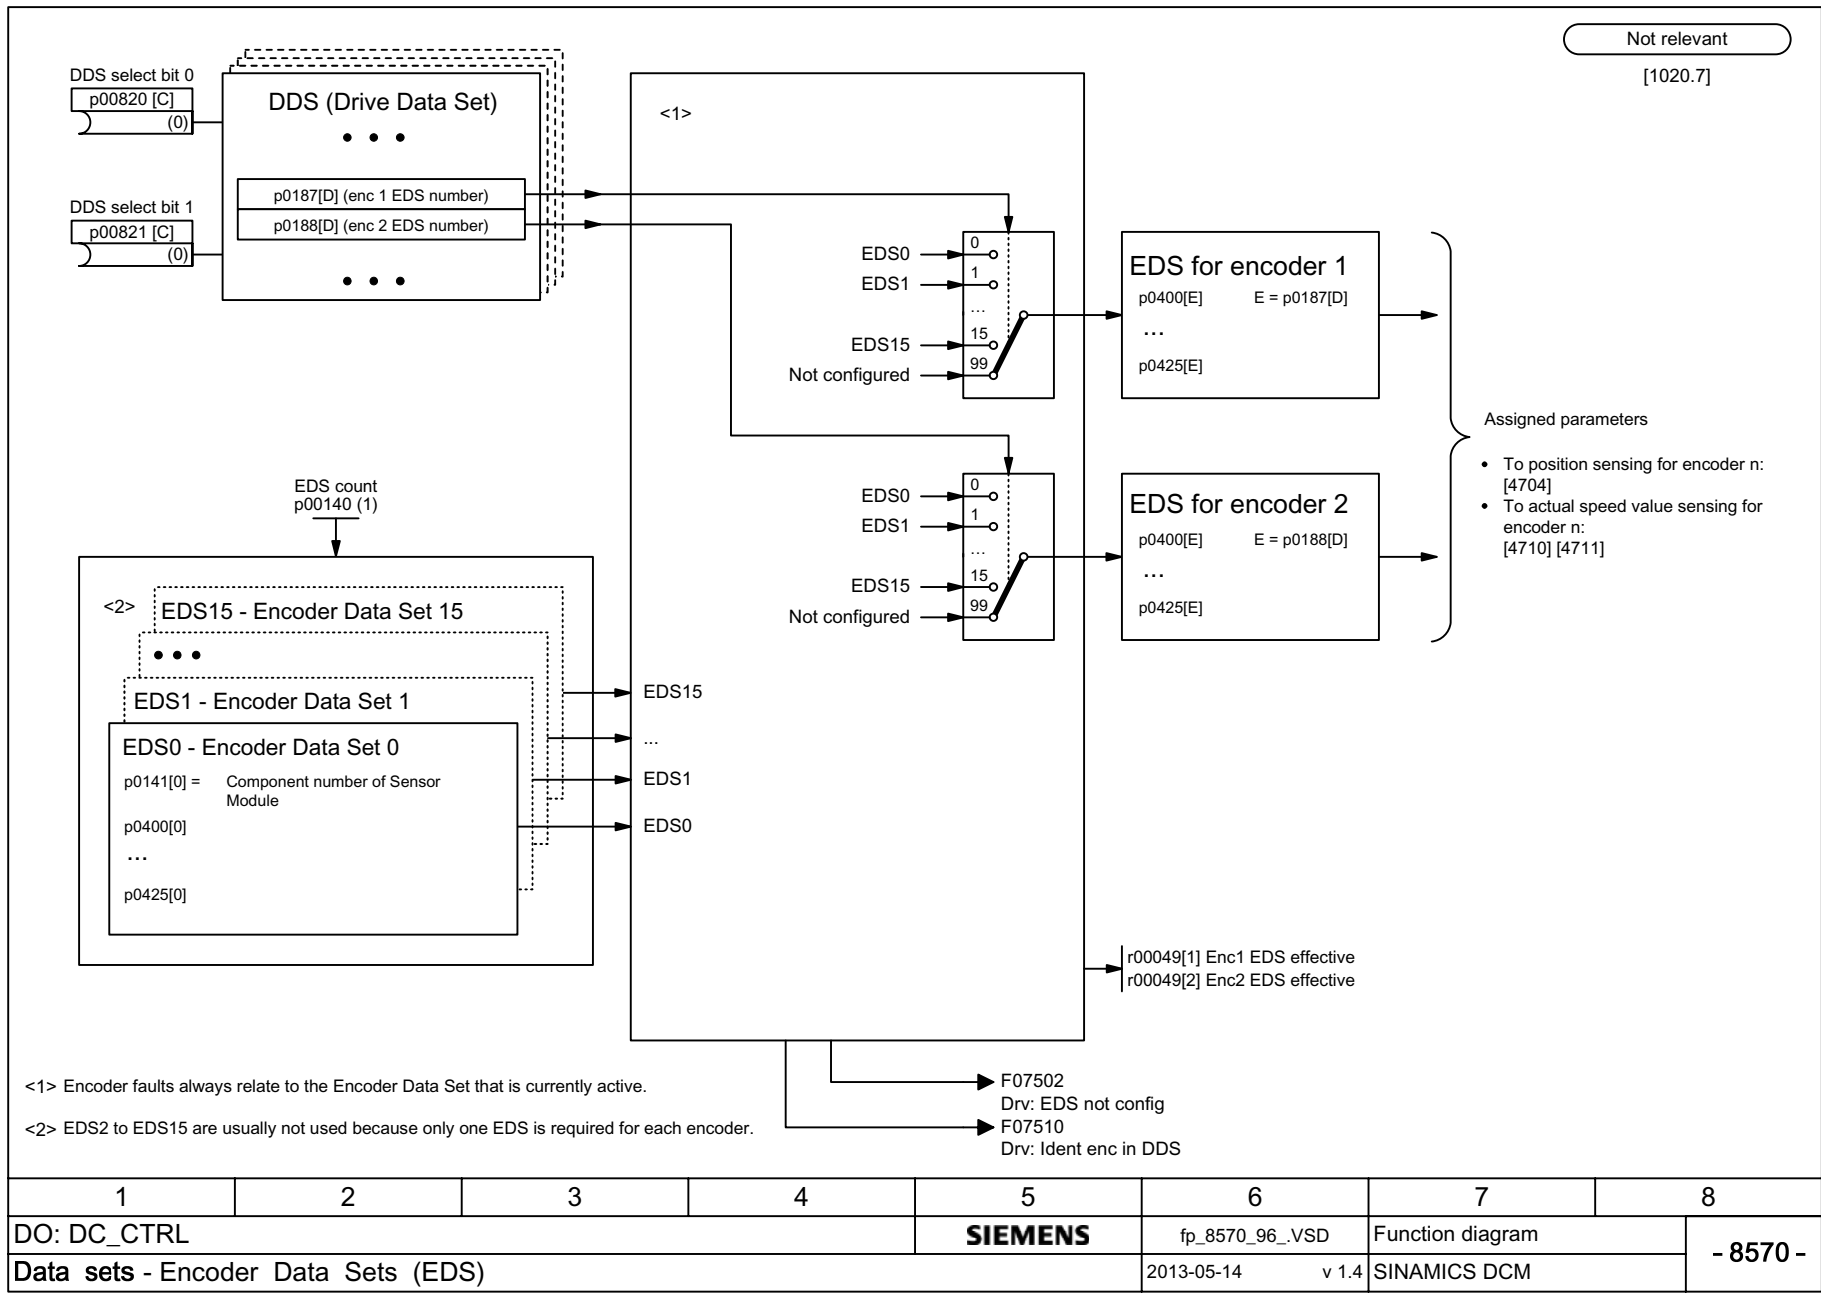


1	2	3	4	5	6	7	8
DO: DC_CTRL				SIEMENS	fp_8570_96_VSD	Function diagram	
Data sets - Encoder Data Sets (EDS)					2013-05-14 v 1.4	SINAMICS DCM	
							- 8570 -


## **2.18            Communication between devices**

### **Function diagrams**

9300 – Peer-to-peer interface	2-821
9350 – Paralleling interface (Part 1)	2-822
9352 – Paralleling interface (Part 2)	2-823
9355 – Paralleling interface (Part 3)	2-824
9360 – Switchover of the power unit topology	2-825

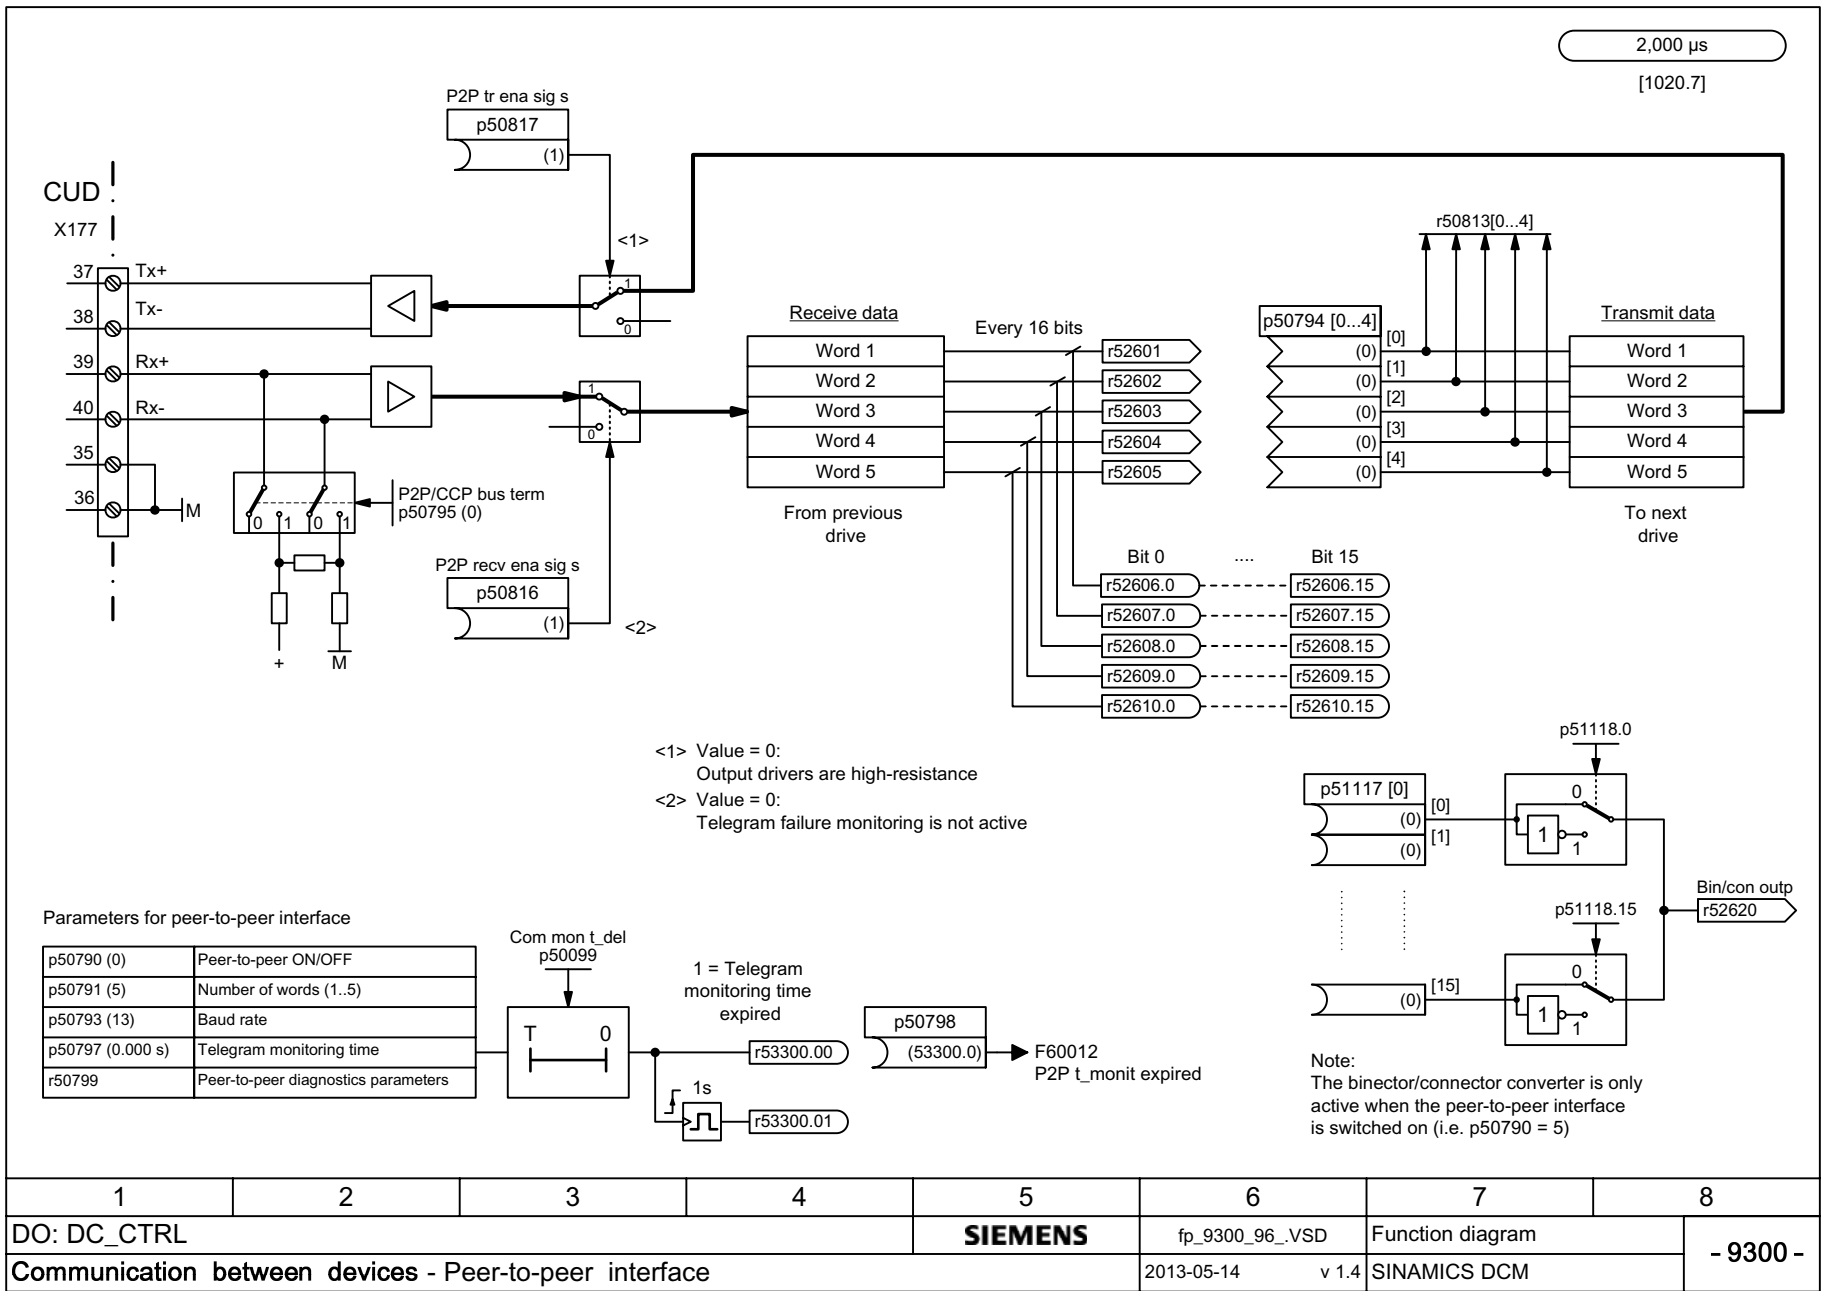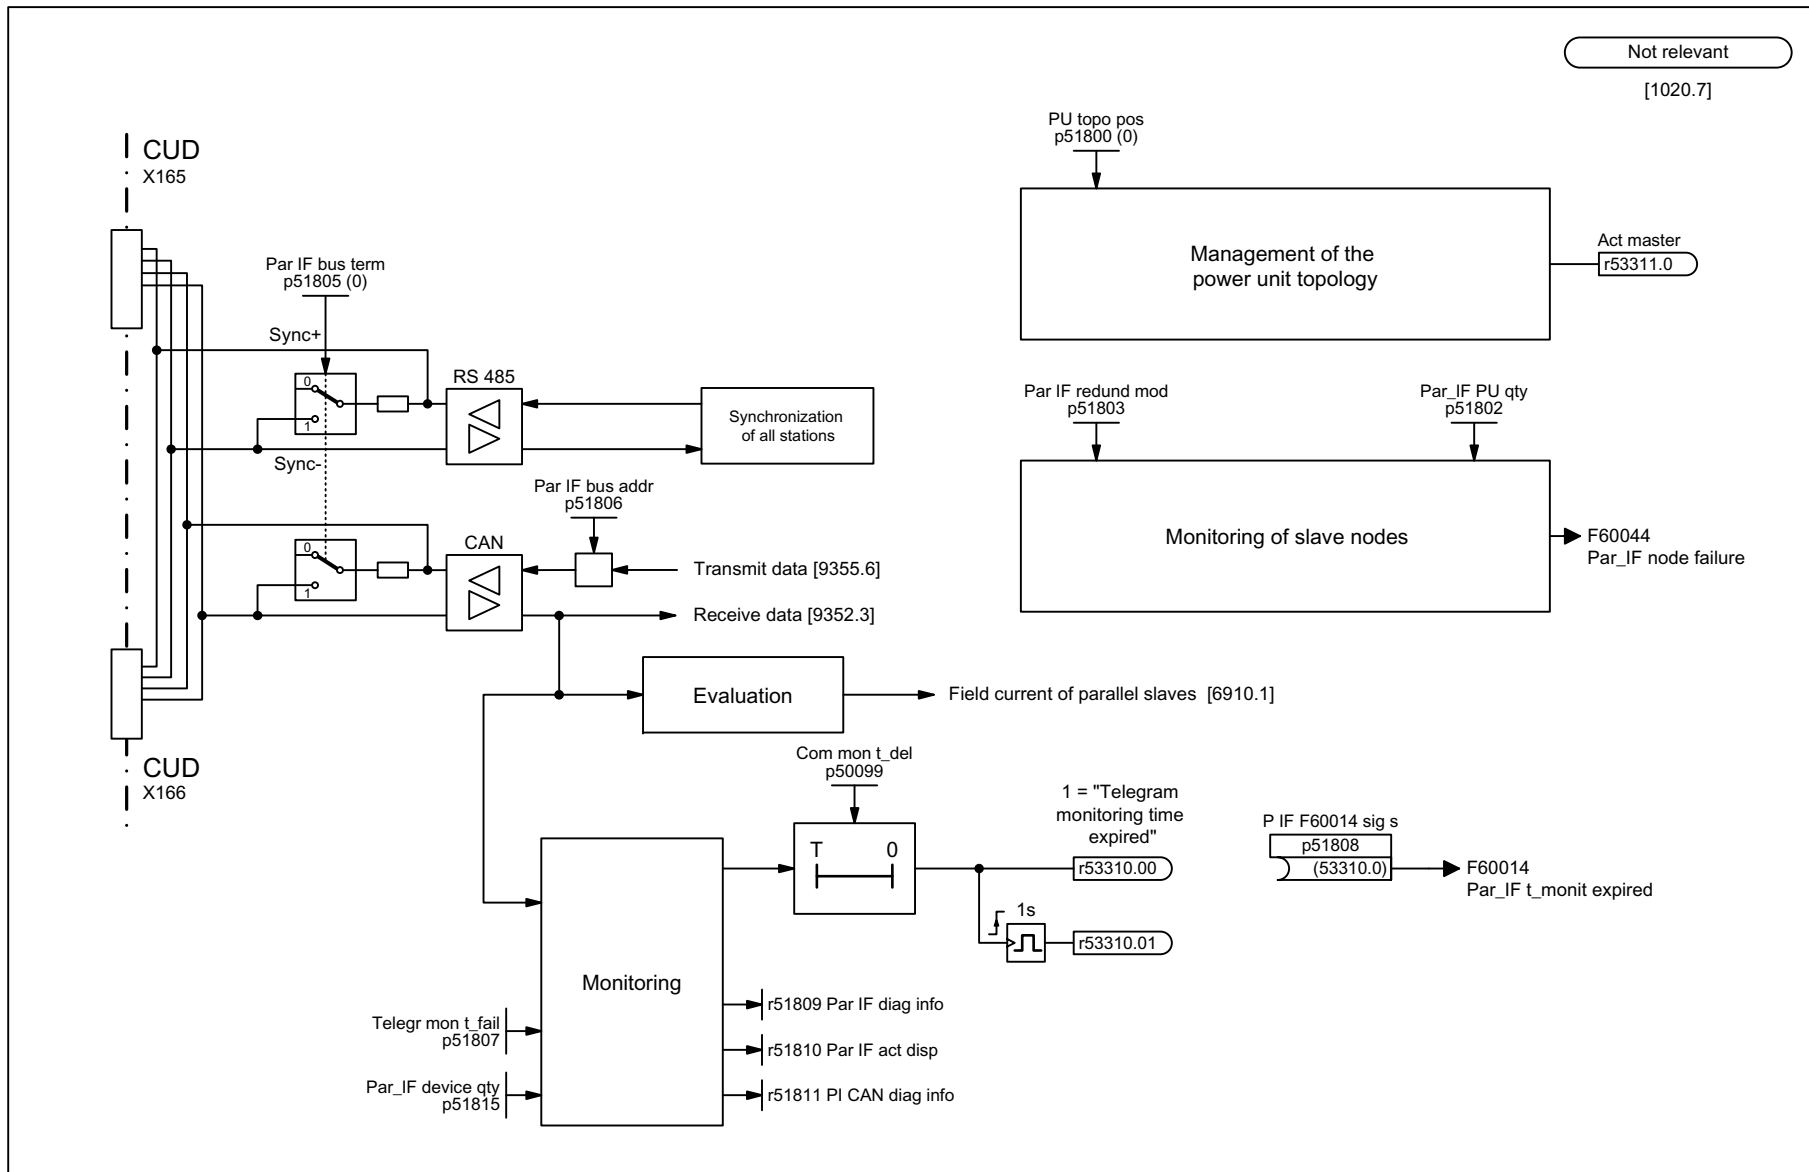Fig. 2-139 9300 – Peer-to-peer interface





1	2	3	4	5	6	7	8
DO: DC_CTRL				<b>SIEMENS</b>	fp_9350_96_VSD	Function diagram	
Communication between devices - Parallel connection interface (part 1)					2013-05-14 v 1.4	SINAMICS DCM	
							- 9350 -

Fig. 2-140 9350 – Paralleling interface (Part 1)



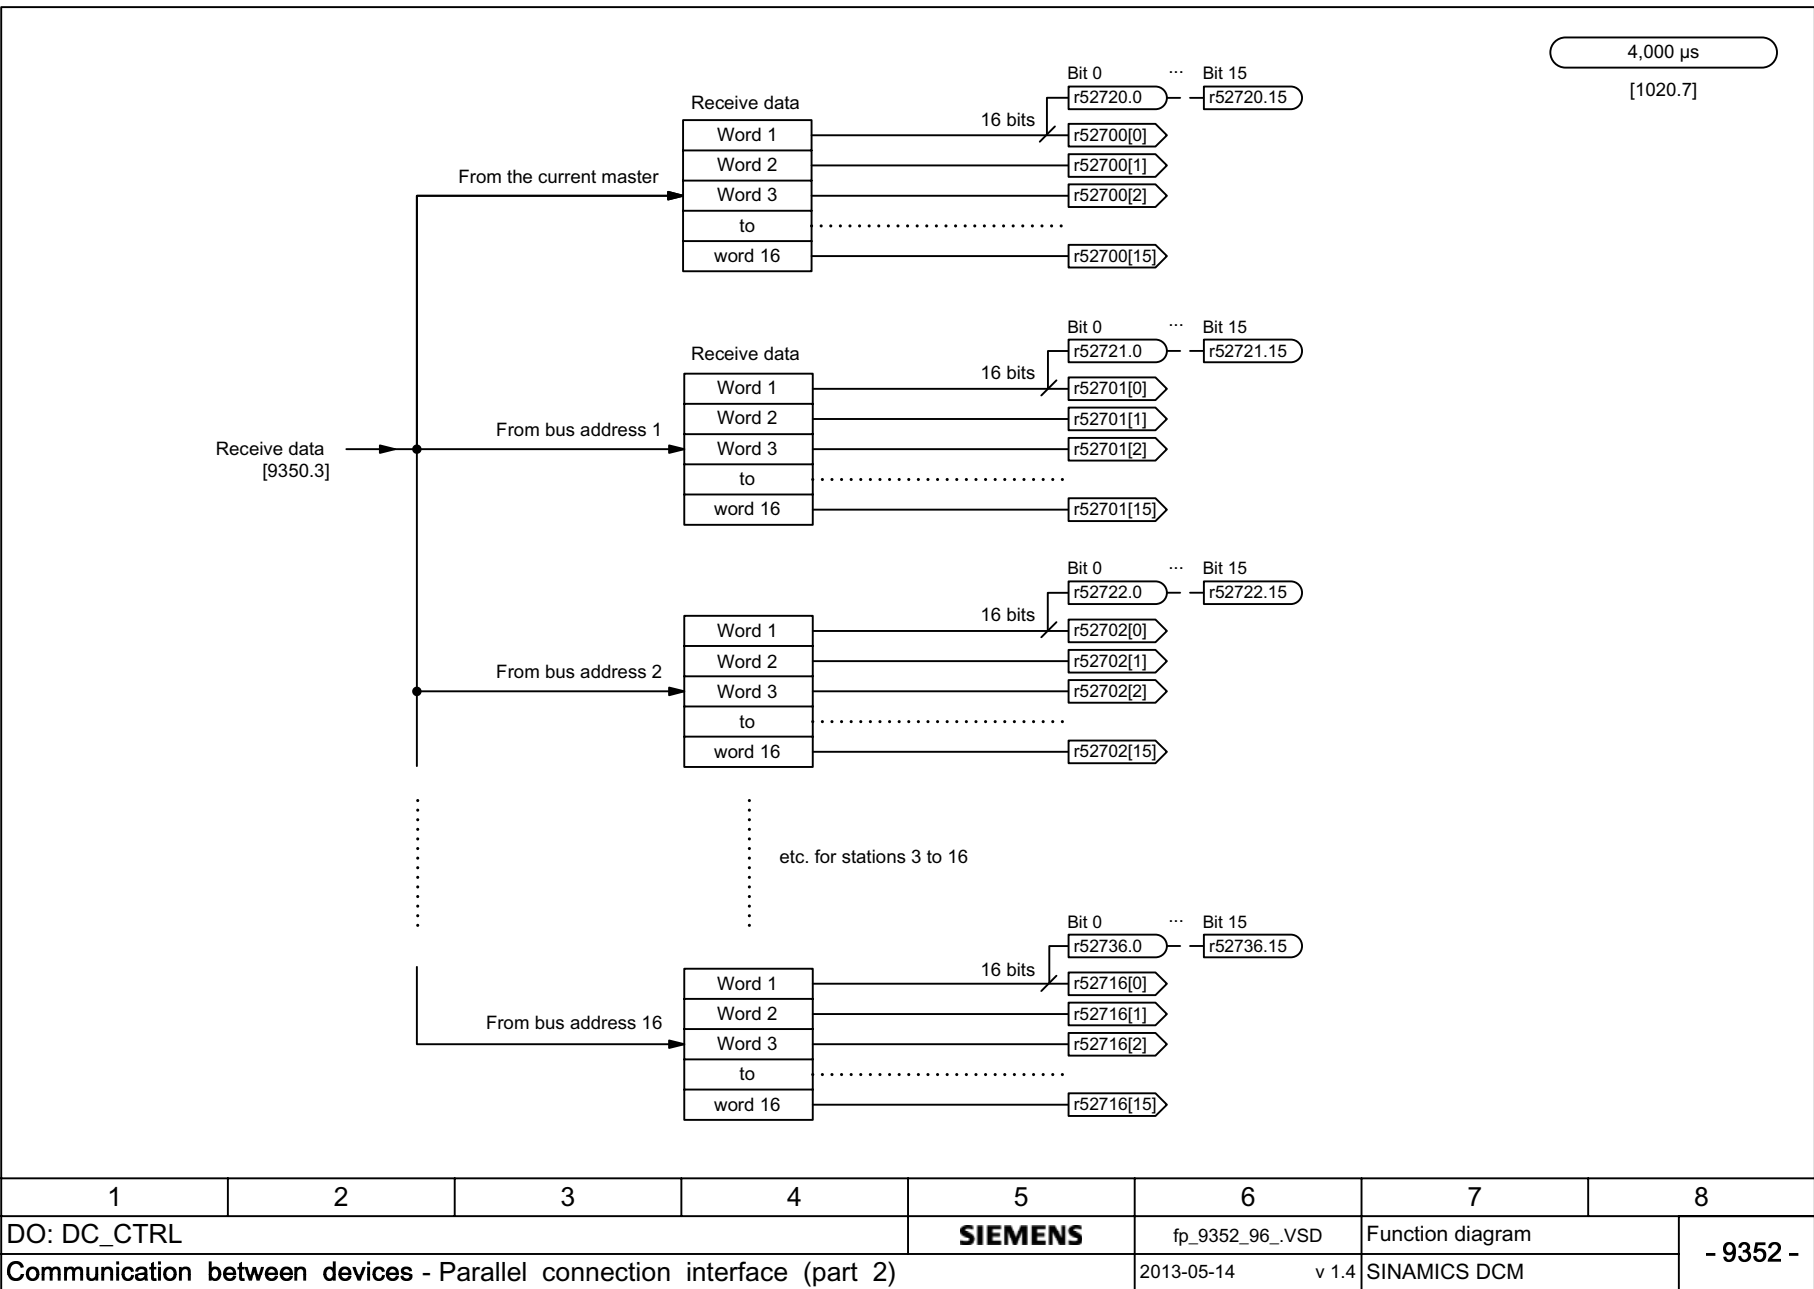


Fig. 2-141 9352 – Paralleling interface (Part 2)



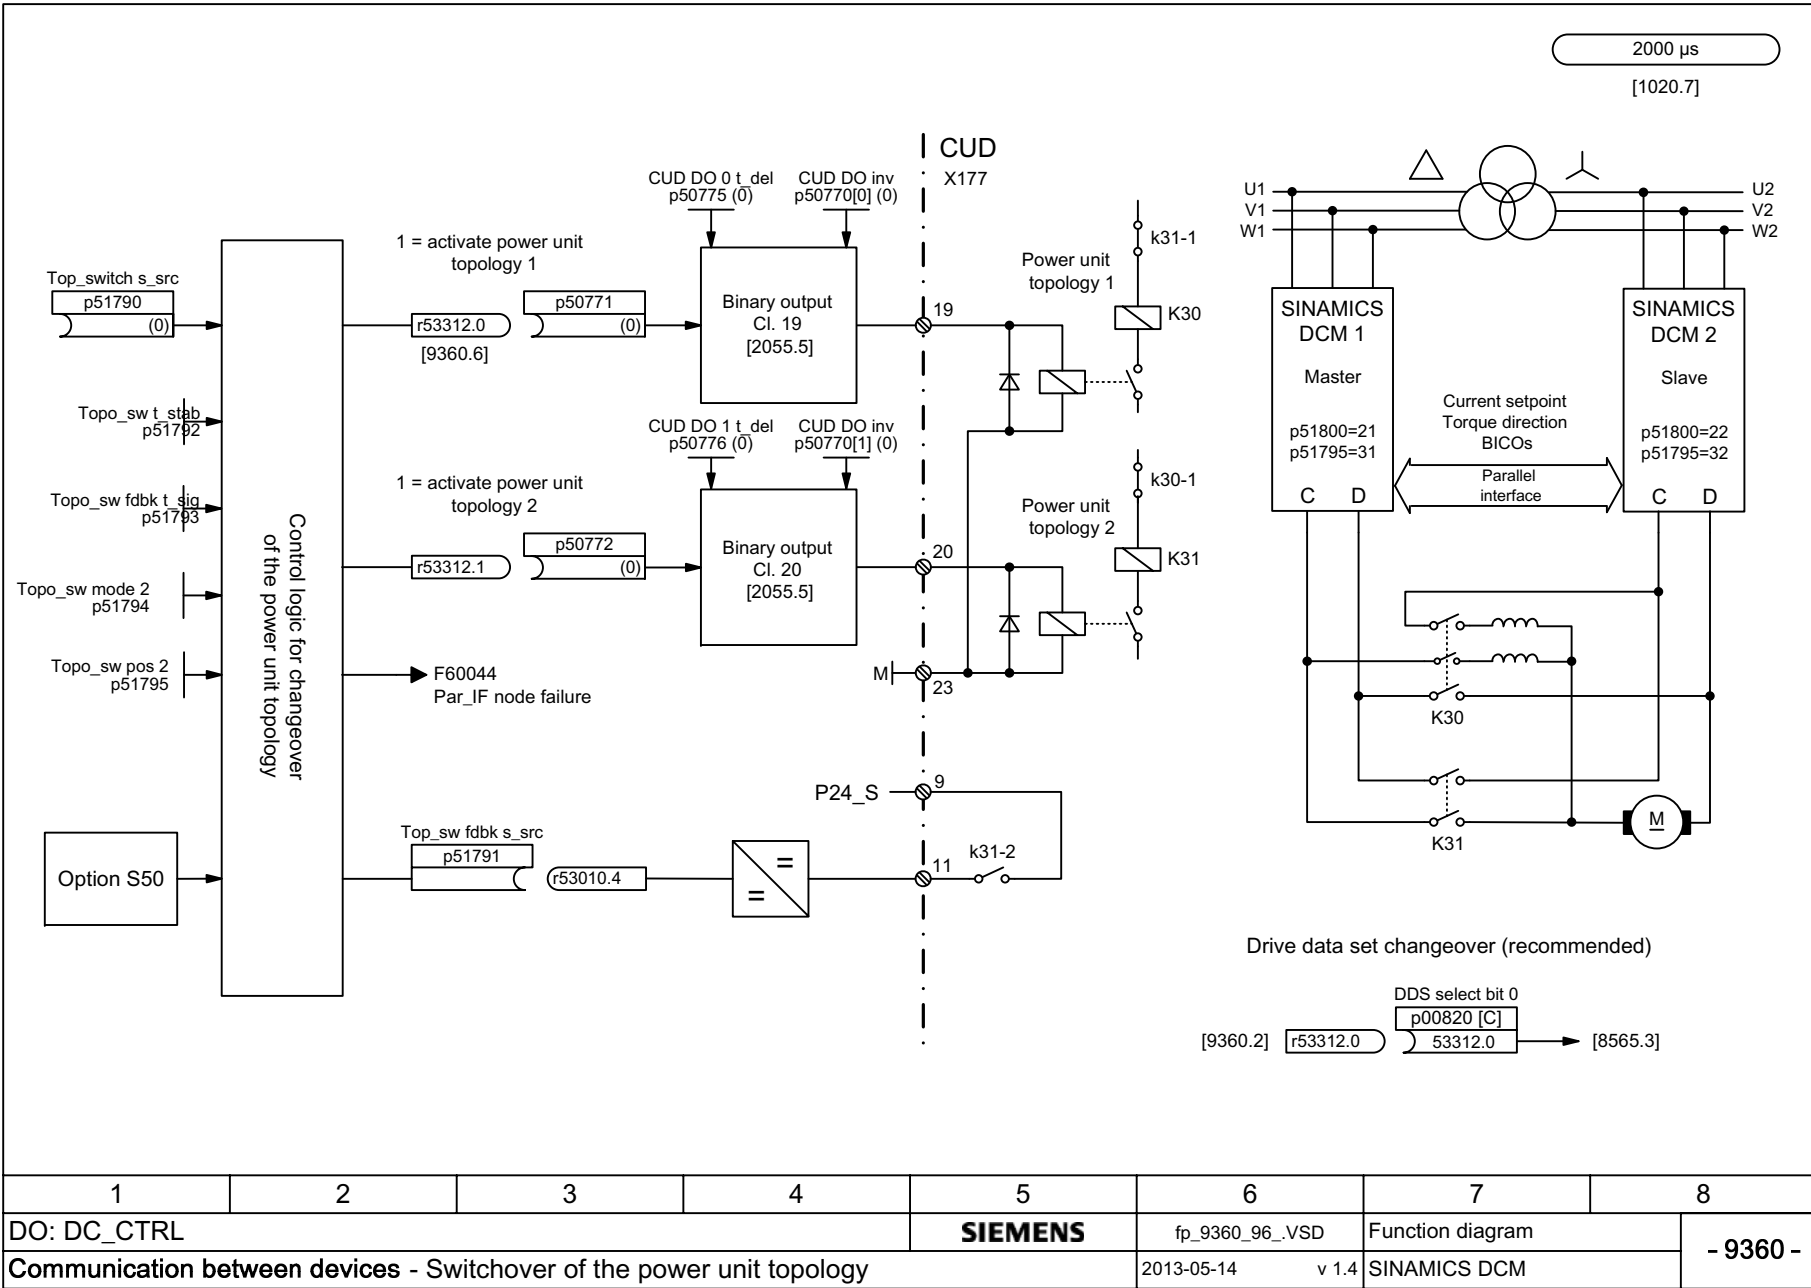




## 2.19 Terminal Module 15 for SINAMICS (TM15DI/DO)

### Function diagrams

---

9400 – Digital inputs/outputs, bidirectional (DI/DO 0 ... DI/DO 7)	2-827
9401 – Digital inputs/outputs, bidirectional (DI/DO 8 ... DI/DO 15)	2-828
9402 – Digital inputs/outputs, bidirectional (DI/DO 16 ... DI/DO 23)	2-829

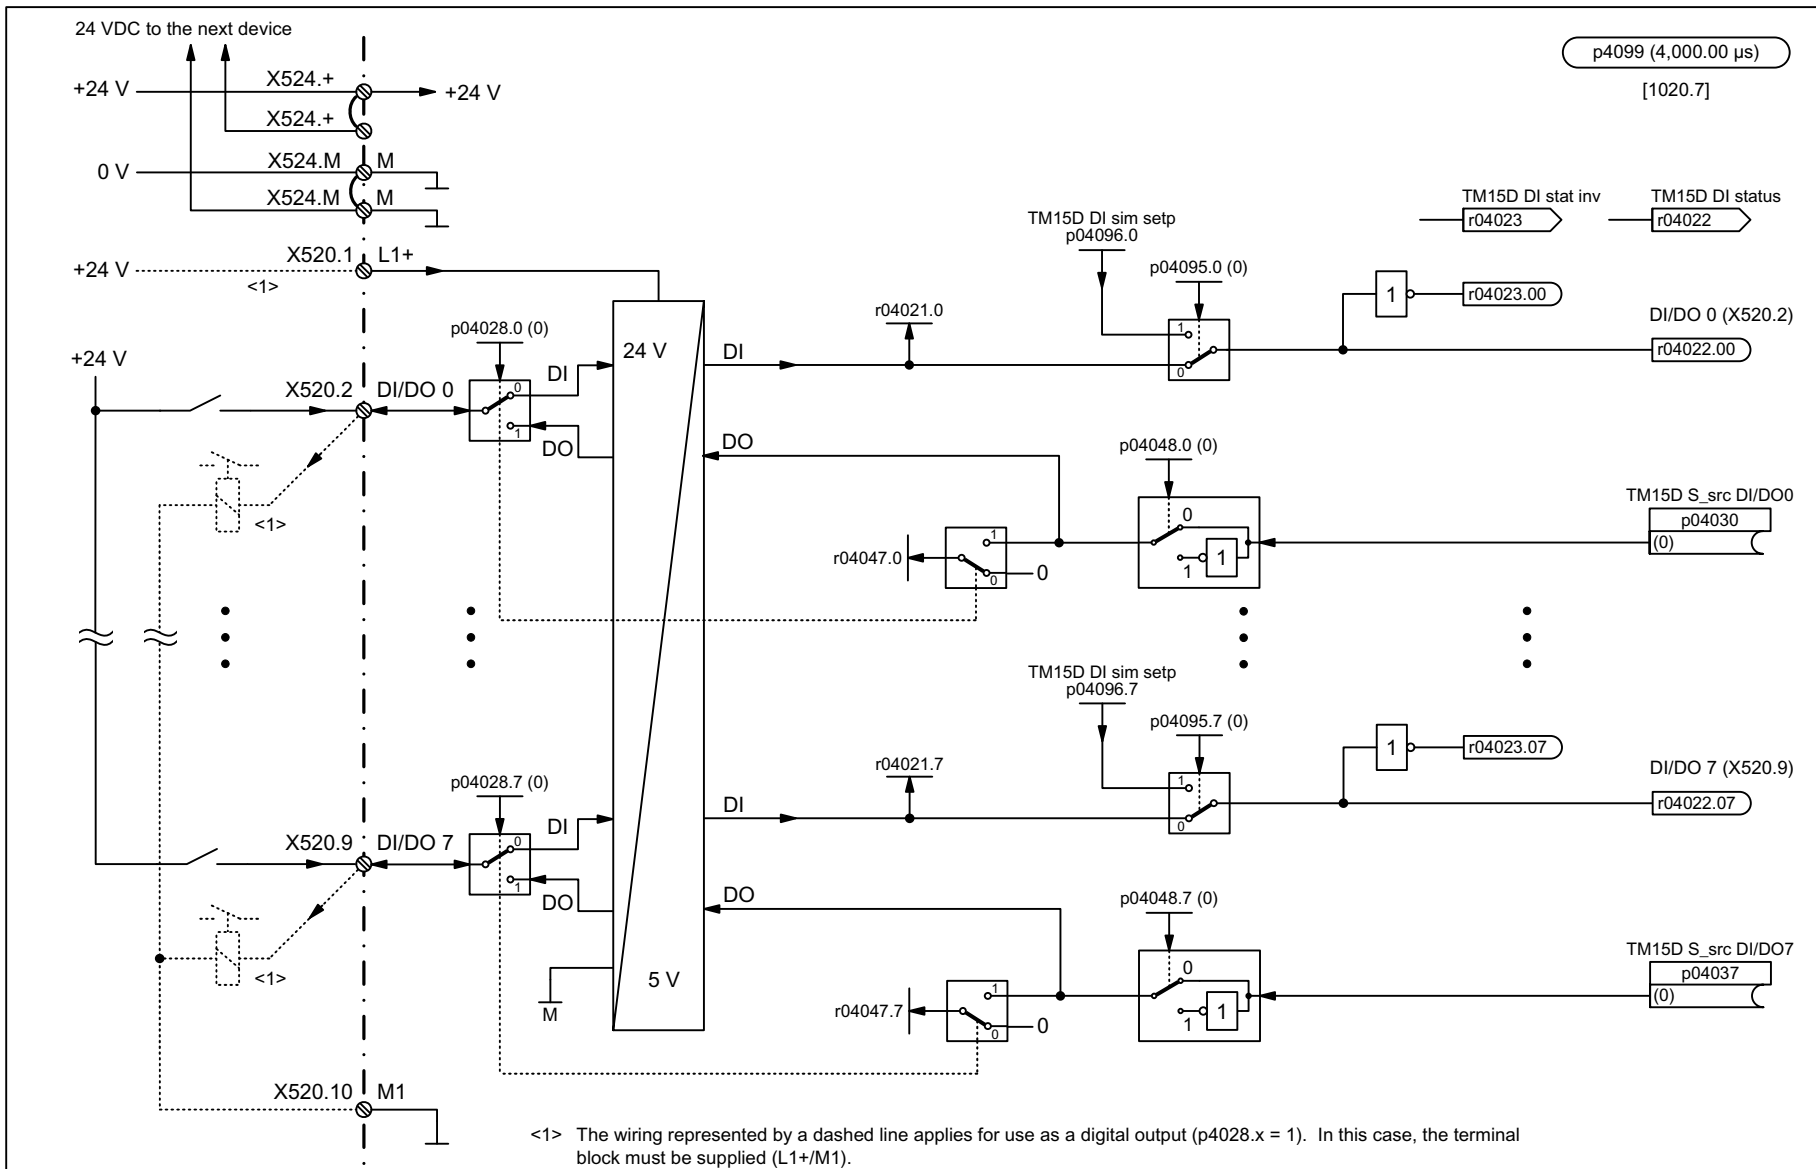---



1	2	3	4	5	6	7	8
DO: TM15DI_DO				<b>SIEMENS</b>	fp_9400_96_VSD	Function diagram	
Terminal Module 15 (TM15) - Digital inputs/outputs, bidirectional (DI/DO 0 ... DI/DO 7)					2013-05-14	v 1.4	SINAMICS DCM
							- 9400 -

Fig. 2-144 9400 – Digital inputs/outputs, bidirectional (DI/DO 0 ... DI/DO 7)

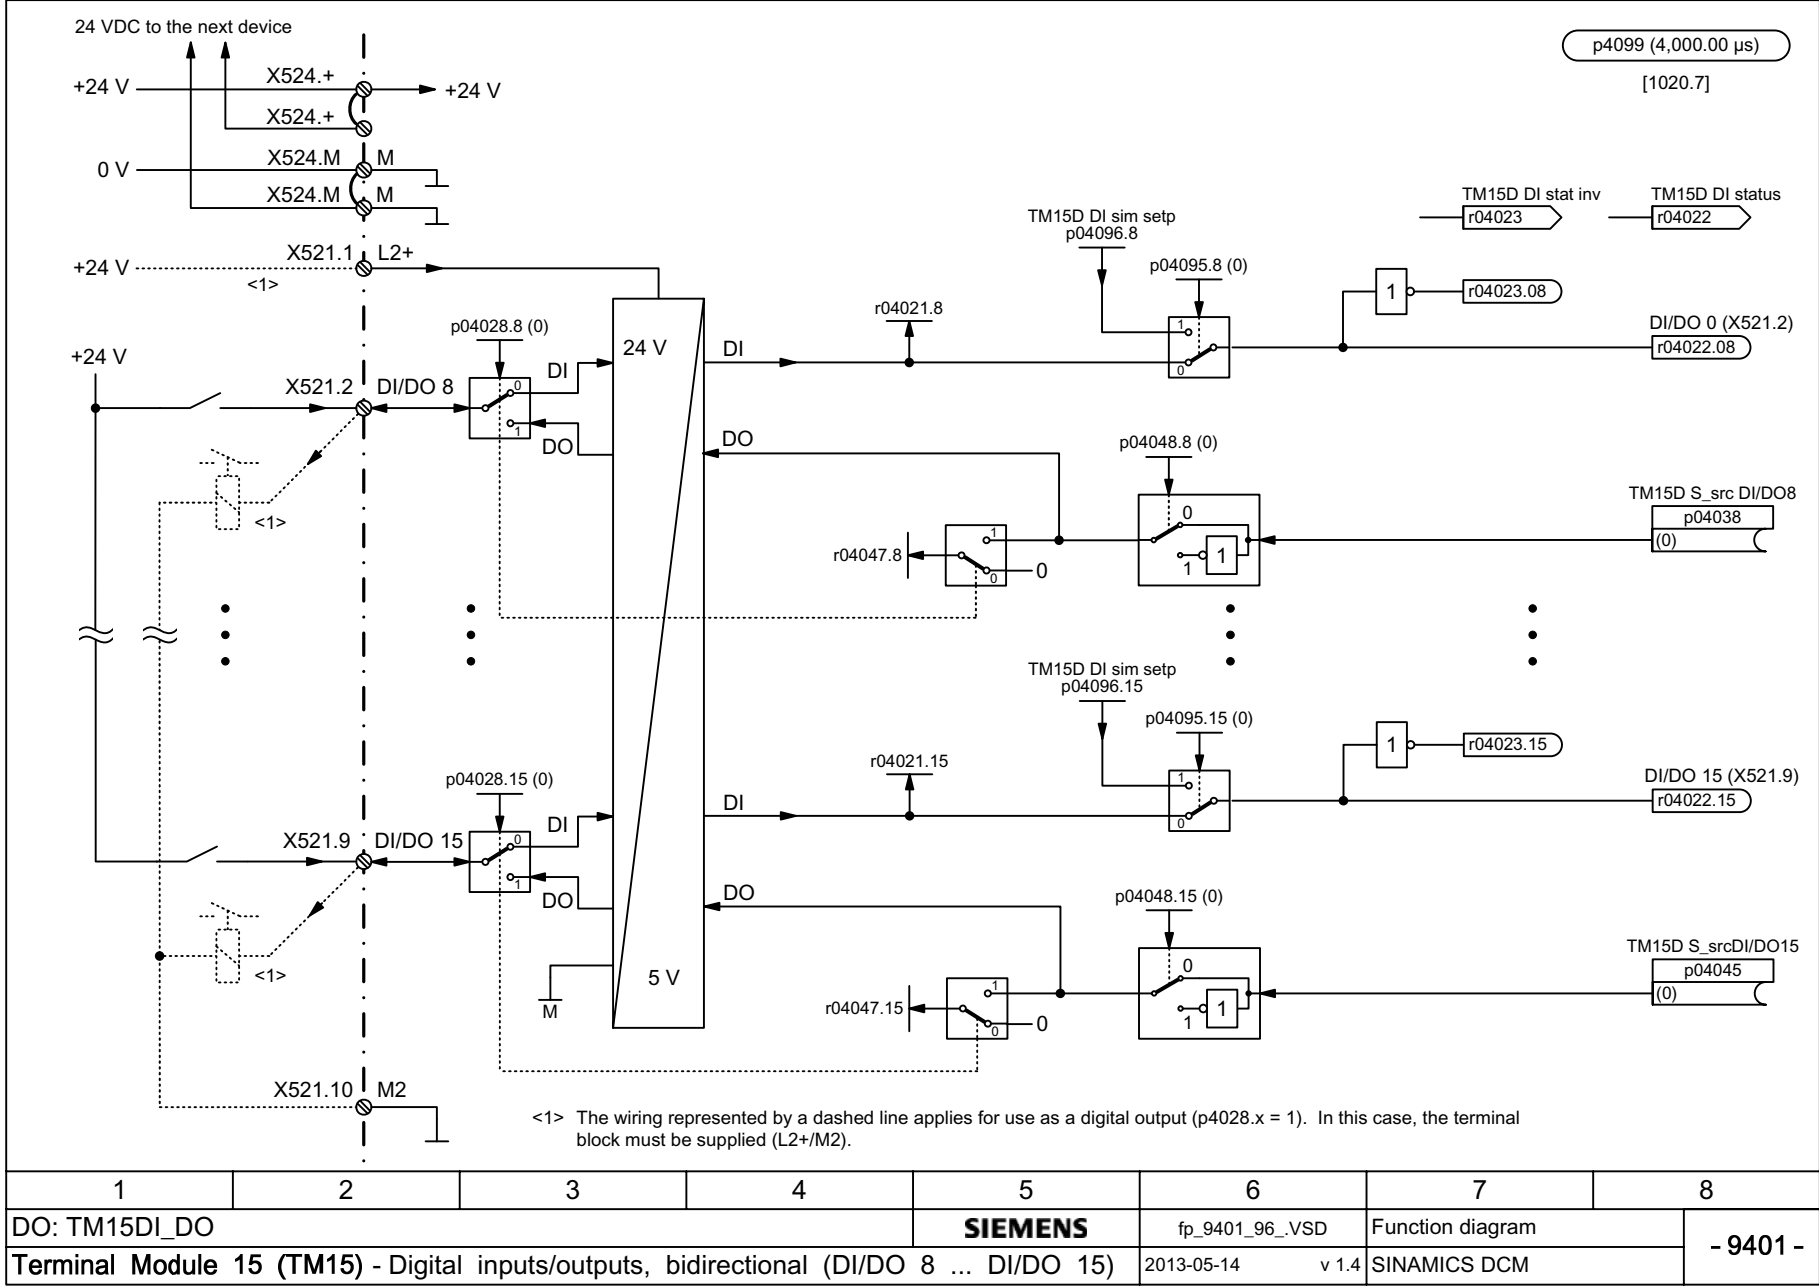


Fig. 2-145 9401 – Digital inputs/outputs, bidirectional (DI/DO 8 ... DI/DO 15)

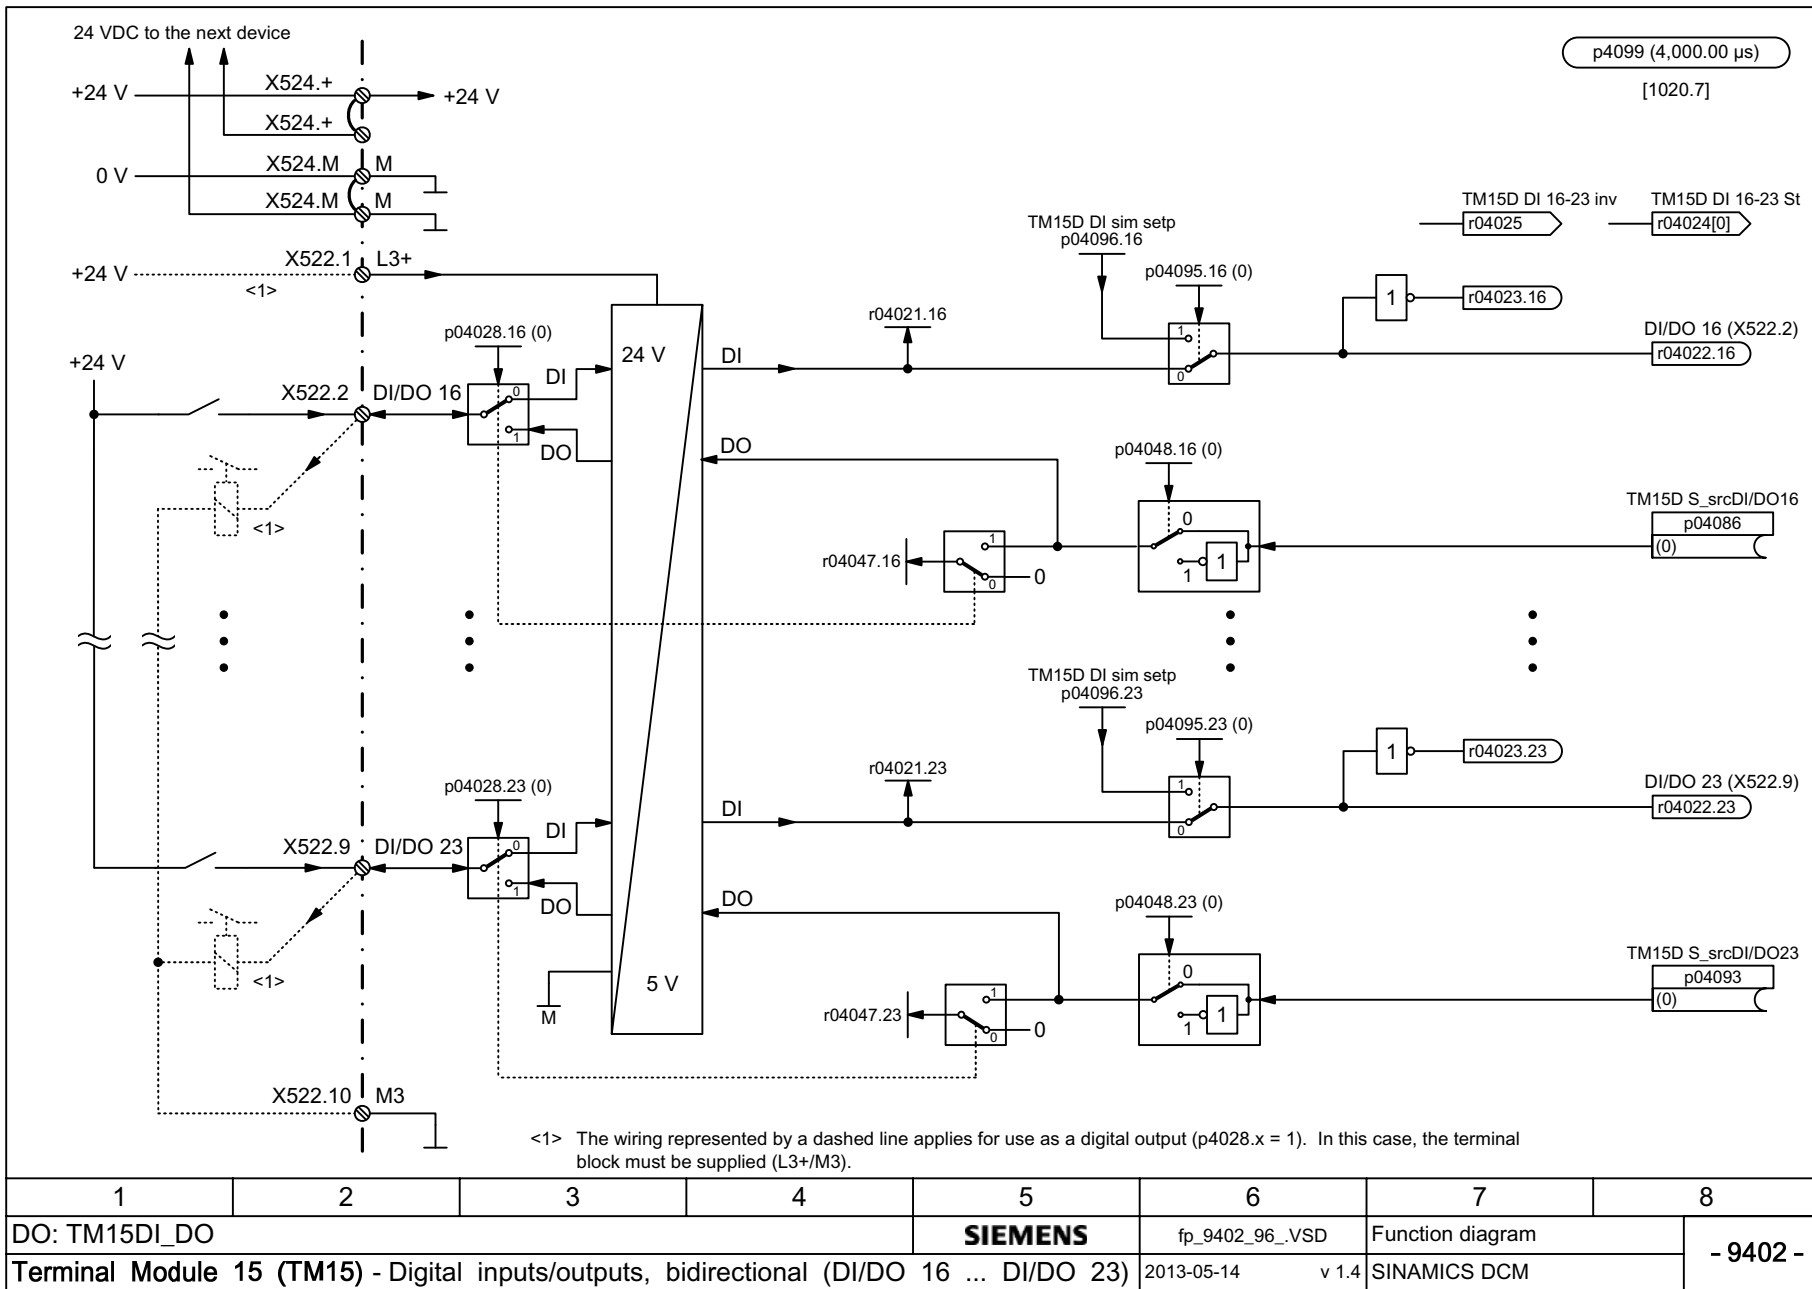


Fig. 2-146 9402 – Digital inputs/outputs, bidirectional (DI/DO 16 ... DI/DO 23)

## 2.20 Terminal Module 31 (TM31)

### Function diagrams

9550 – Digital inputs, isolated (DI 0 ... DI 3)	2-831
9552 – Digital inputs, isolated (DI 4 ... DI 7)	2-832
9556 – Digital relay outputs, isolated (DO 0 ... DO 1)	2-833
9560 – Digital inputs/outputs, bidirectional (DI/DO 8 ... DI/DO 9)	2-834
9562 – Digital inputs/outputs, bidirectional (DI/DO 10 ... DI/DO 11)	2-835
9566 – Analog input 0 (AI 0)	2-836
9568 – Analog input 1 (AI 1)	2-837
9572 – Analog outputs (AO 0 ... AO 1)	2-838
9576 – Temperature evaluation KTY/PTC	2-839
9577 – Sensor monitoring KTY/PTC	2-840

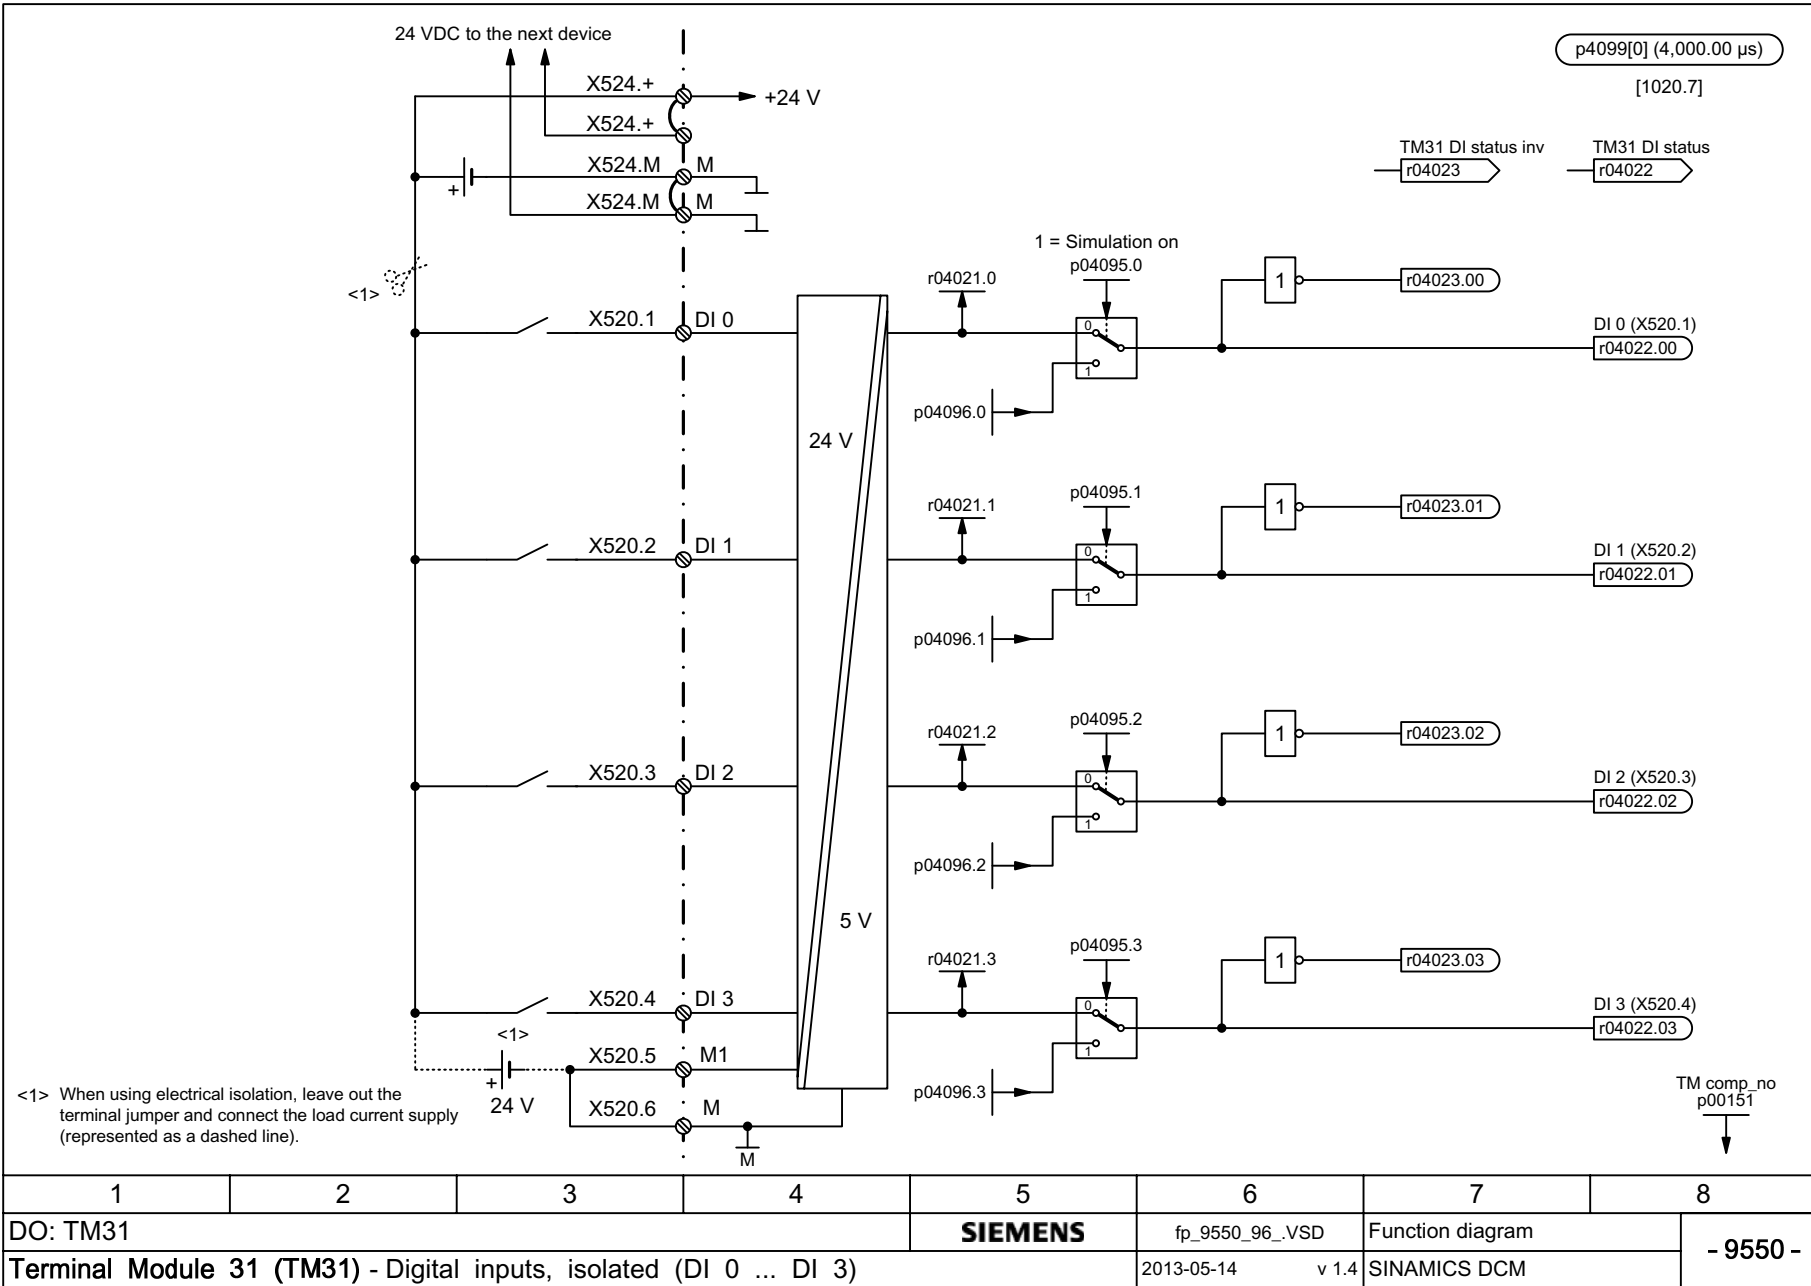


Fig. 2-147 9550 – Digital inputs, isolated (DI 0 ... DI 3)

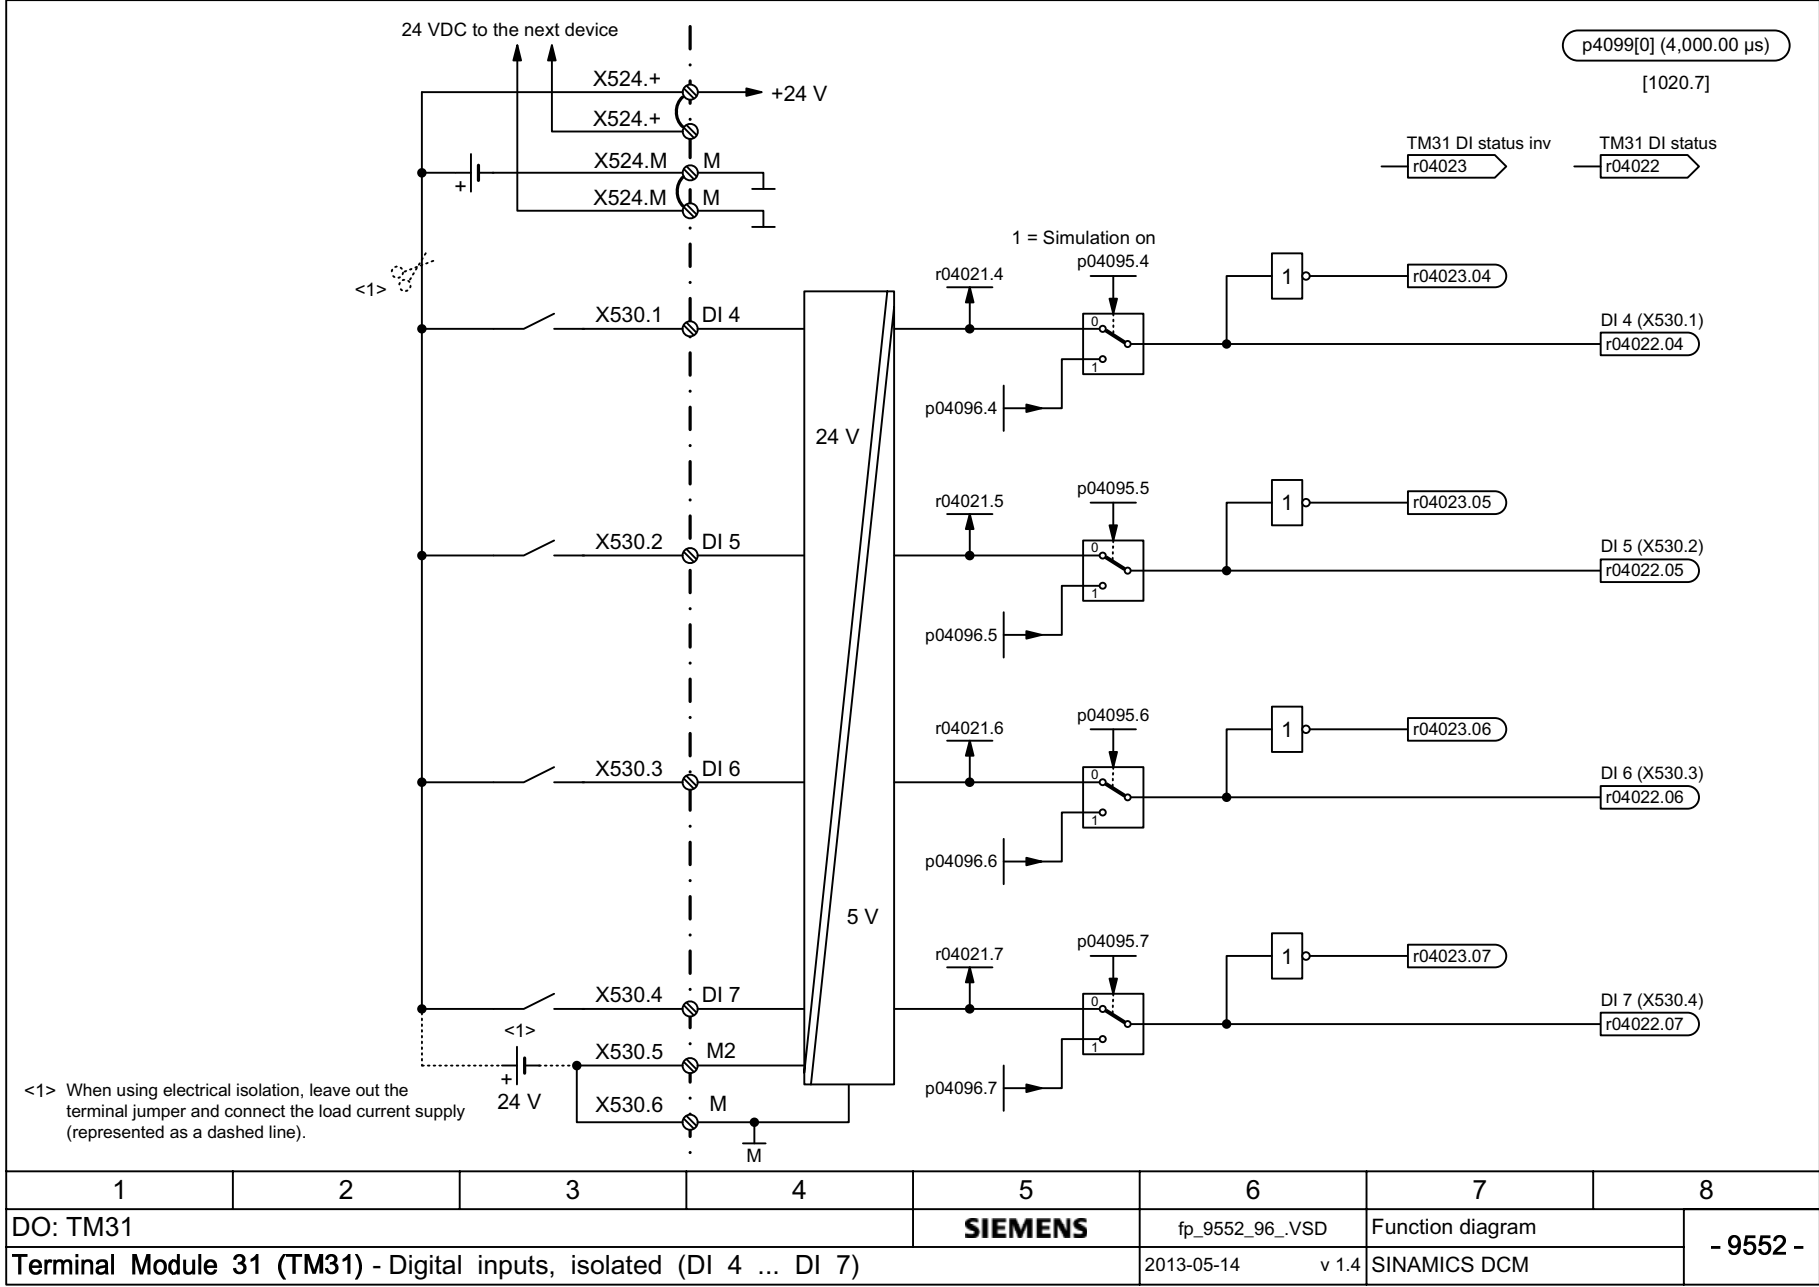


Fig. 2-148 9552 – Digital inputs, isolated (DI 4 ... DI 7)








Fig. 2-149

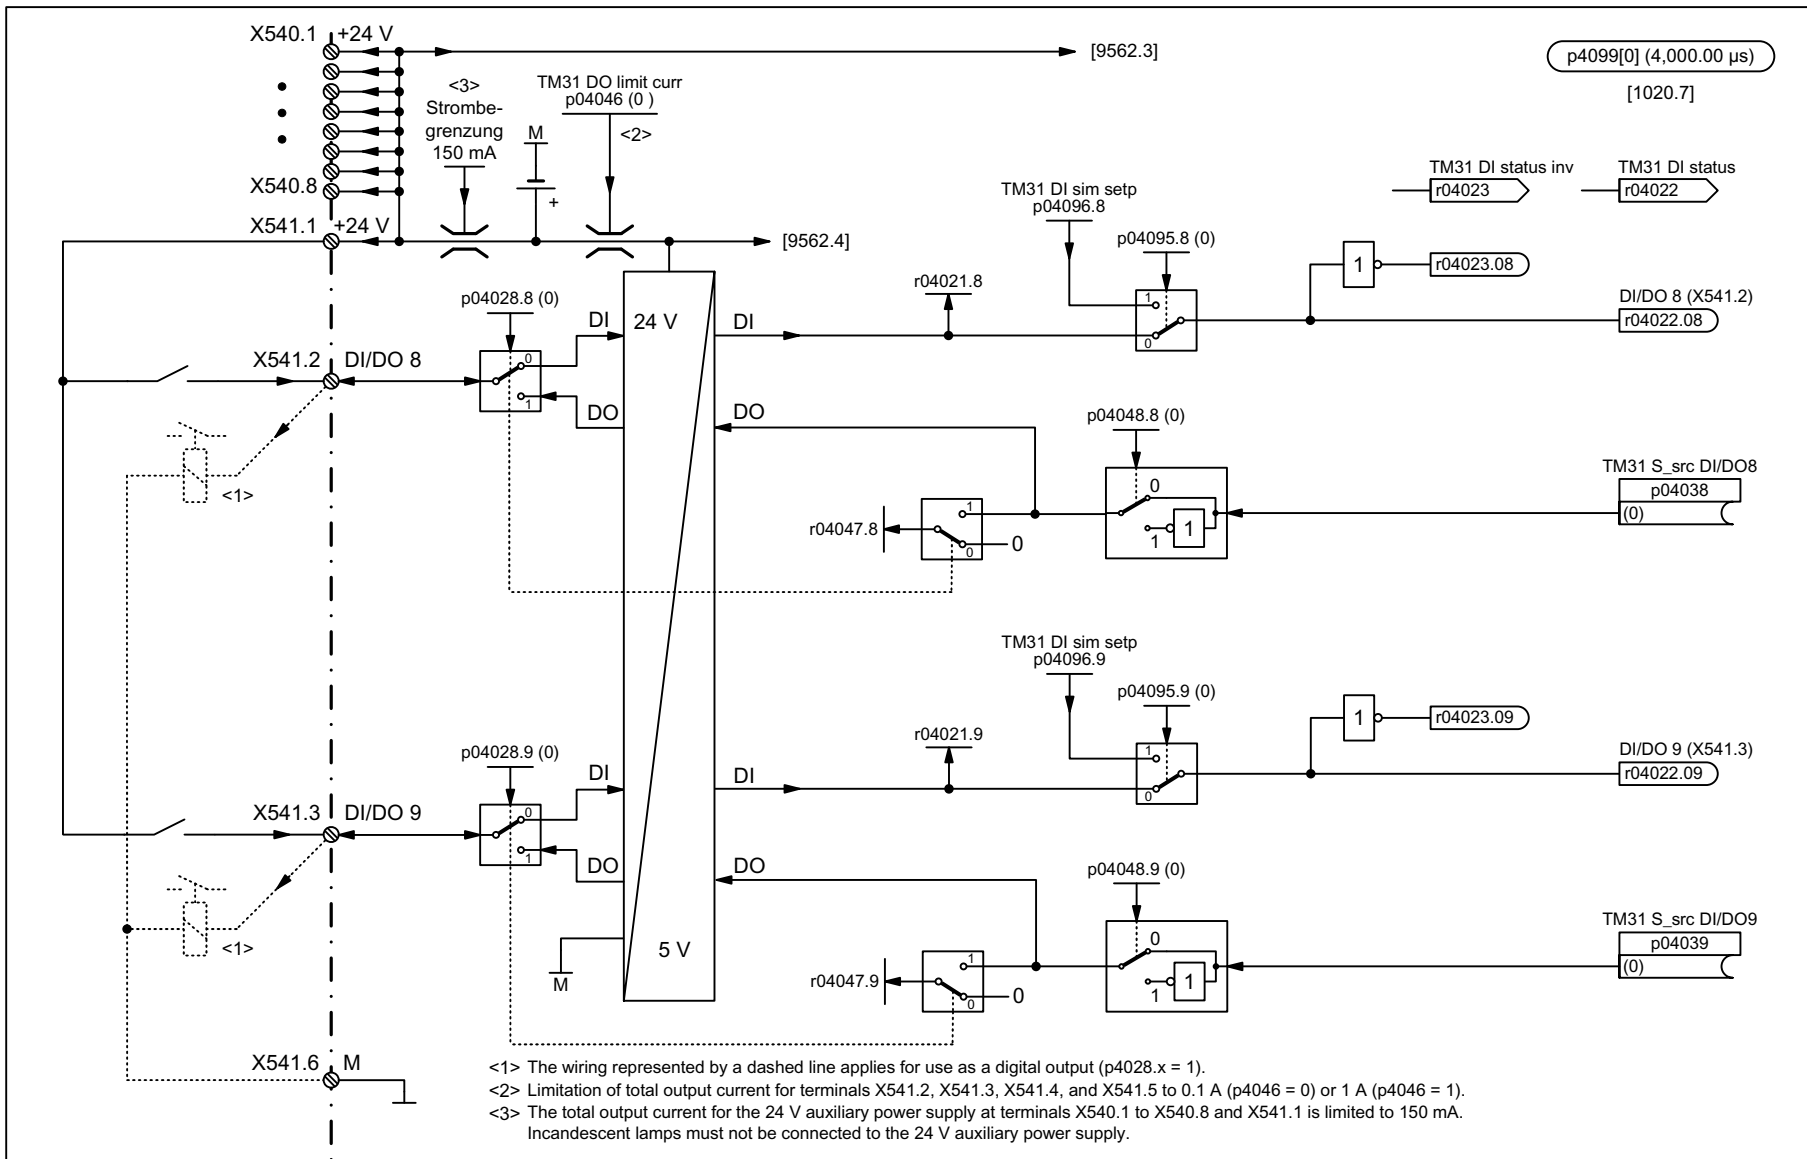


1	2	3	4	5	6	7	8
DO: TM31				<b>SIEMENS</b>	fp_9560_96_VSD	Function diagram	
Terminal Module 31 (TM31) - Digital inputs/outputs, bidirectional (DI/DO 8 ... DI/DO 9)					2013-05-14 v 1.4	SINAMICS DCM	
							- 9560 -

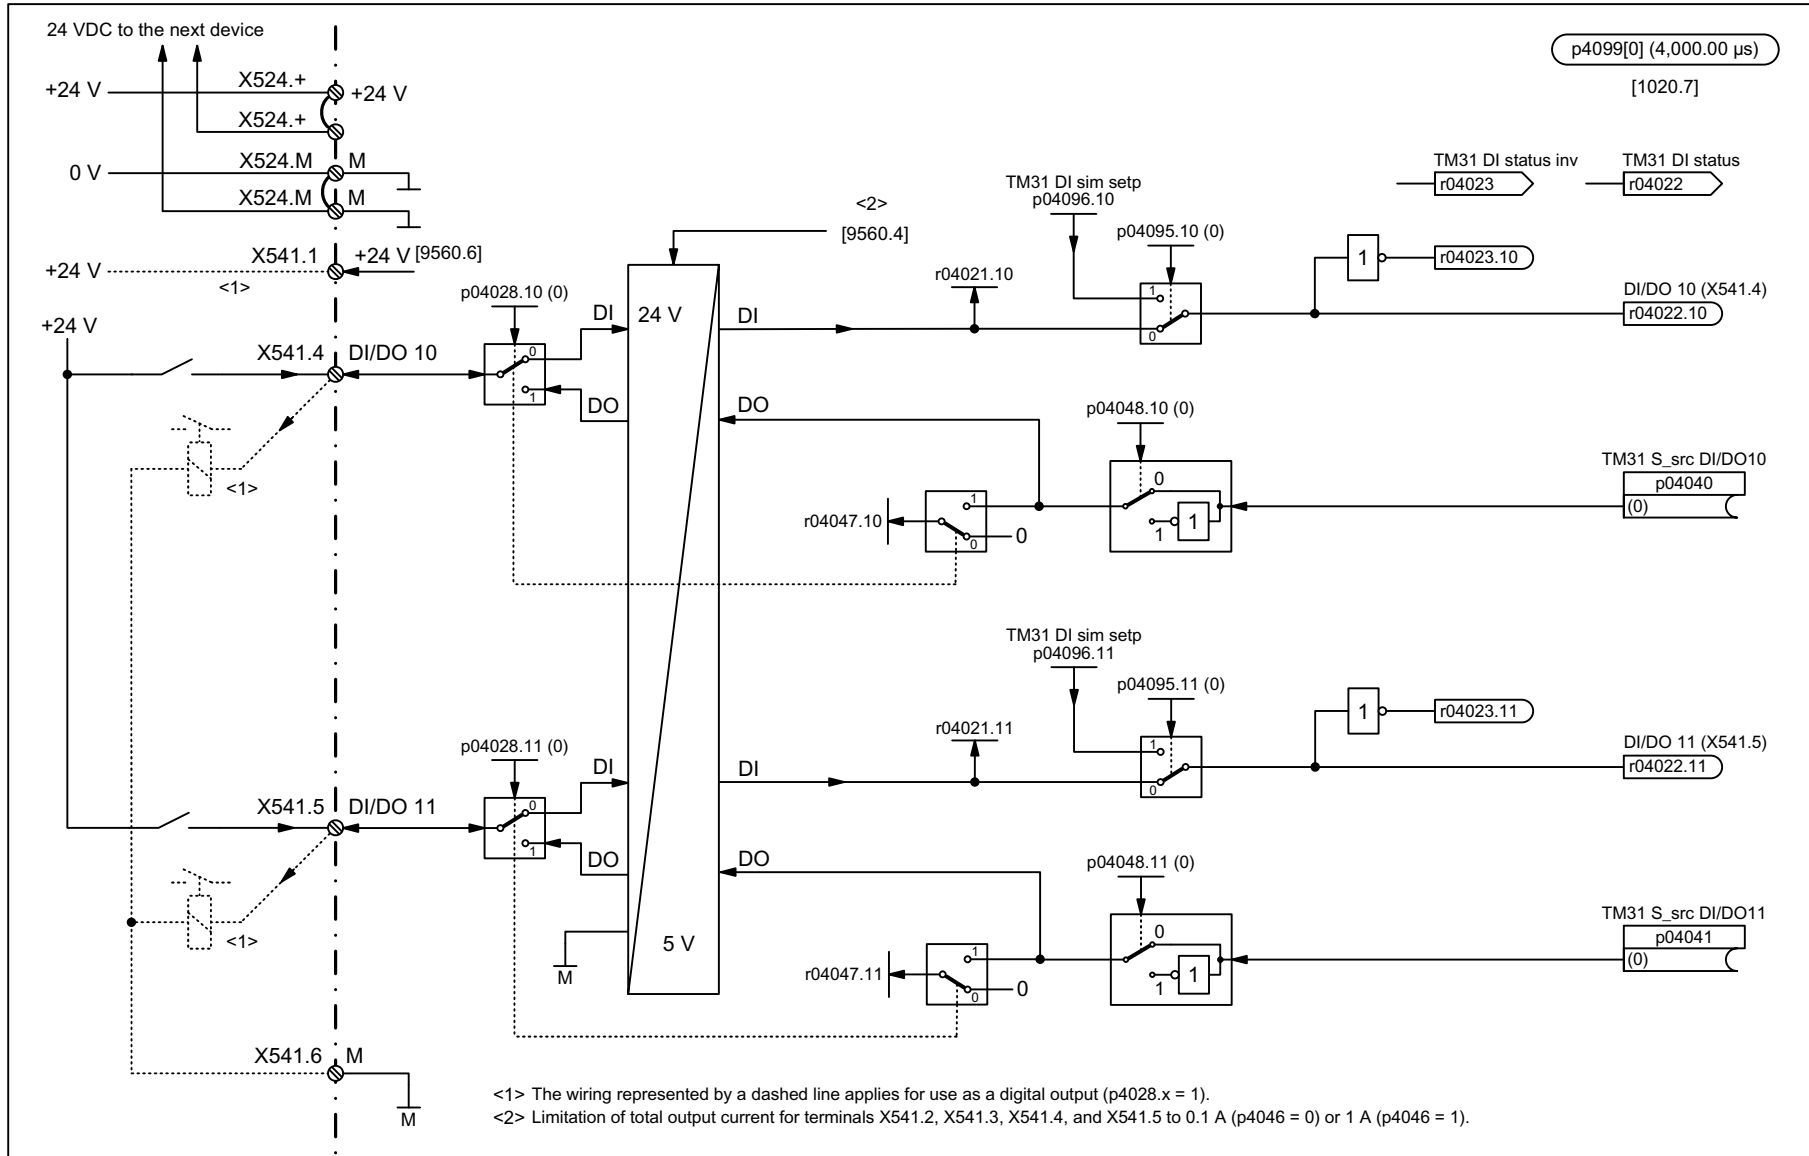Fig. 2-150 9560 – Digital inputs/outputs, bidirectional (DI/DO 8 ... DI/DO 9)



1	2	3	4	5	6	7	8
DO: TM31				<b>SIEMENS</b>	fp_9562_96_VSD	Function diagram	
Terminal Module 31 (TM31) - Digital inputs/outputs, bidirectional (DI/DO 10 ... DI/DO 11)					2013-05-14 v 1.4	SINAMICS DCM	
							- 9562 -

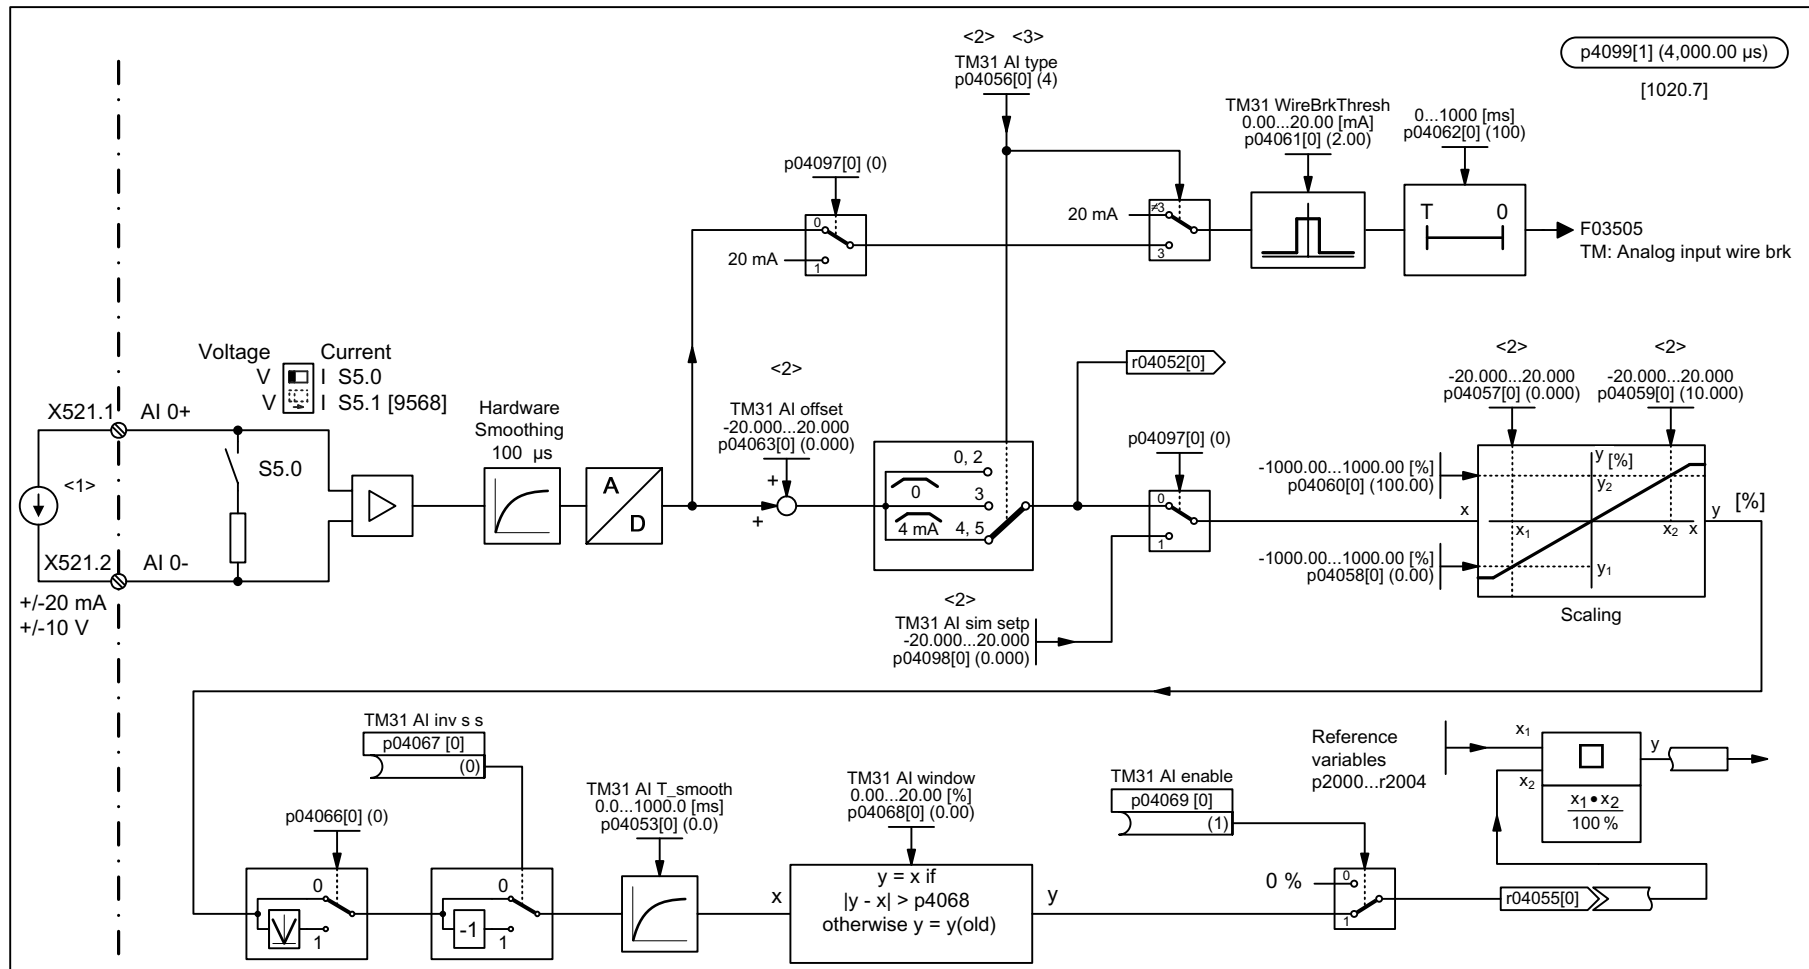Fig. 2-151 9562 – Digital inputs/outputs, bidirectional (DI/DO 10 ... DI/DO 11)




- <1> Differential input!  
With a single-ended input signal, terminal X521.2 must be connected to reference potential M.  
Caution:  
The voltage between an input (X521.1 or X521.2) and ground must not exceed 35 V.  
When a load resistor is connected (S5.0 closed), the voltage between the input terminals must not exceed 15 V.
- <2> When p4056 = 2, 3, 5, the unit is mA.  
When p4056 = 0, 4, the unit is V.


- <3> p4056  
= 0: 0 V ... +10 V  
= 2: 0 mA ... +20 mA  
= 3: 4 mA ... +20 mA with monitoring  
= 4: -10 V ... +10 V  
= 5: -20 mA ... +20 mA


1	2	3	4	5	6	7	8
DO: TM31				<b>SIEMENS</b>	fp_9566_96_VSD	Function diagram	
Terminal Module 31 (TM31) - Analog input 0 (AI 0)					2013-05-14 v 1.4	SINAMICS DCM	
							- 9566 -

Fig. 2-152 9566 – Analog input 0 (AI 0)

Fig. 2-153 9568 – Analog input 1 (AI 1)

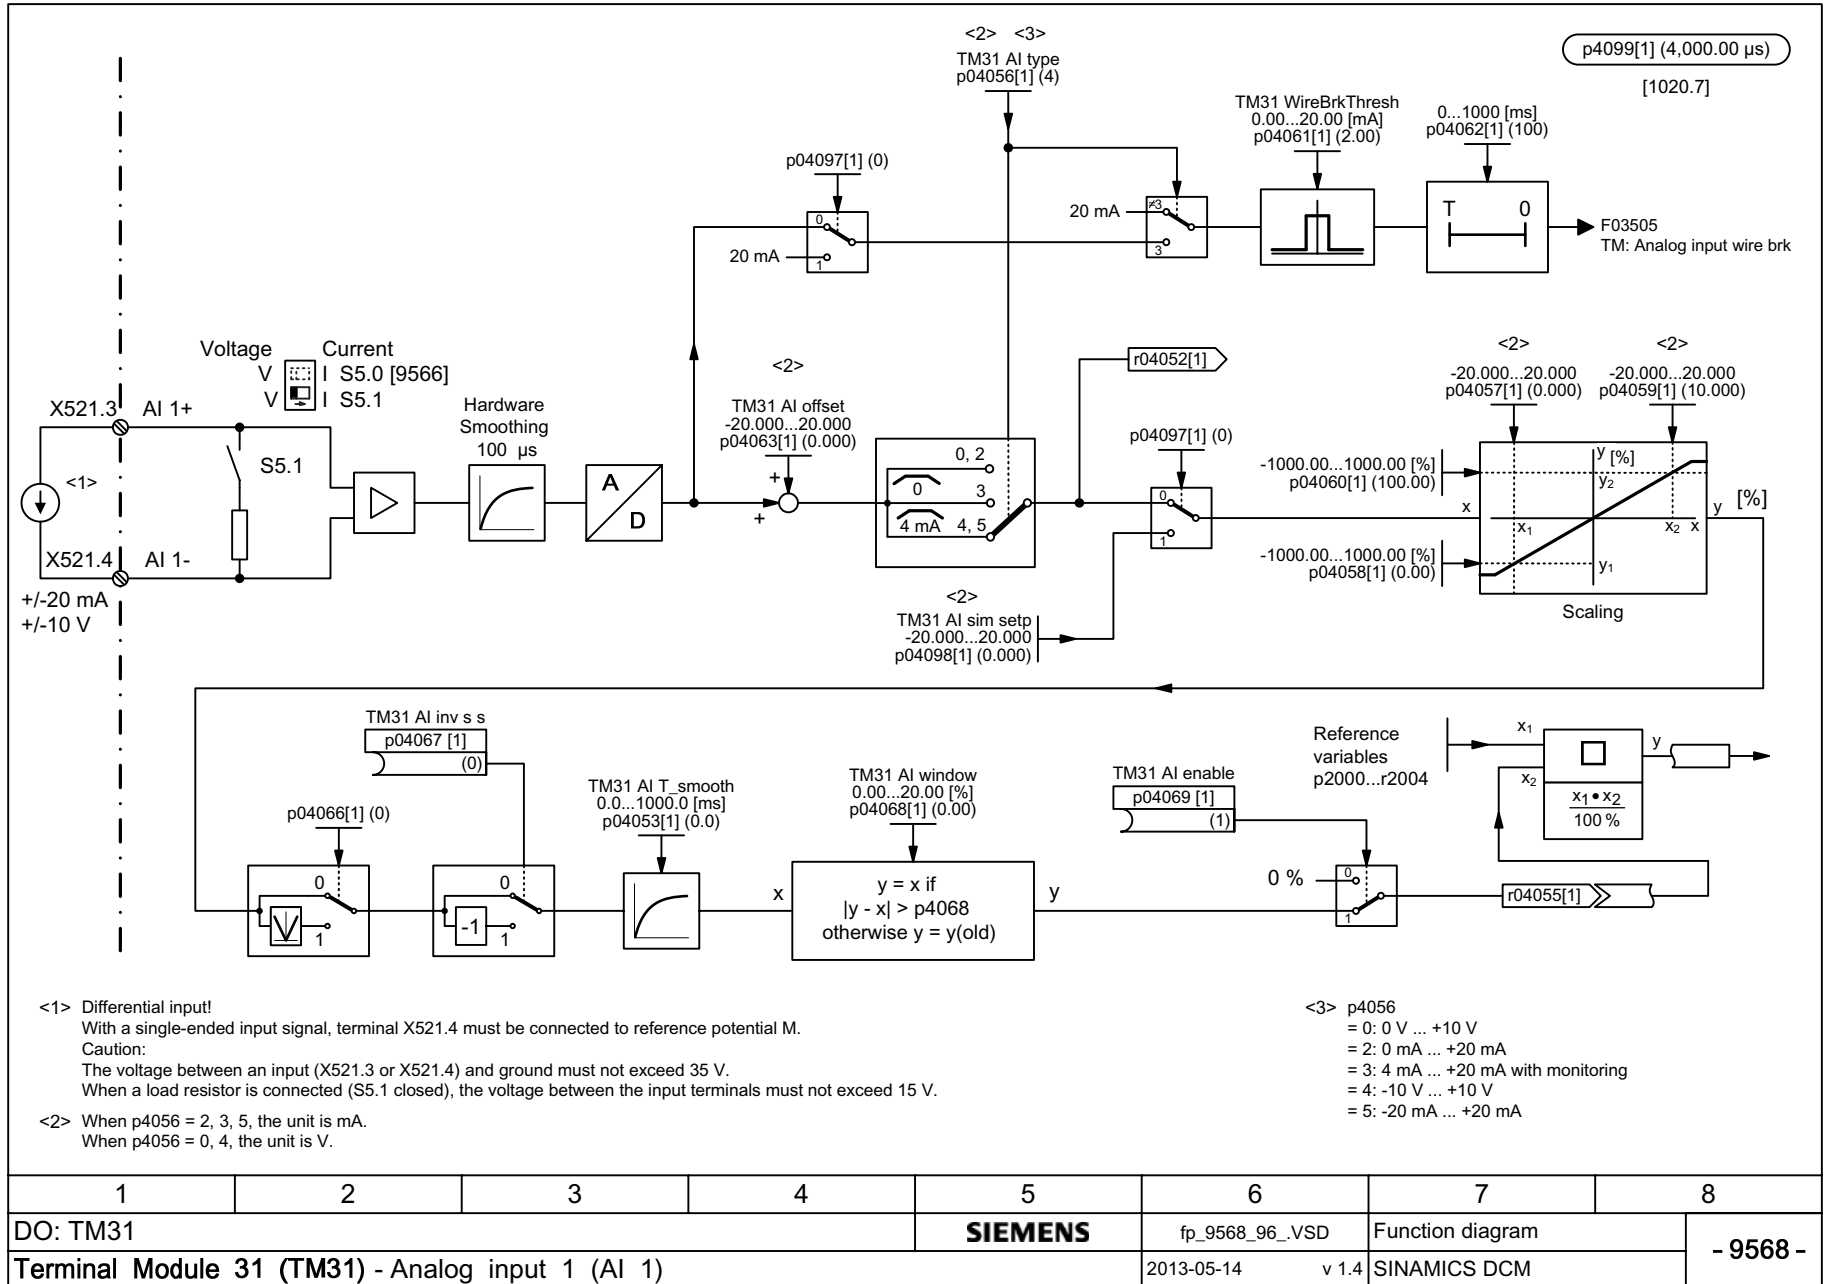

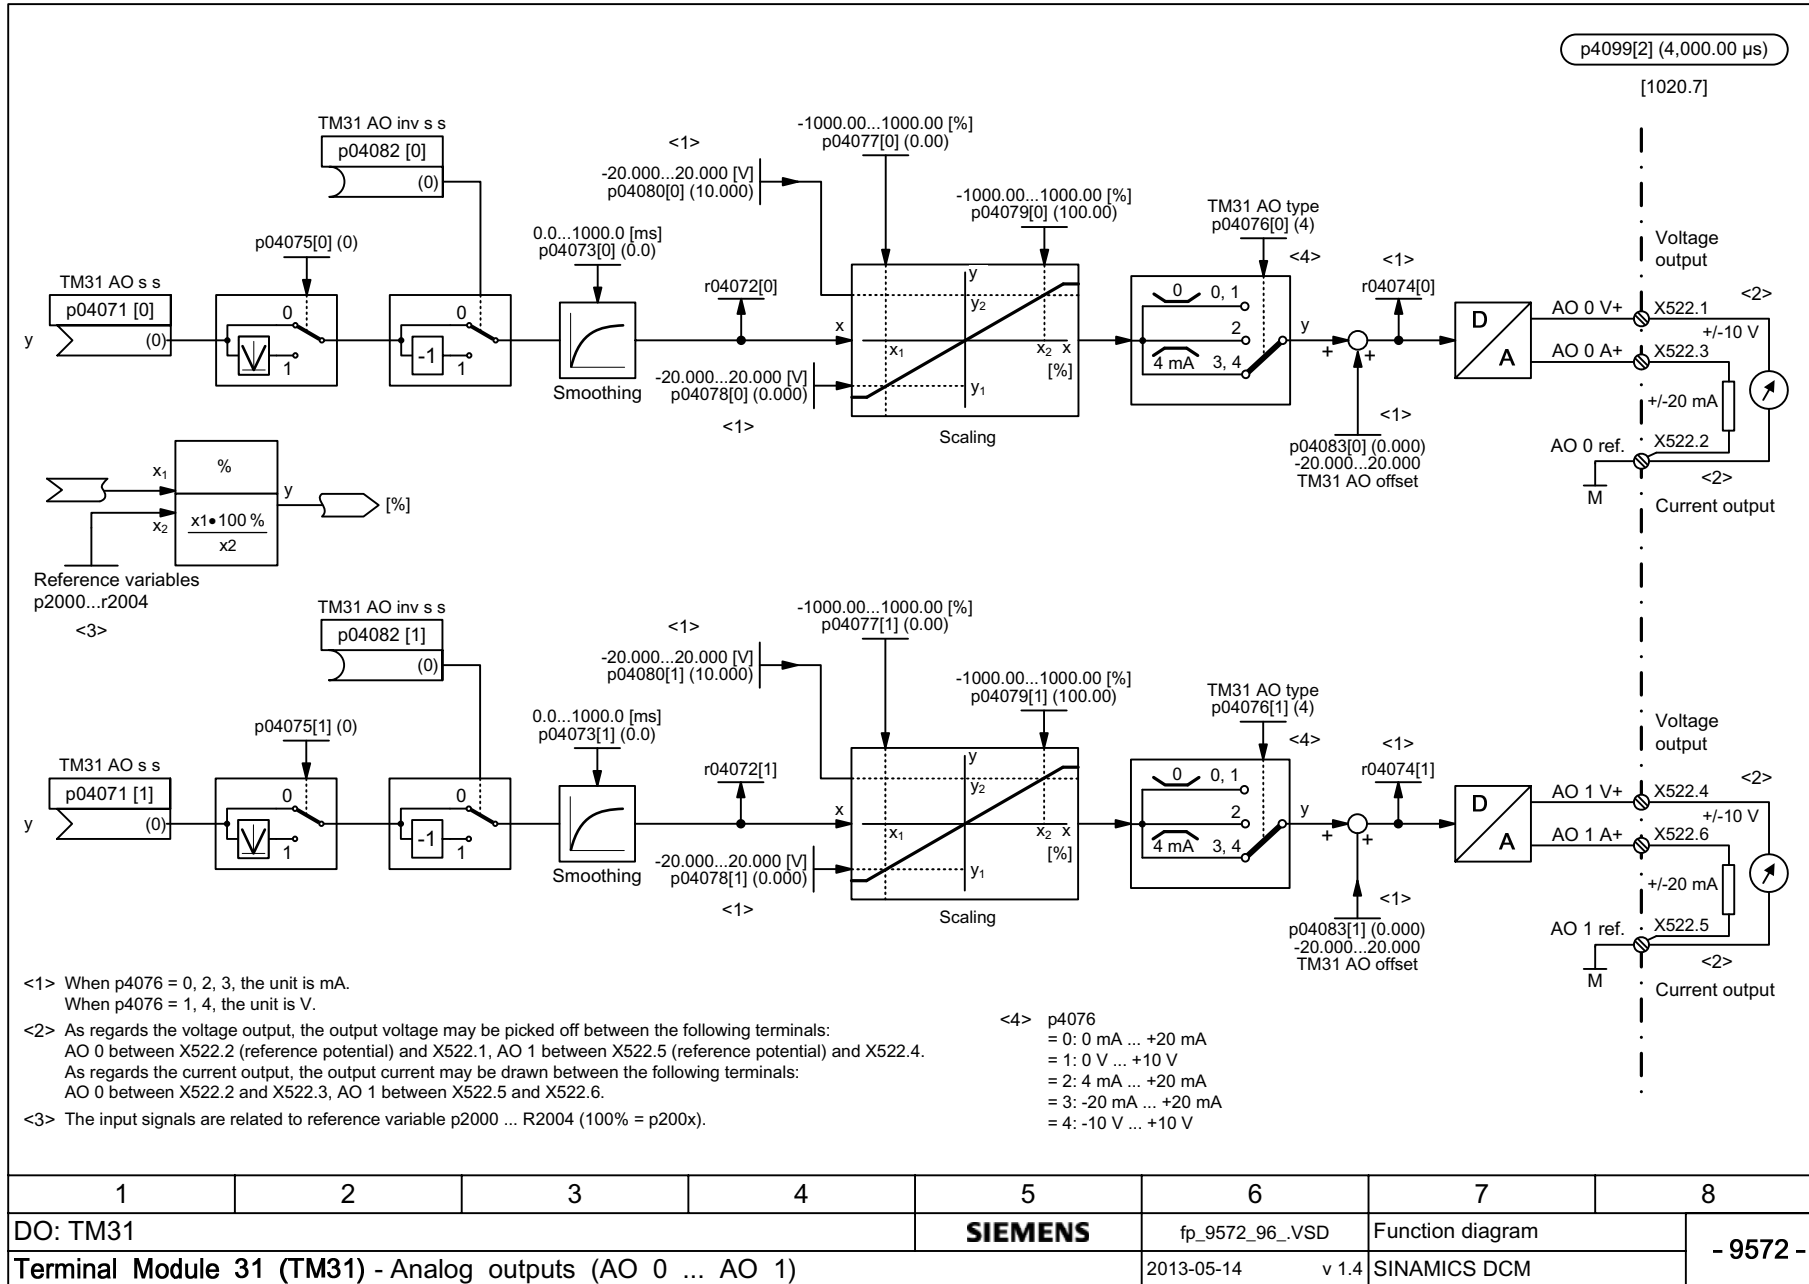

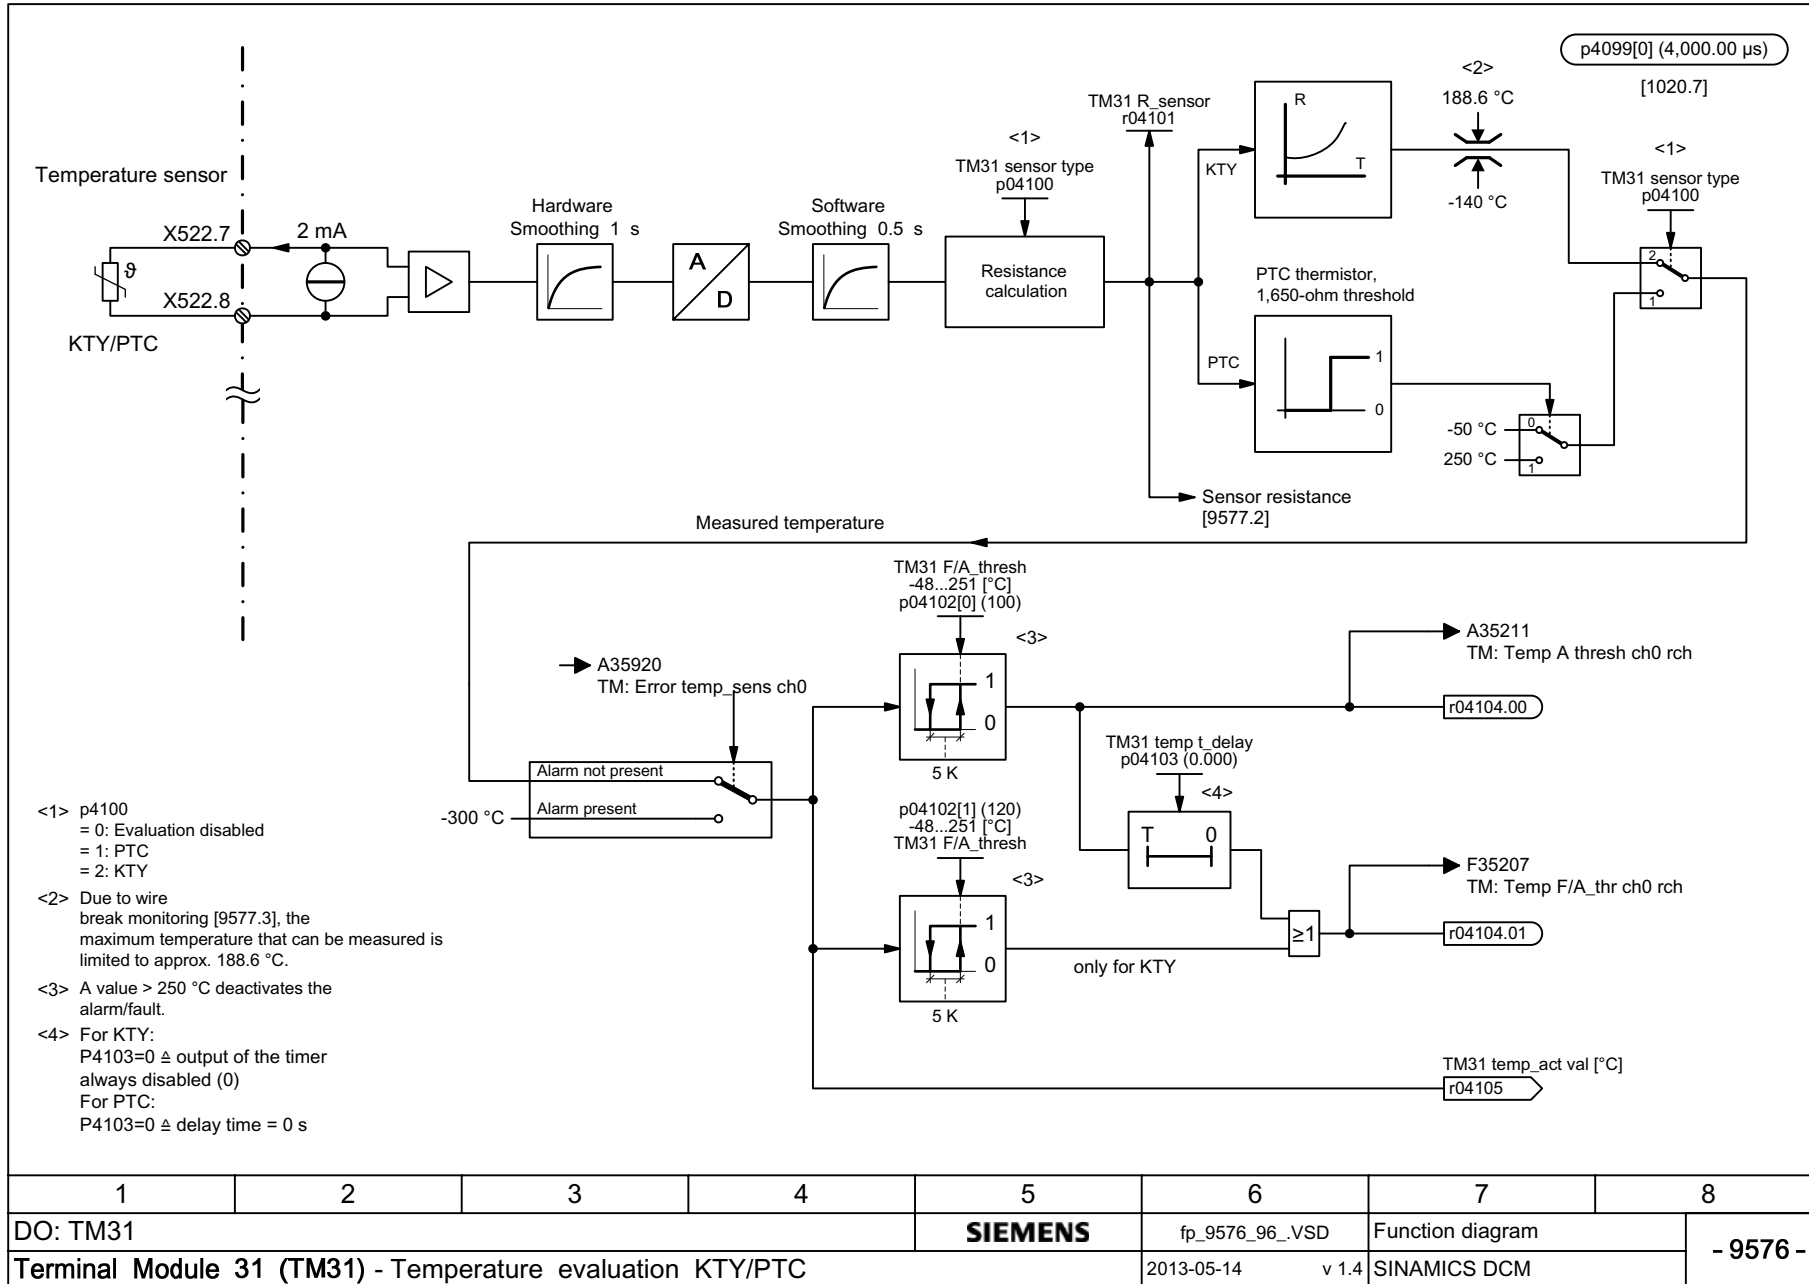

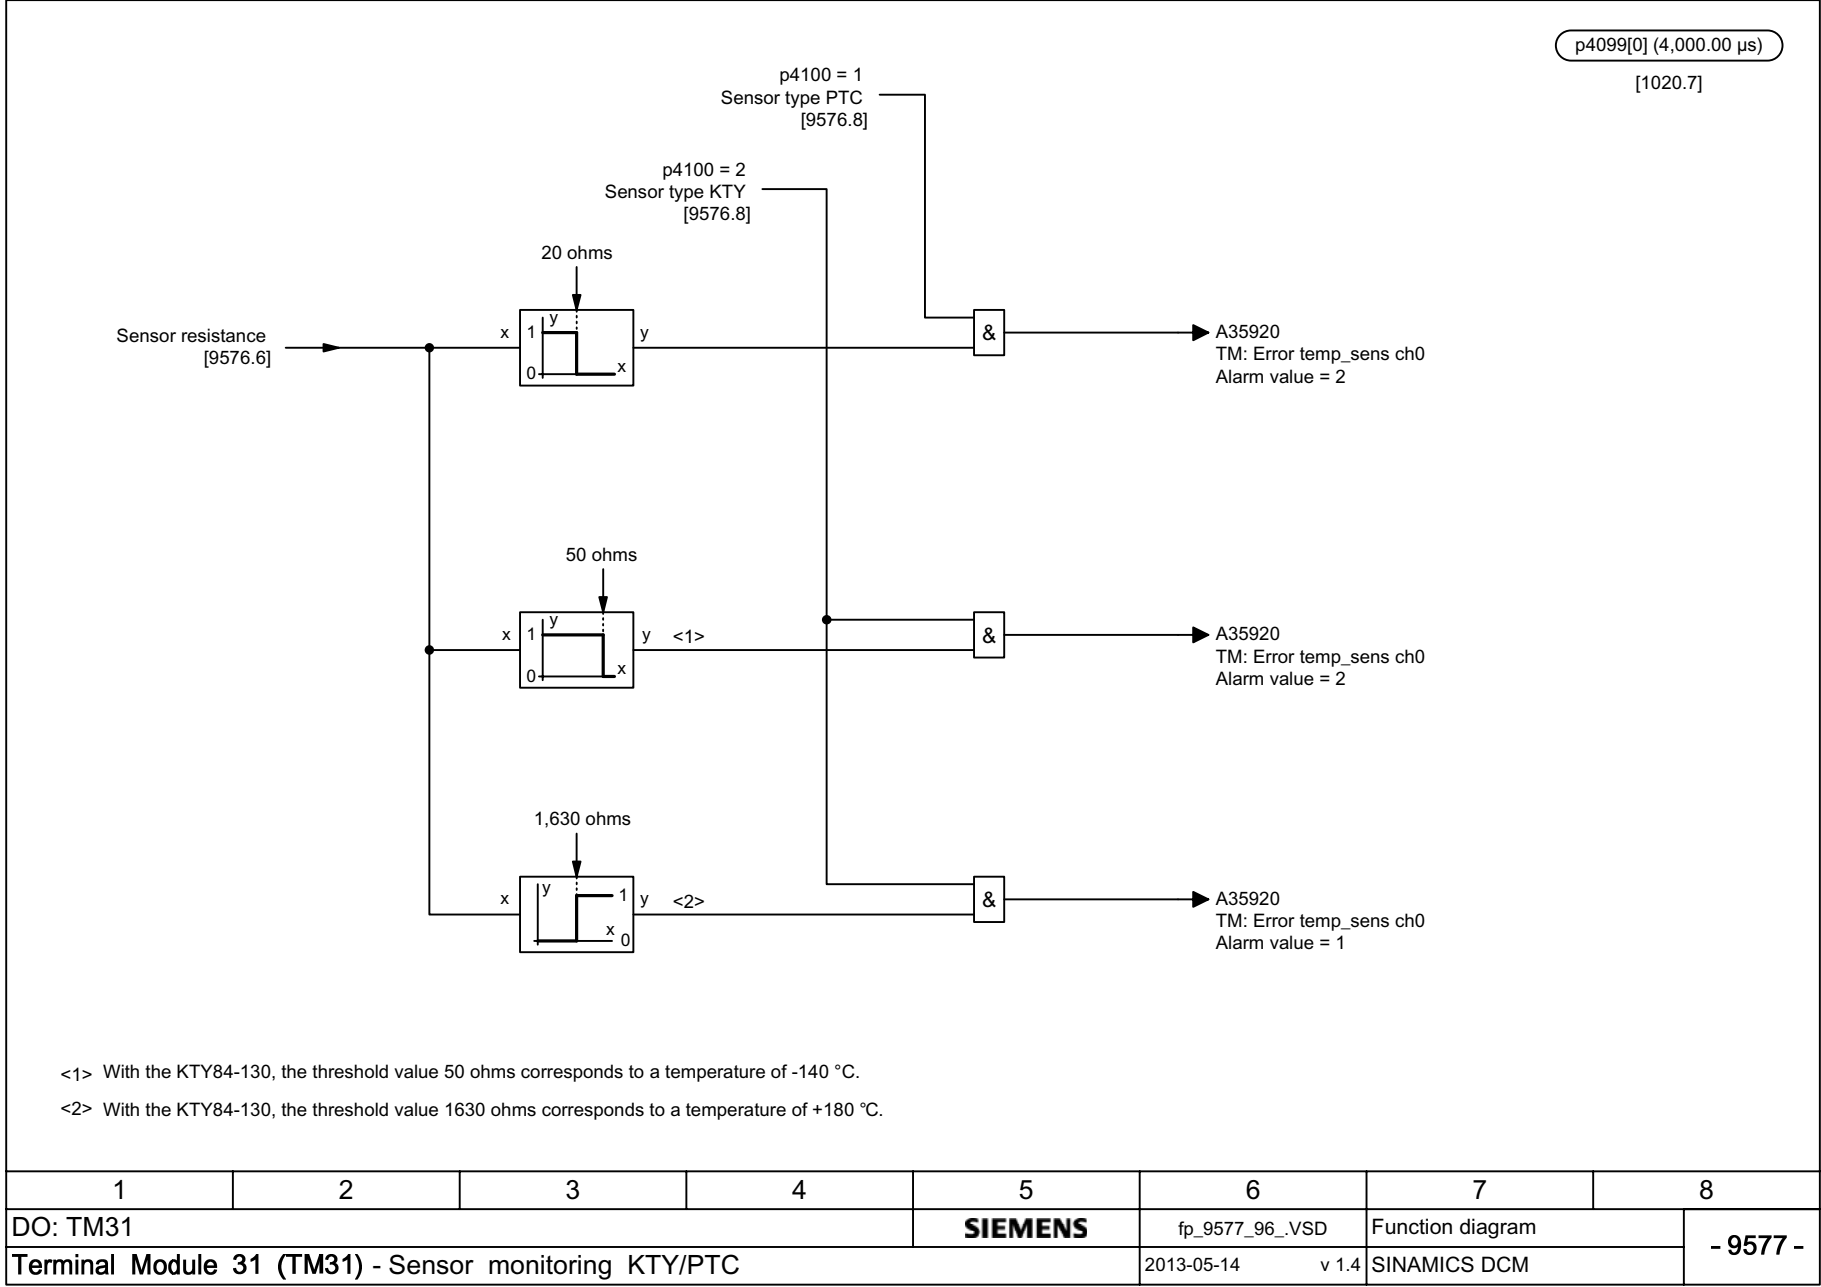


Fig. 2-156 9577 – Sensor monitoring KTY/PTC




## 2.21 Terminal Module 150 (TM150)
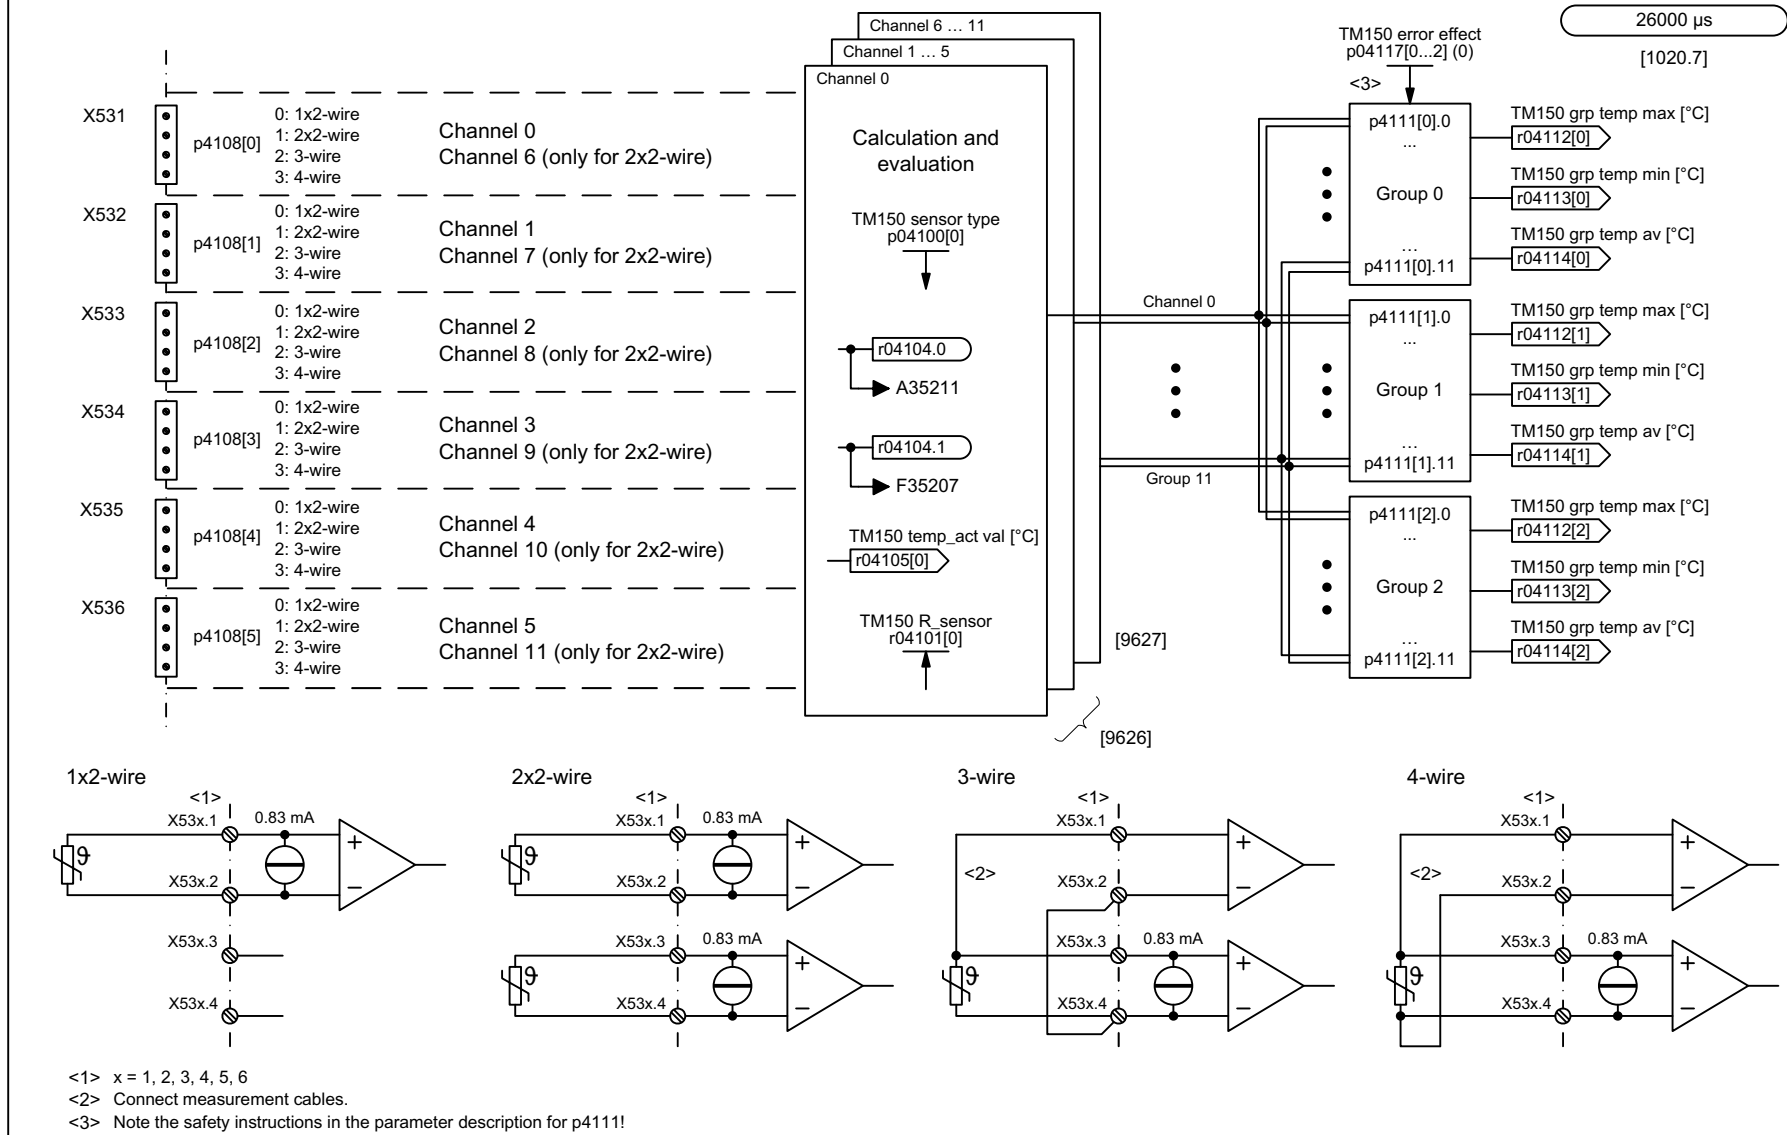
### Function diagrams

---

9625 – Temperature evaluation structure (channels 0 ... 11)	2-842
9626 – Temperature evaluation 1x2, 3, 4-wire (channels 0 ... 5)	2-843
9627 – Temperature evaluation 2x2-wire (channels 0 ... 11)	2-844

---




<1> x = 1, 2, 3, 4, 5, 6  
<2> Connect measurement cables.  
<3> Note the safety instructions in the parameter description for p4111!

1	2	3	4	5	6	7	8
DO: TM150				SIEMENS	fp_9625_96_VSD	Function diagram	
Terminal Module 150 (TM150) - Temperature evaluation structure (channel 0 ... 11)					2013-05-14 v 1.4	SINAMICS DCM	
							- 9625 -

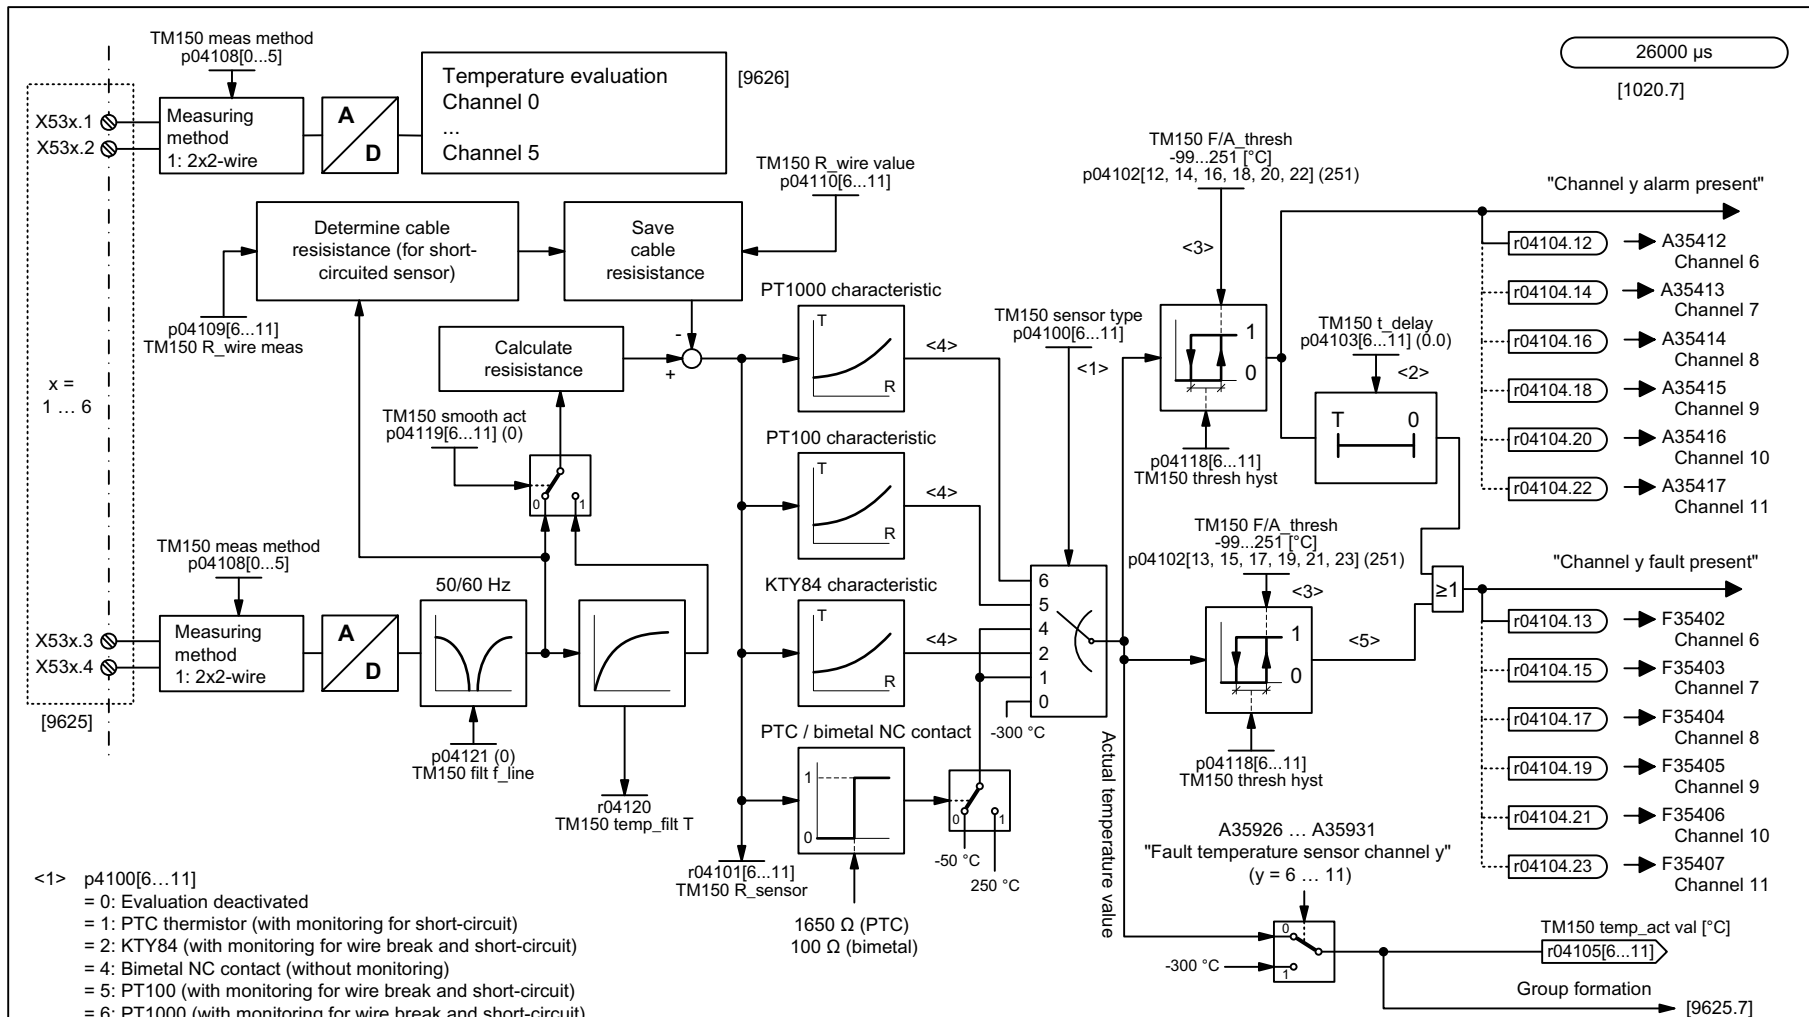Fig. 2-157 9625 – Temperature evaluation structure (channels 0 ... 11)





1	2	3	4	5	6	7	8
DO: TM150				<b>SIEMENS</b>	fp_9627_96_VSD	Function diagram	
Terminal Module 150 (TM150) - Temperature evaluation 2x2-wire (channel 0 ... 11)					2013-05-14 v 1.4	SINAMICS DCM	
							- 9627 -

Fig. 2-159 9627 – Temperature evaluation 2x2-wire (channels 0 ... 11)

## 2.22 Basic Operator Panel 20 (BOP20)

### Function diagrams

---


9912 – Control word interconnection

2-846

---

PROFIdrive sampling time

[1020.7]

Interconnection of STW BOP (r0019)			<1>
Signal	Meaning	Interconnection parameter	
STW BOP.0	1 = ON 0 = OFF (OFF1)	p0840[0] = r0019.0	
STW BOP.1	1 = Do not coast down 0 = Coast down (OFF2)	p0844[0] = r0019.1	
STW BOP.2	1 = No quick stop 0 = Quick stop (OFF3)	p0848[0] = r0019.2	
STW BOP.3	Reserved	-	
STW BOP.4	Reserved	-	
STW BOP.5	Reserved	-	
STW BOP.6	Reserved	-	
STW BOP.7	 = Acknowledge fault	p2102[0] = r0019.7	
STW BOP.8	Reserved	-	
STW BOP.9	Reserved	-	
STW BOP.10	Reserved	-	
STW BOP.11	Reserved	-	
STW BOP.12	Reserved	-	
STW BOP.13	1 = Motorized potentiometer, higher	p1035[0] = r0019.13	
STW BOP.14	1 = Motorized potentiometer, lower	p1036[0] = r0019.14	
STW BOP.15	Reserved	-	

<1> The BICO interconnection is just an example and may be changed by the user.

1	2	3	4	5	6	7	8
DO: CU_DC				<b>SIEMENS</b>	fp_9912_96_.VSD	Function diagram	- 9912 -
Basic Operator Panel (BOP20) - Control word interconnection					2013-05-14 v 1.4	SINAMICS DCM	

Fig. 2-160 9912 – Control word interconnection

# Faults and alarms

# 3

## Content

3.1	Overview of faults and alarms	3-848
3.2	List of faults and alarms	3-857

## 3.1 Overview of faults and alarms

### 3.1.1 General information on faults and alarms

#### Fault/alarm displays

In the case of a fault, the drive signals the corresponding fault(s) and/or alarm(s).

The following methods are available for displaying faults and alarms:

- Display via the fault and alarm buffer for PROFIBUS.
- In online operation, display via the commissioning software.

#### Differences between faults and alarms

The differences between faults and alarms are as follows:

Table 3-1 Differences between faults and alarms

Type	Description
Faults	<p>What happens when a fault occurs?</p> <ul style="list-style-type: none"> <li>• The appropriate fault reaction is triggered.</li> <li>• Status signal ZSW1.3 is set.</li> <li>• The fault is entered into the fault buffer.</li> </ul> <p>How are faults removed?</p> <ul style="list-style-type: none"> <li>• Remove the original cause of the fault.</li> <li>• Acknowledge the fault.</li> </ul>
Alarms	<p>What happens when an alarm occurs?</p> <ul style="list-style-type: none"> <li>• Status signal ZSW1.7 is set.</li> <li>• The alarm is entered into the alarm buffer.</li> </ul> <p>How are alarms removed?</p> <ul style="list-style-type: none"> <li>• Alarms acknowledge themselves. If the cause of the alarm is no longer present, they automatically reset themselves.</li> </ul>



## Fault reactions

The following fault reactions are defined:

Table 3-2 Fault reactions

List	PROFI-drive	Reaction	Description
NONE	-	None	No reaction when a fault occurs
OFF1	ON/ OFF	Brake along the ramp-function generator down ramp followed by pulse disable	<p><b>Closed-loop speed control (p50084 = 1)</b></p> <ul style="list-style-type: none"> <li>• n_set = 0 is input immediately to brake the drive along the ramp-function generator deceleration ramp.</li> <li>• When zero speed is detected, the motor holding brake (if parameterized) is closed. The pulses are suppressed when the closing time (p50088) expires.</li> </ul> <p>Zero speed is detected when the actual speed value falls below the speed threshold (p50370).</p> <p><b>Closed-loop torque control (p50084 = 2)</b></p> <ul style="list-style-type: none"> <li>• The following applies for closed-loop torque control: Reaction as for OFF2</li> </ul>
OFF2	COAST STOP	Internal/external pulse inhibit	<p><b>Closed-loop speed and torque control</b></p> <ul style="list-style-type: none"> <li>• Immediate pulse suppression, the drive "coasts" to a standstill.</li> <li>• Switching on inhibited is activated.</li> </ul>
OFF3	QUICK STOP	Brake along the OFF3 down ramp followed by pulse disable	<p><b>Closed-loop speed control (p50084 = 1)</b></p> <ul style="list-style-type: none"> <li>• n_set = 0 is input immediately to brake the drive along the OFF3 deceleration ramp (p50296).</li> <li>• When zero speed is detected, the motor holding brake (if parameterized) is closed. The pulses are suppressed when the holding brake's closing time (p50088) expires.</li> </ul> <p>Zero speed is detected when the actual speed value falls below the speed threshold (p50370).</p> <ul style="list-style-type: none"> <li>• Switching on inhibited is activated.</li> </ul> <p><b>Closed-loop torque control (p50084 = 2)</b></p> <ul style="list-style-type: none"> <li>• Reaction as for OFF2</li> </ul>
STOP1	-	OFF2	For SINAMICS DCM, these fault reactions have the same effect as for OFF2.
STOP2			
IASC/ DCBRAKE			
ENCODER			

### Acknowledgement of faults

The list of faults and alarms specifies how to acknowledge each fault after the cause has been removed.

Table 3-3 Acknowledgement of faults

Acknowledgment	Description								
POWER ON	<p>The fault is acknowledged by a POWER ON (switch drive unit off and on again).</p> <p><b>Note:</b> If this action has not removed the fault cause, the fault is displayed again immediately after power up.</p>								
IMMEDIATELY	<p>Faults can be acknowledged on one drive object (Points 1 to 3) or on all drive objects (Point 4) as follows:</p> <p>1 Acknowledge by setting parameter: p3981 = 0 --&gt; 1</p> <p>2 Acknowledge via binector inputs:</p> <table border="0"> <tr> <td>p2103</td> <td>BI: 1. Acknowledge faults</td> </tr> <tr> <td>p2104</td> <td>BI: 2. Acknowledge faults</td> </tr> <tr> <td>p2105</td> <td>BI: 3. Acknowledge faults</td> </tr> </table> <p>3 Acknowledge using a PROFIBUS control signal: STW1.7 = 0 --&gt; 1 (edge)</p> <p>4 Acknowledge all faults</p> <table border="0"> <tr> <td>p2102</td> <td>BI: Acknowledge all faults</td> </tr> </table> <p>All of the faults on all of the drive objects of the drive system can be acknowledged using this binector input.</p> <p><b>Note:</b></p> <ul style="list-style-type: none"> <li>• These faults can also be acknowledged by a POWER ON.</li> <li>• If the cause of the fault has not been removed, then the fault will continue to be displayed after acknowledgment.</li> </ul>	p2103	BI: 1. Acknowledge faults	p2104	BI: 2. Acknowledge faults	p2105	BI: 3. Acknowledge faults	p2102	BI: Acknowledge all faults
p2103	BI: 1. Acknowledge faults								
p2104	BI: 2. Acknowledge faults								
p2105	BI: 3. Acknowledge faults								
p2102	BI: Acknowledge all faults								
PULSE INHIBIT	<p>The fault can only be acknowledged when the pulses are inhibited (r0899.11 = 0). The same options are available for acknowledging as described under acknowledge IMMEDIATELY.</p>								

**Saving the fault buffer when switching off**

The contents of the fault buffer are saved to the non-volatile memory when the Control Unit is switched off, i.e. the fault buffer history is still available when the unit is switched on again.

The fault buffer of a drive object comprises the following parameters:

- r0945[0...63], r0947[0...63], r0948[0...63], r0949[0...63]
- r2109[0...63], r2130[0...63], r2133[0...63], r2136[0...63]

The fault buffer contents can be deleted manually as follows:

- Delete fault buffer for all drive objects:  
p2147 = 1 --> p2147 = 0 is automatically set after execution.
- Delete fault buffer for a specific drive object:  
p0952 = 0 --> The parameter belongs to the specified drive object.

The fault buffer contents are automatically deleted when the following occurs:

- Restore factory setting (p0009 = 30 and p0976 = 1).
- Download with modified structure (e.g. number of drive objects changed).
- Power-up after other parameter values have been loaded (e.g. p0976 = 10).
- Upgrade firmware to later version.

### 3.1.2 Explanation of the list of faults and alarms

The data in the following example have been chosen at random. The information listed below is the maximum amount of information that a description can contain. Some of the information is optional.

The list of faults and alarms (See Chapter 3.2) is structured as follows:

----- <b>Start of the example</b> -----	
<b>Axxxxx (F, N)</b>	<b>Fault location (optional): Name</b>
<b>Message value:</b>	Component number: %1, fault cause: %2
<b>Drive object:</b>	List of objects.
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	Description of possible causes. Fault value (r0949, interpret format): or alarm value (r2124, interpret format): (optional) Information about fault or alarm values (optional).
<b>Remedy:</b>	Description of possible remedies.
Reaction upon F:	NONE (OFF1, OFF2, OFF3)
Acknowl. upon F:	IMMEDIATELY (POWER ON)
Reaction upon N:	NONE
Acknowl. upon N:	NONE
----- <b>End of the example</b> -----	

<b>Axxxxx</b>	<b>Alarm xxxxx</b>
<b>Axxxxx (F, N)</b>	<b>Alarm xxxxx (message type can be changed in F or N)</b>
<b>Fxxxxx</b>	<b>Fault xxxxx</b>
<b>Fxxxxx (A, N)</b>	<b>Fault xxxxx (message type can be changed in A or N)</b>
<b>Nxxxxx</b>	<b>No message</b>
<b>Nxxxxx (A)</b>	<b>No message (message type can be changed in A)</b>

A message comprises a letter followed by the relevant number.

The meaning of the letters is as follows:

- A means "Alarm"
- F means "Fault"
- N means "No message" or "Internal message" (or "No report")

The optional brackets indicate whether the type specified for this message can be changed and which message types can be adjusted via parameter (p2118, p2119).

Information about reaction and acknowledgement is specified independently for a message with adjustable message type (e.g. reaction to F, acknowledgement for F).

---

**Note:**

You can change the default properties of a fault or alarm by setting parameters.

References: SINAMICS DC MASTER operating instructions

The list of faults and alarms (see Chapter 3.2) provides information referred to the properties of a message that have been set as standard. If the properties of a specific message are changed, the corresponding information may have to be modified in this list.

---

**Fault location (optional): Name**

The fault location (optional), the name of the fault or alarm and the message number are all used to identify the message (e.g. with the commissioning software).

**Message value:**

The information provided under the message value tells you about the composition of the fault/alarm value.

**Example:**

Message value: Component number: %1, fault cause: %2

This message value contains information about the component number and cause of the fault. The entries %1 and %2 are placeholders, which are filled appropriately in online operation (e.g. with the commissioning software).

**Drive object:**

Each message (fault/alarm) specifies the drive object in which it can be found.

A message can belong to either one, several, or all drive objects.

**Reaction: Default fault reaction (adjustable fault reaction)**

Specifies the default reaction in the event of a fault.

The optional parentheses indicate whether the default fault reactions can be changed and which fault reactions can be adjusted via parameters (p2100, p2101).

**Note:**

See Chapter 3.1.1

**Acknowledgment: Default acknowledgment (adjustable acknowledgment)**

Specifies the default method of acknowledging faults after the cause has been eliminated.

The optional parentheses indicate whether the default acknowledgement can be changed and which acknowledgement can be adjusted via parameters (p2126, p2127).

**Note:**

See Chapter 3.1.1

**Cause:**

Description of the possible causes of the fault/alarm. A fault or alarm value can also be specified (optional).

Fault value (r0949, format):

The fault value is entered into the fault buffer in r0949[0...63] and specifies additional, more precise information about a fault.

Alarm value (r2124, format):

The alarm value specifies additional, more precise information about an alarm.

The alarm value is entered in the alarm buffer in r2124[0...7] and specifies additional, more precise information about an alarm.

**Remedy:**

Description of the methods available for removing the cause of the active fault or alarm.



**Alarm**

In certain cases, servicing and maintenance personnel are responsible for choosing a suitable method to remove the fault cause.

---

### 3.1.3 Number ranges of faults and alarms

**Note:**

The following number ranges represent an overview of all faults and alarms associated with the SINAMICS drive range.

The faults and alarms for the product described in this List Manual are described in detail in Chapter 3.2.

Faults and alarms are organized into the following number ranges:

Table 3-4 Number ranges of faults and alarms

from	to	Range
1000	3999	Control Unit, closed-loop control
4000	4999	Reserved
5000	5999	Power unit
6000	6899	Infeed
6900	6999	Braking Module
7000	7999	Drive
8000	8999	Option Board
9000	12999	Reserved
13000	13020	Licensing
13021	13099	Reserved
13100	13102	Know-how protection
13103	19999	Reserved
20000	29999	OEM
30000	30999	DRIVE-CLiQ component power unit
31000	31999	DRIVE-CLiQ component encoder 1
32000	32999	DRIVE-CLiQ component encoder 2 <b>Note</b> Faults that occur are automatically output as an alarm if the encoder is parameterized as a direct measuring system and does not intervene in the motor control.
33000	33999	DRIVE-CLiQ component encoder 3 <b>Note</b> Faults that occur are automatically output as an alarm if the encoder is parameterized as a direct measuring system and does not intervene in the motor control.
34000	34999	Voltage Sensing Module (VSM)
35000	35199	Terminal Module 54F (TM54F)

Table 3-4 Number ranges of faults and alarms, continued

from	to	Range
35200	35999	Terminal Module 31 (TM31)
36000	36999	DRIVE-CLiQ Hub Module
37000	37999	HF Damping Module
40000	40999	Controller Extension 32 (CX32)
41000	48999	Reserved
49000	49999	SINAMICS GM/SM/GL
50000	50499	Communication Board (COMM BOARD)
50500	59999	OEM Siemens
60000	65535	SINAMICS DC MASTER (DC closed-loop control)



## 3.2 List of faults and alarms

Product: SINAMICS DC MASTER, Version: 4601800, Language: eng  
Objects: CU\_DC, CU\_DC\_R, CU\_DC\_R\_S, CU\_DC\_S, DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
Product: SINAMICS DC MASTER OA, Version: 1400800, Language: eng  
Objects: DC\_CTRL

---

### **F01000 Internal software error**

**Message value:** Module: %1, line: %2  
**Drive object:** All objects  
**Reaction:** OFF2  
**Acknowledge:** POWER ON  
**Cause:** An internal software error has occurred.  
Fault value (r0949, interpret hexadecimal):  
Only for internal Siemens troubleshooting.  
**Remedy:**

- evaluate fault buffer (r0945).
- carry out a POWER ON (power off/on) for all components.
- if required, check the data on the non-volatile memory (e.g. memory card).
- upgrade firmware to later version.
- contact the Hotline.
- replace the Control Unit.

---

### **F01001 FloatingPoint exception**

**Message value:** %1  
**Drive object:** All objects  
**Reaction:** OFF2  
**Acknowledge:** POWER ON  
**Cause:** An exception occurred during an operation with the FloatingPoint data type.  
The error may be caused by the basic system or an OA application (e.g., FBLOCKS, DCC).  
Fault value (r0949, interpret hexadecimal):  
Only for internal Siemens troubleshooting.  
Note:  
Refer to r9999 for further information about this fault.  
r9999[0]: Fault number.  
r9999[1]: Program counter at the time when the exception occurred.  
r9999[2]: Cause of the FloatingPoint exception.  
Bit 0 = 1: Operation invalid  
Bit 1 = 1: Division by zero  
Bit 2 = 1: Overflow  
Bit 3 = 1: Underflow  
Bit 4 = 1: Inaccurate result  
**Remedy:**

- carry out a POWER ON (power off/on) for all components.
- check configuration and signals of the blocks in FBLOCKS.
- check configuration and signals of DCC charts.
- upgrade firmware to later version.
- contact the Hotline.

---

### **F01002 Internal software error**

**Message value:** %1  
**Drive object:** All objects  
**Reaction:** OFF2  
**Acknowledge:** IMMEDIATELY  
**Cause:** An internal software error has occurred.  
Fault value (r0949, interpret hexadecimal):  
Only for internal Siemens troubleshooting.  
**Remedy:**

- carry out a POWER ON (power off/on) for all components.
- upgrade firmware to later version.
- contact the Hotline.

<b>F01003</b>	<b>Acknowledgement delay when accessing the memory</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	A memory area was accessed that does not return a "READY". Fault value (r0949, interpret hexadecimal): Only for internal Siemens troubleshooting.
<b>Remedy:</b>	- carry out a POWER ON (power off/on) for all components. - contact the Hotline.
<b>N01004 (F, A)</b>	<b>Internal software error</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	An internal software error has occurred. Fault value (r0949, hexadecimal): Only for internal Siemens troubleshooting.
<b>Remedy:</b>	- read out diagnostics parameter (r9999). - contact the Hotline. See also: r9999 (Software error internal supplementary diagnostics)
Reaction upon F:	OFF2
Acknowl. upon F:	POWER ON
Reaction upon A:	NONE
Acknowl. upon A:	NONE
<b>F01005</b>	<b>Firmware download for DRIVE-CLiQ component unsuccessful</b>
<b>Message value:</b>	Component number: %1, fault cause: %2
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	It was not possible to download the firmware to a DRIVE-CLiQ component. Fault value (r0949, interpret hexadecimal): yyxxxx hex: yy = component number, xxxx = fault cause xxxx = 000B hex = 11 dec: DRIVE-CLiQ component has detected a checksum error. xxxx = 000F hex = 15 dec: The selected DRIVE-CLiQ component did not accept the contents of the firmware file. xxxx = 0012 hex = 18 dec: Firmware version is too old and is not accepted by the component. xxxx = 0013 hex = 19 dec: Firmware version is not suitable for the hardware release of the component. xxxx = 0065 hex = 101 dec: After several communication attempts, no response from the DRIVE-CLiQ component. xxxx = 008B hex = 139 dec: Initially, a new boot loader is loaded (must be repeated after POWER ON). xxxx = 008C hex = 140 dec: Firmware file for the DRIVE-CLiQ component not available on the memory card. xxxx = 008D hex = 141 dec: An inconsistent length of the firmware file was signaled. The firmware download may have been caused by a loss of connection to the firmware file. This can occur during a project download/reset in the case of a SINAMICS Integrated Control Unit, for example. xxxx = 008F hex = 143 dec: Component has not changed to the mode for firmware download. It was not possible to delete the existing firmware. xxxx = 0090 hex = 144 dec: When checking the firmware that was downloaded (checksum), the component detected a fault. It is possible that the file on the memory card is defective.

xxxx = 0091 hex = 145 dec:  
Checking the loaded firmware (checksum) was not completed by the component in the appropriate time.  
xxxx = 009C hex = 156 dec:  
Component with the specified component number is not available (p7828).  
xxxx = Additional values:  
Only for internal Siemens troubleshooting.

**Remedy:**

- check the selected component number (p7828).
- check the DRIVE-CLiQ connection.
- save suitable firmware file for download in the directory "/siemens/sinamics/code/sac/".
- use a component with a suitable hardware version
- after POWER ON has been carried out again for the DRIVE-CLiQ component, download the firmware again.

Depending on p7826, the firmware will be automatically downloaded.

---

**A01006      Firmware update for DRIVE-CLiQ component required**

**Message value:** Component number: %1

**Drive object:** All objects

**Reaction:** NONE

**Acknowledge:** NONE

**Cause:** The firmware of a DRIVE-CLiQ component must be updated as there is no suitable firmware or firmware version in the component for operation with the Control Unit.  
Alarm value (r2124, interpret decimal):  
Component number of the DRIVE-CLiQ component.

**Remedy:** Firmware update using the commissioning software:  
The firmware version of all of the components on the "Version overview" page can be read in the Project Navigator under "Configuration" of the associated drive unit and an appropriate firmware update can be carried out.  
Firmware update via parameter:  

- take the component number from the alarm value and enter into p7828.
- start the firmware download with p7829 = 1.

---

**A01007      POWER ON for DRIVE-CLiQ component required**

**Message value:** Component number: %1

**Drive object:** All objects

**Reaction:** NONE

**Acknowledge:** NONE

**Cause:** A DRIVE-CLiQ component must be powered up again (POWER ON) (e.g. due to a firmware update).  
Alarm value (r2124, interpret decimal):  
Component number of the DRIVE-CLiQ component.  
Note:

For a component number = 1, a POWER ON of the Control Unit is required.

**Remedy:**

- Switch off the power supply of the specified DRIVE-CLiQ component and switch it on again.
- For SINUMERIK, auto commissioning is prevented. In this case, a POWER ON is required for all components and the auto commissioning must be restarted.

---

**F01010      Drive type unknown**

**Message value:** %1

**Drive object:** All objects

**Reaction:** NONE

**Acknowledge:** IMMEDIATELY

**Cause:** An unknown drive type was found.  
Fault value (r0949, interpret decimal):  
Drive object number (refer to p0101, p0107).

**Remedy:**

- replace Power Module.
- carry out a POWER ON (power off/on) for all components.
- upgrade firmware to later version.
- contact the Hotline.

<b>F01011 (N)</b>	<b>Download interrupted</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>The project download was interrupted.</p> <p>Fault value (r0949, interpret decimal):</p> <p>1: The user prematurely interrupted the project download.</p> <p>2: The communication cable was interrupted (e.g. cable breakage, cable withdrawn).</p> <p>3: The project download was prematurely ended by the commissioning software (e.g. STARTER, SCOUT).</p> <p>100: Different versions between the firmware version and project files which were loaded by loading into the file system "Download from memory card".</p> <p>Note:</p> <p>The response to an interrupted download is the state "first commissioning".</p>
<b>Remedy:</b>	<ul style="list-style-type: none"> <li>- check the communication cable.</li> <li>- download the project again.</li> <li>- boot from previously saved files (power-down/power-up or p0976).</li> <li>- when loading into the file system (download from memory card), use the matching version.</li> </ul>
Reaction upon N:	NONE
Acknowl. upon N:	NONE
<b>F01015</b>	<b>Internal software error</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	POWER ON
<b>Cause:</b>	<p>An internal software error has occurred.</p> <p>Fault value (r0949, interpret decimal):</p> <p>Only for internal Siemens troubleshooting.</p>
<b>Remedy:</b>	<ul style="list-style-type: none"> <li>- carry out a POWER ON (power off/on) for all components.</li> <li>- upgrade firmware to later version.</li> <li>- contact the Hotline.</li> </ul>
<b>A01016 (F)</b>	<b>Firmware changed</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>At least one firmware file in the directory was illegally changed on the non-volatile memory (memory card/device memory) with respect to the version when shipped from the factory.</p> <p>Alarm value (r2124, interpret decimal):</p> <p>0: Checksum of one file is incorrect.</p> <p>1: File missing.</p> <p>2: Too many files.</p> <p>3: Incorrect firmware version.</p> <p>4: Incorrect checksum of the back-up file.</p>
<b>Remedy:</b>	<p>For the non-volatile memory for the firmware (memory card/device memory), restore the delivery condition.</p> <p>Note:</p> <p>The file involved can be read out using parameter r9925.</p> <p>The status of the firmware check is displayed using r9926.</p> <p>See also: r9925 (Firmware file incorrect), r9926 (Firmware check status)</p>
Reaction upon F:	OFF2
Acknowl. upon F:	POWER ON

---

<b>A01017</b>	<b>Component lists changed</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>On the memory card, one file in the directory /SIEMENS/SINAMICS/DATA or /ADDON/SINAMICS/DATA has been illegally changed with respect to that supplied from the factory. No changes are permitted in this directory.</p> <p>Alarm value (r2124, interpret decimal):</p> <p>zyx dec: x = Problem, y = Directory, z = File name</p> <p>x = 1: File does not exist.</p> <p>x = 2: Firmware version of the file does not match the software version.</p> <p>x = 3: File checksum is incorrect.</p> <p>y = 0: Directory /SIEMENS/SINAMICS/DATA/</p> <p>y = 1: Directory /ADDON/SINAMICS/DATA/</p> <p>z = 0: File MOTARM.ACX</p> <p>z = 1: File MOTSRM.ACX</p> <p>z = 2: File MOTSLM.ACX</p> <p>z = 3: File ENCDATA.ACX</p> <p>z = 4: File FILTDATA.ACX</p> <p>z = 5: File BRKDATA.ACX</p> <p>z = 6: File DAT_BEAR.ACX</p> <p>z = 7: File CFG_BEAR.ACX</p> <p>z = 8: File ENC_GEAR.ACX</p>
<b>Remedy:</b>	For the file on the memory card involved, restore the status originally supplied from the factory.

---

<b>F01018</b>	<b>Bootling has been interrupted several times</b>
<b>Message value:</b>	-
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	POWER ON
<b>Cause:</b>	<p>Module bootling was interrupted several times. As a consequence, the module boots with the factory setting.</p> <p>Possible reasons for bootling being interrupted:</p> <ul style="list-style-type: none"><li>- power supply interrupted.</li><li>- CPU crashed.</li><li>- parameterization invalid.</li></ul>
<b>Remedy:</b>	<ul style="list-style-type: none"><li>- carry out a POWER ON (power off/on). After switching on, the module reboots from the valid parameterization (if available).</li><li>- restore the valid parameterization.</li></ul> <p>Examples:</p> <ul style="list-style-type: none"><li>a) Carry out a first commissioning, save, carry out a POWER ON (switch-off/switch-on).</li><li>b) Load another valid parameter backup (e.g. from the memory card), save, carry out a POWER ON (switch-off/switch-on).</li></ul> <p>Note:</p> <p>If the fault situation is repeated, then this fault is again output after several interrupted boots.</p>

---

<b>A01019</b>	<b>Writing to the removable data medium unsuccessful</b>
<b>Message value:</b>	-
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	The write access to the removable data medium was unsuccessful.
<b>Remedy:</b>	Remove and check the removable data medium. Then run the data backup again.

<b>A01020</b>	<b>Writing to RAM disk unsuccessful</b>
<b>Message value:</b>	-
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	A write access to the internal RAM disk was unsuccessful.
<b>Remedy:</b>	Adapt the file size for the system logbook to the internal RAM disk (p9930). See also: p9930 (System logbook activation)
<b>F01023</b>	<b>Software timeout (internal)</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	An internal software timeout has occurred. Fault value (r0949, interpret decimal): Only for internal Siemens troubleshooting.
<b>Remedy:</b>	- carry out a POWER ON (power off/on) for all components. - upgrade firmware to later version. - contact the Hotline.
<b>F01030</b>	<b>Sign-of-life failure for master control</b>
<b>Message value:</b>	-
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF3 (IASC/DCBRK, NONE, OFF1, OFF2, STOP1, STOP2)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	For active PC master control, no sign-of-life was received within the monitoring time. The master control was returned to the active BICO interconnection.
<b>Remedy:</b>	Set the monitoring time higher at the PC or, if required, completely disable the monitoring function. For the commissioning software, the monitoring time is set as follows: <Drive> -> Commissioning -> Control panel -> Button "Fetch master control" -> A window is displayed to set the monitoring time in milliseconds. Notice: The monitoring time should be set as short as possible. A long monitoring time means a late response when the communication fails!
<b>F01031</b>	<b>Sign-of-life failure for OFF in REMOTE</b>
<b>Message value:</b>	-
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF3 (IASC/DCBRK, NONE, OFF1, OFF2, STOP1, STOP2)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	With the "OFF in REMOTE" mode active, no sign-of-life was received within 3 seconds.
<b>Remedy:</b>	- Check the data cable connection at the serial interface for the Control Unit (CU) and operator panel. - Check the data cable between the Control Unit and operator panel.
<b>A01032 (F)</b>	<b>ACX: all parameters must be saved</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	The parameters of an individual drive object were saved (p0971 = 1), although there is still no backup of all drive system parameters. The saved object-specific parameters are not loaded the next time that the system powers up. For the system to successfully power up, all of the parameters must have been completely backed up.

Alarm value (r2124, interpret decimal):  
Only for internal Siemens troubleshooting.  
See also: p0971 (Save drive object parameters)  
**Remedy:** Save all parameters (p0977 = 1 or "copy RAM to ROM").  
See also: p0977 (Save all parameters)  
Reaction upon F: NONE (OFF1, OFF2, OFF3)  
Acknowl. upon F: IMMEDIATELY

---

**F01033      Units changeover: Reference parameter value invalid**

**Message value:** Parameter: %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** NONE  
**Acknowledge:** IMMEDIATELY  
**Cause:** When changing over the units to the referred representation type, it is not permissible for any of the required reference parameters to be equal to 0.0  
Fault value (r0949, parameter):  
Reference parameter whose value is 0.0.  
See also: p0595 (Technological unit selection)  
**Remedy:** Set the value of the reference parameter to a number different than 0.0.  
See also: p0596 (Technological unit reference quantity), p2000 (Reference speed), p2001 (Reference voltage), p2002 (Reference current), p2003 (Reference torque), r2004 (Reference power)

---

**F01034      Units changeover: Calculation parameter values after reference value change unsuccessful**

**Message value:** Parameter: %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** NONE  
**Acknowledge:** IMMEDIATELY  
**Cause:** The change of a reference parameter meant that for an involved parameter the selected value was not able to be re-calculated in the per unit representation. The change was rejected and the original parameter value restored.  
Fault value (r0949, parameter):  
Parameter whose value was not able to be re-calculated.  
See also: p0596 (Technological unit reference quantity), p2000 (Reference speed), p2001 (Reference voltage), p2002 (Reference current), p2003 (Reference torque), r2004 (Reference power)  
**Remedy:** Select the value of the reference parameter such that the parameter involved can be calculated in the per unit representation.  
See also: p0596 (Technological unit reference quantity), p2000 (Reference speed), p2001 (Reference voltage), p2002 (Reference current), p2003 (Reference torque), r2004 (Reference power)

---

**A01035 (F)      ACX: Parameter back-up file corrupted**

**Message value:** %1  
**Drive object:** All objects  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** When the Control Unit is booted, no complete data set was found from the parameter back-up files. The last time that the parameterization was saved, it was not completely carried out.  
It is possible that the backup was interrupted by switching off or withdrawing the memory card.  
Alarm value (r2124, interpret hexadecimal):  
ddccbbaa hex:  
aa = 01 hex:  
Power up was realized without data backup. The drive is in the factory setting.  
aa = 02 hex:  
The last available backup data record was loaded. The parameterization must be checked. It is recommended that the parameterization is downloaded again.  
dd, cc, bb:  
Only for internal Siemens troubleshooting.  
See also: p0971 (Save drive object parameters), p0977 (Save all parameters)

**Remedy:** - Download the project again with the commissioning software.  
- save all parameters (p0977 = 1 or "copy RAM to ROM").  
See also: p0977 (Save all parameters)

Reaction upon F: NONE (OFF1, OFF2, OFF3)

Acknowled. upon F: IMMEDIATELY

---

**F01036 (A) ACX: Parameter back-up file missing**

**Message value:** %1

**Drive object:** All objects

**Reaction:** NONE (OFF1, OFF2, OFF3)

**Acknowledge:** IMMEDIATELY

**Cause:** When downloading the device parameterization, a parameter back-up file PSxxxxxy.ACX associated with a drive object cannot be found.  
Fault value (r0949, interpret hexadecimal):  
Byte 1: yyy in the file name PSxxxxxy.ACX  
yyy = 000 --> consistency back-up file  
yyy = 001 ... 062 --> drive object number  
yyy = 099 --> PROFIBUS parameter back-up file  
Byte 2, 3, 4:  
Only for internal Siemens troubleshooting.

**Remedy:** If you have saved the project data using the commissioning software, carry out a new download for your project.  
Save using the function "Copy RAM to ROM" or with p0977 = 1  
This means that the parameter files are again completely written into the non-volatile memory.  
Note:  
If the project data have not been backed up, then a new first commissioning is required.

Reaction upon A: NONE

Acknowled. upon A: NONE

---

**F01038 (A) ACX: Loading the parameter back-up file unsuccessful**

**Message value:** %1

**Drive object:** All objects

**Reaction:** NONE (OFF1, OFF2, OFF3)

**Acknowledge:** IMMEDIATELY

**Cause:** An error has occurred when downloading PSxxxxxy.ACX or PTxxxxxy.ACX files from the non-volatile memory.  
Fault value (r0949, interpret hexadecimal):  
Byte 1: yyy in the file name PSxxxxxy.ACX  
yyy = 000 --> consistency back-up file  
yyy = 001 ... 062 --> drive object number  
yyy = 099 --> PROFIBUS parameter back-up file  
Byte 2:  
255: Incorrect drive object type.  
254: Topology comparison unsuccessful -> drive object type was not able to be identified.  
Reasons could be:  
- Incorrect component type in the actual topology  
- Component does not exist in the actual topology.  
- Component not active.  
Additional values:  
Only for internal Siemens troubleshooting.  
Byte 4, 3:  
Only for internal Siemens troubleshooting.

**Remedy:** - If you have saved the project data using the commissioning software, download the project again. Save using the function "Copy RAM to ROM" or with p0977 = 1 so that all of the parameter files are again completely written to the non-volatile memory.  
- replace the memory card or Control Unit.  
Re byte 2 = 255:  
- Correct the drive object type (see p0107).

Reaction upon A: NONE

Acknowled. upon A: NONE



<b>F01039 (A)</b>	<b>ACX: Writing to the parameter back-up file was unsuccessful</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE (OFF1, OFF2, OFF3)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	Writing to at least one parameter back-up file PSxxxxxyy.*** in the non-volatile memory was unsuccessful. - In the directory /USER/SINAMICS/DATA/ at least one parameter back-up file PSxxxxxyy.*** has the "read only" file attribute and cannot be overwritten. - There is not sufficient free memory space available. - The non-volatile memory is defective and cannot be written to. Fault value (r0949, interpret hexadecimal): dcba hex a = yyy in the file names PSxxxxxyy.*** a = 000 --> consistency back-up file a = 001 ... 062 --> drive object number a = 070 --> FEPROM.BIN a = 080 --> DEL4BOOT.TXT a = 099 --> PROFIBUS parameter back-up file b = xxx in the file names PSxxxxxyy.*** b = 000 --> data save started with p0977 = 1 or p0971 = 1 b = 010 --> data save started with p0977 = 10 b = 011 --> data save started with p0977 = 11 b = 012 --> data save started with p0977 = 12 d, c: Only for internal Siemens troubleshooting.
<b>Remedy:</b>	- check the file attribute of the files (PSxxxxxyy.***, CAxxxxxyy.***, CCxxxxxyy.***) and, if required, change from "read only" to "writeable". - check the free memory space in the non-volatile memory. Approx. 80 kbyte of free memory space is required for every drive object in the system. - replace the memory card or Control Unit.
Reaction upon A:	NONE
Acknowled. upon A:	NONE
<b>F01040</b>	<b>Save parameter settings and carry out a POWER ON</b>
<b>Message value:</b>	-
<b>Drive object:</b>	All objects
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	POWER ON
<b>Cause:</b>	A parameter was changed in the drive system which means that it is necessary to save the parameters and re-boot.
<b>Remedy:</b>	- save the parameters (p0971/p0977). - carry out a POWER ON (power off/on) for all components. Then: - upload the drive unit (commissioning software).
<b>F01041</b>	<b>Parameter save necessary</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	Defective or missing files were detected on the memory card when booting. Fault value (r0949, interpret decimal): 1: Source file cannot be opened. 2: Source file cannot be read. 3: Target directory cannot be set up. 4: Target file cannot be set up/opened. 5: Target file cannot be written to. Additional values: Only for internal Siemens troubleshooting.

- Remedy:**
- save the parameters.
  - download the project again to the drive unit.
  - update the firmware
  - if required, replace the Control Unit and/or memory card card.

---

**F01042 Parameter error during project download**

**Message value:** Parameter: %1, Index: %2, fault cause: %3

**Drive object:** All objects

**Reaction:** OFF2 (NONE, OFF1, OFF3)

**Acknowledge:** IMMEDIATELY

**Cause:** An error was detected when downloading a project using the commissioning software (e.g. incorrect parameter value).  
For the specified parameter, it was detected that dynamic limits were exceeded that may possibly depend on other parameters.  
Fault value (r0949, interpret hexadecimal):  
ccbbaaaa hex  
aaaa = Parameter  
bb = Index  
cc = fault cause  
0: Parameter number illegal.  
1: Parameter value cannot be changed.  
2: Lower or upper value limit exceeded.  
3: Sub-index incorrect.  
4: No array, no sub-index.  
5: Data type incorrect.  
6: Setting not permitted (only resetting).  
7: Descriptive element cannot be changed.  
9: Descriptive data not available.  
11: No master control.  
15: No text array available.  
17: Task cannot be executed due to operating state.  
20: Illegal value.  
21: Response too long.  
22: Parameter address illegal.  
23: Format illegal.  
24: Number of values not consistent.  
25: Drive object does not exist.  
101: Presently de-activated.  
104: Illegal value.  
107: Write access not permitted when controller enabled.  
108: Unit unknown.  
109: Write access only in the commissioning state, encoder (p0010 = 4).  
110: Write access only in the commissioning state, motor (p0010 = 3).  
111: Write access only in the commissioning state, power unit (p0010 = 2).  
112: Write access only in the quick commissioning mode (p0010 = 1).  
113: Write access only in the ready mode (p0010 = 0).  
114: Write access only in the commissioning state, parameter reset (p0010 = 30).  
115: Write access only in the Safety Integrated commissioning state (p0010 = 95).  
116: Write access only in the commissioning state, technological application/units (p0010 = 5).  
117: Write access only in the commissioning state (p0010 not equal to 0).  
118: Write access only in the commissioning state, download (p0010 = 29).  
119: Parameter may not be written in download.  
120: Write access only in the commissioning state, drive basic configuration (device: p0009 = 3).  
121: Write access only in the commissioning state, define drive type (device: p0009 = 2).  
122: Write access only in the commissioning state, data set basic configuration (device: p0009 = 4).  
123: Write access only in the commissioning state, device configuration (device: p0009 = 1).  
124: Write access only in the commissioning state, device download (device: p0009 = 29).  
125: Write access only in the commissioning state, device parameter reset (device: p0009 = 30).  
126: Write access only in the commissioning state, device ready (device: p0009 = 0).  
127: Write access only in the commissioning state, device (device: p0009 not equal to 0).  
129: Parameter may not be written in download.  
130: Transfer of the master control is inhibited via binector input p0806.

131: Required BICO interconnection not possible because BICO output does not supply floating value  
 132: Free BICO interconnection inhibited via p0922.  
 133: Access method not defined.  
 200: Below the valid values.  
 201: Above the valid values.  
 202: Cannot be accessed from the Basic Operator Panel (BOP).  
 203: Cannot be read from the Basic Operator Panel (BOP).  
 204: Write access not permitted.

**Remedy:**

- enter the correct value in the specified parameter.
- identify the parameter that restricts the limits of the specified parameter.

---

**F01043 Fatal error at project download**

**Message value:** Fault cause: %1

**Drive object:** All objects

**Reaction:** OFF2 (OFF1, OFF3)

**Acknowledge:** IMMEDIATELY

**Cause:** A fatal error was detected when downloading a project using the commissioning software.  
 Fault value (r0949, interpret decimal):  
 1: Device status cannot be changed to Device Download (drive object ON?).  
 2: Incorrect drive object number.  
 3: A drive object that has already been deleted is deleted again.  
 4: Deleting of a drive object that has already been registered for generation.  
 5: Deleting a drive object that does not exist.  
 6: Generating an undeleted drive object that already existed.  
 7: Regenerating a drive object already registered for generation.  
 8: Maximum number of drive objects that can be generated exceeded.  
 9: Error while generating a device drive object.  
 10: Error while generating target topology parameters (p9902 and p9903).  
 11: Error while generating a drive object (global component).  
 12: Error while generating a drive object (drive component).  
 13: Unknown drive object type.  
 14: Drive status cannot be changed to "ready for operation" (r0947 and r0949).  
 15: Drive status cannot be changed to drive download.  
 16: Device status cannot be changed to "ready for operation".  
 17: It is not possible to download the topology. The component wiring should be checked, taking into account the various messages/signals.  
 18: A new download is only possible if the factory settings are restored for the drive unit.  
 19: The slot for the option module has been configured several times (e.g. CAN and COMM BOARD).  
 20: The configuration is inconsistent (e.g. CAN for Control Unit, however no CAN configured for drive objects A\_INF, SERVO or VECTOR ).  
 21: Error when accepting the download parameters.  
 22: Software-internal download error.  
 Additional values: only for internal Siemens troubleshooting.

**Remedy:**

- use the current version of the commissioning software.
- modify the offline project and carry out a new download (e.g. compare the number of drive objects, motor, encoder, power unit in the offline project and at the drive).
- change the drive state (is a drive rotating or is there a message/signal?).
- carefully note any other messages/signals and remove their cause.
- boot from previously saved files (power-down/power-up or p0976).

---

**F01044 CU: Descriptive data error**

**Message value:** %1

**Drive object:** All objects

**Reaction:** OFF2

**Acknowledge:** POWER ON

**Cause:** An error was detected when loading the descriptive data saved in the non-volatile memory.

**Remedy:** Replace the memory card or Control Unit.

<b>A01045</b>	<b>CU: Configuring data invalid</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	An error was detected when evaluating the parameter files PSxxxxxyy.ACX, PTxxxxxyy.ACX, CAxxxxxyy.ACX, or CCxxxxxyy.ACX saved in the non-volatile memory. Because of this, under certain circumstances, several of the saved parameter values were not able to be accepted. Also see r9406 up to r9408. Alarm value (r2124, interpret hexadecimal): Only for internal Siemens troubleshooting.
<b>Remedy:</b>	- Check the parameters displayed in r9406 up to r9408, and correct these if required. - Restore the factory setting using (p0976 = 1) and re-load the project into the drive unit. Then save the parameterization in STARTER using the "Copy RAM to ROM" function or with p0977 = 1. This overwrites the incorrect parameter files in the non-volatile memory – and the alarm is withdrawn.
<b>A01049</b>	<b>CU: It is not possible to write to file</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	It is not possible to write into a write-protected file (PSxxxxxx.acx). The write request was interrupted. Alarm value (r2124, interpret decimal): Drive object number.
<b>Remedy:</b>	Check whether the "write protected" attribute has been set for the files in the non-volatile memory under .../USER/SINAMICS/DATA/... When required, remove write protection and save again (e.g. set p0977 to 1).
<b>F01050</b>	<b>Memory card and device incompatible</b>
<b>Message value:</b>	-
<b>Drive object:</b>	All objects
<b>Reaction:</b>	OFF2 (NONE, OFF1, OFF3)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	The memory card and the device type do not match (e.g. a memory card for SINAMICS S is inserted in SINAMICS G).
<b>Remedy:</b>	- insert the matching memory card. - use the matching Control Unit or power unit.
<b>F01054</b>	<b>CU: System limit exceeded</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	At least one system overload has been identified. Fault value (r0949, interpret decimal): 1: Computing time load too high (r9976[1]). 5: Peak load too high (r9976[5]). As long as this fault is present, it is not possible to save the parameters (p0971, p0977). See also: r9976 (System utilization)
<b>Remedy:</b>	Re fault value = 1, 5: - reduce the computing time load of the drive unit (r9976[1] and r9976[5]) to under 100 %. - check the sampling times and adjust if necessary (p0115, p0799, p4099). - de-activate function modules. - de-activate drive objects. - remove drive objects from the target topology. - note the DRIVE-CLiQ topology rules and if required, change the DRIVE-CLiQ topology.

When using the Drive Control Chart (DCC) or free function blocks (FBLOCKS), the following applies

- the computing time load of the individual run-time groups on a drive object can be read out in r21005 (DCC) or r20005 (FBLOCKS).
- if necessary, the assignment of the run-time group (p21000, p20000) can be changed in order to increase the sampling time (r21001, r20001).
- if necessary, reduce the number of cyclically calculated blocks (DCC) and/or function blocks (FBLOCKS).

---

<b>F01055</b>	<b>CU: Internal error (SYNO of port and application not identical)</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	All applications that operate with slaves at one port must be derived from the same SYNO clock cycle. The first application whose registration (log-on) connects a slave to a port defines the SYNO clock cycle that will be used as basis for the port. Fault value (r0949, interpret hexadecimal): Method ID. Note: Only for internal Siemens troubleshooting.
<b>Remedy:</b>	Contact the Hotline.

---

<b>F01056</b>	<b>CU: Internal error (clock cycle of parameter group already assigned differently)</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	The requested parameter group (IREG, NREG, ...) is already being used in a different clock cycle. Fault value (r0949, interpret hexadecimal): Method ID. Note: Only for internal Siemens troubleshooting.
<b>Remedy:</b>	Contact the Hotline.

---

<b>F01057</b>	<b>CU: Internal error (different DRIVE-CLiQ type for the slave)</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	The requested DRIVE-CLiQ type (hps_ps, hps_enc, ...) has been specified differently for the same slave component. Fault value (r0949, interpret hexadecimal): Method ID. Note: Only for internal Siemens troubleshooting.
<b>Remedy:</b>	Contact the Hotline.

---

<b>F01058</b>	<b>CU: Internal error (slave missing in topology)</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	The requested slave component does not exist in the topology. Fault value (r0949, interpret hexadecimal): Method ID. Note: Only for internal Siemens troubleshooting.
<b>Remedy:</b>	Contact the Hotline.

---

<b>F01059</b>	<b>CU: Internal error (port does not exist)</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	The port object assigned according to the topology of the requested slave component does not exist. Fault value (r0949, interpret hexadecimal): Method ID. Note: Only for internal Siemens troubleshooting.
<b>Remedy:</b>	Contact the Hotline.
<b>F01060</b>	<b>CU: Internal error (parameter group not available)</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	The requested parameter group (IREG, NREG, ...) is not offered by this slave type. Fault value (r0949, interpret hexadecimal): Method ID. Note: Only for internal Siemens troubleshooting.
<b>Remedy:</b>	Contact the Hotline.
<b>F01061</b>	<b>CU: Internal error (application not known)</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	An application that is not registered with TSM has attempted to register with registerSlaves(). The cause can be an unsuccessful TSM registration or an incorrect registration sequence. It is always necessary to log in to the TSM before registerSlaves() can be used. Fault value (r0949, interpret hexadecimal): Method ID. Note: Only for internal Siemens troubleshooting.
<b>Remedy:</b>	Contact the Hotline.
<b>F01063</b>	<b>CU: Internal error (PDM)</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	An internal software error has occurred. Fault value (r0949, interpret hexadecimal): Method ID. Note: Only for internal Siemens troubleshooting.
<b>Remedy:</b>	Contact the Hotline.
<b>F01068</b>	<b>CU: Data memory memory overflow</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	The utilization for a data memory area is too large.

Fault value (r0949, interpret binary):  
Bit 0 = 1: High-speed data memory 1 overloaded  
Bit 1 = 1: High-speed data memory 2 overloaded  
Bit 2 = 1: High-speed data memory 3 overloaded  
Bit 3 = 1: High-speed data memory 4 overloaded

**Remedy:**

- de-activate the function module.
- de-activate drive object.
- remove the drive object from the target topology.

---

**A01069      Parameter backup and device incompatible**

**Message value:** -  
**Drive object:** CU\_DC, CU\_DC\_R, CU\_DC\_R\_S, CU\_DC\_S  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The parameter backup on the memory card and the drive unit do not match.  
The module boots with the factory settings.  
Example:  
Devices A and B. are not compatible and a memory card with the parameter backup for device A is inserted in device B.  
**Remedy:**

- insert a memory card with compatible parameter backup and carry out a POWER ON.
- insert a memory card without parameter backup and carry out a POWER ON.
- If required, withdraw the memory card and carry out POWER ON.
- save the parameters (p0971 = 1).

---

**A01069      Parameter backup and device incompatible**

**Message value:** -  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The parameter backup on the memory card and the drive unit do not match.  
The module boots with the factory settings.  
Example:  
Devices A and B. are not compatible and a memory card with the parameter backup for device A is inserted in device B.  
**Remedy:**

- insert a memory card with compatible parameter backup and carry out a POWER ON.
- insert a memory card without parameter backup and carry out a POWER ON.
- save the parameters (p0977 = 1).

---

**F01072      Memory card restored from the backup copy**

**Message value:** -  
**Drive object:** All objects  
**Reaction:** NONE  
**Acknowledge:** IMMEDIATELY  
**Cause:** The Control Unit was switched-off while writing to the memory card. This is why the visible partition became defective.  
After switching on, the data from the non-visible partition (backup copy) were written to the visible partition.  
**Remedy:** Check that the firmware and parameterization is up-to-date.

---

**A01073      POWER ON required for backup copy on memory card**

**Message value:** -  
**Drive object:** All objects  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The parameter assignment on the visible partition of the memory card has changed.  
In order that the backup copy on the memory card is updated on the non-visible partition, it is necessary to carry out a POWER ON or hardware reset (p0972) of the Control Unit.  
Note:  
It is possible that a new POWER ON is requested via this alarm (e.g. after saving with p0971 = 1).

**Remedy:**

- carry out a POWER ON (power off/on) for the Control Unit.
- carry out a hardware reset (RESET button, p0972).

---

**A01099 Tolerance window of time synchronization exited**

**Message value:** -

**Drive object:** All objects

**Reaction:** NONE

**Acknowledge:** NONE

**Cause:** The time master exited the selected tolerance window for time synchronization.  
See also: p3109 (RTC real time synchronization tolerance window)

**Remedy:** Select the re-synchronization interval so that the synchronization deviation between the time master and drive system lies within the tolerance window.  
See also: r3108 (RTC last synchronization deviation)

---

**A01100 CU: Memory card withdrawn**

**Message value:** -

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** NONE

**Acknowledge:** NONE

**Cause:** The memory card (non-volatile memory) was withdrawn during operation.  
Notice:  
It is not permissible for the memory card to be withdrawn or inserted under voltage.

**Remedy:**

- power down the drive system.
- re-insert the memory card that was withdrawn - this card must match the drive system.
- power up the drive system again.

---

**A01104 CU: Do not power down. File system being optimized.**

**Message value:** -

**Drive object:** All objects

**Reaction:** NONE

**Acknowledge:** NONE

**Cause:** The file system is currently being optimized in the non-volatile device memory of the Control Unit. This process may take several minutes.  
Notice:  
The Control Unit must not be powered down during optimization, as this can lead to user data being lost.

**Remedy:** Leave the Control Unit powered up during optimization.  
Note:  
The alarm disappears automatically once file system optimization is complete.

---

**F01105 (A) CU: Insufficient memory**

**Message value:** %1

**Drive object:** All objects

**Reaction:** OFF1

**Acknowledge:** POWER ON

**Cause:** Too many functions have been configured on this Control Unit (e.g. too many drives, function modules, data sets, OA applications, blocks, etc).  
Fault value (r0949, interpret decimal):  
Only for internal Siemens troubleshooting.

**Remedy:**

- change the configuration on this Control Unit (e.g. fewer drives, function modules, data sets, OA applications, blocks, etc).
- use an additional Control Unit.

Reaction upon A: NONE

Acknowl. upon A: NONE



---

<b>F01106</b>	<b>CU: Insufficient memory</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	There is not sufficient free memory space available.
<b>Remedy:</b>	Not necessary.

---

<b>F01107</b>	<b>CU: Data save in the non-volatile memory unsuccessful</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	A data save in the non-volatile memory was not able to be successfully carried out. - non-volatile memory is defective. - insufficient space in the non-volatile memory. Fault value (r0949, interpret decimal): Only for internal Siemens troubleshooting.
<b>Remedy:</b>	- try to save again. - replace the memory card or Control Unit.

---

<b>F01110</b>	<b>CU: More than one SINAMICS G on one Control Unit</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	TM150, TM15DI_DO, TM31
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	More than one SINAMICS G type power unit is being operated from the Control Unit. Fault value (r0949, interpret decimal): Number of the second drive with a SINAMICS G type power unit.
<b>Remedy:</b>	Only one SINAMICS G drive type is permitted.

---

<b>F01111</b>	<b>CU: Mixed operation of drive units illegal</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	Illegal operation of various drive units on one Control Unit: - SINAMICS S together with SINAMICS G - SINAMICS S together with SINAMICS S Value or Combi Fault value (r0949, interpret decimal): Number of the first drive object with a different power unit type.
<b>Remedy:</b>	Only power units of one particular drive type may be operated with one Control Unit.

---

<b>F01112</b>	<b>CU: Power unit not permissible</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	The connected power unit cannot be used together with this Control Unit. Fault value (r0949, interpret decimal): 1: Power unit is not supported (e.g. PM240). 2: DC/AC power unit connected to CU310 not permissible. 3: Power unit (S120M) not permitted for vector control.
<b>Remedy:</b>	Replace the power unit that is not permissible by a component that is permissible.

---

---

**F01120 (A) Terminal initialization has failed**

**Message value:** %1  
**Drive object:** All objects  
**Reaction:** OFF1 (OFF2)  
**Acknowledge:** IMMEDIATELY (POWER ON)  
**Cause:** An internal software error occurred while the terminal functions were being initialized.  
 Fault value (r0949, interpret hexadecimal):  
 Only for internal Siemens troubleshooting.  
**Remedy:**  
 - carry out a POWER ON (power off/on) for all components.  
 - upgrade firmware to later version.  
 - contact the Hotline.  
 - replace the Control Unit.  
 Reaction upon A: NONE  
 Acknowl. upon A: NONE

---

**F01122 (A) Frequency at the measuring probe input too high**

**Message value:** %1  
**Drive object:** All objects  
**Reaction:** OFF1 (OFF2)  
**Acknowledge:** IMMEDIATELY  
**Cause:** The frequency of the pulses at the measuring probe input is too high.  
 Fault value (r0949, interpret decimal):  
 1: DI/DO 9 (X122.8)  
 2: DI/DO 10 (X122.10)  
 4: DI/DO 11 (X122.11)  
 8: DI/DO 13 (X132.8)  
 16: DI/DO 14 (X132.10)  
 32: DI/DO 15 (X132.11)  
 64: DI/DO 8 (X122.7)  
 128: DI/DO 12 (X132.7)  
**Remedy:** Reduce the frequency of the pulses at the measuring probe input.  
 Reaction upon A: NONE  
 Acknowl. upon A: NONE

---

**F01150 CU: Number of instances of a drive object type exceeded**

**Message value:** Drive object type: %1, number permitted: %2, actual number: %3  
**Drive object:** All objects  
**Reaction:** NONE  
**Acknowledge:** IMMEDIATELY  
**Cause:** The maximum permissible number of instances of a drive object type was exceeded.  
 Drive object type:  
 Drive object type (p0107), for which the maximum permissible number of instances was exceeded.  
 Number permitted:  
 Max. permissible number of instances for this drive object type.  
 Actual number:  
 Current number of instances for this drive object type.  
 Note regarding the message value:  
 The individual information is coded as follows in the message value (r0949/r2124):  
 ddccbbaa hex: aa = drive object type, bb = number limited, cc = actual number, dd = no significance  
**Remedy:**  
 - power down the unit.  
 - suitably restrict the number of instances of a drive object type by reducing the number of inserted components.  
 - re-commission the unit.

---

<b>F01151</b>	<b>CU: Number of drive objects of a category exceeded</b>
<b>Message value:</b>	Drive object category: %1, number permitted: %2, actual number: %3
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	The maximum permissible number of drive objects of a category was exceeded. Drive object category: Drive object category, for which the maximum permissible number of drive objects was exceeded. Number permitted: Max. permissible number for this drive object category. Actual number: Actual number for this drive object category. Note regarding the message value: The individual information is coded as follows in the message value (r0949/r2124): ddccbbaa hex: aa = drive object category, bb = number limited, cc = actual number, dd = no significance
<b>Remedy:</b>	- power down the unit. - suitably restrict the number of drive objects of the specified category by reducing the number of inserted components. - re-commission the unit.

---

<b>F01200</b>	<b>CU: Time slice management internal software error</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	IMMEDIATELY (POWER ON)
<b>Cause:</b>	A time slice management error has occurred. It is possible that the sampling times have been inadmissibly set. Fault value (r0949, interpret hexadecimal): 998: Too many time slices occupied by OA (e.g. DCC). 999: Too many time slices occupied by the basic system. Too many different sampling times may have been set. Additional values: Only for internal Siemens troubleshooting.
<b>Remedy:</b>	- check the sampling time setting (p0112, p0115, p4099, p9500, p9511). - contact the Hotline.

---

<b>F01205</b>	<b>CU: Time slice overflow</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	POWER ON
<b>Cause:</b>	Insufficient processing time is available for the existing topology. Fault value (r0949, interpret hexadecimal): Only for internal Siemens troubleshooting.
<b>Remedy:</b>	- reduce the number of drives. - increase the sampling times.

---

<b>F01221</b>	<b>CU: Bas clk cyc too low</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	The closed-loop control / monitoring cannot maintain the envisaged clock cycle. The runtime of the closed-loop control/monitoring is too long for the particular clock cycle or the computing time remaining in the system is not sufficient for the closed-loop control/monitoring. Fault value (r0949, interpret hexadecimal): Only for internal Siemens troubleshooting.

---

**Remedy:** Increase the basic clock cycle of DRIVE-CLiQ communication.  
See also: p0112 (Sampling times pre-setting p0115)

---

**F01222 CU: Basic clock cycle too low (computing time for communication not available)**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150  
**Reaction:** NONE  
**Acknowledge:** IMMEDIATELY  
**Cause:** A time slice has not been defined that fulfills the requirements.  
The port cannot be correctly operated as the alternating cyclic clock cycle cannot be maintained.  
Fault value (r0949, interpret hexadecimal):  
Method ID.  
Note:  
Only for internal Siemens troubleshooting.  
**Remedy:** Contact the Hotline.

---

**A01223 CU: Sampling time inconsistent**

**Message value:** %1  
**Drive object:** All objects  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** When changing a sampling time (p0115[0], p0799 or p4099), inconsistency between the clock cycles has been identified.  
Alarm value (r2124, interpret decimal):  
1: Value lower than minimum value.  
2: Value higher than maximum value.  
3: Value not a multiple of 1.25 µs.  
4: Value does not match clock-cycle synchronous PROFIBUS operation.  
5: Value not a multiple of 125 µs.  
6: Value not a multiple of 250 µs.  
7: Value not a multiple of 375 µs.  
8: Value not a multiple of 400 µs.  
10: Special restriction of the drive object violated.  
20: On a SERVO with a sampling time of 62.5 µs, more than two drive objects or one drive object of a type other than SERVO have been detected on the same DRIVE-CLiQ line (a maximum of two SERVO type drive objects are permitted).  
21: Value can be a multiple of the current controller sampling time of a servo or vector drive in the system (e.g. for TB30, the values of all of the indices should be taken into account).  
30: Value less than 31.25 µs.  
31: Value less than 62.5 µs (31.25 µs is not supported for SMC10, SMC30, SMI10 and Double Motor Modules).  
32: Value less than 125 µs.  
33: Value less than 250 µs.  
40: Nodes have been identified on the DRIVE-CLiQ line whose highest common denominator of the sampling times is less than 125 µs. Further, none of the nodes has a sampling time of less than 125 µs.  
41: A chassis unit was identified on the DRIVE-CLiQ line as a node. Further, the highest common denominator of the sampling times of all of the nodes connected to the line is less than 250 µs.  
42: An Active Line Module was identified on the DRIVE-CLiQ line as a node. Further, the highest common denominator of the sampling times of all of the nodes connected to the line is less than 125 µs.  
43: A Voltage Sensing Module (VSM) was identified on the DRIVE-CLiQ line as a node. Further, the highest common denominator of the sampling times of all of the nodes connected to the line is not equal to the current controller sampling time of the drive object of the VSM.  
44: The highest common denominator of the sampling times of all of the components connected to the DRIVE-CLiQ line is not the same for all components of this drive object (e.g. there are components on different DRIVE-CLiQ lines on which different highest common denominators are generated).  
45: A chassis parallel unit was identified on the DRIVE-CLiQ line as a node. Further, the highest common denominator of the sampling times of all of the nodes connected to the line is less than 162.5 µs or 187.5 µs (for a 2 or 3x parallel connection).  
46: A node has been identified on the DRIVE-CLiQ line whose sampling time is not a multiple of the lowest sampling time on this line.  
52: Nodes have been identified on the DRIVE-CLiQ line whose highest common denominator of the sampling times is less than 31.25 µs.

54: Nodes have been identified on the DRIVE-CLiQ line whose highest common denominator of the sampling times is less than 62.5 µs.  
56: Nodes have been identified on the DRIVE-CLiQ line whose highest common denominator of the sampling times is less than 125 µs.  
58: Nodes have been identified on the DRIVE-CLiQ line whose highest common denominator of the sampling times is less than 250 µs.  
99: Inconsistency of cross drive objects detected.  
116: Recommended clock cycle in r0116[0...1].  
General note:  
The topology rules should be noted when connecting up DRIVE-CLiQ (refer to the appropriate product documentation).  
The parameters of the sampling times can also be changed with automatic calculations.  
Example for highest common denominator: 125 µs, 125 µs, 62.5 µs --> 62.5 µs

**Remedy:**

- check the DRIVE-CLiQ cables.
- set a valid sampling time.

See also: p0115, p4099

---

**A01224 CU: Pulse frequency inconsistent**

**Message value:** %1  
**Drive object:** All objects  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** When changing the minimum pulse frequency (p0113) inconsistency between the pulse frequencies was identified.  
Alarm value (r2124, interpret decimal):  
1: Value lower than minimum value.  
2: Value higher than maximum value.  
3: Resulting sampling time is not a multiple of 1.25 µs.  
4: Value does not match clock-cycle synchronous PROFIBUS operation.  
10: Special restriction of the drive object violated.  
99: Inconsistency of cross drive objects detected.  
116: Recommended clock cycle in r0116[0...1].  
**Remedy:** Set a valid pulse frequency.

---

**F01250 CU: CU-EEPROM incorrect read-only data**

**Message value:** %1  
**Drive object:** All objects  
**Reaction:** NONE (OFF2)  
**Acknowledge:** POWER ON  
**Cause:** Error when reading the read-only data of the EEPROM in the Control Unit.  
Fault value (r0949, interpret decimal):  
Only for internal Siemens troubleshooting.  
**Remedy:**

- carry out a POWER ON.
- replace the Control Unit.

---

**A01251 CU: CU-EEPROM incorrect read-write data**

**Message value:** %1  
**Drive object:** All objects  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** Error when reading the read-write data of the EEPROM in the Control Unit.  
Alarm value (r2124, interpret decimal):  
Only for internal Siemens troubleshooting.  
**Remedy:** For alarm value r2124 < 256, the following applies:  

- carry out a POWER ON.
- replace the Control Unit.

For alarm value r2124 >= 256, the following applies:  

- for the drive object with this alarm, clear the fault memory (p0952 = 0).
- as an alternative, clear the fault memory of all drive objects (p2147 = 1).
- replace the Control Unit.

<b>F01255</b>	<b>CU: Option Board EEPROM read-only data error</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE (OFF2)
<b>Acknowledge:</b>	POWER ON
<b>Cause:</b>	Error when reading the read-only data of the EEPROM in the Option Board. Fault value (r0949, interpret decimal): Only for internal Siemens troubleshooting.
<b>Remedy:</b>	- carry out a POWER ON. - replace the Control Unit.
<b>A01256</b>	<b>CU: Option Board EEPROM read-write data error</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	Error when reading the read-write data of the EEPROM in the Option Board. Fault value (r0949, interpret decimal): Only for internal Siemens troubleshooting.
<b>Remedy:</b>	- carry out a POWER ON. - replace the Control Unit.
<b>F01303</b>	<b>DRIVE-CLiQ component does not support the required function</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	A function requested by the Control Unit is not supported by a DRIVE-CLiQ component. Fault value (r0949, interpret decimal): 1: The component does not support the de-activation. 101: The Motor Module does not support an internal armature short-circuit. 102: The Motor Module does not support the de-activation. 201: The Sensor Module does not support actual value inversion (p0410.0 = 1) when using a Hall sensor (p0404.6 = 1) for the commutation. 202: The Sensor Module does not support parking/unparking. 203: The Sensor Module does not support the de-activation. 204: The firmware of this Terminal Module 15 (TM15) does not support the application TM15DI/DO. 205: The Sensor Module does not support the selected temperature evaluation (r0458). 206: The firmware of this Terminal Modules TM41/TM31/TM15 refers to an old firmware version. It is urgently necessary to upgrade the firmware to ensure disturbance-free operation. 207: The power unit with this hardware version does not support operation with device supply voltages of less than 380 V. 208: The Sensor Module does not support de-selection of commutation with zero mark (via p0430.23). 211: The Sensor Module does not support single-track encoders (r0459.10). 212: The Sensor Module does not support LVDT sensors (p4677.0). 213: The Sensor Module does not support the characteristic type (p4662).
<b>Remedy:</b>	Upgrade the firmware of the DRIVE-CLiQ component involved. For fault value = 205: Check parameter p0600 and p0601 and if required, adapt interpretation. For fault value = 207: Replace the power unit or if required set the device supply voltage higher (p0210). For fault value = 208: Check parameter p0430.23 and reset if necessary.

---

<b>A01304 (F)</b>	<b>Firmware version of DRIVE-CLiQ component is not up-to-date</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	The non-volatile memory has a more recent firmware version than the one in the connected DRIVE-CLiQ component. Alarm value (r2124, interpret decimal): Component number of the DRIVE-CLiQ component involved.
<b>Remedy:</b>	Update the firmware (p7828, p7829 and commissioning software).
Reaction upon F:	NONE
Acknowled. upon F:	IMMEDIATELY

---

<b>F01305</b>	<b>Topology: Component number missing</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	The component number from the topology was not parameterized (p0121 (for power unit, refer to p0107), p0131 (for servo/vector drives, refer to p0107), p0141, p0151, p0161). Fault value (r0949, interpret decimal): Data set number. Note: The fault also occurs if speed encoders have been configured (p0187 to p0189) but no component numbers exist for them. In this case, the fault value includes the drive data set number plus 100 * encoder number (e.g. 3xx, if a component number was not entered in p0141 for the third encoder (p0189)). See also: p0121 (Power unit component number), p0141 (Encoder interface (Sensor Module) component number), p0142 (Encoder component number), p0151 (Terminal Module component number), p0187 (Encoder 1 encoder data set number), p0188 (Encoder 2 encoder data set number)
<b>Remedy:</b>	Enter the missing component number or remove the component and restart commissioning. See also: p0121 (Power unit component number), p0141 (Encoder interface (Sensor Module) component number), p0142 (Encoder component number), p0151 (Terminal Module component number), p0187 (Encoder 1 encoder data set number), p0188 (Encoder 2 encoder data set number)

---

<b>A01306</b>	<b>Firmware of the DRIVE-CLiQ component being updated</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	Firmware update is active for at least one DRIVE-CLiQ component. Alarm value (r2124, interpret decimal): Component number of the DRIVE-CLiQ component.
<b>Remedy:</b>	Not necessary. This alarm automatically disappears after the firmware has been updated.

---

<b>A01314</b>	<b>Topology: Component must not be present</b>
<b>Message value:</b>	Component number: %1, Component class: %2, Connection number: %3
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	For a component, "de-activate and not present" is set but this component is still in the topology. Alarm value (r2124, interpret hexadecimal): ddccbbaa hex: aa = component number bb = component class of the component cc = connection number

<b>Remedy:</b>	<p>Note: Component class and connection number are described in F01375.</p> <ul style="list-style-type: none"> <li>- remove the corresponding component.</li> <li>- change the setting "de-activate and not present".</li> </ul> <p>Note: Under "Topology --&gt; Topology view" the commissioning software where relevant offers improved diagnostics capability (e.g. setpoint/actual value comparison). See also: p0105 (Activate/de-activate drive object), p0125 (Activate/de-activate power unit components), p0145 (Activate/de-activate encoder interface)</p>
<b>A01315</b>	<b>Drive object not ready for operation</b>
<b>Message value:</b>	-
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>For the active drive object involved, at least one activated component is missing.</p> <p>Note: All other active and operational drive objects can be in the "RUN" state.</p>
<b>Remedy:</b>	<p>The alarm automatically disappears again with the following actions:</p> <ul style="list-style-type: none"> <li>- de-activate the drive object involved (p0105 = 0).</li> <li>- de-activate the components involved (p0125 = 0, p0145 = 0, p0155 = 0, p0165 = 0).</li> <li>- re-insert the components involved.</li> </ul> <p>See also: p0105 (Activate/de-activate drive object), p0125 (Activate/de-activate power unit components), p0145 (Activate/de-activate encoder interface)</p>
<b>A01316</b>	<b>Drive object inactive and again ready for operation</b>
<b>Message value:</b>	-
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>If, when inserting a component of the target topology, an inactive, non-operational drive object becomes operational again. The associated parameter of the component is, in this case, set to "activate" (p0125, p0145, p0155, p0165).</p> <p>Note: This is the only message that is displayed for a de-activated drive object.</p>
<b>Remedy:</b>	<p>The alarm automatically disappears again with the following actions:</p> <ul style="list-style-type: none"> <li>- activate the drive object involved (p0105 = 1).</li> <li>- again withdraw the components involved.</li> </ul> <p>See also: p0105 (Activate/de-activate drive object)</p>
<b>A01317 (N)</b>	<b>De-activated component again present</b>
<b>Message value:</b>	-
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>If a component of the target topology for an active drive object is inserted and the associated parameter of the component is set to "de-activate" (p0125, p0145, p0155, p0165).</p> <p>Note: This is the only message that is displayed for a de-activated component.</p>
<b>Remedy:</b>	<p>The alarm automatically disappears again with the following actions:</p> <ul style="list-style-type: none"> <li>- activate the components involved (p0125 = 1, p0145 = 1, p0155 = 1, p0165 = 1).</li> <li>- again withdraw the components involved.</li> </ul> <p>See also: p0125 (Activate/de-activate power unit components), p0145 (Activate/de-activate encoder interface)</p>
Reaction upon N:	NONE
Acknowl. upon N:	NONE



---

<b>A01318</b>	<b>BICO: De-activated interconnections present</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	This alarm is used in the following cases: <ul style="list-style-type: none"><li>- If an inactive/non-operational drive object is active again/ready for operation</li><li>- If there are items in the list of BI/CI parameters (r9498[0...29], r9499[0...29])</li><li>- If the BICO interconnections saved in the list of BI/CI parameters (r9498[0...29], r9499[0...29]) have actually been changed</li></ul>
<b>Remedy:</b>	Reset alarm: <ul style="list-style-type: none"><li>- Set p9496 to 1 or 2</li></ul> or <ul style="list-style-type: none"><li>- de-activate the drive object again.</li></ul>

---

<b>A01319</b>	<b>Inserted component not initialized</b>
<b>Message value:</b>	-
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150, TM15DI_DO, TM31
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	Initialization is required for at least one inserted component. This is only possible if the pulses are inhibited for all the drive objects.
<b>Remedy:</b>	Activate pulse inhibit for all drive objects.

---

<b>A01320</b>	<b>Topology: Drive object number does not exist in configuration</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	A drive object number is missing in p0978 Alarm value (r2124, interpret decimal): Index of p0101 under which the missing drive object number can be determined.
<b>Remedy:</b>	Set p0009 to 1 and change p0978: Rules: <ul style="list-style-type: none"><li>- p0978 must include all of the drive object numbers (p0101).</li><li>- it is not permissible for a drive object number to be repeated.</li><li>- by entering a 0, the drive objects with PZD are separated from those without PZD.</li><li>- only 2 partial lists are permitted. After the second 0, all values must be 0.</li><li>- dummy drive object numbers (255) are only permitted in the first partial list.</li></ul>

---

<b>A01321</b>	<b>Topology: Drive object number does not exist in configuration</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	p0978 contains a drive object number that does not exist. Alarm value (r2124, interpret decimal): Index of p0978 under which the drive object number can be determined.
<b>Remedy:</b>	Set p0009 to 1 and change p0978: Rules: <ul style="list-style-type: none"><li>- p0978 must include all of the drive object numbers (p0101).</li><li>- it is not permissible for a drive object number to be repeated.</li><li>- by entering a 0, the drive objects with PZD are separated from those without PZD.</li><li>- only 2 partial lists are permitted. After the second 0, all values must be 0.</li><li>- dummy drive object numbers (255) are only permitted in the first partial list.</li></ul>

---

---

**A01322      Topology: Drive object number present twice in configuration**

**Message value:** %1  
**Drive object:** All objects  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** A drive object number is present more than once in p0978.  
 Alarm value (r2124, interpret decimal):  
 Index of p0978 under which the involved drive object number is located.  
**Remedy:** Set parameter p0009 = 1 and change p0978:  
 Rules:  
 - p0978 must include all of the drive object numbers (p0101).  
 - it is not permissible for a drive object number to be repeated.  
 - by entering a 0, the drive objects with PZD are separated from those without PZD.  
 - only 2 partial lists are permitted. After the second 0, all values must be 0.  
 - dummy drive object numbers (255) are only permitted in the first partial list.

---

**A01323      Topology: More than two partial lists created**

**Message value:** %1  
**Drive object:** All objects  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** Partial lists are available more than twice in p0978. After the second 0, all must be 0.  
 Alarm value (r2124, interpret decimal):  
 Index of p0978 under which the illegal value is located.  
**Remedy:** Set p0009 to 1 and change p0978:  
 Rules:  
 - p0978 must include all of the drive object numbers (p0101).  
 - it is not permissible for a drive object number to be repeated.  
 - by entering a 0, the drive objects with PZD are separated from those without PZD.  
 - only 2 partial lists are permitted. After the second 0, all values must be 0.  
 - dummy drive object numbers (255) are only permitted in the first partial list.

---

**A01324      Topology: Dummy drive object number incorrectly created**

**Message value:** %1  
**Drive object:** All objects  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** In p0978, dummy drive object numbers (255) are only permitted in the first partial list.  
 Alarm value (r2124, interpret decimal):  
 Index of p0978 under which the illegal value is located.  
**Remedy:** Set p0009 to 1 and change p0978:  
 Rules:  
 - p0978 must include all of the drive object numbers (p0101).  
 - it is not permissible for a drive object number to be repeated.  
 - by entering a 0, the drive objects with PZD are separated from those without PZD.  
 - only 2 partial lists are permitted. After the second 0, all values must be 0.  
 - dummy drive object numbers (255) are only permitted in the first partial list.

---

**F01325      Topology: Component number not present in target topology**

**Message value:** Component number: %1  
**Drive object:** All objects  
**Reaction:** NONE  
**Acknowledge:** IMMEDIATELY  
**Cause:** The component configured in a parameter (e.g. p0121, p0131, etc.) is not present in the target topology.  
 Alarm value (r2124, interpret decimal):  
 Configured component number that is not present in target topology.  
**Remedy:** Establish topology and DO configuration consistency.

<b>A01330</b>	<b>Topology: Quick commissioning not possible</b>
<b>Message value:</b>	Fault cause: %1, supplementary information: %2, preliminary component number: %3
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>Unable to carry out a quick commissioning. The existing actual topology does not fulfill the requirements.</p> <p>Alarm value (r2124, interpret hexadecimal):</p> <p>ccccbbaa hex: cccc = preliminary component number, bb = supplementary information, aa = fault cause</p> <p>aa = 01 hex = 1 dec:</p> <p>On one component illegal connections were detected.</p> <ul style="list-style-type: none"><li>- bb = 01 hex = 1 dec: For a Motor Module, more than one motor with DRIVE-CLiQ was detected.</li><li>- bb = 02 hex = 2 dec: For a motor with DRIVE-CLiQ, the DRIVE-CLiQ cable is not connected to a Motor Module.</li></ul> <p>aa = 02 hex = 2 dec:</p> <p>The topology contains too many components of a particular type.</p> <ul style="list-style-type: none"><li>- bb = 01 hex = 1 dec: There is more than one master Control Unit.</li><li>- bb = 02 hex = 2 dec: There is more than 1 infeed (8 for a parallel circuit configuration).</li><li>- bb = 03 hex = 3 dec: There are more than 10 Motor Modules (8 for a parallel circuit configuration).</li><li>- bb = 04 hex = 4 dec: There are more than 9 encoders.</li><li>- bb = 05 hex = 5 dec: There are more than 8 Terminal Modules.</li><li>- bb = 07 hex = 7 dec: Unknown component type</li><li>- bb = 08 hex = 8 dec: There are more than 6 drive slaves.</li><li>- bb = 09 hex = 9 dec: Connection of a drive slave not permitted.</li><li>- bb = 0a hex = 10 dec: There is no drive master.</li><li>- bb = 0b hex = 11 dec: There is more than one motor with DRIVE-CLiQ for a parallel circuit.</li><li>- bb = 0c hex = 12 dec: Different power units are being used in a parallel connection.</li></ul> <p>- cccc: Not used.</p> <p>aa = 03 hex = 3 dec:</p> <p>More than 16 components are connected at a DRIVE-CLiQ socket of the Control Unit.</p> <ul style="list-style-type: none"><li>- bb = 0, 1, 2, 3 means e.g. detected at the DRIVE-CLiQ socket X100, X101, X102, X103.</li></ul> <p>- cccc: Not used.</p> <p>aa = 04 hex = 4 dec:</p> <p>The number of components connected one after the other is greater than 125.</p> <ul style="list-style-type: none"><li>- bb: Not used.</li><li>- cccc = preliminary component number of the first component and component that resulted in the fault.</li></ul> <p>aa = 05 hex = 5 dec:</p> <p>The component is not permissible for SERVO.</p> <ul style="list-style-type: none"><li>- bb = 01 hex = 1 dec: SINAMICS G available.</li><li>- bb = 02 hex = 2 dec: Chassis available.</li></ul> <p>- cccc = preliminary component number of the first component and component that resulted in the fault.</p> <p>aa = 06 hex = 6 dec:</p> <p>On one component illegal EEPROM data was detected. These must be corrected before the system continues to boot.</p> <ul style="list-style-type: none"><li>- bb = 01 hex = 1 dec: The Order No. [MLFB] of the power unit that was replaced includes a space retainer. The space retainer (*) must be replaced by a correct character.</li></ul> <p>- cccc = preliminary component number of the component with illegal EEPROM data.</p> <p>aa = 07 hex = 7 dec:</p> <p>The actual topology contains an illegal combination of components.</p> <ul style="list-style-type: none"><li>- bb = 01 hex = 1 dec: Active Line Module (ALM) and Basic Line Module (BLM).</li><li>- bb = 02 hex = 2 dec: Active Line Module (ALM) and Smart Line Module (SLM).</li><li>- bb = 03 hex = 3 dec: SIMOTION control (e.g. SIMOTION D445) and SINUMERIK component (e.g. NX15).</li><li>- bb = 04 hex = 4 dec: SINUMERIK control (e.g. SINUMERIK 730.net) and SIMOTION component (e.g. CX32).</li></ul> <p>- cccc: Not used.</p> <p>Note:</p> <p>Connection type and connection number are described in F01375.</p> <p>See also: p0097 (Select drive object type), r0098 (Actual device topology), p0099 (Device target topology)</p>
<b>Remedy:</b>	<ul style="list-style-type: none"><li>- adapt the output topology to the permissible requirements.</li><li>- carry out commissioning using the commissioning software.</li><li>- for motors with DRIVE-CLiQ, connect the power and DRIVE-CLiQ cable to the same Motor Module (Single Motor Module: DRIVE-CLiQ at X202, Double Motor Module: DRIVE-CLiQ from motor 1 (X1) to X202, from motor 2 (X2) to X203).</li></ul>

Re aa = 06 hex = 6 dec and bb = 01 hex = 1 dec:

Correct the order number when commissioning using the commissioning software.

See also: p0097 (Select drive object type), r0098 (Actual device topology), p0099 (Device target topology)

<b>A01331</b>	<b>Topology: At least one component not assigned to a drive object</b>
<b>Message value:</b>	Component number: %1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	At least one component is not assigned to a drive object. - when commissioning, a component was not able to be automatically assigned to a drive object. - the parameters for the data sets are not correctly set. Alarm value (r2124, interpret decimal): Component number of the unassigned component.
<b>Remedy:</b>	This component is assigned to a drive object. Check the parameters for the data sets. Examples: - power unit (p0121). - motor (p0131, p0186). - encoder interface (p0140, p0141, p0187 ... p0189). - encoder (p0140, p0142, p0187 ... p0189). - Terminal Module (p0151). - option board (p0161).
<b>F01340</b>	<b>Topology: Too many components on one line</b>
<b>Message value:</b>	Component number or connection number: %1, fault cause: %2
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	For the selected communications clock cycle, too many DRIVE-CLiQ components are connected to one line of the Control Unit. Fault value (r0949, interpret hexadecimal): xyy hex: x = fault cause, yy = component number or connection number. 1yy: The communications clock cycle of the DRIVE-CLiQ connection on the Control Unit is not sufficient for all read transfers. 2yy: The communications clock cycle of the DRIVE-CLiQ connection on the Control Unit is not sufficient for all write transfers. 3yy: Cyclic communication is fully utilized. 4yy: The DRIVE-CLiQ cycle starts before the earliest end of the application. An additional dead time must be added to the control. Sign-of-life errors can be expected. The conditions of operation with a current controller sampling time of 31.25 µs have not been maintained. 5yy: Internal buffer overflow for net data of a DRIVE-CLiQ connection. 6yy: Internal buffer overflow for receive data of a DRIVE-CLiQ connection. 7yy: Internal buffer overflow for send data of a DRIVE-CLiQ connection. 8yy: The component clock cycles cannot be combined with one another 900: The lowest common multiple of the clock cycles in the system is too high to be determined. 901: The lowest common multiple of the clock cycles in the system cannot be generated with the hardware.

**Remedy:**

- check the DRIVE-CLiQ connection.
- Reduce the number of components on the DRIVE-CLiQ line involved and distribute these to other DRIVE-CLiQ sockets of the Control Unit. This means that communication is uniformly distributed over several lines.

Re fault value = 1yy - 4yy in addition:

- increase the sampling times (p0112, p0115, p4099). If necessary, for DCC or FBLOCKS, change the assignment of the run-time group (p21000, p20000) so that the sampling time (r21001, r20001) is increased.
- if necessary, reduce the number of cyclically calculated blocks (DCC) and/or function blocks (FBLOCKS).
- reduce the function modules (r0108).
- establish the conditions for operation with a current controller sampling time of 31.25 µs (at the DRIVE-CLiQ line, only operate Motor Modules and Sensor Modules with this sampling time and only use a permitted Sensor Module (e.g. SMC20, this means a 3 at the last position of the order number)).
- For an NX, the corresponding Sensor Module for a possibly existing second measuring system should be connected to a free DRIVE-CLiQ socket of the NX.

Re fault value = 8yy in addition:

- check the clock cycles settings (p0112, p0115, p4099). Clock cycles on a DRIVE-CLiQ line must be perfect integer multiples of one another. As clock cycle on a line, all clock cycles of all drive objects in the previously mentioned parameters apply, which have components on the line involved.

Re fault value = 9yy in addition:

- check the clock cycles settings (p0112, p0115, p4099). The lower the numerical value difference between two clock cycles, the higher the lowest common multiple. This behavior has a significantly stronger influence, the higher the numerical values of the clock cycles.

---

**F01341      Topology: Maximum number of DRIVE-CLiQ components exceeded**

**Message value:** -

**Drive object:** All objects

**Reaction:** NONE

**Acknowledge:** IMMEDIATELY

**Cause:** Too many DRIVE-CLiQ components were defined in the actual topology.  
Note:  
Pulse enable is withdrawn and prevented.

**Remedy:**

- check the DRIVE-CLiQ connection.
- reduce the number components on the DRIVE-CLiQ line involved in order to maintain the maximum quantity structure.

---

**F01354      Topology: Actual topology indicates an illegal component**

**Message value:** Fault cause: %1, component number: %2

**Drive object:** All objects

**Reaction:** OFF2

**Acknowledge:** IMMEDIATELY

**Cause:** The actual topology indicates at least one illegal component.  
Fault value (r0949, interpret hexadecimal):  
yyxx hex: yy = component number, xx = cause.  
xx = 1: Component at this Control Unit not permissible.  
xx = 2: Component in combination with another component not permissible.  
Note:  
Pulse enable is prevented.

**Remedy:** Remove the illegal components and restart the system.

---

**F01355      Topology: Actual topology changed**

**Message value:** %1

**Drive object:** All objects

**Reaction:** NONE

**Acknowledge:** IMMEDIATELY

**Cause:** The device target topology (p0099) does not correspond to the device actual topology (r0098).  
The fault only occurs if the topology was commissioned using the automatic internal device mechanism and not using the commissioning software.  
Fault value (r0949, interpret decimal):  
Only for internal Siemens troubleshooting.  
See also: r0098 (Actual device topology), p0099 (Device target topology)

**Remedy:** One of the following counter-measures can be selected if no faults have occurred in the topology detection itself:  
 If commissioning is still not completed:  
 - carry out a self-commissioning routine (starting from p0009 = 1).  
 In general:  
 Set p0099 = r0098, set p0009 = 0; for existing Motor Modules, this results in servo drives being automatically generated (p0107).  
 Generating servo drives: Set p0097 to 1, set p0009 to 0.  
 Generating vector drives: Set p0097 to 2, set p0009 to 0.  
 Generating vector drives with parallel circuit: Set p0097 to 12, set p0009 to 0.  
 In order to set configurations in p0108, before setting p0009 to 0, it is possible to first set p0009 to 2 and modify p0108. The index corresponds to the drive object (p0107).  
 If commissioning has already been completed:  
 - re-establish the original connections and re-connect power to the Control Unit.  
 - restore the factory setting for the complete equipment (all of the drives) and allow automatic self-commissioning again.  
 - change the device parameterization to match the connections (this is only possible using the commissioning software).  
**Notice:**  
 Topology changes that result in this fault being generated cannot be accepted by the automatic function in the device, but must be transferred using the commissioning software and parameter download. The automatic function in the device only allows constant topology to be used. Otherwise, when the topology is changed, all of the previous parameter settings are lost and replaced by the factory setting.  
 See also: r0098 (Actual device topology)

---

**F01356 Topology: There is a defective DRIVE-CLiQ component**

**Message value:** Fault cause: %1, Component number: %2, Connection number: %3  
**Drive object:** All objects  
**Reaction:** OFF2  
**Acknowledge:** IMMEDIATELY  
**Cause:** The actual topology indicates at least one defective DRIVE-CLiQ component.  
 Fault value (r0949, interpret hexadecimal):  
 zzyyxx hex:  
 zz = connection number of the component at which the defective component is connected  
 yy = component number of the component at which the defective component is connected  
 xx = fault cause  
 xx = 1: Component at this Control Unit not permissible.  
 xx = 2: component with communication defect.  
**Note:**  
 Pulse enable is withdrawn and prevented.  
**Remedy:** Replace the defective component and restart the system.

---

**F01357 Topology: Two Control Units identified on the DRIVE-CLiQ line**

**Message value:** component number: %1, connection number: %2  
**Drive object:** All objects  
**Reaction:** OFF2  
**Acknowledge:** IMMEDIATELY  
**Cause:** In the actual topology, 2 Control Units are connected with one another through DRIVE-CLiQ. This is not permitted.  
 Fault value (r0949, interpret hexadecimal):  
 yyxx hex:  
 yy = connection number of the Control Unit at which the second Control Unit is connected  
 xx = component number of the Control Unit at which the second Control Unit is connected  
**Note:**  
 Pulse enable is withdrawn and prevented.  
**Remedy:**  
 - remove the second Control Unit and restart the system.  
 - for the component DRIVE-CLiQ extension, interchange the hybrid cable (IN/OUT).

---

<b>A01358</b>	<b>Topology: Line termination not available</b>
<b>Message value:</b>	CU connection number: %1, component number: %2, connection number: %3
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	At least one line with distributed drives is not terminated. The last participant on the line must be terminated with a line termination connector. This therefore ensures the degree of protection of the distributed drives. Fault value (r0949, interpret hexadecimal): zzyyxx hex: zz = connection number of the distributed drive where there is no terminating connector yy = component number xx = CU connection number
<b>Remedy:</b>	Install the line terminating connector for the last distributed drive.

---

<b>F01359</b>	<b>Topology: DRIVE-CLiQ performance not sufficient</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	The DRIVE-CLiQ performance is not sufficient at one line in order to identify an inserted component. Fault value (r0949, interpret hexadecimal): Only for internal Siemens troubleshooting.
<b>Remedy:</b>	- carry out a POWER ON (power off/on). - Distribute components across several DRIVE-CLiQ lines. Note: For this topology, do not withdraw and insert components in operation.

---

<b>F01360</b>	<b>Topology: Actual topology not permissible</b>
<b>Message value:</b>	Fault cause: %1, preliminary component number: %2
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	The detected actual topology is not permissible. Fault value (r0949, interpret hexadecimal): ccccbbaa hex: cccc = preliminary component number, bb = no significance, aa = fault cause aa = 01 hex = 1 dec: Too many components were detected at the Control Unit. A maximum of 199 components is permissible. aa = 02 hex = 2 dec: The component type of a component is not known. aa = 03 hex = 3 dec: It is illegal to combine ALM and BLM. aa = 04 hex = 4 dec: It is illegal to combine ALM and SLM. aa = 05 hex = 5 dec: It is illegal to combine BLM and SLM. aa = 06 hex = 6 dec: A CX32 was not directly connected to a permitted Control Unit. aa = 07 hex = 7 dec: An NX10 or NX15 was not directly connected to a permitted Control Unit. aa = 08 hex = 8 dec: A component was connected to a Control Unit that is not permitted for this purpose. aa = 09 hex = 9 dec: A component was connected to a Control Unit with out-of-date firmware. aa = 0A hex = 10 dec: Too many components of a particular type detected. aa = 0B hex = 11 dec: Too many components of a particular type detected on a single line.

**Remedy:**

Note:  
The drive system is no longer booted. In this state, the drive control (closed-loop) cannot be enabled.

Re fault cause = 1:  
Change the configuration. Connect less than 199 components to the Control Unit.

Re fault cause = 2:  
Remove the component with unknown component type.

Re fault cause = 3, 4, 5:  
Establish a valid combination.

Re fault cause = 6, 7:  
Connect the expansion module directly to a permitted Control Unit.

Re fault cause = 8:  
Remove component or use a permissible component.

Re fault cause = 9:  
Upgrade the firmware of the Control Unit to a later version.

Re fault cause = 10, 11:  
Reduce the number of components.

---

**A01361**      **Topology: Actual topology contains SINUMERIK and SIMOTION components**

**Message value:**    %1

**Drive object:**      All objects

**Reaction:**          NONE

**Acknowledge:**      NONE

**Cause:**            The detected actual topology contains SINUMERIK and SIMOTION components.  
The drive system is no longer booted. In this state, the drive control (closed-loop) cannot be enabled.  
Alarm value (r2124, interpret hexadecimal):  
ddccbbaa hex: cc = fault cause, bb = component class of the actual topology, aa = component number of the component  
cc = 01 hex = 1 dec:  
An NX10 or NX15 was connected to a SIMOTION control.  
cc = 02 hex = 2 dec:  
A CX32 was connected to a SINUMERIK control.

**Remedy:**            Re alarm value = 1:  
Replace all NX10 or NX15 by a CX32.  
Re alarm value = 2:  
Replace all CX32 by an NX10 or NX15.

---

**A01362**      **Topology: Topology rule(s) broken**

**Message value:**    %1

**Drive object:**      All objects

**Reaction:**          NONE

**Acknowledge:**      NONE

**Cause:**            At least one topology rule for the SINAMICS S120 Combi has been broken.  
In the event of a fault, the ramping up of the drive system is aborted and closed-loop drive control is not enabled.  
Alarm value (r2124, interpret decimal):  
The alarm value indicates which rule has been violated.

- 1: The S120 Combi may only be wired via DRIVE-CLiQ socket X200 to X100 on the NCU.
- 2: Only one Single Motor Module (SMM) or one Double Motor Module (DMM) may be connected via X200 to the DRIVE-CLiQ socket X101 on the NCU.
- 3: Only one Terminal Module 54F (TM54F) or one DRIVE-CLiQ Hub Module (hub) may be connected via X500 to the DRIVE-CLiQ socket X102 on the NCU.
- 4: Only Sensor Modules may be connected to DRIVE-CLiQ sockets X201 up to X203 (3-axis) or X204 (4-axis) on the S120 Combi.
- 5: Only one Sensor Module, type SMC20 or SME20 may be connected to DRIVE-CLiQ socket X205 (X204 is not available for 3-axis).
- 6: If a Single Motor Module is being used as the first expansion axis, only one more Single Motor Module may be connected (via X200 to X201 on the first Single Motor Module).
- 7: Only Sensor Modules may be connected to the corresponding DRIVE-CLiQ socket X202 on any Single Motor Modules which may be present.
- 8: For a second Single Motor Module or for a Double Motor Module, it is not permissible to connect anything at X201.
- 9: If a Double Motor Module is used as an expansion axis, only Sensor Modules may be connected to X202 and X203.



- 10: If a Terminal Module 54F (TM54F) is configured, only one DRIVE-CLiQ Hub Module (DMC20, DME20) may be connected to X501 of the TM54F module via DRIVE-CLiQ socket X500.
- 11: On the DRIVE-CLiQ Hub Module, only Sensor Modules Cabinet (SMC) and Sensor Modules External (SME) may be connected to X501 through X505.
- 12: Only certain Motor Modules may be used for expansion axes.
- 13: For an S120 Combi with 3 axes, nothing must be connected at the DRIVE-CLiQ Hub Module at X503.
- Remedy:** Evaluate the alarm value and ensure compliance with the corresponding topology rule(s).

---

**F01375      Topology: Actual topology, duplicate connection between two components**

**Message value:** Preliminary component number: %1, component class: %2, connection number: %3

**Drive object:** All objects

**Reaction:** NONE

**Acknowledge:** IMMEDIATELY

**Cause:** When detecting the actual topology, a ring-type connection was detected.  
Fault value (r0949, interpret hexadecimal):  
ccbbaaaa hex:  
cc = connection number  
bb = component class  
aaaa = preliminary component number of a component included in the ring  
Component class:  
1: Control Unit.  
2: Motor Module.  
3: Line Module.  
4: Sensor Module (SM).  
5: Voltage Sensing Module (VSM).  
6: Terminal Module (TM).  
7: DRIVE-CLiQ Hub Module.  
8: Controller Extension 32 (CX32, NX10, NX15).  
9: Filter Module.  
10: Hydraulic Module.  
49: DRIVE-CLiQ components (non-listed components).  
50: Option Slot (e.g. Terminal Board 30).  
60: Encoder (e.g. EnDat).  
70: Motor with DRIVE-CLiQ.  
71: Hydraulic Cylinder.  
72: Hydraulic Valve.  
Component type:  
Precise designation within a component class (e.g. "SMC20").  
Connection number:  
Consecutive numbers, starting from zero, of the appropriate connection or slot (e.g. DRIVE-CLiQ connection X100 on the Control Unit has the connection number 0).

**Remedy:** Output the fault value and remove the specified connection.  
Note:  
Under "Topology --> Topology view" the commissioning software where relevant offers improved diagnostics capability (e.g. setpoint/actual value comparison).

---

**F01380      Topology: Actual topology, defective EEPROM**

**Message value:** Preliminary component number: %1

**Drive object:** All objects

**Reaction:** NONE

**Acknowledge:** POWER ON

**Cause:** When detecting the actual topology, a component with a defective EEPROM was detected.  
Fault value (r0949, interpret hexadecimal):  
bbbbaaaa hex:  
aaaa = preliminary component number of the defective components

**Remedy:** Output the fault value and remove the defected component.

<b>A01381</b>	<b>Topology: Comparison power unit shifted</b>
<b>Message value:</b>	Component number: %1, component class: %2, component number: %3, connection number: %4
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>The topology comparison has detected a power unit in the actual topology that has been shifted with respect to the target topology.</p> <p>Alarm value (r2124, interpret hexadecimal): ddccbbaa hex: dd = connection number cc = component number bb = component class aa = component number of the component shifted in the target topology</p> <p>Note: The connection in the actual topology where the shifted component was detected is described in dd, cc and bb. Component class and connection number are described in F01375. The drive system is no longer booted. In this state, the drive control (closed-loop) cannot be enabled.</p>
<b>Remedy:</b>	<p>Adapting the topologies:</p> <ul style="list-style-type: none"> <li>- undo the change to the actual topology by changing over the DRIVE-CLiQ cables.</li> <li>- commissioning software: Go online, upload the drive unit, adapt the topology offline and download the modified project.</li> <li>- automatically remove the topology error (p9904).</li> </ul> <p>Note: Under "Topology --&gt; Topology view" the commissioning software where relevant offers improved diagnostics capability (e.g. setpoint/actual value comparison).</p>
<b>A01382</b>	<b>Topology: Comparison Sensor Module shifted</b>
<b>Message value:</b>	Component number: %1, component class: %2, component number: %3, connection number: %4
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>The topology comparison has detected a Sensor Module in the actual topology that has been shifted with respect to the target topology.</p> <p>Alarm value (r2124, interpret hexadecimal): ddccbbaa hex: dd = connection number cc = component number bb = component class aa = component number of the component shifted in the target topology</p> <p>Note: The connection in the actual topology where the shifted component was detected is described in dd, cc and bb. Component class and connection number are described in F01375. The drive system is no longer booted. In this state, the drive control (closed-loop) cannot be enabled.</p>
<b>Remedy:</b>	<p>Adapting the topologies:</p> <ul style="list-style-type: none"> <li>- undo the change to the actual topology by changing over the DRIVE-CLiQ cables.</li> <li>- commissioning software: Go online, upload the drive unit, adapt the topology offline and download the modified project.</li> <li>- automatically remove the topology error (p9904).</li> </ul> <p>Note: Under "Topology --&gt; Topology view" the commissioning software where relevant offers improved diagnostics capability (e.g. setpoint/actual value comparison).</p>
<b>A01383</b>	<b>Topology: Comparison Terminal Module shifted</b>
<b>Message value:</b>	Component number: %1, component class: %2, component number: %3, connection number: %4
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>The topology comparison has detected a Terminal Module in the actual topology that has been shifted with respect to the target topology.</p>

Alarm value (r2124, interpret hexadecimal):

ddccbbaa hex:

dd = connection number

cc = component number

bb = component class

aa = component number of the component shifted in the target topology

Note:

The connection in the actual topology where the shifted component was detected is described in dd, cc and bb.

Component class and connection number are described in F01375.

The drive system is no longer booted. In this state, the drive control (closed-loop) cannot be enabled.

**Remedy:**

Adapting the topologies:

- undo the change to the actual topology by changing over the DRIVE-CLiQ cables.

- commissioning software: Go online, upload the drive unit, adapt the topology offline and download the modified project.

- automatically remove the topology error (p9904).

Note:

Under "Topology --> Topology view" the commissioning software where relevant offers improved diagnostics capability (e.g. setpoint/actual value comparison).

**A01384**

**Topology: Comparison DRIVE-CLiQ Hub Module shifted**

**Message value:**

Component number: %1, component class: %2, component number: %3, connection number: %4

**Drive object:**

All objects

**Reaction:**

NONE

**Acknowledge:**

NONE

**Cause:**

The topology comparison has detected a DRIVE-CLiQ Hub Module in the actual topology that has been shifted with respect to the target topology.

Alarm value (r2124, interpret hexadecimal):

ddccbbaa hex:

dd = connection number

cc = component number

bb = component class

aa = component number of the component shifted in the target topology

Note:

The connection in the actual topology where the shifted component was detected is described in dd, cc and bb.

Component class and connection number are described in F01375.

The drive system is no longer booted. In this state, the drive control (closed-loop) cannot be enabled.

**Remedy:**

Adapting the topologies:

- undo the change to the actual topology by changing over the DRIVE-CLiQ cables.

- commissioning software: Go online, upload the drive unit, adapt the topology offline and download the modified project.

- automatically remove the topology error (p9904).

Note:

Under "Topology --> Topology view" the commissioning software where relevant offers improved diagnostics capability (e.g. setpoint/actual value comparison).

**A01385**

**Topology: Comparison CX32 shifted**

**Message value:**

Component number: %1, component class: %2, component number: %3, connection number: %4

**Drive object:**

All objects

**Reaction:**

NONE

**Acknowledge:**

NONE

**Cause:**

The topology comparison has detected a controller extension 32 (CX32) in the actual topology that has been shifted with respect to the target topology.

Alarm value (r2124, interpret hexadecimal):

ddccbbaa hex:

dd = connection number

cc = component number

bb = component class

aa = component number of the component shifted in the target topology

Note:

The connection in the actual topology where the shifted component was detected is described in dd, cc and bb. Component class and connection number are described in F01375.

The drive system is no longer booted. In this state, the drive control (closed-loop) cannot be enabled.

**Remedy:**

Adapting the topologies:

- undo the change to the actual topology by changing over the DRIVE-CLiQ cables.

- commissioning software: Go online, upload the drive unit, adapt the topology offline and download the modified project.

- automatically remove the topology error (p9904).

Note:

Under "Topology --> Topology view" the commissioning software where relevant offers improved diagnostics capability (e.g. setpoint/actual value comparison).

**A01386**

**Topology: Comparison DRIVE-CLiQ component shifted**

**Message value:**

Component number: %1, component class: %2, component number: %3, connection number: %4

**Drive object:**

All objects

**Reaction:**

NONE

**Acknowledge:**

NONE

**Cause:**

The topology comparison has detected a DRIVE-CLiQ component in the actual topology that has been shifted with respect to the target topology.

Alarm value (r2124, interpret hexadecimal):

ddccbbaa hex:

dd = connection number

cc = component number

bb = component class

aa = component number of the component shifted in the target topology

Note:

The connection in the actual topology where the shifted component was detected is described in dd, cc and bb. Component class and connection number are described in F01375.

The drive system is no longer booted. In this state, the drive control (closed-loop) cannot be enabled.

**Remedy:**

Adapting the topologies:

- undo the change to the actual topology by changing over the DRIVE-CLiQ cables.

- commissioning software: Go online, upload the drive unit, adapt the topology offline and download the modified project.

- automatically remove the topology error (p9904).

Note:

Under "Topology --> Topology view" the commissioning software where relevant offers improved diagnostics capability (e.g. setpoint/actual value comparison).

**A01387**

**Topology: Comparison option slot component shifted**

**Message value:**

Component number: %1, component class: %2, component number: %3, connection number: %4

**Drive object:**

All objects

**Reaction:**

NONE

**Acknowledge:**

NONE

**Cause:**

The topology comparison has detected a option slot component in the actual topology that has been shifted with respect to the target topology.

Alarm value (r2124, interpret hexadecimal):

ddccbbaa hex:

dd = connection number

cc = component number

bb = component class

aa = component number of the component shifted in the target topology

Note:

The connection in the actual topology where the shifted component was detected is described in dd, cc and bb. Component class and connection number are described in F01375.

The drive system is no longer booted. In this state, the drive control (closed-loop) cannot be enabled.

**Remedy:**

Adapting the topologies:

- undo the change to the actual topology by changing over the DRIVE-CLiQ cables.

- commissioning software: Go online, upload the drive unit, adapt the topology offline and download the modified project.

- automatically remove the topology error (p9904).

Note:  
Under "Topology --> Topology view" the commissioning software where relevant offers improved diagnostics capability (e.g. setpoint/actual value comparison).

---

<b>A01388</b>	<b>Topology: Comparison EnDat encoder shifted</b>
<b>Message value:</b>	Component number: %1, component class: %2, component number: %3, connection number: %4
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>The topology comparison has detected an EnDat encoder in the actual topology that has been shifted with respect to the target topology.</p> <p>Alarm value (r2124, interpret hexadecimal): ddccbbaa hex: dd = connection number cc = component number bb = component class aa = component number of the component shifted in the target topology</p> <p>Note: The connection in the actual topology where the shifted component was detected is described in dd, cc and bb. Component class and connection number are described in F01375. The drive system is no longer booted. In this state, the drive control (closed-loop) cannot be enabled.</p>
<b>Remedy:</b>	<p>Adapting the topologies: - undo the change to the actual topology by changing over the DRIVE-CLiQ cables. - commissioning software: Go online, upload the drive unit, adapt the topology offline and download the modified project. - automatically remove the topology error (p9904).</p> <p>Note: Under "Topology --&gt; Topology view" the commissioning software where relevant offers improved diagnostics capability (e.g. setpoint/actual value comparison).</p>

---

<b>A01389</b>	<b>Topology: Comparison motor with DRIVE-CLiQ shifted</b>
<b>Message value:</b>	Component number: %1, component class: %2, component number: %3, connection number: %4
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>The topology comparison has detected a motor with DRIVE-CLiQ in the actual topology that has been shifted with respect to the target topology.</p> <p>Alarm value (r2124, interpret hexadecimal): ddccbbaa hex: dd = connection number cc = component number bb = component class aa = component number of the component shifted in the target topology</p> <p>Note: The connection in the actual topology where the shifted component was detected is described in dd, cc and bb. Component class and connection number are described in F01375. The drive system is no longer booted. In this state, the drive control (closed-loop) cannot be enabled.</p>
<b>Remedy:</b>	<p>Adapting the topologies: - undo the change to the actual topology by changing over the DRIVE-CLiQ cables. - commissioning software: Go online, upload the drive unit, adapt the topology offline and download the modified project. - automatically remove the topology error (p9904).</p> <p>Note: Under "Topology --&gt; Topology view" the commissioning software where relevant offers improved diagnostics capability (e.g. setpoint/actual value comparison).</p>

<b>A01416</b>	<b>Topology: Comparison additional component in actual topology</b>
<b>Message value:</b>	Component number: %1, Component class: %2, Connection number: %3
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>The topology comparison has found a component in the actual topology which is not specified in the target topology. The alarm value includes the component number and connection number of the component with which the additional component is connected.</p> <p>Alarm value (r2124, interpret hexadecimal):</p> <p>ddccbbaa hex:</p> <p>cc = connection number</p> <p>bb = component class of the additional component</p> <p>aa = component number</p> <p>Note:</p> <ul style="list-style-type: none"> <li>- component class and connection number are described in F01375.</li> <li>- components that are connected to this additional component are not operational.</li> </ul>
<b>Remedy:</b>	<p>Adapting the topologies:</p> <ul style="list-style-type: none"> <li>- remove the additional component in the actual topology.</li> <li>- download the target topology that matches the actual topology (commissioning software).</li> </ul> <p>Note:</p> <p>Under "Topology --&gt; Topology view" the commissioning software where relevant offers improved diagnostics capability (e.g. setpoint/actual value comparison).</p>
<b>A01420</b>	<b>Topology: Comparison a component is different</b>
<b>Message value:</b>	Component number: %1, component class target: %2, component class actual: %3, fault cause: %4
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>The topology comparison has detected differences in the actual and target topologies in relation to one component. There are differences in the electronic rating plate.</p> <p>Alarm value (r2124, interpret hexadecimal):</p> <p>ddccbbaa hex: aa = component number of the component, bb = component class of the target topology, cc = component class of the actual topology, dd = fault cause</p> <p>dd = 01 hex = 1 dec:</p> <p>Different component type.</p> <p>dd = 02 hex = 2 dec:</p> <p>Different Order No.</p> <p>dd = 03 hex = 3 dec:</p> <p>Different manufacturer.</p> <p>dd = 04 hex = 4 dec:</p> <p>Connection changed over for a multi-component slave (e.g. Double Motor Module), defective EEPROM data in the electronic rating plate, or only part of a multi-component slave set to "de-activate and not present".</p> <p>dd = 05 hex = 5 dec:</p> <p>A CX32 was replaced by an NX10 or NX15.</p> <p>dd = 06 hex = 6 dec:</p> <p>An NX10 or NX15 was replaced by a CX32.</p> <p>dd = 07 hex = 7 dec:</p> <p>A component was replaced by another component with a different number of ports.</p> <p>Note:</p> <p>Component class and component type are described in F01375.</p> <p>The drive system is no longer booted. In this state, the drive control (closed-loop) cannot be enabled.</p>
<b>Remedy:</b>	<p>Adapting the topologies:</p> <ul style="list-style-type: none"> <li>- check the component soft-wired connections against the hardware configuration of the drive unit in the commissioning software and correct differences.</li> <li>- parameterize the topology comparison of all components (p9906).</li> <li>- parameterize the topology comparison of one components (p9907, p9908).</li> </ul> <p>Note:</p> <p>Under "Topology --&gt; Topology view" the commissioning software where relevant offers improved diagnostics capability (e.g. setpoint/actual value comparison).</p>

<hr/>	
<b>A01421</b>	<b>Topology: Comparison different components</b>
<b>Message value:</b>	Component number: %1, component class target: %2, component class actual: %3, fault cause: %4
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>The topology comparison has detected differences in the actual and target topologies in relation to one component. The component class, the component type or the number of connections differ.</p> <p>Alarm value (r2124, interpret hexadecimal): ddccbbaa hex: aa = component number of the component, bb = component class of the target topology, cc = component class of the actual topology, dd = fault cause dd = 01 hex = 1 dec: Different component class. dd = 02 hex = 2 dec: Different component type. dd = 03 hex = 3 dec: Different Order No. dd = 04 hex = 4 dec: Different number of connections.</p> <p>Note: Component class, component type and connection number are described in F01375. The drive system is no longer booted. In this state, the drive control (closed-loop) cannot be enabled.</p>
<b>Remedy:</b>	<p>Check the component soft-wired connections against the hardware configuration of the drive unit in the commissioning software and correct differences.</p> <p>Note: Under "Topology --&gt; Topology view" the commissioning software where relevant offers improved diagnostics capability (e.g. setpoint/actual value comparison).</p>
<hr/>	
<b>A01425</b>	<b>Topology: Comparison serial number of a component is different</b>
<b>Message value:</b>	Component number: %1, Component class: %2, Differences: %3
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>The topology comparison has detected differences in the actual and target topologies in relation to one component. The serial number is different.</p> <p>Alarm value (r2124, interpret hexadecimal): ddccbbaa hex: cc = number of differences bb = component class aa = component number of the component</p> <p>Note: The component class is described in F01375. The drive system is no longer booted. In this state, the drive control (closed-loop) cannot be enabled.</p>
<b>Remedy:</b>	<p>Adapting the topologies: - change over the actual topology to match the target topology. - download the target topology that matches the actual topology (commissioning software).</p> <p>Re byte cc: cc = 1 --&gt; can be acknowledged using p9904 or p9905. cc &gt; 1 --&gt; can be acknowledged using p9905 and can be de-activated using p9906 or p9907/p9908.</p> <p>Note: Under "Topology --&gt; Topology view" the commissioning software where relevant offers improved diagnostics capability (e.g. setpoint/actual value comparison). See also: p9904 (Topology comparison acknowledge differences), p9905 (Device specialization), p9906 (Topology comparison comparison stage of all components), p9907 (Topology comparison comparison stage of the component number), p9908 (Topology comparison comparison stage of a component)</p>

<b>A01428</b>	<b>Topology: Comparison connection of a component is different</b>
<b>Message value:</b>	Component number: %1, Component class: %2, Connection number1: %3, Connection number2: %4
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>The topology comparison has detected differences in the actual and target topologies in relation to one component. A component was connected to another connection.</p> <p>The different connections of a component are described in the alarm value:</p> <p>Alarm value (r2124, interpret hexadecimal):</p> <p>ddccbbaa hex:</p> <p>dd = connection number of the target topology</p> <p>cc = connection number of the actual topology</p> <p>bb = component class</p> <p>aa = component number</p> <p>Note:</p> <p>Component class and connection number are described in F01375.</p> <p>The drive system is no longer booted. In this state, the drive control (closed-loop) cannot be enabled.</p>
<b>Remedy:</b>	<p>Adapting the topologies:</p> <ul style="list-style-type: none"> <li>- change over the actual topology to match the target topology.</li> <li>- download the target topology that matches the actual topology (commissioning software).</li> <li>- automatically remove the topology error (p9904).</li> </ul> <p>Note:</p> <p>Under "Topology --&gt; Topology view" the commissioning software where relevant offers improved diagnostics capability (e.g. setpoint/actual value comparison).</p> <p>See also: p9904 (Topology comparison acknowledge differences)</p>
<b>A01429</b>	<b>Topology: Comparison connection is different for more than one component</b>
<b>Message value:</b>	Component number: %1, Component class: %2, Connection number1: %3, Connection number2: %4
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>A topology comparison has found differences between the actual and target topology for several components. A component was connected to another connection.</p> <p>The different connections of a component are described in the alarm value:</p> <p>Alarm value (r2124, interpret hexadecimal):</p> <p>ddccbbaa hex:</p> <p>dd = connection number of the target topology</p> <p>cc = connection number of the actual topology</p> <p>bb = component class</p> <p>aa = component number</p> <p>Note:</p> <p>Component class and connection number are described in F01375.</p> <p>The drive system is no longer booted. In this state, the drive control (closed-loop) cannot be enabled.</p>
<b>Remedy:</b>	<p>Adapting the topologies:</p> <ul style="list-style-type: none"> <li>- change over the actual topology to match the target topology.</li> <li>- download the target topology that matches the actual topology (commissioning software).</li> </ul> <p>Note:</p> <p>In the software, a Double Motor Module behaves just like two separate DRIVE-CLiQ nodes. If a Double Motor Module is re-inserted, this can result in several differences in the actual topology.</p> <p>Under "Topology --&gt; Topology view" the commissioning software where relevant offers improved diagnostics capability (e.g. setpoint/actual value comparison).</p>
<b>F01451</b>	<b>Topology: Target topology is invalid</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>An error was detected in the target topology.</p> <p>The target topology is invalid.</p>



Fault value (r0949, interpret hexadecimal):  
ccccbbaa hex: cccc = index error, bb = component number, aa = fault cause  
aa = 1B hex = 27 dec: Error not specified.  
aa = 1C hex = 28 dec: Value illegal.  
aa = 1D hex = 29 dec: Incorrect ID.  
aa = 1E hex = 30 dec: Incorrect ID length.  
aa = 1F hex = 31 dec: Too few indices left.  
aa = 20 hex = 32 dec: component not connected to Control Unit.

**Remedy:** Reload the target topology using the commissioning software.

---

**F01470      Topology: Target topology ring-type connection detected**

**Message value:** Component number: %1, Component class: %2, Connection number: %3

**Drive object:** All objects

**Reaction:** NONE

**Acknowledge:** IMMEDIATELY

**Cause:** A ring-type connection was detected when writing to the target topology.  
Fault value (r0949, interpret hexadecimal):

ddccbbaa hex:  
cc = connection number  
bb = component class  
aa = component number of a component included in the ring

Note:  
Component class and connection number are described in F01375.

**Remedy:** Read out the fault value and remove one of the specified connections.  
Then download the target topology again using the commissioning software.  
Note:  
Under "Topology --> Topology view" the commissioning software where relevant offers improved diagnostics capability (e.g. setpoint/actual value comparison).

---

**F01475      Topology: Target topology duplicate connection between two components**

**Message value:** Component number: %1, Component class: %2, Connection number1: %3, Connection number2: %4

**Drive object:** All objects

**Reaction:** NONE

**Acknowledge:** IMMEDIATELY

**Cause:** When writing the target topology, a duplicate connection between two components was detected.  
Fault value (r0949, interpret hexadecimal):

ddccbbaa hex:  
dd = connection number 2 of the duplicate connection  
cc = connection number 1 of the duplicate connection  
bb = component class  
aa = component number of one of the components connected twice

Note:  
Component class and connection number are described in F01375.

**Remedy:** Read out the fault value and remove one of the two specified connections.  
Then download the target topology again using the commissioning software.  
Note:  
Under "Topology --> Topology view" the commissioning software where relevant offers improved diagnostics capability (e.g. setpoint/actual value comparison).

---

**A01481      Topology: Comparison power unit missing in the actual topology**

**Message value:** Component number: %1

**Drive object:** All objects

**Reaction:** NONE

**Acknowledge:** NONE

**Cause:** The topology comparison has detected a power unit in the target topology that is not available in the actual topology.  
Alarm value (r2124, interpret decimal):  
Component number of the additional target components.

- Remedy:**
- delete the drive belonging to the power unit in the commissioning software project and download the new configuration to the drive unit.
  - check that the actual topology matches the target topology and if required, change over.
  - check DRIVE-CLiQ cables for interruption and contact problems.
  - check the 24 V supply voltage.
  - check that the power unit is working properly.

Note:

Under "Topology --> Topology view" the commissioning software where relevant offers improved diagnostics capability (e.g. setpoint/actual value comparison).

---

**A01482      Topology: Comparison Sensor Module missing in the actual topology**

**Message value:** Component number: %1

**Drive object:** All objects

**Reaction:** NONE

**Acknowledge:** NONE

**Cause:** The topology comparison has detected a Sensor Module in the target topology that is not available in the actual topology.

Alarm value (r2124, interpret decimal):

Component number of the additional target components.

- Remedy:**
- re-configure the drive belonging to the Sensor Module in the commissioning software project (encoder configuration) and download the new configuration to the drive unit.
  - delete the drive belonging to the Sensor Module in the commissioning software project and download the new configuration to the drive unit.
  - check that the actual topology matches the target topology and if required, change over.
  - check DRIVE-CLiQ cables for interruption and contact problems.
  - check the 24 V supply voltage.
  - check that the Sensor Module is working properly.

Note:

Under "Topology --> Topology view" the commissioning software where relevant offers improved diagnostics capability (e.g. setpoint/actual value comparison).

---

**A01483      Topology: Comparison Terminal Module missing in the actual topology**

**Message value:** Component number: %1

**Drive object:** All objects

**Reaction:** NONE

**Acknowledge:** NONE

**Cause:** The topology comparison has detected a Terminal Module in the target topology that is not available in the actual topology.

Alarm value (r2124, interpret decimal):

Component number of the additional target components.

- Remedy:**
- delete the Terminal Module in the commissioning software project and download the new configuration to the drive unit.
  - check that the actual topology matches the target topology and if required, change over.
  - check DRIVE-CLiQ cables for interruption and contact problems.
  - check the 24 V supply voltage.
  - check that the Terminal Module is working properly.

Note:

Under "Topology --> Topology view" the commissioning software where relevant offers improved diagnostics capability (e.g. setpoint/actual value comparison).

---

**A01484      Topology: Comparison DRIVE-CLiQ Hub Module missing in the actual topology**

**Message value:** Component number: %1

**Drive object:** All objects

**Reaction:** NONE

**Acknowledge:** NONE

**Cause:** The topology comparison has detected a DRIVE-CLiQ Hub Module in the target topology that does not exist in the actual topology.

Alarm value (r2124, interpret decimal):

Component number of the additional target components.

- Remedy:**
- delete the DRIVE-CLiQ Hub Module in the commissioning software project and download the new configuration to the drive unit.
  - check that the actual topology matches the target topology and if required, change over.
  - check DRIVE-CLiQ cables for interruption and contact problems.
  - check the 24 V supply voltage.
  - test the DRIVE-CLiQ Hub Module to ensure that it functions properly.

Note:

Under "Topology --> Topology view" the commissioning software where relevant offers improved diagnostics capability (e.g. setpoint/actual value comparison).

---

**A01485 Topology: Comparison CX32 missing in the actual topology**

**Message value:** Component number: %1

**Drive object:** All objects

**Reaction:** NONE

**Acknowledge:** NONE

**Cause:** The topology comparison has detected a controller extension 32 (CX32) in the target topology that is not available in the actual topology.

Alarm value (r2124, interpret decimal):

Component number of the additional target components.

- Remedy:**
- delete the CX32 / NX in the commissioning software project and download the new configuration to the drive unit.
  - check that the actual topology matches the target topology and if required, change over.
  - check DRIVE-CLiQ cables for interruption and contact problems.
  - check the 24 V supply voltage.
  - check that CX32/NX functions correctly.

Note:

Under "Topology --> Topology view" the commissioning software where relevant offers improved diagnostics capability (e.g. setpoint/actual value comparison).

---

**A01486 Topology: Comparison DRIVE-CLiQ components missing in the actual topology**

**Message value:** Component number: %1

**Drive object:** All objects

**Reaction:** NONE

**Acknowledge:** NONE

**Cause:** The topology comparison has detected a DRIVE-CLiQ component in the target topology that is not available in the actual topology.

Alarm value (r2124, interpret decimal):

Component number of the additional target components.

- Remedy:**
- delete the drive belonging to this component in the commissioning software project and download the new configuration to the drive unit.
  - re-configure the drive belonging to this component in the commissioning software project and download the new configuration to the drive unit.
  - check that the actual topology matches the target topology and if required, change over.
  - check DRIVE-CLiQ cables for interruption and contact problems.
  - check the 24 V supply voltage.
  - check that the component is working properly.

Note:

Under "Topology --> Topology view" the commissioning software where relevant offers improved diagnostics capability (e.g. setpoint/actual value comparison).

---

**A01487 Topology: Comparison option slot components missing in the actual topology**

**Message value:** Component number: %1

**Drive object:** All objects

**Reaction:** NONE

**Acknowledge:** NONE

**Cause:** The topology comparison has detected an option slot module in the target topology that is not available in the actual topology.

Alarm value (r2124, interpret decimal):

Component number of the additional target components.

- Remedy:**
- delete the option board in the commissioning software project and download the new configuration to the drive unit.
  - re-configure the drive unit in the commissioning software project and download the new configuration to the drive unit.
  - check that the actual topology matches the target topology and if required, change over.
  - check that the option board is functioning correctly

Note:

Under "Topology --> Topology view" the commissioning software where relevant offers improved diagnostics capability (e.g. setpoint/actual value comparison).

---

**A01488      Topology: Comparison EnDat encoder missing in the actual topology**

**Message value:** Component number: %1

**Drive object:** All objects

**Reaction:** NONE

**Acknowledge:** NONE

**Cause:** The topology comparison has detected an EnDat encoder in the target topology that is not available in the actual topology.

Alarm value (r2124, interpret decimal):

Component number of the additional target components.

- Remedy:**
- re-configure the drive belonging to the encoder in the commissioning software project (encoder configuration) and download the new configuration to the drive unit.
  - delete the drive belonging to the encoder in the commissioning software project and download the new configuration to the drive unit.
  - check that the actual topology matches the target topology and if required, change over.

Note:

Under "Topology --> Topology view" the commissioning software where relevant offers improved diagnostics capability (e.g. setpoint/actual value comparison).

---

**A01489      Topology: Comparison motor with DRIVE-CLiQ missing in the actual topology**

**Message value:** Component number: %1

**Drive object:** All objects

**Reaction:** NONE

**Acknowledge:** NONE

**Cause:** The topology comparison has detected a motor with DRIVE-CLiQ in the target topology that is not available in the actual topology.

Alarm value (r2124, interpret decimal):

Component number of the additional target components.

- Remedy:**
- re-configure the drive belonging to this motor in the commissioning software project and download the new configuration to the drive unit.
  - re-configure the drive belonging to this motor in the commissioning software project and download the new configuration to the drive unit.
  - check that the actual topology matches the target topology and if required, change over.
  - check DRIVE-CLiQ cables for interruption and contact problems.
  - check that the motor is working properly.

Note:

Under "Topology --> Topology view" the commissioning software where relevant offers improved diagnostics capability (e.g. setpoint/actual value comparison).

---

**F01505 (A)      BICO: Interconnection cannot be established**

**Message value:** Parameter: %1

**Drive object:** All objects

**Reaction:** NONE

**Acknowledge:** IMMEDIATELY

**Cause:** A PROFIdrive telegram has been set (p0922).

An interconnection contained in the telegram was not able to be established.

Fault value (r0949, interpret decimal):

Parameter receiver that should be changed.

**Remedy:** Establish another interconnection.

Reaction upon A: NONE

Acknowled. upon A: NONE

---

<b>F01506 (A)</b>	<b>BICO: No standard telegram</b>
<b>Message value:</b>	Parameter: %1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150, TM31
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	The standard telegram in p0922 is not maintained and therefore p0922 is set to 999. Fault value (r0949, interpret decimal): BICO parameter for which the write attempt was unsuccessful.
<b>Remedy:</b>	Again set the required standard telegram (p0922).
Reaction upon A:	NONE
Acknowl. upon A:	NONE

---

<b>A01507 (F, N)</b>	<b>BICO: Interconnections to inactive objects present</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	There are BICO interconnections to an inactive/inoperable drive object. The BI/CI parameters involved are listed in r9498. The associated BO/CO parameters are listed in r9499. The list of the BICO interconnections to other drive objects is displayed in r9491 and r9492 of the de-activated drive object. Note: r9498 and r9499 are only written to, if p9495 is not set to 0. Alarm value (r2124, interpret decimal): Number of BICO interconnections found to inactive drive objects.
<b>Remedy:</b>	- set all open BICO interconnections centrally to the factory setting with p9495 = 2. - make the non-operational drive object active/operational again (re-insert or activate components).
Reaction upon F:	OFF2 (IASC/DCBRK, NONE, OFF1, OFF3, STOP1, STOP2)
Acknowl. upon F:	IMMEDIATELY
Reaction upon N:	NONE
Acknowl. upon N:	NONE

---

<b>A01508</b>	<b>BICO: Interconnections to inactive objects exceeded</b>
<b>Message value:</b>	-
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	The maximum number of BICO interconnections (signal sinks) when de-activating a drive object was exceeded. When de-activating a drive object, all BICO interconnections (signal sinks) are listed in the following parameters: - r9498[0...29]: List of the BI/CI parameters involved. - r9499[0...29]: List of the associated BO/CO parameters.
<b>Remedy:</b>	The alarm automatically disappears as soon as no BICO interconnection (value = 0) is entered in r9498[29] and r9499[29]. Notice: When re-activating the drive object, all BICO interconnections should be checked and if required, re-established.

---

<b>F01510</b>	<b>BICO: Signal source is not float type</b>
<b>Message value:</b>	Parameter: %1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	The requested connector output does not have the correct data type. This interconnection is not established. Fault value (r0949, interpret decimal): Parameter number to which an interconnection should be made (connector output).
<b>Remedy:</b>	Interconnect this connector input with a connector output having a float data type.

<b>F01511 (A)</b>	<b>BICO: Interconnection with different scalings</b>
<b>Message value:</b>	Parameter: %1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>The requested BICO interconnection was established. However, a conversion is made between the BICO output and BICO input using the reference values.</p> <ul style="list-style-type: none"> <li>- the BICO output has different normalized units than the BICO input.</li> <li>- message only for interconnections within a drive object.</li> </ul> <p>Example:</p> <p>The BICO output has, as normalized unit, voltage and the BICO input has current.</p> <p>This means that the factor p2002/p2001 is calculated between the BICO output and the BICO input.</p> <p>p2002: contains the reference value for current</p> <p>p2001: contains the reference value for voltage</p> <p>Fault value (r0949, interpret decimal):</p> <p>Parameter number of the BICO input (signal sink).</p>
<b>Remedy:</b>	Not necessary.
Reaction upon A:	NONE
Acknowl. upon A:	NONE
<b>F01512</b>	<b>BICO: No scaling available</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	POWER ON
<b>Cause:</b>	<p>An attempt was made to determine a conversion factor for a scaling that does not exist.</p> <p>Fault value (r0949, interpret decimal):</p> <p>Unit (e.g. corresponding to SPEED) for which an attempt was made to determine a factor.</p>
<b>Remedy:</b>	Apply scaling or check the transfer value.
<b>F01513 (N, A)</b>	<b>BICO: Interconnection cross DO with different scalings</b>
<b>Message value:</b>	Parameter: %1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>The requested BICO interconnection was established. However, a conversion is made between the BICO output and BICO input using the reference values.</p> <p>An interconnection is made between different drive objects and the BICO output has different normalized units than the BICO input or the normalized units are the same but the reference values are different.</p> <p>Example 1:</p> <p>BICO output with voltage normalized unit, BICO input with current normalized unit, BICO output and BICO input lie in different drive objects. This means that the factor p2002/p2001 is calculated between the BICO output and the BICO input.</p> <p>p2002: contains the reference value for current</p> <p>p2001: contains the reference value for voltage</p> <p>Example 2:</p> <p>BICO output with voltage normalized unit in drive object 1 (DO1), BICO input with voltage normalized unit in drive object 2 (DO2). The reference values for voltage (p2001) of the two drive objects have different values. This means that the factor p2001(DO1)/p2001(DO2) is calculated between the BICO output and the BICO input.</p> <p>p2001: contains the reference value for voltage, drive objects 1, 2</p> <p>Fault value (r0949, interpret decimal):</p> <p>Parameter number of the BICO input (signal sink).</p>
<b>Remedy:</b>	Not necessary.
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE

---

<b>A01514 (F)</b>	<b>BICO: Error when writing during a reconnect</b>
<b>Message value:</b>	Parameter: %1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	During a reconnect operation (e.g. while booting or downloading - but can also occur in normal operation) a parameter was not able to be written to. Example: When writing to BICO input with double word format (DWORD), in the second index, the memory areas overlap (e.g. p8861). The parameter is then reset to the factory setting. Alarm value (r2124, interpret decimal): Parameter number of the BICO input (signal sink).
<b>Remedy:</b>	Not necessary.
Reaction upon F:	NONE
Acknowl. upon F:	IMMEDIATELY

---

<b>F01515 (A)</b>	<b>BICO: Writing to parameter not permitted as the master control is active</b>
<b>Message value:</b>	-
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	When changing the number of CDS or when copying from CDS, the master control is active.
<b>Remedy:</b>	If required, return the master control and repeat the operation.
Reaction upon A:	NONE
Acknowl. upon A:	NONE

---

<b>A01590 (F)</b>	<b>Drive: Motor maintenance interval expired</b>
<b>Message value:</b>	Fault cause: %1 bin
<b>Drive object:</b>	TM150, TM15DI_DO, TM31
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	The selected service/maintenance interval for this motor was reached. Alarm value (r2124, interpret decimal): Motor data set number.
<b>Remedy:</b>	carry out service/maintenance and reset the service/maintenance interval (p0651).
Reaction upon F:	NONE
Acknowl. upon F:	IMMEDIATELY

---

<b>F01800</b>	<b>DRIVE-CLiQ: Hardware/configuration error</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE (IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)
<b>Acknowledge:</b>	IMMEDIATELY (POWER ON)
<b>Cause:</b>	A DRIVE-CLiQ connection fault has occurred. Fault value (r0949, interpret decimal): 100 ... 107: Communication via DRIVE-CLiQ socket X100 ... X107 has not been switched to cyclic operation. The cause may be an incorrect structure or a configuration that results in an impossible bus timing. 10: Loss of the DRIVE-CLiQ connection. The cause may be, for example, that the DRIVE-CLiQ cable was withdrawn from the Control Unit or as a result of a short-circuit for motors with DRIVE-CLiQ. This fault can only be acknowledged in cyclic communication. 11: Repeated faults when detecting the connection. This fault can only be acknowledged in cyclic communication. 12: A connection was detected but the node ID exchange mechanism does not function. The reason is probably that the component is defective. This fault can only be acknowledged in cyclic communication.

---

**Remedy:**

Re fault value = 100 ... 107:

- ensure that the DRIVE-CLiQ components have the same firmware versions.
- avoid longer topologies for short current controller clock cycles.

For fault value = 10:

- check the DRIVE-CLiQ cables at the Control Unit.
- remove any short-circuit for motors with DRIVE-CLiQ.
- carry out a POWER ON.

For fault value = 11:

- check the electrical cabinet design and cable routing for EMC compliance

For fault value = 12:

- replace the component involved.

---

**A01839 DRIVE-CLiQ diagnostics: cable fault to the component**

**Message value:** Component number: %1

**Drive object:** All objects

**Reaction:** NONE

**Acknowledge:** NONE

**Cause:** The fault counter (r9936[0...199]) to monitor the DRIVE-CLiQ connections/cables has been incremented.  
Alarm value (r2124, interpret decimal):  
Component number.  
Note:  
The component number specifies the component whose feeder cable from the direction of the Control Unit is faulted.  
The alarm automatically disappears after 5 seconds, assuming that no other data transfer error has occurred.  
See also: r9936 (DRIVE-CLiQ diagnostic error counter connection)

**Remedy:**

- check the corresponding DRIVE-CLiQ cables.
- check the electrical cabinet design and cable routing for EMC compliance

---

**A01900 (F) PB/PN: Configuration telegram error**

**Message value:** %1

**Drive object:** All objects

**Reaction:** NONE

**Acknowledge:** NONE

**Cause:** A controller attempts to establish a connection using an incorrect configuring telegram.  
Alarm value (r2124, interpret decimal):

1:  
Connection established to more drive objects than configured in the device. The drive objects for process data exchange and their sequence are defined in p0978.

2:  
Too many PZD data words for output or input to a drive object. The number of possible PZD items in a drive object is determined by the number of indices in r2050/p2051.

3:  
Uneven number of bytes for input or output.

4:  
Setting data for synchronization not accepted. For more information, see A01902.

211:  
Unknown parameterizing block.

223:  
Clock synchronization for the PZD interface set in p8815[0] is not permissible.  
More than one PZD interface is operated in clock synchronism.

253:  
PN Shared Device: Illegal mixed configuration of PROFIsafe and PZD.

254:  
PN Shared Device: Illegal double assignment of a slot/subslot.

255:  
PN: Configured drive object and existing drive object do not match.

500:  
Illegal PROFIsafe configuration for the interface set in p8815[1].  
More than one PZD interface is operated with PROFIsafe.

501:  
PROFIsafe parameter error (e.g. F\_dest).



	502: PROFIsafe telegram does not match.
	503: PROFIsafe connection is rejected as long as there is no isochronous connection (p8969). Additional values: Only for internal Siemens troubleshooting.
<b>Remedy:</b>	Check the bus configuration on the master and the slave sides. Re alarm value = 1, 2: - Check the list of the drive objects with process data exchange (p0978). Note: With p0978[x] = 0, all of the following drive objects in the list are excluded from the process data exchange. Re alarm value = 2: - Check the number of data words for output and input to a drive object. Re alarm value = 211: - Ensure offline version <= online version. Re alarm value = 223, 500: - Check the setting in p8839 and p8815. - Check for inserted but not configured CBE20. - Ensure that only one PZD interface is operated in clock synchronism or with PROFIsafe. Re alarm value = 255: - Check configured drive objects. Re alarm value = 501: - Check the set PROFIsafe address (p9610). Re alarm value = 502: - Check the set PROFIsafe telegram (p60022, p9611).
Reaction upon F:	NONE (OFF1)
Acknowled. upon F:	IMMEDIATELY

<b>A01902</b>	<b>PB/PN clock cycle synchronous operation parameterization not permissible</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	Parameterization for isochronous operation is not permissible. Alarm value (r2124, interpret decimal): 0: Bus cycle time Tdp < 0.5 ms. 1: Bus cycle time Tdp > 32 ms. 2: Bus cycle time Tdp is not an integer multiple of the current controller clock cycle. 3: Instant of the actual value sensing Ti > Bus cycle time Tdp or Ti = 0. 4: Instant of the actual value sensing Ti is not an integer multiple of the current controller clock cycle. 5: Instant of the setpoint acceptance To >= Bus cycle time Tdp or To = 0. 6: Instant of the setpoint acceptance To is not an integer multiple of the current controller clock cycle. 7: Master application cycle time Tmapc is not an integer multiple of the speed controller clock cycle. 8: Bus reserve bus cycle time Tdp - data exchange time Tdx less than two current controller clock cycles. 10: Instant of the setpoint acceptance To <= data exchange time Tdx + current controller clock cycle 11: Master application cycle time Tmapc > 14 x Tdp or Tmapc = 0. 12: PLL tolerance window Tpll_w > Tpll_w_max. 13: Bus cycle time Tdp is not a multiple of all basic clock cycles p0110[x]. 16: For COMM BOARD, the instant in time for the actual value sensing Ti is less than two current controller clock cycles.
<b>Remedy:</b>	- Adapt the bus parameterization Tdp, Ti, To. - adapt the current and speed controller clock cycle. Re alarm value = 10: - Reduce Tdx by using fewer bus participants or shorter telegrams. Note: PB: PROFIBUS PN: PROFINET

<b>F01910 (N, A)</b>	<b>Fieldbus: setpoint timeout</b>
<b>Message value:</b>	-
<b>Drive object:</b>	All objects
<b>Reaction:</b>	OFF3 (IASC/DCBRK, NONE, OFF1, OFF2, STOP1, STOP2)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	The reception of setpoints from the fieldbus interface (onboard, PROFIBUS/PROFINET/USS) has been interrupted. - bus connection interrupted. - controller switched off. - controller set into the STOP state. See also: p2040 (Fieldbus interface monitoring time), p2047 (PROFIBUS additional monitoring time)
<b>Remedy:</b>	Restore the bus connection and set the controller to RUN. PROFIBUS slave redundancy: For operation on a Y link, it must be ensured that "DP alarm mode = DPV1" is set in the slave parameterization.
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE
<b>F01911 (N, A)</b>	<b>PB/PN clock cycle synchronous operation clock cycle failure</b>
<b>Message value:</b>	-
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150, TM15DI_DO, TM31
<b>Reaction:</b>	OFF1 (OFF3)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	The global control telegram to synchronize the clock cycles has failed - in cyclic operation - for several DP clock cycles or has violated the time grid specified in the parameterizing telegram over several consecutive DP clock cycles (refer to the bus cycle time, Tdp and Tpllw).
<b>Remedy:</b>	- check the physical bus configuration (cable, connector, terminating resistor, shielding, etc.). - check whether communication was briefly or permanently interrupted. - check the bus and controller for utilization level (e.g. bus cycle time Tdp was set too short). PB: PROFIBUS PN: PROFINET
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE
<b>F01915 (N, A)</b>	<b>PB/PN clock cycle synchronous operation sign-of-life failure drive object 1</b>
<b>Message value:</b>	-
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	Group display for problems with the sign-of-life of the master (clock-cycle synchronous operation) on the drive object 1 (Control Unit). For central measurements, synchronism with the central master is lost.
<b>Remedy:</b>	Note: PB: PROFIBUS PN: PROFINET
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE

---

<b>A01920 (F)</b>	<b>PROFIBUS: Interruption cyclic connection</b>
<b>Message value:</b>	-
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	The cyclic connection to the PROFIBUS master is interrupted.
<b>Remedy:</b>	Establish the PROFIBUS connection and activate the PROFIBUS master in the cyclic mode.
Reaction upon F:	NONE (OFF1)
Acknowl. upon F:	IMMEDIATELY

---

<b>A01921 (F)</b>	<b>PROFIBUS: Receive setpoints after To</b>
<b>Message value:</b>	-
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	Output data of PROFIBUS master (setpoints) received at the incorrect instant in time within the PROFIBUS clock cycle.
<b>Remedy:</b>	- check bus configuration. - check parameters for clock cycle synchronization (ensure To > Tdx). Note: To: Time of setpoint acceptance Tdx: Data exchange time
Reaction upon F:	NONE (OFF1)
Acknowl. upon F:	IMMEDIATELY

---

<b>A01930</b>	<b>PB/PN current controller clock cycle clock cycle synch. not equal</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	The current controller clock cycle of all drives must be set the same for the clock cycle synchronous operation. Alarm value (r2124, interpret decimal): Number of the drive object with different current controller clock cycle.
<b>Remedy:</b>	Set current controller clock cycles to identical values (p0115[0]). Note: PB: PROFIBUS PN: PROFINET See also: p0115

---

<b>A01931</b>	<b>PB/PN speed controller clock cycle clock cycle synch. not equal</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	The speed controller clock cycle of all drives must be set the same for the clock cycle synchronous operation. Alarm value (r2124, interpret decimal): Number of the drive object with the different speed controller clock cycle.
<b>Remedy:</b>	Set the speed controller clock cycles the same (p0115[1]). Note: PB: PROFIBUS PN: PROFINET See also: p0115

---

<b>A01940</b>	<b>PB/PN clock cycle synchronism not reached</b>
<b>Message value:</b>	-
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>The bus is in the data exchange state and clock synchronous operation has been selected using the parameterizing telegram. It was not possible to synchronize to the clock cycle specified by the master.</p> <ul style="list-style-type: none"> <li>- the master does not send a clock synchronous global control telegram although clock synchronous operation was selected when configuring the bus.</li> <li>- the master is using another clock synchronous DP clock cycle than was transferred to the slave in the parameterizing telegram.</li> <li>- at least one drive object has a pulse enable (not controlled from PROFIBUS/PROFINET either).</li> </ul>
<b>Remedy:</b>	<ul style="list-style-type: none"> <li>- check the master application and bus configuration.</li> <li>- check the consistency between the clock cycle input when configuring the slave and clock cycle setting at the master.</li> <li>- check that no drive object has a pulse enable. Only enable the pulses after synchronizing the PROFIBUS/PROFINET drives.</li> </ul> <p>Note: PB: PROFIBUS PN: PROFINET</p>
<b>A01941</b>	<b>PB/PN clock cycle signal missing when establishing bus communication</b>
<b>Message value:</b>	-
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>The bus is in the data exchange state and clock synchronous operation has been selected using the parameterizing telegram. The global control telegram for synchronization is not being received.</p>
<b>Remedy:</b>	<p>Check the master application and bus configuration.</p> <p>Note: PB: PROFIBUS PN: PROFINET</p>
<b>A01943</b>	<b>PB/PN clock cycle signal error when establishing bus communication</b>
<b>Message value:</b>	-
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>The bus is in the data exchange state and clock synchronous operation has been selected using the parameterizing telegram.</p> <p>The global control telegram for synchronization is being irregularly received.</p> <ul style="list-style-type: none"> <li>- the master is sending an irregular global control telegram.</li> <li>- the master is using another clock synchronous DP clock cycle than was transferred to the slave in the parameterizing telegram.</li> </ul>
<b>Remedy:</b>	<ul style="list-style-type: none"> <li>- check the master application and bus configuration.</li> <li>- check the consistency between the clock cycle input when configuring the slave and clock cycle setting at the master.</li> </ul> <p>Note: PB: PROFIBUS PN: PROFINET</p>
<b>A01945</b>	<b>PROFIBUS: Connection to the Publisher failed</b>
<b>Message value:</b>	Fault cause: %1 bin
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>For PROFIBUS peer-to-peer data transfer, the connection to at least one Publisher has failed.</p>

Alarm value (r2124, interpret binary):  
 Bit 0 = 1: Publisher with address in r2077[0], connection failed.  
 ...  
 Bit 15 = 1: Publisher with address in r2077[15], connection failed.

**Remedy:**

- check the PROFIBUS cables.
- carry out a first commissioning of the Publisher that has the failed connection.

See also: r2077 (PROFIBUS diagnostics peer-to-peer data transfer addresses)

---

**F01946 (A)      PROFIBUS: Connection to the Publisher aborted**

**Message value:**      Fault cause: %1 bin  
**Drive object:**      All objects  
**Reaction:**            OFF1 (NONE, OFF2, OFF3)  
**Acknowledge:**      IMMEDIATELY (POWER ON)  
**Cause:**              At this drive object, the connection to at least one Publisher for PROFIBUS peer-to-peer data transfer in cyclic operation has been aborted.  
                             Fault value (r0949, interpret binary):  
                             Bit 0 = 1: Publisher with address in r2077[0], connection aborted.  
                             ...  
                             Bit 15 = 1: Publisher with address in r2077[15], connection aborted.

**Remedy:**

- check the PROFIBUS cables.
- check the state of the Publisher that has the aborted connection.

See also: r2077 (PROFIBUS diagnostics peer-to-peer data transfer addresses)

Reaction upon A:      NONE  
 Acknowl. upon A:    NONE

---

**F01950 (N, A)      PB/PN clock cycle synchronous operation synchronization unsuccessful**

**Message value:**      -  
**Drive object:**      All objects  
**Reaction:**            OFF1 (NONE)  
**Acknowledge:**      IMMEDIATELY (POWER ON)  
**Cause:**              Synchronization of the internal clock cycle to the global control telegram has failed. The internal clock cycle exhibits an unexpected shift.

**Remedy:**              Only for internal Siemens troubleshooting.  
                             Note:  
                             PB: PROFIBUS  
                             PN: PROFINET

Reaction upon N:      NONE  
 Acknowl. upon N:    NONE  
 Reaction upon A:      NONE  
 Acknowl. upon A:    NONE

---

**F01951              CU DRIVE-CLiQ: Synchronization application clock cycle missing**

**Message value:**      %1  
**Drive object:**      All objects  
**Reaction:**            OFF2 (NONE)  
**Acknowledge:**      IMMEDIATELY (POWER ON)  
**Cause:**              If DRIVE-CLiQ components with different application clock cycle are operated on a DRIVE-CLiQ port, this requires synchronization with the Control Unit. This synchronization routine was unsuccessful.  
                             Fault value (r0949, interpret decimal):  
                             Only for internal Siemens troubleshooting.

**Remedy:**

- carry out a POWER ON (power off/on) for all components.
- upgrade the software of the DRIVE-CLiQ components.
- upgrade the Control Unit software.

Note:  
 If a Controller Extension is being used (e.g. CX32, NX10), then the following applies:  
 Check whether the Controller Extension is issuing error messages, and if required, remove these.

<b>F01952</b>	<b>CU DRIVE-CLiQ: Synchronization of component not supported</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	OFF2 (NONE)
<b>Acknowledge:</b>	IMMEDIATELY (POWER ON)
<b>Cause:</b>	The existing system configuration requires that the connected DRIVE-CLiQ components support the synchronization between the basic clock cycle, DRIVE-CLiQ clock cycle and the application clock cycle. However, not all DRIVE-CLiQ components have this functionality. Fault value (r0949, interpret decimal): Component number of the first faulty DRIVE-CLiQ component.
<b>Remedy:</b>	Upgrade the firmware of the component specified in the fault value. Note: If required, also upgrade additional components in the DRIVE-CLiQ line.
<b>A01953</b>	<b>CU DRIVE-CLiQ: Synchronization not completed</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	After the drive system is powered up, the synchronization between the basic clock cycle, DRIVE-CLiQ clock cycle and application clock cycle was started but was not completed within the selected time tolerance. Alarm value (r2124, interpret decimal): Only for internal Siemens troubleshooting.
<b>Remedy:</b>	Carry out a POWER ON (power off/on) for all components. If the error occurs after the drive sampling times were changed, and if a Terminal Module 31 (TM31) is being used, the sampling times (p0115, p4099) should be set as integer multiples to the drive clock cycles (p0115).
<b>F01954</b>	<b>CU DRIVE-CLiQ: Synchronization unsuccessful</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	IMMEDIATELY (POWER ON)
<b>Cause:</b>	Synchronization between the basic clock cycle, DRIVE-CLiQ clock cycle and application clock cycle was started and was not able to be successfully completed (e.g. after switch-on). Fault value (r0949, interpret decimal): Only for internal Siemens troubleshooting.
<b>Remedy:</b>	1. Remove the cause of a possible DRIVE-CLiQ fault. 2. Initiate a new synchronization, e.g. as follows: - remove the PROFIBUS master and re-insert again. - restart the PROFIBUS master. - switch-off the Control Unit and switch-on again. - carry out a Control Unit hardware reset (RESET button, p0972). - carry out a parameter reset and download the saved parameters (p0009 = 30, p0976 = 2, 3).
<b>A01955</b>	<b>CU DRIVE-CLiQ: Synchronization DO not completed</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	After the drive system is powered up, the synchronization between the basic clock cycle, DRIVE-CLiQ clock cycle and application clock cycle was started but was not completed within the selected time tolerance. Alarm value (r2124, interpret decimal): Only for internal Siemens troubleshooting.
<b>Remedy:</b>	Carry out a POWER ON (power off/on) for all components of the DO.

---

<b>A01990 (F)</b>	<b>USS: PZD configuration error</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150, TM15DI_DO, TM31
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	The configuration of the process data (PZD) for the USS protocol is incorrect. Alarm value (r2124, interpret decimal): 2: PZD amount (p2022) too great for the first drive object (p978[0]). The number of possible PZD items in a drive object is determined by the number of indices in r2050/p2051.
<b>Remedy:</b>	Re alarm value = 2: Check the amount of USS PZD (p2022) and the maximum PZD amount (r2050/p2051) for the first drive object (p0978[0]).
Reaction upon F:	NONE (OFF1)
Acknowled. upon F:	IMMEDIATELY

---

<b>A02000</b>	<b>Function generator: Start not possible</b>
<b>Message value:</b>	-
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	The function generator has already been started.
<b>Remedy:</b>	Stop the function generator and restart again if necessary. Note: The alarm is reset as follows: - remove the cause of this alarm. - restart the function generator. See also: p4800 (Function generator control)

---

<b>A02005</b>	<b>Function generator: Drive does not exist</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	The drive object specified for connection does not exist.
<b>Remedy:</b>	Use the existing drive object with the corresponding number. Note: The alarm is reset as follows: - remove the cause of this alarm. - restart the function generator.

---

<b>A02006</b>	<b>Function generator: No drive specified for connection</b>
<b>Message value:</b>	-
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	No drive specified for connection in p4815.
<b>Remedy:</b>	At least one drive to be connected must be specified in p4815. Note: The alarm is reset as follows: - remove the cause of this alarm. - restart the function generator.

---

<b>A02007</b>	<b>Function generator: Drive not SERVO / VECTOR / DC_CTRL</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	The drive object specified for connection is not a SERVO / VECTOR or DC_CTRL.
<b>Remedy:</b>	Use a SERVO / VECTOR / DC_CTRL drive object with the corresponding number. Note: The alarm is reset as follows: - remove the cause of this alarm. - restart the function generator.
<b>A02008</b>	<b>Function generator: Drive specified a multiple number of times</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	The drive object specified for connection is already specified. Alarm value (r2124, interpret decimal): Drive object number of the drive object that is specified a multiple number of times.
<b>Remedy:</b>	Specify a different drive object. Note: The alarm is reset as follows: - remove the cause of this alarm. - restart the function generator.
<b>A02009</b>	<b>Function generator: Illegal mode</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	The set operating mode (p1300) of the drive object is not permissible when using the function generator. Alarm value (r2124, interpret decimal): Number of the drive object involved.
<b>Remedy:</b>	Change the operating mode for this drive object to p1300 = 20 (encoderless speed control) or p1300 = 21 (speed control with encoder). Note: The alarm is reset as follows: - remove the cause of this alarm. - restart the function generator.
<b>A02010</b>	<b>Function generator: Speed setpoint from the drive is not zero</b>
<b>Message value:</b>	-
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	The speed setpoint of a drive selected for connection is greater than the value for the standstill detection set using p1226.
<b>Remedy:</b>	For all of the drives specified for connection, set the speed setpoints to zero. Note: The alarm is reset as follows: - remove the cause of this alarm. - restart the function generator.



---

<b>A02011</b>	<b>Function generator: The actual drive speed is not zero</b>
<b>Message value:</b>	-
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	The speed actual value of a drive selected for connection is greater than the value for the standstill detection set using p1226.
<b>Remedy:</b>	Set the relevant drives to zero speed before starting the function generator. Note: The alarm is reset as follows: - remove the cause of this alarm. - restart the function generator.

---

<b>A02015</b>	<b>Function generator: Drive enable signals missing</b>
<b>Message value:</b>	-
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	The master control and/or enable signals are missing to connect to the specified drive.
<b>Remedy:</b>	Fetch the master control to the specified drive object and set all enable signals. Note: The alarm is reset as follows: - remove the cause of this alarm. - restart the function generator.

---

<b>A02016</b>	<b>Function generator: Magnetizing running</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	Magnetizing has not yet been completed on a drive object specified for connection. Alarm value (r2124, interpret decimal): Number of the drive object involved.
<b>Remedy:</b>	Wait for magnetizing of the motor (r0056.4). Note: The alarm is reset as follows: - restart the function generator. See also: r0056 (Status word, closed-loop control)

---

<b>A02020</b>	<b>Function generator: Parameter cannot be changed</b>
<b>Message value:</b>	-
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	This parameter setting cannot be changed when the function generator is active (p4800 = 1). See also: p4810, p4812, p4813, p4820, p4821, p4822, p4823, p4824, p4825, p4826, p4827, p4828, p4829
<b>Remedy:</b>	- stop the function generator before parameterizing (p4800 = 0). - if required, start the function generator (p4800 = 1). Note: The alarm is reset as follows: - remove the cause of this alarm. - restart the function generator. See also: p4800 (Function generator control)

---

---

**A02025      Function generator: Period too short**

**Message value:** -  
**Drive object:** All objects  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The value for the period is too short.  
 See also: p4821 (Function generator period)  
**Remedy:** Check and adapt the value for the period.  
 Note:  
 The alarm is reset as follows:  
 - remove the cause of this alarm.  
 - restart the function generator.  
 See also: p4821 (Function generator period)

---

**A02026      Function generator: Pulse width too high**

**Message value:** -  
**Drive object:** All objects  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The selected pulse width is too high.  
 The pulse width must be less than the period duration.  
 See also: p4822 (Function generator pulse width)  
**Remedy:** Reduce pulse width.  
 Note:  
 The alarm is reset as follows:  
 - remove the cause of this alarm.  
 - restart the function generator.  
 See also: p4821 (Function generator period), p4822 (Function generator pulse width)

---

**A02030      Function generator: Physical address equals zero**

**Message value:** -  
**Drive object:** All objects  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The specified physical address is zero.  
 See also: p4812 (Function generator physical address)  
**Remedy:** Set a physical address with a value other than zero.  
 Note:  
 The alarm is reset as follows:  
 - remove the cause of this alarm.  
 - restart the function generator.  
 See also: p4812 (Function generator physical address)

---

**A02040      Function generator: Illegal value for offset**

**Message value:** -  
**Drive object:** All objects  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The value for the offset is higher than the value for the upper limit or lower than the value for the lower limit.  
 See also: p4826 (Function generator offset)  
**Remedy:** Adjust the offset value accordingly.  
 Note:  
 The alarm is reset as follows:  
 - remove the cause of this alarm.  
 - restart the function generator.  
 See also: p4826 (Function generator offset), p4828 (Function generator lower limit), p4829 (Function generator upper limit)

---

<b>A02041</b>	<b>Function generator: Illegal value for bandwidth</b>
<b>Message value:</b>	-
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	The bandwidth referred to the time slice clock cycle of the function generator has either been set too low or too high. Depending on the time slice clock cycle, the bandwidth is defined as follows: $\text{Bandwidth\_max} = 1 / (2 \times \text{time slice clock cycle})$ $\text{Bandwidth\_min} = \text{Bandwidth\_max} / 100000$ Example: Assumption: $p4830 = 125 \mu\text{s}$ --> $\text{Bandwidth\_max} = 1 / (2 \times 125 \mu\text{s}) = 4000 \text{ Hz}$ --> $\text{Bandwidth\_min} = 4000 \text{ Hz} / 100000 = 0.04 \text{ Hz}$ Note: $p4823$ : Function generator bandwidth $p4830$ : Function generator time slice clock cycle See also: $p4823$ (Function generator bandwidth), $p4830$ (Function generator time slice cycle)
<b>Remedy:</b>	Check the value for the bandwidth and adapt accordingly. Note: The alarm is reset as follows: - remove the cause of this alarm. - restart the function generator.

---

<b>A02047</b>	<b>Function generator: Time slice clock cycle invalid</b>
<b>Message value:</b>	-
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	The time slice clock cycle selected does not match any of the existing time slices. See also: $p4830$ (Function generator time slice cycle)
<b>Remedy:</b>	Enter an existing time slice clock cycle. The existing time slices can be read out via $p7901$ . Note: The alarm is reset as follows: - remove the cause of this alarm. - restart the function generator. See also: $r7901$ (Sampling times)

---

<b>A02050</b>	<b>Trace: Start not possible</b>
<b>Message value:</b>	-
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	The trace has already been started. See also: $p4700$ (Trace control)
<b>Remedy:</b>	Stop the trace and, if necessary, start again.

---

<b>A02055</b>	<b>Trace: Recording time too short</b>
<b>Message value:</b>	-
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	The trace duration is too short. The minimum is twice the value of the trace clock cycle. See also: $p4721$ (Trace recording time)
<b>Remedy:</b>	Check the selected recording time and, if necessary, adjust.

<b>A02056</b>	<b>Trace: Recording cycle too short</b>
<b>Message value:</b>	-
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	The selected recording cycle is shorter than the selected basic clock cycle 0 (p0110[0]). See also: p4720 (Trace recording cycle)
<b>Remedy:</b>	Increase the value for the trace cycle.
<b>A02057</b>	<b>Trace: Time slice clock cycle invalid</b>
<b>Message value:</b>	-
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	The time slice clock cycle selected does not match any of the existing time slices. See also: p4723 (Trace time slice cycle)
<b>Remedy:</b>	Enter an existing time slice clock cycle. The existing time slices can be read out via p7901. See also: r7901 (Sampling times)
<b>A02058</b>	<b>Trace: Time slice clock cycle for endless trace not valid</b>
<b>Message value:</b>	-
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	The selected time slice clock cycle cannot be used for the endless trace See also: p4723 (Trace time slice cycle)
<b>Remedy:</b>	Enter the clock cycle of an existing time slice with a cycle time $\geq 2$ ms for up to 4 recording channels or $\geq 4$ ms from 5 recording channels per trace. The existing time slices can be read out via p7901. See also: r7901 (Sampling times)
<b>A02059</b>	<b>Trace: Time slice clock cycle for 2 x 8 recording channels not valid</b>
<b>Message value:</b>	-
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	The selected time slice clock cycle cannot be used for more than 4 recording channels. See also: p4723 (Trace time slice cycle)
<b>Remedy:</b>	Enter the clock cycle of an existing time slice with a cycle time $\geq 4$ ms or reduce the number of recording channels to 4 per trace. The existing time slices can be read out via p7901. See also: r7901 (Sampling times)
<b>A02060</b>	<b>Trace: Signal to be traced missing</b>
<b>Message value:</b>	-
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	- a signal to be traced was not specified. - the specified signals are not valid. See also: p4730 (Trace record signal 0), p4731 (Trace record signal 1), p4732 (Trace record signal 2), p4733 (Trace record signal 3)
<b>Remedy:</b>	- specify the signal to be traced. - check whether the relevant signal can be traced.

---

<b>A02061</b>	<b>Trace: Invalid signal</b>
<b>Message value:</b>	-
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<ul style="list-style-type: none"><li>- the specified signal does not exist.</li><li>- the specified signal can no longer be traced (recorded).</li></ul> See also: p4730 (Trace record signal 0), p4731 (Trace record signal 1), p4732 (Trace record signal 2), p4733 (Trace record signal 3)
<b>Remedy:</b>	<ul style="list-style-type: none"><li>- specify the signal to be traced.</li><li>- check whether the relevant signal can be traced.</li></ul>

---

<b>A02062</b>	<b>Trace: Invalid trigger signal</b>
<b>Message value:</b>	-
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<ul style="list-style-type: none"><li>- a trigger signal was not specified.</li><li>- the specified signal does not exist.</li><li>- the specified signal is not a fixed-point signal.</li><li>- the specified signal cannot be used as a trigger signal for the trace.</li></ul> See also: p4711 (Trace trigger signal)
<b>Remedy:</b>	Specify a valid trigger signal.

---

<b>A02063</b>	<b>Trace: Invalid data type</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	The specified data type to select a signal using a physical address is invalid. See also: p4711 (Trace trigger signal), p4730 (Trace record signal 0), p4731 (Trace record signal 1), p4732 (Trace record signal 2), p4733 (Trace record signal 3)
<b>Remedy:</b>	Use a valid data type.

---

<b>A02070</b>	<b>Trace: Parameter cannot be changed</b>
<b>Message value:</b>	-
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	The trace parameter settings cannot be changed when the trace is active. See also: p4700, p4710, p4711, p4712, p4713, p4714, p4715, p4716, p4720, p4721, p4722, p4730, p4731, p4732, p4733, p4780, p4781, p4782, p4783, p4789, p4795
<b>Remedy:</b>	<ul style="list-style-type: none"><li>- stop the trace before parameterization.</li><li>- if required, start the trace.</li></ul>

---

<b>A02075</b>	<b>Trace: Pretrigger time too long</b>
<b>Message value:</b>	-
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	The selected pretrigger time must be shorter than the trace time. See also: p4721 (Trace recording time), p4722 (Trace trigger delay)
<b>Remedy:</b>	Check the pretrigger time setting and change if necessary.

---

<b>F02080</b>	<b>Trace: Parameterization deleted due to unit changeover</b>
<b>Message value:</b>	-
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	The trace parameterization in the drive unit was deleted due to a unit changeover or a change in the reference parameters.
<b>Remedy:</b>	Restart trace.
<b>A02097</b>	<b>MTrace: multiple trace cannot be activated</b>
<b>Message value:</b>	-
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	The following functions or settings are not permissible in conjunction with a multiple trace: <ul style="list-style-type: none"> <li>- measuring function.</li> <li>- long-time trace</li> <li>- trigger condition "immediate recording start" (IMMEDIATE)</li> <li>- trigger condition "start with function generator" (FG_START).</li> </ul>
<b>Remedy:</b>	<ul style="list-style-type: none"> <li>- Deactivate multiple trace.</li> <li>- Deactivate function or setting that is not permissible.</li> </ul>
<b>A02098</b>	<b>MTrace: cannot be saved</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>It is not possible to save the measurement results of a multiple trace on the memory card.</p> <p>A multiple trace is not started or is canceled.</p> <p>Alarm value (r2124, interpret decimal):</p> <p>1: memory card cannot be accessed (not inserted or blocked by a mounted USB drive).</p> <p>3: data save operation too slow. A second trace has been completed before the measurement results of the first trace were able to be saved.</p> <p>4: data save operation canceled (e.g. a file required for the save operation was no longer able to be found).</p> <p>See also: p4840 (MTrace cycle number setting)</p>
<b>Remedy:</b>	<ul style="list-style-type: none"> <li>- insert or remove the memory card.</li> <li>- use a larger memory card.</li> <li>- configure the trace with a longer trace time or use an endless trace.</li> <li>- avoid saving parameters while the multiple trace is running. Saving parameters can block writing measurement result files to the card, so that this alarm is output with alarm value 3</li> <li>- check whether other functions are presently accessing measurement result files of the multiple trace.</li> </ul>
<b>A02099</b>	<b>Trace: Insufficient Control Unit memory</b>
<b>Message value:</b>	-
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	The memory space still available on the Control Unit is no longer sufficient for the trace function.
<b>Remedy:</b>	<p>Reduce the memory required, e.g. as follows:</p> <ul style="list-style-type: none"> <li>- reduce the trace time.</li> <li>- increase the trace clock cycle.</li> <li>- reduce the number of signals to be traced.</li> </ul> <p>See also: r4708 (Trace memory space required), r4799 (Trace memory location free)</p>

---

**A02150      OA: Application cannot be loaded**

**Message value:** %1  
**Drive object:** All objects  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The system was not able to load an OA application.  
Alarm value (r2124, interpret hexadecimal):  
Only for internal Siemens troubleshooting.  
**Remedy:** - carry out a POWER ON (power off/on) for all components.  
- upgrade firmware to later version.  
- contact the Hotline.  
**Note:**  
OA: Open Architecture  
See also: r4950, r4955, p4956, r4957

---

**F02151 (A)      OA: Internal software error**

**Message value:** %1  
**Drive object:** All objects  
**Reaction:** OFF2 (NONE, OFF1, OFF3)  
**Acknowledge:** IMMEDIATELY (POWER ON)  
**Cause:** An internal software error has occurred within an OA application.  
Fault value (r0949, interpret hexadecimal):  
Only for internal Siemens troubleshooting.  
**Remedy:** - carry out a POWER ON (power off/on) for all components.  
- upgrade firmware to later version.  
- contact the Hotline.  
- replace the Control Unit.  
**Note:**  
OA: Open Architecture  
See also: r4950, r4955, p4956, r4957  
**Reaction upon A:** NONE  
**Acknowl. upon A:** NONE

---

**F02152 (A)      OA: Insufficient memory**

**Message value:** %1  
**Drive object:** All objects  
**Reaction:** OFF1  
**Acknowledge:** IMMEDIATELY (POWER ON)  
**Cause:** Too many functions have been configured on this Control Unit (e.g. too many drives, function modules, data sets, OA applications, blocks, etc).  
Fault value (r0949, interpret decimal):  
Only for internal Siemens troubleshooting.  
**Remedy:** - change the configuration on this Control Unit (e.g. fewer drives, function modules, data sets, OA applications, blocks, etc).  
- use an additional Control Unit.  
**Note:**  
OA: Open Architecture  
**Reaction upon A:** NONE  
**Acknowl. upon A:** NONE

---

**F03000      NVRAM fault on action**

**Message value:** %1  
**Drive object:** All objects  
**Reaction:** NONE  
**Acknowledge:** IMMEDIATELY  
**Cause:** A fault occurred during execution of action p7770 = 1 or 2 for the NVRAM data.

Fault value (r0949, interpret hexadecimal):  
yyxx hex: yy = fault cause, xx = application ID

yy = 1:

The action p7770 = 1 is not supported by this version if Drive Control Chart (DCC) is activated for the drive object concerned.

yy = 2:

The data length of the specified application is not the same in the NVRAM and the backup.

yy = 3:

The data checksum in p7774 is not correct.

yy = 4:

No data available to load.

See also: p7770 (NVRAM action)

**Remedy:**

- Perform the remedy according to the results of the troubleshooting.
- If necessary, start the action again.

---

### **F03001 NVRAM checksum incorrect**

**Message value:** %1

**Drive object:** All objects

**Reaction:** NONE

**Acknowledge:** IMMEDIATELY

**Cause:** A checksum error occurred when evaluating the non-volatile data (NVRAM) on the Control Unit.  
The NVRAM data affected was deleted.

**Remedy:** Carry out a POWER ON (power off/on) for all components.

---

### **F03500 (A) TM: Initialization**

**Message value:** %1

**Drive object:** All objects

**Reaction:** OFF1 (OFF2)

**Acknowledge:** IMMEDIATELY (POWER ON)

**Cause:** When initializing the Terminal Modules, the terminals of the Control Unit or the Terminal Board 30, an internal software error has occurred.

Fault value (r0949, interpret decimal):

yxxx dex

y = Only for internal Siemens troubleshooting

xxx = component number (p0151)

**Remedy:**

- power down/power up the power supply for the Control Unit.
- check the DRIVE-CLiQ connection.
- if required, replace the Terminal Module.

The Terminal Module should be directly connected to a DRIVE-CLiQ socket of the Control Unit.  
If the fault occurs again, replace the Terminal Module.

Reaction upon A: NONE

Acknowl. upon A: NONE

---

### **A03501 TM: Sampling time change**

**Message value:** -

**Drive object:** All objects

**Reaction:** NONE

**Acknowledge:** NONE

**Cause:** The sampling times of the inputs/outputs were changed.  
This change only becomes valid after the next boot.

**Remedy:** Carry out a POWER ON.



<b>F03505 (N, A)</b>	<b>TM: Analog input wire breakage</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S, TM150, TM15DI_DO, TM31
<b>Reaction:</b>	OFF1 (NONE, OFF2)
<b>Acknowledge:</b>	IMMEDIATELY (POWER ON)
<b>Cause:</b>	<p>The wire-break monitoring for an analog input has responded.</p> <p>The input current of the analog input has exceeded the threshold value parameterized in p4061[x].</p> <p>Index x = 0: Analog input 0 (X521.1/X521.2)</p> <p>Index x = 1: Analog input 1 (X521.3/X521.4)</p> <p>Fault value (r0949, interpret decimal):</p> <p>yxxx dec</p> <p>y = analog input (0 = analog input 0 (AI 0), 1 = analog input 1 (AI 1))</p> <p>xxx = component number (p0151)</p> <p>Note:</p> <p>For the following analog input type, the wire breakage monitoring is active:</p> <p>p4056[x] = 3 (unipolar current input monitored (+4 ... +20 mA))</p>
<b>Remedy:</b>	<p>- check the wiring for interruptions.</p> <p>- Check the magnitude of the injected current - it is possible that the infed signal is too low.</p> <p>- Check the load resistor (250 Ohm).</p> <p>Note:</p> <p>The input current measured by the Terminal Module can be read out from r4052[x].</p> <p>For p4056[x] = 3 (unipolar current input monitored (+4 ... +20 mA)) the following applies:</p> <p>A current less than 4 mA is not displayed in r4052[x] - but instead r4052[x] = 4 mA is output.</p>
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE

<b>F03505 (N, A)</b>	<b>Analog input wire breakage</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF1 (NONE, OFF2)
<b>Acknowledge:</b>	IMMEDIATELY (POWER ON)
<b>Cause:</b>	The wire-break monitoring for an analog input has responded.
<b>Remedy:</b>	
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE

<b>A03510 (F, N)</b>	<b>TM: Calibration data not plausible</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>During ramp-up, the Terminal Module 31 (TM31) calibration data is read in and checked for plausibility.</p> <p>At least one calibration data point was determined to be invalid.</p> <p>Alarm value (r2124, interpret binary):</p> <p>Bit 1: 10 V value, analog input 0 invalid.</p> <p>Bit 3: 10 V value, analog input 1 invalid.</p> <p>Bit 4: Offset, analog output 0 invalid.</p> <p>Bit 5: 10 V value, analog output 0 invalid.</p> <p>Bit 6: Offset, analog output 1 invalid.</p> <p>Bit 7: 10 V value, analog input 1 invalid.</p>
<b>Remedy:</b>	<p>- power down/power up the power supply for the Control Unit.</p> <p>- check the DRIVE-CLiQ connection.</p>

Note:  
If it reoccurs, then replace the module.  
In principle, operation could continue.  
The analog channel involved possibly does not achieve the specified accuracy.

Reaction upon F: NONE (OFF1, OFF2)  
Acknowl. upon F: IMMEDIATELY (POWER ON)  
Reaction upon N: NONE  
Acknowl. upon N: NONE

---

**A03550 TM: Speed setpoint filter natural frequency > Shannon frequency**

**Message value:** -  
**Drive object:** All objects  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The natural filter frequency of the speed setpoint filter (p1417) is greater than or equal to the Shannon frequency. The Shannon frequency is calculated according to the following formula:  
 $0.5 / p4099[3]$   
**Remedy:** Reduce the natural frequency of the speed setpoint filter (PT2 low pass) (p1417).

---

**F03590 (N, A) TM: Module not ready**

**Message value:** %1  
**Drive object:** All objects  
**Reaction:** NONE (IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)  
**Acknowledge:** IMMEDIATELY (POWER ON)  
**Cause:** The Terminal Module involved does not send a ready signal and no valid cyclic data.  
Fault value (r0949, interpret decimal):  
Drive object number of the Terminal Module involved.  
**Remedy:**  
- check the 24 V power supply.  
- check the DRIVE-CLiQ connection.  
- check whether the sampling time of the drive object involved is not equal to zero (p4099[0]).  
Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

**F07082 Macro: Execution not possible**

**Message value:** Fault cause: %1, supplementary information: %2, preliminary parameter number: %3  
**Drive object:** All objects  
**Reaction:** NONE  
**Acknowledge:** IMMEDIATELY  
**Cause:** The macro cannot be executed.  
Fault value (r0949, interpret hexadecimal):  
ccccbbaa hex:  
cccc = preliminary parameter number, bb = supplementary information, aa = fault cause  
Fault causes for the trigger parameter itself:  
19: Called file is not valid for the trigger parameter.  
20: Called file is not valid for parameter 15.  
21: Called file is not valid for parameter 700.  
22: Called file is not valid for parameter 1000.  
23: Called file is not valid for parameter 1500.  
24: Data type of a TAG is incorrect (e.g. Index, number or bit is not U16).  
Fault causes for the parameters to be set:  
25: Error level has an undefined value.  
26: Mode has an undefined value.  
27: A value was entered as string in the tag value that is not "DEFAULT".  
31: Entered drive object type unknown.  
32: A device was not able to be found for the determined drive object number.  
34: A trigger parameter was recursively called.

35: It is not permissible to write to the parameter via macro.  
36: Check, writing to a parameter unsuccessful, parameter can only be read, not available, incorrect data type, value range or assignment incorrect.  
37: Source parameter for a BICO interconnection was not able to be determined.  
38: An index was set for a non-indexed (or CDS-dependent) parameter.  
39: No index was set for an indexed parameter.  
41: A bit operation is only permissible for parameters with the parameter format DISPLAY\_BIN.  
42: A value not equal to 0 or 1 was set for a BitOperation.  
43: Reading the parameter to be changed by the BitOperation was unsuccessful.  
51: Factory setting for DEVICE may only be executed on the DEVICE.  
61: The setting of a value was unsuccessful.

**Remedy:**

- check the parameter involved.  
- check the macro file and BICO interconnection.  
See also: p0015, p0700, p1000 (Macro Connector Inputs (CI) for speed setpoints), p1500 (Macro Connector Inputs (CI) for torque setpoints)

---

**F07083      Macro: ACX file not found**

**Message value:** Parameter: %1

**Drive object:** All objects

**Reaction:** NONE

**Acknowledge:** IMMEDIATELY

**Cause:** The ACX file (macro) to be executed was not able to be found in the appropriate directory.  
Fault value (r0949, interpret decimal):  
Parameter number with which the execution was started.  
See also: p0015, p0700, p1000 (Macro Connector Inputs (CI) for speed setpoints), p1500 (Macro Connector Inputs (CI) for torque setpoints)

**Remedy:**

- check whether the file is saved in the appropriate directory on the memory card.  
Example:  
If p0015 is set to 1501, then the selected ACX file must be located in the following directory:  
... /PMACROS/DEVICE/P15/PM001501.ACX

---

**F07084      Macro: Condition for WaitUntil not fulfilled**

**Message value:** Parameter: %1

**Drive object:** All objects

**Reaction:** NONE

**Acknowledge:** IMMEDIATELY

**Cause:** The WaitUntil condition set in the macro was not fulfilled in a certain number of attempts.  
Fault value (r0949, interpret decimal):  
Parameter number for which the condition was set.

**Remedy:**

Check and correct the conditions for the WaitUntil loop.

---

**F07086      Units changeover: Parameter limit violation due to reference value change**

**Message value:** Parameter: %1

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** NONE

**Acknowledge:** IMMEDIATELY

**Cause:** A reference parameter was changed in the system. This resulted in the fact that for the parameters involved, the selected value was not able to be written in the per unit notation.  
The values of the parameters were set to the corresponding violated minimum limit/maximum limit or to the factory setting.  
Possible causes:

- the steady-state minimum limit/maximum limit or that defined in the application was violated.

Fault value (r0949, parameter):

Diagnostics parameter to display the parameters that were not able to be re-calculated.

See also: p0596 (Technological unit reference quantity), p2000 (Reference speed), p2001 (Reference voltage), p2002 (Reference current), p2003 (Reference torque), r2004 (Reference power)

**Remedy:**

Check the adapted parameter value and if required correct.  
See also: r9450 (Reference value change parameter with unsuccessful calculation)

<b>F07088</b>	<b>Units changeover: Parameter limit violation due to units changeover</b>
<b>Message value:</b>	Parameter: %1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>A changeover of units was initiated. This resulted in a violation of a parameter limit</p> <p>Possible causes for the violation of a parameter limit:</p> <ul style="list-style-type: none"> <li>- When rounding off a parameter corresponding to its decimal places, the steady-state minimum limit or maximum limit was violated.</li> <li>- inaccuracies for the data type "FloatingPoint".</li> </ul> <p>In these cases, when the minimum limit is violated then the parameter value is rounded up and when the maximum limited is violated the parameter value is rounded down.</p> <p>Fault value (r0949, interpret decimal):</p> <p>Diagnostics parameter r9451 to display all parameters whose value had to be adapted.</p> <p>See also: p0595 (Technological unit selection)</p>
<b>Remedy:</b>	<p>Check the adapted parameter values and if required correct.</p> <p>See also: r9451 (Units changeover adapted parameters)</p>
<b>A07089</b>	<b>Changing over units: Function module activation is blocked because the units have been changed over</b>
<b>Message value:</b>	-
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	An attempt was made to activate a function module. This is not permissible if the units have already been changed over.
<b>Remedy:</b>	Restore units that have been changed over to the factory setting.
<b>F07110</b>	<b>Drive: Sampling times and basic clock cycle do not match</b>
<b>Message value:</b>	Parameter: %1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>The parameterized sampling times do not match the basic clock cycle.</p> <p>Fault value (r0949, interpret decimal):</p> <p>The fault value specifies the parameter involved.</p> <p>See also: r0110, r0111, p0115</p>
<b>Remedy:</b>	<p>Enter the current controller sampling times so that they are identical to the basic clock cycle, e.g. by selecting p0112.</p> <p>Note which basic clock cycle is selected in p0111.</p> <p>The sampling times in p0115 can only be changed manually in the sampling times pre-setting "Expert" (p0112).</p> <p>See also: r0110, r0111, p0112, p0115</p>
<b>A07200</b>	<b>Drive: Master control ON command present</b>
<b>Message value:</b>	-
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>The ON/OFF1 command is present (no 0 signal).</p> <p>The command is either influenced via binector input p0840 (current CDS) or control word bit 0 via the master control.</p>
<b>Remedy:</b>	Switch the signal via binector input p0840 (current CDS) or control word bit 0 via the master control to 0.

<b>F07220 (N, A)</b>	<b>Drive: Master control by PLC missing</b>
<b>Message value:</b>	-
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF1 (NONE, OFF2, OFF3, STOP1, STOP2)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	The "master control by PLC" signal was missing in operation. - interconnection of the binector input for "master control by PLC" is incorrect (p0854). - the higher-level control has withdrawn the "master control by PLC" signal. - data transfer via the fieldbus (master/drive) was interrupted.
<b>Remedy:</b>	- check the interconnection of the binector input for "master control by PLC" (p0854). - check the "master control by PLC" signal and, if required, switch in. - check the data transfer via the fieldbus (master/drive). Note: If the drive should continue to operate after withdrawing "master control by PLC" then fault response must be parameterized to NONE or the message type should be parameterized as alarm.
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE
<b>A07350 (F)</b>	<b>Drive: Measuring probe parameterized to a digital output</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	The measuring probe is connected to a bi-directional digital input/output and the terminal is set as output. Alarm value (r2124, interpret decimal): 8: DI/DO 8 (X122.9/X132.1) 9: DI/DO 9 (X122.10/X132.2) 10: DI/DO 10 (X122.12/X132.3) 11: DI/DO 11 (X122.13/X132.4) 12: DI/DO 12 (X132.9) 13: DI/DO 13 (X132.10) 14: DI/DO 14 (X132.12) 15: DI/DO 15 (X132.13) To the terminal designation: The first designation is valid for CU320, the second for CU305.
<b>Remedy:</b>	- set the terminal as input (p0728). - de-select the measuring probe (p0488, p0489, p0580).
Reaction upon F:	OFF1
Acknowl. upon F:	IMMEDIATELY
<b>F07426 (A)</b>	<b>Technology controller actual value limited</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF1 (IASC/DCBRK, NONE, OFF2, OFF3)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	The actual value for the technology controller, interconnected via connector input p2264, has reached a limit. Fault value (r0949, interpret decimal): 1: upper limit reached. 2: lower limit reached.
<b>Remedy:</b>	- adapt the limits to the signal level (p2267, p2268). - Check the actual value normalization (p0595, p0596). - Deactivate evaluation of the limits (p2252 bit 3) See also: p0595 (Technological unit selection), p0596 (Technological unit reference quantity), p2264 (Technology controller actual value), p2267 (Technology controller upper limit actual value), p2268 (Technology controller lower limit actual value)

Reaction upon A: NONE  
Acknowl. upon A: NONE

---

**A07428 (N) Technology controller parameterizing error**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The technology controller has a parameterizing error.  
Alarm value (r2124, interpret decimal):  
1:  
The upper output limit in p2291 is set lower than the lower output limit in p2292.  
**Remedy:** Re alarm value = 1:  
Set the output limit in p2291 higher than in p2292.  
See also: p2291 (Technology controller maximum limiting), p2292 (Technology controller minimum limiting)  
Reaction upon N: NONE  
Acknowl. upon N: NONE

---

**F07447 Load gear: Position tracking, maximum actual value exceeded**

**Message value:** Component number: %1, encoder data set: %2, drive data set: %3  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** NONE  
**Acknowledge:** IMMEDIATELY  
**Cause:** When the position tracking of the load gear is configured, the drive/encoder (motor encoder) identifies a maximum possible absolute position actual value (r2723) that can no longer be represented within 32 bits.  
Maximum value:  $p0408 * p2721 * 2^{p0419}$   
Fault value (r0949, interpret hexadecimal):  
ccbbaa hex  
aa = encoder data set  
bb = component number  
cc = drive data set  
See also: p0408 (Rotary encoder pulse number), p0419 (Fine resolution absolute value Gx\_XIST2 (in bits)), p2721 (Load gear rotary absolute encoder revolutions virtual)  
**Remedy:** - reduce the fine resolution (p0419).  
- reduce the multiturn resolution (p2721).  
See also: p0419 (Fine resolution absolute value Gx\_XIST2 (in bits)), p2721 (Load gear rotary absolute encoder revolutions virtual)

---

**F07448 (A) Load gear: Position tracking, linear axis has exceeded the maximum range**

**Message value:** -  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF1 (NONE, OFF2, OFF3)  
**Acknowledge:** IMMEDIATELY  
**Cause:** For a configured linear axis/no modulo axis, the currently effective motor encoder (encoder 1) has exceeded the maximum possible traversing range.  
For the configured linear axis, the maximum traversing range is defined to be  $64x (+/- 32x)$  of p0421. It should be read in p2721 and interpreted as the number of load revolutions.  
Note:  
Only the motor encoder in the currently effective drive data set is monitored here. The actual effective drive data set is displayed in x = r0051 and the corresponding motor encoder is specified in in p0187[x].  
**Remedy:** The fault should be resolved as follows:  
- select encoder commissioning (p0010 = 4).  
- reset position tracking, position (p2720.2 = 1).  
- de-select encoder commissioning (p0010 = 0).  
The fault should then be acknowledged and the absolute encoder adjusted.  
Reaction upon A: NONE  
Acknowl. upon A: NONE

<b>F07449 (A)</b>	<b>Load gear: Position tracking actual position outside tolerance window</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF1 (NONE, OFF2, OFF3)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>When powered down, the currently effective motor encoder was moved through a distance greater than was parameterized in the tolerance window. It is possible that there is no longer any reference between the mechanical system and encoder.</p> <p>Note:</p> <p>Only the motor encoder in the currently effective drive data set is monitored here. The actual effective drive data set is displayed in x = r0051 and the corresponding motor encoder is specified in in p0187[x].</p> <p>Fault value (r0949, interpret decimal):</p> <p>Deviation (difference) to the last encoder position in increments of the absolute value after the measuring gear - if one is being used. The sign designates the traversing direction.</p> <p>Note:</p> <p>The deviation (difference) found is also displayed in r2724.</p> <p>See also: p2722 (Load gear position tracking tolerance window), r2724 (Load gear position difference)</p>
<b>Remedy:</b>	<p>Reset the position tracking as follows:</p> <ul style="list-style-type: none"> <li>- select encoder commissioning (p0010 = 4).</li> <li>- reset position tracking, position (p2720.2 = 1).</li> <li>- de-select encoder commissioning (p0010 = 0).</li> </ul> <p>The fault should then be acknowledged and, if necessary, the absolute encoder adjusted (p2507).</p> <p>See also: p0010</p>
Reaction upon A:	NONE
Acknowl. upon A:	NONE
<b>F07500</b>	<b>Drive: Power unit data set PDS not configured</b>
<b>Message value:</b>	Drive data set: %1
<b>Drive object:</b>	TM150, TM15DI_DO, TM31
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>Only for controlled line supply infeed/regenerative feedback units:</p> <p>The power unit data set was not configured - this means that a data set number was not entered into the drive data set.</p> <p>Fault value (r0949, interpret decimal):</p> <p>Drive data set number of p0185.</p>
<b>Remedy:</b>	The index of the power unit data set associated with the drive data set should be entered into p0185.
<b>F07501</b>	<b>Drive: Motor Data Set MDS not configured</b>
<b>Message value:</b>	Drive data set: %1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>Only for power units:</p> <p>The motor data set was not configured - this means that a data set number was not entered into the associated drive data set.</p> <p>Fault value (r0949, interpret decimal):</p> <p>The fault value includes the drive data set number of p0186.</p>
<b>Remedy:</b>	The index of the motor data set associated with the drive data set should be entered into p0186.

<b>F07502</b>	<b>Drive: Encoder Data Set EDS not configured</b>
<b>Message value:</b>	Drive data set: %1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>Only for power units:</p> <p>The encoder data set was not configured - this means that a data set number was not entered into the associated drive data set.</p> <p>Fault value (r0949, interpret decimal):</p> <p>The fault value includes the drive data set number of p0187, p0188 and p0189.</p> <p>The fault value is increased by 100 * encoder number (e.g. for p0189: Fault value 3xx with xx = data set number).</p>
<b>Remedy:</b>	The index of the encoder data set associated with the drive data set should be entered into p0187 (1st encoder), p0188 (2nd encoder) and p0189 (3rd encoder).
<b>A07504</b>	<b>Drive: Motor data set is not assigned to a drive data set</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>A motor data set is not assigned to a drive object.</p> <p>All of the existing motor data sets in the drive data sets must be assigned using the MDS number (p0186[0...n]).</p> <p>There must be at least as many drive data sets as motor data sets.</p> <p>Alarm value (r2124, interpret decimal):</p> <p>Number of the motor data set that has not been assigned.</p>
<b>Remedy:</b>	<p>In the drive data sets, assign the non-assigned motor data set using the MDS number (p0186[0...n]).</p> <ul style="list-style-type: none"> <li>- check whether all of the motor data sets are assigned to drive data sets.</li> <li>- if required, delete superfluous motor data sets.</li> <li>- if required, set up new drive data sets and assign to the corresponding motor data sets.</li> </ul>
<b>F07509</b>	<b>Drive: Component number missing</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>A Drive Data Set (DDS) is assigned to a Motor Data Set (MDS) or Encoder Data Set (EDS) that does not have a component number.</p> <p>Alarm value (r2124, interpret decimal):</p> <p>nnmmmmxyyy</p> <p>nn: Number of the MDS/EDS.</p> <p>mmm: Parameter number of the missing component number.</p> <p>xx: Number of the DDS that is assigned to the MDS/EDS.</p> <p>yyy: Parameter number that references the MDS/EDS.</p> <p>Example:</p> <p>p0186[7] = 5: DDS 7 is assigned MDS 5.</p> <p>p0131[5] = 0: There is no component number set in MDS 5.</p> <p>Alarm value = 0513107186</p>
<b>Remedy:</b>	<p>In the drive data sets, no longer assign MDS/EDS using p0186, p0187, p0188, p0189 or set a valid component number.</p> <p>See also: p0141 (Encoder interface (Sensor Module) component number), p0142 (Encoder component number), p0187 (Encoder 1 encoder data set number), p0188 (Encoder 2 encoder data set number)</p>
<b>F07510</b>	<b>Drive: Identical encoder in the drive data set</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	More than one encoder with identical component number is assigned to a single drive data set. In one drive data set, it is not permissible that identical encoders are operated together.



Fault value (r0949, interpret decimal):  
 $1000 * \text{first identical encoder} + 100 * \text{second identical encoder} + \text{drive data set}$ .  
 Example:  
 Fault value = 1203 means:  
 In drive data set 3, the first (p0187[3]) and second encoder (p0188[3]) are identical.

**Remedy:** Assign the drive data set to different encoders.  
 See also: p0141 (Encoder interface (Sensor Module) component number), p0187 (Encoder 1 encoder data set number), p0188 (Encoder 2 encoder data set number)

---

**F07511 Drive: Encoder used a multiple number of times**

**Message value:** %1  
**Drive object:** All objects  
**Reaction:** NONE  
**Acknowledge:** IMMEDIATELY  
**Cause:** Each encoder may only be assigned to one drive and within a drive must - in each drive data set - either always be encoder 1, always encoder 2 or always encoder 3. This unique assignment has been violated.  
 Fault value (r0949, interpret decimal):  
 The two parameters in coded form, that refer to the same component number.  
 First parameter:  
 Index: First and second decimal place (99 for EDS, not assigned DDS)  
 Parameter number: Third decimal place (1 for p0187, 2 for p0188, 3 for p0189, 4 for EDS not assigned DDS)  
 Drive number: Fourth and fifth decimal place  
 Second parameter:  
 Index: Sixth and seventh decimal place (99 for EDS, not assigned DDS)  
 Parameter number: Eighth decimal place (1 for p0187, 2 for p0188, 3 for p0189, 4 for EDS, not assigned DDS)  
 Drive number: Ninth and tenth decimal place  
 See also: p0141 (Encoder interface (Sensor Module) component number)

**Remedy:** Correct the double use of a component number using the two parameters coded in the fault value.

---

**F07512 Drive: Encoder data set changeover cannot be parameterized**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF2  
**Acknowledge:** IMMEDIATELY  
**Cause:** Using p0141, a changeover of the encoder data set is prepared that is illegal. In this firmware release, an encoder data set changeover is only permitted for the components in the actual topology.  
 Alarm value (r2124, interpret decimal):  
 Incorrect EDS data set number.  
 See also: p0187 (Encoder 1 encoder data set number), p0188 (Encoder 2 encoder data set number)

**Remedy:** Every encoder data set must be assigned its own dedicated DRIVE-CLiQ socket. The component numbers of the encoder interfaces (p0141) must have different values within a drive object.  
 The following must apply:  
 p0141[0] not equal to p0141[1] not equal to ... not equal to p0141[n]

---

**F07515 Drive: Power unit and motor incorrectly connected**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF2  
**Acknowledge:** IMMEDIATELY  
**Cause:** A power unit (via PDS) was assigned to a motor (via MDS) in a drive data set that is not connected in the target topology. It is possible that a motor has not been assigned to the power unit (p0131).  
 Fault value (r0949, interpret decimal):  
 Number of the incorrectly parameterized drive data set.

**Remedy:** - assign the drive data set to a combination of motor and power unit permitted by the target topology.  
 - adapt the target topology.  
 - If required, for a missing motor, recreate the component (drive Wizard).  
 See also: p0121 (Power unit component number)

<b>F07516</b>	<b>Drive: Re-commission the data set</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	The assignment between the drive data set and motor data set (p0186) or between the drive data set and the encoder data set was modified (p0187). This is the reason that the drive data set must re-commissioned. Fault value (r0949, interpret decimal): Drive data set to be re-commissioned.
<b>Remedy:</b>	Commission the drive data set specified in the fault value (r0949).
<b>F07517</b>	<b>Drive: Encoder data set changeover incorrectly parameterized</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	An MDS cannot have different motor encoders in two different DDS. The following parameterization therefore results results in an error: p0186[0] = 0, p0187[0] = 0 p0186[0] = 0, p0187[0] = 1 Alarm value (r2124, interpret decimal): The lower 16 bits indicate the first DDS and the upper 16 bits indicate the second DDS.
<b>Remedy:</b>	If you wish to operate a motor once with one motor encoder and then another time with the other motor encoder, then you must set up two different MDSs, in which the motor data are the same. Example: p0186[0] = 0, p0187[0] = 0 p0186[0] = 1, p0187[0] = 1
<b>F07518</b>	<b>Drive: Motor data set changeover incorrectly parameterized</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	The system has identified that two motor data sets were incorrectly parameterized. Parameter r0313 (calculated from p0314, p0310, p0311), r0315 and p1982 may only have different values if the motor data sets are assigned different motors. p0827 is used to assign the motors and/contactors. It is not possible to toggle between motor data sets. Alarm value (r2124, interpret hexadecimal): xxxxyyyy: First DDS with assigned MDS, yyyy: Second DDS with assigned MDS
<b>Remedy:</b>	Correct the parameterization of the motor data sets.
<b>A07530</b>	<b>Drive: Drive Data Set DDS not present</b>
<b>Message value:</b>	-
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	The selected drive data set is not available (p0837 > p0180). The drive data set was not changed over. See also: p0180 (Number of Drive Data Sets (DDS)), p0820 (Drive Data Set selection DDS bit 0), p0821 (Drive Data Set selection DDS bit 1), r0837 (Drive Data Set DDS selected)
<b>Remedy:</b>	- select the existing drive data set. - set up additional drive data sets.

---

<b>A07531</b>	<b>Drive: Command Data Set CDS not present</b>
Message value:	-
Drive object:	All objects
Reaction:	NONE
Acknowledge:	NONE
Cause:	The selected command data set is not available (p0836 > p0170). The command data set was not changed over. See also: p0810 (Command data set selection CDS bit 0), r0836 (Command Data Set CDS selected)
Remedy:	- select the existing command data set. - set up additional command data sets.

---

<b>A07541</b>	<b>Drive: Data set changeover not possible</b>
Message value:	-
Drive object:	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
Reaction:	NONE
Acknowledge:	NONE
Cause:	The selected drive data set changeover and the assigned motor changeover are not possible and are not carried out. For synchronous motors, the motor contactor may only be switched for actual speeds less than the speed at the start of field weakening (r0063 < p0348). See also: r0063 (Speed actual value)
Remedy:	Reduce the speed to below the speed at the start of field weakening (r0063 < p0348).

---

<b>A07550 (F, N)</b>	<b>Drive: Not possible to reset encoder parameters</b>
Message value:	%1
Drive object:	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
Reaction:	NONE
Acknowledge:	NONE
Cause:	When carrying out a factory setting (e.g. using p0970 = 1), it was not possible to reset the encoder parameters. The encoder parameters are directly read out of the encoder via DRIVE-CLiQ. Alarm value (r2124, interpret decimal): Component number of the encoder involved.
Remedy:	- repeat the operation. - check the DRIVE-CLiQ connection.
Reaction upon F:	NONE (IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)
Acknowled. upon F:	IMMEDIATELY (POWER ON)
Reaction upon N:	NONE
Acknowled. upon N:	NONE

---

<b>F07551</b>	<b>Drive encoder: No commutation angle information</b>
Message value:	Fault cause: %1, drive data set: %2
Drive object:	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
Reaction:	OFF2 (IASC/DCBRK)
Acknowledge:	IMMEDIATELY (POWER ON)
Cause:	The commutation angle information is missing. This means that synchronous motors cannot be controlled (closed-loop control) Fault value (r0949, interpret decimal): yyyyxxxx dec: yyyy = fault cause, xxxx = drive data set yyyy = 1 dec: The motor encoder used does not supply an absolute commutation angle. yyyy = 2 dec: The selected ratio of the measuring gear does not match the motor pole pair number.
Remedy:	Re fault cause = 1: - check the encoder parameterization (p0404). - use an encoder with track C/D, EnDat interface of Hall sensors. - use an encoder with sinusoidal A/B track for which the motor pole pair number (r0313) is an integer multiple of the encoder pulse number (p0408). - activate the pole position identification routine (p1982 = 1).

---

Re fault cause = 2:

- the quotient of the pole pair number divided by the ratio of the measuring gear must be an integer number: (p0314 \* p0433) / p0432.

Note:

For operation with track C/D, this quotient must be less than 8.

See also: p0402 (Gearbox type selection), p0404 (Encoder configuration effective), p0432 (Gearbox factor encoder revolutions), p0433 (Gearbox factor motor/load revolutions)

<b>F07552 (A)</b>	<b>Drive encoder: Encoder configuration not supported</b>
<b>Message value:</b>	Fault cause: %1, component number: %2, encoder data set: %3
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF2 (IASC/DCBRK, NONE, OFF1, OFF3, STOP1, STOP2)
<b>Acknowledge:</b>	IMMEDIATELY (POWER ON)
<b>Cause:</b>	<p>The requested encoder configuration is not supported. Only bits may be requested in p0404 that are signaled as being supported by the encoder evaluation in r0456.</p> <p>Fault value (r0949, interpret decimal):</p> <p>ccccbbaa hex: cccc = fault cause, bb = component number, aa = encoder data set</p> <p>cccc = 1: encoder sin/cos with absolute track (is supported by SME25).</p> <p>cccc = 3: Squarewave encoder (this is supported by SMC30).</p> <p>cccc = 4: sin/cos encoder (this is supported by SMC20, SMI20, SME20, SME25).</p> <p>cccc = 10: DRIVE-CLiQ encoder (is supported by DQI).</p> <p>cccc = 12: sin/cos encoder with reference mark (this is supported by SME20).</p> <p>cccc = 15: Commutation with zero mark for separately-excited synchronous motors with VECTORMV.</p> <p>cccc = 23: Resolver (this is supported by SMC10, SMI10).</p> <p>cccc = 65535: Other function (compare r0456 and p0404).</p> <p>See also: p0404 (Encoder configuration effective), r0456 (Encoder configuration supported)</p>
<b>Remedy:</b>	<p>- check the encoder parameterization (p0400, p0404).</p> <p>- use the matching encoder evaluation (r0456).</p>
Reaction upon A:	NONE
Acknowl. upon A:	NONE
<b>F07553 (A)</b>	<b>Drive encoder: Sensor Module configuration not supported</b>
<b>Message value:</b>	Encoder data set: %1, first incorrect bit: %2, incorrect parameter: %3
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF2 (IASC/DCBRK, NONE, OFF1, OFF3, STOP1, STOP2)
<b>Acknowledge:</b>	IMMEDIATELY (POWER ON)
<b>Cause:</b>	<p>The Sensor Module does not support the requested configuration.</p> <p>For incorrect p0430 (cc = 0), the following applies:</p> <p>- In p0430 (requested functions), at least 1 bit was set that is not set in r0458 (supported functions) (exception: Bit 19, 28, 29, 30, 31).</p> <p>- p1982 &gt; 0 (pole position identification requested), but r0458.16 = 0 (pole position identification not supported).</p> <p>For incorrect p0437 (cc = 1), the following applies:</p> <p>- In p0437 (requested functions), at least 1 bit was set that is not set in r0459 (supported functions).</p> <p>Fault value (r0949, interpret hexadecimal):</p> <p>ddccbbaa hex</p> <p>aa: encoder data set number</p> <p>bb: first incorrect bit</p> <p>cc: incorrect parameter</p> <p>cc = 0: incorrect parameter is p0430</p> <p>cc = 1: incorrect parameter is p0437</p> <p>cc = 2: incorrect parameter is r0459</p> <p>dd: reserved (always 0)</p>
<b>Remedy:</b>	<p>- check the encoder parameterization (p0430, p0437).</p> <p>- check the pole position identification routine (p1982).</p> <p>- use the matching encoder evaluation (r0458, r0459).</p> <p>See also: p0430 (Sensor Module configuration), p0437 (Sensor Module configuration extended), r0458 (Sensor Module properties), r0459 (Sensor Module properties extended)</p>
Reaction upon A:	NONE
Acknowl. upon A:	NONE

<b>F07555 (A)</b>	<b>Drive encoder: Configuration position tracking</b>
<b>Message value:</b>	Component number: %1, encoder data set: %2, drive data set: %3, fault cause: %4
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF2 (IASC/DCBRK, NONE, OFF1, OFF3, STOP1, STOP2)
<b>Acknowledge:</b>	IMMEDIATELY (POWER ON)
<b>Cause:</b>	<p>For position tracking, the configuration is not supported.</p> <p>Position tracking can only be activated for absolute encoders.</p> <p>For linear axes, it is not possible to simultaneously activate the position tracking for load and measuring gears.</p> <p>Fault value (r0949, interpret hexadecimal):</p> <p>ddccbbaa hex</p> <p>aa = encoder data set</p> <p>bb = component number</p> <p>cc = drive data set</p> <p>dd = fault cause</p> <p>dd = 00 hex = 0 dec</p> <p>An absolute encoder is not being used.</p> <p>dd = 01 hex = 1 dec</p> <p>Position tracking cannot be activated because the memory of the internal NVRAM is not sufficient or a Control Unit does not have an NVRAM.</p> <p>dd = 02 hex = 2 dec</p> <p>For a linear axis, the position tracking was activated for the load and measuring gear.</p> <p>dd = 03 hex = 3 dec</p> <p>Position tracking cannot be activated because position tracking with another gear ratio, axis type or tolerance window has already been detected for this encoder data set.</p> <p>dd = 04 hex = 4 dec</p> <p>A linear encoder is being used.</p> <p>See also: p0404 (Encoder configuration effective), p0411 (Measuring gear configuration)</p>
<b>Remedy:</b>	<p>Re fault value 0:</p> <ul style="list-style-type: none"><li>- use an absolute encoder.</li></ul> <p>Re fault value 1:</p> <ul style="list-style-type: none"><li>- use a Control Unit with sufficient NVRAM.</li></ul> <p>Re fault value 2,4:</p> <ul style="list-style-type: none"><li>- if necessary, de-select the position tracking (p0411 for the measuring gear, p2720 for the load gear).</li></ul> <p>Re fault value 3:</p> <ul style="list-style-type: none"><li>- Only activate position tracking of the load gear in the same encoder data set if the gear ratio (p2504, p2505), axis type (p2720.1) and tolerance window (p2722) are also the same. These parameters must be the same in all drive data sets, which use the same motor encoder (p187).</li></ul>
Reaction upon A:	NONE
Acknowled. upon A:	NONE
<b>F07556</b>	<b>Measuring gear: Position tracking, maximum actual value exceeded</b>
<b>Message value:</b>	Component number: %1, encoder data set: %2
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>When the position tracking of the measuring gear is configured, the drive/encoder identifies a maximum possible absolute position actual value (r0483) that cannot be represented within 32 bits.</p> <p>Maximum value: <math>p0408 * p0412 * 2^{p0419}</math></p> <p>Fault value (r0949, interpret decimal):</p> <p>aaaayyxx hex: yy = component number, xx = encoder data set</p> <p>See also: p0408 (Rotary encoder pulse number), p0412 (Measuring gear absolute encoder rotary revolutions virtual), p0419 (Fine resolution absolute value Gx_XIST2 (in bits))</p>
<b>Remedy:</b>	<ul style="list-style-type: none"><li>- reduce the fine resolution (p0419).</li><li>- reduce the multiturn resolution (p0412).</li></ul> <p>See also: p0412 (Measuring gear absolute encoder rotary revolutions virtual), p0419 (Fine resolution absolute value Gx_XIST2 (in bits))</p>

<b>F07560</b>	<b>Drive encoder: Number of pulses is not to the power of two</b>
<b>Message value:</b>	Encoder data set: %1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF2 (IASC/DCBRK, NONE, OFF1, OFF3, STOP1, STOP2)
<b>Acknowledge:</b>	IMMEDIATELY (POWER ON)
<b>Cause:</b>	For rotary absolute encoders, the pulse number in p0408 must be to the power of two. Fault value (r0949, interpret decimal): The fault value includes the encoder data set number involved.
<b>Remedy:</b>	- check the parameterization (p0408, p0404.1, r0458.5). - upgrade the Sensor Module firmware if necessary
<b>F07561</b>	<b>Drive encoder: Number of multiturn pulses is not to the power of two</b>
<b>Message value:</b>	Encoder data set: %1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF2 (IASC/DCBRK, NONE, OFF1, OFF3, STOP1, STOP2)
<b>Acknowledge:</b>	IMMEDIATELY (POWER ON)
<b>Cause:</b>	The multiturn resolution in p0421 must be to the power of two. Fault value (r0949, interpret decimal): The fault value includes the encoder data set number involved.
<b>Remedy:</b>	- check the parameterization (p0421, p0404.1, r0458.5). - upgrade the Sensor Module firmware if necessary
<b>F07562 (A)</b>	<b>Drive, encoder: Position tracking, incremental encoder not possible</b>
<b>Message value:</b>	Fault cause: %1, component number: %2, encoder data set: %3
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF2 (IASC/DCBRK, NONE, OFF1, OFF3, STOP1, STOP2)
<b>Acknowledge:</b>	IMMEDIATELY (POWER ON)
<b>Cause:</b>	The requested position tracking for incremental encoders is not supported. Fault value (r0949, interpret hexadecimal): ccccbbaa hex aa = encoder data set bb = component number cccc = fault cause cccc = 00 hex = 0 dec The encoder type does not support the "Position tracking incremental encoder" function. cccc = 01 hex = 1 dec Position tracking cannot be activated because the memory of the internal NVRAM is not sufficient or a Control Unit does not have an NVRAM. cccc = 04 hex = 4 dec A linear encoder is used that does not support the "position tracking" function. See also: p0404 (Encoder configuration effective), p0411 (Measuring gear configuration), r0456 (Encoder configuration supported)
<b>Remedy:</b>	- check the encoder parameterization (p0400, p0404). - use a Control Unit with sufficient NVRAM. - if required, de-select position tracking for the incremental encoder (p0411.3 = 0).
Reaction upon A:	NONE
Acknowled. upon A:	NONE
<b>F07563 (A)</b>	<b>Drive encoder: XIST1_ERW configuration incorrect</b>
<b>Message value:</b>	Fault cause: %1, encoder data set: %2
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF2 (IASC/DCBRK, NONE, OFF1, OFF3, STOP1, STOP2)
<b>Acknowledge:</b>	IMMEDIATELY (POWER ON)
<b>Cause:</b>	An incorrect configuration was identified for the "Absolute position for incremental encoder" function.

Fault value (r0949, interpret decimal):  
 Fault cause:  
 1 (= 01 hex):  
 The "Absolute value for incremental encoder" function is not supported (r0459.13 = 0).  
 Note regarding the message value:  
 The individual information is coded as follows in the message value (r0949/r2124):  
 yyxx dec: yy = fault cause, xx = encoder data set  
 See also: r0459 (Sensor Module properties extended), p4652 (XIST1\_ERW reset mode)

**Remedy:** For fault value = 1:  
 - upgrade the Sensor Module firmware version.  
 - check the mode (p4652 = 1, 3 requires the property r0459.13 = 1).

Reaction upon A: NONE  
 Acknowl. upon A: NONE

---

**A07565 (F, N) Drive: Encoder error in PROFIdrive encoder interface 1**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** An encoder error was signaled for encoder 1 via the PROFIdrive encoder interface (G1\_ZSW.15).  
 Alarm value (r2124, interpret decimal):  
 Error code from G1\_XIST2, refer to the description regarding r0483.  
 Note:  
 This alarm is only output if p0480[0] is not equal to zero.

**Remedy:** Acknowledge the encoder error using the encoder control word (G1\_STW.15 = 1).

Reaction upon F: NONE (OFF1, OFF2, OFF3)  
 Acknowl. upon F: IMMEDIATELY  
 Reaction upon N: NONE  
 Acknowl. upon N: NONE

---

**A07566 (F, N) Drive: Encoder error in PROFIdrive encoder interface 2**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** An encoder error was signaled for encoder 2 via the PROFIdrive encoder interface (G2\_ZSW.15).  
 Alarm value (r2124, interpret decimal):  
 Error code from G2\_XIST2, refer to the description regarding r0483.  
 Note:  
 This alarm is only output if p0480[1] is not equal to zero.

**Remedy:** Acknowledge the encoder error using the encoder control word (G2\_STW.15 = 1).

Reaction upon F: NONE (OFF1, OFF2, OFF3)  
 Acknowl. upon F: IMMEDIATELY  
 Reaction upon N: NONE  
 Acknowl. upon N: NONE

---

**A07567 (F, N) Drive: Encoder error in PROFIdrive encoder interface 3**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** An encoder error was signaled for encoder 3 via the PROFIdrive encoder interface (G3\_ZSW.15).  
 Alarm value (r2124, interpret decimal):  
 Error code from G3\_XIST2, refer to the description regarding r0483.  
 Note:  
 This alarm is only output if p0480[2] is not equal to zero.

**Remedy:** Acknowledge the encoder error using the encoder control word (G3\_STW.15 = 1).

Reaction upon F: NONE (OFF1, OFF2, OFF3)  
 Acknowl. upon F: IMMEDIATELY  
 Reaction upon N: NONE  
 Acknowl. upon N: NONE

---

**A07569 (F) Encoder could not be identified**

**Message value:** -  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** During encoder identification (waiting) with p0400 = 10100, the encoder could not be identified.  
 Either the wrong encoder has been installed or no encoder has been installed, the wrong encoder cable has been connected or no encoder cable has been connected to the Sensor Module, or the DRIVE-CLiQ component has not been connected to DRIVE-CLiQ.  
**Note:**  
 Encoder identification must be supported by the encoder and is possible in the following cases:  
 - Encoder with EnDat interface  
 - Motor with DRIVE-CLiQ  
**Remedy:**  
 - check and, if necessary, connect the encoder and/or encoder cable.  
 - check and, if necessary, establish the DRIVE-CLiQ connection.  
 - in the case of encoders that cannot be identified (e.g. encoders without EnDat interface), the correct encoder type must be entered in p0400.  
 Reaction upon F: NONE (OFF1, OFF2, OFF3)  
 Acknowl. upon F: IMMEDIATELY

---

**F07575 Drive: Motor encoder not ready**

**Message value:** -  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF2 (ENCODER)  
**Acknowledge:** IMMEDIATELY  
**Cause:** The motor encoder signals that it is not ready.  
 - initialization of encoder 1 (motor encoder) was unsuccessful.  
 - the function "parking encoder" is active (encoder control word G1\_STW.14 = 1).  
 - the encoder interface (Sensor Module) is de-activated (p0145).  
 - the Sensor Module is defective.  
**Remedy:** Evaluate other queued faults via encoder 1.

---

**A07580 (F, N) Drive: No Sensor Module with matching component number**

**Message value:** Encoder data set: %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** A Sensor Module with the component number specified in p0141 was not found.  
 Alarm value (r2124, interpret decimal):  
 Encoder data set involved (index of p0141).  
**Remedy:** Correct parameter p0141.  
 Reaction upon F: OFF1 (IASC/DCBRK, NONE, OFF2, OFF3, STOP1, STOP2)  
 Acknowl. upon F: IMMEDIATELY (POWER ON)  
 Reaction upon N: NONE  
 Acknowl. upon N: NONE



---

**A07850 (F)      External alarm 1**

**Message value:** -  
**Drive object:** All objects  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The BICO signal for "external alarm 1" was triggered.  
The condition for this external alarm is fulfilled.  
See also: p2112 (External alarm 1)  
**Remedy:** Eliminate the causes of this alarm.  
Reaction upon F: NONE (IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)  
Acknowl. upon F: IMMEDIATELY (POWER ON)

---

**A07851 (F)      External alarm 2**

**Message value:** -  
**Drive object:** All objects  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The BICO signal for "external alarm 2" was triggered.  
The condition for this external alarm is fulfilled.  
See also: p2116 (External alarm 2)  
**Remedy:** Eliminate the causes of this alarm.  
Reaction upon F: NONE (IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)  
Acknowl. upon F: IMMEDIATELY (POWER ON)

---

**A07852 (F)      External alarm 3**

**Message value:** -  
**Drive object:** All objects  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The BICO signal for "external alarm 3" was triggered.  
The condition for this external alarm is fulfilled.  
See also: p2117 (External alarm 3)  
**Remedy:** Eliminate the causes of this alarm.  
Reaction upon F: NONE (IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)  
Acknowl. upon F: IMMEDIATELY (POWER ON)

---

**F07860 (A)      External fault 1**

**Message value:** -  
**Drive object:** All objects  
**Reaction:** OFF2 (IASC/DCBRK, NONE, OFF1, OFF3, STOP1, STOP2)  
**Acknowledge:** IMMEDIATELY (POWER ON)  
**Cause:** The BICO signal "external fault 1" was triggered.  
See also: p2106 (External fault 1)  
**Remedy:** Eliminate the causes of this fault.  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

**F07861 (A)      External fault 2**

**Message value:** -  
**Drive object:** All objects  
**Reaction:** OFF2 (IASC/DCBRK, NONE, OFF1, OFF3, STOP1, STOP2)  
**Acknowledge:** IMMEDIATELY (POWER ON)  
**Cause:** The BICO signal "external fault 2" was triggered.  
See also: p2107 (External fault 2)  
**Remedy:** Eliminate the causes of this fault.

Reaction upon A: NONE  
Acknowl. upon A: NONE

---

**F07862 (A) External fault 3**  
**Message value:** -  
**Drive object:** All objects  
**Reaction:** OFF2 (IASC/DCBRK, NONE, OFF1, OFF3, STOP1, STOP2)  
**Acknowledge:** IMMEDIATELY (POWER ON)  
**Cause:** The BICO signal "external fault 3" was triggered.  
See also: p2108, p3111, p3112  
**Remedy:** Eliminate the causes of this fault.  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

**F08000 (N, A) TB: +/-15 V power supply faulted**  
**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** NONE (IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)  
**Acknowledge:** IMMEDIATELY (POWER ON)  
**Cause:** Terminal Board 30 detects an incorrect internal power supply voltage.  
Fault value (r0949, interpret decimal):  
0: Error when testing the monitoring circuit.  
1: Fault in normal operation.  
**Remedy:** - replace Terminal Board 30.  
- replace Control Unit.  
Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

**F08010 (N, A) TB: Analog-digital converter**  
**Message value:** -  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** NONE (IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)  
**Acknowledge:** IMMEDIATELY (POWER ON)  
**Cause:** The analog/digital converter on Terminal Board 30 has not supplied any converted data.  
**Remedy:** - check the power supply.  
- replace Terminal Board 30.  
Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

**F08500 (A) COMM BOARD: Monitoring time configuration expired**  
**Message value:** %1  
**Drive object:** All objects  
**Reaction:** OFF1 (OFF2, OFF3)  
**Acknowledge:** IMMEDIATELY  
**Cause:** The monitoring time for the configuration has expired.  
Fault value (r0949, interpret decimal):  
0: The transfer time of the send configuration data has been exceeded.  
1: The transfer time of the receive configuration data has been exceeded.  
**Remedy:** Check communications link.  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

---

**F08501 (N, A)      COMM BOARD: Setpoint timeout**

**Message value:** -  
**Drive object:** All objects  
**Reaction:** OFF3 (IASC/DCBRK, NONE, OFF1, OFF2, STOP1, STOP2)  
**Acknowledge:** IMMEDIATELY  
**Cause:** The reception of setpoints from the COMM BOARD has been interrupted.  
- bus connection interrupted.  
- controller switched off.  
- controller set into the STOP state.  
- COMM BOARD defective.  
See also: p8840 (COMM BOARD monitoring time)  
**Remedy:** - Restore the bus connection and set the controller to RUN.  
- check the set monitoring time if the error persists.  
See also: p8840 (COMM BOARD monitoring time)  
  
Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

**F08502 (A)      COMM BOARD: Monitoring time sign-of-life expired**

**Message value:** -  
**Drive object:** All objects  
**Reaction:** OFF1 (OFF2, OFF3)  
**Acknowledge:** IMMEDIATELY  
**Cause:** The monitoring time for the sign-of-life counter has expired.  
The connection to the COMM BOARD was interrupted.  
**Remedy:** - check communications link.  
- check COMM BOARD.  
  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

**A08504 (F)      COMM BOARD: Internal cyclic data transfer error**

**Message value:** %1  
**Drive object:** All objects  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The cyclic actual and/or setpoint values were not transferred within the specified times.  
Alarm value (r2124, interpret decimal):  
Only for internal Siemens troubleshooting.  
**Remedy:** Check the parameterizing telegram (Ti, To, Tdp, etc.).  
Reaction upon F: NONE (OFF1, OFF2, OFF3)  
Acknowl. upon F: IMMEDIATELY

---

**F08510 (A)      COMM BOARD: Send configuration data invalid**

**Message value:** %1  
**Drive object:** All objects  
**Reaction:** OFF1 (OFF2, OFF3)  
**Acknowledge:** IMMEDIATELY  
**Cause:** COMM BOARD did not accept the send-configuration data.  
Fault value (r0949, interpret decimal):  
Return value of the send-configuration data check.  
**Remedy:** Check the send configuration data.  
Reaction upon A: NONE  
Acknowl. upon A: NONE

<b>A08511 (F)</b>	<b>COMM BOARD: Receive configuration data invalid</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>The drive unit did not accept the receive configuration data.</p> <p>Alarm value (r2124, interpret decimal):</p> <p>Return value of the receive configuration data check.</p> <p>1: Connection established to more drive objects than configured in the device. The drive objects for process data exchange and their sequence are defined in p0978.</p> <p>2: Too many PZD data words for output or input to a drive object. The number of possible PZD items in a drive object is determined by the number of indices in r2050/p2051 for PZD IF1, and in r8850/p8851 for PZD IF2.</p> <p>3: Uneven number of bytes for input or output.</p> <p>4: Setting data for synchronization not accepted. For more information, see A01902.</p> <p>5: Cyclic operation not active.</p> <p>17: CBE20 Shared Device: Configuration of the F-CPU has been changed.</p> <p>223: Illegal clock synchronization for the PZD interface set in p8815[0].</p> <p>500: Illegal PROFIsafe configuration for the interface set in p8815[1].</p> <p>501: PROFIsafe parameter error (e.g. F_dest).</p> <p>503: PROFIsafe connection is rejected as long as there is no isochronous connection (p8969).</p> <p>Additional values:</p> <p>Only for internal Siemens troubleshooting.</p>
<b>Remedy:</b>	<p>Check the receive configuration data.</p> <p>Re alarm value = 1, 2:</p> <ul style="list-style-type: none"> <li>- Check the list of the drive objects with process data exchange (p0978). With p0978[x] = 0, all of the following drive objects in the list are excluded from the process data exchange.</li> </ul> <p>Re alarm value = 2:</p> <ul style="list-style-type: none"> <li>- Check the number of data words for output and input to a drive object.</li> </ul> <p>Re alarm value = 17:</p> <ul style="list-style-type: none"> <li>- CBE20 Shared Device: Unplug/plug A-CPU.</li> </ul> <p>Re alarm value = 223, 500:</p> <ul style="list-style-type: none"> <li>- Check the setting in p8839 and p8815.</li> <li>- Ensure that only one PZD interface is operated in clock synchronism or with PROFIsafe.</li> </ul> <p>Re alarm value = 501:</p> <ul style="list-style-type: none"> <li>- Check the set PROFIsafe address (p9610).</li> </ul>
Reaction upon F:	NONE (OFF1, OFF2, OFF3)
Acknowl. upon F:	IMMEDIATELY
<b>A08520 (F)</b>	<b>COMM BOARD: Non-cyclic channel error</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>The memory or the buffer status of the non-cyclic channel has an error.</p> <p>Alarm value (r2124, interpret decimal):</p> <p>0: Error in the buffer status.</p> <p>1: Error in the memory.</p>
<b>Remedy:</b>	Check communications link.
Reaction upon F:	NONE (OFF1, OFF2, OFF3)
Acknowl. upon F:	IMMEDIATELY
<b>A08526 (F)</b>	<b>COMM BOARD: No cyclic connection</b>
<b>Message value:</b>	-
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	There is no cyclic connection to the control.

**Remedy:** Establish the cyclic connection and activate the control with cyclic operation.  
For PROFINET, check the parameters "Name of Station" and "IP of Station" (r61000, r61001).  
If a CBE20 is inserted and PROFIBUS is to communicate via PZD Interface 1, then this must be parameterized using the STARTER commissioning tool or directly using p8839.

Reaction upon F: NONE (OFF1)

Acknowledgment upon F: IMMEDIATELY

---

**A08530 (F) COMM BOARD: Message channel error**

**Message value:** %1

**Drive object:** All objects

**Reaction:** NONE

**Acknowledge:** NONE

**Cause:** The memory or the buffer status of the message channel has an error.

Alarm value (r2124, interpret decimal):

0: Error in the buffer status.

1: Error in the memory.

**Remedy:** Check communications link.

Reaction upon F: NONE (OFF1, OFF2, OFF3)

Acknowledgment upon F: IMMEDIATELY

---

**A08550 PZD Interface Hardware assignment error**

**Message value:** %1

**Drive object:** CU\_DC, CU\_DC\_R, CU\_DC\_R\_S, CU\_DC\_S

**Reaction:** NONE

**Acknowledge:** NONE

**Cause:** The assignment of the hardware to the PZD interface has been incorrectly parameterized.

Alarm value (r2124, interpret decimal):

3: Assigned COMM BOARD missing.

See also: p8839 (PZD interface hardware assignment)

**Remedy:** Check the parameterization and if required, correct (p8839).

---

**A08550 PZD Interface Hardware assignment error**

**Message value:** %1

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31

**Reaction:** NONE

**Acknowledge:** NONE

**Cause:** The assignment of the hardware to the PZD interface has been incorrectly parameterized.

Alarm value (r2124, interpret decimal):

1: Only one of the two indices is not equal to 99 (automatic).

2: Both PZD interfaces are assigned to the same hardware.

3: Assigned COMM BOARD missing.

4: CBC10 is assigned to interface 1.

See also: p8839 (PZD interface hardware assignment)

**Remedy:** Check the parameterization and if required, correct (p8839).

---

**A08564 CBE20: Syntax error in configuration file**

**Message value:** -

**Drive object:** All objects

**Reaction:** NONE

**Acknowledge:** NONE

**Cause:** A syntax error has been detected in the ASCII configuration file for the Communication Board Ethernet 20 (CBE20).  
The saved configuration file has not been loaded.

**Remedy:** - Check the CBE20 configuration (p8940 and following), correct if necessary, and activate (p8945 = 2).

Note:

The configuration is not applied until the next POWER ON!

- reconfigure the CBE20 (e.g. using the STARTER commissioning software)

See also: p8945 (CBE20 interface configuration)

<b>A08565</b>	<b>CBE20: Consistency error affecting adjustable parameters</b>
<b>Message value:</b>	-
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>A consistency error was detected when activating the configuration (p8945 = 1) for the Communication Board Ethernet 20 (CBE20).</p> <p>The currently set configuration has not been activated.</p> <p>Possible causes:</p> <ul style="list-style-type: none"> <li>- IP address, subnet mask or default gateway is not correct</li> <li>- IP address or station name used twice in the network</li> <li>- station name contains invalid characters, etc.</li> </ul> <p>See also: p8940 (CBE20 Name of Station), p8941 (CBE20 IP Address of Station), p8942 (CBE20 Default Gateway of Station), p8943 (CBE20 Subnet Mask of Station), p8944 (CBE20 DHCP Mode)</p>
<b>Remedy:</b>	<p>Check the required interface configuration (p8940 and following), correct if necessary, and activate (p8945 = 1).</p> <p>See also: p8945 (CBE20 interface configuration)</p>
<b>A13000</b>	<b>License not adequate</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<ul style="list-style-type: none"> <li>- for the drive unit, the options that require a license are being used but the licenses are not sufficient.</li> <li>- an error occurred when checking the existing licenses.</li> </ul> <p>Alarm value (r2124, interpret decimal):</p> <p>0: The existing license is not sufficient.</p> <p>1: An adequate license was not able to be determined as the memory card with the required licensing data was withdrawn in operation.</p> <p>2: An adequate license was not able to be determined as there is no licensing data available on the memory card.</p> <p>3: An adequate license was not able to be determined as there is a checksum error in the license key.</p> <p>4: An internal error occurred when checking the license.</p>
<b>Remedy:</b>	<p>Re alarm value = 0: Additional licenses are required and these must be activated (p9920, p9921).</p> <p>Re alarm value = 1: With the system powered down, re-insert the memory card that matches the system.</p> <p>Re alarm value = 2: Enter and activate the license key (p9920, p9921).</p> <p>Re alarm value = 3: Compare the license key (p9920) entered with the license key on the certificate of license. Re-enter the license key and activate (p9920, p9921).</p> <p>Re alarm value = 4:  <ul style="list-style-type: none"> <li>- carry out a POWER ON.</li> <li>- upgrade firmware to later version.</li> <li>- contact the Hotline.</li> </ul> </p>
<b>A13001</b>	<b>Error in license checksum</b>
<b>Message value:</b>	-
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	When checking the checksum of the license key, an error was detected.
<b>Remedy:</b>	<p>Compare the license key (p9920) entered with the license key on the certificate of license.</p> <p>Re-enter the license key and activate (p9920, p9921).</p>

---

**F13009      Licensing OA application not licensed**

**Message value:** %1  
**Drive object:** All objects  
**Reaction:** OFF1  
**Acknowledge:** IMMEDIATELY  
**Cause:** At least one OA application which is under license does not have a license.  
Note:  
Refer to r4955 and p4955 for information about the installed OA applications.  
**Remedy:** - enter and activate the license key for OA applications under license (p9920, p9921).  
- if necessary, de-activate unlicensed OA applications (p4956).  
See also: p9920 (Licensing enter license key), p9921 (Licensing activate license key)

---

**F13010      Licensing function module not licensed**

**Message value:** %1  
**Drive object:** All objects  
**Reaction:** OFF1  
**Acknowledge:** IMMEDIATELY  
**Cause:** At least one function module which is under license does not have a license.  
Fault value (r0949, interpret hexadecimal):  
Bit x = 1: The corresponding function module does not have a license.  
Note:  
Refer to p0108 or r0108 for the assignment between the bit number and function module.  
**Remedy:** - enter and activate the license key for function modules under license (p9920, p9921).  
- if necessary, de-activate unlicensed function modules (p0108, r0108).  
See also: p9920 (Licensing enter license key), p9921 (Licensing activate license key)

---

**F13100      Know-how protection: Copy protection error**

**Message value:** %1  
**Drive object:** All objects  
**Reaction:** OFF1  
**Acknowledge:** IMMEDIATELY  
**Cause:** The know-how protection with copy protection for the memory card is active.  
An error has occurred when checking the memory card.  
Fault value (r0949, interpret decimal):  
0: A memory card is not inserted.  
2: An invalid memory card is inserted.  
3: The memory card is being used in another Control Unit.  
12: An invalid memory card is inserted (OEM input incorrect, p7769).  
13: The memory card is being used in another Control Unit (OEM input incorrect, p7759).  
See also: p7765 (KHP memory card copy protection)  
**Remedy:** For fault value = 0:  
- Insert the correct memory card and carry out POWER ON.  
Re fault value = 2, 3, 12, 13:  
- contact the responsible OEM.  
- Deactivate copy protection (p7765) and acknowledge the fault (p3981).  
- Deactivate know-how protection (p7766 ... p7768) and acknowledge the fault (p3981).  
Note:  
In general, the copy protection can only be changed when know-how protection is deactivated.  
KHP: Know-How Protection  
See also: p3981 (Faults acknowledge drive object), p7765 (KHP memory card copy protection)

---

**F13101      Know-how protection: Copy protection cannot be activated**

**Message value:** %1  
**Drive object:** All objects  
**Reaction:** NONE  
**Acknowledge:** IMMEDIATELY  
**Cause:** An error occurred when attempting to activate the copy protection for the memory card.

Fault value (r0949, interpret decimal):

0: A memory card is not inserted.

Note:

KHP: Know-How Protection

**Remedy:**

- insert the memory card and carry out POWER ON.
- Try to activate copy protection again (p7765).

See also: p7765 (KHP memory card copy protection)

---

### **F13102      Know-how protection: Consistency error of the protected data**

**Message value:** %1

**Drive object:** All objects

**Reaction:** OFF1

**Acknowledge:** IMMEDIATELY

**Cause:** An error was identified when checking the consistency of the protected files. As a consequence, the project on the memory card cannot be run.

Fault value (r0949, interpret hexadecimal):

yyyyxxxx hex: yyyy = object number, xxxx = fault cause

xxxx = 1:

A file has a checksum error.

xxxx = 2:

The files are not consistent with one another.

xxxx = 3:

The project files, which were loaded into the file system via load (download from the memory card), are inconsistent.

Note:

KHP: Know-How Protection

**Remedy:**

- Replace the project on the memory card or replace project files for download from the memory card.
- Restore the factory setting and download again.

---

### **F30001      Power unit: Overcurrent**

**Message value:** Fault cause: %1 bin

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** OFF2

**Acknowledge:** IMMEDIATELY

**Cause:** The power unit has detected an overcurrent condition.

- closed-loop control is incorrectly parameterized.
- motor has a short-circuit or fault to ground (frame).
- U/f operation: Up ramp set too low.
- U/f operation: Rated motor current is significantly greater than that of the Motor Module.
- infeed: High discharge and post-charging currents for voltage dip.
- infeed: High post-charging currents for overload when motoring and DC link voltage dip.
- infeed: Short-circuit currents at power-up due to the missing line reactor.
- power cables are not correctly connected.
- the power cables exceed the maximum permissible length.
- power unit defective.
- line phase interrupted.

Additional causes for a parallel switching device (r0108.15 = 1):

- a power unit has tripped (powered down) due to a ground fault.
- the closed-loop circulating current control is either too slow or has been set too fast.

Fault value (r0949, interpret bitwise binary):

Bit 0: Phase U.

Bit 1: Phase V.

Bit 2: Phase W.

Bit 3: Overcurrent in the DC link.

Note:

Fault value = 0 means that the phase with overcurrent is not recognized (e.g. for blocksize device).

**Remedy:**

- check the motor data - if required, carry out commissioning.
- check the motor circuit configuration (star/delta).
- U/f operation: Increase up ramp.
- U/f operation: Check the assignment of the rated currents of the motor and Motor Module.
- infeed: Check the line supply quality.
- infeed: Reduce the motor load.



- infeed: Check the correct connection of the line filter and the line commutating reactor.
- check the power cable connections.
- check the power cables for short-circuit or ground fault.
- check the length of the power cables.
- replace power unit.
- check the line supply phases.

For a parallel switching device (r0108.15 = 1) the following additionally applies:

- check the ground fault monitoring thresholds (p0287).
- check the setting of the closed-loop circulating current control (p7036, p7037).

---

<b>F30002</b>	<b>Power unit: DC link voltage overvoltage</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>The power unit has detected overvoltage in the DC link.</p> <ul style="list-style-type: none"> <li>- motor regenerates too much energy.</li> <li>- device connection voltage too high.</li> <li>- when operating with a Voltage Sensing Module (VSM), the phase assignment L1, L2, L3 at the VSM differs from the phase assignment at the power unit.</li> <li>- line phase interrupted.</li> </ul> <p>Fault value (r0949, interpret decimal): DC link voltage at the time of trip [0.1 V].</p>
<b>Remedy:</b>	<ul style="list-style-type: none"> <li>- increase the ramp-down time</li> <li>- activate the DC link voltage controller</li> <li>- use a brake resistor or Active Line Module</li> <li>- increase the current limit of the infeed or use a larger module (for the Active Line Module)</li> <li>- check the device supply voltage</li> <li>- check and correct the phase assignment at the VSM and at the power unit</li> <li>- check the line supply phases.</li> </ul>

---

<b>F30003</b>	<b>Power unit: DC link voltage undervoltage</b>
<b>Message value:</b>	-
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>The power unit has detected an undervoltage condition in the DC link.</p> <ul style="list-style-type: none"> <li>- line supply failure</li> <li>- line supply voltage below the permissible value.</li> <li>- line supply infeed failed or interrupted.</li> <li>- line phase interrupted.</li> </ul> <p>Note: The monitoring threshold for undervoltage in the DC link is indicated in r0296.</p>
<b>Remedy:</b>	<ul style="list-style-type: none"> <li>- check the line supply voltage</li> <li>- check the line supply infeed and observe the fault messages relating to it (if there are any)</li> <li>- check the line supply phases.</li> <li>- check the line supply voltage setting (p0210).</li> <li>- booksize units: check the setting of p0278.</li> </ul> <p>Note: The ready signal for the infeed (r0863) must be interconnected to the associated drive inputs (p0864).</p>

---

<b>F30004</b>	<b>Power unit: Overtemperature heat sink AC inverter</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>The temperature of the power unit heat sink has exceeded the permissible limit value.</p> <ul style="list-style-type: none"> <li>- insufficient cooling, fan failure.</li> <li>- overload.</li> <li>- ambient temperature too high.</li> </ul>

---

- pulse frequency too high.  
 Fault value (r0949):  
 Temperature [1 bit = 0.01 °C].

**Remedy:**

- check whether the fan is running.
- check the fan elements.
- check whether the ambient temperature is in the permissible range.
- check the motor load.
- reduce the pulse frequency if this is higher than the rated pulse frequency.

Notice:  
 This fault can only be acknowledged after this alarm threshold for alarm A05000 has been undershot.

---

**F30005 Power unit: Overload I2t**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF2  
**Acknowledge:** IMMEDIATELY

**Cause:**  
 The power unit was overloaded (r0036 = 100 %).  
 - the permissible rated power unit current was exceeded for an inadmissibly long time.  
 - the permissible load duty cycle was not maintained.  
 Fault value (r0949, interpret decimal):  
 I2t [100 % = 16384].

**Remedy:**

- reduce the continuous load.
- adapt the load duty cycle.
- check the motor and power unit rated currents.

---

**F30006 Power unit: Thyristor Control Board**

**Message value:** -  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF2  
**Acknowledge:** IMMEDIATELY

**Cause:**  
 The Thyristor Control Board (TCB) of the Basic Line Module signals a fault.  
 - there is no line supply voltage.  
 - the line contactor is not closed.  
 - the line supply voltage is too low.  
 - line supply frequency outside the permissible range (45 ... 66 Hz).  
 - there is a DC link short-circuit.  
 - there is a DC link short-circuit (during the pre-charging phase).  
 - voltage supply for the Thyristor Control Board outside the nominal range (5 ... 18 V) and line voltage >30 V.  
 - there is an internal fault in the Thyristor Control Board.

**Remedy:**  
 The faults must be saved in the Thyristor Control Board and must be acknowledged. To do this, the supply voltage of the Thyristor Control Board must be switched out for at least 10 s!  
 - check the line supply voltage  
 - check or energize the line contactor.  
 - check the monitoring time and, if required, increase (p0857).  
 - if required, observe additional power unit messages/signals.  
 - check the DC link regarding short-circuit or ground fault.  
 - evaluate diagnostic LEDs for the Thyristor Control Board.

---

**F30008 Power unit: Sign-of-life error cyclic data**

**Message value:** -  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** NONE (OFF1, OFF2, OFF3)  
**Acknowledge:** IMMEDIATELY

**Cause:**  
 The Control Unit has not punctually updated the cyclic setpoint telegram. The number of consecutive sign-of-life errors has exceeded the fault threshold (p7789).

**Remedy:**

- check the electrical cabinet design and cable routing for EMC compliance
- for projects with the VECTOR drive object, check whether p0117 = 6 has been set on the Control Unit.
- increase the fault threshold (p7789).

---

<b>A30010 (F)</b>	<b>Power unit: Sign-of-life error cyclic data</b>
Message value:	-
Drive object:	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
Reaction:	NONE
Acknowledge:	NONE
Cause:	A DRIVE-CLiQ communication error has occurred between the Control Unit and the power unit involved. The cyclic setpoint telegrams of the Control Unit were not received on time by the power unit for at least one clock cycle.
Remedy:	Check the electrical cabinet design and cable routing for EMC compliance.
Reaction upon F:	NONE (OFF1, OFF2, OFF3)
Acknowled. upon F:	IMMEDIATELY (POWER ON)

---

<b>F30011</b>	<b>Power unit: Line phase failure in main circuit</b>
Message value:	%1
Drive object:	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
Reaction:	OFF2 (OFF1)
Acknowledge:	IMMEDIATELY
Cause:	At the power unit, the DC link voltage ripple has exceeded the permissible limit value. Possible causes: - A line phase has failed. - The 3 line phases are inadmissibly unsymmetrical. - the fuse of a phase of a main circuit has ruptured. - A motor phase has failed. Fault value (r0949, interpret decimal): Only for internal Siemens troubleshooting.
Remedy:	- check the main circuit fuses. - Check whether a single-phase load is distorting the line voltages. - check the motor feeder cables.

---

<b>F30012</b>	<b>Power unit: Temperature sensor heat sink wire breakage</b>
Message value:	%1
Drive object:	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
Reaction:	OFF1 (OFF2)
Acknowledge:	IMMEDIATELY
Cause:	The connection to a heat sink temperature sensor in the power unit is interrupted. Fault value (r0949, interpret hexadecimal): Bit 0: Module slot (electronics slot) Bit 1: Air intake Bit 2: Inverter 1 Bit 3: Inverter 2 Bit 4: Inverter 3 Bit 5: Inverter 4 Bit 6: Inverter 5 Bit 7: Inverter 6 Bit 8: Rectifier 1 Bit 9: Rectifier 2
Remedy:	Contact the manufacturer.

---

<b>F30013</b>	<b>Power unit: Temperature sensor heat sink short-circuit</b>
Message value:	%1
Drive object:	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
Reaction:	OFF1 (OFF2)
Acknowledge:	IMMEDIATELY
Cause:	The heat sink temperature sensor in the power unit is short-circuited. Fault value (r0949, interpret hexadecimal): Bit 0: Module slot (electronics slot) Bit 1: Air intake

Bit 2: Inverter 1  
 Bit 3: Inverter 2  
 Bit 4: Inverter 3  
 Bit 5: Inverter 4  
 Bit 6: Inverter 5  
 Bit 7: Inverter 6  
 Bit 8: Rectifier 1  
 Bit 9: Rectifier 2

**Remedy:** Contact the manufacturer.

---

**F30017 Power unit: Hardware current limit has responded too often**

**Message value:** Fault cause: %1 bin  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF2  
**Acknowledge:** IMMEDIATELY  
**Cause:** The hardware current limitation in the relevant phase (see A30031, A30032, A30033) has responded too often. The number of times the limit has been exceeded depends on the design and type of power unit.  
 For infeed units, the following applies:  
 - closed-loop control is incorrectly parameterized.  
 - load on the infeed is too high.  
 - Voltage Sensing Module incorrectly connected.  
 - line reactor missing or the incorrect type.  
 - power unit defective.  
 The following applies to Motor Modules:  
 - closed-loop control is incorrectly parameterized.  
 - fault in the motor or in the power cables.  
 - the power cables exceed the maximum permissible length.  
 - motor load too high  
 - power unit defective.  
 Fault value (r0949, interpret binary):  
 Bit 0: Phase U  
 Bit 1: Phase V  
 Bit 2: Phase W  
**Remedy:** For infeed units, the following applies:  
 - check the controller settings and reset and identify the controller if necessary (p0340 = 2, p3410 = 5)  
 - reduce the load and increase the DC-link capacitance or use a higher-rating infeed if necessary  
 - check the connection of the optional Voltage Sensing Module  
 - check the connection and technical data of the line reactor  
 - check the power cables for short-circuit or ground fault.  
 - replace power unit.  
 The following applies to Motor Modules:  
 - check the motor data and if required, recalculate the controller parameters (p0340 = 3). As an alternative, run a motor data identification (p1910 = 1, p1960 = 1).  
 - check the motor circuit configuration (star-delta).  
 - check the motor load.  
 - check the power cable connections.  
 - check the power cables for short-circuit or ground fault.  
 - check the length of the power cables.  
 - replace power unit.

---

**F30021 Power unit: Ground fault**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF2  
**Acknowledge:** IMMEDIATELY  
**Cause:** Power unit has detected a ground fault.  
 - ground fault in the power cables.  
 - winding fault or ground fault at the motor.  
 - CT defective.  
 Additional cause for CU310/CUA31:  
 - when the brake is applied, this causes the hardware DC current monitoring to respond.

Additional cause for parallel switching devices (r0108.15 = 1):  
- the closed-loop circulating current control is either too slow or has been set too fast.  
Fault value (r0949, interpret decimal):  
Absolute value, total current amplitude [20479 = r0209 x 1.4142].  
Note:  
For power units, a ground fault is also emulated in r3113.5.

**Remedy:**

- check the power cable connections.
  - check the motor.
  - check the CT.
- The following applies additionally for CU310/CUA31:  
- check the cables and contacts of the brake connection (a wire is possibly broken).  
For parallel switching devices (r0108.15 = 1) the following additionally applies:  
- check the ground fault monitoring thresholds (p0287).  
- check the setting of the closed-loop circulating current control (p7036, p7037).

---

**F30022      Power unit: Monitoring U<sub>ce</sub>**

**Message value:** Fault cause: %1 bin  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF2  
**Acknowledge:** POWER ON  
**Cause:** In the power unit, the monitoring of the collector-emitter voltage (U<sub>ce</sub>) of the semiconductor has responded.  
Possible causes:  
- fiber-optic cable interrupted.  
- power supply of the IGBT gating module missing.  
- short-circuit at the power unit output.  
- defective semiconductor in the power unit.  
Fault value (r0949, interpret binary):  
Bit 0: Short-circuit in phase U  
Bit 1: Short circuit in phase V  
Bit 2: Short-circuit in phase W  
Bit 3: Light transmitter enable defective  
Bit 4: U<sub>ce</sub> group fault signal interrupted  
See also: r0949 (Fault value)

**Remedy:**

- check the fiber-optic cable and if required, replace.
- check the power supply of the IGBT gating module (24 V).
- check the power cable connections.
- select the defective semiconductor and replace.

---

**F30025      Power unit: Chip overtemperature**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF2  
**Acknowledge:** IMMEDIATELY  
**Cause:** The chip temperature of the semiconductor has exceeded the permissible limit value.  
- the permissible load duty cycle was not maintained.  
- insufficient cooling, fan failure.  
- overload.  
- ambient temperature too high.  
- pulse frequency too high.  
Fault value (r0949, interpret decimal):  
Temperature difference between the heat sink and chip [0.01 °C].

**Remedy:**

- adapt the load duty cycle.
- check whether the fan is running.
- check the fan elements.
- check whether the ambient temperature is in the permissible range.
- check the motor load.
- reduce the pulse frequency if this is higher than the rated pulse frequency.

Notice:  
This fault can only be acknowledged after this alarm threshold for alarm A05001 has been undershot.

<b>F30027</b>	<b>Power unit: Precharging DC link time monitoring</b>
<b>Message value:</b>	Enable signals: %1, Status: %2
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>The power unit DC link was not able to be pre-charged within the expected time.</p> <ol style="list-style-type: none"> <li>1) There is no line supply voltage connected.</li> <li>2) The line contactor/line side switch has not been closed.</li> <li>3) The line supply voltage is too low.</li> <li>4) Line supply voltage incorrectly set (p0210).</li> <li>5) The pre-charging resistors are overheated as there were too many pre-charging operations per time unit.</li> <li>6) The pre-charging resistors are overheated as the DC link capacitance is too high.</li> <li>7) The pre-charging resistors are overheated because when there is no "ready for operation" (r0863.0) of the infeed unit, power is taken from the DC link.</li> <li>8) The pre-charging resistors are overheated as the line contactor was closed during the DC link fast discharge through the Braking Module.</li> <li>9) The DC link has either a ground fault or a short-circuit.</li> <li>10) The pre-charging circuit is possibly defective (only for chassis units).</li> <li>11) Infeed is defective and/or fuse has ruptured in the Motor Module (only Booksize units).</li> </ol> <p>Fault value (r0949, interpret binary):          yyyyxxxx hex:          yyyy = power unit state          0: Fault status (wait for OFF and fault acknowledgement).          1: Restart inhibit (wait for OFF).          2: Overvoltage condition detected -&gt; change into the fault state.          3: Undervoltage condition detected -&gt; change into the fault state.          4: Wait for bridging contactor to open -&gt; change into the fault state.          5: Wait for bridging contactor to open -&gt; change into restart inhibit.          6: Commissioning.          7: Ready for pre-charging.          8: Pre-charging started, DC link voltage less than the minimum switch-on voltage.          9: Pre-charging, DC link voltage end of pre-charging still not detected.          10: Wait for the end of the de-bounce time of the main contactor after pre-charging has been completed.          11: Pre-charging completed, ready for pulse enable.          12: It was detected that the STO terminal was energized at the power unit.          xxxx = Missing internal enable signals, power unit (inverted bit-coded, FFFF hex -&gt; all internal enable signals available)          Bit 0: Power supply of the IGBT gating shut down.          Bit 1: Ground fault detected.          Bit 2: Peak current intervention.          Bit 3: I2t exceeded.          Bit 4: Thermal model overtemperature calculated.          Bit 5: (heat sink, gating module, power unit) overtemperature measured.          Bit 6: Reserved.          Bit 7: Overvoltage detected.          Bit 8: Power unit has completed pre-charging, ready for pulse enable.          Bit 9: STO terminal missing.          Bit 10: Overcurrent detected.          Bit 11: Armature short-circuit active.          Bit 12: DRIVE-CLiQ fault active.          Bit 13: Vce fault detected, transistor de-saturated due to overcurrent/short-circuit.          Bit 14: Undervoltage detected.</p>
<b>Remedy:</b>	<p>In general:</p> <ul style="list-style-type: none"> <li>- check the line supply voltage at the input terminals.</li> <li>- check the line supply voltage setting (p0210).</li> </ul> <p>For booksize drive units, the following applies:</p> <ul style="list-style-type: none"> <li>- wait (approx. 8 minutes) until the pre-charging resistors have cooled down. For this purpose, preferably disconnect the infeed unit from the line supply.</li> </ul> <p>Re 5):</p> <ul style="list-style-type: none"> <li>- carefully observe the permissible pre-charging frequency (refer to the appropriate Equipment Manual).</li> </ul>

Re 6):  
- check the total capacitance of the DC link and reduce in accordance with the maximum permissible DC-link capacitance if necessary (refer to the appropriate Equipment Manual)

Re 7):  
- interconnect the ready-for-operation signal from the infeed unit (r0863.0) in the enable logic of the drives connected to this DC link

Re 8):  
- check the connections of the external line contactor. The line contactor must be open during DC-link fast discharge.

Re 9):  
- check the DC link for ground faults or short circuits.

Re 11):  
- Check the DC link voltage of the infeed (r0070) and Motor Modules (r0070).  
If the DC link voltage generated by the infeed (or external) is not displayed for the Motor Modules (r0070), then a fuse has ruptured in the Motor Module.

---

**A30030      Power unit: Internal overtemperature alarm**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The temperature inside the converter has exceeded the permissible limit value of the alarm threshold.  
- insufficient cooling, fan failure.  
- overload.  
- ambient temperature too high.  
Fault value (r0949, interpret decimal):  
Only for internal Siemens troubleshooting.  
**Remedy:** - possibly use an additional fan  
- check whether the ambient temperature is in the permissible range.  
Notice:  
This fault can only be acknowledged once the permissible temperature limit minus 5 K has been fallen below.

---

**A30031      Power unit: Hardware current limiting in phase U**

**Message value:** -  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** Hardware current limit for phase U responded. The pulsing in this phase is inhibited for one pulse period.  
- closed-loop control is incorrectly parameterized.  
- fault in the motor or in the power cables.  
- the power cables exceed the maximum permissible length.  
- motor load too high  
- power unit defective.  
Note:  
Alarm A30031 is always output if, for a Power Module, the hardware current limiting of phase U, V or W responds.  
**Remedy:** - check the motor data and if required, recalculate the control parameters (p0340 = 3). As an alternative, run a motor data identification (p1910 = 1, p1960 = 1).  
- check the motor circuit configuration (star/delta).  
- check the motor load.  
- check the power cable connections.  
- check the power cables for short-circuit or ground fault.  
- check the length of the power cables.

---

**A30032      Power unit: Hardware current limiting in phase V**

**Message value:** -  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** Hardware current limit for phase V responded. The pulsing in this phase is inhibited for one pulse period.  
- closed-loop control is incorrectly parameterized.  
- fault in the motor or in the power cables.

	<ul style="list-style-type: none"> <li>- the power cables exceed the maximum permissible length.</li> <li>- motor load too high</li> <li>- power unit defective.</li> </ul> <p>Note:</p> <p>Alarm A30031 is always output if, for a Power Module, the hardware current limiting of phase U, V or W responds.</p> <p><b>Remedy:</b> Check the motor data and if required, recalculate the control parameters (p0340 = 3). As an alternative, run a motor data identification (p1910 = 1, p1960 = 1).</p> <ul style="list-style-type: none"> <li>- check the motor circuit configuration (star/delta).</li> <li>- check the motor load.</li> <li>- check the power cable connections.</li> <li>- check the power cables for short-circuit or ground fault.</li> <li>- check the length of the power cables.</li> </ul>
--	--

<b>A30033</b>	<b>Power unit: Hardware current limiting in phase W</b>
<b>Message value:</b>	-
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>Hardware current limit for phase W responded. The pulsing in this phase is inhibited for one pulse period.</p> <ul style="list-style-type: none"> <li>- closed-loop control is incorrectly parameterized.</li> <li>- fault in the motor or in the power cables.</li> <li>- the power cables exceed the maximum permissible length.</li> <li>- motor load too high</li> <li>- power unit defective.</li> </ul> <p>Note:</p> <p>Alarm A30031 is always output if, for a Power Module, the hardware current limiting of phase U, V or W responds.</p>
<b>Remedy:</b>	<ul style="list-style-type: none"> <li>- check the motor data and if required, recalculate the control parameters (p0340 = 3). As an alternative, run a motor data identification (p1910 = 1, p1960 = 1).</li> <li>- check the motor circuit configuration (star/delta).</li> <li>- check the motor load.</li> <li>- check the power cable connections.</li> <li>- check the power cables for short-circuit or ground fault.</li> <li>- check the length of the power cables.</li> </ul>

<b>F30035</b>	<b>Power unit: Air intake overtemperature</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF1 (OFF2)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>The air intake in the power unit has exceeded the permissible temperature limit.</p> <p>For air-cooled power units, the temperature limit is at 55 °C.</p> <ul style="list-style-type: none"> <li>- ambient temperature too high.</li> <li>- insufficient cooling, fan failure.</li> </ul> <p>Fault value (r0949, interpret decimal):</p> <p>Temperature [0.01 °C].</p>
<b>Remedy:</b>	<ul style="list-style-type: none"> <li>- check whether the fan is running.</li> <li>- check the fan elements.</li> <li>- check whether the ambient temperature is in the permissible range.</li> </ul> <p>Notice:</p> <p>This fault can only be acknowledged after this alarm threshold for alarm A05002 has been undershot.</p>

<b>F30037</b>	<b>Power unit: Rectifier overtemperature</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>The temperature in the rectifier of the power unit has exceeded the permissible temperature limit.</p> <ul style="list-style-type: none"> <li>- insufficient cooling, fan failure.</li> <li>- overload.</li> </ul>



	<ul style="list-style-type: none"> <li>- ambient temperature too high.</li> <li>- line supply phase failure.</li> </ul> <p>Fault value (r0949, interpret decimal): Temperature [0.01 °C].</p>
<b>Remedy:</b>	<ul style="list-style-type: none"> <li>- check whether the fan is running.</li> <li>- check the fan elements.</li> <li>- check whether the ambient temperature is in the permissible range.</li> <li>- check the motor load.</li> <li>- check the line supply phases.</li> </ul> <p>Notice: This fault can only be acknowledged after this alarm threshold for alarm A05004 has been undershot.</p>
<b>F30040</b>	<b>Power unit: Undervolt 24/48 V</b>
<b>Message value:</b>	Channel: %1, voltage: %2 [0.1 V]
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	IMMEDIATELY (POWER ON)
<b>Cause:</b>	<p>Failure of the power supply for the power unit.</p> <ul style="list-style-type: none"> <li>- The undervoltage threshold was undershot for longer than 3 ms.</li> </ul> <p>Fault value (r0949, interpret hexadecimal): yyxxxx hex: yy = channel, xxxx = voltage [0.1 V] yy = 0: 24 V power supply yy = 1: 48 V power supply</p>
<b>Remedy:</b>	<ul style="list-style-type: none"> <li>- Check the power supply of the power unit.</li> <li>- carry out a POWER ON (power off/on) for the component.</li> </ul>
<b>A30041 (F)</b>	<b>Power unit: Undervolt 24/48 V alarm</b>
<b>Message value:</b>	Channel: %1, voltage: %2 [0.1 V]
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>For the power unit power supply, the lower threshold has been violated.</p> <p>Alarm value (r2124, interpret hexadecimal): yyxxxx hex: yy = channel, xxxx = voltage [0.1 V] yy = 0: 24 V power supply yy = 1: 48 V power supply</p>
<b>Remedy:</b>	<ul style="list-style-type: none"> <li>- Check the power supply of the power unit.</li> <li>- carry out a POWER ON (power off/on) for the component.</li> </ul>
Reaction upon F:	NONE (OFF1, OFF2)
Acknowl. upon F:	IMMEDIATELY (POWER ON)
<b>A30042</b>	<b>Power unit: Fan has reached the maximum operating hours</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>The maximum operating time of at least one fan will soon be reached, or has already been exceeded.</p> <p>Fault value (r0949, interpret binary): Bit 0: heat sink fan will reach the maximum operating time in 500 hours. Bit 1: heat sink fan has exceeded the maximum operating time. Bit 8: internal device fan will reach the maximum operating time in 500 hours. Bit 9: internal device fan has exceeded the maximum operating time.</p> <p>Note: The maximum operating time of the heat sink fan in the power unit is displayed in p0252. The maximum operating time of the internal device fan in the power unit is internally specified and is fixed.</p>
<b>Remedy:</b>	<p>For the fan involved, carry out the following:</p> <ul style="list-style-type: none"> <li>- replace the fan.</li> <li>- reset the operating hours counter (p0251, p0254).</li> </ul>

<b>F30043</b>	<b>Power unit: Overvolt 24/48 V</b>
<b>Message value:</b>	Channel: %1, voltage: %2 [0.1 V]
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	POWER ON
<b>Cause:</b>	For the power unit power supply, the upper threshold has been violated. Fault value (r0949, interpret hexadecimal): yyxxxx hex: yy = channel, xxxx = voltage [0.1 V] yy = 0: 24 V power supply yy = 1: 48 V power supply
<b>Remedy:</b>	Check the power supply of the power unit.
<b>A30044 (F)</b>	<b>Power unit: Overvolt 24/48 V alarm</b>
<b>Message value:</b>	Channel: %1, voltage: %2 [0.1 V]
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	For the power unit power supply, the upper threshold has been violated. Alarm value (r2124, interpret hexadecimal): yyxxxx hex: yy = channel, xxxx = voltage [0.1 V] yy = 0: 24 V power supply yy = 1: 48 V power supply
<b>Remedy:</b>	Check the power supply of the power unit.
Reaction upon F:	NONE (OFF1, OFF2, OFF3)
Acknowl. upon F:	IMMEDIATELY (POWER ON)
<b>F30045</b>	<b>Power unit: Supply undervoltage</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	IMMEDIATELY (POWER ON)
<b>Cause:</b>	Power supply fault in the power unit. - The voltage monitor signals an undervoltage fault on the module. The following applies for CU31x: - the voltage monitoring on the DAC board signals an undervoltage fault on the module. For S120M, the following applies: - This message is displayed for undervoltage or overvoltage.
<b>Remedy:</b>	- Check the power supply of the power unit. - carry out a POWER ON (power off/on) for the component. - replace the module if necessary.
<b>A30046 (F)</b>	<b>Power unit: Undervoltage alarm</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	Before the last restart, a problem occurred at the power unit power supply. The voltage monitor in the internal FPGA of the PSA signals an undervoltage fault on the module. Fault value (r0949, interpret decimal): Register value of the voltage fault register.
<b>Remedy:</b>	- check the 24 V DC voltage supply to power unit. - carry out a POWER ON (power off/on) for the component. - replace the module if necessary.
Reaction upon F:	NONE (OFF1, OFF2)
Acknowl. upon F:	IMMEDIATELY (POWER ON)

---

**F30050      Power unit: 24 V supply overvoltage**

**Message value:** -  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF2  
**Acknowledge:** POWER ON  
**Cause:** The voltage monitor signals an overvoltage fault on the module.  
**Remedy:** - check the 24 V power supply.  
- replace the module if necessary.

---

**F30052      EEPROM data error**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF2  
**Acknowledge:** POWER ON  
**Cause:** EEPROM data error of the power unit module.  
Fault value (r0949, interpret decimal):  
0, 2, 3, 4:  
The EEPROM data read in from the power unit module are incorrect.  
1:  
EEPROM data is not compatible to the firmware of the power unit application.  
Additional values:  
Only for internal Siemens troubleshooting.  
**Remedy:** Re fault value = 0, 2, 3, 4:  
Replace the power unit module or update the EEPROM data.  
For fault value = 1:  
The following applies for CU31x and CUA31:  
Update the firmware \SIEMENS\SINAMICS\CODE\SAC\cu31xi.ufw (cua31.ufw)

---

**F30053      FPGA data faulty**

**Message value:** %1  
**Drive object:** All objects  
**Reaction:** NONE  
**Acknowledge:** POWER ON  
**Cause:** The FPGA data of the power unit are faulty.  
**Remedy:** Replace the power unit or update the FPGA data.

---

**F30070      Cycle requested by the power unit module not supported**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF2  
**Acknowledge:** IMMEDIATELY  
**Cause:** A cycle is requested that is not supported by the power unit.  
Fault value (r0949, interpret hexadecimal):  
0: The current control cycle is not supported.  
1: The DRIVE-CLiQ cycle is not supported.  
2: Internal timing problem (clearance between RX and TX instants too low).  
3: Internal timing problem (TX instant too early).  
**Remedy:** The power unit only supports the following cycles:  
62.5 µs, 125 µs, 250 µs and 500 µs  
For fault value = 0:  
Set a permitted current control cycle.  
For fault value = 1:  
Set a permitted DRIVE-CLiQ cycle.  
Re fault value = 2, 3:  
Contact the manufacturer (you may have an incompatible firmware version).

<b>F30071</b>	<b>No new actual values received from the power unit module</b>
<b>Message value:</b>	-
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	The number of actual value telegrams from the power unit module that have failed has exceeded the permissible number.
<b>Remedy:</b>	Check the interface (adjustment and locking) to the power unit module.
<b>F30072</b>	<b>Setpoints are no longer being transferred to the power unit</b>
<b>Message value:</b>	-
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	The following applies for CU31x and CUA31: More than one setpoint telegram was not able to be transferred to the power unit module.
<b>Remedy:</b>	The following applies for CU31x and CUA31: Check the interface (adjustment and locking) to the power unit module.
<b>A30073 (N)</b>	<b>Actual value/setpoint preprocessing no longer synchronous</b>
<b>Message value:</b>	-
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	Communication with the power unit module is no longer in synchronism with the current control cycle.
<b>Remedy:</b>	Wait until synchronization is re-established.
Reaction upon N:	NONE
Acknowl. upon N:	NONE
<b>F30074 (A)</b>	<b>Communication error between the Control Unit and Power Module</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	Communications between the Control Unit (CU) and Power Module (PM) via the interface no longer possible. The CU may have been withdrawn or is incorrectly inserted. Fault value (r0949, interpret hexadecimal): 0 hex: - a Control Unit with external 24 V supply was withdrawn from the Power Module during operation. - with the Power Module switched off, the external 24 V supply for the Control unit was interrupted for some time. 1 hex: The Control Unit was withdrawn from the Power Module during operation, although the encoderless safe motion monitoring functions are enabled. This is not supported. After re-inserting the Control Unit in operation, communications to the Power Module no longer possible. 20A hex: The Control Unit was inserted on a Power Module, which has another code number. 20B hex: The Control Unit was inserted on a Power Module, which although it has the same code number, has a different serial number. 601 hex: The Control Unit was inserted on a Power Module, whose power/performance class (chassis unit) is not supported.
<b>Remedy:</b>	Reinsert the Control Unit (CU) or the Control Unit adapter (CUAxx) onto the original Power Module and continue operation. If required, carry out a POWER ON for the CU and/or the CUA.
Reaction upon A:	NONE
Acknowl. upon A:	NONE

---

**F30080 Power unit: Current increasing too quickly**

<b>Message value:</b>	Fault cause: %1 bin
<b>Drive object:</b>	CU_DC, CU_DC_R, CU_DC_R_S, CU_DC_S, TM150, TM15DI_DO, TM31
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>The power unit has detected an excessive rate of rise in the overvoltage range.</p> <ul style="list-style-type: none"><li>- closed-loop control is incorrectly parameterized.</li><li>- motor has a short-circuit or fault to ground (frame).</li><li>- U/f operation: Up ramp set too low.</li><li>- U/f operation: rated current of motor much greater than that of power unit.</li><li>- infeed: High discharge and post-charging currents for voltage dip.</li><li>- infeed: High post-charging currents for overload when motoring and DC link voltage dip.</li><li>- infeed: Short-circuit currents at power-up due to the missing line reactor.</li><li>- power cables are not correctly connected.</li><li>- power cables exceed the maximum permissible length.</li><li>- power unit defective.</li></ul> <p>Additional causes for a parallel switching device (r0108.15 = 1):</p> <ul style="list-style-type: none"><li>- a power unit has tripped (powered down) due to a ground fault.</li><li>- the closed-loop circulating current control is either too slow or has been set too fast.</li></ul> <p>Fault value (r0949, interpret bitwise binary):</p> <p>Bit 0: Phase U. Bit 1: Phase V. Bit 2: Phase W.</p>
<b>Remedy:</b>	<ul style="list-style-type: none"><li>- check the motor data - if required, carry out commissioning.</li><li>- check the motor circuit configuration (star-delta)</li><li>- U/f operation: Increase up ramp.</li><li>- U/f operation: Check assignment of rated currents of motor and power unit.</li><li>- infeed: Check the line supply quality.</li><li>- infeed: Reduce the motor load.</li><li>- infeed: Correct connection of the line reactor.</li><li>- check the power cable connections.</li><li>- check the power cables for short-circuit or ground fault.</li><li>- check the length of the power cables.</li><li>- replace power unit.</li></ul> <p>For a parallel switching device (r0108.15 = 1) the following additionally applies:</p> <ul style="list-style-type: none"><li>- check the ground fault monitoring thresholds (p0287).</li><li>- check the setting of the closed-loop circulating current control (p7036, p7037).</li></ul>

---

**F30081 Power unit: Switching operations too frequent**

<b>Message value:</b>	Fault cause: %1 bin
<b>Drive object:</b>	All objects
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>The power unit has executed too many switching operations for current limitation.</p> <ul style="list-style-type: none"><li>- closed-loop control is incorrectly parameterized.</li><li>- motor has a short-circuit or fault to ground (frame).</li><li>- U/f operation: Up ramp set too low.</li><li>- U/f operation: rated current of motor much greater than that of power unit.</li><li>- infeed: High discharge and post-charging currents for voltage dip.</li><li>- infeed: High post-charging currents for overload when motoring and DC link voltage dip.</li><li>- infeed: Short-circuit currents at power-up due to the missing line reactor.</li><li>- power cables are not correctly connected.</li><li>- power cables exceed the maximum permissible length.</li><li>- power unit defective.</li></ul> <p>Additional causes for a parallel switching device (r0108.15 = 1):</p> <ul style="list-style-type: none"><li>- a power unit has tripped (powered down) due to a ground fault.</li><li>- the closed-loop circulating current control is either too slow or has been set too fast.</li></ul> <p>Fault value (r0949, interpret bitwise binary):</p> <p>Bit 0: Phase U. Bit 1: Phase V. Bit 2: Phase W.</p>

- Remedy:**
- check the motor data - if required, carry out commissioning.
  - check the motor circuit configuration (star-delta)
  - U/f operation: Increase up ramp.
  - U/f operation: Check assignment of rated currents of motor and power unit.
  - infeed: Check the line supply quality.
  - infeed: Reduce the motor load.
  - infeed: Correct connection of the line reactor.
  - check the power cable connections.
  - check the power cables for short-circuit or ground fault.
  - check the length of the power cables.
  - replace power unit.
- For a parallel switching device (r0108.15 = 1) the following additionally applies:
- check the ground fault monitoring thresholds (p0287).
  - check the setting of the closed-loop circulating current control (p7036, p7037).

---

**F30105 PU: Actual value sensing fault**

- Message value:** -
- Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S
- Reaction:** OFF2
- Acknowledge:** IMMEDIATELY
- Cause:** At least one incorrect actual value channel was detected on the Power Stack Adapter (PSA).  
The incorrect actual value channels are displayed in the following diagnostic parameters.
- Remedy:** Evaluate the diagnostic parameters.  
If the actual value channel is incorrect, check the components and if required, replace.

---

**F30600 SI MM: STOP A initiated**

- Message value:** %1
- Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S
- Reaction:** OFF2
- Acknowledge:** IMMEDIATELY (POWER ON)
- Cause:** The "Safety Integrated" function integrated in the drive in the Motor Module (MM) has detected a fault and initiated STOP A (pulse suppression via the safety shutdown path of the Motor Module).  
- forced checking procedure of the safety shutdown path of the Motor Module unsuccessful.  
- subsequent response to fault F30611 (defect in a monitoring channel).  
Fault value (r0949, interpret decimal):  
0: Stop request from the Control Unit.  
1005: Pulses suppressed although STO not selected and there is no internal STOP A present.  
1010: Pulses enabled although STO is selected or an internal STOP A is present.  
1020: Internal software error in the "Internal voltage protection" function. The "internal voltage protection" function is withdrawn. A STOP A that cannot be acknowledged is initiated.  
9999: Subsequent response to fault F30611.
- Remedy:**
- select Safe Torque Off and de-select again.
  - replace the Motor Module involved.
- For fault value = 1020:
- carry out a POWER ON (power off/on) for all components.
  - upgrade the Motor Module software.
  - replace the Motor Module.
- For fault value = 9999:
- carry out diagnostics for fault F30611.
- Note:**  
CU: Control Unit  
MM: Motor Module  
SI: Safety Integrated  
STO: Safe Torque Off / SH: Safe standstill

<b>F30611 (A)</b>	<b>SI MM: Defect in a monitoring channel</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE (OFF1, OFF2, OFF3)
<b>Acknowledge:</b>	IMMEDIATELY (POWER ON)
<b>Cause:</b>	<p>The "Safety Integrated" function integrated in the drive in the Motor Module has detected a fault in the crosswise data comparison between the Control Unit (CU) and Motor Module (MM) and initiated a STOP F.</p> <p>As a result of this fault, after the parameterized transition has expired (p9858), fault F30600 is output (SI MM: STOP A initiated).</p> <p>Fault value (r0949, interpret decimal):</p> <p>0: Stop request from the Control Unit.</p> <p>1 ... 999:</p> <p>Number of the cross-compared data that resulted in this fault. This number is also displayed in r9895.</p> <p>1: SI monitoring clock cycle (r9780, r9880).</p> <p>2: SI enable safety functions (p9601, p9801). Crosswise data comparison is only carried out for the supported bits.</p> <p>3: SI SGE changeover tolerance time (p9650, p9850).</p> <p>4: SI transition period STOP F to STOP A (p9658, p9858).</p> <p>5: SI enable Safe Brake Control (p9602, p9802).</p> <p>6: SI Motion enable, safety-relevant functions (p9501, internal value).</p> <p>7: SI pulse suppression delay time for Safe Stop 1 (p9652, p9852).</p> <p>8: SI PROFIsafe address (p9610, p9810).</p> <p>9: SI debounce time for STO/SBC/SS1 (MM) (p9651, p9851).</p> <p>10: SI delay time for pulse suppression for ESR (p9697, p9897).</p> <p>11: SI Safe Brake Adapter mode, BICO interconnection (p9621, p9821).</p> <p>12: SI Safe Brake Adapter relay ON time (p9622[0], p9822[0]).</p> <p>13: SI Safe Brake Adapter relay OFF time (p9622[1], p9822[1]).</p> <p>14: SI PROFIsafe telegram selection (p9611, p9811).</p> <p>1000: Watchdog timer has expired.</p> <p>Within the time of approx. 5 x p9650, alternatively, the following was defined:</p> <ul style="list-style-type: none"><li>- Too many signal changes have occurred at the EP terminal of the Motor Module.</li><li>- Via PROFIsafe/TM54F, STO was too frequently initiated (also as subsequent response).</li><li>- Safe pulse cancellation (r9723.9) was too frequently initiated (also as subsequent response).</li></ul> <p>1001, 1002: Initialization error, change timer / check timer.</p> <p>1950: Module temperature outside the permissible temperature range.</p> <p>1951: Module temperature not plausible.</p> <p>1952: S120M: hardware access fault</p> <p>2000: Status of the STO selection on the Control Unit and Motor Module are different.</p> <p>2001: Feedback signal for safe pulse suppression on the Control Unit and Motor Module are different.</p> <p>2002: Status of the delay timer SS1 on the Control Unit and Motor Module are different (status of the timer in p9650/p9850).</p> <p>2003: Status of the STO terminal on the Control Unit and Motor Module are different.</p> <p>6000 ... 6999:</p> <p>Error in the PROFIsafe control.</p> <p>For these fault values, the failsafe control signals (failsafe values) are transferred to the safety functions.</p> <p>The significance of the individual message values is described in safety message C01711.</p>
<b>Remedy:</b>	<p>Re fault value = 1 ... 5 and 7 ... 999:</p> <ul style="list-style-type: none"><li>- check the cross data comparison that resulted in a STOP F.</li><li>- carry out a POWER ON (power off/on) for all components.</li><li>- upgrade the Motor Module software.</li><li>- upgrade the Control Unit software.</li></ul> <p>For fault value = 6:</p> <ul style="list-style-type: none"><li>- carry out a POWER ON (power off/on) for all components.</li><li>- upgrade the Motor Module software.</li><li>- upgrade the Control Unit software.</li></ul> <p>For fault value = 1000:</p> <ul style="list-style-type: none"><li>- check the wiring of the safety-relevant inputs (SGE) on the Control Unit (contact problems).</li><li>- PROFIsafe: Remove contact problems/faults at the PROFIBUS master/PROFINET controller.</li><li>- check the wiring of the failsafe inputs at the TM54F (contact problems).</li></ul> <p>Re fault value = 1001, 1002:</p> <ul style="list-style-type: none"><li>- carry out a POWER ON (power off/on) for all components.</li><li>- upgrade the Motor Module software.</li><li>- upgrade the Control Unit software.</li></ul>

For fault value = 1950:

- operate the module in the permissible range.
- check the module fan, replace the Motor Module involved.

For fault value = 1951:

- operate the module in the permissible range.
- replace the Motor Module involved.

For fault value = 1952:

- replace the Motor Module involved.

Re fault value = 2000, 2001, 2002, 2003:

- check the tolerance time SGE changeover and if required, increase the value (p9650/p9850, p9652/p9852).
- check the wiring of the safety-relevant inputs (SGE) (contact problems).
- check why STO was selected in r9872. When the SMM functions are active (p9501 = 1), STO can also be selected using these functions.
- replace the Motor Module involved.

Note:

This fault can be acknowledged after removing the cause of the error and after correct selection/deselection of STO.

Re fault value = 6000 ... 6999:

Refer to the description of the message values in safety message C01711.

Note:

CU: Control Unit

EP: Enable Pulses

ESR: Extended Stop and Retract

MM: Motor Module

SGE: Safety-relevant input

SI: Safety Integrated

SMM: Safe Motion Monitoring

SS1: Safe Stop 1 (corresponds to Stop Category 1 acc. to EN60204)

STO: Safe Torque Off / SH: Safe standstill

Reaction upon A: NONE

Acknowl. upon A: NONE

---

#### **N30620 (F, A) SI MM: Safe Torque Off active**

**Message value:** -

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** NONE

**Acknowledge:** NONE

**Cause:** The function "Safe Torque Off" (STO) of the basic functions was selected on the Motor Module (MM) via the input terminal and is active.

Note:

- This message does not result in a safety stop response.
- This message is not output when STO is selected using the Extended Functions.

**Remedy:** Not necessary.

Note:

MM: Motor Module

SI: Safety Integrated

STO: Safe Torque Off / SH: Safe standstill

Reaction upon F: OFF2

Acknowl. upon F: IMMEDIATELY (POWER ON)

Reaction upon A: NONE

Acknowl. upon A: NONE

---

#### **N30621 (F, A) SI MM: Safe Stop 1 active**

**Message value:** -

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** NONE

**Acknowledge:** NONE

**Cause:** The "Safe Stop 1" function (SS1) was selected on the Motor Module (MM) and is active.

Note:

This message does not result in a safety stop response.



**Remedy:** Not necessary.  
Note:  
MM: Motor Module  
SI: Safety Integrated  
SS1: Safe Stop 1 (corresponds to Stop Category 1 acc. to EN60204)

Reaction upon F: NONE (OFF3)  
Acknowl. upon F: IMMEDIATELY (POWER ON)  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

**F30625 SI MM: Sign-of-life error in safety data**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF2  
**Acknowledge:** IMMEDIATELY (POWER ON)  
**Cause:** The "Safety Integrated" function integrated in the drive on the Motor Module (MM) has detected an error in the sign-of-life of the safety data between the Control Unit (CU) and MM and initiated a STOP A.  
- there is either a DRIVE-CLiQ communication error or communication has failed.  
- a time slice overflow of the safety software has occurred.  
- The enable of the safety functions in both monitoring channels is inconsistent (p9601 = 0, p9801 <> 0).  
Fault value (r0949, interpret decimal):  
Only for internal Siemens troubleshooting.

**Remedy:**  
- select Safe Torque Off and de-select again.  
- carry out a POWER ON (power off/on) for all components.  
- check whether there is a DRIVE-CLiQ communication error between the Control Unit and the Motor Module involved and, if required, carry out a diagnostics routine for the faults identified.  
- de-select all drive functions that are not absolutely necessary.  
- reduce the number of drives.  
- check the electrical cabinet design and cable routing for EMC compliance  
- Check the enable of the safety functions for both of the monitoring channels and if required, correct (p9601, p9801).  
Note:  
CU: Control Unit  
MM: Motor Module  
SI: Safety Integrated

---

**F30630 SI MM: Brake control error**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF2  
**Acknowledge:** IMMEDIATELY (POWER ON)  
**Cause:** The "Safety Integrated" function integrated in the drive on the Motor Module (MM) has detected a brake control error and initiated a STOP A.  
- motor cable is not shielded correctly.  
- defect in control circuit of the Motor Module.  
Fault value (r0949, interpret decimal):  
10:  
Fault in "open holding brake" operation.  
- Parameter p1278 incorrectly set.  
- No brake connected or wire breakage (check whether brake releases for p1278 = 1 and p9602/p9802 = 0 (SBC deactivated)).  
- Ground fault in brake cable.  
30:  
Fault in "close holding brake" operation.  
- No brake connected or wire breakage (check whether brake releases for p1278 = 1 and p9602/p9802 = 0 (SBC deactivated)).  
- Short-circuit in brake winding.  
40:  
Fault in "brake closed" state.

60, 70:

Fault in the brake control circuit of the Control Unit or communication fault between the Control Unit and Motor Module (brake control).

81: Safe Brake Adapter: Fault in "brake closed" state.

82: Safe Brake Adapter: Fault for the operation "open brake".

83: Safe Brake Adapter: Fault for the operation "close brake".

84,85:

Safe Brake Adapter:

Fault in the brake control circuit of the Control Unit or communication fault between the Control Unit and Motor Module (brake control).

90:

Brake released for service purposes (X4).

91:

Fault in "open holding brake" operation.

- No brake connected or wire breakage (check whether brake releases for p1278 = 1 and p9602/p9802 = 0 (SBC deactivated)).

**Remedy:**

- check parameter p1278 (for SBC, only p1278 = 0 is permissible).

- select Safe Torque Off and de-select again.

- check the motor holding brake connection.

- check the function of the motor holding brake.

- check whether there is a DRIVE-CLiQ communication error between the Control Unit and the Motor Module involved and, if required, carry out a diagnostics routine for the faults identified.

- check that the electrical cabinet design and cable routing are in compliance with EMC regulations (e.g. shield of the motor cable and brake conductors are connected with the shield connecting plate and the motor connectors are tightly screwed to the housing).

- replace the Motor Module involved.

Operation with Safe Brake Module or Safe Brake Adapter:

- check the Safe Brake Module or Safe Brake Adapter connection.

- Replace the Safe Brake Module or Safe Brake Adapter.

Note:

MM: Motor Module

SBC: Safe Brake Control

SI: Safety Integrated

**F30631**

**Brake control: External release active**

**Message value:**

-

**Drive object:**

DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:**

OFF2

**Acknowledge:**

IMMEDIATELY (POWER ON)

**Cause:**

For mounting purposes, the brake is supplied with voltage via terminal X4.1 and released.

**Remedy:**

If required, again remove the power supply at X4.1.

**A30640 (F)**

**SI MM: Fault in the shutdown path of the second channel**

**Message value:**

%1

**Drive object:**

DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:**

NONE

**Acknowledge:**

NONE

**Cause:**

The Motor Module has detected a communication error with the higher-level control or the TM54F to transfer the safety-relevant information or there is a communication error between Motor Modules connected in parallel.

Note:

This fault results in a STOP A that can be acknowledged.

Fault value (r0949, interpret decimal):

Only for internal Siemens troubleshooting.

**Remedy:**

For the higher-level control, the following applies:

- check the PROFIsafe address in the higher-level control and Motor Modules and if required, align.

- save all parameters (p0977 = 1).

- carry out a POWER ON (power off/on) for all components.

For TM54F, carry out the following steps:

- start the copy function for the node identifier (p9700 = 1D hex).

- acknowledge hardware CRC (p9701 = EC hex).

- save all parameters (p0977 = 1).

- carry out a POWER ON (power off/on) for all components.
- For a parallel connection, the following applies:
- check the PROFIsafe address in the Control Unit and Motor Module and if required, align.
  - save all parameters (p0977 = 1).
  - carry out a POWER ON (power off/on) for all components.
- The following generally applies:
- upgrade the Motor Module software.

Note:

MM: Motor Module

SI: Safety Integrated

Reaction upon F: NONE (OFF2)

Acknowled. upon F: IMMEDIATELY (POWER ON)

---

**F30649 SI MM: Internal software error**

**Message value:** %1

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** OFF2

**Acknowledge:** IMMEDIATELY (POWER ON)

**Cause:** An internal error in the Safety Integrated software on the Motor Module has occurred.

Note:

This fault results in a STOP A that cannot be acknowledged.

Fault value (r0949, interpret hexadecimal):

Only for internal Siemens troubleshooting.

- Remedy:**
- carry out a POWER ON (power off/on) for all components.
  - re-commission the Safety Integrated function and carry out a POWER ON.
  - upgrade the Motor Module software.
  - contact the Hotline.
  - replace the Motor Module.

Note:

MM: Motor Module

SI: Safety Integrated

---

**F30650 SI MM: Acceptance test required**

**Message value:** %1

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** OFF2

**Acknowledge:** IMMEDIATELY (POWER ON)

**Cause:** The "Safety Integrated" function on the Motor Module requires an acceptance test.

Note:

This fault results in a STOP A that can be acknowledged.

Fault value (r0949, interpret decimal):

130: Safety parameters for the Motor Module not available.

Note:

This fault value is always output when Safety Integrated is commissioned for the first time.

1000: Reference and actual checksum in the Motor Module are not identical (booting).

- as a result of the changed current controller sampling time (p0115[0]), the clock cycle time for the Safety Integrated Basic Functions (r9880) was adapted.

- at least one checksum-checked piece of data is defective.

- Safety parameters set offline and loaded into the Control Unit.

2000: Reference and actual checksum on the Motor Module are not identical (commissioning mode).

- reference checksum incorrectly entered into the Motor Module (p9899 not equal to r9898).

2003: Acceptance test is required as a safety parameter has been changed.

2005: The safety logbook has identified that the safety checksums have changed. An acceptance test is required.

3003: Acceptance test is required as a hardware-related safety parameter has been changed.

9999: Subsequent response of another safety-related fault that occurred when booting that requires an acceptance test.

- Remedy:**
- For fault value = 130:
- carry out safety commissioning routine.
- For fault value = 1000:
- check the Safety Integrated Basic Functions (r9880) and adapt the reference checksum (p9899).

- again carry out safety commissioning routine.
- replace the memory card or Control Unit.
- Using STARTER, activate the safety parameters for the drive involved (change settings, copy parameters, activate settings).
- For fault value = 2000:
  - check the safety parameters in the Motor Module and adapt the reference checksum (p9899).
- Re fault value = 2003, 2005:
  - Carry out an acceptance test and generate an acceptance report.
- The procedure when carrying out an acceptance test as well as an example of the acceptance report are provided in the following literature:  
SINAMICS S120 Function Manual Safety Integrated
- For fault value = 3003:
  - carry out the function checks for the modified hardware and generate an acceptance report.
- The procedure when carrying out an acceptance test as well as an example of the acceptance report are provided in the following literature:  
SINAMICS S120 Function Manual Safety Integrated
- For fault value = 9999:
  - carry out diagnostics for the other safety-related fault that is present.
- Note:  
MM: Motor Module  
SI: Safety Integrated

<b>F30651</b>	<b>SI MM: Synchronization with Control Unit unsuccessful</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	IMMEDIATELY (POWER ON)
<b>Cause:</b>	The "Safety Integrated" function integrated in the drive is requesting synchronization of the safety time slices on the Control Unit and Motor Module. This synchronization routine was unsuccessful. Note: This fault results in a STOP A that cannot be acknowledged. Fault value (r0949, interpret decimal): Only for internal Siemens troubleshooting.
<b>Remedy:</b>	<ul style="list-style-type: none"> <li>- carry out a POWER ON (power off/on) for all components.</li> <li>- upgrade the Motor Module software.</li> <li>- upgrade the Control Unit software.</li> </ul> Note: MM: Motor Module SI: Safety Integrated
<b>F30652</b>	<b>SI MM: Illegal monitoring clock cycle</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	IMMEDIATELY (POWER ON)
<b>Cause:</b>	The Safety Integrated monitoring clock cycle cannot be maintained due to the communication conditions requested in the system. Note: This fault results in a STOP A that cannot be acknowledged. Fault value (r0949, interpret decimal): Only for internal Siemens troubleshooting.
<b>Remedy:</b>	<ul style="list-style-type: none"> <li>- if fault F01652 simultaneously occurs, apply the remedy/countermeasure described there.</li> <li>- Upgrade the firmware of the Motor Module to a later version.</li> </ul> Note: MM: Motor Module SI: Safety Integrated

<hr/>	
<b>F30655</b>	<b>SI MM: Align monitoring functions</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	IMMEDIATELY (POWER ON)
<b>Cause:</b>	<p>An error has occurred when aligning the Safety Integrated monitoring functions on the Control Unit (CU) and Motor Module (MM). Control Unit and Motor Module were not able to determine a common set of supported SI monitoring functions.</p> <ul style="list-style-type: none"><li>- there is either a DRIVE-CLiQ communication error or communication has failed.</li><li>- Safety Integrated software releases on the Control Unit and Motor Module are not compatible with one another.</li></ul> <p>Note: This fault results in a STOP A that cannot be acknowledged. Fault value (r0949, interpret hexadecimal): Only for internal Siemens troubleshooting.</p>
<b>Remedy:</b>	<ul style="list-style-type: none"><li>- carry out a POWER ON (power off/on) for all components.</li><li>- upgrade the Motor Module software.</li><li>- upgrade the Control Unit software.</li><li>- check the electrical cabinet design and cable routing for EMC compliance</li></ul> <p>Note: CU: Control Unit MM: Motor Module SI: Safety Integrated</p>
<hr/>	
<b>F30656</b>	<b>SI MM: Motor Module parameter error</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	IMMEDIATELY (POWER ON)
<b>Cause:</b>	<p>When accessing the Safety Integrated parameters for the Motor Module (MM) in the non-volatile memory, an error has occurred.</p> <p>Note: This fault results in a STOP A that can be acknowledged. Fault value (r0949, interpret decimal): 129: <ul style="list-style-type: none"><li>- safety parameters for the Motor Module corrupted.</li><li>- drive with enabled safety functions was possibly copied offline using the commissioning software and the project downloaded.</li></ul> 131: Internal software error on the Control Unit. 255: Internal Motor Module software error.</p>
<b>Remedy:</b>	<ul style="list-style-type: none"><li>- re-commission the safety functions.</li><li>- upgrade the Control Unit software.</li><li>- upgrade the Motor Module software.</li><li>- replace the memory card or Control Unit.</li></ul> <p>For fault value = 129: <ul style="list-style-type: none"><li>- activate the safety commissioning mode (p0010 = 95).</li><li>- adapt the PROFIsafe address (p9610).</li><li>- start the copy function for SI parameters (p9700 = D0 hex).</li><li>- acknowledge data change (p9701 = DC hex).</li><li>- exit the safety commissioning mode (p0010 = 0).</li><li>- save all parameters (p0977 = 1 or "copy RAM to ROM").</li><li>- carry out a POWER ON (power off/on) for all components.</li></ul></p> <p>Note: MM: Motor Module SI: Safety Integrated</p>

<b>F30659</b>	<b>SI MM: Write request for parameter rejected</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	IMMEDIATELY (POWER ON)
<b>Cause:</b>	<p>The write request for one or several Safety Integrated parameters on the Motor Module (MM) was rejected.</p> <p>Note:</p> <p>This fault does not result in a safety stop response.</p> <p>Fault value (r0949, interpret decimal):</p> <p>10: An attempt was made to enable the STO function although this cannot be supported.</p> <p>11: An attempt was made to enable the SBC function although this cannot be supported.</p> <p>13: An attempt was made to enable the SS1 function although this cannot be supported.</p> <p>14: An attempt was made to enable the safe motion monitoring function with the higher-level control, although this cannot be supported.</p> <p>15: An attempt was made to enable the motion monitoring functions integrated in the drive although these cannot be supported.</p> <p>16: An attempt was made to enable the PROFIsafe communication - although this cannot be supported or the version of the PROFIsafe driver used on the CU and MM is different.</p> <p>18: An attempt was made to enable the PROFIsafe function for Basic Functions although this cannot be supported.</p> <p>19: For ESR, an attempt was made to enable the delay for pulse suppression, although this cannot be supported.</p> <p>33: An attempt was made to enable the motion monitoring functions without selection integrated in the drive (p9601.5, p9801.5), although this cannot be supported.</p>
<b>Remedy:</b>	<p>Re fault value = 10, 11, 13, 14, 15, 16, 18, 19:</p> <ul style="list-style-type: none"> <li>- check whether there are faults in the safety function alignment between the Control Unit and the Motor Module involved (F01655, F30655) and if required, carry out diagnostics for the faults involved.</li> <li>- use a Motor Module that supports the required function.</li> <li>- upgrade the Motor Module software.</li> <li>- upgrade the Control Unit software.</li> </ul> <p>For fault value = 33:</p> <ul style="list-style-type: none"> <li>- Deselect motion monitoring functions without selection integrated in drive (p9601.5, p9801.5) and select safety functions that are supported (see p9771/p9871),</li> </ul> <p>or:</p> <ul style="list-style-type: none"> <li>- use a Motor Module that supports the required function.</li> <li>- upgrade the Motor Module software.</li> <li>- upgrade the Control Unit software.</li> </ul> <p>Note:</p> <p>CU: Control Unit</p> <p>ESR: Extended Stop and Retract</p> <p>MM: Motor Module</p> <p>SBC: Safe Brake Control</p> <p>SI: Safety Integrated</p> <p>SS1: Safe Stop 1 (corresponds to Stop Category 1 acc. to EN60204)</p> <p>STO: Safe Torque Off / SH: Safe standstill</p>
<b>N30800 (F)</b>	<b>Power unit: Group signal</b>
<b>Message value:</b>	-
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	The power unit has detected at least one fault.
<b>Remedy:</b>	Evaluate the other messages that are presently available.
Reaction upon F:	OFF2
Acknowled. upon F:	IMMEDIATELY

---

**F30801 Power unit DRIVE-CLiQ: Sign-of-life missing**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF2  
**Acknowledge:** IMMEDIATELY  
**Cause:** A DRIVE-CLiQ communication error has occurred from the Control Unit to the power unit concerned.  
The computing time load might be too high.  
Fault cause:  
10 (= 0A hex):  
The sign-of-life bit in the receive telegram is not set.  
Note regarding the message value:  
The individual information is coded as follows in the message value (r0949/r2124):  
0000yyxx hex: yy = component number, xx = error cause  
**Remedy:**

- check the electrical cabinet design and cable routing for EMC compliance
- remove DRIVE-CLiQ components that are not required.
- de-select functions that are not required.
- if required, increase the sampling times (p0112, p0115).
- replace the component involved.

---

**F30802 Power unit: Time slice overflow**

**Message value:** -  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF2  
**Acknowledge:** IMMEDIATELY  
**Cause:** A time slice overflow has occurred.  
**Remedy:**

- carry out a POWER ON (power off/on) for all components.
- upgrade firmware to later version.
- contact the Hotline.

---

**F30804 (N, A) Power unit: CRC**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF2 (OFF1, OFF3)  
**Acknowledge:** IMMEDIATELY  
**Cause:** A CRC error has occurred for the power unit.  
**Remedy:**

- carry out a POWER ON (power off/on) for all components.
- upgrade firmware to later version.
- contact the Hotline.

Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

**F30805 Power unit: EPROM checksum error**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF2  
**Acknowledge:** IMMEDIATELY  
**Cause:** Internal parameter data is corrupted.  
Fault value (r0949, interpret hexadecimal):  
01: EEPROM access error.  
02: Too many blocks in the EEPROM.  
**Remedy:** Replace the module.

<b>F30809</b>	<b>Power unit: Switching information not valid</b>
<b>Message value:</b>	-
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	For 3P gating unit, the following applies: The last switching status word in the setpoint telegram is identified by the end ID. Such an end ID was not found.
<b>Remedy:</b>	- carry out a POWER ON (power off/on) for all components. - upgrade firmware to later version. - contact the Hotline.
<b>A30810 (F)</b>	<b>Power unit: Watchdog timer</b>
<b>Message value:</b>	-
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	When booting it was detected that the cause of the previous reset was an SAC watchdog timer overflow.
<b>Remedy:</b>	- carry out a POWER ON (power off/on) for all components. - upgrade firmware to later version. - contact the Hotline.
Reaction upon F:	NONE (OFF2)
Acknowled. upon F:	IMMEDIATELY
<b>F30820</b>	<b>Power unit DRIVE-CLiQ: Telegram error</b>
<b>Message value:</b>	Component number: %1, fault cause: %2
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	A DRIVE-CLiQ communication error has occurred from the Control Unit to the power unit concerned. Fault cause: 1 (= 01 hex): Checksum error (CRC error). 2 (= 02 hex): Telegram is shorter than specified in the length byte or in the receive list. 3 (= 03 hex): Telegram is longer than specified in the length byte or in the receive list. 4 (= 04 hex): The length of the receive telegram does not match the receive list. 5 (= 05 hex): The type of the receive telegram does not match the receive list. 6 (= 06 hex): The address of the component in the telegram and in the receive list do not match. 7 (= 07 hex): A SYNC telegram is expected - but the received telegram is not a SYNC telegram. 8 (= 08 hex): No SYNC telegram is expected - but the received telegram is one. 9 (= 09 hex): The error bit in the receive telegram is set. 16 (= 10 hex): The receive telegram is too early. Note regarding the message value: The individual information is coded as follows in the message value (r0949/r2124): 0000yyxx hex: yy = component number, xx = error cause
<b>Remedy:</b>	- carry out a POWER ON (power off/on). - check the electrical cabinet design and cable routing for EMC compliance - check the DRIVE-CLiQ wiring (interrupted cable, contacts, ...). See also: p9916 (DRIVE-CLiQ data transfer error shutdown threshold slave)



---

<b>F30835</b>	<b>Power unit DRIVE-CLiQ: Cyclic data transfer error</b>
<b>Message value:</b>	Component number: %1, fault cause: %2
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>A DRIVE-CLiQ communication error has occurred from the Control Unit to the power unit concerned. The nodes do not send and receive in synchronism.</p> <p>Fault cause:</p> <p>33 (= 21 hex): The cyclic telegram has not been received.</p> <p>34 (= 22 hex): Timeout in the telegram receive list.</p> <p>64 (= 40 hex): Timeout in the telegram send list.</p> <p>Note regarding the message value: The individual information is coded as follows in the message value (r0949/r2124): 0000yyxx hex: yy = component number, xx = error cause</p>
<b>Remedy:</b>	<p>- carry out a POWER ON.</p> <p>- replace the component involved.</p> <p>See also: p9916 (DRIVE-CLiQ data transfer error shutdown threshold slave)</p>

---

<b>F30836</b>	<b>Power unit DRIVE-CLiQ: Send error for DRIVE-CLiQ data</b>
<b>Message value:</b>	Component number: %1, fault cause: %2
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>A DRIVE-CLiQ communication error has occurred from the Control Unit to the power unit concerned. Data were not able to be sent.</p> <p>Fault cause:</p> <p>65 (= 41 hex): Telegram type does not match send list.</p> <p>Note regarding the message value: The individual information is coded as follows in the message value (r0949/r2124): 0000yyxx hex: yy = component number, xx = error cause</p>
<b>Remedy:</b>	Carry out a POWER ON.

---

<b>F30837</b>	<b>Power unit DRIVE-CLiQ: Component fault</b>
<b>Message value:</b>	Component number: %1, fault cause: %2
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>Fault detected on the DRIVE-CLiQ component concerned. Faulty hardware cannot be excluded.</p> <p>Fault cause:</p> <p>32 (= 20 hex): Error in the telegram header.</p> <p>35 (= 23 hex): Receive error: The telegram buffer memory contains an error.</p> <p>66 (= 42 hex): Send error: The telegram buffer memory contains an error.</p> <p>67 (= 43 hex): Send error: The telegram buffer memory contains an error.</p> <p>Note regarding the message value: The individual information is coded as follows in the message value (r0949/r2124): 0000yyxx hex: yy = component number, xx = error cause</p>
<b>Remedy:</b>	<p>- check the DRIVE-CLiQ wiring (interrupted cable, contacts, ...).</p> <p>- check the electrical cabinet design and cable routing for EMC compliance</p> <p>- if required, use another DRIVE-CLiQ socket (p9904).</p> <p>- replace the component involved.</p>

---

**A30840 Power unit DRIVE-CLiQ: error below the signaling threshold**

<b>Message value:</b>	Component number: %1, fault cause: %2
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>A DRIVE-CLiQ error has occurred below the signaling threshold.</p> <p>Fault cause:</p> <p>1 (= 01 hex): Checksum error (CRC error).</p> <p>2 (= 02 hex): Telegram is shorter than specified in the length byte or in the receive list.</p> <p>3 (= 03 hex): Telegram is longer than specified in the length byte or in the receive list.</p> <p>4 (= 04 hex): The length of the receive telegram does not match the receive list.</p> <p>5 (= 05 hex): The type of the receive telegram does not match the receive list.</p> <p>6 (= 06 hex): The address of the component in the telegram and in the receive list do not match.</p> <p>7 (= 07 hex): A SYNC telegram is expected - but the received telegram is not a SYNC telegram.</p> <p>8 (= 08 hex): No SYNC telegram is expected - but the received telegram is one.</p> <p>9 (= 09 hex): The error bit in the receive telegram is set.</p> <p>10 (= 0A hex): The sign-of-life bit in the receive telegram is not set.</p> <p>11 (= 0B hex): Synchronization error during alternating cyclic data transfer.</p> <p>16 (= 10 hex): The receive telegram is too early.</p> <p>32 (= 20 hex): Error in the telegram header.</p> <p>33 (= 21 hex): The cyclic telegram has not been received.</p> <p>34 (= 22 hex): Timeout in the telegram receive list.</p> <p>35 (= 23 hex): Receive error: The telegram buffer memory contains an error.</p> <p>64 (= 40 hex): Timeout in the telegram send list.</p> <p>65 (= 41 hex): Telegram type does not match send list.</p> <p>66 (= 42 hex): Send error: The telegram buffer memory contains an error.</p> <p>67 (= 43 hex): Send error: The telegram buffer memory contains an error.</p> <p>Note regarding the message value: The individual information is coded as follows in the message value (r0949/r2124): 0000yyxx hex: yy = component number, xx = error cause</p>
<b>Remedy:</b>	<p>- check the electrical cabinet design and cable routing for EMC compliance</p> <p>- check the DRIVE-CLiQ wiring (interrupted cable, contacts, ...).</p> <p>See also: p9916 (DRIVE-CLiQ data transfer error shutdown threshold slave)</p>

---

**F30845 Power unit DRIVE-CLiQ: Cyclic data transfer error**

<b>Message value:</b>	Component number: %1, fault cause: %2
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	A DRIVE-CLiQ communication error has occurred from the Control Unit to the power unit concerned.

Fault cause:  
11 (= 0B hex):  
Synchronization error during alternating cyclic data transfer.  
Note regarding the message value:  
The individual information is coded as follows in the message value (r0949/r2124):  
0000yyxx hex: yy = component number, xx = error cause  
**Remedy:**  
Carry out a POWER ON (power off/on).  
See also: p9916 (DRIVE-CLiQ data transfer error shutdown threshold slave)

---

**F30850      Power unit: Internal software error**  
**Message value:**    %1  
**Drive object:**     DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:**         OFF1 (NONE, OFF2, OFF3)  
**Acknowledge:**     POWER ON  
**Cause:**            An internal software error has occurred in the power unit.  
                      Fault value (r0949, interpret decimal):  
                      Only for internal Siemens troubleshooting.  
**Remedy:**           - replace power unit.  
                      - if required, upgrade the firmware in the power unit.  
                      - contact the Hotline.

---

**F30851      Power unit DRIVE-CLiQ (CU): Sign-of-life missing**  
**Message value:**    Component number: %1, fault cause: %2  
**Drive object:**     DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:**         OFF2 (NONE, OFF1, OFF3)  
**Acknowledge:**     IMMEDIATELY  
**Cause:**            A DRIVE-CLiQ communication error has occurred from the power unit to the Control Unit involved.  
                      The DRIVE-CLiQ component did not set the sign-of-life to the Control Unit.  
                      Fault cause:  
                      10 (= 0A hex):  
                      The sign-of-life bit in the receive telegram is not set.  
                      Note regarding the message value:  
                      The individual information is coded as follows in the message value (r0949/r2124):  
                      0000yyxx hex: yy = component number, xx = error cause  
**Remedy:**           Upgrade the firmware of the component involved.

---

**F30860      Power unit DRIVE-CLiQ (CU): Telegram error**  
**Message value:**    Component number: %1, fault cause: %2  
**Drive object:**     DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:**         OFF2  
**Acknowledge:**     IMMEDIATELY  
**Cause:**            A DRIVE-CLiQ communication error has occurred from the power unit to the Control Unit involved.  
                      Fault cause:  
                      1 (= 01 hex):  
                      Checksum error (CRC error).  
                      2 (= 02 hex):  
                      Telegram is shorter than specified in the length byte or in the receive list.  
                      3 (= 03 hex):  
                      Telegram is longer than specified in the length byte or in the receive list.  
                      4 (= 04 hex):  
                      The length of the receive telegram does not match the receive list.  
                      5 (= 05 hex):  
                      The type of the receive telegram does not match the receive list.  
                      6 (= 06 hex):  
                      The address of the power unit in the telegram and in the receive list do not match.  
                      9 (= 09 hex):  
                      The error bit in the receive telegram is set.  
                      16 (= 10 hex):  
                      The receive telegram is too early.

17 (= 11 hex):  
CRC error and the receive telegram is too early.  
18 (= 12 hex):  
The telegram is shorter than that specified in the length byte or in the receive list and the receive telegram is too early.  
19 (= 13 hex):  
The telegram is longer than that specified in the length byte or in the receive list and the receive telegram is too early.  
20 (= 14 hex):  
The length of the receive telegram does not match the receive list and the receive telegram is too early.  
21 (= 15 hex):  
The type of the receive telegram does not match the receive list and the receive telegram is too early.  
22 (= 16 hex):  
The address of the power unit in the telegram and in the receive list does not match and the receive telegram is too early.  
25 (= 19 hex):  
The error bit in the receive telegram is set and the receive telegram is too early.  
Note regarding the message value:  
The individual information is coded as follows in the message value (r0949/r2124):  
0000yyxx hex: yy = component number, xx = error cause

**Remedy:**

- carry out a POWER ON (power off/on).
- check the electrical cabinet design and cable routing for EMC compliance
- check the DRIVE-CLiQ wiring (interrupted cable, contacts, ...).

See also: p9915 (DRIVE-CLiQ data transfer error shutdown threshold master)

---

**F30875 Power unit DRIVE-CLiQ (CU): Supply voltage failed**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF2  
**Acknowledge:** IMMEDIATELY  
**Cause:** The DRIVE-CLiQ communication from the DRIVE-CLiQ component involved to the Control Unit signals that the supply voltage has failed.  
 Fault cause:  
 9 (= 09 hex):  
 The power supply voltage for the components has failed.  
 Note regarding the message value:  
 The individual information is coded as follows in the message value (r0949/r2124):  
 0000yyxx hex: yy = component number, xx = error cause

**Remedy:**

- carry out a POWER ON (power off/on).
- check the power supply voltage wiring for the DRIVE-CLiQ component (interrupted cable, contacts, ...).
- check the dimensioning of the power supply for the DRIVE-CLiQ component.

---

**F30885 CU DRIVE-CLiQ (CU): Cyclic data transfer error**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF2  
**Acknowledge:** IMMEDIATELY  
**Cause:** A DRIVE-CLiQ communication error has occurred from the power unit to the Control Unit involved.  
 The nodes do not send and receive in synchronism.  
 Fault cause:  
 26 (= 1A hex):  
 Sign-of-life bit in the receive telegram not set and the receive telegram is too early.  
 33 (= 21 hex):  
 The cyclic telegram has not been received.  
 34 (= 22 hex):  
 Timeout in the telegram receive list.  
 64 (= 40 hex):  
 Timeout in the telegram send list.  
 98 (= 62 hex):  
 Error at the transition to cyclic operation.  
 Note regarding the message value:  
 The individual information is coded as follows in the message value (r0949/r2124):  
 0000yyxx hex: yy = component number, xx = error cause

**Remedy:**

- check the power supply voltage of the component involved.
- carry out a POWER ON.
- replace the component involved.

See also: p9915 (DRIVE-CLiQ data transfer error shutdown threshold master)

---

**F30886      PU DRIVE-CLiQ (CU): Error when sending DRIVE-CLiQ data**

**Message value:** Component number: %1, fault cause: %2

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** OFF2

**Acknowledge:** IMMEDIATELY

**Cause:** A DRIVE-CLiQ communication error has occurred from the power unit to the Control Unit involved.  
Data were not able to be sent.  
Fault cause:  
65 (= 41 hex):  
Telegram type does not match send list.  
Note regarding the message value:  
The individual information is coded as follows in the message value (r0949/r2124):  
0000yyxx hex: yy = component number, xx = error cause

**Remedy:** Carry out a POWER ON.

---

**F30887      Power unit DRIVE-CLiQ (CU): Component fault**

**Message value:** Component number: %1, fault cause: %2

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** OFF2

**Acknowledge:** IMMEDIATELY

**Cause:** Fault detected on the DRIVE-CLiQ component (power unit) involved. Faulty hardware cannot be excluded.  
Fault cause:  
32 (= 20 hex):  
Error in the telegram header.  
35 (= 23 hex):  
Receive error: The telegram buffer memory contains an error.  
66 (= 42 hex):  
Send error: The telegram buffer memory contains an error.  
67 (= 43 hex):  
Send error: The telegram buffer memory contains an error.  
96 (= 60 hex):  
Response received too late during runtime measurement.  
97 (= 61 hex):  
Time taken to exchange characteristic data too long.  
Note regarding the message value:  
The individual information is coded as follows in the message value (r0949/r2124):  
0000yyxx hex: yy = component number, xx = error cause

**Remedy:**

- check the DRIVE-CLiQ wiring (interrupted cable, contacts, ...).
- check the electrical cabinet design and cable routing for EMC compliance
- if required, use another DRIVE-CLiQ socket (p9904).
- replace the component involved.

---

**F30895      PU DRIVE-CLiQ (CU): Alternating cyclic data transfer error**

**Message value:** Component number: %1, fault cause: %2

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31

**Reaction:** OFF2 (IASC/DCBRK, NONE, OFF1, OFF3, STOP1, STOP2)

**Acknowledge:** IMMEDIATELY

**Cause:** A DRIVE-CLiQ communication error has occurred from the power unit to the Control Unit involved.  
Fault cause:  
11 (= 0B hex):  
Synchronization error during alternating cyclic data transfer.  
Note regarding the message value:  
The individual information is coded as follows in the message value (r0949/r2124):  
0000yyxx hex: yy = component number, xx = error cause

**Remedy:** Carry out a POWER ON.  
See also: p9915 (DRIVE-CLiQ data transfer error shutdown threshold master)

---

**F30896 Power unit DRIVE-CLiQ (CU): Inconsistent component properties**

**Message value:** Component number: %1

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** OFF2 (IASC/DCBRK, NONE, OFF1, OFF3, STOP1, STOP2)

**Acknowledge:** IMMEDIATELY

**Cause:** The properties of the DRIVE-CLiQ component (power unit), specified by the fault value, have changed in an incompatible fashion with respect to the properties when booted. One cause can be, e.g. that a DRIVE-CLiQ cable or DRIVE-CLiQ component has been replaced.  
Fault value (r0949, interpret decimal):  
Component number.

**Remedy:** - carry out a POWER ON.  
- when a component is replaced, the same component type and if possible the same firmware version should be used.  
- when a cable is replaced, only cables whose length is the same as or as close as possible to the length of the original cables should be used (ensure compliance with the maximum cable length).

---

**F30899 (N, A) Power unit: Unknown fault**

**Message value:** New message: %1

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** NONE (IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)

**Acknowledge:** IMMEDIATELY (POWER ON)

**Cause:** A fault occurred on the power unit that cannot be interpreted by the Control Unit firmware.  
This can occur if the firmware on this component is more recent than the firmware on the Control Unit.  
Fault value (r0949, interpret decimal):  
Fault number.  
Note:  
If required, the significance of this new fault can be read about in a more recent description of the Control Unit.

**Remedy:** - replace the firmware on the power unit by an older firmware version (r0128).  
- upgrade the firmware on the Control Unit (r0018).

Reaction upon N: NONE

Acknowled. upon N: NONE

Reaction upon A: NONE

Acknowled. upon A: NONE

---

**F30903 Power unit: I2C bus error occurred**

**Message value:** %1

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** NONE (IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)

**Acknowledge:** IMMEDIATELY

**Cause:** Communications error with an EEPROM or A/D converter.  
Fault value (r0949, interpret hexadecimal):  
80000000 hex:  
- internal software error.  
00000001 hex ... 0000FFFF hex:  
- module fault.

**Remedy:** Re fault value = 80000000 hex:  
- upgrade firmware to later version.  
Re fault value = 00000001 hex ... 0000FFFF hex:  
- replace the module.

---

---

**F30907 Power unit: FPGA configuration unsuccessful**

**Message value:** -  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF2 (IASC/DCBRK, NONE, OFF1, OFF3, STOP1, STOP2)  
**Acknowledge:** IMMEDIATELY  
**Cause:** During initialization within the power unit, an internal software error has occurred.  
**Remedy:**

- if required, upgrade the firmware in the power unit.
- replace power unit.
- contact the Hotline.

---

**A30920 (F) Power unit: Temperature sensor fault**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** When evaluating the temperature sensor, an error occurred.  
Alarm value (r2124, interpret decimal):  
1: Wire breakage or sensor not connected (KTY: R > 1630 Ohm, PT100: R > 375 Ohm).  
2: Measured resistance too low (PTC: R < 20 Ohm, KTY: R < 50 Ohm, PT100: R < 30 Ohm).  
**Note:**  
A temperature sensor is connected to the following terminals:  
- "Booksize" format: X21.1/.2 or X22.1/.2  
- "Chassis" format: X41.4/.3  
Information on temperature sensors is provided in the following literature for example:  
SINAMICS S120 Function Manual Drive Functions  
**Remedy:**

- make sure that the sensor is connected correctly.
- replace the sensor.

Reaction upon F: NONE (IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)  
Acknowl. upon F: IMMEDIATELY

---

**A30999 (F, N) Power unit: Unknown alarm**

**Message value:** New message: %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** An alarm occurred on the power unit that cannot be interpreted by the Control Unit firmware.  
This can occur if the firmware on this component is more recent than the firmware on the Control Unit.  
Alarm value (r2124, interpret decimal):  
Alarm number.  
**Note:**  
If required, the significance of this new alarm can be read about in a more recent description of the Control Unit.  
**Remedy:**

- replace the firmware on the power unit by an older firmware version (r0128).
- upgrade the firmware on the Control Unit (r0018).

Reaction upon F: NONE (IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)  
Acknowl. upon F: IMMEDIATELY (POWER ON)  
Reaction upon N: NONE  
Acknowl. upon N: NONE

---

**F31100 (N, A) Encoder 1: Zero mark distance error**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** ENCODER (IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)  
**Acknowledge:** PULSE INHIBIT  
**Cause:** The measured zero mark distance does not correspond to the parameterized zero mark distance.  
For distance-coded encoders, the zero mark distance is determined from zero marks detected pairs. This means that if a zero mark is missing, depending on the pair generation, this cannot result in a fault and also has no effect in the system.

The zero mark distance for the zero mark monitoring is set in p0425 (rotary encoder) or p0424 (linear encoder).  
 Fault value (r0949, interpret decimal):  
 Last measured zero mark distance in increments (4 increments = 1 encoder pulse).  
 The sign designates the direction of motion when detecting the zero mark distance.  
 See also: p0491 (Motor encoder fault response ENCODER)

**Remedy:**

- check that the encoder cables are routed in compliance with EMC.
- check the plug connections
- check the encoder type (encoder with equidistant zero marks).
- adapt the parameter for the distance between zero marks (p0424, p0425).
- if message output above speed threshold, reduce filter time if necessary (p0438).
- replace the encoder or encoder cable

Reaction upon N: NONE  
 Acknowl. upon N: NONE  
 Reaction upon A: NONE  
 Acknowl. upon A: NONE

---

**F31101 (N, A) Encoder 1: Zero mark failed**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** ENCODER (IASC/DCBRK, NONE, OFF1, OFF2, OFF3, STOP1, STOP2)  
**Acknowledge:** PULSE INHIBIT  
**Cause:** The 1.5 x parameterized zero mark distance was exceeded.  
 The zero mark distance for the zero mark monitoring is set in p0425 (rotary encoder) or p0424 (linear encoder).  
 Fault value (r0949, interpret decimal):  
 Number of increments after POWER ON or since the last zero mark that was detected (4 increments = 1 encoder pulse).  
 See also: p0491 (Motor encoder fault response ENCODER)

**Remedy:**

- check that the encoder cables are routed in compliance with EMC.
- check the plug connections
- check the encoder type (encoder with equidistant zero marks).
- adapt the parameter for the clearance between zero marks (p0425).
- if message output above speed threshold, reduce filter time if necessary (p0438).
- when p0437.1 is active, check p4686.
- replace the encoder or encoder cable

Reaction upon N: NONE  
 Acknowl. upon N: NONE  
 Reaction upon A: NONE  
 Acknowl. upon A: NONE

---

**F31103 (N, A) Encoder 1: Amplitude error track R**

**Message value:** R track: %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** ENCODER (IASC/DCBRK, NONE)  
**Acknowledge:** PULSE INHIBIT  
**Cause:** The amplitude of the reference track signal (track R) does not lie within the tolerance bandwidth for encoder 1.  
 The fault can be initiated when the unipolar voltage level is exceeded (RP/RN) or if the differential amplitude is under-shot.  
 Fault value (r0949, interpret hexadecimal):  
 yyyxxxxx hex: yyyy = 0, xxxx = Signal level, track R (16 bits with sign)  
 The response thresholds of the unipolar signal levels of the encoder are between < 1400 mV and > 3500 mV.  
 The response threshold for the differential signal level of the encoder is < -1600 mV.  
 A signal level of 500 mV peak value corresponds to the numerical value 5333 hex = 21299 dec.  
 Note:  
 The analog value of the amplitude error is not measured at the same time with the hardware fault output by the Sensor Module.  
 The fault value can only be represented between -32768 ... 32767 dec (-770 ... 770 mV).



The signal level is not evaluated unless the following conditions are satisfied:

- Sensor Module properties available (r0459.31 = 1).

- Monitoring active (p0437.31 = 1).

See also: p0491 (Motor encoder fault response ENCODER)

**Remedy:**

- check the speed range; frequency characteristic (amplitude characteristic) of the measuring equipment might not be sufficient for the speed range
- check that the encoder cables and shielding are routed in compliance with EMC.
- check the plug connections and contacts of the encoder cable.
- check the encoder type (encoder with zero marks).
- check whether the zero mark is connected and the signal cables RP and RN have been connected correctly
- replace the encoder cable.
- if the coding disk is soiled or the lighting aged, replace the encoder.

Reaction upon N: NONE

Acknowl. upon N: NONE

Reaction upon A: NONE

Acknowl. upon A: NONE

---

**F31110 (N, A) Encoder 1: Serial communications error**

**Message value:** Fault cause: %1 bin

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** ENCODER (IASC/DCBRK, NONE)

**Acknowledge:** PULSE INHIBIT

**Cause:** Serial communication protocol transfer error between the encoder and evaluation module.

Fault value (r0949, interpret binary):

Bit 0: Alarm bit in the position protocol.

Bit 1: Incorrect quiescent level on the data line.

Bit 2: Encoder does not respond (does not supply a start bit within 50 ms).

Bit 3: CRC error: The checksum in the protocol from the encoder does not match the data.

Bit 4: Encoder acknowledgement error: The encoder incorrectly understood the task (request) or cannot execute it.

Bit 5: Internal error in the serial driver: An illegal mode command was requested.

Bit 6: Timeout when cyclically reading.

Bit 7: Timeout for the register communication.

Bit 8: Protocol is too long (e.g. > 64 bits).

Bit 9: Receive buffer overflow.

Bit 10: Frame error when reading twice.

Bit 11: Parity error.

Bit 12: Data line signal level error during the monoflop time.

Bit 13: Data line incorrect.

Bit 14: Fault for the register communication.

Note:

For an EnDat 2.2 encoder, the significance of the fault value for F3x135 (x = 1, 2, 3) is described.

**Remedy:**

Re fault value, bit 0 = 1:

- Enc defect F31111 may provide additional details.

Re fault value, bit 1 = 1:

- Incorrect encoder type / replace the encoder or encoder cable.

Re fault value, bit 2 = 1:

- Incorrect encoder type / replace the encoder or encoder cable.

Re fault value, bit 3 = 1:

- EMC / connect the cable shield, replace the encoder or encoder cable.

Re fault value, bit 4 = 1:

- EMC / connect the cable shield, replace the encoder or encoder cable, replace the Sensor Module.

Re fault value, bit 5 = 1:

- EMC / connect the cable shield, replace the encoder or encoder cable, replace the Sensor Module.

Re fault value, bit 6 = 1:

- Update Sensor Module firmware.

Re fault value, bit 7 = 1:

- Incorrect encoder type / replace the encoder or encoder cable.

Re fault value, bit 8 = 1:

- Check parameterization (p0429.2).

Re fault value, bit 9 = 1:

- EMC / connect the cable shield, replace the encoder or encoder cable, replace the Sensor Module.

Re fault value, bit 10 = 1:  
 - Check parameterization (p0429.2, p0449).  
 Re fault value, bit 11 = 1:  
 - Check parameterization (p0436).  
 Re fault value, bit 12 = 1:  
 - Check parameterization (p0429.6).  
 Re fault value, bit 13 = 1:  
 - Check data line.  
 Re fault value, bit 14 = 1:  
 - Incorrect encoder type / replace the encoder or encoder cable.

Reaction upon N: NONE  
 Acknowl. upon N: NONE  
 Reaction upon A: NONE  
 Acknowl. upon A: NONE

---

**F31111 (N, A) Encoder 1: Absolute encoder internal error**

**Message value:** Fault cause: %1 bin, additional information: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** ENCODER (IASC/DCBRK, NONE)  
**Acknowledge:** PULSE INHIBIT  
**Cause:** The absolute encoder fault word supplies fault bits that have been set.

Fault value (r0949, interpret binary):  
 yyyyxxxx hex: yyyy = supplementary information, xxxx = fault cause  
 yyyy = 0:  
 Bit 0: Lighting system failed.  
 Bit 1: Signal amplitude too low.  
 Bit 2: Position value incorrect.  
 Bit 3: Encoder power supply overvoltage condition.  
 Bit 4: Encoder power supply undervoltage condition.  
 Bit 5: Encoder power supply overcurrent condition.  
 Bit 6: The battery must be changed.  
 yyyy = 1:  
 Bit 0: Signal amplitude outside the control range.  
 Bit 1: Error multiturn interface  
 Bit 2: Internal data error (singleturn/multiturn not with single steps).  
 Bit 3: Error EEPROM interface.  
 Bit 4: SAR converter error.  
 Bit 5: Fault for the register data transfer.  
 Bit 6: Internal error identified at the error pin (nErr).  
 Bit 7: Temperature threshold exceeded or fallen below.  
 See also: p0491 (Motor encoder fault response ENCODER)

**Remedy:** For yyyy = 0:  
 Re fault value, bit 0 = 1:  
 Encoder is defective. Replace the encoder, where the motor encoder has a direct DRIVE-CLiQ socket: Replace the motor.  
 Re fault value, bit 1 = 1:  
 Encoder is defective. Replace the encoder, where the motor encoder has a direct DRIVE-CLiQ socket: Replace the motor.  
 Re fault value, bit 2 = 1:  
 Encoder is defective. Replace the encoder, where the motor encoder has a direct DRIVE-CLiQ socket: Replace the motor.  
 Re fault value, bit 3 = 1:  
 5 V power supply voltage fault.  
 When using an SMC: Check the plug-in cable between the encoder and SMC or replace the SMC.  
 When a motor encoder with a direct DRIVE-CLiQ connection is used: Replace the motor.  
 Re fault value, bit 4 = 1:  
 5 V power supply voltage fault.  
 When using an SMC: Check the plug-in cable between the encoder and SMC or replace the SMC.  
 When using a motor with DRIVE-CLiQ: Replace the motor.

Re fault value, bit 5 = 1:  
Encoder is defective. Replace the encoder, where the motor encoder has a direct DRIVE-CLiQ socket: Replace the motor.  
Re fault value, bit 6 = 1:  
The battery must be changed (only for encoders with battery back-up).  
For yyyy = 1:  
Encoder is defective. Replace encoder.

Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

#### **F31112 (N, A) Encoder 1: Error bit set in the serial protocol**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** ENCODER (IASC/DCBRK, NONE)  
**Acknowledge:** PULSE INHIBIT  
**Cause:** The encoder sends a set error bit via the serial protocol.  
Fault value (r0949, interpret binary):  
Bit 0: Fault bit in the position protocol.  
**Remedy:** For fault value, bit 0 = 1:  
In the case of an EnDat encoder, F31111 may provide further details.

Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

#### **F31115 (N, A) Encoder 1: Amplitude error track A or B ( $A^2 + B^2$ )**

**Message value:** A track: %1, B-track: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** ENCODER (IASC/DCBRK, NONE)  
**Acknowledge:** PULSE INHIBIT  
**Cause:** The amplitude (root of  $A^2 + B^2$ ) for encoder 1 exceeds the permissible tolerance.  
Fault value (r0949, interpret hexadecimal):  
yyyyxxxx hex:  
yyyy = Signal level, track B (16 bits with sign).  
xxxx = Signal level, track A (16 bits with sign).  
The nominal signal level of the encoder must lie in the range 375 mV to 600 mV (500 mV -25/+20 %).  
The response thresholds are < 170 mV (observe the frequency response of the encoder) and > 750 mV.  
A signal level of 500 mV peak value corresponds to the numerical value 5333 hex = 21299 dec.  
Note for sensors modules for resolvers (e. g. SMC10):  
The nominal signal level is at 2900 mV (2.0 Vrms). The response thresholds are < 1070 mV and > 3582 mV.  
A signal level of 2900 mV peak value corresponds to the numerical value 6666 hex = 26214 dec.  
Note:  
The analog values of the amplitude error are not measured at the same time with the hardware fault output by the Sensor Module.  
See also: p0491 (Motor encoder fault response ENCODER)  
**Remedy:**  
- check that the encoder cables and shielding are routed in compliance with EMC.  
- check the plug connections  
- replace the encoder or encoder cable  
- check the Sensor Module (e.g. contacts).  
The following applies to measuring systems without their own bearing system:  
- adjust the scanning head and check the bearing system of the measuring wheel.  
The following applies for measuring systems with their own bearing system:  
- ensure that the encoder housing is not subject to any axial force.

Reaction upon N: NONE  
Acknowl. upon N: NONE

Reaction upon A: NONE  
Acknowl. upon A: NONE

<b>F31116 (N, A)</b>	<b>Encoder 1: Amplitude error monitoring track A + B</b>
<b>Message value:</b>	A track: %1, B-track: %2
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	ENCODER (IASC/DCBRK, NONE)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>The amplitude of the rectified encoder signals A and B and the amplitude from the roots of <math>A^2 + B^2</math> for encoder 1 are not within the tolerance bandwidth.</p> <p>Fault value (r0949, interpret hexadecimal): yyyyxxxx hex: yyyy = Signal level, track B (16 bits with sign). xxxx = Signal level, track A (16 bits with sign).</p> <p>The nominal signal level of the encoder must lie in the range 375 mV to 600 mV (500 mV -25/+20 %). The response thresholds are &lt; 130 mV (observe the frequency response of the encoder) and &gt; 955 mV. A signal level of 500 mV peak value corresponds to the numerical value 5333 hex = 21299 dec.</p> <p>Note: The analog values of the amplitude error are not measured at the same time with the hardware fault output by the Sensor Module. See also: p0491 (Motor encoder fault response ENCODER)</p>
<b>Remedy:</b>	<ul style="list-style-type: none"> <li>- check that the encoder cables and shielding are routed in compliance with EMC.</li> <li>- check the plug connections</li> <li>- replace the encoder or encoder cable</li> <li>- check the Sensor Module (e.g. contacts).</li> </ul>
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE

<b>F31117 (N, A)</b>	<b>Encoder 1: Inversion error signals A/B/R</b>
<b>Message value:</b>	Fault cause: %1 bin
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	ENCODER (IASC/DCBRK, NONE)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>For a square-wave encoder (bipolar, double ended) signals A*, B* and R* are not inverted with respect to signals A, B and R.</p> <p>Fault value (r0949, interpret binary): Bits 0 ... 15: Only for internal Siemens troubleshooting. Bit 16: Error track A. Bit 17: Error track B. Bit 18: Error track R.</p> <p>Note: For SMC30 (order no.. 6SL3055-0AA00-5CA0 and 6SL3055-0AA00-5CA1 only), CUA32, and CU310, the following applies: A square-wave encoder without track R is used and track monitoring (p0405.2 = 1) is activated. See also: p0491 (Motor encoder fault response ENCODER)</p>
<b>Remedy:</b>	<ul style="list-style-type: none"> <li>- Check the encoder/cable.</li> <li>- Does the encoder supply signals and the associated inverted signals?</li> </ul> <p>Note: For SMC30 (order no. 6SL3055-0AA00-5CA0 and 6SL3055-0AA00-5CA1 only), the following applies: - check the setting of p0405 (p0405.2 = 1 is only possible if the encoder is connected at X520). For a square-wave encoder without track R, the following jumpers must be set for the connection at X520 (SMC30) or X23 (CUA32, CU310): - pin 10 (reference signal R) &lt;--&gt; pin 7 (encoder power supply, ground) - pin 11 (reference signal R inverted) &lt;--&gt; pin 4 (encoder power supply)</p>
Reaction upon N:	NONE
Acknowl. upon N:	NONE

Reaction upon A: NONE  
Acknowl. upon A: NONE

---

**F31118 (N, A) Encoder 1: Speed difference outside the tolerance range**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** ENCODER (IASC/DCBRK, NONE)  
**Acknowledge:** PULSE INHIBIT  
**Cause:** For an HTL/TTL encoder, the speed difference has exceeded the value in p0492 over several sampling cycles. The change to the averaged speed actual value - if applicable - is monitored in the current controller sampling time. Encoder 1 is used as motor encoder and can be effective has fault response to change over to encoderless operation.  
 Fault value (r0949, interpret decimal):  
 Only for internal Siemens troubleshooting.  
 See also: p0491 (Motor encoder fault response ENCODER), p0492 (Square-wave encoder maximum speed difference per sampling cycle)  
**Remedy:** - check the tachometer feeder cable for interruptions.  
 - check the grounding of the tachometer shielding.  
 - if required, increase the maximum speed difference per sampling cycle (p0492).  
 Reaction upon N: NONE  
 Acknowl. upon N: NONE  
 Reaction upon A: NONE  
 Acknowl. upon A: NONE

---

**F31120 (N, A) Encoder 1: Power supply voltage fault**

**Message value:** Fault cause: %1 bin  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** ENCODER (IASC/DCBRK, NONE)  
**Acknowledge:** PULSE INHIBIT  
**Cause:** A power supply fault was detected for encoder 1.  
 Fault value (r0949, interpret binary):  
 Bit 0: Undervoltage condition on the sense line.  
 Bit 1: Overcurrent condition for the encoder power supply.  
 Bit 2: Overcurrent condition for encoder power supply on cable resolver excitation negative.  
 Bit 3: Overcurrent condition for encoder power supply on cable resolver excitation positive.  
 Bit 4: The 24 V power supply through the Power Module (PM) is overloaded.  
 Bit 5: Overcurrent at the EnDat connection of the converter.  
 Bit 6: Overvoltage at the EnDat connection of the converter.  
 Bit 7: Hardware fault at the EnDat connection of the converter.  
 Note:  
 If the encoder cables 6FX2002-2EQ00-.... and 6FX2002-2CH00-.... are interchanged, this can result in the encoder being destroyed because the pins of the operating voltage are reversed.  
 See also: p0491 (Motor encoder fault response ENCODER)  
**Remedy:** Re fault value, bit 0 = 1:  
 - correct encoder cable connected?  
 - check the plug connections of the encoder cable.  
 SMC30: Check the parameterization (p0404.22).  
 Re fault value, bit 1 = 1:  
 - correct encoder cable connected?  
 - replace the encoder or encoder cable  
 Re fault value, bit 2 = 1:  
 - correct encoder cable connected?  
 - replace the encoder or encoder cable  
 Re fault value, bit 3 = 1:  
 - correct encoder cable connected?  
 - replace the encoder or encoder cable  
 Re fault value, bit 5 = 1:  
 - Measuring unit correctly connected at the converter?  
 - Replace the measuring unit or the cable to the measuring unit.

Re fault value, bit 6, 7 = 1:  
 - Replace the defective EnDat 2.2 converter.

Reaction upon N: NONE  
 Acknowl. upon N: NONE  
 Reaction upon A: NONE  
 Acknowl. upon A: NONE

---

**F31121 (N, A) Encoder 1: Coarse position error**

**Message value:** -  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** ENCODER (NONE)  
**Acknowledge:** PULSE INHIBIT  
**Cause:** For the actual value sensing, an error was detected on the module.  
 As a result of this error, it must be assumed that the actual value sensing supplies an incorrect coarse position.  
 See also: p0491 (Motor encoder fault response ENCODER)  
**Remedy:** Replace the motor with DRIVE-CLiQ or the appropriate Sensor Module.

Reaction upon N: NONE  
 Acknowl. upon N: NONE  
 Reaction upon A: NONE  
 Acknowl. upon A: NONE

---

**F31122 Encoder 1: Internal power supply voltage faulty**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** ENCODER  
**Acknowledge:** IMMEDIATELY  
**Cause:** Fault in internal reference voltage of ASICs for encoder 1.  
 Fault value (r0949, interpret decimal):  
 1: Reference voltage error.  
 2: Internal undervoltage.  
 3: Internal overvoltage.  
**Remedy:** Replace the motor with DRIVE-CLiQ or the appropriate Sensor Module.

---

**F31123 (N, A) Encoder 1: Signal level A/B unipolar outside tolerance**

**Message value:** Fault cause: %1 bin  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** ENCODER (IASC/DCBRK, NONE)  
**Acknowledge:** PULSE INHIBIT  
**Cause:** The unipolar level (AP/AN or BP/BN) for encoder 1 is outside the permissible tolerance.  
 Fault value (r0949, interpret binary):  
 Bit 0 = 1: Either AP or AN outside the tolerance.  
 Bit 16 = 1: Either BP or BN outside the tolerance.  
 The unipolar nominal signal level of the encoder must lie in the range 2500 mV +/- 500 mV.  
 The response thresholds are < 1700 mV and > 3300 mV.  
 Note:  
 The signal level is not evaluated unless the following conditions are satisfied:  
 - Sensor Module properties available (r0459.31 = 1).  
 - Monitoring active (p0437.31 = 1).  
 See also: p0491 (Motor encoder fault response ENCODER)  
**Remedy:** - make sure that the encoder cables and shielding are installed in an EMC-compliant manner.  
 - check the plug connections and contacts of the encoder cable.  
 - check the short-circuit of a signal cable with mass or the operating voltage.  
 - replace the encoder cable.

Reaction upon N: NONE  
 Acknowl. upon N: NONE  
 Reaction upon A: NONE  
 Acknowl. upon A: NONE

---

**F31125 (N, A) Encoder 1: Amplitude error track A or B overcontrolled**

**Message value:** A track: %1, B-track: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** ENCODER (IASC/DCBRK, NONE)  
**Acknowledge:** PULSE INHIBIT  
**Cause:** The amplitude of track A or B for encoder 1 exceeds the permissible tolerance band.  
Fault value (r0949, interpret hexadecimal):  
yyyyxxxx hex:  
yyyy = Signal level, track B (16 bits with sign).  
xxxx = Signal level, track A (16 bits with sign).  
The nominal signal level of the encoder must lie in the range 375 mV to 600 mV (500 mV -25/+20 %).  
The response threshold is > 750 mV. This fault also occurs if the A/D converter is overcontrolled.  
A signal level of 500 mV peak value corresponds to the numerical value 5333 hex = 21299 dec.  
Note for sensors modules for resolvers (e. g. SMC10):  
The nominal signal level is at 2900 mV (2.0 Vrms). The response threshold is > 3582 mV.  
A signal level of 2900 mV peak value corresponds to the numerical value 6666 hex = 26214 dec.  
Note:  
The analog values of the amplitude error are not measured at the same time with the hardware fault output by the Sensor Module.  
See also: p0491 (Motor encoder fault response ENCODER)  
**Remedy:** - check that the encoder cables and shielding are routed in compliance with EMC.  
- replace the encoder or encoder cable  
Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

**F31126 (N, A) Encoder 1: Amplitude AB too high**

**Message value:** Amplitude: %1, Angle: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** ENCODER (IASC/DCBRK, NONE)  
**Acknowledge:** PULSE INHIBIT  
**Cause:** The amplitude (root of  $A^2 + B^2$  or  $|A| + |B|$ ) for encoder 1 exceeds the permissible tolerance.  
Fault value (r0949, interpret hexadecimal):  
yyyyxxxx hex:  
yyyy = Angle  
xxxx = Amplitude, i.e. root from  $A^2 + B^2$  (16 bits without sign)  
The nominal signal level of the encoder must lie in the range 375 mV to 600 mV (500 mV -25/+20 %).  
The response threshold for  $(|A| + |B|)$  is > 1120 mV or the root of  $(A^2 + B^2)$  > 955 mV.  
A signal level of 500 mV peak value corresponds to the numerical value of 299A hex = 10650 dec.  
The angle 0 ... FFFF hex corresponds to 0 ... 360 degrees of the fine position. Zero degrees is present at the negative zero crossover of track B.  
Note:  
The analog values of the amplitude error are not measured at the same time with the hardware fault output by the Sensor Module.  
See also: p0491 (Motor encoder fault response ENCODER)  
**Remedy:** - check that the encoder cables and shielding are routed in compliance with EMC.  
- replace the encoder or encoder cable  
Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

<b>F31129 (N, A)</b>	<b>Encoder 1: Position difference hall sensor/track C/D and A/B too large</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	ENCODER (IASC/DCBRK, NONE)
<b>Acknowledge:</b>	PULSE INHIBIT
<b>Cause:</b>	<p>The error for track C/D is greater than +/-15 ° mechanical or +/-60 ° electrical or the error for the Hall signals is greater than +/-60 ° electrical.</p> <p>One period of track C/D corresponds to 360 ° mechanical.</p> <p>One period of the Hall signal corresponds to 360 ° electrical.</p> <p>The monitoring responds if, for example, Hall sensors are connected as equivalent for the C/D tracks with the incorrect rotational sense or supply values that are not accurate enough.</p> <p>After the fine synchronization using one reference mark or 2 reference marks for distance-coded encoders, this fault is no longer initiated, but instead, Alarm A31429.</p> <p>Fault value (r0949, interpret decimal):</p> <p>For track C/D, the following applies:</p> <p>Measured deviation as mechanical angle (16 bits with sign, 182 dec corresponds to 1 °).</p> <p>For Hall signals, the following applies:</p> <p>Measured deviation as electrical angle (16 bits with sign, 182 dec corresponds to 1 °).</p> <p>See also: p0491 (Motor encoder fault response ENCODER)</p>
<b>Remedy:</b>	<ul style="list-style-type: none"> <li>- track C or D not connected.</li> <li>- correct the direction of rotation of the Hall sensor possibly connected as equivalent for track C/D.</li> <li>- check that the encoder cables are routed in compliance with EMC.</li> <li>- check the adjustment of the Hall sensor.</li> </ul>
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE
<b>F31130 (N, A)</b>	<b>Encoder 1: Zero mark and position error from the coarse synchronization</b>
<b>Message value:</b>	Angular deviation, electrical: %1, angle, mechanical: %2
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	ENCODER (IASC/DCBRK, NONE, OFF1, OFF2, OFF3, STOP1, STOP2)
<b>Acknowledge:</b>	PULSE INHIBIT
<b>Cause:</b>	<p>After initializing the pole position using track C/D, Hall signals or pole position identification routine, the zero mark was detected outside the permissible range. For distance-coded encoders, the test is carried out after passing 2 zero marks. Fine synchronization was not carried out.</p> <p>When initializing via track C/D (p0404) then it is checked whether the zero mark occurs in an angular range of +/-18 ° mechanical.</p> <p>When initializing via Hall sensors (p0404) or pole position identification (p1982) it is checked whether the zero mark occurs in an angular range of +/-60 ° electrical.</p> <p>Fault value (r0949, interpret hexadecimal):</p> <p>yyyyxxxx hex</p> <p>yyyy: Determined mechanical zero mark position (can only be used for track C/D).</p> <p>xxxx: Deviation of the zero mark from the expected position as electrical angle.</p> <p>Scaling: 32768 dec = 180 °</p> <p>See also: p0491 (Motor encoder fault response ENCODER)</p>
<b>Remedy:</b>	<ul style="list-style-type: none"> <li>- Check p0431 and, if necessary, correct (trigger via p1990 = 1 if necessary).</li> <li>- check that the encoder cables are routed in compliance with EMC.</li> <li>- check the plug connections</li> <li>- if the Hall sensor is used as an equivalent for track C/D, check the connection.</li> <li>- Check the connection of track C or D.</li> <li>- replace the encoder or encoder cable</li> </ul>
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE



<b>F31131 (N, A)</b>	<b>Encoder 1: Deviation position incremental/absolute too large</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	ENCODER (IASC/DCBRK, NONE, OFF1, OFF2, OFF3, STOP1, STOP2)
<b>Acknowledge:</b>	PULSE INHIBIT
<b>Cause:</b>	<p>Absolute encoder:</p> <p>When cyclically reading the absolute position, an excessively high difference to the incremental position was detected. The absolute position that was read is rejected.</p> <p>Limit value for the deviation:</p> <ul style="list-style-type: none"> <li>- EnDat encoder: Is supplied from the encoder and is a minimum of 2 quadrants (e.g. EQ1 1325 &gt; 2 quadrants, EQN 1325 &gt; 50 quadrants).</li> <li>- other encoders: 15 pulses = 60 quadrants.</li> </ul> <p>Incremental encoder:</p> <p>When the zero pulse is passed, a deviation in the incremental position was detected.</p> <p>For equidistant zero marks, the following applies:</p> <ul style="list-style-type: none"> <li>- The first zero mark passed supplies the reference point for all subsequent checks. The other zero marks must have n times the distance referred to the first zero mark.</li> </ul> <p>For distance-coded zero marks, the following applies:</p> <ul style="list-style-type: none"> <li>- the first zero mark pair supplies the reference point for all subsequent checks. The other zero mark pairs must have the expected distance to the first zero mark pair.</li> </ul> <p>Fault value (r0949, interpret decimal):</p> <p>Deviation in quadrants (1 pulse = 4 quadrants).</p> <p>See also: p0491 (Motor encoder fault response ENCODER)</p>
<b>Remedy:</b>	<ul style="list-style-type: none"> <li>- check that the encoder cables are routed in compliance with EMC.</li> <li>- check the plug connections</li> <li>- replace the encoder or encoder cable</li> <li>- check whether the coding disk is dirty or there are strong ambient magnetic fields.</li> <li>- adapt the parameter for the clearance between zero marks (p0425).</li> <li>- if message output above speed threshold, reduce filter time if necessary (p0438).</li> </ul>
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE
<b>F31135</b>	<b>Encoder 1: Fault when determining the position</b>
<b>Message value:</b>	Fault cause: %1 bin
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	ENCODER (IASC/DCBRK, NONE)
<b>Acknowledge:</b>	PULSE INHIBIT
<b>Cause:</b>	<p>The encoder supplies status information bit by bit in an internal status/fault word.</p> <p>Some of these bits cause this fault to be triggered. Other bits are status displays. The status/fault word is displayed in the fault value.</p> <p>Note regarding the bit designation:</p> <p>The first designation is valid for DRIVE-CLiQ encoders, the second for EnDat 2.2 encoders.</p> <p>Fault value (r0949, interpret binary):</p> <ul style="list-style-type: none"> <li>Bit 0: F1 (safety status display).</li> <li>Bit 1: F2 (safety status display).</li> <li>Bit 2: Reserved (lighting).</li> <li>Bit 3: Reserved (signal amplitude).</li> <li>Bit 4: Reserved (position value).</li> <li>Bit 5: Reserved (overvoltage).</li> <li>Bit 6: Reserved (undervoltage)/hardware fault EnDat supply (--&gt; F3x110, x = 1, 2, 3).</li> <li>Bit 7: Reserved (overcurrent)/EnDat encoder withdrawn when not in the parked state (--&gt; F3x110, x = 1, 2, 3).</li> <li>Bit 8: Reserved (battery)/overcurrent EnDat supply (--&gt; F3x110, x = 1, 2, 3).</li> <li>Bit 9: Reserved/overvoltage EnDat supply (--&gt; F3x110, x = 1, 2, 3).</li> <li>Bit 11: Reserved/internal communication error (--&gt; F3x110, x = 1, 2, 3).</li> <li>Bit 12: Reserved/internal communication error (--&gt; F3x110, x = 1, 2, 3).</li> <li>Bit 13: Reserved/internal communication error (--&gt; F3x110, x = 1, 2, 3).</li> <li>Bit 14: Reserved/internal communication error (--&gt; F3x110, x = 1, 2, 3).</li> <li>Bit 15: Internal communication error (--&gt; F3x110, x = 1, 2, 3).</li> </ul>

Bit 16: Lighting (--> F3x135, x = 1, 2, 3).  
 Bit 17: Signal amplitude (--> F3x135, x = 1, 2, 3).  
 Bit 18: Singleturn position 1 (--> F3x135, x = 1, 2, 3).  
 Bit 19: Overvoltage (--> F3x135, x = 1, 2, 3).  
 Bit 20: Undervoltage (--> F3x135, x = 1, 2, 3).  
 Bit 21: Overcurrent (--> F3x135, x = 1, 2, 3).  
 Bit 22: Temperature exceeded (--> F3x405, x = 1, 2, 3).  
 Bit 23: Singleturn position 2 (safety status display).  
 Bit 24: Singleturn system (--> F3x135, x = 1, 2, 3).  
 Bit 25: Singleturn power down (--> F3x135, x = 1, 2, 3).  
 Bit 26: Multiturn position 1 (--> F3x136, x = 1, 2, 3).  
 Bit 27: Multiturn position 2 (--> F3x136, x = 1, 2, 3).  
 Bit 28: Multiturn system (--> F3x136, x = 1, 2, 3).  
 Bit 29: Multiturn power down (--> F3x136, x = 1, 2, 3).  
 Bit 30: Multiturn overflow/underflow (--> F3x136, x = 1, 2, 3).  
 Bit 31: Multiturn battery (reserved).

**Remedy:** - determine the detailed cause of the fault using the fault value.  
 - replace the encoder if necessary.

**Note:**

An EnDat 2.2 encoder may only be removed and inserted in the "Park" state.

If an EnDat 2.2 encoder was removed when not in the "Park" state, then after inserting the encoder, a POWER ON (switch-off/on) is necessary to acknowledge the fault.

### F31136

### Encoder 1: Error when determining multiturn information

**Message value:** Fault cause: %1 bin

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** ENCODER (IASC/DCBRK, NONE)

**Acknowledge:** PULSE INHIBIT

**Cause:**

The encoder supplies status information bit by bit in an internal status/fault word.

Some of these bits cause this fault to be triggered. Other bits are status displays. The status/fault word is displayed in the fault value.

**Note regarding the bit designation:**

The first designation is valid for DRIVE-CLiQ encoders, the second for EnDat 2.2 encoders.

**Fault value (r0949, interpret binary):**

Bit 0: F1 (safety status display).

Bit 1: F2 (safety status display).

Bit 2: Reserved (lighting).

Bit 3: Reserved (signal amplitude).

Bit 4: Reserved (position value).

Bit 5: Reserved (overvoltage).

Bit 6: Reserved (undervoltage)/hardware fault EnDat supply (--> F3x110, x = 1, 2, 3).

Bit 7: Reserved (overcurrent)/EnDat encoder withdrawn when not in the parked state (--> F3x110, x = 1, 2, 3).

Bit 8: Reserved (battery)/overcurrent EnDat supply (--> F3x110, x = 1, 2, 3).

Bit 9: Reserved/overvoltage EnDat supply (--> F3x110, x = 1, 2, 3).

Bit 11: Reserved/internal communication error (--> F3x110, x = 1, 2, 3).

Bit 12: Reserved/internal communication error (--> F3x110, x = 1, 2, 3).

Bit 13: Reserved/internal communication error (--> F3x110, x = 1, 2, 3).

Bit 14: Reserved/internal communication error (--> F3x110, x = 1, 2, 3).

Bit 15: Internal communication error (--> F3x110, x = 1, 2, 3).

Bit 16: Lighting (--> F3x135, x = 1, 2, 3).

Bit 17: Signal amplitude (--> F3x135, x = 1, 2, 3).

Bit 18: Singleturn position 1 (--> F3x135, x = 1, 2, 3).

Bit 19: Overvoltage (--> F3x135, x = 1, 2, 3).

Bit 20: Undervoltage (--> F3x135, x = 1, 2, 3).

Bit 21: Overcurrent (--> F3x135, x = 1, 2, 3).

Bit 22: Temperature exceeded (--> F3x405, x = 1, 2, 3).

Bit 23: Singleturn position 2 (safety status display).

Bit 24: Singleturn system (--> F3x135, x = 1, 2, 3).

Bit 25: Singleturn power down (--> F3x135, x = 1, 2, 3).

Bit 26: Multiturn position 1 (--> F3x136, x = 1, 2, 3).

Bit 27: Multiturn position 2 (--> F3x136, x = 1, 2, 3).

Bit 28: Multiturn system (--> F3x136, x = 1, 2, 3).

Bit 29: Multiturn power down (--> F3x136, x = 1, 2, 3).  
 Bit 30: Multiturn overflow/underflow (--> F3x136, x = 1, 2, 3).  
 Bit 31: Multiturn battery (reserved).

**Remedy:**

- determine the detailed cause of the fault using the fault value.
- replace the encoder if necessary.

Note:

An EnDat 2.2 encoder may only be removed and inserted in the "Park" state.

If an EnDat 2.2 encoder was removed when not in the "Park" state, then after inserting the encoder, a POWER ON (switch-off/on) is necessary to acknowledge the fault.

---

### **F31137 Encoder 1: Internal fault when determining the position**

**Message value:** Fault cause: %1 bin

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** ENCODER (IASC/DCBRK, NONE)

**Acknowledge:** PULSE INHIBIT

**Cause:** A position determination fault has occurred in the DRIVE-CLiQ encoder.

Fault value (r0949, interpret binary):

yyxxxxxx hex: yy = encoder version, xxxxxx = bit coding of the fault cause

For yy = 08 hex (bit 27 = 1), the following bit definition applies:

Bit 0: Control range of the transmit current control has been exited.

Bit 1: Amplitude fault.

Bit 2: Temperature outside the thresholds.

Bit 3: Synchronization fault, counter/interpolator.

Bit 4: Configuration error.

Bit 5: Conversion time of the interpolator fallen below.

Bit 6: Error when reading out the absolute value.

Bit 7: Externally signaled fault.

Bit 8: F1 (safety status display).

Bit 9: F2 (safety status display).

Bit 16: Transmit current fault.

Bit 17: Error multiturn interface

Bit 18: Internal data error (single-step error).

Bit 19: Error EEPROM interface.

Bit 20: SAR converter error.

Bit 21: Error, internal register data transfer.

Bit 22: External fault.

Bit 23: Temperature signal.

Note:

For an encoder version that is not described here, please contact the encoder manufacturer for more detailed information on the bit coding.

**Remedy:**

- determine the detailed cause of the fault using the fault value.
- if required, replace the DRIVE-CLiQ encoder.

---

### **F31138 Encoder 1: Internal error when determining multiturn information**

**Message value:** Fault cause: %1 bin

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** ENCODER (IASC/DCBRK, NONE)

**Acknowledge:** PULSE INHIBIT

**Cause:** A position determination fault has occurred in the DRIVE-CLiQ encoder.

Fault value (r0949, interpret binary):

yyxxxxxx hex: yy = encoder version, xxxxxx = bit coding of the fault cause

For yy = 08 hex (bit 27 = 1), the following bit definition applies:

Bit 0: Control range of the transmit current control has been exited.

Bit 1: Amplitude fault.

Bit 2: Temperature outside the thresholds.

Bit 3: Synchronization fault, counter/interpolator.

Bit 4: Configuration error.

Bit 5: Conversion time of the interpolator fallen below.

Bit 6: Error when reading out the absolute value.

Bit 7: Externally signaled fault.

Bit 8: F1 (safety status display).

Bit 9: F2 (safety status display).  
 Bit 16: Transmit current fault.  
 Bit 17: Error multiturn interface  
 Bit 18: Internal data error (single-step error).  
 Bit 19: Error EEPROM interface.  
 Bit 20: SAR converter error.  
 Bit 21: Error, internal register data transfer.  
 Bit 22: External fault.  
 Bit 23: Temperature signal.

**Note:**

For an encoder version that is not described here, please contact the encoder manufacturer for more detailed information on the bit coding.

**Remedy:**

- determine the detailed cause of the fault using the fault value.
- if required, replace the DRIVE-CLiQ encoder.

---

**F31150 (N, A) Encoder 1: Initialization error**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** ENCODER (IASC/DCBRK, NONE, OFF1, OFF2, OFF3, STOP1, STOP2)  
**Acknowledge:** PULSE INHIBIT  
**Cause:** Encoder functionality selected in p0404 is not operating correctly.  
 Fault value (r0949, interpret hexadecimal):  
 Encoder malfunction.  
 The bit assignment corresponds to that of p0404 (e.g. bit 5 set: Error track C/D).  
 See also: p0404 (Encoder configuration effective), p0491 (Motor encoder fault response ENCODER)

**Remedy:**

- Check that p0404 is correctly set.
- check the encoder type used (incremental/absolute) and for SMCxx, the encoder cable.
- if relevant, note additional fault messages that describe the fault in detail.

Reaction upon N: NONE  
 Acknowl. upon N: NONE  
 Reaction upon A: NONE  
 Acknowl. upon A: NONE

---

**F31151 (N, A) Encoder 1: Encoder speed for initialization AB too high**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** ENCODER (IASC/DCBRK, NONE, OFF1, OFF2, OFF3, STOP1, STOP2)  
**Acknowledge:** PULSE INHIBIT  
**Cause:** The encoder speed is too high during while initializing the sensor.  
**Remedy:** Reduce the speed of the encoder accordingly during initialization.  
 If necessary, de-activate monitoring (p0437.29).  
 See also: p0437 (Sensor Module configuration extended)

Reaction upon N: NONE  
 Acknowl. upon N: NONE  
 Reaction upon A: NONE  
 Acknowl. upon A: NONE

---

**F31152 (N, A) Encoder 1: Maximum input frequency exceeded**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** ENCODER (IASC/DCBRK, NONE, OFF1, OFF2, OFF3, STOP1, STOP2)  
**Acknowledge:** PULSE INHIBIT  
**Cause:** The maximum input frequency of the encoder evaluation has been exceeded.  
 Fault value (r0949, interpret decimal):  
 Actual input frequency in Hz.  
 See also: p0408 (Rotary encoder pulse number)

**Remedy:**

- Reduce the speed.
- Use an encoder with a lower pulse number (p0408).

Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

**F31160 (N, A) Encoder 1: Analog sensor channel A failed**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** ENCODER (IASC/DCBRK, NONE)  
**Acknowledge:** PULSE INHIBIT  
**Cause:** The input voltage of the analog sensor is outside the permissible limits.  
Fault value (r0949, interpret decimal):  
1: Input voltage outside detectable measuring range.  
2: Input voltage outside the measuring range set in (p4673).  
3: The absolute value of the input voltage has exceeded the range limit (p4676).  
**Remedy:** For fault value = 1:  
- check the output voltage of the analog sensor.  
For fault value = 2:  
- check the voltage setting for each encoder period (p4673).  
For fault value = 3:  
- check the range limit setting and increase it if necessary (p4676).  
Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

**F31161 (N, A) Encoder 1: Analog sensor channel B failed**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** ENCODER (IASC/DCBRK, NONE)  
**Acknowledge:** PULSE INHIBIT  
**Cause:** The input voltage of the analog sensor is outside the permissible limits.  
Fault value (r0949, interpret decimal):  
1: Input voltage outside detectable measuring range.  
2: Input voltage outside the measuring range set in (p4675).  
3: The absolute value of the input voltage has exceeded the range limit (p4676).  
**Remedy:** For fault value = 1:  
- check the output voltage of the analog sensor.  
For fault value = 2:  
- check the voltage setting for each encoder period (p4675).  
For fault value = 3:  
- check the range limit setting and increase it if necessary (p4676).  
Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

**F31163 (N, A) Encoder 1: Analog sensor position value exceeds limit value**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** ENCODER (IASC/DCBRK, NONE)  
**Acknowledge:** PULSE INHIBIT  
**Cause:** The position value has exceeded the permissible range of -0.5 ... +0.5.  
Fault value (r0949, interpret decimal):  
1: Position value from the LVDT sensor.  
2: Position value from the encoder characteristic.

**Remedy:** For fault value = 1:  
 - Check the LVDT ratio (p4678).  
 - check the reference signal connection at track B.  
 For fault value = 2:  
 - check the coefficients of the characteristic (p4663 ... p4666).

Reaction upon N: NONE  
 Acknowl. upon N: NONE  
 Reaction upon A: NONE  
 Acknowl. upon A: NONE

---

**A31400 (F, N) Encoder 1: Alarm threshold zero mark distance error**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The measured zero mark distance does not correspond to the parameterized zero mark distance.  
 For distance-coded encoders, the zero mark distance is determined from zero marks detected pairs. This means that if a zero mark is missing, depending on the pair generation, this cannot result in a fault and also has no effect in the system.  
 The zero mark distance for the zero mark monitoring is set in p0425 (rotary encoder) or p0424 (linear encoder).  
 Alarm value (r2124, interpret decimal):  
 Last measured zero mark distance in increments (4 increments = 1 encoder pulse).  
 The sign designates the direction of motion when detecting the zero mark distance.

**Remedy:** - check that the encoder cables are routed in compliance with EMC.  
 - check the plug connections  
 . check the encoder type (encoder with equidistant zero marks).  
 - adapt the parameter for the distance between zero marks (p0424, p0425).  
 - replace the encoder or encoder cable

Reaction upon F: NONE (ENCODER, IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)  
 Acknowl. upon F: IMMEDIATELY  
 Reaction upon N: NONE  
 Acknowl. upon N: NONE

---

**A31401 (F, N) Encoder 1: Alarm threshold zero mark failed**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The 1.5 x parameterized zero mark distance was exceeded.  
 The zero mark distance for the zero mark monitoring is set in p0425 (rotary encoder) or p0424 (linear encoder).  
 Alarm value (r2124, interpret decimal):  
 Number of increments after POWER ON or since the last zero mark that was detected (4 increments = 1 encoder pulse).

**Remedy:** - check that the encoder cables are routed in compliance with EMC.  
 - check the plug connections  
 . check the encoder type (encoder with equidistant zero marks).  
 - adapt the parameter for the clearance between zero marks (p0425).  
 - replace the encoder or encoder cable

Reaction upon F: NONE (ENCODER, IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)  
 Acknowl. upon F: IMMEDIATELY  
 Reaction upon N: NONE  
 Acknowl. upon N: NONE

---

<b>F31405 (N, A)</b>	<b>Encoder 1: Temperature in the encoder evaluation inadmissible</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	ENCODER (IASC/DCBRK, NONE, OFF1, OFF2, OFF3, STOP1, STOP2)
<b>Acknowledge:</b>	IMMEDIATELY (POWER ON)
<b>Cause:</b>	The encoder evaluation for a motor with DRIVE-CLiQ has detected an inadmissible temperature. The fault threshold is 125 ° C. Alarm value (r2124, interpret decimal): Measured board/module temperature in 0.1 °C.
<b>Remedy:</b>	Reduce the ambient temperature for the DRIVE-CLiQ connection of the motor.
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE

---

<b>A31407 (F, N)</b>	<b>Encoder 1: Function limit reached</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	The encoder has reached one of its function limits. A service is recommended. Alarm value (r2124, interpret decimal): 1 : Incremental signals 3 : Absolute track 4 : Code connection
<b>Remedy:</b>	Perform service. Replace the encoder if necessary. Note: The actual functional reserve of an encoder can be displayed via r4651. See also: p4650 (Encoder functional reserve component number), r4651 (Encoder functional reserve)
Reaction upon F:	NONE (ENCODER, IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)
Acknowl. upon F:	IMMEDIATELY
Reaction upon N:	NONE
Acknowl. upon N:	NONE

---

<b>A31410 (F, N)</b>	<b>Encoder 1: Serial communications</b>
<b>Message value:</b>	Fault cause: %1 bin
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	Serial communication protocol transfer error between the encoder and evaluation module. Alarm value (r2124, interpret binary): Bit 0: Alarm bit in the position protocol. Bit 1: Incorrect quiescent level on the data line. Bit 2: Encoder does not respond (does not supply a start bit within 50 ms). Bit 3: CRC error: The checksum in the protocol from the encoder does not match the data. Bit 4: Encoder acknowledgement error: The encoder incorrectly understood the task (request) or cannot execute it. Bit 5: Internal error in the serial driver: An illegal mode command was requested. Bit 6: Timeout when cyclically reading. Bit 8: Protocol is too long (e.g. > 64 bits). Bit 9: Receive buffer overflow. Bit 10: Frame error when reading twice. Bit 11: Parity error. Bit 12: Data line signal level error during the monoflop time.
<b>Remedy:</b>	- check that the encoder cables are routed in compliance with EMC. - check the plug connections - replace encoder.

---

Reaction upon F: NONE (ENCODER, IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)  
 Acknowl. upon F: IMMEDIATELY  
 Reaction upon N: NONE  
 Acknowl. upon N: NONE

---

**A31411 (F, N) Encoder 1: Absolute encoder signals internal alarms**

**Message value:** Fault cause: %1 bin, additional information: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The absolute encoder fault word includes alarm bits that have been set.  
 Alarm value (r2124, interpret binary):  
 yyyyxxxx hex: yyyy = supplementary information, xxxx = fault cause  
 yyyy = 0:  
 Bit 0: Frequency exceeded (speed too high).  
 Bit 1: Temperature exceeded.  
 Bit 2: Control reserve, lighting system exceeded.  
 Bit 3: Battery discharged.  
 Bit 4: Reference point passed.  
 yyyy = 1:  
 Bit 0: Signal amplitude outside the control range.  
 Bit 1: Error multiturn interface  
 Bit 2: Internal data error (singleturn/multiturn not with single steps).  
 Bit 3: Error EEPROM interface.  
 Bit 4: SAR\_converter error.  
 Bit 5: Fault for the register data transfer.  
 Bit 6: Internal error identified at the error pin (nErr).  
 Bit 7: Temperature threshold exceeded or fallen below.  
 See also: p0491 (Motor encoder fault response ENCODER)  
**Remedy:** Replace encoder.  
 Reaction upon F: NONE (ENCODER, IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)  
 Acknowl. upon F: IMMEDIATELY  
 Reaction upon N: NONE  
 Acknowl. upon N: NONE

---

**A31412 (F, N) Encoder 1: Error bit set in the serial protocol**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The encoder sends a set error bit via the serial protocol.  
 Alarm value (r2124, interpret binary):  
 Bit 0: Fault bit in the position protocol.  
 Bit 1: Alarm bit in the position protocol.  
**Remedy:**  
 - carry out a POWER ON (power off/on) for all components.  
 - check that the encoder cables are routed in compliance with EMC.  
 - check the plug connections  
 - replace encoder.  
 Reaction upon F: NONE (ENCODER, IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)  
 Acknowl. upon F: IMMEDIATELY  
 Reaction upon N: NONE  
 Acknowl. upon N: NONE



<b>A31414 (F, N)</b>	<b>Encoder 1: Amplitude error track C or D (<math>C^2 + D^2</math>)</b>
<b>Message value:</b>	C track: %1, D track: %2
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>The amplitude (<math>C^2 + D^2</math>) of track C or D of the encoder or from the Hall signals, is not within the tolerance bandwidth.</p> <p>Alarm value (r2124, interpret hexadecimal):            yyyxxxx hex:            yyyy = Signal level, track D (16 bits with sign).            xxxx = Signal level, track C (16 bits with sign).            The nominal signal level of the encoder must lie in the range 375 mV to 600 mV (500 mV -25/+20 %).            The response thresholds are &lt; 230 mV (observe the frequency response of the encoder) and &gt; 750 mV.            A signal level of 500 mV peak value corresponds to the numerical value 5333 hex = 21299 dec.</p> <p>Note:            If the amplitude is not within the tolerance bandwidth, then it cannot be used to initialize the start position.</p>
<b>Remedy:</b>	<ul style="list-style-type: none"> <li>- check that the encoder cables are routed in compliance with EMC.</li> <li>- check the plug connections</li> <li>- replace the encoder or encoder cable</li> <li>- check the Sensor Module (e.g. contacts).</li> <li>- check the Hall sensor box</li> </ul>
Reaction upon F:	NONE (ENCODER, IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)
Acknowl. upon F:	IMMEDIATELY
Reaction upon N:	NONE
Acknowl. upon N:	NONE
<b>N31415 (F, A)</b>	<b>Encoder 1: Amplitude alarm track A or B (<math>A^2 + B^2</math>)</b>
<b>Message value:</b>	Amplitude: %1, Angle: %2
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>The amplitude (root of <math>A^2 + B^2</math>) for encoder 1 exceeds the permissible tolerance.</p> <p>Alarm value (r2124, interpret hexadecimal):            yyyxxxx hex:            yyyy = Angle            xxxx = Amplitude, i.e. root from <math>A^2 + B^2</math> (16 bits without sign)</p> <p>The nominal signal level of the encoder must lie in the range 375 mV to 600 mV (500 mV -25/+20 %).            The response threshold is &lt; 230 mV (observe the frequency response of the encoder).            A signal level of 500 mV peak value corresponds to the numerical value 299A hex = 10650 dec.            The angle 0 ... FFFF hex corresponds to 0 ... 360 degrees of the fine position. Zero degrees is present at the negative zero crossover of track B.</p> <p>Note for sensors modules for resolvers (e. g. SMC10):            The nominal signal level is at 2900 mV (2.0 Vrms). The response threshold is &lt; 1414 mV (1.0 Vrms).            A signal level of 2900 mV peak value corresponds to the numerical value 3333 hex = 13107 dec.</p> <p>Note:            The analog values of the amplitude error are not measured at the same time with the hardware fault output by the Sensor Module.            See also: p0491 (Motor encoder fault response ENCODER)</p>
<b>Remedy:</b>	<ul style="list-style-type: none"> <li>- check the speed range, frequency characteristic (amplitude characteristic) of the measuring equipment is not sufficient for the speed range.</li> <li>- check that the encoder cables and shielding are routed in compliance with EMC.</li> <li>- check the plug connections</li> <li>- replace the encoder or encoder cable</li> <li>- check the Sensor Module (e.g. contacts).</li> <li>- if the coding disk is soiled or the lighting aged, replace the encoder.</li> </ul>
Reaction upon F:	NONE (ENCODER, IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)
Acknowl. upon F:	IMMEDIATELY
Reaction upon A:	NONE
Acknowl. upon A:	NONE

<b>A31418 (F, N)</b>	<b>Encoder 1: Speed difference per sampling rate exceeded</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	For an HTL/TTL encoder, the speed difference between two sampling cycles has exceeded the value in p0492. The change to the averaged speed actual value - if applicable - is monitored in the current controller sampling time. Alarm value (r2124, interpret decimal): Only for internal Siemens troubleshooting. See also: p0492 (Square-wave encoder maximum speed difference per sampling cycle)
<b>Remedy:</b>	- check the tachometer feeder cable for interruptions. - check the grounding of the tachometer shielding. - if required, increase the setting of p0492.
Reaction upon F:	NONE (IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)
Acknowl. upon F:	IMMEDIATELY
Reaction upon N:	NONE
Acknowl. upon N:	NONE
<b>A31419 (F, N)</b>	<b>Encoder 1: Track A or B outside tolerance</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	The amplitude/phase/offset correction for track A or B is at the limit. Amplitude error correction: Amplitude B / Amplitude A = 0.78 ... 1.27 Phase: <84 degrees or >96 degrees SMC20: Offset correction: +/-140 mV SMC10: Offset correction: +/-650 mV Alarm value (r2124, interpret hexadecimal): xxxx1: Minimum of the offset correction, track B xxxx2: Maximum of the offset correction, track B xxx1x: Minimum of the offset correction, track A xxx2x: Maximum of the offset correction, track A xx1xx: Minimum of the amplitude correction, track B/A xx2xx: Maximum of the amplitude correction, track B/A x1xxx: Minimum of the phase error correction x2xxx: Maximum of the phase error correction 1xxxx: Minimum of the cubic correction 2xxxx: Maximum of the cubic correction See also: p0491 (Motor encoder fault response ENCODER)
<b>Remedy:</b>	- check mechanical mounting tolerances for encoders without their own bearings (e.g. toothed-wheel encoders). - check the plug connections (also the transition resistance). - check the encoder signals. - replace the encoder or encoder cable
Reaction upon F:	NONE (ENCODER, IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)
Acknowl. upon F:	IMMEDIATELY
Reaction upon N:	NONE
Acknowl. upon N:	NONE
<b>A31421 (F, N)</b>	<b>Encoder 1: Coarse position error</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	For the actual value sensing, an error was detected. As a result of this error, it must be assumed that the actual value sensing supplies an incorrect coarse position.

Alarm value (r2124, interpret decimal):

3: The absolute position of the serial protocol and track A/B differ by half an encoder pulse. The absolute position must have its zero position in the quadrants in which both tracks are negative. In the case of a fault, the position can be incorrect by one encoder pulse.

**Remedy:**

Re alarm value = 3:

- For a standard encoder with cable, contact the manufacturer where relevant.
- correct the assignment of the tracks to the position value that is serially transferred. To do this, the two tracks must be connected, inverted, at the Sensor Module (interchange A with A\* and B with B\*) or, for a programmable encoder, check the zero offset of the position.

Reaction upon F: NONE (ENCODER, IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)

Acknowl. upon F: IMMEDIATELY

Reaction upon N: NONE

Acknowl. upon N: NONE

---

**A31422 (F, N) Encoder 1: Pulses per revolution square-wave encoder outside tolerance bandwidth**

**Message value:** %1

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** NONE

**Acknowledge:** NONE

**Cause:** The measured zero mark distance does not correspond to the parameterized zero mark distance.  
This alarm is triggered with active square-wave encoder PPR correction and re-parameterized fault 31131 if the accumulator contains larger values than p4683 or p4684.  
The zero mark distance for zero mark monitoring is set in p0425 (rotary encoder).

Alarm value (r2124, interpret decimal):

accumulated differential pulses in encoder pulses.

See also: p0491 (Motor encoder fault response ENCODER)

**Remedy:**

- check that the encoder cables are routed in compliance with EMC.
- check the plug connections
- check the encoder type (encoder with equidistant zero marks).
- adapt the parameter for the distance between zero marks (p0424, p0425).
- replace the encoder or encoder cable

Reaction upon F: NONE (ENCODER, IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)

Acknowl. upon F: IMMEDIATELY

Reaction upon N: NONE

Acknowl. upon N: NONE

---

**A31429 (F, N) Encoder 1: Position difference hall sensor/track C/D and A/B too large**

**Message value:** %1

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** NONE

**Acknowledge:** NONE

**Cause:** The error for track C/D is greater than +/-15 ° mechanical or +/-60 ° electrical or the error for the Hall signals is greater than +/-60 ° electrical.

One period of track C/D corresponds to 360 ° mechanical.

One period of the Hall signal corresponds to 360 ° electrical.

The monitoring responds if, for example, Hall sensors are connected as equivalent for the C/D tracks with the incorrect rotational sense or supply values that are not accurate enough.

Alarm value (r2124, interpret decimal):

For track C/D, the following applies:

Measured deviation as mechanical angle (16 bits with sign, 182 dec corresponds to 1 °).

For Hall signals, the following applies:

Measured deviation as electrical angle (16 bits with sign, 182 dec corresponds to 1 °).

See also: p0491 (Motor encoder fault response ENCODER)

**Remedy:**

- track C or D not connected.
- correct the direction of rotation of the Hall sensor possibly connected as equivalent for track C/D.
- check that the encoder cables are routed in compliance with EMC.
- check the adjustment of the Hall sensor.

Reaction upon F: NONE (ENCODER, IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)

Acknowl. upon F: IMMEDIATELY

Reaction upon N: NONE  
Acknowl. upon N: NONE

---

<b>A31431 (F, N)</b>	<b>Encoder 1: Deviation position incremental/absolute too large</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>When the zero pulse is passed, a deviation in the incremental position was detected.</p> <p>For equidistant zero marks, the following applies:</p> <ul style="list-style-type: none"> <li>- The first zero mark passed supplies the reference point for all subsequent checks. The other zero marks must have n times the distance referred to the first zero mark.</li> </ul> <p>For distance-coded zero marks, the following applies:</p> <ul style="list-style-type: none"> <li>- the first zero mark pair supplies the reference point for all subsequent checks. The other zero mark pairs must have the expected distance to the first zero mark pair.</li> </ul> <p>Alarm value (r2124, interpret decimal):</p> <p>Deviation in quadrants (1 pulse = 4 quadrants).</p> <p>See also: p0491 (Motor encoder fault response ENCODER)</p>
<b>Remedy:</b>	<ul style="list-style-type: none"> <li>- check that the encoder cables are routed in compliance with EMC.</li> <li>- check the plug connections</li> <li>- replace the encoder or encoder cable</li> <li>- Clean coding disk or remove strong magnetic fields.</li> </ul>
Reaction upon F:	NONE (ENCODER, IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)
Acknowl. upon F:	IMMEDIATELY
Reaction upon N:	NONE
Acknowl. upon N:	NONE

---

<b>A31432 (F, N)</b>	<b>Encoder 1: Rotor position adaptation corrects deviation</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>For track A/B, pulses have been lost or too many have been counted. These pulses are presently being corrected.</p> <p>Alarm value (r2124, interpret decimal):</p> <p>Last measured deviation of zero mark in increments (4 increments = 1 encoder pulse).</p> <p>The sign designates the direction of motion when detecting the zero mark distance.</p>
<b>Remedy:</b>	<ul style="list-style-type: none"> <li>- check that the encoder cables are routed in compliance with EMC.</li> <li>- check the plug connections</li> <li>- replace the encoder or encoder cable</li> <li>- check encoder limit frequency.</li> <li>- adapt the parameter for the distance between zero marks (p0424, p0425).</li> </ul>
Reaction upon F:	NONE (ENCODER, IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)
Acknowl. upon F:	IMMEDIATELY
Reaction upon N:	NONE
Acknowl. upon N:	NONE

---

<b>A31442 (F, N)</b>	<b>Encoder 1: Battery voltage pre-alarm</b>
<b>Message value:</b>	-
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	When switched-off, the encoder uses a battery to back up the multiturn information. The battery voltage is no longer sufficient to check the multiturn information.
<b>Remedy:</b>	Replace battery.
Reaction upon F:	NONE (ENCODER, IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)
Acknowl. upon F:	IMMEDIATELY

Reaction upon N: NONE  
Acknowl. upon N: NONE

---

**A31443 (F, N) Encoder 1: Unipolar CD signal level outside specification**

**Message value:** Fault cause: %1 bin  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The unipolar level (CP/CN or DP/DN) for encoder 1 is outside the permissible tolerance.  
Alarm value (r2124, interpret binary):  
Bit 0 = 1: Either CP or CN outside the tolerance.  
Bit 16 = 1: Either DP or DN outside the tolerance.  
The unipolar nominal signal level of the encoder must lie in the range 2500 mV +/- 500 mV.  
The response thresholds are < 1700 mV and > 3300 mV.  
Note:  
The signal level is not evaluated unless the following conditions are satisfied:  
- Sensor Module properties available (r0459.31 = 1).  
- Monitoring active (p0437.31 = 1).  
See also: p0491 (Motor encoder fault response ENCODER)  
**Remedy:**  
- check that the encoder cables and shielding are routed in compliance with EMC.  
- check the plug connections and contacts of the encoder cable.  
- are the C/D tracks connected correctly (have the signal lines CP and CN or DP and DN been interchanged)?  
- replace the encoder cable.  
Reaction upon F: NONE (ENCODER, IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)  
Acknowl. upon F: IMMEDIATELY  
Reaction upon N: NONE  
Acknowl. upon N: NONE

---

**A31460 (N) Encoder 1: Analog sensor channel A failed**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The input voltage of the analog sensor is outside the permissible limits.  
Alarm value (r2124, interpret decimal):  
1: Input voltage outside detectable measuring range.  
2: Input voltage outside measuring range set in p4673.  
3: The absolute value of the input voltage has exceeded the range limit (p4676).  
**Remedy:**  
Re alarm value = 1:  
- check the output voltage of the analog sensor.  
Re alarm value = 2:  
- check the voltage setting for each encoder period (p4673).  
Re alarm value = 3:  
- check the range limit setting and increase it if necessary (p4676).  
Reaction upon N: NONE  
Acknowl. upon N: NONE

---

**A31461 (N) Encoder 1: Analog sensor channel B failed**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The input voltage of the analog sensor is outside the permissible limits.  
Alarm value (r2124, interpret decimal):  
1: Input voltage outside detectable measuring range.  
2: Input voltage outside the measuring range set in (p4675).  
3: The absolute value of the input voltage has exceeded the range limit (p4676).

**Remedy:**

Re alarm value = 1:  
 - check the output voltage of the analog sensor.  
 Re alarm value = 2:  
 - check the voltage setting for each encoder period (p4675).  
 Re alarm value = 3:  
 - check the range limit setting and increase it if necessary (p4676).

Reaction upon N: NONE

Acknowl. upon N: NONE

---

**A31462 (N) Encoder 1: Analog sensor no channel active**

**Message value:** %1

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** NONE

**Acknowledge:** NONE

**Cause:** Channel A and B are not activated for the analog sensor.

**Remedy:**

- activate channel A and/or channel B (p4670).  
 - check the encoder configuration (p0404.17).

Reaction upon N: NONE

Acknowl. upon N: NONE

---

**A31463 (N) Encoder 1: Analog sensor position value exceeds limit value**

**Message value:** %1

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** NONE

**Acknowledge:** NONE

**Cause:**

The position value has exceeded the permissible range of -0.5 ... +0.5.  
 Alarm value (r2124, interpret decimal):  
 1: Position value from the LVDT sensor.  
 2: Position value from the encoder characteristic.

**Remedy:**

Re alarm value = 1:  
 - Check the LVDT ratio (p4678).  
 - check the reference signal connection at track B.  
 Re alarm value = 2:  
 - check the coefficients of the characteristic (p4663 ... p4666).

Reaction upon N: NONE

Acknowl. upon N: NONE

---

**A31470 (F, N) Encoder 1: Soiling detected**

**Message value:** -

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** NONE

**Acknowledge:** NONE

**Cause:**

In the case of the alternative encoder system interface on the Sensor Module Cabinet 30 (SMC30), encoder soiling is signaled via a 0 signal at terminal X521.7.

**Remedy:**

- check the plug connections  
 - replace the encoder or encoder cable

Reaction upon F: NONE (ENCODER, IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)

Acknowl. upon F: IMMEDIATELY

Reaction upon N: NONE

Acknowl. upon N: NONE

<b>F31500 (N, A)</b>	<b>Encoder 1: Position tracking traversing range exceeded</b>
<b>Message value:</b>	-
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF1 (NONE, OFF2, OFF3)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	For a configured linear axis without modulo correction, the drive/encoder has exceeded the maximum possible traversing range. The value should be read in p0412 and interpreted as the number of motor revolutions. For p0411.0 = 1, the maximum traversing range for the configured linear axis is defined to be 64x (+/- 32x) of p0421. For p0411.3 = 1, the maximum traversing range for the configured linear axis is pre-set (default value) to the highest possible value and is +/-p0412/2 (rounded off to complete revolutions). The highest possible value depends on the pulse number (p0408) and the fine resolution (p0419).
<b>Remedy:</b>	The fault should be resolved as follows: - select encoder commissioning (p0010 = 4). - reset the position tracking as follows (p0411.2 = 1). - de-select encoder commissioning (p0010 = 0). The fault should then be acknowledged and the absolute encoder adjusted.
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE
<b>F31501 (N, A)</b>	<b>Encoder 1: Position tracking encoder position outside tolerance window</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF1 (NONE, OFF2, OFF3)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	When powered down, the drive/encoder was moved through a distance greater than was parameterized in the tolerance window. It is possible that there is no longer any reference between the mechanical system and encoder. Fault value (r0949, interpret decimal): Deviation (difference) to the last encoder position in increments of the absolute value. The sign designates the traversing direction. Note: The deviation (difference) found is also displayed in r0477. See also: p0413 (Measuring gear position tracking tolerance window), r0477 (Measuring gear position difference)
<b>Remedy:</b>	Reset the position tracking as follows: - select encoder commissioning (p0010 = 4). - reset the position tracking as follows (p0411.2 = 1). - de-select encoder commissioning (p0010 = 0). The fault should then be acknowledged and, if necessary, the absolute encoder adjusted (p2507). See also: p0010
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE
<b>F31502 (N, A)</b>	<b>Encoder 1: Encoder with measuring gear without valid signals</b>
<b>Message value:</b>	-
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF1 (OFF2, OFF3)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	The encoder with measuring gear no longer provides any valid signals.
<b>Remedy:</b>	It must be ensured that all of the encoders, with mounted measuring gear, provide valid actual values in operation.
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE

---

**F31503 (N, A) Encoder 1: Position tracking cannot be reset**

**Message value:** -

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** OFF1 (NONE, OFF2, OFF3)

**Acknowledge:** IMMEDIATELY

**Cause:** The position tracking for the measuring gear cannot be reset.

**Remedy:** The fault should be resolved as follows:  
 - select encoder commissioning (p0010 = 4).  
 - reset the position tracking as follows (p0411.2 = 1).  
 - de-select encoder commissioning (p0010 = 0).  
 The fault should then be acknowledged and the absolute encoder adjusted.

Reaction upon N: NONE

Acknowl. upon N: NONE

Reaction upon A: NONE

Acknowl. upon A: NONE

---

**A31700 Encoder 1: Effectivity test does not supply the expected value**

**Message value:** Fault cause: %1 bin

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** NONE

**Acknowledge:** NONE

**Cause:** The DRIVE-CLiQ encoder fault word supplies fault bits that have been set.  
 Fault value (r0949, interpret binary):  
 Bit x = 1: Effectivity test x unsuccessful.

**Remedy:** Replace encoder.

---

**N31800 (F) Encoder 1: Group signal**

**Message value:** -

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** ENCODER (IASC/DCBRK, NONE)

**Acknowledge:** NONE

**Cause:** The motor encoder has detected at least one fault.  
 See also: p0491 (Motor encoder fault response ENCODER)

**Remedy:** Evaluate the other messages that are presently available.

Reaction upon F: ENCODER (IASC/DCBRK, NONE)

Acknowl. upon F: IMMEDIATELY

---

**F31801 (N, A) Encoder 1 DRIVE-CLiQ: Sign-of-life missing**

**Message value:** Component number: %1, fault cause: %2

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** ENCODER (IASC/DCBRK, NONE)

**Acknowledge:** IMMEDIATELY

**Cause:** A DRIVE-CLiQ communication error has occurred from the Control Unit to the encoder involved.  
 Fault cause:  
 10 (= 0A hex):  
 The sign-of-life bit in the receive telegram is not set.  
 Note regarding the message value:  
 The individual information is coded as follows in the message value (r0949/r2124):  
 0000yyxx hex: yy = component number, xx = error cause  
 See also: p0491 (Motor encoder fault response ENCODER)

**Remedy:** - check the electrical cabinet design and cable routing for EMC compliance  
 - replace the component involved.  
 See also: p9916 (DRIVE-CLiQ data transfer error shutdown threshold slave)

Reaction upon N: NONE

Acknowl. upon N: NONE



Reaction upon A: NONE  
Acknowl. upon A: NONE

---

**F31802 (N, A) Encoder 1: Time slice overflow**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** ENCODER (IASC/DCBRK, NONE)  
**Acknowledge:** IMMEDIATELY  
**Cause:** A time slice overflow has occurred in encoder 1.  
Fault value (r0949, interpret hexadecimal):  
yx hex: y = function involved (Siemens-internal fault diagnostics), x = time slice involved  
x = 9:  
Time slice overflow of the fast (current controller clock cycle) time slice.  
x = A:  
Time slice overflow of the average time slice.  
x = C:  
Time slice overflow of the slow time slice.  
yx = 3E7:  
Timeout when waiting for SYNO (e.g. unexpected return to non-cyclic operation).  
See also: p0491 (Motor encoder fault response ENCODER)  
**Remedy:** Increase the current controller sampling time  
Note:  
For a current controller sampling time = 31.25 µs, use an SMx20 with order number 6SL3055-0AA00-5xA3.  
Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

**F31804 (N, A) Encoder 1: Checksum error**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** ENCODER (IASC/DCBRK, NONE)  
**Acknowledge:** POWER ON (IMMEDIATELY)  
**Cause:** A checksum error has occurred when reading-out the program memory on the Sensor Module.  
Fault value (r0949, interpret hexadecimal):  
yyyyxxxx hex  
yyyy: Memory area involved.  
xxxx: Difference between the checksum at POWER ON and the actual checksum.  
See also: p0491 (Motor encoder fault response ENCODER)  
**Remedy:**  
- carry out a POWER ON (power off/on).  
- upgrade firmware to later version (>= V2.6 HF3, >= V4.3 SP2, >= V4.4).  
- check whether the permissible ambient temperature for the component is maintained.  
- replace the Sensor Module.  
Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

**F31805 (N, A) Encoder 1: EPROM checksum error**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** ENCODER (IASC/DCBRK, NONE)  
**Acknowledge:** IMMEDIATELY  
**Cause:** Internal parameter data is corrupted.  
Fault value (r0949, interpret hexadecimal):  
01: EEPROM access error.  
02: Too many blocks in the EEPROM.  
See also: p0491 (Motor encoder fault response ENCODER)

**Remedy:** Replace the module.  
**Reaction upon N:** NONE  
**Acknowl. upon N:** NONE  
**Reaction upon A:** NONE  
**Acknowl. upon A:** NONE

---

**F31806 (N, A) Encoder 1: Initialization error**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** ENCODER (IASC/DCBRK, NONE)  
**Acknowledge:** PULSE INHIBIT  
**Cause:** The encoder was not successfully initialized.  
 Fault value (r0949, interpret hexadecimal):  
 Bit 0, 1: Encoder initialization with the motor rotating has failed (deviation involving coarse and fine position in encoder pulses/4).  
 Bit 2: Mid-voltage matching for track A unsuccessful.  
 Bit 3: Mid-voltage matching for track B unsuccessful.  
 Bit 4: Mid-voltage matching for acceleration input unsuccessful.  
 Bit 5: Mid-voltage matching for track safety A unsuccessful.  
 Bit 6: Mid-voltage matching for track safety B unsuccessful.  
 Bit 7: Mid-voltage matching for track C unsuccessful.  
 Bit 8: Mid-voltage matching for track D unsuccessful.  
 Bit 9: Mid-voltage matching for track R unsuccessful.  
 Bit 10: The difference in mid-voltages between A and B is too great (> 0.5 V)  
 Bit 11: The difference in mid-voltages between C and D is too great (> 0.5 V)  
 Bit 12: The difference in mid-voltages between safety A and safety B is too great (> 0.5 V)  
 Bit 13: The difference in mid-voltages between A and safety B is too great (> 0.5 V)  
 Bit 14: The difference in mid-voltages between B and safety A is too great (> 0.5 V)  
 Bit 15: The standard deviation of the calculated mid-voltages is too great (> 0.3 V)  
 Bit 16: Internal fault - fault when reading a register (CAFE)  
 Bit 17: Internal fault - fault when writing a register (CAFE)  
 Bit 18: Internal fault: No mid-voltage matching available  
 Bit 19: Internal error - ADC access error.  
 Bit 20: Internal error - no zero crossover found.  
 Bit 28: Error while initializing the EnDat 2.2 measuring unit.  
 Bit 29: Error when reading out the data from the EnDat 2.2 measuring unit.  
 Bit 30: EEPROM checksum of the EnDat 2.2 measuring unit incorrect.  
 Bit 31: Data of the EnDat 2.2 measuring unit inconsistent.  
**Note:**  
 Bit 0, 1: Up to 6SL3055-0AA00-5\*A0  
 Bits 2 ... 20: 6SL3055-0AA00-5\*A1 and higher  
 See also: p0491 (Motor encoder fault response ENCODER)  
**Remedy:** Acknowledge fault.  
 If the fault cannot be acknowledged:  
 Bits 2 ... 9: Check encoder power supply.  
 Bits 2 ... 14: Check the corresponding cable.  
 Bit 15 with no other bits: Check track R, check settings in p0404.  
 Bit 28: Check the cable between the EnDat 2.2 converter and the measuring unit.  
 Bit 29 ... 31: Replace the defective measuring unit.  
**Reaction upon N:** NONE  
**Acknowl. upon N:** NONE  
**Reaction upon A:** NONE  
**Acknowl. upon A:** NONE

---

<b>A31811 (F, N)</b>	<b>Encoder 1: Encoder serial number changed</b>
<b>Message value:</b>	-
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>The serial number of the motor encoder of a synchronous motor has changed. The change was only checked for encoders with serial number (e.g. EnDat encoders) and build-in motors (e.g. p0300 = 401) or third-party motors (p0300 = 2).</p> <p>Cause 1:</p> <ul style="list-style-type: none"><li>- The encoder was replaced.</li></ul> <p>Cause 2:</p> <ul style="list-style-type: none"><li>- A third-party, built-in or linear motor was re-commissioned.</li></ul> <p>Cause 3:</p> <ul style="list-style-type: none"><li>- The motor with integrated and adjusted encoder was replaced.</li></ul> <p>Cause 4:</p> <ul style="list-style-type: none"><li>- The firmware was updated to a version that checks the encoder serial number.</li></ul> <p>Note:</p> <p>With closed-loop position control, the serial number is accepted when starting the adjustment (p2507 = 2). When the encoder is adjusted (p2507 = 3), the serial number is checked for changes and if required, the adjustment is reset (p2507 = 1).</p> <p>Proceed as follows to hide serial number monitoring:</p> <ul style="list-style-type: none"><li>- set the following serial numbers for the corresponding Encoder Data Set: p0441= FF, p0442 = 0, p0443 = 0, p0444 = 0, p0445 = 0.</li><li>- parameterize F07414 as message type N (p2118, p2119).</li></ul> <p>See also: p0491 (Motor encoder fault response ENCODER)</p>
<b>Remedy:</b>	<p>Re causes 1, 2:</p> <p>Carry out an automatic adjustment using the pole position identification routine. Acknowledge fault. Initiate the pole position identification routine with p1990 = 1. Then check that the pole position identification routine is correctly executed.</p> <p>SERVO:</p> <p>If a pole position identification technique is selected in p1980, and if p0301 does not contain a motor type with an encoder adjusted in the factory, then p1990 is automatically activated.</p> <p>or</p> <p>Set the adjustment via p0431. In this case, the new serial number is automatically accepted.</p> <p>or</p> <p>Mechanically adjust the encoder. Accept the new serial number with p0440 = 1.</p> <p>Re causes 3, 4:</p> <p>Accept the new serial number with p0440 = 1.</p>
Reaction upon F:	NONE (ENCODER, OFF2)
Acknowl. upon F:	IMMEDIATELY
Reaction upon N:	NONE
Acknowl. upon N:	NONE

---

<b>F31812 (N, A)</b>	<b>Encoder 1: Requested cycle or RX-/TX timing not supported</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>A cycle requested from the Control Unit or RX/TX timing is not supported.</p> <p>Fault value (r0949, interpret decimal):</p> <ul style="list-style-type: none"><li>0: Application cycle is not supported.</li><li>1: DRIVE-CLiQ cycle is not supported.</li><li>2: Distance between RX and TX instants in time too low.</li><li>3: TX instant in time too early.</li></ul>
<b>Remedy:</b>	<p>Carry out a POWER ON (power off/on) for all components.</p>
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE

<b>F31813</b>	<b>Encoder 1: Hardware logic unit failed</b>
<b>Message value:</b>	Fault cause: %1 bin
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	ENCODER (IASC/DCBRK, NONE)
<b>Acknowledge:</b>	PULSE INHIBIT
<b>Cause:</b>	The DRIVE-CLiQ encoder fault word supplies fault bits that have been set. Fault value (r0949, interpret binary): Bit 0: ALU watchdog has responded. Bit 1: ALU has detected a sign-of-life error.
<b>Remedy:</b>	Replace encoder.
<b>F31820 (N, A)</b>	<b>Encoder 1 DRIVE-CLiQ: Telegram error</b>
<b>Message value:</b>	Component number: %1, fault cause: %2
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	ENCODER (IASC/DCBRK, NONE)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	A DRIVE-CLiQ communication error has occurred from the Control Unit to the encoder concerned. Fault cause: 1 (= 01 hex): Checksum error (CRC error). 2 (= 02 hex): Telegram is shorter than specified in the length byte or in the receive list. 3 (= 03 hex): Telegram is longer than specified in the length byte or in the receive list. 4 (= 04 hex): The length of the receive telegram does not match the receive list. 5 (= 05 hex): The type of the receive telegram does not match the receive list. 6 (= 06 hex): The address of the component in the telegram and in the receive list do not match. 7 (= 07 hex): A SYNC telegram is expected - but the received telegram is not a SYNC telegram. 8 (= 08 hex): No SYNC telegram is expected - but the received telegram is one. 9 (= 09 hex): The error bit in the receive telegram is set. 16 (= 10 hex): The receive telegram is too early. Note regarding the message value: The individual information is coded as follows in the message value (r0949/r2124): 0000yyxx hex: yy = component number, xx = error cause See also: p0491 (Motor encoder fault response ENCODER)
<b>Remedy:</b>	- carry out a POWER ON (power off/on). - check the electrical cabinet design and cable routing for EMC compliance - check the DRIVE-CLiQ wiring (interrupted cable, contacts, ...). See also: p9916 (DRIVE-CLiQ data transfer error shutdown threshold slave)
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE
<b>F31835 (N, A)</b>	<b>Encoder 1 DRIVE-CLiQ: Cyclic data transfer error</b>
<b>Message value:</b>	Component number: %1, fault cause: %2
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	ENCODER (IASC/DCBRK, NONE)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	A DRIVE-CLiQ communication error has occurred from the Control Unit to the encoder concerned. The nodes do not send and receive in synchronism.

Fault cause:  
33 (= 21 hex):  
The cyclic telegram has not been received.  
34 (= 22 hex):  
Timeout in the telegram receive list.  
64 (= 40 hex):  
Timeout in the telegram send list.  
Note regarding the message value:  
The individual information is coded as follows in the message value (r0949/r2124):  
0000yyxx hex: yy = component number, xx = error cause  
See also: p0491 (Motor encoder fault response ENCODER)

**Remedy:**  
- carry out a POWER ON.  
- replace the component involved.  
See also: p9916 (DRIVE-CLiQ data transfer error shutdown threshold slave)

Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

**F31836 (N, A) Encoder 1 DRIVE-CLiQ: Send error for DRIVE-CLiQ data**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** ENCODER (IASC/DCBRK, NONE)  
**Acknowledge:** IMMEDIATELY  
**Cause:** A DRIVE-CLiQ communication error has occurred from the Control Unit to the encoder involved. Data were not able to be sent.  
Fault cause:  
65 (= 41 hex):  
Telegram type does not match send list.  
Note regarding the message value:  
The individual information is coded as follows in the message value (r0949/r2124):  
0000yyxx hex: yy = component number, xx = error cause  
See also: p0491 (Motor encoder fault response ENCODER)

**Remedy:** Carry out a POWER ON.

Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

**F31837 (N, A) Encoder 1 DRIVE-CLiQ: Component fault**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** ENCODER (IASC/DCBRK, NONE)  
**Acknowledge:** IMMEDIATELY  
**Cause:** Fault detected on the DRIVE-CLiQ component concerned. Faulty hardware cannot be excluded.  
Fault cause:  
32 (= 20 hex):  
Error in the telegram header.  
35 (= 23 hex):  
Receive error: The telegram buffer memory contains an error.  
66 (= 42 hex):  
Send error: The telegram buffer memory contains an error.  
67 (= 43 hex):  
Send error: The telegram buffer memory contains an error.  
Note regarding the message value:  
The individual information is coded as follows in the message value (r0949/r2124):  
0000yyxx hex: yy = component number, xx = error cause  
See also: p0491 (Motor encoder fault response ENCODER)

**Remedy:**

- check the DRIVE-CLiQ wiring (interrupted cable, contacts, ...).
- check the electrical cabinet design and cable routing for EMC compliance
- if required, use another DRIVE-CLiQ socket (p9904).
- replace the component involved.

Reaction upon N: NONE

Acknowl. upon N: NONE

Reaction upon A: NONE

Acknowl. upon A: NONE

---

**A31840 Encoder 1 DRIVE-CLiQ: error below the signaling threshold**

**Message value:** Component number: %1, fault cause: %2

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** NONE

**Acknowledge:** NONE

**Cause:** A DRIVE-CLiQ error has occurred below the signaling threshold.

Fault cause:

1 (= 01 hex):  
Checksum error (CRC error).

2 (= 02 hex):  
Telegram is shorter than specified in the length byte or in the receive list.

3 (= 03 hex):  
Telegram is longer than specified in the length byte or in the receive list.

4 (= 04 hex):  
The length of the receive telegram does not match the receive list.

5 (= 05 hex):  
The type of the receive telegram does not match the receive list.

6 (= 06 hex):  
The address of the component in the telegram and in the receive list do not match.

7 (= 07 hex):  
A SYNC telegram is expected - but the received telegram is not a SYNC telegram.

8 (= 08 hex):  
No SYNC telegram is expected - but the received telegram is one.

9 (= 09 hex):  
The error bit in the receive telegram is set.

10 (= 0A hex):  
The sign-of-life bit in the receive telegram is not set.

11 (= 0B hex):  
Synchronization error during alternating cyclic data transfer.

16 (= 10 hex):  
The receive telegram is too early.

32 (= 20 hex):  
Error in the telegram header.

33 (= 21 hex):  
The cyclic telegram has not been received.

34 (= 22 hex):  
Timeout in the telegram receive list.

35 (= 23 hex):  
Receive error: The telegram buffer memory contains an error.

64 (= 40 hex):  
Timeout in the telegram send list.

65 (= 41 hex):  
Telegram type does not match send list.

66 (= 42 hex):  
Send error: The telegram buffer memory contains an error.

67 (= 43 hex):  
Send error: The telegram buffer memory contains an error.

Note regarding the message value:  
The individual information is coded as follows in the message value (r0949/r2124):  
0000yyxx hex: yy = component number, xx = error cause

**Remedy:**

- check the electrical cabinet design and cable routing for EMC compliance
- check the DRIVE-CLiQ wiring (interrupted cable, contacts, ...).

See also: p9916 (DRIVE-CLiQ data transfer error shutdown threshold slave)

---

**F31845 (N, A) Encoder 1 DRIVE-CLiQ: Cyclic data transfer error**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** ENCODER (IASC/DCBRK, NONE)  
**Acknowledge:** IMMEDIATELY  
**Cause:** A DRIVE-CLiQ communication error has occurred from the Control Unit to the encoder involved.  
Fault cause:  
11 (= 0B hex):  
Synchronization error during alternating cyclic data transfer.  
Note regarding the message value:  
The individual information is coded as follows in the message value (r0949/r2124):  
0000yyxx hex: yy = component number, xx = error cause  
See also: p0491 (Motor encoder fault response ENCODER)  
**Remedy:** Carry out a POWER ON (power off/on).  
See also: p9916 (DRIVE-CLiQ data transfer error shutdown threshold slave)

Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

**F31850 (N, A) Encoder 1: Encoder evaluation internal software error**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** ENCODER (IASC/DCBRK, NONE)  
**Acknowledge:** POWER ON  
**Cause:** An internal software error has occurred in the Sensor Module of encoder 1.  
Fault value (r0949, interpret decimal):  
1: Background time slice is blocked.  
2: Checksum over the code memory is not OK.  
10000: OEM memory of the EnDat encoder contains data that cannot be interpreted.  
11000 ... 11499: Descriptive data from EEPROM incorrect.  
11500 ... 11899: Calibration data from EEPROM incorrect.  
11900 ... 11999: Configuration data from EEPROM incorrect.  
12000 ... 12008: Communication with AD converter faulted.  
16000: DRIVE-CLiQ encoder initialization application error.  
16001: DRIVE-CLiQ encoder initialization ALU error.  
16002: DRIVE-CLiQ encoder HSI / SSI initialization error.  
16003: DRIVE-CLiQ encoder safety initialization error.  
16004: DRIVE-CLiQ encoder internal system error.  
See also: p0491 (Motor encoder fault response ENCODER)

**Remedy:**

- replace the Sensor Module.
- if required, upgrade the firmware in the Sensor Module.
- contact the Hotline.

Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

<b>F31851 (N, A)</b>	<b>Encoder 1 DRIVE-CLiQ (CU): Sign-of-life missing</b>
<b>Message value:</b>	Component number: %1, fault cause: %2
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	ENCODER (IASC/DCBRK, NONE)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>A DRIVE-CLiQ communication error has occurred from the Sensor Module (encoder 1) involved to the Control Unit. The DRIVE-CLiQ component did not set the sign-of-life to the Control Unit.</p> <p>Fault cause:</p> <p>10 (= 0A hex):</p> <p>The sign-of-life bit in the receive telegram is not set.</p> <p>Note regarding the message value:</p> <p>The individual information is coded as follows in the message value (r0949/r2124):</p> <p>0000yyxx hex: yy = component number, xx = error cause</p>
<b>Remedy:</b>	<p>- Upgrade the firmware of the component involved.</p> <p>- carry out a POWER ON (power off/on) for the component involved.</p>
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE
<b>F31860 (N, A)</b>	<b>Encoder 1 DRIVE-CLiQ (CU): Telegram error</b>
<b>Message value:</b>	Component number: %1, fault cause: %2
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	ENCODER (IASC/DCBRK, NONE)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>A DRIVE-CLiQ communication error has occurred from the Sensor Module (encoder 1) involved to the Control Unit.</p> <p>Fault cause:</p> <p>1 (= 01 hex):</p> <p>Checksum error (CRC error).</p> <p>2 (= 02 hex):</p> <p>Telegram is shorter than specified in the length byte or in the receive list.</p> <p>3 (= 03 hex):</p> <p>Telegram is longer than specified in the length byte or in the receive list.</p> <p>4 (= 04 hex):</p> <p>The length of the receive telegram does not match the receive list.</p> <p>5 (= 05 hex):</p> <p>The type of the receive telegram does not match the receive list.</p> <p>6 (= 06 hex):</p> <p>The address of the power unit in the telegram and in the receive list do not match.</p> <p>9 (= 09 hex):</p> <p>The error bit in the receive telegram is set.</p> <p>16 (= 10 hex):</p> <p>The receive telegram is too early.</p> <p>17 (= 11 hex):</p> <p>CRC error and the receive telegram is too early.</p> <p>18 (= 12 hex):</p> <p>The telegram is shorter than that specified in the length byte or in the receive list and the receive telegram is too early.</p> <p>19 (= 13 hex):</p> <p>The telegram is longer than that specified in the length byte or in the receive list and the receive telegram is too early.</p> <p>20 (= 14 hex):</p> <p>The length of the receive telegram does not match the receive list and the receive telegram is too early.</p> <p>21 (= 15 hex):</p> <p>The type of the receive telegram does not match the receive list and the receive telegram is too early.</p> <p>22 (= 16 hex):</p> <p>The address of the power unit in the telegram and in the receive list does not match and the receive telegram is too early.</p> <p>25 (= 19 hex):</p> <p>The error bit in the receive telegram is set and the receive telegram is too early.</p>



Note regarding the message value:

The individual information is coded as follows in the message value (r0949/r2124):

0000yyxx hex: yy = component number, xx = error cause

**Remedy:**

- carry out a POWER ON (power off/on).
  - check the electrical cabinet design and cable routing for EMC compliance
  - check the DRIVE-CLiQ wiring (interrupted cable, contacts, ...).
- See also: p9915 (DRIVE-CLiQ data transfer error shutdown threshold master)

Reaction upon N: NONE

Acknowl. upon N: NONE

Reaction upon A: NONE

Acknowl. upon A: NONE

---

**F31875 (N, A) Encoder 1 DRIVE-CLiQ (CU): Supply voltage failed**

**Message value:** Component number: %1, fault cause: %2

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** ENCODER (IASC/DCBRK, NONE)

**Acknowledge:** IMMEDIATELY

**Cause:** The DRIVE-CLiQ communication from the DRIVE-CLiQ component involved to the Control Unit signals that the supply voltage has failed.

Fault cause:

9 (= 09 hex):

The power supply voltage for the components has failed.

Note regarding the message value:

The individual information is coded as follows in the message value (r0949/r2124):

0000yyxx hex: yy = component number, xx = error cause

**Remedy:**

- carry out a POWER ON (power off/on).
- check the power supply voltage wiring for the DRIVE-CLiQ component (interrupted cable, contacts, ...).
- check the dimensioning of the power supply for the DRIVE-CLiQ component.

Reaction upon N: NONE

Acknowl. upon N: NONE

Reaction upon A: NONE

Acknowl. upon A: NONE

---

**F31885 (N, A) Encoder 1 DRIVE-CLiQ (CU): Cyclic data transfer error**

**Message value:** Component number: %1, fault cause: %2

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** ENCODER (IASC/DCBRK, NONE)

**Acknowledge:** IMMEDIATELY

**Cause:** A DRIVE-CLiQ communication error has occurred from the Sensor Module (encoder 1) involved to the Control Unit. The nodes do not send and receive in synchronism.

Fault cause:

26 (= 1A hex):

Sign-of-life bit in the receive telegram not set and the receive telegram is too early.

33 (= 21 hex):

The cyclic telegram has not been received.

34 (= 22 hex):

Timeout in the telegram receive list.

64 (= 40 hex):

Timeout in the telegram send list.

98 (= 62 hex):

Error at the transition to cyclic operation.

Note regarding the message value:

The individual information is coded as follows in the message value (r0949/r2124):

0000yyxx hex: yy = component number, xx = error cause

**Remedy:**

- check the power supply voltage of the component involved.
  - carry out a POWER ON.
  - replace the component involved.
- See also: p9915 (DRIVE-CLiQ data transfer error shutdown threshold master)

Reaction upon N: NONE  
 Acknowl. upon N: NONE  
 Reaction upon A: NONE  
 Acknowl. upon A: NONE

---

<b>F31886 (N, A)</b>	<b>Encoder 1 DRIVE-CLiQ (CU): Error when sending DRIVE-CLiQ data</b>
<b>Message value:</b>	Component number: %1, fault cause: %2
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	ENCODER (IASC/DCBRK, NONE)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	A DRIVE-CLiQ communication error has occurred from the Sensor Module (encoder 1) involved to the Control Unit. Data were not able to be sent. Fault cause: 65 (= 41 hex): Telegram type does not match send list. Note regarding the message value: The individual information is coded as follows in the message value (r0949/r2124): 0000yyxx hex: yy = component number, xx = error cause
<b>Remedy:</b>	- carry out a POWER ON. - check whether the firmware version of the encoder (r0148) matches the firmware version of Control Unit (r0018).
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE

---

<b>F31887 (N, A)</b>	<b>Encoder 1 DRIVE-CLiQ (CU): Component fault</b>
<b>Message value:</b>	Component number: %1, fault cause: %2
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	ENCODER (IASC/DCBRK, NONE)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	Fault detected on the DRIVE-CLiQ component involved (Sensor Module for encoder 1). Faulty hardware cannot be excluded. Fault cause: 32 (= 20 hex): Error in the telegram header. 35 (= 23 hex): Receive error: The telegram buffer memory contains an error. 66 (= 42 hex): Send error: The telegram buffer memory contains an error. 67 (= 43 hex): Send error: The telegram buffer memory contains an error. 96 (= 60 hex): Response received too late during runtime measurement. 97 (= 61 hex): Time taken to exchange characteristic data too long. Note regarding the message value: The individual information is coded as follows in the message value (r0949/r2124): 0000yyxx hex: yy = component number, xx = error cause
<b>Remedy:</b>	- check the DRIVE-CLiQ wiring (interrupted cable, contacts, ...). - check the electrical cabinet design and cable routing for EMC compliance - if required, use another DRIVE-CLiQ socket (p9904). - replace the component involved.
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE

<b>F31895 (N, A)</b>	<b>Encoder 1 DRIVE-CLiQ (CU): Alternating cyclic data transfer error</b>
<b>Message value:</b>	Component number: %1, fault cause: %2
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	ENCODER (IASC/DCBRK, NONE)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>A DRIVE-CLiQ communication error has occurred from the Sensor Module (encoder 1) involved to the Control Unit.</p> <p>Fault cause:</p> <p>11 (= 0B hex):</p> <p>Synchronization error during alternating cyclic data transfer.</p> <p>Note regarding the message value:</p> <p>The individual information is coded as follows in the message value (r0949/r2124):</p> <p>0000yyxx hex: yy = component number, xx = error cause</p>
<b>Remedy:</b>	<p>Carry out a POWER ON.</p> <p>See also: p9915 (DRIVE-CLiQ data transfer error shutdown threshold master)</p>
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE
<b>F31896 (N, A)</b>	<b>Encoder 1 DRIVE-CLiQ (CU): Inconsistent component properties</b>
<b>Message value:</b>	Component number: %1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF2 (ENCODER, IASC/DCBRK, NONE, OFF1, OFF3, STOP1, STOP2)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>The properties of the DRIVE-CLiQ component (Sensor Module for encoder 1), specified by the fault value, have changed in an incompatible fashion with respect to the properties when booted. One cause can be, e.g. that a DRIVE-CLiQ cable or DRIVE-CLiQ component has been replaced.</p> <p>Fault value (r0949, interpret decimal):</p> <p>Component number.</p>
<b>Remedy:</b>	<ul style="list-style-type: none"> <li>- carry out a POWER ON.</li> <li>- when a component is replaced, the same component type and if possible the same firmware version should be used.</li> <li>- when a cable is replaced, only cables whose length is the same as or as close as possible to the length of the original cables should be used (ensure compliance with the maximum cable length).</li> </ul>
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE
<b>F31899 (N, A)</b>	<b>Encoder 1: Unknown fault</b>
<b>Message value:</b>	New message: %1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	ENCODER (IASC/DCBRK, NONE, OFF1, OFF2, OFF3, STOP1, STOP2)
<b>Acknowledge:</b>	IMMEDIATELY (POWER ON)
<b>Cause:</b>	<p>A fault occurred on the Sensor Module for encoder 1 that cannot be interpreted by the Control Unit firmware. This can occur if the firmware on this component is more recent than the firmware on the Control Unit.</p> <p>Fault value (r0949, interpret decimal):</p> <p>Fault number.</p> <p>Note:</p> <p>If required, the significance of this new fault can be read about in a more recent description of the Control Unit.</p> <p>See also: p0491 (Motor encoder fault response ENCODER)</p>
<b>Remedy:</b>	<ul style="list-style-type: none"> <li>- replace the firmware on the Sensor Module by an older firmware version (r0148).</li> <li>- upgrade the firmware on the Control Unit (r0018).</li> </ul>
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE

<b>A31902 (F, N)</b>	<b>Encoder 1: SPI-BUS error occurred</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	Error when operating the internal SPI bus. Fault value (r0949, interpret hexadecimal): Only for internal Siemens troubleshooting.
<b>Remedy:</b>	- replace the Sensor Module. - if required, upgrade the firmware in the Sensor Module. - contact the Hotline.
Reaction upon F:	NONE (ENCODER, IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)
Acknowl. upon F:	IMMEDIATELY
Reaction upon N:	NONE
Acknowl. upon N:	NONE
<b>A31903 (F, N)</b>	<b>Encoder 1: I2C-BUS error occurred</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	Error when operating the internal I2C bus. Fault value (r0949, interpret hexadecimal): Only for internal Siemens troubleshooting.
<b>Remedy:</b>	- replace the Sensor Module. - if required, upgrade the firmware in the Sensor Module. - contact the Hotline.
Reaction upon F:	NONE (ENCODER, IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)
Acknowl. upon F:	IMMEDIATELY
Reaction upon N:	NONE
Acknowl. upon N:	NONE
<b>F31905 (N, A)</b>	<b>Encoder 1: Parameterization error</b>
<b>Message value:</b>	Parameter: %1, supplementary information: %2
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	ENCODER (IASC/DCBRK, NONE, OFF1, OFF2, OFF3, STOP1, STOP2)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	A parameter of encoder 1 was detected as being incorrect. It is possible that the parameterized encoder type does not match the connected encoder. The parameter involved can be determined as follows: - determine the parameter number using the fault value (r0949). - determine the parameter index (p0187). Fault value (r0949, interpret decimal): yyyyxxxx dec: yyyy = supplementary information, xxxx = parameter xxxx = 421: For an EnDat/SSI encoder, the absolute position in the protocol must be less than or equal to 30 bits. yyyy = 0: No information available. yyyy = 1: The component does not support HTL level (p0405.1 = 0) combined with track monitoring A/B <> -A/B (p0405.2 = 1). yyyy = 2: A code number for an identified encoder has been entered into p0400, however, no identification was carried out. Please start a new encoder identification. yyyy = 3: A code number for an identified encoder has been entered into p0400, however, no identification was carried out. Please select a listed encoder in p0400 with a code number < 10000. yyyy = 4: This component does not support SSI encoders (p0404.9 = 1) without track A/B.

yyyy = 5:  
For SQW encoder, value in p4686 greater than in p0425.  
yyyy = 6:  
DRIVE-CLiQ encoder cannot be used with this firmware version.  
yyyy = 7:  
For an SQW encoder, the Xact1 correction (p0437.2) is only permitted with equidistant zero marks.  
yyyy = 8:  
The motor pole pair width is not supported by the linear scale being used.  
yyyy = 9:  
The length of the position in the EnDat protocol may be a maximum of 32 bits.  
yyyy = 10:  
The connected encoder is not supported.  
yyyy = 11:  
The hardware does not support track monitoring.  
See also: p0491 (Motor encoder fault response ENCODER)

**Remedy:**

- check whether the connected encoder type matches the encoder that has been parameterized.
- correct the parameter specified by the fault value (r0949) and p0187.
- re parameter number = 314:
- check the pole pair number and measuring gear ratio. The quotient of the "pole pair number" divided by the "measuring gear ratio" must be less than or equal to 1000 ((r0313 \* p0433) / p0432 <= 1000).

Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

### **F31912 Encoder 1: Device combination is not permissible**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** ENCODER (IASC/DCBRK, NONE)  
**Acknowledge:** PULSE INHIBIT  
**Cause:** The selected device combination is not supported.  
Fault value (r0949, interpret decimal):  
1003:  
The connected measuring unit cannot be operated with the EnDat 2.2 converter. For instance, the measuring unit has a pulse number/resolution of 2^n.  
1005:  
The type of measuring unit (incremental) is not supported by the EnDat 2.2 converter.  
1006:  
The maximum duration (31.25 µs) of the EnDat transfer was exceeded.  
2001:  
The set combination of current controller cycle, DP cycle and Safety cycle is not supported by the EnDat 2.2 converter.  
2002:  
The resolution of the linear measuring unit does not match the pole pair width of the linear motor

**Remedy:**

Re fault value = 1003, 1005, 1006:  
- Use a measuring unit that is permissible.  
For fault value = 2001:  
- Set a permissible cycle combination (if required, use standard settings).  
For fault value = 2002:  
- Use a measuring unit with a lower resolution (p0422).

---

### **A31915 (F, N) Encoder 1: Configuration error**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The configuration for encoder 1 is incorrect.

	Alarm value (r2124, interpret decimal): 1: Re-parameterization between fault/alarm is not permissible. 419: When the fine resolution Gx_XIST2 is configured, the encoder identifies a maximum possible absolute position actual value (r0483) that can no longer be represented within 32 bits.
<b>Remedy:</b>	Re alarm value = 1: No re-parameterization between fault/alarm. Re alarm value = 419: Reduce the fine resolution (p0419) or deactivate the monitoring (p0437.25), if the complete multiturn range is not required.
Reaction upon F:	NONE (ENCODER, IASC/DCBRK)
Acknowl. upon F:	IMMEDIATELY
Reaction upon N:	NONE
Acknowl. upon N:	NONE

<b>F31916 (N, A)</b>	<b>Encoder 1: Parameterization fault</b>
<b>Message value:</b>	Parameter: %1, supplementary information: %2
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	ENCODER (IASC/DCBRK, NONE, OFF1, OFF2, OFF3, STOP1, STOP2)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	A parameter of encoder 1 was detected as being incorrect. It is possible that the parameterized encoder type does not match the connected encoder. The parameter involved can be determined as follows: - determine the parameter number using the fault value (r0949). - determine the parameter index (p0187). Fault value (r0949, interpret decimal): Parameter number. Note: This fault is only output for encoders where r0404.10 = 1 or r0404.11 = 1. It corresponds to A31905 with encoders where r0404.10 = 0 and r0404.11 = 0. See also: p0491 (Motor encoder fault response ENCODER)
<b>Remedy:</b>	- check whether the connected encoder type matches the encoder that has been parameterized. - correct the parameter specified by the fault value (r0949) and p0187.
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE

<b>A31920 (F, N)</b>	<b>Encoder 1: Temperature sensor fault</b>
<b>Message value:</b>	Fault cause: %1, channel number: %2
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	When evaluating the temperature sensor, an error occurred. Fault cause: 1 (= 01 hex): Wire breakage or sensor not connected (KTY: R > 1630 Ohm). 2 (= 02 hex): Measured resistance too low (PTC: R < 20 Ohm, KTY: R < 50 Ohm). Additional values: Only for internal Siemens troubleshooting. Note regarding the message value: The individual information is coded as follows in the message value (r0949/r2124): 0000yyxx hex: yy = channel number, xx = error cause See also: p0491 (Motor encoder fault response ENCODER)
<b>Remedy:</b>	- check that the encoder cable is the correct type and is correctly connected. - check the temperature sensor selection in p0600 to p0603. - replace the Sensor Module (hardware defect or incorrect calibration data).

Reaction upon F: NONE (ENCODER, IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)  
Acknowl. upon F: IMMEDIATELY  
Reaction upon N: NONE  
Acknowl. upon N: NONE

---

**A31930 (N) Encoder 1: Data logger has saved data**

**Message value:** -

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** NONE

**Acknowledge:** NONE

**Cause:** For the activated function "Data logger" (p0437.0 = 1) a fault has occurred with the Sensor Module. This alarm indicates that the diagnostics data corresponding to the fault was saved on the memory card.  
The diagnostics data is saved in the following folder:  
/USER/SINAMICS/DATA/SMTRC00.BIN  
...  
/USER/SINAMICS/DATA/SMTRC07.BIN  
/USER/SINAMICS/DATA/SMTRCIDX.TXT  
The following information is contained in the TXT file:  
- Display of the last written BIN file.  
- Number of write operations that are still possible (from 10000 downwards).  
**Note:**  
Only Siemens can evaluate the BIN files.

**Remedy:** Not necessary.  
The alarm disappears automatically.  
The data logger is ready to record the next fault case.

Reaction upon N: NONE  
Acknowl. upon N: NONE

---

**A31940 (F, N) Encoder 1: Spindle sensor S1 voltage incorrect**

**Message value:** %1

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** NONE

**Acknowledge:** NONE

**Cause:** The voltage of analog sensor S1 is outside the permissible range.  
Fault value (r0949, interpret decimal):  
Signal level from sensor S1.  
**Note:**  
A signal level of 500 mV corresponds to the numerical value 500 dec.

**Remedy:** - Check the clamped tool.  
- Check the tolerance and if required, adapt (p5040).  
- Check the thresholds and if required, adapt (p5041).  
- Check analog sensor S1 and connections.

Reaction upon F: NONE (ENCODER, IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)  
Acknowl. upon F: IMMEDIATELY  
Reaction upon N: NONE  
Acknowl. upon N: NONE

---

**F31950 Encoder 1: Internal software error**

**Message value:** %1

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** ENCODER (OFF2)

**Acknowledge:** POWER ON

**Cause:** An internal software error has occurred.  
Fault value (r0949, interpret decimal):  
The fault value contains information regarding the fault source.  
Only for internal Siemens troubleshooting.

**Remedy:** - If necessary, upgrade the firmware in the Sensor Module to a later version.  
- contact the Hotline.

<b>A31999 (F, N)</b>	<b>Encoder 1: Unknown alarm</b>
<b>Message value:</b>	New message: %1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>A alarm has occurred on the Sensor Module for encoder 1 that cannot be interpreted by the Control Unit firmware. This can occur if the firmware on this component is more recent than the firmware on the Control Unit.</p> <p>Alarm value (r2124, interpret decimal): Alarm number.</p> <p>Note: If required, the significance of this new alarm can be read about in a more recent description of the Control Unit. See also: p0491 (Motor encoder fault response ENCODER)</p>
<b>Remedy:</b>	<ul style="list-style-type: none"> <li>- replace the firmware on the Sensor Module by an older firmware version (r0148).</li> <li>- upgrade the firmware on the Control Unit (r0018).</li> </ul>
Reaction upon F:	NONE (ENCODER, IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)
Acknowl. upon F:	IMMEDIATELY (POWER ON)
Reaction upon N:	NONE
Acknowl. upon N:	NONE
<b>F32100 (N, A)</b>	<b>Encoder 2: Zero mark distance error</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF1 (IASC/DCBRK, NONE, OFF2, OFF3, STOP1, STOP2)
<b>Acknowledge:</b>	PULSE INHIBIT
<b>Cause:</b>	<p>The measured zero mark distance does not correspond to the parameterized zero mark distance.</p> <p>For distance-coded encoders, the zero mark distance is determined from zero marks detected pairs. This means that if a zero mark is missing, depending on the pair generation, this cannot result in a fault and also has no effect in the system.</p> <p>The zero mark distance for the zero mark monitoring is set in p0425 (rotary encoder) or p0424 (linear encoder). Fault value (r0949, interpret decimal): Last measured zero mark distance in increments (4 increments = 1 encoder pulse). The sign designates the direction of motion when detecting the zero mark distance.</p>
<b>Remedy:</b>	<ul style="list-style-type: none"> <li>- check that the encoder cables are routed in compliance with EMC.</li> <li>- check the plug connections</li> <li>- check the encoder type (encoder with equidistant zero marks).</li> <li>- adapt the parameter for the distance between zero marks (p0424, p0425).</li> <li>- if message output above speed threshold, reduce filter time if necessary (p0438).</li> <li>- replace the encoder or encoder cable</li> </ul>
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE
<b>F32101 (N, A)</b>	<b>Encoder 2: Zero mark failed</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF1 (IASC/DCBRK, NONE, OFF2, OFF3, STOP1, STOP2)
<b>Acknowledge:</b>	PULSE INHIBIT
<b>Cause:</b>	<p>The 1.5 x parameterized zero mark distance was exceeded.</p> <p>The zero mark distance for the zero mark monitoring is set in p0425 (rotary encoder) or p0424 (linear encoder). Fault value (r0949, interpret decimal): Number of increments after POWER ON or since the last zero mark that was detected (4 increments = 1 encoder pulse).</p>
<b>Remedy:</b>	<ul style="list-style-type: none"> <li>- check that the encoder cables are routed in compliance with EMC.</li> <li>- check the plug connections</li> <li>- check the encoder type (encoder with equidistant zero marks).</li> <li>- adapt the parameter for the clearance between zero marks (p0425).</li> </ul>



- if message output above speed threshold, reduce filter time if necessary (p0438).
- when p0437.1 is active, check p4686.
- replace the encoder or encoder cable

Reaction upon N: NONE  
 Acknowl. upon N: NONE  
 Reaction upon A: NONE  
 Acknowl. upon A: NONE

---

### **F32103 (N, A) Encoder 2: Amplitude error track R**

**Message value:** R track: %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF1 (IASC/DCBRK, NONE, OFF2, OFF3)  
**Acknowledge:** IMMEDIATELY  
**Cause:** The amplitude of the reference track signal (track R) does not lie within the tolerance bandwidth for encoder 2. The fault can be initiated when the unipolar voltage level is exceeded (RP/RN) or if the differential amplitude is under-shot.  
 Fault value (r0949, interpret hexadecimal):  
 yyyyyxxx hex: yyyy = 0, xxxx = Signal level, track R (16 bits with sign)  
 The response thresholds of the unipolar signal levels of the encoder are between < 1400 mV and > 3500 mV.  
 The response threshold for the differential signal level of the encoder is < -1600 mV.  
 A signal level of 500 mV peak value corresponds to the numerical value 5333 hex = 21299 dec.  
**Note:**  
 The analog value of the amplitude error is not measured at the same time with the hardware fault output by the Sensor Module.  
 The fault value can only be represented between -32768 ... 32767 dec (-770 ... 770 mV).  
 The signal level is not evaluated unless the following conditions are satisfied:  
 - Sensor Module properties available (r0459.31 = 1).  
 - Monitoring active (p0437.31 = 1).  
**Remedy:**  
 - check the speed range; frequency characteristic (amplitude characteristic) of the measuring equipment might not be sufficient for the speed range  
 - check that the encoder cables and shielding are routed in compliance with EMC.  
 - check the plug connections and contacts of the encoder cable.  
 - check the encoder type (encoder with zero marks).  
 - check whether the zero mark is connected and the signal cables RP and RN have been connected correctly  
 - replace the encoder cable.  
 - if the coding disk is soiled or the lighting aged, replace the encoder.  
 Reaction upon N: NONE  
 Acknowl. upon N: NONE  
 Reaction upon A: NONE  
 Acknowl. upon A: NONE

---

### **F32110 (N, A) Encoder 2: Serial communications error**

**Message value:** Fault cause: %1 bin  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF1 (IASC/DCBRK, NONE, OFF2, OFF3)  
**Acknowledge:** PULSE INHIBIT  
**Cause:** Serial communication protocol transfer error between the encoder and evaluation module.  
 Fault value (r0949, interpret binary):  
 Bit 0: Alarm bit in the position protocol.  
 Bit 1: Incorrect quiescent level on the data line.  
 Bit 2: Encoder does not respond (does not supply a start bit within 50 ms).  
 Bit 3: CRC error: The checksum in the protocol from the encoder does not match the data.  
 Bit 4: Encoder acknowledgement error: The encoder incorrectly understood the task (request) or cannot execute it.  
 Bit 5: Internal error in the serial driver: An illegal mode command was requested.  
 Bit 6: Timeout when cyclically reading.  
 Bit 7: Timeout for the register communication.  
 Bit 8: Protocol is too long (e.g. > 64 bits).  
 Bit 9: Receive buffer overflow.  
 Bit 10: Frame error when reading twice.

Bit 11: Parity error.  
 Bit 12: Data line signal level error during the monoflop time.  
 Bit 13: Data line incorrect.  
 Bit 14: Fault for the register communication.  
 Note:  
 For an EnDat 2.2 encoder, the significance of the fault value for F3x135 (x = 1, 2, 3) is described.

**Remedy:**

Re fault value, bit 0 = 1:  
 - Enc defect F31111 may provide additional details.  
 Re fault value, bit 1 = 1:  
 - Incorrect encoder type / replace the encoder or encoder cable.  
 Re fault value, bit 2 = 1:  
 - Incorrect encoder type / replace the encoder or encoder cable.  
 Re fault value, bit 3 = 1:  
 - EMC / connect the cable shield, replace the encoder or encoder cable.  
 Re fault value, bit 4 = 1:  
 - EMC / connect the cable shield, replace the encoder or encoder cable, replace the Sensor Module.  
 Re fault value, bit 5 = 1:  
 - EMC / connect the cable shield, replace the encoder or encoder cable, replace the Sensor Module.  
 Re fault value, bit 6 = 1:  
 - Update Sensor Module firmware.  
 Re fault value, bit 7 = 1:  
 - Incorrect encoder type / replace the encoder or encoder cable.  
 Re fault value, bit 8 = 1:  
 - Check parameterization (p0429.2).  
 Re fault value, bit 9 = 1:  
 - EMC / connect the cable shield, replace the encoder or encoder cable, replace the Sensor Module.  
 Re fault value, bit 10 = 1:  
 - Check parameterization (p0429.2, p0449).  
 Re fault value, bit 11 = 1:  
 - Check parameterization (p0436).  
 Re fault value, bit 12 = 1:  
 - Check parameterization (p0429.6).  
 Re fault value, bit 13 = 1:  
 - Check data line.  
 Re fault value, bit 14 = 1:  
 - Incorrect encoder type / replace the encoder or encoder cable.

Reaction upon N: NONE  
 Acknowl. upon N: NONE  
 Reaction upon A: NONE  
 Acknowl. upon A: NONE

---

**F32111 (N, A) Encoder 2: Absolute encoder internal fault**

**Message value:** Fault cause: %1 bin, additional information: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF1 (IASC/DCBRK, NONE, OFF2, OFF3)  
**Acknowledge:** PULSE INHIBIT  
**Cause:** The absolute encoder fault word supplies fault bits that have been set.  
 Fault value (r0949, interpret binary):  
 yyyxxxx hex: yyyy = supplementary information, xxxx = fault cause  
 yyyy = 0:  
 Bit 0: Lighting system failed.  
 Bit 1: Signal amplitude too low.  
 Bit 2: Position value incorrect.  
 Bit 3: Encoder power supply overvoltage condition.  
 Bit 4: Encoder power supply undervoltage condition.  
 Bit 5: Encoder power supply overcurrent condition.  
 Bit 6: The battery must be changed.  
 yyyy = 1:  
 Bit 0: Signal amplitude outside the control range.  
 Bit 1: Error multiturn interface  
 Bit 2: Internal data error (singleturn/multiturn not with single steps).

Bit 3: Error EEPROM interface.  
 Bit 4: SAR converter error.  
 Bit 5: Fault for the register data transfer.  
 Bit 6: Internal error identified at the error pin (nErr).  
 Bit 7: Temperature threshold exceeded or fallen below.

**Remedy:**

For yyyy = 0:  
 Re fault value, bit 0 = 1:  
 Encoder is defective. Replace the encoder, where the motor encoder has a direct DRIVE-CLiQ socket: Replace the motor.  
 Re fault value, bit 1 = 1:  
 Encoder is defective. Replace the encoder, where the motor encoder has a direct DRIVE-CLiQ socket: Replace the motor.  
 Re fault value, bit 2 = 1:  
 Encoder is defective. Replace the encoder, where the motor encoder has a direct DRIVE-CLiQ socket: Replace the motor.  
 Re fault value, bit 3 = 1:  
 5 V power supply voltage fault.  
 When using an SMC: Check the plug-in cable between the encoder and SMC or replace the SMC.  
 When a motor encoder with a direct DRIVE-CLiQ connection is used: Replace the motor.  
 Re fault value, bit 4 = 1:  
 5 V power supply voltage fault.  
 When using an SMC: Check the plug-in cable between the encoder and SMC or replace the SMC.  
 When using a motor with DRIVE-CLiQ: Replace the motor.  
 Re fault value, bit 5 = 1:  
 Encoder is defective. Replace the encoder, where the motor encoder has a direct DRIVE-CLiQ socket: Replace the motor.  
 Re fault value, bit 6 = 1:  
 The battery must be changed (only for encoders with battery back-up).  
 For yyyy = 1:  
 Encoder is defective. Replace encoder.

Reaction upon N: NONE  
 Acknowl. upon N: NONE  
 Reaction upon A: NONE  
 Acknowl. upon A: NONE

---

**F32112 (N, A) Encoder 2: Error bit set in the serial protocol**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF1 (IASC/DCBRK, NONE, OFF2, OFF3)  
**Acknowledge:** PULSE INHIBIT  
**Cause:** The encoder sends a set error bit via the serial protocol.  
 Fault value (r0949, interpret binary):  
 Bit 0: Fault bit in the position protocol.  
**Remedy:** For fault value, bit 0 = 1:  
 In the case of an EnDat encoder, F31111 may provide further details.

Reaction upon N: NONE  
 Acknowl. upon N: NONE  
 Reaction upon A: NONE  
 Acknowl. upon A: NONE

---

**F32115 (N, A) Encoder 2: Amplitude error track A or B ( $A^2 + B^2$ )**

**Message value:** A track: %1, B-track: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF1 (IASC/DCBRK, NONE, OFF2, OFF3)  
**Acknowledge:** PULSE INHIBIT  
**Cause:** The amplitude (root of  $A^2 + B^2$ ) for encoder 2 exceeds the permissible tolerance.

Fault value (r0949, interpret hexadecimal):

yyyyxxxx hex:

yyyy = Signal level, track B (16 bits with sign).

xxxx = Signal level, track A (16 bits with sign).

The nominal signal level of the encoder must lie in the range 375 mV to 600 mV (500 mV -25/+20 %).

The response thresholds are < 170 mV (observe the frequency response of the encoder) and > 750 mV.

A signal level of 500 mV peak value corresponds to the numerical value 5333 hex = 21299 dec.

Note for sensors modules for resolvers (e. g. SMC10):

The nominal signal level is at 2900 mV (2.0 Vrms). The response thresholds are < 1070 mV and > 3582 mV.

A signal level of 2900 mV peak value corresponds to the numerical value 6666 hex = 26214 dec.

Note:

The analog values of the amplitude error are not measured at the same time with the hardware fault output by the Sensor Module.

**Remedy:**

- check that the encoder cables and shielding are routed in compliance with EMC.

- check the plug connections

- replace the encoder or encoder cable

- check the Sensor Module (e.g. contacts).

The following applies to measuring systems without their own bearing system:

- adjust the scanning head and check the bearing system of the measuring wheel.

The following applies for measuring systems with their own bearing system:

- ensure that the encoder housing is not subject to any axial force.

Reaction upon N: NONE

Acknowled. upon N: NONE

Reaction upon A: NONE

Acknowled. upon A: NONE

---

**F32116 (N, A) Encoder 2: Amplitude error monitoring track A + B**

**Message value:** A track: %1, B-track: %2

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** OFF1 (IASC/DCBRK, NONE, OFF2, OFF3)

**Acknowledge:** IMMEDIATELY

**Cause:** The amplitude of the rectified encoder signals A and B and the amplitude from the roots of  $A^2 + B^2$  for encoder 2 are not within the tolerance bandwidth.

Fault value (r0949, interpret hexadecimal):

yyyyxxxx hex:

yyyy = Signal level, track B (16 bits with sign).

xxxx = Signal level, track A (16 bits with sign).

The nominal signal level of the encoder must lie in the range 375 mV to 600 mV (500 mV -25/+20 %).

The response thresholds are < 130 mV (observe the frequency response of the encoder) and > 955 mV.

A signal level of 500 mV peak value corresponds to the numerical value 5333 hex = 21299 dec.

Note:

The analog values of the amplitude error are not measured at the same time with the hardware fault output by the Sensor Module.

**Remedy:**

- check that the encoder cables and shielding are routed in compliance with EMC.

- check the plug connections

- replace the encoder or encoder cable

- check the Sensor Module (e.g. contacts).

Reaction upon N: NONE

Acknowled. upon N: NONE

Reaction upon A: NONE

Acknowled. upon A: NONE

---

**F32117 (N, A) Encoder 2: Inversion error signals A/B/R**

**Message value:** Fault cause: %1 bin

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** OFF1 (IASC/DCBRK, NONE, OFF2, OFF3)

**Acknowledge:** IMMEDIATELY

**Cause:** For a square-wave encoder (bipolar, double ended) signals A\*, B\* and R\* are not inverted with respect to signals A, B and R.

Fault value (r0949, interpret binary):

Bits 0 ... 15: Only for internal Siemens troubleshooting.

Bit 16: Error track A.

Bit 17: Error track B.

Bit 18: Error track R.

Note:

For SMC30 (order no.. 6SL3055-0AA00-5CA0 and 6SL3055-0AA00-5CA1 only), CUA32, and CU310, the following applies:

A square-wave encoder without track R is used and track monitoring (p0405.2 = 1) is activated.

**Remedy:**

- Check the encoder/cable.

- Does the encoder supply signals and the associated inverted signals?

Note:

For SMC30 (order no. 6SL3055-0AA00-5CA0 and 6SL3055-0AA00-5CA1 only), the following applies:

- check the setting of p0405 (p0405.2 = 1 is only possible if the encoder is connected at X520).

For a square-wave encoder without track R, the following jumpers must be set for the connection at X520 (SMC30) or X23 (CUA32, CU310):

- pin 10 (reference signal R) <--> pin 7 (encoder power supply, ground)

- pin 11 (reference signal R inverted) <--> pin 4 (encoder power supply)

Reaction upon N: NONE

Acknowl. upon N: NONE

Reaction upon A: NONE

Acknowl. upon A: NONE

---

**F32118 (N, A) Encoder 2: Speed difference outside the tolerance range**

**Message value:** %1

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** OFF1 (IASC/DCBRK, NONE, OFF2, OFF3)

**Acknowledge:** PULSE INHIBIT

**Cause:** For an HTL/TTL encoder, the speed difference has exceeded the value in p0492 over several sampling cycles. The change to the averaged speed actual value - if applicable - is monitored in the current controller sampling time.

Fault value (r0949, interpret decimal):

Only for internal Siemens troubleshooting.

See also: p0492 (Square-wave encoder maximum speed difference per sampling cycle)

**Remedy:**

- check the tachometer feeder cable for interruptions.

- check the grounding of the tachometer shielding.

- if required, increase the maximum speed difference per sampling cycle (p0492).

Reaction upon N: NONE

Acknowl. upon N: NONE

Reaction upon A: NONE

Acknowl. upon A: NONE

---

**F32120 (N, A) Encoder 2: Power supply voltage fault**

**Message value:** Fault cause: %1 bin

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** OFF1 (IASC/DCBRK, NONE, OFF2, OFF3)

**Acknowledge:** PULSE INHIBIT

**Cause:** A power supply fault was detected for encoder 2.

Fault value (r0949, interpret binary):

Bit 0: Undervoltage condition on the sense line.

Bit 1: Overcurrent condition for the encoder power supply.

Bit 2: Overcurrent condition for encoder power supply on cable resolver excitation negative.

Bit 3: Overcurrent condition for encoder power supply on cable resolver excitation positive.

Bit 4: The 24 V power supply through the Power Module (PM) is overloaded.

Bit 5: Overcurrent at the EnDat connection of the converter.

Bit 6: Overvoltage at the EnDat connection of the converter.

Bit 7: Hardware fault at the EnDat connection of the converter.

Note:

If the encoder cables 6FX2002-2EQ00-.... and 6FX2002-2CH00-.... are interchanged, this can result in the encoder being destroyed because the pins of the operating voltage are reversed.

<b>Remedy:</b>	<p>Re fault value, bit 0 = 1:</p> <ul style="list-style-type: none"> <li>- correct encoder cable connected?</li> <li>- check the plug connections of the encoder cable.</li> <li>- SMC30: Check the parameterization (p0404.22).</li> </ul> <p>Re fault value, bit 1 = 1:</p> <ul style="list-style-type: none"> <li>- correct encoder cable connected?</li> <li>- replace the encoder or encoder cable</li> </ul> <p>Re fault value, bit 2 = 1:</p> <ul style="list-style-type: none"> <li>- correct encoder cable connected?</li> <li>- replace the encoder or encoder cable</li> </ul> <p>Re fault value, bit 3 = 1:</p> <ul style="list-style-type: none"> <li>- correct encoder cable connected?</li> <li>- replace the encoder or encoder cable</li> </ul> <p>Re fault value, bit 5 = 1:</p> <ul style="list-style-type: none"> <li>- Measuring unit correctly connected at the converter?</li> <li>- Replace the measuring unit or the cable to the measuring unit.</li> </ul> <p>Re fault value, bit 6, 7 = 1:</p> <ul style="list-style-type: none"> <li>- Replace the defective EnDat 2.2 converter.</li> </ul>
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE

---

### **F32121 (N, A) Encoder 2: Coarse position error**

<b>Message value:</b>	-
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF1 (NONE, OFF2, OFF3)
<b>Acknowledge:</b>	PULSE INHIBIT
<b>Cause:</b>	<p>For the actual value sensing, an error was detected on the module.</p> <p>As a result of this error, it must be assumed that the actual value sensing supplies an incorrect coarse position.</p>
<b>Remedy:</b>	Replace the motor with DRIVE-CLiQ or the appropriate Sensor Module.
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE

---

### **F32122 Encoder 2: Internal power supply voltage faulty**

<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF1
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>Fault in internal reference voltage of ASICs for encoder 2.</p> <p>Fault value (r0949, interpret decimal):</p> <p>1: Reference voltage error.</p> <p>2: Internal undervoltage.</p> <p>3: Internal overvoltage.</p>
<b>Remedy:</b>	Replace the motor with DRIVE-CLiQ or the appropriate Sensor Module.

---

### **F32123 (N, A) Encoder 2: Signal level A/B unipolar outside tolerance**

<b>Message value:</b>	Fault cause: %1 bin
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF1 (IASC/DCBRK, NONE, OFF2, OFF3)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>The unipolar level (AP/AN or BP/BN) for encoder 2 is outside the permissible tolerance.</p> <p>Fault value (r0949, interpret binary):</p> <p>Bit 0 = 1: Either AP or AN outside the tolerance.</p> <p>Bit 16 = 1: Either BP or BN outside the tolerance.</p> <p>The unipolar nominal signal level of the encoder must lie in the range 2500 mV +/- 500 mV.</p>

The response thresholds are < 1700 mV and > 3300 mV.

Note:

The signal level is not evaluated unless the following conditions are satisfied:

- Sensor Module properties available (r0459.31 = 1).
- Monitoring active (p0437.31 = 1).

**Remedy:**

- make sure that the encoder cables and shielding are installed in an EMC-compliant manner.
- check the plug connections and contacts of the encoder cable.
- check the short-circuit of a signal cable with mass or the operating voltage.
- replace the encoder cable.

Reaction upon N: NONE

Acknowled. upon N: NONE

Reaction upon A: NONE

Acknowled. upon A: NONE

---

**F32125 (N, A) Encoder 2: Amplitude error track A or B overcontrolled**

**Message value:** A track: %1, B-track: %2

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** OFF1 (IASC/DCBRK, NONE, OFF2, OFF3, STOP1, STOP2)

**Acknowledge:** PULSE INHIBIT

**Cause:** The amplitude of track A or B for encoder 2 exceeds the permissible tolerance band.

Fault value (r0949, interpret hexadecimal):

yyyyxxxx hex:

yyyy = Signal level, track B (16 bits with sign).

xxxx = Signal level, track A (16 bits with sign).

The nominal signal level of the encoder must lie in the range 375 mV to 600 mV (500 mV -25/+20 %).

The response threshold is > 750 mV. This fault also occurs if the A/D converter is overcontrolled.

A signal level of 500 mV peak value corresponds to the numerical value 5333 hex = 21299 dec.

Note for sensors modules for resolvers (e. g. SMC10):

The nominal signal level is at 2900 mV (2.0 Vrms). The response threshold is > 3582 mV.

A signal level of 2900 mV peak value corresponds to the numerical value 6666 hex = 26214 dec.

Note:

The analog values of the amplitude error are not measured at the same time with the hardware fault output by the Sensor Module.

**Remedy:**

- check that the encoder cables and shielding are routed in compliance with EMC.
- replace the encoder or encoder cable

Reaction upon N: NONE

Acknowled. upon N: NONE

Reaction upon A: NONE

Acknowled. upon A: NONE

---

**F32126 (N, A) Encoder 2: Amplitude AB too high**

**Message value:** Amplitude: %1, Angle: %2

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** OFF1 (IASC/DCBRK, NONE, OFF2, OFF3, STOP1, STOP2)

**Acknowledge:** PULSE INHIBIT

**Cause:** The amplitude (root of  $A^2 + B^2$  or  $|A| + |B|$ ) for encoder 2 exceeds the permissible tolerance.

Fault value (r0949, interpret hexadecimal):

yyyyxxxx hex:

yyyy = Angle

xxxx = Amplitude, i.e. root from  $A^2 + B^2$  (16 bits without sign)

The nominal signal level of the encoder must lie in the range 375 mV to 600 mV (500 mV -25/+20 %).

The response threshold for  $(|A| + |B|)$  is > 1120 mV or the root of  $(A^2 + B^2) > 955$  mV.

A signal level of 500 mV peak value corresponds to the numerical value of 299A hex = 10650 dec.

The angle 0 ... FFFF hex corresponds to 0 ... 360 degrees of the fine position. Zero degrees is present at the negative zero crossover of track B.

Note:

The analog values of the amplitude error are not measured at the same time with the hardware fault output by the Sensor Module.

**Remedy:**

- check that the encoder cables and shielding are routed in compliance with EMC.
- replace the encoder or encoder cable

Reaction upon N: NONE

Acknowl. upon N: NONE

Reaction upon A: NONE

Acknowl. upon A: NONE

---

**F32129 (N, A) Encoder 2: Position difference hall sensor/track C/D and A/B too large**

**Message value:** %1

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** OFF1 (IASC/DCBRK, NONE, OFF2, OFF3)

**Acknowledge:** PULSE INHIBIT

**Cause:**

The error for track C/D is greater than +/-15 ° mechanical or +/-60 ° electrical or the error for the Hall signals is greater than +/-60 ° electrical.

One period of track C/D corresponds to 360 ° mechanical.

One period of the Hall signal corresponds to 360 ° electrical.

The monitoring responds if, for example, Hall sensors are connected as equivalent for the C/D tracks with the incorrect rotational sense or supply values that are not accurate enough.

After the fine synchronization using one reference mark or 2 reference marks for distance-coded encoders, this fault is no longer initiated, but instead, Alarm A32429.

Fault value (r0949, interpret decimal):

For track C/D, the following applies:

Measured deviation as mechanical angle (16 bits with sign, 182 dec corresponds to 1 °).

For Hall signals, the following applies:

Measured deviation as electrical angle (16 bits with sign, 182 dec corresponds to 1 °).

**Remedy:**

- track C or D not connected.
- correct the direction of rotation of the Hall sensor possibly connected as equivalent for track C/D.
- check that the encoder cables are routed in compliance with EMC.
- check the adjustment of the Hall sensor.

Reaction upon N: NONE

Acknowl. upon N: NONE

Reaction upon A: NONE

Acknowl. upon A: NONE

---

**F32130 (N, A) Encoder 2: Zero mark and position error from the coarse synchronization**

**Message value:** Angular deviation, electrical: %1, angle, mechanical: %2

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** OFF1 (IASC/DCBRK, NONE, OFF2, OFF3, STOP1, STOP2)

**Acknowledge:** PULSE INHIBIT

**Cause:**

After initializing the pole position using track C/D, Hall signals or pole position identification routine, the zero mark was detected outside the permissible range. For distance-coded encoders, the test is carried out after passing 2 zero marks. Fine synchronization was not carried out.

When initializing via track C/D (p0404) then it is checked whether the zero mark occurs in an angular range of +/-18 ° mechanical.

When initializing via Hall sensors (p0404) or pole position identification (p1982) it is checked whether the zero mark occurs in an angular range of +/-60 ° electrical.

Fault value (r0949, interpret hexadecimal):

yyyyxxxx hex

yyyy: Determined mechanical zero mark position (can only be used for track C/D).

xxxx: Deviation of the zero mark from the expected position as electrical angle.

Scaling: 32768 dec = 180 °

**Remedy:**

- check that the encoder cables are routed in compliance with EMC.
- check the plug connections
- if the Hall sensor is used as an equivalent for track C/D, check the connection.
- Check the connection of track C or D.
- replace the encoder or encoder cable

Reaction upon N: NONE

Acknowl. upon N: NONE



Reaction upon A: NONE  
Acknowl. upon A: NONE

---

<b>F32131 (N, A)</b>	<b>Encoder 2: Deviation position incremental/absolute too large</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF1 (IASC/DCBRK, NONE, OFF2, OFF3, STOP1, STOP2)
<b>Acknowledge:</b>	PULSE INHIBIT
<b>Cause:</b>	<p>Absolute encoder: When cyclically reading the absolute position, an excessively high difference to the incremental position was detected. The absolute position that was read is rejected. Limit value for the deviation: - EnDat encoder: Is supplied from the encoder and is a minimum of 2 quadrants (e.g. EQI 1325 &gt; 2 quadrants, EQN 1325 &gt; 50 quadrants). - other encoders: 15 pulses = 60 quadrants.</p> <p>Incremental encoder: When the zero pulse is passed, a deviation in the incremental position was detected. For equidistant zero marks, the following applies: - The first zero mark passed supplies the reference point for all subsequent checks. The other zero marks must have n times the distance referred to the first zero mark. For distance-coded zero marks, the following applies: - the first zero mark pair supplies the reference point for all subsequent checks. The other zero mark pairs must have the expected distance to the first zero mark pair. Fault value (r0949, interpret decimal): Deviation in quadrants (1 pulse = 4 quadrants).</p>
<b>Remedy:</b>	<ul style="list-style-type: none"><li>- check that the encoder cables are routed in compliance with EMC.</li><li>- check the plug connections</li><li>- replace the encoder or encoder cable</li><li>- check whether the coding disk is dirty or there are strong ambient magnetic fields.</li><li>- adapt the parameter for the clearance between zero marks (p0425).</li><li>- if message output above speed threshold, reduce filter time if necessary (p0438).</li></ul>
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE

---

<b>F32135</b>	<b>Encoder 2: Fault when determining the position</b>
<b>Message value:</b>	Fault cause: %1 bin
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF1 (IASC/DCBRK, NONE, OFF2, OFF3)
<b>Acknowledge:</b>	PULSE INHIBIT
<b>Cause:</b>	<p>The encoder supplies status information bit by bit in an internal status/fault word. Some of these bits cause this fault to be triggered. Other bits are status displays. The status/fault word is displayed in the fault value. Note regarding the bit designation: The first designation is valid for DRIVE-CLiQ encoders, the second for EnDat 2.2 encoders. Fault value (r0949, interpret binary): Bit 0: F1 (safety status display). Bit 1: F2 (safety status display). Bit 2: Reserved (lighting). Bit 3: Reserved (signal amplitude). Bit 4: Reserved (position value). Bit 5: Reserved (overvoltage). Bit 6: Reserved (undervoltage)/hardware fault EnDat supply (--&gt; F3x110, x = 1, 2, 3). Bit 7: Reserved (overcurrent)/EnDat encoder withdrawn when not in the parked state (--&gt; F3x110, x = 1, 2, 3). Bit 8: Reserved (battery)/overcurrent EnDat supply (--&gt; F3x110, x = 1, 2, 3). Bit 9: Reserved/overvoltage EnDat supply (--&gt; F3x110, x = 1, 2, 3). Bit 11: Reserved/internal communication error (--&gt; F3x110, x = 1, 2, 3). Bit 12: Reserved/internal communication error (--&gt; F3x110, x = 1, 2, 3). Bit 13: Reserved/internal communication error (--&gt; F3x110, x = 1, 2, 3).</p>

Bit 14: Reserved/internal communication error (--> F3x110, x = 1, 2, 3).  
 Bit 15: Internal communication error (--> F3x110, x = 1, 2, 3).  
 Bit 16: Lighting (--> F3x135, x = 1, 2, 3).  
 Bit 17: Signal amplitude (--> F3x135, x = 1, 2, 3).  
 Bit 18: Singleturn position 1 (--> F3x135, x = 1, 2, 3).  
 Bit 19: Overvoltage (--> F3x135, x = 1, 2, 3).  
 Bit 20: Undervoltage (--> F3x135, x = 1, 2, 3).  
 Bit 21: Overcurrent (--> F3x135, x = 1, 2, 3).  
 Bit 22: Temperature exceeded (--> F3x405, x = 1, 2, 3).  
 Bit 23: Singleturn position 2 (safety status display).  
 Bit 24: Singleturn system (--> F3x135, x = 1, 2, 3).  
 Bit 25: Singleturn power down (--> F3x135, x = 1, 2, 3).  
 Bit 26: Multiturn position 1 (--> F3x136, x = 1, 2, 3).  
 Bit 27: Multiturn position 2 (--> F3x136, x = 1, 2, 3).  
 Bit 28: Multiturn system (--> F3x136, x = 1, 2, 3).  
 Bit 29: Multiturn power down (--> F3x136, x = 1, 2, 3).  
 Bit 30: Multiturn overflow/underflow (--> F3x136, x = 1, 2, 3).  
 Bit 31: Multiturn battery (reserved).

**Remedy:**

- determine the detailed cause of the fault using the fault value.
- replace the encoder if necessary.

Note:

An EnDat 2.2 encoder may only be removed and inserted in the "Park" state.

If an EnDat 2.2 encoder was removed when not in the "Park" state, then after inserting the encoder, a POWER ON (switch-off/on) is necessary to acknowledge the fault.

### F32136

### Encoder 2: Error when determining multiturn information

**Message value:** Fault cause: %1 bin

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** OFF1 (IASC/DCBRK, NONE, OFF2, OFF3)

**Acknowledge:** PULSE INHIBIT

**Cause:** The encoder supplies status information bit by bit in an internal status/fault word. Some of these bits cause this fault to be triggered. Other bits are status displays. The status/fault word is displayed in the fault value.

Note regarding the bit designation:

The first designation is valid for DRIVE-CLiQ encoders, the second for EnDat 2.2 encoders.

Fault value (r0949, interpret binary):

Bit 0: F1 (safety status display).

Bit 1: F2 (safety status display).

Bit 2: Reserved (lighting).

Bit 3: Reserved (signal amplitude).

Bit 4: Reserved (position value).

Bit 5: Reserved (overvoltage).

Bit 6: Reserved (undervoltage)/hardware fault EnDat supply (--> F3x110, x = 1, 2, 3).

Bit 7: Reserved (overcurrent)/EnDat encoder withdrawn when not in the parked state (--> F3x110, x = 1, 2, 3).

Bit 8: Reserved (battery)/overcurrent EnDat supply (--> F3x110, x = 1, 2, 3).

Bit 9: Reserved/overvoltage EnDat supply (--> F3x110, x = 1, 2, 3).

Bit 11: Reserved/internal communication error (--> F3x110, x = 1, 2, 3).

Bit 12: Reserved/internal communication error (--> F3x110, x = 1, 2, 3).

Bit 13: Reserved/internal communication error (--> F3x110, x = 1, 2, 3).

Bit 14: Reserved/internal communication error (--> F3x110, x = 1, 2, 3).

Bit 15: Internal communication error (--> F3x110, x = 1, 2, 3).

Bit 16: Lighting (--> F3x135, x = 1, 2, 3).

Bit 17: Signal amplitude (--> F3x135, x = 1, 2, 3).

Bit 18: Singleturn position 1 (--> F3x135, x = 1, 2, 3).

Bit 19: Overvoltage (--> F3x135, x = 1, 2, 3).

Bit 20: Undervoltage (--> F3x135, x = 1, 2, 3).

Bit 21: Overcurrent (--> F3x135, x = 1, 2, 3).

Bit 22: Temperature exceeded (--> F3x405, x = 1, 2, 3).

Bit 23: Singleturn position 2 (safety status display).

Bit 24: Singleturn system (--> F3x135, x = 1, 2, 3).

Bit 25: Singleturn power down (--> F3x135, x = 1, 2, 3).

Bit 26: Multiturn position 1 (--> F3x136, x = 1, 2, 3).

Bit 27: Multiturn position 2 (--> F3x136, x = 1, 2, 3).  
 Bit 28: Multiturn system (--> F3x136, x = 1, 2, 3).  
 Bit 29: Multiturn power down (--> F3x136, x = 1, 2, 3).  
 Bit 30: Multiturn overflow/underflow (--> F3x136, x = 1, 2, 3).  
 Bit 31: Multiturn battery (reserved).

**Remedy:**

- determine the detailed cause of the fault using the fault value.
- replace the encoder if necessary.

Note:

An EnDat 2.2 encoder may only be removed and inserted in the "Park" state.

If an EnDat 2.2 encoder was removed when not in the "Park" state, then after inserting the encoder, a POWER ON (switch-off/on) is necessary to acknowledge the fault.

---

### F32137 Encoder 2: Internal fault when determining the position

**Message value:** Fault cause: %1 bin

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** OFF1 (IASC/DCBRK, NONE, OFF2, OFF3)

**Acknowledge:** PULSE INHIBIT

**Cause:** A position determination fault has occurred in the DRIVE-CLiQ encoder.

Fault value (r0949, interpret binary):

yyxxxxxx hex: yy = encoder version, xxxxxx = bit coding of the fault cause

For yy = 08 hex (bit 27 = 1), the following bit definition applies:

Bit 0: Control range of the transmit current control has been exited.

Bit 1: Amplitude fault.

Bit 2: Temperature outside the thresholds.

Bit 3: Synchronization fault, counter/interpolator.

Bit 4: Configuration error.

Bit 5: Conversion time of the interpolator fallen below.

Bit 6: Error when reading out the absolute value.

Bit 7: Externally signaled fault.

Bit 8: F1 (safety status display).

Bit 9: F2 (safety status display).

Bit 16: Transmit current fault.

Bit 17: Error multiturn interface

Bit 18: Internal data error (single-step error).

Bit 19: Error EEPROM interface.

Bit 20: SAR converter error.

Bit 21: Error, internal register data transfer.

Bit 22: External fault.

Bit 23: Temperature signal.

Note:

For an encoder version that is not described here, please contact the encoder manufacturer for more detailed information on the bit coding.

**Remedy:**

- determine the detailed cause of the fault using the fault value.
- if required, replace the DRIVE-CLiQ encoder.

---

### F32138 Encoder 2: Internal error when determining multiturn information

**Message value:** Fault cause: %1 bin

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** OFF1 (IASC/DCBRK, NONE, OFF2, OFF3)

**Acknowledge:** PULSE INHIBIT

**Cause:** A position determination fault has occurred in the DRIVE-CLiQ encoder.

Fault value (r0949, interpret binary):

yyxxxxxx hex: yy = encoder version, xxxxxx = bit coding of the fault cause

For yy = 08 hex (bit 27 = 1), the following bit definition applies:

Bit 0: Control range of the transmit current control has been exited.

Bit 1: Amplitude fault.

Bit 2: Temperature outside the thresholds.

Bit 3: Synchronization fault, counter/interpolator.

Bit 4: Configuration error.

Bit 5: Conversion time of the interpolator fallen below.

Bit 6: Error when reading out the absolute value.

Bit 7: Externally signaled fault.  
 Bit 8: F1 (safety status display).  
 Bit 9: F2 (safety status display).  
 Bit 16: Transmit current fault.  
 Bit 17: Error multitrack interface  
 Bit 18: Internal data error (single-step error).  
 Bit 19: Error EEPROM interface.  
 Bit 20: SAR converter error.  
 Bit 21: Error, internal register data transfer.  
 Bit 22: External fault.  
 Bit 23: Temperature signal.  
 Note:  
 For an encoder version that is not described here, please contact the encoder manufacturer for more detailed information on the bit coding.

**Remedy:**

- determine the detailed cause of the fault using the fault value.
- if required, replace the DRIVE-CLiQ encoder.

---

**F32150 (N, A) Encoder 2: Initialization error**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF1 (IASC/DCBRK, NONE, OFF2, OFF3, STOP1, STOP2)  
**Acknowledge:** PULSE INHIBIT  
**Cause:** Encoder functionality selected in p0404 is not operating correctly.  
 Fault value (r0949, interpret hexadecimal):  
 Encoder malfunction.  
 The bit assignment corresponds to that of p0404 (e.g. bit 5 set: Error track C/D).

**Remedy:**

- Check that p0404 is correctly set.
- check the encoder type used (incremental/absolute) and for SMCxx, the encoder cable.
- if relevant, note additional fault messages that describe the fault in detail.

Reaction upon N: NONE  
 Acknowl. upon N: NONE  
 Reaction upon A: NONE  
 Acknowl. upon A: NONE

---

**F32151 (N, A) Encoder 2: Encoder speed for initialization AB too high**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF1 (IASC/DCBRK, NONE, OFF2, OFF3, STOP1, STOP2)  
**Acknowledge:** PULSE INHIBIT  
**Cause:** The encoder speed is too high during while initializing the sensor.  
**Remedy:** Reduce the speed of the encoder accordingly during initialization.  
 If necessary, de-activate monitoring (p0437.29).  
 See also: p0437 (Sensor Module configuration extended)

Reaction upon N: NONE  
 Acknowl. upon N: NONE  
 Reaction upon A: NONE  
 Acknowl. upon A: NONE

---

**F32152 (N, A) Encoder 2: Maximum input frequency exceeded**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF1 (IASC/DCBRK, NONE, OFF2, OFF3, STOP1, STOP2)  
**Acknowledge:** PULSE INHIBIT  
**Cause:** The maximum input frequency of the encoder evaluation has been exceeded.  
 Fault value (r0949, interpret decimal):  
 Actual input frequency in Hz.  
 See also: p0408 (Rotary encoder pulse number)

**Remedy:**           - Reduce the speed.  
                  - Use an encoder with a lower pulse number (p0408).

Reaction upon N:   NONE  
Acknowl. upon N:   NONE  
Reaction upon A:   NONE  
Acknowl. upon A:   NONE

---

**F32160 (N, A)   Encoder 2: Analog sensor channel A failed**

**Message value:**   %1  
**Drive object:**    DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:**        OFF1 (IASC/DCBRK, NONE)  
**Acknowledge:**    PULSE INHIBIT  
**Cause:**          The input voltage of the analog sensor is outside the permissible limits.  
                  Fault value (r0949, interpret decimal):  
                  1: Input voltage outside detectable measuring range.  
                  2: Input voltage outside the measuring range set in (p4673).  
                  3: The absolute value of the input voltage has exceeded the range limit (p4676).

**Remedy:**          For fault value = 1:  
                  - check the output voltage of the analog sensor.  
                  For fault value = 2:  
                  - check the voltage setting for each encoder period (p4673).  
                  For fault value = 3:  
                  - check the range limit setting and increase it if necessary (p4676).

Reaction upon N:   NONE  
Acknowl. upon N:   NONE  
Reaction upon A:   NONE  
Acknowl. upon A:   NONE

---

**F32161 (N, A)   Encoder 2: Analog sensor channel B failed**

**Message value:**   %1  
**Drive object:**    DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:**        OFF1 (IASC/DCBRK, NONE)  
**Acknowledge:**    PULSE INHIBIT  
**Cause:**          The input voltage of the analog sensor is outside the permissible limits.  
                  Fault value (r0949, interpret decimal):  
                  1: Input voltage outside detectable measuring range.  
                  2: Input voltage outside the measuring range set in (p4675).  
                  3: The absolute value of the input voltage has exceeded the range limit (p4676).

**Remedy:**          For fault value = 1:  
                  - check the output voltage of the analog sensor.  
                  For fault value = 2:  
                  - check the voltage setting for each encoder period (p4675).  
                  For fault value = 3:  
                  - check the range limit setting and increase it if necessary (p4676).

Reaction upon N:   NONE  
Acknowl. upon N:   NONE  
Reaction upon A:   NONE  
Acknowl. upon A:   NONE

---

**F32163 (N, A)   Encoder 2: Analog sensor position value exceeds limit value**

**Message value:**   %1  
**Drive object:**    DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:**        OFF1 (IASC/DCBRK, NONE)  
**Acknowledge:**    PULSE INHIBIT  
**Cause:**          The position value has exceeded the permissible range of -0.5 ... +0.5.

	<p>Fault value (r0949, interpret decimal):</p> <p>1: Position value from the LVDT sensor.</p> <p>2: Position value from the encoder characteristic.</p>
<b>Remedy:</b>	<p>For fault value = 1:</p> <ul style="list-style-type: none"> <li>- Check the LVDT ratio (p4678).</li> <li>- check the reference signal connection at track B.</li> </ul> <p>For fault value = 2:</p> <ul style="list-style-type: none"> <li>- check the coefficients of the characteristic (p4663 ... p4666).</li> </ul>
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE

---

<b>A32400 (F, N)</b>	<b>Encoder 2: Alarm threshold zero mark distance error</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>The measured zero mark distance does not correspond to the parameterized zero mark distance.</p> <p>For distance-coded encoders, the zero mark distance is determined from zero marks detected pairs. This means that if a zero mark is missing, depending on the pair generation, this cannot result in a fault and also has no effect in the system.</p> <p>The zero mark distance for the zero mark monitoring is set in p0425 (rotary encoder) or p0424 (linear encoder).</p> <p>Alarm value (r2124, interpret decimal):</p> <p>Last measured zero mark distance in increments (4 increments = 1 encoder pulse).</p> <p>The sign designates the direction of motion when detecting the zero mark distance.</p>
<b>Remedy:</b>	<ul style="list-style-type: none"> <li>- check that the encoder cables are routed in compliance with EMC.</li> <li>- check the plug connections</li> <li>- check the encoder type (encoder with equidistant zero marks).</li> <li>- adapt the parameter for the distance between zero marks (p0424, p0425).</li> <li>- replace the encoder or encoder cable</li> </ul>
Reaction upon F:	NONE (IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)
Acknowl. upon F:	IMMEDIATELY
Reaction upon N:	NONE
Acknowl. upon N:	NONE

---

<b>A32401 (F, N)</b>	<b>Encoder 2: Alarm threshold zero mark failed</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>The 1.5 x parameterized zero mark distance was exceeded.</p> <p>The zero mark distance for the zero mark monitoring is set in p0425 (rotary encoder) or p0424 (linear encoder).</p> <p>Alarm value (r2124, interpret decimal):</p> <p>Number of increments after POWER ON or since the last zero mark that was detected (4 increments = 1 encoder pulse).</p>
<b>Remedy:</b>	<ul style="list-style-type: none"> <li>- check that the encoder cables are routed in compliance with EMC.</li> <li>- check the plug connections</li> <li>- check the encoder type (encoder with equidistant zero marks).</li> <li>- adapt the parameter for the clearance between zero marks (p0425).</li> <li>- replace the encoder or encoder cable</li> </ul>
Reaction upon F:	NONE (IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)
Acknowl. upon F:	IMMEDIATELY
Reaction upon N:	NONE
Acknowl. upon N:	NONE

---

<b>F32405 (N, A)</b>	<b>Encoder 2: Temperature in the encoder evaluation inadmissible</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF1 (IASC/DCBRK, NONE, OFF2, OFF3, STOP1, STOP2)
<b>Acknowledge:</b>	IMMEDIATELY (POWER ON)
<b>Cause:</b>	The encoder evaluation for a motor with DRIVE-CLiQ has detected an inadmissible temperature. The fault threshold is 125 ° C. Alarm value (r2124, interpret decimal): Measured board/module temperature in 0.1 °C.
<b>Remedy:</b>	Reduce the ambient temperature for the DRIVE-CLiQ connection of the motor.
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE

---

<b>A32407 (F, N)</b>	<b>Encoder 2: Function limit reached</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	The encoder has reached one of its function limits. A service is recommended. Alarm value (r2124, interpret decimal): 1 : Incremental signals 3 : Absolute track 4 : Code connection
<b>Remedy:</b>	Perform service. Replace the encoder if necessary. Note: The actual functional reserve of an encoder can be displayed via r4651. See also: p4650 (Encoder functional reserve component number), r4651 (Encoder functional reserve)
Reaction upon F:	NONE (IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)
Acknowl. upon F:	IMMEDIATELY
Reaction upon N:	NONE
Acknowl. upon N:	NONE

---

<b>A32410 (F, N)</b>	<b>Encoder 2: Serial communications</b>
<b>Message value:</b>	Fault cause: %1 bin
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	Serial communication protocol transfer error between the encoder and evaluation module. Alarm value (r2124, interpret binary): Bit 0: Alarm bit in the position protocol. Bit 1: Incorrect quiescent level on the data line. Bit 2: Encoder does not respond (does not supply a start bit within 50 ms). Bit 3: CRC error: The checksum in the protocol from the encoder does not match the data. Bit 4: Encoder acknowledgement error: The encoder incorrectly understood the task (request) or cannot execute it. Bit 5: Internal error in the serial driver: An illegal mode command was requested. Bit 6: Timeout when cyclically reading. Bit 8: Protocol is too long (e.g. > 64 bits). Bit 9: Receive buffer overflow. Bit 10: Frame error when reading twice. Bit 11: Parity error. Bit 12: Data line signal level error during the monoflop time.
<b>Remedy:</b>	- check that the encoder cables are routed in compliance with EMC. - check the plug connections - replace encoder.

---

Reaction upon F: NONE (IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)  
 Acknowl. upon F: IMMEDIATELY  
 Reaction upon N: NONE  
 Acknowl. upon N: NONE

---

**A32411 (F, N) Encoder 2: Absolute encoder signals internal alarms**

**Message value:** Fault cause: %1 bin, additional information: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The absolute encoder fault word includes alarm bits that have been set.  
 Alarm value (r2124, interpret binary):  
 yyyxxxxx hex: yyyy = supplementary information, xxxx = fault cause  
 yyyy = 0:  
 Bit 0: Frequency exceeded (speed too high).  
 Bit 1: Temperature exceeded.  
 Bit 2: Control reserve, lighting system exceeded.  
 Bit 3: Battery discharged.  
 Bit 4: Reference point passed.  
 yyyy = 1:  
 Bit 0: Signal amplitude outside the control range.  
 Bit 1: Error multiturn interface  
 Bit 2: Internal data error (singleturn/multiturn not with single steps).  
 Bit 3: Error EEPROM interface.  
 Bit 4: SAR converter error.  
 Bit 5: Fault for the register data transfer.  
 Bit 6: Internal error identified at the error pin (nErr).  
 Bit 7: Temperature threshold exceeded or fallen below.  
**Remedy:** Replace encoder.  
 Reaction upon F: NONE (IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)  
 Acknowl. upon F: IMMEDIATELY  
 Reaction upon N: NONE  
 Acknowl. upon N: NONE

---

**A32412 (F, N) Encoder 2: Error bit set in the serial protocol**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The encoder sends a set error bit via the serial protocol.  
 Alarm value (r2124, interpret binary):  
 Bit 0: Fault bit in the position protocol.  
 Bit 1: Alarm bit in the position protocol.  
**Remedy:**  
 - carry out a POWER ON (power off/on) for all components.  
 - check that the encoder cables are routed in compliance with EMC.  
 - check the plug connections  
 - replace encoder.  
 Reaction upon F: NONE (IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)  
 Acknowl. upon F: IMMEDIATELY  
 Reaction upon N: NONE  
 Acknowl. upon N: NONE



<hr/>	
<b>A32414 (F, N)</b>	<b>Encoder 2: Amplitude error track C or D (<math>C^2 + D^2</math>)</b>
<b>Message value:</b>	C track: %1, D track: %2
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>The amplitude (<math>C^2 + D^2</math>) of track C or D of the encoder or from the Hall signals, is not within the tolerance bandwidth.</p> <p>Alarm value (r2124, interpret hexadecimal): yyyyxxxx hex: yyyy = Signal level, track D (16 bits with sign). xxxx = Signal level, track C (16 bits with sign). The nominal signal level of the encoder must lie in the range 375 mV to 600 mV (500 mV -25/+20 %). The response thresholds are &lt; 230 mV (observe the frequency response of the encoder) and &gt; 750 mV. A signal level of 500 mV peak value corresponds to the numerical value 5333 hex = 21299 dec.</p> <p>Note: If the amplitude is not within the tolerance bandwidth, then it cannot be used to initialize the start position.</p>
<b>Remedy:</b>	<ul style="list-style-type: none"><li>- check that the encoder cables are routed in compliance with EMC.</li><li>- check the plug connections</li><li>- replace the encoder or encoder cable</li><li>- check the Sensor Module (e.g. contacts).</li><li>- check the Hall sensor box</li></ul>
Reaction upon F:	NONE (IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)
Acknowl. upon F:	IMMEDIATELY
Reaction upon N:	NONE
Acknowl. upon N:	NONE
<hr/>	
<b>N32415 (F, A)</b>	<b>Encoder 2: Amplitude alarm track A or B (<math>A^2 + B^2</math>)</b>
<b>Message value:</b>	Amplitude: %1, Angle: %2
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>The amplitude (root of <math>A^2 + B^2</math>) for encoder 2 exceeds the permissible tolerance.</p> <p>Alarm value (r2124, interpret hexadecimal): yyyyxxxx hex: yyyy = Angle xxxx = Amplitude, i.e. root from <math>A^2 + B^2</math> (16 bits without sign) The nominal signal level of the encoder must lie in the range 375 mV to 600 mV (500 mV -25/+20 %). The response threshold is &lt; 230 mV (observe the frequency response of the encoder). A signal level of 500 mV peak value corresponds to the numerical value 299A hex = 10650 dec. The angle 0 ... FFFF hex corresponds to 0 ... 360 degrees of the fine position. Zero degrees is present at the negative zero crossover of track B.</p> <p>Note for sensors modules for resolvers (e. g. SMC10): The nominal signal level is at 2900 mV (2.0 Vrms). The response threshold is &lt; 1414 mV (1.0 Vrms). A signal level of 2900 mV peak value corresponds to the numerical value 3333 hex = 13107 dec.</p> <p>Note: The analog values of the amplitude error are not measured at the same time with the hardware fault output by the Sensor Module.</p>
<b>Remedy:</b>	<ul style="list-style-type: none"><li>- check the speed range, frequency characteristic (amplitude characteristic) of the measuring equipment is not sufficient for the speed range.</li><li>- check that the encoder cables and shielding are routed in compliance with EMC.</li><li>- check the plug connections</li><li>- replace the encoder or encoder cable</li><li>- check the Sensor Module (e.g. contacts).</li><li>- if the coding disk is soiled or the lighting aged, replace the encoder.</li></ul>
Reaction upon F:	NONE (IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)
Acknowl. upon F:	IMMEDIATELY
Reaction upon A:	NONE
Acknowl. upon A:	NONE

<b>A32418 (F, N)</b>	<b>Encoder 2: Speed difference per sampling rate exceeded</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	For an HTL/TTL encoder, the speed difference between two sampling cycles has exceeded the value in p0492. The change to the averaged speed actual value - if applicable - is monitored in the current controller sampling time. Alarm value (r2124, interpret decimal): Only for internal Siemens troubleshooting. See also: p0492 (Square-wave encoder maximum speed difference per sampling cycle)
<b>Remedy:</b>	<ul style="list-style-type: none"> <li>- check the tachometer feeder cable for interruptions.</li> <li>- check the grounding of the tachometer shielding.</li> <li>- if required, increase the setting of p0492.</li> </ul>
Reaction upon F:	NONE (IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)
Acknowl. upon F:	IMMEDIATELY
Reaction upon N:	NONE
Acknowl. upon N:	NONE
<b>A32419 (F, N)</b>	<b>Encoder 2: Track A or B outside tolerance</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>The amplitude/phase/offset correction for track A or B is at the limit.</p> <p>Amplitude error correction: Amplitude B / Amplitude A = 0.78 ... 1.27</p> <p>Phase: &lt;84 degrees or &gt;96 degrees</p> <p>SMC20: Offset correction: +/-140 mV</p> <p>SMC10: Offset correction: +/-650 mV</p> <p>Alarm value (r2124, interpret hexadecimal):</p> <p>xxxx1: Minimum of the offset correction, track B</p> <p>xxxx2: Maximum of the offset correction, track B</p> <p>xxx1x: Minimum of the offset correction, track A</p> <p>xxx2x: Maximum of the offset correction, track A</p> <p>xx1xx: Minimum of the amplitude correction, track B/A</p> <p>xx2xx: Maximum of the amplitude correction, track B/A</p> <p>x1xxx: Minimum of the phase error correction</p> <p>x2xxx: Maximum of the phase error correction</p> <p>1xxxx: Minimum of the cubic correction</p> <p>2xxxx: Maximum of the cubic correction</p>
<b>Remedy:</b>	<ul style="list-style-type: none"> <li>- check mechanical mounting tolerances for encoders without their own bearings (e.g. toothed-wheel encoders).</li> <li>- check the plug connections (also the transition resistance).</li> <li>- check the encoder signals.</li> <li>- replace the encoder or encoder cable</li> </ul>
Reaction upon F:	NONE (IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)
Acknowl. upon F:	IMMEDIATELY
Reaction upon N:	NONE
Acknowl. upon N:	NONE
<b>A32421 (F, N)</b>	<b>Encoder 2: Coarse position error</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	For the actual value sensing, an error was detected. As a result of this error, it must be assumed that the actual value sensing supplies an incorrect coarse position.

Alarm value (r2124, interpret decimal):

3: The absolute position of the serial protocol and track A/B differ by half an encoder pulse. The absolute position must have its zero position in the quadrants in which both tracks are negative. In the case of a fault, the position can be incorrect by one encoder pulse.

**Remedy:**

Re alarm value = 3:

- For a standard encoder with cable, contact the manufacturer where relevant.
- correct the assignment of the tracks to the position value that is serially transferred. To do this, the two tracks must be connected, inverted, at the Sensor Module (interchange A with A\* and B with B\*) or, for a programmable encoder, check the zero offset of the position.

Reaction upon F: NONE (IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)

Acknowl. upon F: IMMEDIATELY

Reaction upon N: NONE

Acknowl. upon N: NONE

---

**A32422 (F, N) Encoder 2: Pulses per revolution square-wave encoder outside tolerance bandwidth**

**Message value:** %1

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** NONE

**Acknowledge:** NONE

**Cause:** The measured zero mark distance does not correspond to the parameterized zero mark distance.  
This alarm is triggered with active square-wave encoder PPR correction and re-parameterized fault 31131 if the accumulator contains larger values than p4683 or p4684.  
The zero mark distance for zero mark monitoring is set in p0425 (rotary encoder).  
Alarm value (r2124, interpret decimal):  
accumulated differential pulses in encoder pulses.

**Remedy:**

- check that the encoder cables are routed in compliance with EMC.
- check the plug connections
- check the encoder type (encoder with equidistant zero marks).
- adapt the parameter for the distance between zero marks (p0424, p0425).
- replace the encoder or encoder cable

Reaction upon F: NONE (IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)

Acknowl. upon F: IMMEDIATELY

Reaction upon N: NONE

Acknowl. upon N: NONE

---

**A32429 (F, N) Encoder 2: Position difference hall sensor/track C/D and A/B too large**

**Message value:** %1

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** NONE

**Acknowledge:** NONE

**Cause:** The error for track C/D is greater than +/-15 ° mechanical or +/-60 ° electrical or the error for the Hall signals is greater than +/-60 ° electrical.  
One period of track C/D corresponds to 360 ° mechanical.  
One period of the Hall signal corresponds to 360 ° electrical.  
The monitoring responds if, for example, Hall sensors are connected as equivalent for the C/D tracks with the incorrect rotational sense or supply values that are not accurate enough.  
Alarm value (r2124, interpret decimal):  
For track C/D, the following applies:  
Measured deviation as mechanical angle (16 bits with sign, 182 dec corresponds to 1 °).  
For Hall signals, the following applies:  
Measured deviation as electrical angle (16 bits with sign, 182 dec corresponds to 1 °).

**Remedy:**

- track C or D not connected.
- correct the direction of rotation of the Hall sensor possibly connected as equivalent for track C/D.
- check that the encoder cables are routed in compliance with EMC.
- check the adjustment of the Hall sensor.

Reaction upon F: NONE (IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)

Acknowl. upon F: IMMEDIATELY

Reaction upon N: NONE  
Acknowl. upon N: NONE

---

<b>A32431 (F, N)</b>	<b>Encoder 2: Deviation position incremental/absolute too large</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>When the zero pulse is passed, a deviation in the incremental position was detected.</p> <p>For equidistant zero marks, the following applies:</p> <ul style="list-style-type: none"> <li>- The first zero mark passed supplies the reference point for all subsequent checks. The other zero marks must have n times the distance referred to the first zero mark.</li> </ul> <p>For distance-coded zero marks, the following applies:</p> <ul style="list-style-type: none"> <li>- the first zero mark pair supplies the reference point for all subsequent checks. The other zero mark pairs must have the expected distance to the first zero mark pair.</li> </ul> <p>Alarm value (r2124, interpret decimal):</p> <p>Deviation in quadrants (1 pulse = 4 quadrants).</p>
<b>Remedy:</b>	<ul style="list-style-type: none"> <li>- check that the encoder cables are routed in compliance with EMC.</li> <li>- check the plug connections</li> <li>- replace the encoder or encoder cable</li> <li>- Clean coding disk or remove strong magnetic fields.</li> </ul>
Reaction upon F:	NONE (IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)
Acknowl. upon F:	IMMEDIATELY
Reaction upon N:	NONE
Acknowl. upon N:	NONE

---

<b>A32432 (F, N)</b>	<b>Encoder 2: Rotor position adaptation corrects deviation</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>For track A/B, pulses have been lost or too many have been counted. These pulses are presently being corrected.</p> <p>Alarm value (r2124, interpret decimal):</p> <p>Last measured deviation of zero mark in increments (4 increments = 1 encoder pulse).</p> <p>The sign designates the direction of motion when detecting the zero mark distance.</p>
<b>Remedy:</b>	<ul style="list-style-type: none"> <li>- check that the encoder cables are routed in compliance with EMC.</li> <li>- check the plug connections</li> <li>- replace the encoder or encoder cable</li> <li>- check encoder limit frequency.</li> <li>- adapt the parameter for the distance between zero marks (p0424, p0425).</li> </ul>
Reaction upon F:	NONE (IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)
Acknowl. upon F:	IMMEDIATELY
Reaction upon N:	NONE
Acknowl. upon N:	NONE

---

<b>A32442 (F, N)</b>	<b>Encoder 2: Battery voltage pre-alarm</b>
<b>Message value:</b>	-
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>When switched-off, the encoder uses a battery to back up the multiturn information. The battery voltage is no longer sufficient to check the multiturn information.</p>
<b>Remedy:</b>	Replace battery.
Reaction upon F:	NONE (IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)
Acknowl. upon F:	IMMEDIATELY
Reaction upon N:	NONE
Acknowl. upon N:	NONE

---

---

**A32443 (F, N) Encoder 2: Unipolar CD signal level outside specification**

**Message value:** Fault cause: %1 bin  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The unipolar level (CP/CN or DP/DN) for encoder 2 is outside the permissible tolerance.  
Alarm value (r2124, interpret binary):  
Bit 0 = 1: Either CP or CN outside the tolerance.  
Bit 16 = 1: Either DP or DN outside the tolerance.  
The unipolar nominal signal level of the encoder must lie in the range 2500 mV +/- 500 mV.  
The response thresholds are < 1700 mV and > 3300 mV.  
Note:  
The signal level is not evaluated unless the following conditions are satisfied:  
- Sensor Module properties available (r0459.31 = 1).  
- Monitoring active (p0437.31 = 1).  
**Remedy:**  
- check that the encoder cables and shielding are routed in compliance with EMC.  
- check the plug connections and contacts of the encoder cable.  
- are the C/D tracks connected correctly (have the signal lines CP and CN or DP and DN been interchanged)?  
- replace the encoder cable.  
Reaction upon F: NONE (IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)  
Acknowl. upon F: IMMEDIATELY  
Reaction upon N: NONE  
Acknowl. upon N: NONE

---

**A32460 (N) Encoder 2: Analog sensor channel A failed**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The input voltage of the analog sensor is outside the permissible limits.  
Alarm value (r2124, interpret decimal):  
1: Input voltage outside detectable measuring range.  
2: Input voltage outside measuring range set in p4673.  
3: The absolute value of the input voltage has exceeded the range limit (p4676).  
**Remedy:**  
Re alarm value = 1:  
- check the output voltage of the analog sensor.  
Re alarm value = 2:  
- check the voltage setting for each encoder period (p4673).  
Re alarm value = 3:  
- check the range limit setting and increase it if necessary (p4676).  
Reaction upon N: NONE  
Acknowl. upon N: NONE

---

**A32461 (N) Encoder 2: Analog sensor channel B failed**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The input voltage of the analog sensor is outside the permissible limits.  
Alarm value (r2124, interpret decimal):  
1: Input voltage outside detectable measuring range.  
2: Input voltage outside the measuring range set in (p4675).  
3: The absolute value of the input voltage has exceeded the range limit (p4676).  
**Remedy:**  
Re alarm value = 1:  
- check the output voltage of the analog sensor.  
Re alarm value = 2:  
- check the voltage setting for each encoder period (p4675).

Reaction upon N: NONE  
 Acknowl. upon N: NONE

---

**A32462 (N) Encoder 2: Analog sensor no channel active**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** Channel A and B are not activated for the analog sensor.  
**Remedy:** - activate channel A and/or channel B (p4670).  
 - check the encoder configuration (p0404.17).

Reaction upon N: NONE  
 Acknowl. upon N: NONE

---

**A32463 (N) Encoder 2: Analog sensor position value exceeds limit value**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The position value has exceeded the permissible range of -0.5 ... +0.5.  
 Alarm value (r2124, interpret decimal):  
 1: Position value from the LVDT sensor.  
 2: Position value from the encoder characteristic.

**Remedy:** Re alarm value = 1:  
 - Check the LVDT ratio (p4678).  
 - check the reference signal connection at track B.  
 Re alarm value = 2:  
 - check the coefficients of the characteristic (p4663 ... p4666).

Reaction upon N: NONE  
 Acknowl. upon N: NONE

---

**A32470 (F, N) Encoder 2: Soiling detected**

**Message value:** -  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** In the case of the alternative encoder system interface on the Sensor Module Cabinet 30 (SMC30), encoder soiling is signaled via a 0 signal at terminal X521.7.  
**Remedy:** - check the plug connections  
 - replace the encoder or encoder cable

Reaction upon F: NONE (IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)  
 Acknowl. upon F: IMMEDIATELY  
 Reaction upon N: NONE  
 Acknowl. upon N: NONE

---

**F32500 (N, A) Encoder 2: Position tracking traversing range exceeded**

**Message value:** -  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF1 (NONE, OFF2, OFF3)  
**Acknowledge:** IMMEDIATELY  
**Cause:** For a configured linear axis without modulo correction, the drive/encoder has exceeded the maximum possible traversing range. The value should be read in p0412 and interpreted as the number of motor revolutions.

For p0411.0 = 1, the maximum traversing range for the configured linear axis is defined to be 64x (+/- 32x) of p0421. For p0411.3 = 1, the maximum traversing range for the configured linear axis is pre-set (default value) to the highest possible value and is +/-p0412/2 (rounded off to complete revolutions). The highest possible value depends on the pulse number (p0408) and the fine resolution (p0419).

**Remedy:** The fault should be resolved as follows:  
 - select encoder commissioning (p0010 = 4).  
 - reset the position tracking as follows (p0411.2 = 1).  
 - de-select encoder commissioning (p0010 = 0).  
 The fault should then be acknowledged and the absolute encoder adjusted.

Reaction upon N: NONE  
 Acknowl. upon N: NONE  
 Reaction upon A: NONE  
 Acknowl. upon A: NONE

---

**F32501 (N, A) Encoder 2: Position tracking encoder position outside tolerance window**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF1 (NONE, OFF2, OFF3)  
**Acknowledge:** IMMEDIATELY  
**Cause:** When powered down, the drive/encoder was moved through a distance greater than was parameterized in the tolerance window. It is possible that there is no longer any reference between the mechanical system and encoder.  
 Fault value (r0949, interpret decimal):  
 Deviation (difference) to the last encoder position in increments of the absolute value.  
 The sign designates the traversing direction.  
 Note:  
 The deviation (difference) found is also displayed in r0477.  
 See also: p0413 (Measuring gear position tracking tolerance window), r0477 (Measuring gear position difference)

**Remedy:** Reset the position tracking as follows:  
 - select encoder commissioning (p0010 = 4).  
 - reset the position tracking as follows (p0411.2 = 1).  
 - de-select encoder commissioning (p0010 = 0).  
 The fault should then be acknowledged and, if necessary, the absolute encoder adjusted (p2507).  
 See also: p0010

Reaction upon N: NONE  
 Acknowl. upon N: NONE  
 Reaction upon A: NONE  
 Acknowl. upon A: NONE

---

**F32502 (N, A) Encoder 2: Encoder with measuring gear without valid signals**

**Message value:** -  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF1 (OFF2, OFF3)  
**Acknowledge:** IMMEDIATELY  
**Cause:** The encoder with measuring gear no longer provides any valid signals.  
**Remedy:** It must be ensured that all of the encoders, with mounted measuring gear, provide valid actual values in operation.

Reaction upon N: NONE  
 Acknowl. upon N: NONE  
 Reaction upon A: NONE  
 Acknowl. upon A: NONE

---

**F32503 (N, A) Encoder 2: Position tracking cannot be reset**

**Message value:** -  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF1 (NONE, OFF2, OFF3)  
**Acknowledge:** IMMEDIATELY  
**Cause:** The position tracking for the measuring gear cannot be reset.

**Remedy:** The fault should be resolved as follows:  
 - select encoder commissioning (p0010 = 4).  
 - reset the position tracking as follows (p0411.2 = 1).  
 - de-select encoder commissioning (p0010 = 0).  
 The fault should then be acknowledged and the absolute encoder adjusted.

Reaction upon N: NONE  
 Acknowl. upon N: NONE  
 Reaction upon A: NONE  
 Acknowl. upon A: NONE

---

**A32700 Encoder 2: Effectivity test does not supply the expected value**

**Message value:** Fault cause: %1 bin  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The DRIVE-CLiQ encoder fault word supplies fault bits that have been set.  
 Fault value (r0949, interpret binary):  
 Bit x = 1: Effectivity test x unsuccessful.  
**Remedy:** Replace encoder.

---

**N32800 (F) Encoder 2: Group signal**

**Message value:** -  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF1 (IASC/DCBRK, NONE, OFF2, OFF3)  
**Acknowledge:** NONE  
**Cause:** The motor encoder has detected at least one fault.  
**Remedy:** Evaluates other actual messages.  
 Reaction upon F: OFF1 (IASC/DCBRK, NONE, OFF2, OFF3)  
 Acknowl. upon F: IMMEDIATELY

---

**F32801 (N, A) Encoder 2 DRIVE-CLiQ: Sign-of-life missing**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF1 (IASC/DCBRK, NONE, OFF2, OFF3)  
**Acknowledge:** IMMEDIATELY  
**Cause:** A DRIVE-CLiQ communication error has occurred from the Control Unit to the encoder involved.  
 Fault cause:  
 10 (= 0A hex):  
 The sign-of-life bit in the receive telegram is not set.  
 Note regarding the message value:  
 The individual information is coded as follows in the message value (r0949/r2124):  
 0000yyxx hex: yy = component number, xx = error cause  
**Remedy:** - check the electrical cabinet design and cable routing for EMC compliance  
 - replace the component involved.  
 See also: p9916 (DRIVE-CLiQ data transfer error shutdown threshold slave)

Reaction upon N: NONE  
 Acknowl. upon N: NONE  
 Reaction upon A: NONE  
 Acknowl. upon A: NONE

---

**F32802 (N, A) Encoder 2: Time slice overflow**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF1 (IASC/DCBRK, NONE, OFF2, OFF3)  
**Acknowledge:** IMMEDIATELY  
**Cause:** A time slice overflow has occurred in encoder 2.



Fault value (r0949, interpret hexadecimal):  
yx hex: y = function involved (Siemens-internal fault diagnostics), x = time slice involved  
x = 9:  
Time slice overflow of the fast (current controller clock cycle) time slice.  
x = A:  
Time slice overflow of the average time slice.  
x = C:  
Time slice overflow of the slow time slice.  
yx = 3E7:  
Timeout when waiting for SYNO (e.g. unexpected return to non-cyclic operation).

**Remedy:** Increase the current controller sampling time  
Note:  
For a current controller sampling time = 31.25 µs, use an SMx20 with order number 6SL3055-0AA00-5xA3.

Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

**F32804 (N, A) Encoder 2: Checksum error**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF1 (IASC/DCBRK, NONE, OFF2, OFF3)  
**Acknowledge:** POWER ON (IMMEDIATELY)  
**Cause:** A checksum error has occurred when reading-out the program memory on the Sensor Module.  
Fault value (r0949, interpret hexadecimal):  
yyyyxxxx hex  
yyyy: Memory area involved.  
xxxx: Difference between the checksum at POWER ON and the actual checksum.

**Remedy:**

- carry out a POWER ON (power off/on).
- upgrade firmware to later version (>= V2.6 HF3, >= V4.3 SP2, >= V4.4).
- check whether the permissible ambient temperature for the component is maintained.
- replace the Sensor Module.

Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

**F32805 (N, A) Encoder 2: EPROM checksum error**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF1 (IASC/DCBRK, NONE, OFF2, OFF3)  
**Acknowledge:** IMMEDIATELY  
**Cause:** Internal parameter data is corrupted.  
Fault value (r0949, interpret hexadecimal):  
01: EEPROM access error.  
02: Too many blocks in the EEPROM.

**Remedy:** Replace the module.

Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

<b>F32806 (N, A)</b>	<b>Encoder 2: Initialization error</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF1 (IASC/DCBRK, NONE, OFF2, OFF3)
<b>Acknowledge:</b>	PULSE INHIBIT
<b>Cause:</b>	<p>The encoder was not successfully initialized.</p> <p>Fault value (r0949, interpret hexadecimal):</p> <p>Bit 0, 1: Encoder initialization with the motor rotating has failed (deviation involving coarse and fine position in encoder pulses/4).</p> <p>Bit 2: Mid-voltage matching for track A unsuccessful.</p> <p>Bit 3: Mid-voltage matching for track B unsuccessful.</p> <p>Bit 4: Mid-voltage matching for acceleration input unsuccessful.</p> <p>Bit 5: Mid-voltage matching for track safety A unsuccessful.</p> <p>Bit 6: Mid-voltage matching for track safety B unsuccessful.</p> <p>Bit 7: Mid-voltage matching for track C unsuccessful.</p> <p>Bit 8: Mid-voltage matching for track D unsuccessful.</p> <p>Bit 9: Mid-voltage matching for track R unsuccessful.</p> <p>Bit 10: The difference in mid-voltages between A and B is too great (&gt; 0.5 V)</p> <p>Bit 11: The difference in mid-voltages between C and D is too great (&gt; 0.5 V)</p> <p>Bit 12: The difference in mid-voltages between safety A and safety B is too great (&gt; 0.5 V)</p> <p>Bit 13: The difference in mid-voltages between A and safety B is too great (&gt; 0.5 V)</p> <p>Bit 14: The difference in mid-voltages between B and safety A is too great (&gt; 0.5 V)</p> <p>Bit 15: The standard deviation of the calculated mid-voltages is too great (&gt; 0.3 V)</p> <p>Bit 16: Internal fault - fault when reading a register (CAFE)</p> <p>Bit 17: Internal fault - fault when writing a register (CAFE)</p> <p>Bit 18: Internal fault: No mid-voltage matching available</p> <p>Bit 19: Internal error - ADC access error.</p> <p>Bit 20: Internal error - no zero crossover found.</p> <p>Bit 28: Error while initializing the EnDat 2.2 measuring unit.</p> <p>Bit 29: Error when reading out the data from the EnDat 2.2 measuring unit.</p> <p>Bit 30: EEPROM checksum of the EnDat 2.2 measuring unit incorrect.</p> <p>Bit 31: Data of the EnDat 2.2 measuring unit inconsistent.</p> <p>Note:</p> <p>Bit 0, 1: Up to 6SL3055-0AA00-5*A0</p> <p>Bits 2 ... 20: 6SL3055-0AA00-5*A1 and higher</p>
<b>Remedy:</b>	<p>Acknowledge fault.</p> <p>If the fault cannot be acknowledged:</p> <p>Bits 2 ... 9: Check encoder power supply.</p> <p>Bits 2 ... 14: Check the corresponding cable.</p> <p>Bit 15 with no other bits: Check track R, check settings in p0404.</p> <p>Bit 28: Check the cable between the EnDat 2.2 converter and the measuring unit.</p> <p>Bit 29 ... 31: Replace the defective measuring unit.</p>
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE
<b>A32811 (F, N)</b>	<b>Encoder 2: Encoder serial number changed</b>
<b>Message value:</b>	-
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>The encoder serial number has changed. The change is only checked for encoders with serial number (e.g. EnDat encoders).</p> <p>- The encoder was replaced.</p> <p>Note:</p> <p>With closed-loop position control, the serial number is accepted when starting the adjustment (p2507 = 2).</p> <p>When the encoder is adjusted (p2507 = 3), the serial number is checked for changes and if required, the adjustment is reset (p2507 = 1).</p>

Proceed as follows to hide serial number monitoring:  
- set the following serial numbers for the corresponding Encoder Data Set: p0441= FF, p0442 = 0, p0443 = 0, p0444 = 0, p0445 = 0.

**Remedy:** Mechanically adjust the encoder. Accept the new serial number with p0440 = 1.  
Reaction upon F: NONE (OFF1, OFF2, OFF3)  
Acknowl. upon F: IMMEDIATELY  
Reaction upon N: NONE  
Acknowl. upon N: NONE

---

**F32812 (N, A) Encoder 2: Requested cycle or RX-/TX timing not supported**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF2  
**Acknowledge:** IMMEDIATELY  
**Cause:** A cycle requested from the Control Unit or RX/TX timing is not supported.  
Fault value (r0949, interpret decimal):  
0: Application cycle is not supported.  
1: DRIVE-CLiQ cycle is not supported.  
2: Distance between RX and TX instants in time too low.  
3: TX instant in time too early.  
**Remedy:** Carry out a POWER ON (power off/on) for all components.  
Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

**F32813 Encoder 2: Hardware logic unit failed**

**Message value:** Fault cause: %1 bin  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF1 (IASC/DCBRK, NONE, OFF2, OFF3)  
**Acknowledge:** PULSE INHIBIT  
**Cause:** The DRIVE-CLiQ encoder fault word supplies fault bits that have been set.  
Fault value (r0949, interpret binary):  
Bit 0: ALU watchdog has responded.  
Bit 1: ALU has detected a sign-of-life error.  
**Remedy:** Replace encoder.

---

**F32820 (N, A) Encoder 2 DRIVE-CLiQ: Telegram error**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF1 (IASC/DCBRK, NONE, OFF2, OFF3)  
**Acknowledge:** IMMEDIATELY  
**Cause:** A DRIVE-CLiQ communication error has occurred from the Control Unit to the encoder concerned.  
Fault cause:  
1 (= 01 hex):  
Checksum error (CRC error).  
2 (= 02 hex):  
Telegram is shorter than specified in the length byte or in the receive list.  
3 (= 03 hex):  
Telegram is longer than specified in the length byte or in the receive list.  
4 (= 04 hex):  
The length of the receive telegram does not match the receive list.  
5 (= 05 hex):  
The type of the receive telegram does not match the receive list.  
6 (= 06 hex):  
The address of the component in the telegram and in the receive list do not match.  
7 (= 07 hex):  
A SYNC telegram is expected - but the received telegram is not a SYNC telegram.

8 (= 08 hex):  
No SYNC telegram is expected - but the received telegram is one.  
9 (= 09 hex):  
The error bit in the receive telegram is set.  
16 (= 10 hex):  
The receive telegram is too early.  
Note regarding the message value:  
The individual information is coded as follows in the message value (r0949/r2124):  
0000yyxx hex: yy = component number, xx = error cause

**Remedy:**

- carry out a POWER ON (power off/on).
- check the electrical cabinet design and cable routing for EMC compliance
- check the DRIVE-CLiQ wiring (interrupted cable, contacts, ...).

See also: p9916 (DRIVE-CLiQ data transfer error shutdown threshold slave)

Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

### F32835 (N, A) Encoder 2 DRIVE-CLiQ: Cyclic data transfer error

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF1 (IASC/DCBRK, NONE, OFF2, OFF3)  
**Acknowledge:** IMMEDIATELY  
**Cause:** A DRIVE-CLiQ communication error has occurred from the Control Unit to the encoder concerned. The nodes do not send and receive in synchronism.  
Fault cause:  
33 (= 21 hex):  
The cyclic telegram has not been received.  
34 (= 22 hex):  
Timeout in the telegram receive list.  
64 (= 40 hex):  
Timeout in the telegram send list.  
Note regarding the message value:  
The individual information is coded as follows in the message value (r0949/r2124):  
0000yyxx hex: yy = component number, xx = error cause

**Remedy:**

- carry out a POWER ON.
- replace the component involved.

See also: p9916 (DRIVE-CLiQ data transfer error shutdown threshold slave)

Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

### F32836 (N, A) Encoder 2 DRIVE-CLiQ: Send error for DRIVE-CLiQ data

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF1 (IASC/DCBRK, NONE, OFF2, OFF3)  
**Acknowledge:** IMMEDIATELY  
**Cause:** A DRIVE-CLiQ communication error has occurred from the Control Unit to the encoder involved. Data were not able to be sent.  
Fault cause:  
65 (= 41 hex):  
Telegram type does not match send list.  
Note regarding the message value:  
The individual information is coded as follows in the message value (r0949/r2124):  
0000yyxx hex: yy = component number, xx = error cause

**Remedy:** Carry out a POWER ON.

Reaction upon N: NONE  
Acknowl. upon N: NONE

Reaction upon A: NONE  
Acknowl. upon A: NONE

---

**F32837 (N, A) Encoder 2 DRIVE-CLiQ: Component fault**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF1 (IASC/DCBRK, NONE, OFF2, OFF3)  
**Acknowledge:** IMMEDIATELY  
**Cause:** Fault detected on the DRIVE-CLiQ component concerned. Faulty hardware cannot be excluded.  
Fault cause:  
32 (= 20 hex):  
Error in the telegram header.  
35 (= 23 hex):  
Receive error: The telegram buffer memory contains an error.  
66 (= 42 hex):  
Send error: The telegram buffer memory contains an error.  
67 (= 43 hex):  
Send error: The telegram buffer memory contains an error.  
Note regarding the message value:  
The individual information is coded as follows in the message value (r0949/r2124):  
0000yyxx hex: yy = component number, xx = error cause  
**Remedy:**  
- check the DRIVE-CLiQ wiring (interrupted cable, contacts, ...).  
- check the electrical cabinet design and cable routing for EMC compliance  
- if required, use another DRIVE-CLiQ socket (p9904).  
- replace the component involved.  
  
Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

**A32840 Encoder 2 DRIVE-CLiQ: error below the signaling threshold**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** A DRIVE-CLiQ error has occurred below the signaling threshold.  
Fault cause:  
1 (= 01 hex):  
Checksum error (CRC error).  
2 (= 02 hex):  
Telegram is shorter than specified in the length byte or in the receive list.  
3 (= 03 hex):  
Telegram is longer than specified in the length byte or in the receive list.  
4 (= 04 hex):  
The length of the receive telegram does not match the receive list.  
5 (= 05 hex):  
The type of the receive telegram does not match the receive list.  
6 (= 06 hex):  
The address of the component in the telegram and in the receive list do not match.  
7 (= 07 hex):  
A SYNC telegram is expected - but the received telegram is not a SYNC telegram.  
8 (= 08 hex):  
No SYNC telegram is expected - but the received telegram is one.  
9 (= 09 hex):  
The error bit in the receive telegram is set.  
10 (= 0A hex):  
The sign-of-life bit in the receive telegram is not set.  
11 (= 0B hex):  
Synchronization error during alternating cyclic data transfer.

List of faults and alarms

16 (= 10 hex):  
The receive telegram is too early.  
32 (= 20 hex):  
Error in the telegram header.  
33 (= 21 hex):  
The cyclic telegram has not been received.  
34 (= 22 hex):  
Timeout in the telegram receive list.  
35 (= 23 hex):  
Receive error: The telegram buffer memory contains an error.  
64 (= 40 hex):  
Timeout in the telegram send list.  
65 (= 41 hex):  
Telegram type does not match send list.  
66 (= 42 hex):  
Send error: The telegram buffer memory contains an error.  
67 (= 43 hex):  
Send error: The telegram buffer memory contains an error.  
Note regarding the message value:  
The individual information is coded as follows in the message value (r0949/r2124):  
0000yyxx hex: yy = component number, xx = error cause

**Remedy:**

- check the electrical cabinet design and cable routing for EMC compliance
- check the DRIVE-CLiQ wiring (interrupted cable, contacts, ...).

See also: p9916 (DRIVE-CLiQ data transfer error shutdown threshold slave)

---

**F32845 (N, A) Encoder 2 DRIVE-CLiQ: Cyclic data transfer error**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF1 (IASC/DCBRK, NONE, OFF2, OFF3)  
**Acknowledge:** IMMEDIATELY  
**Cause:** A DRIVE-CLiQ communication error has occurred from the Control Unit to the encoder involved.  
Fault cause:  
11 (= 0B hex):  
Synchronization error during alternating cyclic data transfer.  
Note regarding the message value:  
The individual information is coded as follows in the message value (r0949/r2124):  
0000yyxx hex: yy = component number, xx = error cause

**Remedy:**

Carry out a POWER ON (power off/on).  
See also: p9916 (DRIVE-CLiQ data transfer error shutdown threshold slave)

Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

**F32850 (N, A) Encoder 2: Encoder evaluation internal software error**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF1 (IASC/DCBRK, NONE, OFF2, OFF3)  
**Acknowledge:** POWER ON  
**Cause:** An internal software error has occurred in the Sensor Module of encoder 2.  
Fault value (r0949, interpret decimal):  
1: Background time slice is blocked.  
2: Checksum over the code memory is not OK.  
10000: OEM memory of the EnDat encoder contains data that cannot be interpreted.  
11000 ... 11499: Descriptive data from EEPROM incorrect.  
11500 ... 11899: Calibration data from EEPROM incorrect.  
11900 ... 11999: Configuration data from EEPROM incorrect.  
12000 ... 12008: Communication with AD converter faulted.  
16000: DRIVE-CLiQ encoder initialization application error.  
16001: DRIVE-CLiQ encoder initialization ALU error.

16002: DRIVE-CLiQ encoder HSI / SSI initialization error.  
16003: DRIVE-CLiQ encoder safety initialization error.  
16004: DRIVE-CLiQ encoder internal system error.

**Remedy:**

- replace the Sensor Module.
- if required, upgrade the firmware in the Sensor Module.
- contact the Hotline.

Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

**F32851 (N, A) Encoder 2 DRIVE-CLiQ (CU): Sign-of-life missing**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF1 (IASC/DCBRK, NONE, OFF2, OFF3)  
**Acknowledge:** IMMEDIATELY  
**Cause:** A DRIVE-CLiQ communication error has occurred from the Sensor Module (encoder 2) involved to the Control Unit.  
The DRIVE-CLiQ component did not set the sign-of-life to the Control Unit.  
Fault cause:  
10 (= 0A hex):  
The sign-of-life bit in the receive telegram is not set.  
Note regarding the message value:  
The individual information is coded as follows in the message value (r0949/r2124):  
0000yyxx hex: yy = component number, xx = error cause

**Remedy:**

- Upgrade the firmware of the component involved.
- carry out a POWER ON (power off/on) for the component involved.

Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

**F32860 (N, A) Encoder 2 DRIVE-CLiQ (CU): Telegram error**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF1 (IASC/DCBRK, NONE, OFF2, OFF3)  
**Acknowledge:** IMMEDIATELY  
**Cause:** A DRIVE-CLiQ communication error has occurred from the Sensor Module (encoder 2) involved to the Control Unit.  
Fault cause:  
1 (= 01 hex):  
Checksum error (CRC error).  
2 (= 02 hex):  
Telegram is shorter than specified in the length byte or in the receive list.  
3 (= 03 hex):  
Telegram is longer than specified in the length byte or in the receive list.  
4 (= 04 hex):  
The length of the receive telegram does not match the receive list.  
5 (= 05 hex):  
The type of the receive telegram does not match the receive list.  
6 (= 06 hex):  
The address of the power unit in the telegram and in the receive list do not match.  
9 (= 09 hex):  
The error bit in the receive telegram is set.  
16 (= 10 hex):  
The receive telegram is too early.  
17 (= 11 hex):  
CRC error and the receive telegram is too early.  
18 (= 12 hex):  
The telegram is shorter than that specified in the length byte or in the receive list and the receive telegram is too early.

19 (= 13 hex):  
The telegram is longer than that specified in the length byte or in the receive list and the receive telegram is too early.  
20 (= 14 hex):  
The length of the receive telegram does not match the receive list and the receive telegram is too early.  
21 (= 15 hex):  
The type of the receive telegram does not match the receive list and the receive telegram is too early.  
22 (= 16 hex):  
The address of the power unit in the telegram and in the receive list does not match and the receive telegram is too early.  
25 (= 19 hex):  
The error bit in the receive telegram is set and the receive telegram is too early.  
Note regarding the message value:  
The individual information is coded as follows in the message value (r0949/r2124):  
0000yyxx hex: yy = component number, xx = error cause

**Remedy:**

- carry out a POWER ON (power off/on).
- check the electrical cabinet design and cable routing for EMC compliance
- check the DRIVE-CLiQ wiring (interrupted cable, contacts, ...).

See also: p9915 (DRIVE-CLiQ data transfer error shutdown threshold master)

Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

#### **F32875 (N, A) Encoder 2 DRIVE-CLiQ (CU): Supply voltage failed**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF1 (IASC/DCBRK, NONE, OFF2, OFF3)  
**Acknowledge:** IMMEDIATELY  
**Cause:** The DRIVE-CLiQ communication from the DRIVE-CLiQ component involved to the Control Unit signals that the supply voltage has failed.  
Fault cause:  
9 (= 09 hex):  
The power supply voltage for the components has failed.  
Note regarding the message value:  
The individual information is coded as follows in the message value (r0949/r2124):  
0000yyxx hex: yy = component number, xx = error cause

**Remedy:**

- carry out a POWER ON (power off/on).
- check the power supply voltage wiring for the DRIVE-CLiQ component (interrupted cable, contacts, ...).
- check the dimensioning of the power supply for the DRIVE-CLiQ component.

Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

#### **F32885 (N, A) Encoder 2 DRIVE-CLiQ (CU): Cyclic data transfer error**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF1 (IASC/DCBRK, NONE, OFF2, OFF3)  
**Acknowledge:** IMMEDIATELY  
**Cause:** A DRIVE-CLiQ communication error has occurred from the Sensor Module (encoder 2) involved to the Control Unit.  
The nodes do not send and receive in synchronism.  
Fault cause:  
26 (= 1A hex):  
Sign-of-life bit in the receive telegram not set and the receive telegram is too early.  
33 (= 21 hex):  
The cyclic telegram has not been received.  
34 (= 22 hex):  
Timeout in the telegram receive list.



64 (= 40 hex):  
Timeout in the telegram send list.  
98 (= 62 hex):  
Error at the transition to cyclic operation.  
Note regarding the message value:  
The individual information is coded as follows in the message value (r0949/r2124):  
0000yyxx hex: yy = component number, xx = error cause

**Remedy:**

- check the power supply voltage of the component involved.
- carry out a POWER ON.
- replace the component involved.

See also: p9915 (DRIVE-CLiQ data transfer error shutdown threshold master)

Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

**F32886 (N, A) Encoder 2 DRIVE-CLiQ (CU): Error when sending DRIVE-CLiQ data**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF1 (IASC/DCBRK, NONE, OFF2, OFF3)  
**Acknowledge:** IMMEDIATELY  
**Cause:** A DRIVE-CLiQ communication error has occurred from the Sensor Module (encoder 2) involved to the Control Unit.  
Data were not able to be sent.  
Fault cause:  
65 (= 41 hex):  
Telegram type does not match send list.  
Note regarding the message value:  
The individual information is coded as follows in the message value (r0949/r2124):  
0000yyxx hex: yy = component number, xx = error cause

**Remedy:** Carry out a POWER ON.

Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

**F32887 (N, A) Encoder 2 DRIVE-CLiQ (CU): Component fault**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF1 (IASC/DCBRK, NONE, OFF2, OFF3)  
**Acknowledge:** IMMEDIATELY  
**Cause:** Fault detected on the DRIVE-CLiQ component involved (Sensor Module for encoder 2). Faulty hardware cannot be excluded.  
Fault cause:  
32 (= 20 hex):  
Error in the telegram header.  
35 (= 23 hex):  
Receive error: The telegram buffer memory contains an error.  
66 (= 42 hex):  
Send error: The telegram buffer memory contains an error.  
67 (= 43 hex):  
Send error: The telegram buffer memory contains an error.  
96 (= 60 hex):  
Response received too late during runtime measurement.  
97 (= 61 hex):  
Time taken to exchange characteristic data too long.  
Note regarding the message value:  
The individual information is coded as follows in the message value (r0949/r2124):  
0000yyxx hex: yy = component number, xx = error cause

**Remedy:**

- check the DRIVE-CLiQ wiring (interrupted cable, contacts, ...).
- check the electrical cabinet design and cable routing for EMC compliance
- if required, use another DRIVE-CLiQ socket (p9904).
- replace the component involved.

Reaction upon N: NONE  
 Acknowl. upon N: NONE  
 Reaction upon A: NONE  
 Acknowl. upon A: NONE

---

**F32895 (N, A) Encoder 2 DRIVE-CLiQ (CU): Alternating cyclic data transfer error**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF1 (IASC/DCBRK, NONE, OFF2, OFF3)  
**Acknowledge:** IMMEDIATELY  
**Cause:** A DRIVE-CLiQ communication error has occurred from the Sensor Module (encoder 2) involved to the Control Unit.  
 Fault cause:  
 11 (= 0B hex):  
 Synchronization error during alternating cyclic data transfer.  
 Note regarding the message value:  
 The individual information is coded as follows in the message value (r0949/r2124):  
 0000yyxx hex: yy = component number, xx = error cause

**Remedy:** Carry out a POWER ON.  
 See also: p9915 (DRIVE-CLiQ data transfer error shutdown threshold master)

Reaction upon N: NONE  
 Acknowl. upon N: NONE  
 Reaction upon A: NONE  
 Acknowl. upon A: NONE

---

**F32896 (N, A) Encoder 2 DRIVE-CLiQ (CU): Inconsistent component properties**

**Message value:** Component number: %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF2 (IASC/DCBRK, NONE, OFF1, OFF3, STOP1, STOP2)  
**Acknowledge:** IMMEDIATELY  
**Cause:** The properties of the DRIVE-CLiQ component (Sensor Module for encoder 2), specified by the fault value, have changed in an incompatible fashion with respect to the properties when booted. One cause can be, e.g. that a DRIVE-CLiQ cable or DRIVE-CLiQ component has been replaced.  
 Fault value (r0949, interpret decimal):  
 Component number.

**Remedy:**

- carry out a POWER ON.
- when a component is replaced, the same component type and if possible the same firmware version should be used.
- when a cable is replaced, only cables whose length is the same as or as close as possible to the length of the original cables should be used (ensure compliance with the maximum cable length).

Reaction upon N: NONE  
 Acknowl. upon N: NONE  
 Reaction upon A: NONE  
 Acknowl. upon A: NONE

---

**F32899 (N, A) Encoder 2: Unknown fault**

**Message value:** New message: %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF1 (IASC/DCBRK, NONE, OFF2, OFF3, STOP1, STOP2)  
**Acknowledge:** IMMEDIATELY (POWER ON)  
**Cause:** A fault occurred on the Sensor Module for encoder 2 that cannot be interpreted by the Control Unit firmware.  
 This can occur if the firmware on this component is more recent than the firmware on the Control Unit.  
 Fault value (r0949, interpret decimal):  
 Fault number.

Note:  
If required, the significance of this new fault can be read about in a more recent description of the Control Unit.

**Remedy:**

- replace the firmware on the Sensor Module by an older firmware version (r0148).
- upgrade the firmware on the Control Unit (r0018).

Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

**A32902 (F, N) Encoder 2: SPI-BUS error occurred**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** Error when operating the internal SPI bus.  
Fault value (r0949, interpret hexadecimal):  
Only for internal Siemens troubleshooting.

**Remedy:**

- replace the Sensor Module.
- if required, upgrade the firmware in the Sensor Module.
- contact the Hotline.

Reaction upon F: NONE (IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)  
Acknowl. upon F: IMMEDIATELY  
Reaction upon N: NONE  
Acknowl. upon N: NONE

---

**A32903 (F, N) Encoder 2: I2C-BUS error occurred**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** Error when operating the internal I2C bus.  
Fault value (r0949, interpret hexadecimal):  
Only for internal Siemens troubleshooting.

**Remedy:**

- replace the Sensor Module.
- if required, upgrade the firmware in the Sensor Module.
- contact the Hotline.

Reaction upon F: NONE (IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)  
Acknowl. upon F: IMMEDIATELY  
Reaction upon N: NONE  
Acknowl. upon N: NONE

---

**F32905 (N, A) Encoder 2: Parameterization error**

**Message value:** Parameter: %1, supplementary information: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF1 (IASC/DCBRK, NONE, OFF2, OFF3, STOP1, STOP2)  
**Acknowledge:** IMMEDIATELY  
**Cause:** A parameter of encoder 2 was detected as being incorrect.  
It is possible that the parameterized encoder type does not match the connected encoder.  
The parameter involved can be determined as follows:  
- determine the parameter number using the fault value (r0949).  
- determine the parameter index (p0187).  
Fault value (r0949, interpret decimal):  
yyyyxxxx dec: yyyy = supplementary information, xxxx = parameter  
xxxx = 421:  
For an EnDat/SSI encoder, the absolute position in the protocol must be less than or equal to 30 bits.  
yyyy = 0:  
No information available.

yyyy = 1:  
The component does not support HTL level (p0405.1 = 0) combined with track monitoring A/B <> -A/B (p0405.2 = 1).

yyyy = 2:  
A code number for an identified encoder has been entered into p0400, however, no identification was carried out. Please start a new encoder identification.

yyyy = 3:  
A code number for an identified encoder has been entered into p0400, however, no identification was carried out. Please select a listed encoder in p0400 with a code number < 10000.

yyyy = 4:  
This component does not support SSI encoders (p0404.9 = 1) without track A/B.

yyyy = 5:  
For SQW encoder, value in p4686 greater than in p0425.

yyyy = 6:  
DRIVE-CLiQ encoder cannot be used with this firmware version.

yyyy = 7:  
For an SQW encoder, the Xact1 correction (p0437.2) is only permitted with equidistant zero marks.

yyyy = 8:  
The motor pole pair width is not supported by the linear scale being used.

yyyy = 9:  
The length of the position in the EnDat protocol may be a maximum of 32 bits.

yyyy = 10:  
The connected encoder is not supported.

yyyy = 11:  
The hardware does not support track monitoring.

**Remedy:**

- check whether the connected encoder type matches the encoder that has been parameterized.
- correct the parameter specified by the fault value (r0949) and p0187.
- re parameter number = 314:
- check the pole pair number and measuring gear ratio. The quotient of the "pole pair number" divided by the "measuring gear ratio" must be less than or equal to 1000 ((r0313 \* p0433) / p0432 <= 1000).

Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

### F32912 Encoder 2: Device combination is not permissible

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** OFF1 (IASC/DCBRK, NONE)  
**Acknowledge:** PULSE INHIBIT  
**Cause:**

The selected device combination is not supported.  
Fault value (r0949, interpret decimal):

1003:  
The connected measuring unit cannot be operated with the EnDat 2.2 converter. For instance, the measuring unit has a pulse number/resolution of 2<sup>n</sup>.

1005:  
The type of measuring unit (incremental) is not supported by the EnDat 2.2 converter.

1006:  
The maximum duration (31.25 µs) of the EnDat transfer was exceeded.

2001:  
The set combination of current controller cycle, DP cycle and Safety cycle is not supported by the EnDat 2.2 converter.

2002:  
The resolution of the linear measuring unit does not match the pole pair width of the linear motor

**Remedy:**

Re fault value = 1003, 1005, 1006:  
- Use a measuring unit that is permissible.

For fault value = 2001:  
- Set a permissible cycle combination (if required, use standard settings).

For fault value = 2002:  
- Use a measuring unit with a lower resolution (p0422).

---

<b>A32915 (F, N)</b>	<b>Encoder 2: Configuration error</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	The configuration for encoder 2 is incorrect. Alarm value (r2124, interpret decimal): 1: Re-parameterization between fault/alarm is not permissible. 419: When the fine resolution Gx_XIST2 is configured, the encoder identifies a maximum possible absolute position actual value (r0483) that can no longer be represented within 32 bits.
<b>Remedy:</b>	Re alarm value = 1: No re-parameterization between fault/alarm. Re alarm value = 419: Reduce the fine resolution (p0419) or deactivate the monitoring (p0437.25), if the complete multiturn range is not required.
Reaction upon F:	NONE (IASC/DCBRK)
Acknowl. upon F:	IMMEDIATELY
Reaction upon N:	NONE
Acknowl. upon N:	NONE

---

<b>F32916 (N, A)</b>	<b>Encoder 2: Parameterization fault</b>
<b>Message value:</b>	Parameter: %1, supplementary information: %2
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF1 (IASC/DCBRK, NONE, OFF2, OFF3, STOP1, STOP2)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	A parameter of encoder 2 was detected as being incorrect. It is possible that the parameterized encoder type does not match the connected encoder. The parameter involved can be determined as follows: - determine the parameter number using the fault value (r0949). - determine the parameter index (p0187). Fault value (r0949, interpret decimal): Parameter number. Note: This fault is only output for encoders where r0404.10 = 1 or r0404.11 = 1. It corresponds to A32905 with encoders where r0404.10 = 0 and r0404.11 = 0.
<b>Remedy:</b>	- check whether the connected encoder type matches the encoder that has been parameterized. - correct the parameter specified by the fault value (r0949) and p0187.
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE

---

<b>A32920 (F, N)</b>	<b>Encoder 2: Temperature sensor fault</b>
<b>Message value:</b>	Fault cause: %1, channel number: %2
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	When evaluating the temperature sensor, an error occurred. Fault cause: 1 (= 01 hex): Wire breakage or sensor not connected (KTY: R > 1630 Ohm). 2 (= 02 hex): Measured resistance too low (PTC: R < 20 Ohm, KTY: R < 50 Ohm). Additional values: Only for internal Siemens troubleshooting.

	Note regarding the message value: The individual information is coded as follows in the message value (r0949/r2124): 0000yyxx hex: yy = channel number, xx = error cause
<b>Remedy:</b>	<ul style="list-style-type: none"> <li>- check that the encoder cable is the correct type and is correctly connected.</li> <li>- check the temperature sensor selection in p0600 to p0603.</li> <li>- replace the Sensor Module (hardware defect or incorrect calibration data).</li> </ul>
Reaction upon F:	NONE (IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)
Acknowl. upon F:	IMMEDIATELY
Reaction upon N:	NONE
Acknowl. upon N:	NONE
<hr/>	
<b>A32930 (N)</b>	<b>Encoder 2: Data logger has saved data</b>
<b>Message value:</b>	-
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>For the activated function "Data logger" (p0437.0 = 1) a fault has occurred with the Sensor Module. This alarm indicates that the diagnostics data corresponding to the fault was saved on the memory card.</p> <p>The diagnostics data is saved in the following folder: /USER/SINAMICS/DATA/SMTRC00.BIN ... /USER/SINAMICS/DATA/SMTRC07.BIN /USER/SINAMICS/DATA/SMTRCIDX.TXT</p> <p>The following information is contained in the TXT file:</p> <ul style="list-style-type: none"> <li>- Display of the last written BIN file.</li> <li>- Number of write operations that are still possible (from 10000 downwards).</li> </ul> <p>Note: Only Siemens can evaluate the BIN files.</p>
<b>Remedy:</b>	<p>Not necessary.</p> <p>The alarm disappears automatically.</p> <p>The data logger is ready to record the next fault case.</p>
Reaction upon N:	NONE
Acknowl. upon N:	NONE
<hr/>	
<b>A32940 (F, N)</b>	<b>Encoder 2: Spindle sensor S1 voltage incorrect</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>The voltage of analog sensor S1 is outside the permissible range.</p> <p>Fault value (r0949, interpret decimal): Signal level from sensor S1.</p> <p>Note: A signal level of 500 mV corresponds to the numerical value 500 dec.</p>
<b>Remedy:</b>	<ul style="list-style-type: none"> <li>- Check the clamped tool.</li> <li>- Check the tolerance and if required, adapt (p5040).</li> <li>- Check the thresholds and if required, adapt (p5041).</li> <li>- Check analog sensor S1 and connections.</li> </ul>
Reaction upon F:	NONE (IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)
Acknowl. upon F:	IMMEDIATELY
Reaction upon N:	NONE
Acknowl. upon N:	NONE

<b>F32950</b>	<b>Encoder 2: Internal software error</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF1 (OFF2)
<b>Acknowledge:</b>	POWER ON
<b>Cause:</b>	An internal software error has occurred. Fault value (r0949, interpret decimal): Information about the fault source. Only for internal Siemens troubleshooting.
<b>Remedy:</b>	- If necessary, upgrade the firmware in the Sensor Module to a later version. - contact the Hotline.
<b>A32999 (F, N)</b>	<b>Encoder 2: Unknown alarm</b>
<b>Message value:</b>	New message: %1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	A alarm has occurred on the Sensor Module for encoder 2 that cannot be interpreted by the Control Unit firmware. This can occur if the firmware on this component is more recent than the firmware on the Control Unit. Alarm value (r2124, interpret decimal): Alarm number. Note: If required, the significance of this new alarm can be read about in a more recent description of the Control Unit.
<b>Remedy:</b>	- replace the firmware on the Sensor Module by an older firmware version (r0148). - upgrade the firmware on the Control Unit (r0018).
Reaction upon F:	NONE (IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)
Acknowl. upon F:	IMMEDIATELY (POWER ON)
Reaction upon N:	NONE
Acknowl. upon N:	NONE
<b>F33125 (N, A)</b>	<b>Encoder 3: Amplitude error track A or B overcontrolled</b>
<b>Message value:</b>	A track: %1, B-track: %2
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF1 (IASC/DCBRK, NONE, OFF2, OFF3, STOP1, STOP2)
<b>Acknowledge:</b>	PULSE INHIBIT
<b>Cause:</b>	The amplitude of track A or B for encoder 3 exceeds the permissible tolerance band. Fault value (r0949, interpret hexadecimal): yyyyxxxx hex: yyyy = Signal level, track B (16 bits with sign). xxxx = Signal level, track A (16 bits with sign). The nominal signal level of the encoder must lie in the range 375 mV to 600 mV (500 mV -25/+20 %). The response threshold is > 750 mV. This fault also occurs if the A/D converter is overcontrolled. A signal level of 500 mV peak value corresponds to the numerical value 5333 hex = 21299 dec. Note for sensors modules for resolvers (e. g. SMC10): The nominal signal level is at 2900 mV (2.0 Vrms). The response threshold is > 3582 mV. A signal level of 2900 mV peak value corresponds to the numerical value 6666 hex = 26214 dec. Note: The analog values of the amplitude error are not measured at the same time with the hardware fault output by the Sensor Module.
<b>Remedy:</b>	- check that the encoder cables and shielding are routed in compliance with EMC. - replace the encoder or encoder cable
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE

<b>F33126 (N, A)</b>	<b>Encoder 3: Amplitude AB too high</b>
<b>Message value:</b>	Amplitude: %1, Angle: %2
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF1 (IASC/DCBRK, NONE, OFF2, OFF3, STOP1, STOP2)
<b>Acknowledge:</b>	PULSE INHIBIT
<b>Cause:</b>	<p>The amplitude (root of <math>A^2 + B^2</math> or <math> A  +  B </math>) for encoder 3 exceeds the permissible tolerance.</p> <p>Fault value (r0949, interpret hexadecimal):</p> <p>yyyyxxxx hex:</p> <p>yyyy = Angle</p> <p>xxxx = Amplitude, i.e. root from <math>A^2 + B^2</math> (16 bits without sign)</p> <p>The nominal signal level of the encoder must lie in the range 375 mV to 600 mV (500 mV -25/+20 %).</p> <p>The response threshold for <math>( A  +  B )</math> is <math>&gt; 1120</math> mV or the root of <math>(A^2 + B^2) &gt; 955</math> mV.</p> <p>A signal level of 500 mV peak value corresponds to the numerical value of 299A hex = 10650 dec.</p> <p>The angle 0 ... FFFF hex corresponds to 0 ... 360 degrees of the fine position. Zero degrees is present at the negative zero crossover of track B.</p> <p>Note:</p> <p>The analog values of the amplitude error are not measured at the same time with the hardware fault output by the Sensor Module.</p>
<b>Remedy:</b>	<p>- check that the encoder cables and shielding are routed in compliance with EMC.</p> <p>- replace the encoder or encoder cable</p>
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE
<b>F33152 (N, A)</b>	<b>Encoder 3: Maximum input frequency exceeded</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	OFF1 (IASC/DCBRK, NONE, OFF2, OFF3, STOP1, STOP2)
<b>Acknowledge:</b>	PULSE INHIBIT
<b>Cause:</b>	<p>The maximum input frequency of the encoder evaluation has been exceeded.</p> <p>Fault value (r0949, interpret decimal):</p> <p>Actual input frequency in Hz.</p> <p>See also: p0408 (Rotary encoder pulse number)</p>
<b>Remedy:</b>	<p>- Reduce the speed.</p> <p>- Use an encoder with a lower pulse number (p0408).</p>
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE
<b>A33442 (F, N)</b>	<b>Encoder 3: Battery voltage pre-alarm</b>
<b>Message value:</b>	-
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	When switched-off, the encoder uses a battery to back up the multiturn information. The battery voltage is no longer sufficient to check the multiturn information.
<b>Remedy:</b>	Replace battery.
Reaction upon F:	NONE (IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)
Acknowl. upon F:	IMMEDIATELY
Reaction upon N:	NONE
Acknowl. upon N:	NONE



---

**A33700 Encoder 3: Effectivity test does not supply the expected value**

---

**Message value:** Fault cause: %1 bin  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The DRIVE-CLiQ encoder fault word supplies fault bits that have been set.  
Fault value (r0949, interpret binary):  
Bit x = 1: Effectivity test x unsuccessful.  
**Remedy:** Replace encoder.

---

**A33840 Encoder 3 DRIVE-CLiQ: error below the signaling threshold**

---

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** A DRIVE-CLiQ error has occurred below the signaling threshold.  
Fault cause:  
1 (= 01 hex):  
Checksum error (CRC error).  
2 (= 02 hex):  
Telegram is shorter than specified in the length byte or in the receive list.  
3 (= 03 hex):  
Telegram is longer than specified in the length byte or in the receive list.  
4 (= 04 hex):  
The length of the receive telegram does not match the receive list.  
5 (= 05 hex):  
The type of the receive telegram does not match the receive list.  
6 (= 06 hex):  
The address of the component in the telegram and in the receive list do not match.  
7 (= 07 hex):  
A SYNC telegram is expected - but the received telegram is not a SYNC telegram.  
8 (= 08 hex):  
No SYNC telegram is expected - but the received telegram is one.  
9 (= 09 hex):  
The error bit in the receive telegram is set.  
10 (= 0A hex):  
The sign-of-life bit in the receive telegram is not set.  
11 (= 0B hex):  
Synchronization error during alternating cyclic data transfer.  
16 (= 10 hex):  
The receive telegram is too early.  
32 (= 20 hex):  
Error in the telegram header.  
33 (= 21 hex):  
The cyclic telegram has not been received.  
34 (= 22 hex):  
Timeout in the telegram receive list.  
35 (= 23 hex):  
Receive error: The telegram buffer memory contains an error.  
64 (= 40 hex):  
Timeout in the telegram send list.  
65 (= 41 hex):  
Telegram type does not match send list.  
66 (= 42 hex):  
Send error: The telegram buffer memory contains an error.  
67 (= 43 hex):  
Send error: The telegram buffer memory contains an error.  
Note regarding the message value:  
The individual information is coded as follows in the message value (r0949/r2124):  
0000yyxx hex: yy = component number, xx = error cause

**Remedy:**

- check the electrical cabinet design and cable routing for EMC compliance
- check the DRIVE-CLiQ wiring (interrupted cable, contacts, ...).

See also: p9916 (DRIVE-CLiQ data transfer error shutdown threshold slave)

---

**F33875 (N, A) Encoder 3 DRIVE-CLiQ (CU): Supply voltage failed**

**Message value:** Component number: %1, fault cause: %2

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** OFF1 (IASC/DCBRK, NONE, OFF2, OFF3)

**Acknowledge:** IMMEDIATELY

**Cause:** The DRIVE-CLiQ communication from the DRIVE-CLiQ component involved to the Control Unit signals that the supply voltage has failed.  
 Fault cause:  
 9 (= 09 hex):  
 The power supply voltage for the components has failed.  
 Note regarding the message value:  
 The individual information is coded as follows in the message value (r0949/r2124):  
 0000yyxx hex: yy = component number, xx = error cause

**Remedy:**

- carry out a POWER ON (power off/on).
- check the power supply voltage wiring for the DRIVE-CLiQ component (interrupted cable, contacts, ...).
- check the dimensioning of the power supply for the DRIVE-CLiQ component.

Reaction upon N: NONE

Acknowl. upon N: NONE

Reaction upon A: NONE

Acknowl. upon A: NONE

---

**F33912 Encoder 3: Device combination is not permissible**

**Message value:** %1

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** OFF1 (IASC/DCBRK, NONE)

**Acknowledge:** PULSE INHIBIT

**Cause:** The selected device combination is not supported.  
 Fault value (r0949, interpret decimal):  
 1003:  
 The connected measuring unit cannot be operated with the EnDat 2.2 converter. For instance, the measuring unit has a pulse number/resolution of 2^n.  
 1005:  
 The type of measuring unit (incremental) is not supported by the EnDat 2.2 converter.  
 1006:  
 The maximum duration (31.25 µs) of the EnDat transfer was exceeded.  
 2001:  
 The set combination of current controller cycle, DP cycle and Safety cycle is not supported by the EnDat 2.2 converter.  
 2002:  
 The resolution of the linear measuring unit does not match the pole pair width of the linear motor

**Remedy:**

Re fault value = 1003, 1005, 1006:  
 - Use a measuring unit that is permissible.

For fault value = 2001:  
 - Set a permissible cycle combination (if required, use standard settings).

For fault value = 2002:  
 - Use a measuring unit with a lower resolution (p0422).

---

**A34840 VSM DRIVE-CLiQ: error below the signaling threshold**

**Message value:** Component number: %1, fault cause: %2

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S

**Reaction:** NONE

**Acknowledge:** NONE

**Cause:** A DRIVE-CLiQ error has occurred below the signaling threshold.

Fault cause:  
1 (= 01 hex):  
Checksum error (CRC error).  
2 (= 02 hex):  
Telegram is shorter than specified in the length byte or in the receive list.  
3 (= 03 hex):  
Telegram is longer than specified in the length byte or in the receive list.  
4 (= 04 hex):  
The length of the receive telegram does not match the receive list.  
5 (= 05 hex):  
The type of the receive telegram does not match the receive list.  
6 (= 06 hex):  
The address of the component in the telegram and in the receive list do not match.  
7 (= 07 hex):  
A SYNC telegram is expected - but the received telegram is not a SYNC telegram.  
8 (= 08 hex):  
No SYNC telegram is expected - but the received telegram is one.  
9 (= 09 hex):  
The error bit in the receive telegram is set.  
10 (= 0A hex):  
The sign-of-life bit in the receive telegram is not set.  
11 (= 0B hex):  
Synchronization error during alternating cyclic data transfer.  
16 (= 10 hex):  
The receive telegram is too early.  
32 (= 20 hex):  
Error in the telegram header.  
33 (= 21 hex):  
The cyclic telegram has not been received.  
34 (= 22 hex):  
Timeout in the telegram receive list.  
35 (= 23 hex):  
Receive error: The telegram buffer memory contains an error.  
64 (= 40 hex):  
Timeout in the telegram send list.  
65 (= 41 hex):  
Telegram type does not match send list.  
66 (= 42 hex):  
Send error: The telegram buffer memory contains an error.  
67 (= 43 hex):  
Send error: The telegram buffer memory contains an error.  
Note regarding the message value:  
The individual information is coded as follows in the message value (r0949/r2124):  
0000yyxx hex: yy = component number, xx = error cause

**Remedy:**

- check the electrical cabinet design and cable routing for EMC compliance
- check the DRIVE-CLiQ wiring (interrupted cable, contacts, ...).

See also: p9916 (DRIVE-CLiQ data transfer error shutdown threshold slave)

---

**F34851      VSM DRIVE-CLiQ (CU): Sign-of-life missing**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** NONE (OFF1, OFF2)  
**Acknowledge:** IMMEDIATELY  
**Cause:** A DRIVE-CLiQ communications error has occurred from the Voltage Sensing Module involved (VSM) to the Control Unit.  
The DRIVE-CLiQ component did not set the sign-of-life to the Control Unit.  
Fault cause:  
10 (= 0A hex):  
The sign-of-life bit in the receive telegram is not set.  
Note regarding the message value:  
The individual information is coded as follows in the message value (r0949/r2124):  
0000yyxx hex: yy = component number, xx = error cause

**Remedy:** Upgrade the firmware of the component involved.

---

**F34860 VSM DRIVE-CLiQ (CU): Telegram error**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** NONE (OFF1, OFF2)  
**Acknowledge:** IMMEDIATELY  
**Cause:** A DRIVE-CLiQ communications error has occurred from the Voltage Sensing Module involved (VSM) to the Control Unit.  
 Fault cause:  
 1 (= 01 hex):  
 Checksum error (CRC error).  
 2 (= 02 hex):  
 Telegram is shorter than specified in the length byte or in the receive list.  
 3 (= 03 hex):  
 Telegram is longer than specified in the length byte or in the receive list.  
 4 (= 04 hex):  
 The length of the receive telegram does not match the receive list.  
 5 (= 05 hex):  
 The type of the receive telegram does not match the receive list.  
 6 (= 06 hex):  
 The address of the power unit in the telegram and in the receive list do not match.  
 9 (= 09 hex):  
 The error bit in the receive telegram is set.  
 16 (= 10 hex):  
 The receive telegram is too early.  
 17 (= 11 hex):  
 CRC error and the receive telegram is too early.  
 18 (= 12 hex):  
 The telegram is shorter than that specified in the length byte or in the receive list and the receive telegram is too early.  
 19 (= 13 hex):  
 The telegram is longer than that specified in the length byte or in the receive list and the receive telegram is too early.  
 20 (= 14 hex):  
 The length of the receive telegram does not match the receive list and the receive telegram is too early.  
 21 (= 15 hex):  
 The type of the receive telegram does not match the receive list and the receive telegram is too early.  
 22 (= 16 hex):  
 The address of the power unit in the telegram and in the receive list does not match and the receive telegram is too early.  
 25 (= 19 hex):  
 The error bit in the receive telegram is set and the receive telegram is too early.  
 Note regarding the message value:  
 The individual information is coded as follows in the message value (r0949/r2124):  
 0000yyxx hex: yy = component number, xx = error cause  
**Remedy:**  
 - carry out a POWER ON (power off/on).  
 - check the electrical cabinet design and cable routing for EMC compliance  
 - check the DRIVE-CLiQ wiring (interrupted cable, contacts, ...).  
 See also: p9915 (DRIVE-CLiQ data transfer error shutdown threshold master)

---

**F34875 VSM DRIVE-CLiQ (CU): Supply voltage failed**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** OFF2  
**Acknowledge:** IMMEDIATELY  
**Cause:** The DRIVE-CLiQ communication from the DRIVE-CLiQ component involved to the Control Unit signals that the supply voltage has failed.  
 Fault cause:  
 9 (= 09 hex):  
 The power supply voltage for the components has failed.

Note regarding the message value:

The individual information is coded as follows in the message value (r0949/r2124):

0000yyxx hex: yy = component number, xx = error cause

**Remedy:**

- carry out a POWER ON (power off/on).
- check the power supply voltage wiring for the DRIVE-CLiQ component (interrupted cable, contacts, ...).
- check the dimensioning of the power supply for the DRIVE-CLiQ component.

**F34885**

**VSM DRIVE-CLiQ (CU): Cyclic data transfer error**

**Message value:**

Component number: %1, fault cause: %2

**Drive object:**

DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31

**Reaction:**

NONE (OFF1, OFF2)

**Acknowledge:**

IMMEDIATELY

**Cause:**

A DRIVE-CLiQ communications error has occurred from the Voltage Sensing Module involved (VSM) to the Control Unit.

The nodes do not send and receive in synchronism.

Fault cause:

26 (= 1A hex):

Sign-of-life bit in the receive telegram not set and the receive telegram is too early.

33 (= 21 hex):

The cyclic telegram has not been received.

34 (= 22 hex):

Timeout in the telegram receive list.

64 (= 40 hex):

Timeout in the telegram send list.

98 (= 62 hex):

Error at the transition to cyclic operation.

Note regarding the message value:

The individual information is coded as follows in the message value (r0949/r2124):

0000yyxx hex: yy = component number, xx = error cause

**Remedy:**

- check the power supply voltage of the component involved.
- carry out a POWER ON.
- replace the component involved.

See also: p9915 (DRIVE-CLiQ data transfer error shutdown threshold master)

**F34886**

**VSM DRIVE-CLiQ (CU): Error when sending DRIVE-CLiQ data**

**Message value:**

Component number: %1, fault cause: %2

**Drive object:**

DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31

**Reaction:**

NONE (OFF1, OFF2)

**Acknowledge:**

IMMEDIATELY

**Cause:**

A DRIVE-CLiQ communications error has occurred from the Voltage Sensing Module involved (VSM) to the Control Unit.

Data were not able to be sent.

Fault cause:

65 (= 41 hex):

Telegram type does not match send list.

Note regarding the message value:

The individual information is coded as follows in the message value (r0949/r2124):

0000yyxx hex: yy = component number, xx = error cause

**Remedy:**

Carry out a POWER ON.

**F34887**

**VSM DRIVE-CLiQ (CU): Component fault**

**Message value:**

Component number: %1, fault cause: %2

**Drive object:**

DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31

**Reaction:**

NONE (OFF1, OFF2)

**Acknowledge:**

IMMEDIATELY

**Cause:**

Fault detected on the DRIVE-CLiQ component (Voltage Sensing Module) involved. Faulty hardware cannot be excluded.

Fault cause:  
 32 (= 20 hex):  
 Error in the telegram header.  
 35 (= 23 hex):  
 Receive error: The telegram buffer memory contains an error.  
 66 (= 42 hex):  
 Send error: The telegram buffer memory contains an error.  
 67 (= 43 hex):  
 Send error: The telegram buffer memory contains an error.  
 96 (= 60 hex):  
 Response received too late during runtime measurement.  
 97 (= 61 hex):  
 Time taken to exchange characteristic data too long.  
 Note regarding the message value:  
 The individual information is coded as follows in the message value (r0949/r2124):  
 0000yyxx hex: yy = component number, xx = error cause

**Remedy:**

- check the DRIVE-CLiQ wiring (interrupted cable, contacts, ...).
- check the electrical cabinet design and cable routing for EMC compliance
- if required, use another DRIVE-CLiQ socket (p9904).
- replace the component involved.

---

**F34895 VSM DRIVE-CLiQ (CU): Alternating cyclic data transfer error**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** NONE (OFF1, OFF2)  
**Acknowledge:** IMMEDIATELY  
**Cause:** A DRIVE-CLiQ communications error has occurred from the Voltage Sensing Module involved (VSM) to the Control Unit.  
 Fault cause:  
 11 (= 0B hex):  
 Synchronization error during alternating cyclic data transfer.  
 Note regarding the message value:  
 The individual information is coded as follows in the message value (r0949/r2124):  
 0000yyxx hex: yy = component number, xx = error cause

**Remedy:** Carry out a POWER ON.  
 See also: p9915 (DRIVE-CLiQ data transfer error shutdown threshold master)

---

**F34896 VSM DRIVE-CLiQ (CU): Inconsistent component properties**

**Message value:** Component number: %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** OFF2 (IASC/DCBRK, NONE, OFF1, OFF3, STOP1, STOP2)  
**Acknowledge:** IMMEDIATELY  
**Cause:** The properties of the DRIVE-CLiQ component (Voltage Sensing Module), specified by the fault value, have changed in an incompatible fashion with respect to the properties when booted. One cause can be, e.g. that a DRIVE-CLiQ cable or DRIVE-CLiQ component has been replaced.  
 Fault value (r0949, interpret decimal):  
 Component number.

**Remedy:**

- carry out a POWER ON.
- when a component is replaced, the same component type and if possible the same firmware version should be used.
- when a cable is replaced, only cables whose length is the same as or as close as possible to the length of the original cables should be used (ensure compliance with the maximum cable length).

---

**A35200 (F, N) TM: Calibration data**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** An error was detected in the calibration data of the Terminal Module.

Alarm value (r2124, interpret decimal):  
ddcbaa dec: dd = component number, c = AI/AO, b = fault type, aa = number  
c = 0: analog input (AI, Analog Input)  
c = 1: analog output (AO, Analog Output)  
b = 0: No calibration data available.  
b = 1: Offset too high (> 100 mV).

**Remedy:**  
- carry out a POWER ON (power off/on) for all components.  
- Replace the component if necessary.

Reaction upon F: NONE  
Acknowl. upon F: IMMEDIATELY (POWER ON)  
Reaction upon N: NONE  
Acknowl. upon N: NONE

---

#### **F35207 (N, A) TM: Temperature fault/alarm threshold channel 0 exceeded**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** OFF2 (NONE, OFF1, OFF3)  
**Acknowledge:** IMMEDIATELY (POWER ON)  
**Cause:** For the temperature evaluation via the Terminal Module (TM), at least one of the following conditions to initiate this fault is fulfilled:  
- alarm threshold has been exceeded longer than that set in the timer (p4102[0], p4103[0]).  
or  
- fault threshold exceeded (p4102[1]).  
**Note:**  
For sensor type "PTC thermistor" and "Bimetallic NC contact" (p4100[0] = 1, 4), the following applies:  
- if r4101[0] > 1650 ohms, the temperature r4105[0] = 250 °C  
- if r4101[0] <= 1650 ohms, the temperature r4105[0] = -50 °C  
The temperature actual value is displayed via connector output r4105[0] and can be interconnected.  
**Notice:**  
This fault only causes the drive to shut down if there is at least one BICO interconnection between the drive and the Terminal Module.  
Fault value (r0949, interpret decimal):  
Temperature actual value at the time of initiation [0.1 °C].  
**Remedy:**  
- allow the temperature sensor to cool down to below p4102[1] - hysteresis (5 K, for TM150, can be set using p4118[0]).  
- if required, set the fault response to NONE (p2100, p2101).  
See also: p4102  
Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

#### **F35208 (N, A) TM: Temperature fault/alarm threshold channel 1 exceeded**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150  
**Reaction:** OFF2 (NONE, OFF1, OFF3)  
**Acknowledge:** IMMEDIATELY (POWER ON)  
**Cause:** For the temperature evaluation via the Terminal Module (TM), at least one of the following conditions to initiate this fault is fulfilled:  
- alarm threshold has been exceeded longer than that set in the timer (p4102[2], p4103[1]).  
or  
- fault threshold exceeded (p4102[3]).  
**Note:**  
For sensor type "PTC thermistor" and "Bimetallic NC contact" (p4100[1] = 1, 4), the following applies:  
- if r4101[1] > 1650 ohms, the temperature r4105[1] = 250 °C  
- if r4101[1] <= 1650 ohms, the temperature r4105[1] = -50 °C  
The temperature actual value is displayed via connector output r4105[1] and can be interconnected.

	<p>Notice:</p> <p>This fault only causes the drive to shut down if there is at least one BICO interconnection between the drive and the Terminal Module.</p> <p>Fault value (r0949, interpret decimal):</p> <p>Temperature actual value at the time of initiation [0.1 °C].</p>
<b>Remedy:</b>	<p>- allow the temperature sensor to cool down to below p4102[3] - hysteresis (5 K, for TM150, can be set using p4118[1]).</p> <p>- if required, set the fault response to NONE (p2100, p2101).</p> <p>See also: p4102</p>
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE

<b>F35209 (N, A)</b>	<b>TM: Temperature fault/alarm threshold channel 2 exceeded</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150
<b>Reaction:</b>	OFF2 (NONE, OFF1, OFF3)
<b>Acknowledge:</b>	IMMEDIATELY (POWER ON)
<b>Cause:</b>	<p>For the temperature evaluation via the Terminal Module (TM), at least one of the following conditions to initiate this fault is fulfilled:</p> <ul style="list-style-type: none"> <li>- alarm threshold has been exceeded longer than that set in the timer (p4102[4], p4103[2]).</li> </ul> <p>or</p> <ul style="list-style-type: none"> <li>- fault threshold exceeded (p4102[5]).</li> </ul> <p>Note:</p> <p>For sensor type "PTC thermistor" and "Bimetallic NC contact" (p4100[2] = 1, 4), the following applies:</p> <ul style="list-style-type: none"> <li>- if r4101[2] &gt; 1650 ohms, the temperature r4105[2] = 250 °C</li> <li>- if r4101[2] &lt;= 1650 ohms, the temperature r4105[2] = -50 °C</li> </ul> <p>The temperature actual value is displayed via connector output r4105[2] and can be interconnected.</p> <p>Notice:</p> <p>This fault only causes the drive to shut down if there is at least one BICO interconnection between the drive and the Terminal Module.</p> <p>Fault value (r0949, interpret decimal):</p> <p>Temperature actual value at the time of initiation [0.1 °C].</p>
<b>Remedy:</b>	<p>- allow the temperature sensor to cool down to below p4102[5] - hysteresis (5 K, for TM150, can be set using p4118[2]).</p> <p>- if required, set the fault response to NONE (p2100, p2101).</p> <p>See also: p4102</p>
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE

<b>F35210 (N, A)</b>	<b>TM: Temperature fault/alarm threshold channel 3 exceeded</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150
<b>Reaction:</b>	OFF2 (NONE, OFF1, OFF3)
<b>Acknowledge:</b>	IMMEDIATELY (POWER ON)
<b>Cause:</b>	<p>For the temperature evaluation via the Terminal Module (TM), at least one of the following conditions to initiate this fault is fulfilled:</p> <ul style="list-style-type: none"> <li>- alarm threshold has been exceeded longer than that set in the timer (p4102[6], p4103[3]).</li> </ul> <p>or</p> <ul style="list-style-type: none"> <li>- fault threshold exceeded (p4102[7]).</li> </ul> <p>Note:</p> <p>For sensor type "PTC thermistor" and "Bimetallic NC contact" (p4100[3] = 1, 4), the following applies:</p> <ul style="list-style-type: none"> <li>- if r4101[3] &gt; 1650 ohms, the temperature r4105[3] = 250 °C</li> <li>- if r4101[3] &lt;= 1650 ohms, the temperature r4105[3] = -50 °C</li> </ul> <p>The temperature actual value is displayed via connector output r4105[3] and can be interconnected.</p>



	Notice: This fault only causes the drive to shut down if there is at least one BICO interconnection between the drive and the Terminal Module. Fault value (r0949, interpret decimal): Temperature actual value at the time of initiation [0.1 °C].
<b>Remedy:</b>	- allow the temperature sensor to cool down to below p4102[7] - hysteresis (5 K, for TM150, can be set using p4118[3]). - if required, set the fault response to NONE (p2100, p2101). See also: p4102
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE

---

<b>A35211 (F, N)</b>	<b>TM: Temperature alarm threshold channel 0 exceeded</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150, TM15DI_DO, TM31
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	The temperature measured using the temperature sensing of the Terminal Module (TM) (r4105[0]) has exceeded the threshold value to initiate this alarm (p4102[0]). Note: For sensor type "PTC thermistor" and "Bimetallic NC contact" (p4100[0] = 1, 4), the following applies: - if r4101[0] > 1650 ohms, the temperature r4105[0] = 250 °C - if r4101[0] <= 1650 ohms, the temperature r4105[0] = -50 °C Alarm value (r2124, interpret decimal): Temperature actual value at the time of initiation [0.1 °C].
<b>Remedy:</b>	- allow the temperature sensor to cool down to below p4102[0] - hysteresis (5 K); for TM150, can be set using p4118[0]. See also: p4102
Reaction upon F:	NONE
Acknowl. upon F:	IMMEDIATELY (POWER ON)
Reaction upon N:	NONE
Acknowl. upon N:	NONE

---

<b>A35212 (F, N)</b>	<b>TM: Temperature alarm threshold channel 1 exceeded</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	The temperature measured using the temperature sensing of the Terminal Module (TM) (r4105[1]) has exceeded the threshold value to initiate this alarm (p4102[2]). Note: For sensor type "PTC thermistor" and "Bimetallic NC contact" (p4100[1] = 1, 4), the following applies: - if r4101[1] > 1650 ohms, the temperature r4105[1] = 250 °C - if r4101[1] <= 1650 ohms, the temperature r4105[1] = -50 °C Alarm value (r2124, interpret decimal): Temperature actual value at the time of initiation [0.1 °C].
<b>Remedy:</b>	- allow the temperature sensor to cool down to below p4102[4] - hysteresis (5 K); for TM150, can be set using p4118[1]. See also: p4102
Reaction upon F:	NONE
Acknowl. upon F:	IMMEDIATELY (POWER ON)
Reaction upon N:	NONE
Acknowl. upon N:	NONE

<b>A35213 (F, N)</b>	<b>TM: Temperature alarm threshold channel 2 exceeded</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>The temperature measured using the temperature sensing of the Terminal Module (TM) (r4105[2]) has exceeded the threshold value to initiate this alarm (p4102[4]).</p> <p>Note:</p> <p>For sensor type "PTC thermistor" and "Bimetallic NC contact" (p4100[2] = 1, 4), the following applies:</p> <ul style="list-style-type: none"> <li>- if r4101[2] &gt; 1650 ohms, the temperature r4105[2] = 250 °C</li> <li>- if r4101[2] &lt;= 1650 ohms, the temperature r4105[2] = -50 °C</li> </ul> <p>Alarm value (r2124, interpret decimal):</p> <p>Temperature actual value at the time of initiation [0.1 °C].</p>
<b>Remedy:</b>	<p>- allow the temperature sensor to cool down to below p4102[4] - hysteresis (5 K); for TM150, can be set using p4118[2].</p> <p>See also: p4102</p>
Reaction upon F:	NONE
Acknowl. upon F:	IMMEDIATELY (POWER ON)
Reaction upon N:	NONE
Acknowl. upon N:	NONE
<b>A35214 (F, N)</b>	<b>TM: Temperature alarm threshold channel 3 exceeded</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>The temperature measured using the temperature sensing of the Terminal Module (TM) (r4105[3]) has exceeded the threshold value to initiate this alarm (p4102[6]).</p> <p>Note:</p> <p>For sensor type "PTC thermistor" and "Bimetallic NC contact" (p4100[3] = 1, 4), the following applies:</p> <ul style="list-style-type: none"> <li>- if r4101[3] &gt; 1650 ohms, the temperature r4105[3] = 250 °C</li> <li>- if r4101[3] &lt;= 1650 ohms, the temperature r4105[3] = -50 °C</li> </ul> <p>Alarm value (r2124, interpret decimal):</p> <p>Temperature actual value at the time of initiation [0.1 °C].</p>
<b>Remedy:</b>	<p>- allow the temperature sensor to cool down to below p4102[6] - hysteresis (5 K); for TM150, can be set using p4118[3].</p> <p>See also: p4102</p>
Reaction upon F:	NONE
Acknowl. upon F:	IMMEDIATELY (POWER ON)
Reaction upon N:	NONE
Acknowl. upon N:	NONE
<b>F35220 (N, A)</b>	<b>TM: Frequency limit reached for signal output</b>
<b>Message value:</b>	-
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM15DI_DO, TM31
<b>Reaction:</b>	OFF1 (NONE, OFF2, OFF3)
<b>Acknowledge:</b>	IMMEDIATELY (POWER ON)
<b>Cause:</b>	<p>The signals output from the Terminal Module 41 (TM41) for tracks A/B have reached the limit frequency. The output signals are no longer in synchronism with the specified setpoint.</p> <p>SIMOTION (p4400 = 0) operating mode:</p> <ul style="list-style-type: none"> <li>- If the TM41 has been configured as the technology project, this fault is also output in response to short-circuited A/B signals in X520.</li> </ul> <p>SINAMICS (p4400 = 1) operating mode:</p> <ul style="list-style-type: none"> <li>- the fine resolution of TM41 in p0418 does not match that of the connector input that was interconnected at p4420</li> <li>- the encoder position actual value r0479 interconnected at connector input p4420 has an excessively high actual speed</li> <li>- the output signals correspond to a speed, which is greater than the maximum speed (r1082 of TM41).</li> </ul>

**Remedy:** SIMOTION (p4400 = 0) operating mode:  
- enter a lower speed setpoint (p1155).  
- reduce the encoder pulse number (p0408).  
- check track A/B for short-circuits.  
SINAMICS (p4400 = 1) operating mode:  
- enter a lower speed setpoint (p1155).  
- reduce the encoder pulse number (p0408).  
Notice:  
The output signal is no longer monitored after changing the message type to "Alarm" (A).  
  
Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

**F35221 (N, A)    TM: Setpoint - actual value deviation outside the tolerance range**

**Message value:** -  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM15DI\_DO, TM31  
**Reaction:** OFF1 (NONE, OFF2, OFF3)  
**Acknowledge:** IMMEDIATELY (POWER ON)  
**Cause:** The deviation between the setpoint and the output signals (track A/B) exceeds the tolerance of +/-3 %. The deviation between the internal and external measured value is too high (> 1000 pulses).  
**Remedy:**  
- reduce the basic clock cycle (p0110, p0111).  
- if required, replace the component (e.g. internal short-circuit).  
  
Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

**A35222 (F, N)    TM: Encoder pulse number not permissible**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM15DI\_DO, TM31  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The encoder pulse number entered does not match the permissible pulse number from a hardware perspective.  
Fault value (r0949, interpret decimal):  
1: Encoder pulse number is too high.  
2: Encoder pulse number is too low.  
4: Encoder pulse number is less than the zero mark offset (p4426).  
**Remedy:**  
- enter the encoder pulse number in the permissible range (p0408).  
- if necessary, replace TM41 SAC with TM41 DAC.  
Note:  
TM41 SAC: order no. = 6SL3055-0AA00-3PA0  
TM41 DAC: order no. = 6SL3055-0AA00-3PA1  
The following applies for TM41 SAC:  
- minimum/maximum value for p0408: 1000/8192  
The following applies for TM41 DAC:  
- minimum/maximum value for p0408: 1000/16384  
See also: p0408 (Rotary encoder pulse number)  
  
Reaction upon F: OFF1 (NONE, OFF2, OFF3)  
Acknowl. upon F: IMMEDIATELY (POWER ON)  
Reaction upon N: NONE  
Acknowl. upon N: NONE

<b>A35223 (F, N)</b>	<b>TM: Zero mark offset not permissible</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM15DI_DO, TM31
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	The entered zero mark offset is not permissible. Fault value (r0949, interpret decimal): 1: Zero mark offset is too high.
<b>Remedy:</b>	Enter the zero mark offset in the permissible range (p4426).
Reaction upon F:	OFF1 (NONE, OFF2, OFF3)
Acknowl. upon F:	IMMEDIATELY (POWER ON)
Reaction upon N:	NONE
Acknowl. upon N:	NONE
<b>F35230</b>	<b>TM: Hardware fault</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150, TM15DI_DO, TM31
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	POWER ON
<b>Cause:</b>	The Terminal Module (TM) used has signaled internal errors. Signals from this module may not be evaluated because they are very likely to be incorrect.
<b>Remedy:</b>	If required, replace the Terminal Module.
<b>F35233</b>	<b>DRIVE-CLiQ component function not supported</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150, TM31
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	A function requested by the Control Unit is not supported by a DRIVE-CLiQ component. Fault value (r0949, interpret decimal): 1: Terminal Module 31 does not support the function "Timer for temperature evaluation" (X522.7/8, p4103 > 0.000). 4: The improved actual value resolution is not supported (p4401.4). 5: The improved setpoint resolution is not supported (p4401.5). 6: The residual value handling in the setpoint channel cannot be deactivated (p4401.6). 7: Output frequencies greater than 750 kHz cannot be activated (p4401.7).
<b>Remedy:</b>	For fault value = 1: - De-activate timer for temperature evaluation (X522.7/8) (p4103 = 0.000). - Use Terminal Module 31 and the relevant firmware version to enable the "Timer for temperature evaluation" function (Order No. 6SL3055-0AA00-3AA1, firmware version 2.6 and higher). See also: p4103
<b>F35400 (N, A)</b>	<b>TM: Temperature fault/alarm threshold channel 4 exceeded</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150
<b>Reaction:</b>	OFF2 (NONE, OFF1, OFF3)
<b>Acknowledge:</b>	IMMEDIATELY (POWER ON)
<b>Cause:</b>	For the temperature evaluation via the Terminal Module 150 (TM150), at least one of the following conditions to initiate this fault is fulfilled: - alarm threshold has been exceeded longer than that set in the timer (p4102[8], p4103[4]). or - fault threshold exceeded (p4102[9]). Note: For sensor type "PTC thermistor" and "Bimetallic NC contact" (p4100[4] = 1, 4), the following applies: - if r4101[4] > 1650 ohms, the temperature r4105[4] = 250 °C - if r4101[4] ≤ 1650 ohms, the temperature r4105[4] = -50 °C The temperature actual value is displayed via connector output r4105[4] and can be interconnected.

Notice:

This fault only causes the drive to shut down if there is at least one BICO interconnection between the drive and the Terminal Module.

Fault value (r0949, interpret decimal):

Temperature actual value at the time of initiation [0.1 °C].

**Remedy:**

- allow the temperature sensor to cool down to below p4102[9] - hysteresis (p4118[4]).

- if required, set the fault response to NONE (p2100, p2101).

See also: p4102

Reaction upon N: NONE

Acknowled. upon N: NONE

Reaction upon A: NONE

Acknowled. upon A: NONE

---

**F35401 (N, A)    TM: Temperature fault/alarm threshold channel 5 exceeded**

**Message value:** %1

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150

**Reaction:** OFF2 (NONE, OFF1, OFF3)

**Acknowledge:** IMMEDIATELY (POWER ON)

**Cause:** For the temperature evaluation via the Terminal Module 150 (TM150), at least one of the following conditions to initiate this fault is fulfilled:

- alarm threshold has been exceeded longer than that set in the timer (p4102[10], p4103[5]).

or

- fault threshold exceeded (p4102[11]).

Note:

For sensor type "PTC thermistor" and "Bimetallic NC contact" (p4100[5] = 1, 4), the following applies:

- if r4101[5] > 1650 ohms, the temperature r4105[5] = 250 °C

- if r4101[5] <= 1650 ohms, the temperature r4105[5] = -50 °C

The temperature actual value is displayed via connector output r4105[5] and can be interconnected.

Notice:

This fault only causes the drive to shut down if there is at least one BICO interconnection between the drive and the Terminal Module.

Fault value (r0949, interpret decimal):

Temperature actual value at the time of initiation [0.1 °C].

**Remedy:**

- allow the temperature sensor to cool down to below p4102[11] - hysteresis (p4118[5]).

- if required, set the fault response to NONE (p2100, p2101).

See also: p4102

Reaction upon N: NONE

Acknowled. upon N: NONE

Reaction upon A: NONE

Acknowled. upon A: NONE

---

**F35402 (N, A)    TM: Temperature fault/alarm threshold channel 6 exceeded**

**Message value:** %1

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150

**Reaction:** OFF2 (NONE, OFF1, OFF3)

**Acknowledge:** IMMEDIATELY (POWER ON)

**Cause:** For the temperature evaluation via the Terminal Module 150 (TM150), at least one of the following conditions to initiate this fault is fulfilled:

- alarm threshold has been exceeded longer than that set in the timer (p4102[12], p4103[6]).

or

- fault threshold exceeded (p4102[13]).

Note:

For sensor type "PTC thermistor" and "Bimetallic NC contact" (p4100[6] = 1, 4), the following applies:

- if r4101[6] > 1650 ohms, the temperature r4105[6] = 250 °C

- if r4101[6] <= 1650 ohms, the temperature r4105[6] = -50 °C

The temperature actual value is displayed via connector output r4105[6] and can be interconnected.

Notice:

This fault only causes the drive to shut down if there is at least one BICO interconnection between the drive and the Terminal Module.

	<p>Fault value (r0949, interpret decimal): Temperature actual value at the time of initiation [0.1 °C].</p> <p><b>Remedy:</b></p> <ul style="list-style-type: none"> <li>- allow the temperature sensor to cool down to below p4102[13] - hysteresis (p4118[6]).</li> <li>- if required, set the fault response to NONE (p2100, p2101).</li> </ul> <p>See also: p4102</p> <p>Reaction upon N: NONE</p> <p>Acknowled. upon N: NONE</p> <p>Reaction upon A: NONE</p> <p>Acknowled. upon A: NONE</p>
<b>F35403 (N, A)</b>	<b>TM: Temperature fault/alarm threshold channel 7 exceeded</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150
<b>Reaction:</b>	OFF2 (NONE, OFF1, OFF3)
<b>Acknowledge:</b>	IMMEDIATELY (POWER ON)
<b>Cause:</b>	<p>For the temperature evaluation via the Terminal Module 150 (TM150), at least one of the following conditions to initiate this fault is fulfilled:</p> <ul style="list-style-type: none"> <li>- alarm threshold has been exceeded longer than that set in the timer (p4102[14], p4103[7]).</li> </ul> <p>or</p> <ul style="list-style-type: none"> <li>- fault threshold exceeded (p4102[15]).</li> </ul> <p>Note:</p> <p>For sensor type "PTC thermistor" and "Bimetallic NC contact" (p4100[7] = 1, 4), the following applies:</p> <ul style="list-style-type: none"> <li>- if r4101[7] &gt; 1650 ohms, the temperature r4105[7] = 250 °C</li> <li>- if r4101[7] &lt;= 1650 ohms, the temperature r4105[7] = -50 °C</li> </ul> <p>The temperature actual value is displayed via connector output r4105[7] and can be interconnected.</p> <p>Notice:</p> <p>This fault only causes the drive to shut down if there is at least one BICO interconnection between the drive and the Terminal Module.</p> <p>Fault value (r0949, interpret decimal): Temperature actual value at the time of initiation [0.1 °C].</p> <p><b>Remedy:</b></p> <ul style="list-style-type: none"> <li>- allow the temperature sensor to cool down to below p4102[15] - hysteresis (p4118[7]).</li> <li>- if required, set the fault response to NONE (p2100, p2101).</li> </ul> <p>See also: p4102</p> <p>Reaction upon N: NONE</p> <p>Acknowled. upon N: NONE</p> <p>Reaction upon A: NONE</p> <p>Acknowled. upon A: NONE</p>
<b>F35404 (N, A)</b>	<b>TM: Temperature fault/alarm threshold channel 8 exceeded</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150
<b>Reaction:</b>	OFF2 (NONE, OFF1, OFF3)
<b>Acknowledge:</b>	IMMEDIATELY (POWER ON)
<b>Cause:</b>	<p>For the temperature evaluation via the Terminal Module 150 (TM150), at least one of the following conditions to initiate this fault is fulfilled:</p> <ul style="list-style-type: none"> <li>- alarm threshold has been exceeded longer than that set in the timer (p4102[16], p4103[8]).</li> </ul> <p>or</p> <ul style="list-style-type: none"> <li>- fault threshold exceeded (p4102[17]).</li> </ul> <p>Note:</p> <p>For sensor type "PTC thermistor" and "Bimetallic NC contact" (p4100[8] = 1, 4), the following applies:</p> <ul style="list-style-type: none"> <li>- if r4101[8] &gt; 1650 ohms, the temperature r4105[8] = 250 °C</li> <li>- if r4101[8] &lt;= 1650 ohms, the temperature r4105[8] = -50 °C</li> </ul> <p>The temperature actual value is displayed via connector output r4105[8] and can be interconnected.</p> <p>Notice:</p> <p>This fault only causes the drive to shut down if there is at least one BICO interconnection between the drive and the Terminal Module.</p> <p>Fault value (r0949, interpret decimal): Temperature actual value at the time of initiation [0.1 °C].</p>

**Remedy:**

- allow the temperature sensor to cool down to below p4102[17] - hysteresis (p4118[8]).
- if required, set the fault response to NONE (p2100, p2101).

See also: p4102

Reaction upon N: NONE  
 Acknowl. upon N: NONE  
 Reaction upon A: NONE  
 Acknowl. upon A: NONE

---

**F35405 (N, A) TM: Temperature fault/alarm threshold channel 9 exceeded**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150  
**Reaction:** OFF2 (NONE, OFF1, OFF3)  
**Acknowledge:** IMMEDIATELY (POWER ON)  
**Cause:** For the temperature evaluation via the Terminal Module 150 (TM150), at least one of the following conditions to initiate this fault is fulfilled:  
 - alarm threshold has been exceeded longer than that set in the timer (p4102[18], p4103[9]).  
 or  
 - fault threshold exceeded (p4102[19]).  
**Note:**  
 For sensor type "PTC thermistor" and "Bimetallic NC contact" (p4100[9] = 1, 4), the following applies:  
 - if r4101[9] > 1650 ohms, the temperature r4105[9] = 250 °C  
 - if r4101[9] <= 1650 ohms, the temperature r4105[9] = -50 °C  
 The temperature actual value is displayed via connector output r4105[9] and can be interconnected.  
**Notice:**  
 This fault only causes the drive to shut down if there is at least one BICO interconnection between the drive and the Terminal Module.  
 Fault value (r0949, interpret decimal):  
 Temperature actual value at the time of initiation [0.1 °C].

**Remedy:**

- allow the temperature sensor to cool down to below p4102[19] - hysteresis (p4118[9]).
- if required, set the fault response to NONE (p2100, p2101).

See also: p4102

Reaction upon N: NONE  
 Acknowl. upon N: NONE  
 Reaction upon A: NONE  
 Acknowl. upon A: NONE

---

**F35406 (N, A) TM: Temperature fault/alarm threshold channel 10 exceeded**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150  
**Reaction:** OFF2 (NONE, OFF1, OFF3)  
**Acknowledge:** IMMEDIATELY (POWER ON)  
**Cause:** For the temperature evaluation via the Terminal Module 150 (TM150), at least one of the following conditions to initiate this fault is fulfilled:  
 - alarm threshold has been exceeded longer than that set in the timer (p4102[20], p4103[10]).  
 or  
 - fault threshold exceeded (p4102[21]).  
**Note:**  
 For sensor type "PTC thermistor" and "Bimetallic NC contact" (p4100[10] = 1, 4), the following applies:  
 - if r4101[10] > 1650 ohms, the temperature r4105[10] = 250 °C  
 - if r4101[10] <= 1650 ohms, the temperature r4105[10] = -50 °C  
 The temperature actual value is displayed via connector output r4105[10] and can be interconnected.  
**Notice:**  
 This fault only causes the drive to shut down if there is at least one BICO interconnection between the drive and the Terminal Module.  
 Fault value (r0949, interpret decimal):  
 Temperature actual value at the time of initiation [0.1 °C].

**Remedy:**

- allow the temperature sensor to cool down to below p4102[21] - hysteresis (p4118[10]).
- if required, set the fault response to NONE (p2100, p2101).

See also: p4102

Reaction upon N: NONE  
 Acknowl. upon N: NONE  
 Reaction upon A: NONE  
 Acknowl. upon A: NONE

---

**F35407 (N, A) TM: Temperature fault/alarm threshold channel 11 exceeded**

**Message value:** %1

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150

**Reaction:** OFF2 (NONE, OFF1, OFF3)

**Acknowledge:** IMMEDIATELY (POWER ON)

**Cause:** For the temperature evaluation via the Terminal Module 150 (TM150), at least one of the following conditions to initiate this fault is fulfilled:  
 - alarm threshold has been exceeded longer than that set in the timer (p4102[22], p4103[11]).  
 or  
 - fault threshold exceeded (p4102[23]).  
**Note:**  
 For sensor type "PTC thermistor" and "Bimetallic NC contact" (p4100[11] = 1, 4), the following applies:  
 - if r4101[11] > 1650 ohms, the temperature r4105[11] = 250 °C  
 - if r4101[11] <= 1650 ohms, the temperature r4105[11] = -50 °C  
 The temperature actual value is displayed via connector output r4105[11] and can be interconnected.  
**Notice:**  
 This fault only causes the drive to shut down if there is at least one BICO interconnection between the drive and the Terminal Module.  
 Fault value (r0949, interpret decimal):  
 Temperature actual value at the time of initiation [0.1 °C].

**Remedy:** - allow the temperature sensor to cool down to below p4102[23] - hysteresis (p4118[11]).  
 - if required, set the fault response to NONE (p2100, p2101).  
 See also: p4102

Reaction upon N: NONE  
 Acknowl. upon N: NONE  
 Reaction upon A: NONE  
 Acknowl. upon A: NONE

---

**A35410 (F, N) TM: Temperature alarm threshold channel 4 exceeded**

**Message value:** %1

**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150

**Reaction:** NONE

**Acknowledge:** NONE

**Cause:** The temperature (r4105[4]) measured using the temperature sensing of the Terminal Module 150 (TM150) has exceeded the threshold value to initiate this alarm (p4102[8]).  
**Note:**  
 For sensor type "PTC thermistor" and "Bimetallic NC contact" (p4100[4] = 1, 4), the following applies:  
 - if r4101[4] > 1650 ohms, the temperature r4105[4] = 250 °C  
 - if r4101[4] <= 1650 ohms, the temperature r4105[4] = -50 °C  
 Alarm value (r2124, interpret decimal):  
 Temperature actual value at the time of initiation [0.1 °C].

**Remedy:** Allow the temperature sensor to cool down to below p4102[8] - hysteresis (p4118[4]).  
 See also: p4102

Reaction upon F: NONE  
 Acknowl. upon F: IMMEDIATELY (POWER ON)  
 Reaction upon N: NONE  
 Acknowl. upon N: NONE



---

**A35411 (F, N)    TM: Temperature alarm threshold channel 5 exceeded**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The temperature (r4105[5]) measured using the temperature sensing of the Terminal Module 150 (TM150) has exceeded the threshold value to initiate this alarm (p4102[10]).  
Note:  
For sensor type "PTC thermistor" and "Bimetallic NC contact" (p4100[5] = 1, 4), the following applies:  
- if r4101[5] > 1650 ohms, the temperature r4105[5] = 250 °C  
- if r4101[5] <= 1650 ohms, the temperature r4105[5] = -50 °C  
Alarm value (r2124, interpret decimal):  
Temperature actual value at the time of initiation [0.1 °C].  
**Remedy:** Allow the temperature sensor to cool down to below p4102[10] - hysteresis (p4118[5]).  
See also: p4102  
Reaction upon F: NONE  
Acknowl. upon F: IMMEDIATELY (POWER ON)  
Reaction upon N: NONE  
Acknowl. upon N: NONE

---

**A35412 (F, N)    TM: Temperature alarm threshold channel 6 exceeded**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The temperature (r4105[6]) measured using the temperature sensing of the Terminal Module 150 (TM150) has exceeded the threshold value to initiate this alarm (p4102[12]).  
Note:  
For sensor type "PTC thermistor" and "Bimetallic NC contact" (p4100[6] = 1, 4), the following applies:  
- if r4101[6] > 1650 ohms, the temperature r4105[6] = 250 °C  
- if r4101[6] <= 1650 ohms, the temperature r4105[6] = -50 °C  
Alarm value (r2124, interpret decimal):  
Temperature actual value at the time of initiation [0.1 °C].  
**Remedy:** Allow the temperature sensor to cool down to below p4102[12] - hysteresis (p4118[6]).  
See also: p4102  
Reaction upon F: NONE  
Acknowl. upon F: IMMEDIATELY (POWER ON)  
Reaction upon N: NONE  
Acknowl. upon N: NONE

---

**A35413 (F, N)    TM: Temperature alarm threshold channel 7 exceeded**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The temperature (r4105[7]) measured using the temperature sensing of the Terminal Module 150 (TM150) has exceeded the threshold value to initiate this alarm (p4102[14]).  
Note:  
For sensor type "PTC thermistor" and "Bimetallic NC contact" (p4100[7] = 1, 4), the following applies:  
- if r4101[7] > 1650 ohms, the temperature r4105[7] = 250 °C  
- if r4101[7] <= 1650 ohms, the temperature r4105[7] = -50 °C  
Alarm value (r2124, interpret decimal):  
Temperature actual value at the time of initiation [0.1 °C].  
**Remedy:** Allow the temperature sensor to cool down to below p4102[14] - hysteresis (p4118[7]).  
See also: p4102  
Reaction upon F: NONE  
Acknowl. upon F: IMMEDIATELY (POWER ON)

Reaction upon N: NONE  
Acknowl. upon N: NONE

---

**A35414 (F, N) TM: Temperature alarm threshold channel 8 exceeded**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The temperature (r4105[8]) measured using the temperature sensing of the Terminal Module 150 (TM150) has exceeded the threshold value to initiate this alarm (p4102[16]).  
Note:  
For sensor type "PTC thermistor" and "Bimetallic NC contact" (p4100[8] = 1, 4), the following applies:  
- if r4101[8] > 1650 ohms, the temperature r4105[8] = 250 °C  
- if r4101[8] <= 1650 ohms, the temperature r4105[8] = -50 °C  
Alarm value (r2124, interpret decimal):  
Temperature actual value at the time of initiation [0.1 °C].  
**Remedy:** Allow the temperature sensor to cool down to below p4102[16] - hysteresis (p4118[8]).  
See also: p4102  
Reaction upon F: NONE  
Acknowl. upon F: IMMEDIATELY (POWER ON)  
Reaction upon N: NONE  
Acknowl. upon N: NONE

---

**A35415 (F, N) TM: Temperature alarm threshold channel 9 exceeded**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The temperature (r4105[9]) measured using the temperature sensing of the Terminal Module 150 (TM150) has exceeded the threshold value to initiate this alarm (p4102[18]).  
Note:  
For sensor type "PTC thermistor" and "Bimetallic NC contact" (p4100[9] = 1, 4), the following applies:  
- if r4101[9] > 1650 ohms, the temperature r4105[9] = 250 °C  
- if r4101[9] <= 1650 ohms, the temperature r4105[9] = -50 °C  
Alarm value (r2124, interpret decimal):  
Temperature actual value at the time of initiation [0.1 °C].  
**Remedy:** Allow the temperature sensor to cool down to below p4102[18] - hysteresis (p4118[9]).  
See also: p4102  
Reaction upon F: NONE  
Acknowl. upon F: IMMEDIATELY (POWER ON)  
Reaction upon N: NONE  
Acknowl. upon N: NONE

---

**A35416 (F, N) TM: Temperature alarm threshold channel 10 exceeded**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The temperature (r4105[10]) measured using the temperature sensing of the Terminal Module 150 (TM150) has exceeded the threshold value to initiate this alarm (p4102[20]).  
Note:  
For sensor type "PTC thermistor" and "Bimetallic NC contact" (p4100[10] = 1, 4), the following applies:  
- if r4101[10] > 1650 ohms, the temperature r4105[10] = 250 °C  
- if r4101[10] <= 1650 ohms, the temperature r4105[10] = -50 °C  
Alarm value (r2124, interpret decimal):  
Temperature actual value at the time of initiation [0.1 °C].  
**Remedy:** Allow the temperature sensor to cool down to below p4102[20] - hysteresis (p4118[10]).  
See also: p4102

Reaction upon F: NONE  
Acknowl. upon F: IMMEDIATELY (POWER ON)  
Reaction upon N: NONE  
Acknowl. upon N: NONE

---

**A35417 (F, N) TM: Temperature alarm threshold channel 11 exceeded**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The temperature (r4105[11]) measured using the temperature sensing of the Terminal Module 150 (TM150) has exceeded the threshold value to initiate this alarm (p4102[22]).  
Note:  
For sensor type "PTC thermistor" and "Bimetallic NC contact" (p4100[11] = 1, 4), the following applies:  
- if r4101[11] > 1650 ohms, the temperature r4105[11] = 250 °C  
- if r4101[11] <= 1650 ohms, the temperature r4105[11] = -50 °C  
Alarm value (r2124, interpret decimal):  
Temperature actual value at the time of initiation [0.1 °C].  
**Remedy:** Allow the temperature sensor to cool down to below p4102[22] - hysteresis (p4118[11]).  
See also: p4102  
Reaction upon F: NONE  
Acknowl. upon F: IMMEDIATELY (POWER ON)  
Reaction upon N: NONE  
Acknowl. upon N: NONE

---

**N35800 (F) TM: Group signal**

**Message value:** -  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** OFF2 (IASC/DCBRK, NONE, OFF1, OFF3, STOP1, STOP2)  
**Acknowledge:** NONE  
**Cause:** The Terminal Module has detected at least one fault.  
**Remedy:** Evaluates other actual messages.  
Reaction upon F: OFF2 (IASC/DCBRK, NONE, OFF1, OFF3, STOP1, STOP2)  
Acknowl. upon F: IMMEDIATELY

---

**A35801 (F, N) TM DRIVE-CLiQ: Sign-of-life missing**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** A DRIVE-CLiQ communication error has occurred between the Control Unit and the Terminal Module involved.  
Fault cause:  
10 (= 0A hex):  
The sign-of-life bit in the receive telegram is not set.  
Note regarding the message value:  
The individual information is coded as follows in the message value (r0949/r2124):  
0000yyxx hex: yy = component number, xx = error cause  
**Remedy:** - check the DRIVE-CLiQ connection.  
- replace the component involved.  
See also: p9916 (DRIVE-CLiQ data transfer error shutdown threshold slave)  
Reaction upon F: NONE  
Acknowl. upon F: IMMEDIATELY  
Reaction upon N: NONE  
Acknowl. upon N: NONE

---

**A35802 (F, N) TM: Time slice overflow**

**Message value:** -  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** A time slice overflow has occurred on the Terminal Module.  
**Remedy:** Replace the Terminal Module.  
**Reaction upon F:** NONE  
**Acknowl. upon F:** IMMEDIATELY (POWER ON)  
**Reaction upon N:** NONE  
**Acknowl. upon N:** NONE

---

**A35803 (F, N) TM: Memory test**

**Message value:** -  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** An error has occurred during the memory test on the Terminal Module.  
**Remedy:**  
 - check whether the permissible ambient temperature for the Terminal Module is being maintained.  
 - replace the Terminal Module.  
**Reaction upon F:** NONE  
**Acknowl. upon F:** IMMEDIATELY (POWER ON)  
**Reaction upon N:** NONE  
**Acknowl. upon N:** NONE

---

**F35804 (N, A) TM: CRC**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** NONE  
**Acknowledge:** IMMEDIATELY (POWER ON)  
**Cause:** A checksum error has occurred when reading-out the program memory on the Terminal Module.  
 Fault value (r0949, interpret hexadecimal):  
 Difference between the checksum at POWER ON and the actual checksum.  
**Remedy:**  
 - check whether the permissible ambient temperature for the component is maintained.  
 - replace the Terminal Module.  
**Reaction upon N:** NONE  
**Acknowl. upon N:** NONE  
**Reaction upon A:** NONE  
**Acknowl. upon A:** NONE

---

**A35805 (F, N) TM: EPROM checksum error**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** Internal parameter data is corrupted.  
 Alarm value (r2124, interpret hexadecimal):  
 01: EEPROM access error.  
 02: Too many blocks in the EEPROM.  
**Remedy:**  
 - check whether the permissible ambient temperature for the component is maintained.  
 - replace the Terminal Module 31 (TM31).  
**Reaction upon F:** NONE  
**Acknowl. upon F:** IMMEDIATELY (POWER ON)

Reaction upon N: NONE  
Acknowl. upon N: NONE

---

**A35807 (F, N)      TM: Sequence control time monitoring**

**Message value:** -  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** Error, timeout, sequence control on the Terminal Module.  
**Remedy:** Replace the Terminal Module.  
Reaction upon F: NONE  
Acknowl. upon F: IMMEDIATELY (POWER ON)  
Reaction upon N: NONE  
Acknowl. upon N: NONE

---

**F35820              TM DRIVE-CLiQ: Telegram error**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** OFF1 (OFF2)  
**Acknowledge:** IMMEDIATELY  
**Cause:** A DRIVE-CLiQ communication error has occurred from the Control Unit to the Terminal Module involved.  
Fault cause:  
1 (= 01 hex):  
Checksum error (CRC error).  
2 (= 02 hex):  
Telegram is shorter than specified in the length byte or in the receive list.  
3 (= 03 hex):  
Telegram is longer than specified in the length byte or in the receive list.  
4 (= 04 hex):  
The length of the receive telegram does not match the receive list.  
5 (= 05 hex):  
The type of the receive telegram does not match the receive list.  
6 (= 06 hex):  
The address of the component in the telegram and in the receive list do not match.  
7 (= 07 hex):  
A SYNC telegram is expected - but the received telegram is not a SYNC telegram.  
8 (= 08 hex):  
No SYNC telegram is expected - but the received telegram is one.  
9 (= 09 hex):  
The error bit in the receive telegram is set.  
16 (= 10 hex):  
The receive telegram is too early.  
Note regarding the message value:  
The individual information is coded as follows in the message value (r0949/r2124):  
0000yyxx hex: yy = component number, xx = error cause  
**Remedy:** - carry out a POWER ON (power off/on).  
- check the electrical cabinet design and cable routing for EMC compliance  
- check the DRIVE-CLiQ wiring (interrupted cable, contacts, ...).  
See also: p9916 (DRIVE-CLiQ data transfer error shutdown threshold slave)

---

**F35835              TM DRIVE-CLiQ: Cyclic data transfer error**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** OFF1 (OFF2)  
**Acknowledge:** IMMEDIATELY  
**Cause:** A DRIVE-CLiQ communication error has occurred from the Control Unit to the Terminal Module involved. The nodes do not send and receive in synchronism.

Fault cause:  
 33 (= 21 hex):  
 The cyclic telegram has not been received.  
 34 (= 22 hex):  
 Timeout in the telegram receive list.  
 64 (= 40 hex):  
 Timeout in the telegram send list.  
 Note regarding the message value:  
 The individual information is coded as follows in the message value (r0949/r2124):  
 0000yyxx hex: yy = component number, xx = error cause

**Remedy:**

- carry out a POWER ON.
- replace the component involved.

See also: p9916 (DRIVE-CLiQ data transfer error shutdown threshold slave)

---

**F35836 TM DRIVE-CLiQ: Send error for DRIVE-CLiQ data**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** OFF1 (OFF2)  
**Acknowledge:** IMMEDIATELY  
**Cause:** A DRIVE-CLiQ communication error has occurred between the Control Unit and the Terminal Module involved. Data were not able to be sent.  
 Fault cause:  
 65 (= 41 hex):  
 Telegram type does not match send list.  
 Note regarding the message value:  
 The individual information is coded as follows in the message value (r0949/r2124):  
 0000yyxx hex: yy = component number, xx = error cause  
**Remedy:** Carry out a POWER ON.

---

**F35837 PTM DRIVE-CLiQ: Component fault**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** OFF1 (OFF2)  
**Acknowledge:** IMMEDIATELY  
**Cause:** Fault detected on the DRIVE-CLiQ component concerned. Faulty hardware cannot be excluded.  
 Fault cause:  
 32 (= 20 hex):  
 Error in the telegram header.  
 35 (= 23 hex):  
 Receive error: The telegram buffer memory contains an error.  
 66 (= 42 hex):  
 Send error: The telegram buffer memory contains an error.  
 67 (= 43 hex):  
 Send error: The telegram buffer memory contains an error.  
 Note regarding the message value:  
 The individual information is coded as follows in the message value (r0949/r2124):  
 0000yyxx hex: yy = component number, xx = error cause  
**Remedy:**

- check the DRIVE-CLiQ wiring (interrupted cable, contacts, ...).
- check the electrical cabinet design and cable routing for EMC compliance
- if required, use another DRIVE-CLiQ socket (p9904).
- replace the component involved.

---

**A35840 TM DRIVE-CLiQ: error below the signaling threshold**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** A DRIVE-CLiQ error has occurred below the signaling threshold.

Fault cause:  
1 (= 01 hex):  
Checksum error (CRC error).  
2 (= 02 hex):  
Telegram is shorter than specified in the length byte or in the receive list.  
3 (= 03 hex):  
Telegram is longer than specified in the length byte or in the receive list.  
4 (= 04 hex):  
The length of the receive telegram does not match the receive list.  
5 (= 05 hex):  
The type of the receive telegram does not match the receive list.  
6 (= 06 hex):  
The address of the component in the telegram and in the receive list do not match.  
7 (= 07 hex):  
A SYNC telegram is expected - but the received telegram is not a SYNC telegram.  
8 (= 08 hex):  
No SYNC telegram is expected - but the received telegram is one.  
9 (= 09 hex):  
The error bit in the receive telegram is set.  
10 (= 0A hex):  
The sign-of-life bit in the receive telegram is not set.  
11 (= 0B hex):  
Synchronization error during alternating cyclic data transfer.  
16 (= 10 hex):  
The receive telegram is too early.  
32 (= 20 hex):  
Error in the telegram header.  
33 (= 21 hex):  
The cyclic telegram has not been received.  
34 (= 22 hex):  
Timeout in the telegram receive list.  
35 (= 23 hex):  
Receive error: The telegram buffer memory contains an error.  
64 (= 40 hex):  
Timeout in the telegram send list.  
65 (= 41 hex):  
Telegram type does not match send list.  
66 (= 42 hex):  
Send error: The telegram buffer memory contains an error.  
67 (= 43 hex):  
Send error: The telegram buffer memory contains an error.  
Note regarding the message value:  
The individual information is coded as follows in the message value (r0949/r2124):  
0000yyxx hex: yy = component number, xx = error cause

**Remedy:**

- check the electrical cabinet design and cable routing for EMC compliance
- check the DRIVE-CLiQ wiring (interrupted cable, contacts, ...).

See also: p9916 (DRIVE-CLiQ data transfer error shutdown threshold slave)

---

<b>F35845</b>	<b>TM DRIVE-CLiQ: Cyclic data transfer error</b>
<b>Message value:</b>	Component number: %1, fault cause: %2
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150, TM15DI_DO, TM31
<b>Reaction:</b>	OFF1 (OFF2)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	A DRIVE-CLiQ communication error has occurred between the Control Unit and the Terminal Module (TM) involved. Fault cause: 11 (= 0B hex): Synchronization error during alternating cyclic data transfer. Note regarding the message value: The individual information is coded as follows in the message value (r0949/r2124): 0000yyxx hex: yy = component number, xx = error cause
<b>Remedy:</b>	Carry out a POWER ON. See also: p9916 (DRIVE-CLiQ data transfer error shutdown threshold slave)

<b>F35850</b>	<b>TM: Internal software error</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150, TM15DI_DO, TM31
<b>Reaction:</b>	OFF1 (NONE, OFF2, OFF3)
<b>Acknowledge:</b>	POWER ON
<b>Cause:</b>	An internal software error in the Terminal Module (TM) has occurred. Fault value (r0949, interpret decimal): 1: Background time slice is blocked. 2: Checksum over the code memory is not OK.
<b>Remedy:</b>	- replace the Terminal Module (TM). - if required, upgrade the firmware in the Terminal Module. - contact the Hotline.
<b>F35851</b>	<b>TM DRIVE-CLiQ (CU): Sign-of-life missing</b>
<b>Message value:</b>	Component number: %1, fault cause: %2
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150, TM15DI_DO, TM31
<b>Reaction:</b>	OFF1 (OFF2)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	A DRIVE-CLiQ communication error has occurred from the Terminal Module involved (TM) to the Control Unit. The DRIVE-CLiQ component did not set the sign-of-life to the Control Unit. Fault cause: 10 (= 0A hex): The sign-of-life bit in the receive telegram is not set. Note regarding the message value: The individual information is coded as follows in the message value (r0949/r2124): 0000yyxx hex: yy = component number, xx = error cause
<b>Remedy:</b>	Upgrade the firmware of the component involved.
<b>F35860</b>	<b>TM DRIVE-CLiQ (CU): Telegram error</b>
<b>Message value:</b>	Component number: %1, fault cause: %2
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150, TM15DI_DO, TM31
<b>Reaction:</b>	OFF1 (OFF2)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	A DRIVE-CLiQ communication error has occurred from the Terminal Module involved (TM) to the Control Unit. Fault cause: 1 (= 01 hex): Checksum error (CRC error). 2 (= 02 hex): Telegram is shorter than specified in the length byte or in the receive list. 3 (= 03 hex): Telegram is longer than specified in the length byte or in the receive list. 4 (= 04 hex): The length of the receive telegram does not match the receive list. 5 (= 05 hex): The type of the receive telegram does not match the receive list. 6 (= 06 hex): The address of the power unit in the telegram and in the receive list do not match. 9 (= 09 hex): The error bit in the receive telegram is set. 16 (= 10 hex): The receive telegram is too early. 17 (= 11 hex): CRC error and the receive telegram is too early. 18 (= 12 hex): The telegram is shorter than that specified in the length byte or in the receive list and the receive telegram is too early. 19 (= 13 hex): The telegram is longer than that specified in the length byte or in the receive list and the receive telegram is too early. 20 (= 14 hex): The length of the receive telegram does not match the receive list and the receive telegram is too early.



21 (= 15 hex):  
The type of the receive telegram does not match the receive list and the receive telegram is too early.  
22 (= 16 hex):  
The address of the power unit in the telegram and in the receive list does not match and the receive telegram is too early.  
25 (= 19 hex):  
The error bit in the receive telegram is set and the receive telegram is too early.  
Note regarding the message value:  
The individual information is coded as follows in the message value (r0949/r2124):  
0000yyxx hex: yy = component number, xx = error cause

**Remedy:**

- carry out a POWER ON (power off/on).
- check the electrical cabinet design and cable routing for EMC compliance
- check the DRIVE-CLiQ wiring (interrupted cable, contacts, ...).

See also: p9915 (DRIVE-CLiQ data transfer error shutdown threshold master)

---

**F35875      TM DRIVE-CLiQ (CU): Supply voltage failed**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** OFF1 (OFF2)  
**Acknowledge:** IMMEDIATELY  
**Cause:** The DRIVE-CLiQ communication from the DRIVE-CLiQ component involved to the Control Unit signals that the supply voltage has failed.  
Fault cause:  
9 (= 09 hex):  
The power supply voltage for the components has failed.  
Note regarding the message value:  
The individual information is coded as follows in the message value (r0949/r2124):  
0000yyxx hex: yy = component number, xx = error cause

**Remedy:**

- carry out a POWER ON (power off/on).
- check the power supply voltage wiring for the DRIVE-CLiQ component (interrupted cable, contacts, ...).
- check the dimensioning of the power supply for the DRIVE-CLiQ component.

---

**F35885      TM DRIVE-CLiQ (CU): Cyclic data transfer error**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** OFF1 (OFF2)  
**Acknowledge:** IMMEDIATELY  
**Cause:** A DRIVE-CLiQ communication error has occurred from the Terminal Module involved (TM) to the Control Unit.  
The nodes do not send and receive in synchronism.  
Fault cause:  
26 (= 1A hex):  
Sign-of-life bit in the receive telegram not set and the receive telegram is too early.  
33 (= 21 hex):  
The cyclic telegram has not been received.  
34 (= 22 hex):  
Timeout in the telegram receive list.  
64 (= 40 hex):  
Timeout in the telegram send list.  
98 (= 62 hex):  
Error at the transition to cyclic operation.  
Note regarding the message value:  
The individual information is coded as follows in the message value (r0949/r2124):  
0000yyxx hex: yy = component number, xx = error cause

**Remedy:**

- check the power supply voltage of the component involved.
- carry out a POWER ON.
- replace the component involved.

See also: p9915 (DRIVE-CLiQ data transfer error shutdown threshold master)

<b>F35886</b>	<b>TM DRIVE-CLiQ (CU): Error when sending DRIVE-CLiQ data</b>
<b>Message value:</b>	Component number: %1, fault cause: %2
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150, TM15DI_DO, TM31
<b>Reaction:</b>	OFF1 (OFF2)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>A DRIVE-CLiQ communication error has occurred from the Terminal Module involved (TM) to the Control Unit. Data were not able to be sent.</p> <p>Fault cause:</p> <p>65 (= 41 hex):</p> <p>Telegram type does not match send list.</p> <p>Note regarding the message value:</p> <p>The individual information is coded as follows in the message value (r0949/r2124):</p> <p>0000yyxx hex: yy = component number, xx = error cause</p>
<b>Remedy:</b>	Carry out a POWER ON.
<b>F35887</b>	<b>TM DRIVE-CLiQ (CU): Component fault</b>
<b>Message value:</b>	Component number: %1, fault cause: %2
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150, TM15DI_DO, TM31
<b>Reaction:</b>	OFF1 (OFF2)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>Fault detected on the DRIVE-CLiQ component (Terminal Module) involved. Faulty hardware cannot be excluded.</p> <p>Fault cause:</p> <p>32 (= 20 hex):</p> <p>Error in the telegram header.</p> <p>35 (= 23 hex):</p> <p>Receive error: The telegram buffer memory contains an error.</p> <p>66 (= 42 hex):</p> <p>Send error: The telegram buffer memory contains an error.</p> <p>67 (= 43 hex):</p> <p>Send error: The telegram buffer memory contains an error.</p> <p>96 (= 60 hex):</p> <p>Response received too late during runtime measurement.</p> <p>97 (= 61 hex):</p> <p>Time taken to exchange characteristic data too long.</p> <p>Note regarding the message value:</p> <p>The individual information is coded as follows in the message value (r0949/r2124):</p> <p>0000yyxx hex: yy = component number, xx = error cause</p>
<b>Remedy:</b>	<ul style="list-style-type: none"> <li>- check the DRIVE-CLiQ wiring (interrupted cable, contacts, ...).</li> <li>- check the electrical cabinet design and cable routing for EMC compliance</li> <li>- if required, use another DRIVE-CLiQ socket (p9904).</li> <li>- replace the component involved.</li> </ul>
<b>F35895</b>	<b>TM DRIVE-CLiQ (CU): Alternating cyclic data transfer error</b>
<b>Message value:</b>	Component number: %1, fault cause: %2
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150, TM15DI_DO, TM31
<b>Reaction:</b>	OFF1 (OFF2)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>A DRIVE-CLiQ communication error has occurred from the Terminal Module involved (TM) to the Control Unit.</p> <p>Fault cause:</p> <p>11 (= 0B hex):</p> <p>Synchronization error during alternating cyclic data transfer.</p> <p>Note regarding the message value:</p> <p>The individual information is coded as follows in the message value (r0949/r2124):</p> <p>0000yyxx hex: yy = component number, xx = error cause</p>
<b>Remedy:</b>	<p>Carry out a POWER ON.</p> <p>See also: p9915 (DRIVE-CLiQ data transfer error shutdown threshold master)</p>

---

<b>F35896</b>	<b>TM DRIVE-CLiQ (CU): Inconsistent component properties</b>
<b>Message value:</b>	Component number: %1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150, TM15DI_DO, TM31
<b>Reaction:</b>	OFF2 (IASC/DCBRK, NONE, OFF1, OFF3, STOP1, STOP2)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	The properties of the DRIVE-CLiQ component (Terminal Module), specified by the fault value, have changed in an incompatible fashion with respect to the properties when booted. One cause can be, e.g. that a DRIVE-CLiQ cable or DRIVE-CLiQ component has been replaced. Fault value (r0949, interpret decimal): Component number.
<b>Remedy:</b>	<ul style="list-style-type: none"><li>- carry out a POWER ON.</li><li>- when a component is replaced, the same component type and if possible the same firmware version should be used.</li><li>- when a cable is replaced, only cables whose length is the same as or as close as possible to the length of the original cables should be used (ensure compliance with the maximum cable length).</li></ul>

---

<b>F35899 (N, A)</b>	<b>TM: Unknown fault</b>
<b>Message value:</b>	New message: %1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150, TM15DI_DO, TM31
<b>Reaction:</b>	NONE (IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)
<b>Acknowledge:</b>	IMMEDIATELY (POWER ON)
<b>Cause:</b>	A fault has occurred on the Terminal Module that cannot be interpreted by the Control Unit firmware. This can occur if the firmware on this component is more recent than the firmware on the Control Unit. Fault value (r0949, interpret decimal): Fault number. Note: If required, the significance of this new fault can be read about in a more recent description of the Control Unit.
<b>Remedy:</b>	<ul style="list-style-type: none"><li>- replace the firmware on the Terminal Module by an older firmware version (r0158).</li><li>- upgrade the firmware on the Control Unit (r0018).</li></ul>
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE

---

<b>A35903 (F, N)</b>	<b>TM: I2C bus error occurred</b>
<b>Message value:</b>	-
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150, TM15DI_DO, TM31
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	An error has occurred while accessing the internal I2C bus of the Terminal Module.
<b>Remedy:</b>	Replace the Terminal Module.
Reaction upon F:	NONE
Acknowl. upon F:	IMMEDIATELY (POWER ON)
Reaction upon N:	NONE
Acknowl. upon N:	NONE

---

<b>A35904 (F, N)</b>	<b>TM: EEPROM</b>
<b>Message value:</b>	-
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150, TM15DI_DO, TM31
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	An error has occurred accessing the non-volatile memory on the Terminal Module.
<b>Remedy:</b>	Replace the Terminal Module.
Reaction upon F:	NONE
Acknowl. upon F:	IMMEDIATELY (POWER ON)

Reaction upon N: NONE  
Acknowl. upon N: NONE

---

**A35905 (F, N) TM: Parameter access**

**Message value:** -  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The Control Unit attempted to write an illegal parameter value to the Terminal Module.  
**Remedy:** - check whether the firmware version of the Terminal Module (r0158) matches the firmware version of Control Unit (r0018).  
- if required, replace the Terminal Module.  
**Note:**  
The firmware versions that match each other are in the readme.txt file on the memory card.

Reaction upon F: NONE  
Acknowl. upon F: IMMEDIATELY (POWER ON)  
Reaction upon N: NONE  
Acknowl. upon N: NONE

---

**A35906 (F, N) TM: 24 V power supply missing**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The 24 V power supply for the digital outputs is missing.  
Alarm value (r2124, interpret hexadecimal):  
01: TM17 24 V power supply for DI/DO 0 ... 7 missing.  
02: TM17 24 V power supply for DI/DO 8 ... 15 missing.  
04: TM15 24 V power supply for DI/DO 0 ... 7 (X520) missing.  
08: TM15 24 V power supply for DI/DO 8 ... 15 (X521) missing.  
10: TM15 24 V power supply for DI/DO 16 ... 23 (X522) missing.  
20: TM41 24 V power supply for DI/DO 0 ... 3 missing.  
**Remedy:** Check the terminals for the power supply voltage (L1+, L2+, L3+, M or +24 V\_1 for TM41).

Reaction upon F: NONE  
Acknowl. upon F: IMMEDIATELY (POWER ON)  
Reaction upon N: NONE  
Acknowl. upon N: NONE

---

**A35907 (F, N) TM: Hardware initialization error**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The Terminal Module was not successfully initialized.  
Alarm value (r2124, interpret hexadecimal):  
01: TM17 or TM41 - incorrect configuration request.  
02: TM17 or TM41 - programming not successful.  
04: TM17 or TM41 - invalid time stamp

**Remedy:** Carry out a POWER ON.  
Reaction upon F: NONE  
Acknowl. upon F: IMMEDIATELY (POWER ON)  
Reaction upon N: NONE  
Acknowl. upon N: NONE

---

**A35910 (F, N)    TM: Module overtemperature**

**Message value:** -  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The temperature in the module has exceeded the highest permissible limit.  
**Remedy:** - reduce the ambient temperature.  
- replace the Terminal Module.

Reaction upon F: NONE  
Acknowl. upon F: IMMEDIATELY (POWER ON)  
Reaction upon N: NONE  
Acknowl. upon N: NONE

---

**A35911 (F, N)    TM: Clock synchronous operation sign-of-life missing**

**Message value:** -  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The maximum permissible number of errors in the master sign-of-life (clock synchronous operation) has been exceeded in cyclic operation.  
When the alarm is output, the module outputs are reset up to the next synchronization.  
**Remedy:** - check the physical bus configuration (terminating resistor, shielding, etc.).  
- check the interconnection of the master sign-of-life (r4201 via p0915).  
- check whether the master correctly sends the sign-of-life (e.g. set up a trace with r4201.12 ... r4201.15 and trigger signal r4301.9).  
- check the bus and master for utilization level (e.g. bus cycle time Tdp was set too short).

Reaction upon F: NONE  
Acknowl. upon F: IMMEDIATELY (POWER ON)  
Reaction upon N: NONE  
Acknowl. upon N: NONE

---

**A35920 (F, N)    TM: Error temperature sensor channel 0**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** When evaluating the temperature sensor, an error occurred.  
Alarm value (r2124, interpret decimal):  
1: Wire breakage or sensor not connected.  
KTY84: R > 1630 Ohm (TM150: R > 2170 Ohm), PT100: R > 194 Ohm, PT1000: R > 1944 Ohm  
2: Measured resistance too low.  
PTC thermistor: R < 20 Ohm, KTY84: R < 50 Ohm (TM150: R < 180 Ohm), PT100: R < 60 Ohm, PT1000: R < 603 Ohm  
**Remedy:** - make sure that the sensor is connected correctly.  
- replace the sensor.

Reaction upon F: NONE  
Acknowl. upon F: IMMEDIATELY (POWER ON)  
Reaction upon N: NONE  
Acknowl. upon N: NONE

<b>A35921 (F, N)</b>	<b>TM: Error temperature sensor channel 1</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	When evaluating the temperature sensor, an error occurred. Alarm value (r2124, interpret decimal): 1: Wire breakage or sensor not connected. KTY84: R > 1630 Ohm (TM150: R > 2170 Ohm), PT100: R > 194 Ohm, PT1000: R > 1944 Ohm 2: Measured resistance too low. PTC thermistor: R < 20 Ohm, KTY84: R < 50 Ohm (TM150: R < 180 Ohm), PT100: R < 60 Ohm, PT1000: R < 603 Ohm
<b>Remedy:</b>	- make sure that the sensor is connected correctly. - replace the sensor.
Reaction upon F:	NONE
Acknowl. upon F:	IMMEDIATELY (POWER ON)
Reaction upon N:	NONE
Acknowl. upon N:	NONE
<b>A35922 (F, N)</b>	<b>TM: Error temperature sensor channel 2</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	When evaluating the temperature sensor, an error occurred. Alarm value (r2124, interpret decimal): 1: Wire breakage or sensor not connected. KTY84: R > 1630 Ohm (TM150: R > 2170 Ohm), PT100: R > 194 Ohm, PT1000: R > 1944 Ohm 2: Measured resistance too low. PTC thermistor: R < 20 Ohm, KTY84: R < 50 Ohm (TM150: R < 180 Ohm), PT100: R < 60 Ohm, PT1000: R < 603 Ohm
<b>Remedy:</b>	- make sure that the sensor is connected correctly. - replace the sensor.
Reaction upon F:	NONE
Acknowl. upon F:	IMMEDIATELY (POWER ON)
Reaction upon N:	NONE
Acknowl. upon N:	NONE
<b>A35923 (F, N)</b>	<b>TM: Error temperature sensor channel 3</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	When evaluating the temperature sensor, an error occurred. Alarm value (r2124, interpret decimal): 1: Wire breakage or sensor not connected. KTY84: R > 1630 Ohm (TM150: R > 2170 Ohm), PT100: R > 194 Ohm, PT1000: R > 1944 Ohm 2: Measured resistance too low. PTC thermistor: R < 20 Ohm, KTY84: R < 50 Ohm (TM150: R < 180 Ohm), PT100: R < 60 Ohm, PT1000: R < 603 Ohm
<b>Remedy:</b>	- make sure that the sensor is connected correctly. - replace the sensor.
Reaction upon F:	NONE
Acknowl. upon F:	IMMEDIATELY (POWER ON)
Reaction upon N:	NONE
Acknowl. upon N:	NONE

---

**A35924 (F, N)    TM: Error temperature sensor channel 4**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** When evaluating the temperature sensor, an error occurred.  
Alarm value (r2124, interpret decimal):  
1: Wire breakage or sensor not connected.  
KTY84: R > 2170 Ohm, PT100: R > 194 Ohm, PT1000: R > 1944 Ohm  
2: Measured resistance too low.  
PTC thermistor: R < 20 Ohm, KTY84: R < 180 Ohm, PT100: R < 60 Ohm, PT1000: R < 603 Ohm  
**Remedy:** - make sure that the sensor is connected correctly.  
- replace the sensor.  
Reaction upon F: NONE  
Acknowl. upon F: IMMEDIATELY (POWER ON)  
Reaction upon N: NONE  
Acknowl. upon N: NONE

---

**A35925 (F, N)    TM: Error temperature sensor channel 5**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** When evaluating the temperature sensor, an error occurred.  
Alarm value (r2124, interpret decimal):  
1: Wire breakage or sensor not connected.  
KTY84: R > 2170 Ohm, PT100: R > 194 Ohm, PT1000: R > 1944 Ohm  
2: Measured resistance too low.  
PTC thermistor: R < 20 Ohm, KTY84: R < 180 Ohm, PT100: R < 60 Ohm, PT1000: R < 603 Ohm  
**Remedy:** - make sure that the sensor is connected correctly.  
- replace the sensor.  
Reaction upon F: NONE  
Acknowl. upon F: IMMEDIATELY (POWER ON)  
Reaction upon N: NONE  
Acknowl. upon N: NONE

---

**A35926 (F, N)    TM: Error temperature sensor channel 6**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** When evaluating the temperature sensor, an error occurred.  
Alarm value (r2124, interpret decimal):  
1: Wire breakage or sensor not connected.  
KTY84: R > 2170 Ohm, PT100: R > 194 Ohm, PT1000: R > 1944 Ohm  
2: Measured resistance too low.  
PTC thermistor: R < 20 Ohm, KTY84: R < 180 Ohm, PT100: R < 60 Ohm, PT1000: R < 603 Ohm  
**Remedy:** - make sure that the sensor is connected correctly.  
- replace the sensor.  
Reaction upon F: NONE  
Acknowl. upon F: IMMEDIATELY (POWER ON)  
Reaction upon N: NONE  
Acknowl. upon N: NONE

---

**A35927 (F, N) TM: Error temperature sensor channel 7**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** When evaluating the temperature sensor, an error occurred.  
 Alarm value (r2124, interpret decimal):  
 1: Wire breakage or sensor not connected.  
 KTY84: R > 2170 Ohm, PT100: R > 194 Ohm, PT1000: R > 1944 Ohm  
 2: Measured resistance too low.  
 PTC thermistor: R < 20 Ohm, KTY84: R < 180 Ohm, PT100: R < 60 Ohm, PT1000: R < 603 Ohm  
**Remedy:**  
 - make sure that the sensor is connected correctly.  
 - replace the sensor.  
 Reaction upon F: NONE  
 Acknowl. upon F: IMMEDIATELY (POWER ON)  
 Reaction upon N: NONE  
 Acknowl. upon N: NONE

---

**A35928 (F, N) TM: Error temperature sensor channel 8**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** When evaluating the temperature sensor, an error occurred.  
 Alarm value (r2124, interpret decimal):  
 1: Wire breakage or sensor not connected.  
 KTY84: R > 2170 Ohm, PT100: R > 194 Ohm, PT1000: R > 1944 Ohm  
 2: Measured resistance too low.  
 PTC thermistor: R < 20 Ohm, KTY84: R < 180 Ohm, PT100: R < 60 Ohm, PT1000: R < 603 Ohm  
**Remedy:**  
 - make sure that the sensor is connected correctly.  
 - replace the sensor.  
 Reaction upon F: NONE  
 Acknowl. upon F: IMMEDIATELY (POWER ON)  
 Reaction upon N: NONE  
 Acknowl. upon N: NONE

---

**A35929 (F, N) TM: Error temperature sensor channel 9**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** When evaluating the temperature sensor, an error occurred.  
 Alarm value (r2124, interpret decimal):  
 1: Wire breakage or sensor not connected.  
 KTY84: R > 2170 Ohm, PT100: R > 194 Ohm, PT1000: R > 1944 Ohm  
 2: Measured resistance too low.  
 PTC thermistor: R < 20 Ohm, KTY84: R < 180 Ohm, PT100: R < 60 Ohm, PT1000: R < 603 Ohm  
**Remedy:**  
 - make sure that the sensor is connected correctly.  
 - replace the sensor.  
 Reaction upon F: NONE  
 Acknowl. upon F: IMMEDIATELY (POWER ON)  
 Reaction upon N: NONE  
 Acknowl. upon N: NONE



---

**A35930 (F, N)    TM: Error temperature sensor channel 10**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** When evaluating the temperature sensor, an error occurred.  
Alarm value (r2124, interpret decimal):  
1: Wire breakage or sensor not connected.  
KTY84: R > 2170 Ohm, PT100: R > 194 Ohm, PT1000: R > 1944 Ohm  
2: Measured resistance too low.  
PTC thermistor: R < 20 Ohm, KTY84: R < 180 Ohm, PT100: R < 60 Ohm, PT1000: R < 603 Ohm  
**Remedy:** - make sure that the sensor is connected correctly.  
- replace the sensor.  
Reaction upon F: NONE  
Acknowl. upon F: IMMEDIATELY (POWER ON)  
Reaction upon N: NONE  
Acknowl. upon N: NONE

---

**A35931 (F, N)    TM: Error temperature sensor channel 11**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** When evaluating the temperature sensor, an error occurred.  
Alarm value (r2124, interpret decimal):  
1: Wire breakage or sensor not connected.  
KTY84: R > 2170 Ohm, PT100: R > 194 Ohm, PT1000: R > 1944 Ohm  
2: Measured resistance too low.  
PTC thermistor: R < 20 Ohm, KTY84: R < 180 Ohm, PT100: R < 60 Ohm, PT1000: R < 603 Ohm  
**Remedy:** - make sure that the sensor is connected correctly.  
- replace the sensor.  
Reaction upon F: NONE  
Acknowl. upon F: IMMEDIATELY (POWER ON)  
Reaction upon N: NONE  
Acknowl. upon N: NONE

---

**A35999 (F, N)    TM: Unknown alarm**

**Message value:** New message: %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** An alarm has occurred on the Terminal Module that cannot be interpreted by the Control Unit firmware.  
This can occur if the firmware on this component is more recent than the firmware on the Control Unit.  
Alarm value (r2124, interpret decimal):  
Alarm number.  
Note:  
If required, the significance of this new alarm can be read about in a more recent description of the Control Unit.  
**Remedy:** - replace the firmware on the Terminal Module by an older firmware version (r0158).  
- upgrade the firmware on the Control Unit (r0018).  
Reaction upon F: NONE (IASC/DCBRK, OFF1, OFF2, OFF3, STOP1, STOP2)  
Acknowl. upon F: IMMEDIATELY (POWER ON)  
Reaction upon N: NONE  
Acknowl. upon N: NONE

<b>A36840</b>	<b>Hub DRIVE-CLiQ: error below the signaling threshold</b>
<b>Message value:</b>	Component number: %1, fault cause: %2
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>A DRIVE-CLiQ error has occurred below the signaling threshold.</p> <p>Fault cause:</p> <p>1 (= 01 hex): Checksum error (CRC error).</p> <p>2 (= 02 hex): Telegram is shorter than specified in the length byte or in the receive list.</p> <p>3 (= 03 hex): Telegram is longer than specified in the length byte or in the receive list.</p> <p>4 (= 04 hex): The length of the receive telegram does not match the receive list.</p> <p>5 (= 05 hex): The type of the receive telegram does not match the receive list.</p> <p>6 (= 06 hex): The address of the component in the telegram and in the receive list do not match.</p> <p>7 (= 07 hex): A SYNC telegram is expected - but the received telegram is not a SYNC telegram.</p> <p>8 (= 08 hex): No SYNC telegram is expected - but the received telegram is one.</p> <p>9 (= 09 hex): The error bit in the receive telegram is set.</p> <p>10 (= 0A hex): The sign-of-life bit in the receive telegram is not set.</p> <p>11 (= 0B hex): Synchronization error during alternating cyclic data transfer.</p> <p>16 (= 10 hex): The receive telegram is too early.</p> <p>32 (= 20 hex): Error in the telegram header.</p> <p>33 (= 21 hex): The cyclic telegram has not been received.</p> <p>34 (= 22 hex): Timeout in the telegram receive list.</p> <p>35 (= 23 hex): Receive error: The telegram buffer memory contains an error.</p> <p>64 (= 40 hex): Timeout in the telegram send list.</p> <p>65 (= 41 hex): Telegram type does not match send list.</p> <p>66 (= 42 hex): Send error: The telegram buffer memory contains an error.</p> <p>67 (= 43 hex): Send error: The telegram buffer memory contains an error.</p> <p>Note regarding the message value: The individual information is coded as follows in the message value (r0949/r2124): 0000yyxx hex: yy = component number, xx = error cause</p>
<b>Remedy:</b>	<p>- check the electrical cabinet design and cable routing for EMC compliance</p> <p>- check the DRIVE-CLiQ wiring (interrupted cable, contacts, ...).</p> <p>See also: p9916 (DRIVE-CLiQ data transfer error shutdown threshold slave)</p>
<b>F36851</b>	<b>Hub DRIVE-CLiQ (CU): Sign-of-life missing</b>
<b>Message value:</b>	Component number: %1, fault cause: %2
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150, TM15DI_DO, TM31
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>DRIVE-CLiQ communication error from DRIVE-CLiQ Hub Module in question to Control Unit.</p> <p>The DRIVE-CLiQ component did not set the sign-of-life to the Control Unit.</p>

Fault cause:  
10 (= 0A hex):  
The sign-of-life bit in the receive telegram is not set.  
Note regarding the message value:  
The individual information is coded as follows in the message value (r0949/r2124):  
0000yyxx hex: yy = component number, xx = error cause  
**Remedy:** Upgrade the firmware of the component involved.

---

**F36860 Hub DRIVE-CLiQ (CU): Telegram error**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** NONE  
**Acknowledge:** IMMEDIATELY  
**Cause:** DRIVE-CLiQ communication error from DRIVE-CLiQ Hub Module in question to Control Unit.  
Fault cause:  
1 (= 01 hex):  
Checksum error (CRC error).  
2 (= 02 hex):  
Telegram is shorter than specified in the length byte or in the receive list.  
3 (= 03 hex):  
Telegram is longer than specified in the length byte or in the receive list.  
4 (= 04 hex):  
The length of the receive telegram does not match the receive list.  
5 (= 05 hex):  
The type of the receive telegram does not match the receive list.  
6 (= 06 hex):  
The address of the power unit in the telegram and in the receive list do not match.  
9 (= 09 hex):  
The error bit in the receive telegram is set.  
16 (= 10 hex):  
The receive telegram is too early.  
17 (= 11 hex):  
CRC error and the receive telegram is too early.  
18 (= 12 hex):  
The telegram is shorter than that specified in the length byte or in the receive list and the receive telegram is too early.  
19 (= 13 hex):  
The telegram is longer than that specified in the length byte or in the receive list and the receive telegram is too early.  
20 (= 14 hex):  
The length of the receive telegram does not match the receive list and the receive telegram is too early.  
21 (= 15 hex):  
The type of the receive telegram does not match the receive list and the receive telegram is too early.  
22 (= 16 hex):  
The address of the power unit in the telegram and in the receive list does not match and the receive telegram is too early.  
25 (= 19 hex):  
The error bit in the receive telegram is set and the receive telegram is too early.  
Note regarding the message value:  
The individual information is coded as follows in the message value (r0949/r2124):  
0000yyxx hex: yy = component number, xx = error cause  
**Remedy:**  
- carry out a POWER ON (power off/on).  
- check the electrical cabinet design and cable routing for EMC compliance  
- check the DRIVE-CLiQ wiring (interrupted cable, contacts, ...).

---

**F36875 HUB DRIVE-CLiQ (CU): Supply voltage failed**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** OFF1 (OFF2)  
**Acknowledge:** IMMEDIATELY  
**Cause:** The DRIVE-CLiQ communication from the DRIVE-CLiQ component involved to the Control Unit signals that the supply voltage has failed.

Fault cause:  
 9 (= 09 hex):  
 The power supply voltage for the components has failed.  
 Note regarding the message value:  
 The individual information is coded as follows in the message value (r0949/r2124):  
 0000yyxx hex: yy = component number, xx = error cause

**Remedy:**

- carry out a POWER ON (power off/on).
- check the power supply voltage wiring for the DRIVE-CLiQ component (interrupted cable, contacts, ...).
- check the dimensioning of the power supply for the DRIVE-CLiQ component.

---

**F36885 Hub DRIVE-CLiQ (CU): Cyclic data transfer error**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** NONE  
**Acknowledge:** IMMEDIATELY  
**Cause:** DRIVE-CLiQ communication error from DRIVE-CLiQ Hub Module in question to the Control Unit.  
 The nodes do not send and receive in synchronism.  
 Fault cause:  
 26 (= 1A hex):  
 Sign-of-life bit in the receive telegram not set and the receive telegram is too early.  
 33 (= 21 hex):  
 The cyclic telegram has not been received.  
 34 (= 22 hex):  
 Timeout in the telegram receive list.  
 64 (= 40 hex):  
 Timeout in the telegram send list.  
 98 (= 62 hex):  
 Error at the transition to cyclic operation.  
 Note regarding the message value:  
 The individual information is coded as follows in the message value (r0949/r2124):  
 0000yyxx hex: yy = component number, xx = error cause

**Remedy:**

- check the supply voltage of the component involved.
- carry out a POWER ON.
- replace the component involved.

---

**F36886 Hub DRIVE-CLiQ (CU): Error when sending DRIVE-CLiQ data**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** NONE  
**Acknowledge:** IMMEDIATELY  
**Cause:** DRIVE-CLiQ communication error from DRIVE-CLiQ Hub Module in question to Control Unit.  
 Data were not able to be sent.  
 Fault cause:  
 65 (= 41 hex):  
 Telegram type does not match send list.  
 Note regarding the message value:  
 The individual information is coded as follows in the message value (r0949/r2124):  
 0000yyxx hex: yy = component number, xx = error cause

**Remedy:** Carry out a POWER ON.

---

**F36887 Hub DRIVE-CLiQ (CU): Component fault**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** NONE  
**Acknowledge:** IMMEDIATELY  
**Cause:** Fault detected on the DRIVE-CLiQ component (DRIVE-CLiQ Hub Module) involved. Faulty hardware cannot be excluded.

Fault cause:  
 32 (= 20 hex):  
 Error in the telegram header.  
 35 (= 23 hex):  
 Receive error: The telegram buffer memory contains an error.  
 66 (= 42 hex):  
 Send error: The telegram buffer memory contains an error.  
 67 (= 43 hex):  
 Send error: The telegram buffer memory contains an error.  
 96 (= 60 hex):  
 Response received too late during runtime measurement.  
 97 (= 61 hex):  
 Time taken to exchange characteristic data too long.  
 Note regarding the message value:  
 The individual information is coded as follows in the message value (r0949/r2124):  
 0000yyxx hex: yy = component number, xx = error cause

**Remedy:**

- check the DRIVE-CLiQ wiring (interrupted cable, contacts, ...).
- check the electrical cabinet design and cable routing for EMC compliance
- if required, use another DRIVE-CLiQ socket (p9904).
- replace the component involved.

---

**F36895      Hub DRIVE-CLiQ (CU): Alternating cyclic data transfer error**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** NONE  
**Acknowledge:** IMMEDIATELY  
**Cause:** DRIVE-CLiQ communication error from DRIVE-CLiQ Hub Module in question to Control Unit.  
 Fault cause:  
 11 (= 0B hex):  
 Synchronization error during alternating cyclic data transfer.  
 Note regarding the message value:  
 The individual information is coded as follows in the message value (r0949/r2124):  
 0000yyxx hex: yy = component number, xx = error cause

**Remedy:** Carry out a POWER ON.  
 See also: p9915 (DRIVE-CLiQ data transfer error shutdown threshold master)

---

**F36896      Hub DRIVE-CLiQ (CU): Inconsistent component properties**

**Message value:** Component number: %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** NONE  
**Acknowledge:** IMMEDIATELY  
**Cause:** The properties of the DRIVE-CLiQ component (DRIVE-CLiQ Hub Module), specified by the fault value, have changed in an incompatible fashion with respect to the properties when booted. One cause can be, e.g. that a DRIVE-CLiQ cable or DRIVE-CLiQ component has been replaced.  
 Fault value (r0949, interpret decimal):  
 Component number.

**Remedy:**

- carry out a POWER ON.
- when a component is replaced, the same component type and if possible the same firmware version should be used.
- when a cable is replaced, only cables whose length is the same as or as close as possible to the length of the original cables should be used (ensure compliance with the maximum cable length).

---

**A37840      HF Damping Module DRIVE-CLiQ: error below the signaling threshold**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** A DRIVE-CLiQ error has occurred below the signaling threshold.

List of faults and alarms

Fault cause:  
 1 (= 01 hex):  
 Checksum error (CRC error).  
 2 (= 02 hex):  
 Telegram is shorter than specified in the length byte or in the receive list.  
 3 (= 03 hex):  
 Telegram is longer than specified in the length byte or in the receive list.  
 4 (= 04 hex):  
 The length of the receive telegram does not match the receive list.  
 5 (= 05 hex):  
 The type of the receive telegram does not match the receive list.  
 6 (= 06 hex):  
 The address of the component in the telegram and in the receive list do not match.  
 7 (= 07 hex):  
 A SYNC telegram is expected - but the received telegram is not a SYNC telegram.  
 8 (= 08 hex):  
 No SYNC telegram is expected - but the received telegram is one.  
 9 (= 09 hex):  
 The error bit in the receive telegram is set.  
 10 (= 0A hex):  
 The sign-of-life bit in the receive telegram is not set.  
 11 (= 0B hex):  
 Synchronization error during alternating cyclic data transfer.  
 16 (= 10 hex):  
 The receive telegram is too early.  
 32 (= 20 hex):  
 Error in the telegram header.  
 33 (= 21 hex):  
 The cyclic telegram has not been received.  
 34 (= 22 hex):  
 Timeout in the telegram receive list.  
 35 (= 23 hex):  
 Receive error: The telegram buffer memory contains an error.  
 64 (= 40 hex):  
 Timeout in the telegram send list.  
 65 (= 41 hex):  
 Telegram type does not match send list.  
 66 (= 42 hex):  
 Send error: The telegram buffer memory contains an error.  
 67 (= 43 hex):  
 Send error: The telegram buffer memory contains an error.  
 Note regarding the message value:  
 The individual information is coded as follows in the message value (r0949/r2124):  
 0000yyxx hex: yy = component number, xx = error cause

**Remedy:**

- check the electrical cabinet design and cable routing for EMC compliance
- check the DRIVE-CLiQ wiring (interrupted cable, contacts, ...).

See also: p9916 (DRIVE-CLiQ data transfer error shutdown threshold slave)

<b>F40000</b>	<b>Fault at DRIVE-CLiQ socket X100</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	A fault has occurred at the drive object at the DRIVE-CLiQ socket X100. Fault value (r0949, interpret decimal): First fault that has occurred for this drive object.
<b>Remedy:</b>	Evaluate the fault buffer of the specified object.

---

**F40001      Fault at DRIVE-CLiQ socket X101**

**Message value:** %1  
**Drive object:** All objects  
**Reaction:** NONE  
**Acknowledge:** IMMEDIATELY  
**Cause:** A fault has occurred at the drive object at the DRIVE-CLiQ socket X101.  
Fault value (r0949, interpret decimal):  
First fault that has occurred for this drive object.  
**Remedy:** Evaluate the fault buffer of the specified object.

---

**F40002      Fault at DRIVE-CLiQ socket X102**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** NONE  
**Acknowledge:** IMMEDIATELY  
**Cause:** A fault has occurred at the drive object at the DRIVE-CLiQ socket X102.  
Fault value (r0949, interpret decimal):  
First fault that has occurred for this drive object.  
**Remedy:** Evaluate the fault buffer of the specified object.

---

**F40003      Fault at DRIVE-CLiQ socket X103**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** NONE  
**Acknowledge:** IMMEDIATELY  
**Cause:** A fault has occurred at the drive object at the DRIVE-CLiQ socket X103.  
Fault value (r0949, interpret decimal):  
First fault that has occurred for this drive object.  
**Remedy:** Evaluate the fault buffer of the specified object.

---

**F40004      Fault at DRIVE-CLiQ socket X104**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** NONE  
**Acknowledge:** IMMEDIATELY  
**Cause:** A fault has occurred at the drive object at the DRIVE-CLiQ socket X104.  
Fault value (r0949, interpret decimal):  
First fault that has occurred for this drive object.  
**Remedy:** Evaluate the fault buffer of the specified object.

---

**F40005      Fault at DRIVE-CLiQ socket X105**

**Message value:** %1  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** NONE  
**Acknowledge:** IMMEDIATELY  
**Cause:** A fault has occurred at the drive object at the DRIVE-CLiQ socket X105.  
Fault value (r0949, interpret decimal):  
First fault that has occurred for this drive object.  
**Remedy:** Evaluate the fault buffer of the specified object.

<b>A40100</b>	<b>Alarm at DRIVE-CLiQ socket X100</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	An alarm has occurred at the drive object at the DRIVE-CLiQ socket X100. Alarm value (r2124, interpret decimal): First alarm that has occurred for this drive object.
<b>Remedy:</b>	Evaluate the alarm buffer of the specified object.
<b>A40101</b>	<b>Alarm at DRIVE-CLiQ socket X101</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	An alarm has occurred at the drive object at the DRIVE-CLiQ socket X101. Alarm value (r2124, interpret decimal): First alarm that has occurred for this drive object.
<b>Remedy:</b>	Evaluate the alarm buffer of the specified object.
<b>A40102</b>	<b>Alarm at DRIVE-CLiQ socket X102</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150, TM15DI_DO, TM31
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	An alarm has occurred at the drive object at the DRIVE-CLiQ socket X102. Alarm value (r2124, interpret decimal): First alarm that has occurred for this drive object.
<b>Remedy:</b>	Evaluate the alarm buffer of the specified object.
<b>A40103</b>	<b>Alarm at DRIVE-CLiQ socket X103</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150, TM15DI_DO, TM31
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	An alarm has occurred at the drive object at the DRIVE-CLiQ socket X103. Alarm value (r2124, interpret decimal): First alarm that has occurred for this drive object.
<b>Remedy:</b>	Evaluate the alarm buffer of the specified object.
<b>A40104</b>	<b>Alarm at DRIVE-CLiQ socket X104</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150, TM15DI_DO, TM31
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	An alarm has occurred at the drive object at the DRIVE-CLiQ socket X104. Alarm value (r2124, interpret decimal): First alarm that has occurred for this drive object.
<b>Remedy:</b>	Evaluate the alarm buffer of the specified object.



---

<b>A40105</b>	<b>Alarm at DRIVE-CLiQ socket X105</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150, TM15DI_DO, TM31
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	An alarm has occurred at the drive object at the DRIVE-CLiQ socket X105. Alarm value (r2124, interpret decimal): First alarm that has occurred for this drive object.
<b>Remedy:</b>	Evaluate the alarm buffer of the specified object.

---

<b>F40799</b>	<b>CX32: Configured transfer end time exceeded</b>
<b>Message value:</b>	-
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150, TM15DI_DO, TM31
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	The configured transfer end time when transferring the cyclic actual values was exceeded.
<b>Remedy:</b>	- carry out a POWER ON (power off/on) for all components. - contact the Hotline.

---

<b>F40801</b>	<b>CX32 DRIVE-CLiQ: Sign-of-life missing</b>
<b>Message value:</b>	Component number: %1, fault cause: %2
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150, TM15DI_DO, TM31
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	A DRIVE-CLiQ communications error has occurred from the Control Unit to the controller extension involved. Fault cause: 10 (= 0A hex): The sign-of-life bit in the receive telegram is not set. Note regarding the message value: The individual information is coded as follows in the message value (r0949/r2124): 0000yyxx hex: yy = component number, xx = error cause
<b>Remedy:</b>	- carry out a POWER ON (power off/on). - replace the component involved. See also: p9916 (DRIVE-CLiQ data transfer error shutdown threshold slave)

---

<b>F40820</b>	<b>CX32 DRIVE-CLiQ: Telegram error</b>
<b>Message value:</b>	Component number: %1, fault cause: %2
<b>Drive object:</b>	DC_CTRL, DC_CTRL_R, DC_CTRL_R_S, DC_CTRL_S, TM150, TM15DI_DO, TM31
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	A DRIVE-CLiQ communications error has occurred from the Control Unit to the controller extension involved. Fault cause: 1 (= 01 hex): Checksum error (CRC error). 2 (= 02 hex): Telegram is shorter than specified in the length byte or in the receive list. 3 (= 03 hex): Telegram is longer than specified in the length byte or in the receive list. 4 (= 04 hex): The length of the receive telegram does not match the receive list. 5 (= 05 hex): The type of the receive telegram does not match the receive list. 6 (= 06 hex): The address of the component in the telegram and in the receive list do not match. 7 (= 07 hex): A SYNC telegram is expected - but the received telegram is not a SYNC telegram. 8 (= 08 hex): No SYNC telegram is expected - but the received telegram is one.

---

9 (= 09 hex):  
The error bit in the receive telegram is set.  
16 (= 10 hex):  
The receive telegram is too early.  
Note regarding the message value:  
The individual information is coded as follows in the message value (r0949/r2124):  
0000yyxx hex: yy = component number, xx = error cause

**Remedy:**

- carry out a POWER ON (power off/on).
- check the electrical cabinet design and cable routing for EMC compliance
- check the DRIVE-CLiQ wiring (interrupted cable, contacts, ...).

See also: p9916 (DRIVE-CLiQ data transfer error shutdown threshold slave)

---

#### **F40825 CX32 DRIVE-CLiQ: Supply voltage failed**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** All objects  
**Reaction:** OFF1 (OFF2)  
**Acknowledge:** IMMEDIATELY  
**Cause:** The DRIVE-CLiQ communication from the DRIVE-CLiQ component involved to the Control Unit signals that the supply voltage has failed.  
 Fault cause:  
 9 (= 09 hex):  
 The power supply voltage for the components has failed.  
 Note regarding the message value:  
 The individual information is coded as follows in the message value (r0949/r2124):  
 0000yyxx hex: yy = component number, xx = error cause

**Remedy:**

- carry out a POWER ON (power off/on).
- check the supply voltage wiring of the DRIVE-CLiQ component (interrupted cable, contacts, ...).
- check the dimensioning of the DRIVE-CLiQ component power supply.

---

#### **F40835 CX32 DRIVE-CLiQ: Cyclic data transfer error**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** OFF2  
**Acknowledge:** IMMEDIATELY  
**Cause:** A DRIVE-CLiQ communications error has occurred from the Control Unit to the controller extension involved. The nodes do not send and receive in synchronism.  
 Fault cause:  
 33 (= 21 hex):  
 The cyclic telegram has not been received.  
 34 (= 22 hex):  
 Timeout in the telegram receive list.  
 64 (= 40 hex):  
 Timeout in the telegram send list.  
 Note regarding the message value:  
 The individual information is coded as follows in the message value (r0949/r2124):  
 0000yyxx hex: yy = component number, xx = error cause

**Remedy:**

- carry out a POWER ON (power off/on).
- replace the component involved.

See also: p9916 (DRIVE-CLiQ data transfer error shutdown threshold slave)

---

#### **F40836 CX32 DRIVE-CLiQ: Send error for DRIVE-CLiQ data**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** OFF2  
**Acknowledge:** IMMEDIATELY  
**Cause:** A DRIVE-CLiQ communications error has occurred from the Control Unit to the controller extension involved. Data were not able to be sent.

Fault cause:  
65 (= 41 hex):  
Telegram type does not match send list.  
Note regarding the message value:  
The individual information is coded as follows in the message value (r0949/r2124):  
0000yyxx hex: yy = component number, xx = error cause  
**Remedy:**  
Carry out a POWER ON (power off/on).

---

#### **F40837 CX32 DRIVE-CLiQ: Component fault**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** OFF2  
**Acknowledge:** IMMEDIATELY  
**Cause:** Fault detected on the DRIVE-CLiQ component concerned. Faulty hardware cannot be excluded.  
Fault cause:  
32 (= 20 hex):  
Error in the telegram header.  
35 (= 23 hex):  
Receive error: The telegram buffer memory contains an error.  
66 (= 42 hex):  
Send error: The telegram buffer memory contains an error.  
67 (= 43 hex):  
Send error: The telegram buffer memory contains an error.  
Note regarding the message value:  
The individual information is coded as follows in the message value (r0949/r2124):  
0000yyxx hex: yy = component number, xx = error cause  
**Remedy:**  
- check the DRIVE-CLiQ wiring (interrupted cable, contacts, ...).  
- check the electrical cabinet design and cable routing for EMC compliance  
- if required, use another DRIVE-CLiQ socket (p9904).  
- replace the component involved.

---

#### **F40845 CX32 DRIVE-CLiQ: Cyclic data transfer error**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** OFF2  
**Acknowledge:** IMMEDIATELY  
**Cause:** A DRIVE-CLiQ communications error has occurred from the Control Unit to the controller extension involved.  
Fault cause:  
11 (= 0B hex):  
Synchronization error during alternating cyclic data transfer.  
Note regarding the message value:  
The individual information is coded as follows in the message value (r0949/r2124):  
0000yyxx hex: yy = component number, xx = error cause  
**Remedy:**  
Carry out a POWER ON (power off/on).  
See also: p9916 (DRIVE-CLiQ data transfer error shutdown threshold slave)

---

#### **F40851 CX32 DRIVE-CLiQ (CU): Sign-of-life missing**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** OFF2  
**Acknowledge:** IMMEDIATELY  
**Cause:** A DRIVE-CLiQ communications error has occurred from the controller extension involved to the Control Unit.  
The DRIVE-CLiQ component did not set the sign-of-life to the Control Unit.  
Fault cause:  
10 (= 0A hex):  
The sign-of-life bit in the receive telegram is not set.  
Note regarding the message value:  
The individual information is coded as follows in the message value (r0949/r2124):  
0000yyxx hex: yy = component number, xx = error cause

**Remedy:** Upgrade the firmware of the component involved.

---

**F40860 CX32 DRIVE-CLiQ (CU): Telegram error**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** OFF2  
**Acknowledge:** IMMEDIATELY  
**Cause:** A DRIVE-CLiQ communications error has occurred from the controller extension involved to the Control Unit.  
 Fault cause:  
 1 (= 01 hex):  
 Checksum error (CRC error).  
 2 (= 02 hex):  
 Telegram is shorter than specified in the length byte or in the receive list.  
 3 (= 03 hex):  
 Telegram is longer than specified in the length byte or in the receive list.  
 4 (= 04 hex):  
 The length of the receive telegram does not match the receive list.  
 5 (= 05 hex):  
 The type of the receive telegram does not match the receive list.  
 6 (= 06 hex):  
 The address of the power unit in the telegram and in the receive list do not match.  
 9 (= 09 hex):  
 The error bit in the receive telegram is set.  
 16 (= 10 hex):  
 The receive telegram is too early.  
 17 (= 11 hex):  
 CRC error and the receive telegram is too early.  
 18 (= 12 hex):  
 The telegram is shorter than that specified in the length byte or in the receive list and the receive telegram is too early.  
 19 (= 13 hex):  
 The telegram is longer than that specified in the length byte or in the receive list and the receive telegram is too early.  
 20 (= 14 hex):  
 The length of the receive telegram does not match the receive list and the receive telegram is too early.  
 21 (= 15 hex):  
 The type of the receive telegram does not match the receive list and the receive telegram is too early.  
 22 (= 16 hex):  
 The address of the power unit in the telegram and in the receive list does not match and the receive telegram is too early.  
 25 (= 19 hex):  
 The error bit in the receive telegram is set and the receive telegram is too early.  
 Note regarding the message value:  
 The individual information is coded as follows in the message value (r0949/r2124):  
 0000yyxx hex: yy = component number, xx = error cause  
**Remedy:**  
 - carry out a POWER ON (power off/on).  
 - check the electrical cabinet design and cable routing for EMC compliance  
 - check the DRIVE-CLiQ wiring (interrupted cable, contacts, ...).  
 See also: p9915 (DRIVE-CLiQ data transfer error shutdown threshold master)

---

**F40875 CX32 DRIVE-CLiQ (CU): Supply voltage failed**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** All objects  
**Reaction:** OFF1 (OFF2)  
**Acknowledge:** IMMEDIATELY  
**Cause:** The DRIVE-CLiQ communication from the DRIVE-CLiQ component involved to the Control Unit signals that the supply voltage has failed.  
 Fault cause:  
 9 (= 09 hex):  
 The power supply voltage for the components has failed.  
 Note regarding the message value:  
 The individual information is coded as follows in the message value (r0949/r2124):  
 0000yyxx hex: yy = component number, xx = error cause

**Remedy:**

- carry out a POWER ON (power off/on).
- check the supply voltage wiring of the DRIVE-CLiQ component (interrupted cable, contacts, ...).
- check the dimensioning of the DRIVE-CLiQ component power supply.

---

**F40885 CX32 DRIVE-CLiQ (CU): Cyclic data transfer error**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** OFF2  
**Acknowledge:** IMMEDIATELY  
**Cause:** A DRIVE-CLiQ communications error has occurred from the controller extension involved to the Control Unit.  
The nodes do not send and receive in synchronism.  
Fault cause:  
26 (= 1A hex):  
Sign-of-life bit in the receive telegram not set and the receive telegram is too early.  
33 (= 21 hex):  
The cyclic telegram has not been received.  
34 (= 22 hex):  
Timeout in the telegram receive list.  
64 (= 40 hex):  
Timeout in the telegram send list.  
98 (= 62 hex):  
Error at the transition to cyclic operation.  
Note regarding the message value:  
The individual information is coded as follows in the message value (r0949/r2124):  
0000yyxx hex: yy = component number, xx = error cause  
**Remedy:**

- check the power supply voltage of the component involved.
- carry out a POWER ON (power off/on).
- replace the component involved.

See also: p9915 (DRIVE-CLiQ data transfer error shutdown threshold master)

---

**F40886 CX32 DRIVE-CLiQ (CU): Error when sending DRIVE-CLiQ data**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** OFF2  
**Acknowledge:** IMMEDIATELY  
**Cause:** A DRIVE-CLiQ communications error has occurred from the controller extension involved to the Control Unit.  
Data were not able to be sent.  
Fault cause:  
65 (= 41 hex):  
Telegram type does not match send list.  
Note regarding the message value:  
The individual information is coded as follows in the message value (r0949/r2124):  
0000yyxx hex: yy = component number, xx = error cause  
**Remedy:** Carry out a POWER ON (power off/on).

---

**F40887 CX32 DRIVE-CLiQ (CU): Component fault**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** OFF2  
**Acknowledge:** IMMEDIATELY  
**Cause:** Fault detected on the DRIVE-CLiQ component concerned. Faulty hardware cannot be excluded.  
Fault cause:  
32 (= 20 hex):  
Error in the telegram header.  
35 (= 23 hex):  
Receive error: The telegram buffer memory contains an error.  
66 (= 42 hex):  
Send error: The telegram buffer memory contains an error.  
67 (= 43 hex):  
Send error: The telegram buffer memory contains an error.

96 (= 60 hex):  
Response received too late during runtime measurement.  
97 (= 61 hex):  
Time taken to exchange characteristic data too long.  
Note regarding the message value:  
The individual information is coded as follows in the message value (r0949/r2124):  
0000yyxx hex: yy = component number, xx = error cause

**Remedy:**

- check the DRIVE-CLiQ wiring (interrupted cable, contacts, ...).
- check the electrical cabinet design and cable routing for EMC compliance
- if required, use another DRIVE-CLiQ socket (p9904).
- replace the component involved.

---

**F40895 CX32 DRIVE-CLiQ (CU): Cyclic data transfer error**

**Message value:** Component number: %1, fault cause: %2  
**Drive object:** DC\_CTRL, DC\_CTRL\_R, DC\_CTRL\_R\_S, DC\_CTRL\_S, TM150, TM15DI\_DO, TM31  
**Reaction:** OFF2  
**Acknowledge:** IMMEDIATELY  
**Cause:** A DRIVE-CLiQ communications error has occurred from the controller extension involved to the Control Unit.  
 Fault cause:  
 11 (= 0B hex):  
 Synchronization error during alternating cyclic data transfer.  
 Note regarding the message value:  
 The individual information is coded as follows in the message value (r0949/r2124):  
 0000yyxx hex: yy = component number, xx = error cause  
**Remedy:** Carry out a POWER ON (power off/on).  
 See also: p9915 (DRIVE-CLiQ data transfer error shutdown threshold master)

---

**A50001 (F) COMM BOARD: Alarm 1**

**Message value:** %1  
**Drive object:** All objects  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** CBE20:  
 A PROFINET controller attempts to establish a connection using an incorrect configuring telegram. The "Shared Device" function has been activated (p8829 = 2).  
 Alarm value (r2124, interpret decimal):  
 10: A CPU sends a PROFIsafe telegram.  
 11: F CPU sends a PZD telegram.  
 12: F CPU without an A CPU.  
 13: F CPU with more PROFIsafe subslots than activated with p9601.3.  
 14: F CPU with fewer PROFIsafe subslots than activated with p9601.3.  
 15: PROFIsafe telegram of the F-CPU does not match the setting in p60022.  
 See also: p8829 (CBE20 remote controller number)  
**Remedy:** CBE20:  
 Check the configuration of the PROFINET controllers as well as the p8829 and p9601.3 setting.  
 Reaction upon F: NONE (OFF1, OFF2, OFF3)  
 Acknowled. upon F: IMMEDIATELY

---

**A50002 (F) COMM BOARD: Alarm 2**

**Message value:** %1  
**Drive object:** All objects  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** CBE20 SINAMICS Link:  
 A specific telegram word (send) is being used twice.  
 Alarm value (r2124, interpret decimal):  
 Telegram word used twice  
 See also: p8871 (SINAMICS Link send telegram word PZD)

**Remedy:** CBE20 SINAMICS Link:  
Correct the parameter assignment.  
See also: p8871 (SINAMICS Link send telegram word PZD)

Reaction upon F: NONE (OFF1, OFF2, OFF3)

Acknowled. upon F: IMMEDIATELY

---

**A50003 (F)      COMM BOARD: Alarm 3**

**Message value:** Info. 1: %1, info. 2: %2

**Drive object:** All objects

**Reaction:** NONE

**Acknowledge:** NONE

**Cause:** CBE20 SINAMICS Link:  
A specific telegram word (receive) is being used twice.  
Alarm value (r2124, interpret hexadecimal):  
yyyyxxxx hex: yyyy = info. 1, xxxx = info. 2  
Info. 1 (decimal) = Address of sender  
Info. 2 (decimal) = Receive telegram word  
See also: p8870 (SINAMICS Link receive telegram word PZD), p8872 (SINAMICS Link address receive PZD)

**Remedy:** CBE20 SINAMICS Link:  
Correct the parameter assignment.

Reaction upon F: NONE (OFF1, OFF2, OFF3)

Acknowled. upon F: IMMEDIATELY

---

**A50004 (F)      COMM BOARD: Alarm 4**

**Message value:** Info. 1: %1, info. 2: %2

**Drive object:** All objects

**Reaction:** NONE

**Acknowledge:** NONE

**Cause:** CBE20 SINAMICS Link:  
- telegram word (receive) and address of sender inconsistent. Both values have to be either equal to zero or not equal to zero.  
- drive object number p8872 > 16 with p8811 = 16.  
Alarm value (r2124, interpret hexadecimal):  
yyyyxxxx hex: yyyy = info. 1, xxxx = info. 2  
Info. 1 (decimal) = Drive object number from p8870, p8872  
Info. 2 (decimal) = Index from p8870, p8872  
See also: p8870 (SINAMICS Link receive telegram word PZD), p8872 (SINAMICS Link address receive PZD)

**Remedy:** In the case of CBE20 SINAMICS Link:  
Correct the parameter assignment.

Reaction upon F: NONE (OFF1, OFF2, OFF3)

Acknowled. upon F: IMMEDIATELY

---

**A50005 (F)      COMM BOARD: Alarm 5**

**Message value:** %1

**Drive object:** All objects

**Reaction:** NONE

**Acknowledge:** NONE

**Cause:** CBE20 SINAMICS Link:  
Sender not found on SINAMICS Link.  
Alarm value (r2124, interpret decimal):  
Address of sender that cannot be located  
See also: p8872 (SINAMICS Link address receive PZD)

**Remedy:** CBE20 SINAMICS Link:  
Check the connection to the sender.

Reaction upon F: NONE (OFF1, OFF2, OFF3)

Acknowled. upon F: IMMEDIATELY

<b>A50006 (F)</b>	<b>COMM BOARD: Alarm 6</b>
<b>Message value:</b>	Info. 1: %1, info. 2: %2
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	CBE20 SINAMICS Link: The parameter assignment indicates that the sender and the receiver are one and the same. This is not permitted. Alarm value (r2124, interpret hexadecimal): yyyyxxxx hex: yyyy = info. 1, xxxx = info. 2 Info. 1 (decimal) = Drive object number from p8872 Info. 2 (decimal) = Index from p8872 See also: p8836 (SINAMICS Link address), p8872 (SINAMICS Link address receive PZD)
<b>Remedy:</b>	In the case of CBE20 SINAMICS Link: Correct the parameter assignment. All p8872[index] must be set to a value not equal to p8836.
Reaction upon F:	NONE (OFF1, OFF2, OFF3)
Acknowl. upon F:	IMMEDIATELY
<b>A50010 (F)</b>	<b>COMM BOARD: Alarm 10</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	CBE20: PROFINET Name of Station is invalid.
<b>Remedy:</b>	CBE20: Correct the name of the station (p8940) and activate (p8945 = 2). See also: p8940 (CBE20 Name of Station)
Reaction upon F:	NONE (OFF1, OFF2, OFF3)
Acknowl. upon F:	IMMEDIATELY
<b>A50020 (F)</b>	<b>COMM BOARD: Alarm 20</b>
<b>Message value:</b>	-
<b>Drive object:</b>	All objects
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	CBE20: The PROFINET function "Shared Device" has been activated (p8829 = 2). However, only the connection to a PRO-FINET controller is present. See also: p8829 (CBE20 remote controller number)
<b>Remedy:</b>	CBE20: Check the configuration of the PROFINET controllers as well as the p8829 setting.
Reaction upon F:	NONE (OFF1, OFF2, OFF3)
Acknowl. upon F:	IMMEDIATELY
<b>F60004 (N, A)</b>	<b>Armature circuit phase failure detected</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL
<b>Reaction:</b>	OFF2 (NONE)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	Phase failure in armature infeed. The line voltage rms value calculated from the area of each line half-wave (rectifier average value * harmonic factor) is less than the response value for phase failure monitoring or the distance between two line zero crossings in the same phase is more than 270 degrees or the distance between two line zero crossings in different phases is not between 30 and 90 degrees. - Phase failure threshold set incorrectly (p50353) - Armature phase failed - Line contactor opened in operation



- Fuse blown on three-phase side of armature circuit
- Fuse blown in power unit

Fault value (r0949, decimal interpretation):

1:

Power failure has occurred in armature infeed (UV, VW, WU)

r50047[1] = 0: First power failure in armature phase UV

r50047[1] = 1: First power failure in armature phase VW

r50047[1] = 2: First power failure in armature phase WU

r50047[2]: Incorrect voltage value as a % of p50078[0]

2:

Wait time for new zero crossing has expired in one armature phase (UV, VW, WU)

r50047[1] = 0: No zero crossing in armature phase UV in excess of 270 °

r50047[1] = 1: No zero crossing in armature phase VW in excess of 270 °

r50047[1] = 2: No zero crossing in armature phase WU in excess of 270 °

r50047[2]: Time without zero crossing (= duration 270 °) of armature phase r50047[1] in ms

3:

Line asymmetry in armature infeed (UV, VW, WU)

r50047[1]: Phase number of phase of last zero crossing (0 = UV, 1 = VW, 2 = WU)

r50047[2]: Phase number of phase of last-but-one zero crossing (0 = UV, 1 = VW, 2 = WU)

r50047[3]: Time of last raw zero crossing in ms

r50047[4]: Time of last-but-one raw zero crossing in ms

r50047[5]: Time of last positive refined zero crossing in phase UV in ms

r50047[6]: Time of last negative refined zero crossing in phase UV in ms

r50047[7]: Time of last positive refined zero crossing in phase VW in ms

r50047[8]: Time of last negative refined zero crossing in phase VW in ms

r50047[9]: Time of last positive refined zero crossing in phase WU in ms

r50047[10]: Time of last negative refined zero crossing in phase WU in ms

r50047[11]: Last good 60 ° period in ms

See also: p50089 (Sequence control voltage at power unit wait time), p50095 (Sequence control DC circuit contactor wait time), p50691 (Sequence control line contactor feedback)

#### Remedy:

- Check threshold for phase failure (p50353).

- Check the field supply voltage.

- Check the fuses and line contactor.

See also: p50089 (Sequence control voltage at power unit wait time), p50353 (Line monitoring phase failure threshold)

Reaction upon N: NONE

Acknowl. upon N: NONE

Reaction upon A: NONE

Acknowl. upon A: NONE

### F60005 (N, A) Field circuit phase failure detected

Message value: %1

Drive object: DC\_CTRL

Reaction: OFF2 (NONE)

Acknowledge: IMMEDIATELY

Cause: A phase failure has been detected in the field circuit.

The line voltage rms value calculated from the area of each line half-wave (rectifier average value \* harmonic factor) is less than the response value for phase failure monitoring or the distance between two line zero crossings of the voltage for the field converter is more than 270 degrees.

- Phase failure threshold set incorrectly (p50353)

- Field phase failed

- Line contactor opened in operation

- Fuse blown in field circuit

Fault value (r0949, decimal interpretation):

1: Power failure in field infeed

Note:

r50047[1]: Incorrect voltage value as a % of p50078[1]

2: Wait time for new zero crossing has expired in the field phase.

Note:

r50047[1]: Time without zero crossing (= duration 270 °) of armature phase r50047[1] in ms

See also: p50089 (Sequence control voltage at power unit wait time)

**Remedy:**

- Check threshold for phase failure (p50353).
- Check the field supply voltage.
- Check the fuses and line contactor.

See also: p50089 (Sequence control voltage at power unit wait time)

Reaction upon N: NONE  
 Acknowl. upon N: NONE  
 Reaction upon A: NONE  
 Acknowl. upon A: NONE

---

**F60006 (N, A) Line monitoring undervoltage**

**Message value:** %1  
**Drive object:** DC\_CTRL  
**Reaction:** OFF2 (NONE)  
**Acknowledge:** IMMEDIATELY  
**Cause:** The line voltage has undershot the permissible undervoltage limit for longer than the setting in p50361.

Fault value (r0949, decimal interpretation):

- 1: Armature undervoltage occurred
- 2: Field undervoltage occurred

Note:

r50047[1] = 0: Undervoltage in armature phase UV  
 r50047[1] = 1: Undervoltage in armature phase VW  
 r50047[1] = 2: Undervoltage in armature phase WU  
 r50047[1] = 3: Undervoltage in field phase  
 r50047[2] = Incorrect voltage value as a % of p50078[0] or p50078[1]

**Remedy:**

- Check monitoring limit for armature ( $p50078[0] * (1 + p50351/100\%)$ ).
- Check monitoring limit for field ( $p50078[1] * (1 + p50351/100\%)$ ).
- Check monitoring time (p50361).

See also: p50078 (Supply voltage rated value), p50351 (Line undervoltage threshold), p50361 (Line monitoring undervoltage delay time)

Reaction upon N: NONE  
 Acknowl. upon N: NONE  
 Reaction upon A: NONE  
 Acknowl. upon A: NONE

---

**F60007 (N, A) Line monitoring overvoltage**

**Message value:** %1  
**Drive object:** DC\_CTRL  
**Reaction:** OFF2 (NONE)  
**Acknowledge:** IMMEDIATELY  
**Cause:** The line voltage has overshot the permissible overvoltage limit for longer than the setting in p50362.

Fault value (r0949, decimal interpretation):

- 1: Armature overvoltage occurred
- 2: Field overvoltage occurred

Note:

r50047[1] = 0: Overvoltage in armature phase UV  
 r50047[1] = 1: Overvoltage in armature phase VW  
 r50047[1] = 2: Overvoltage in armature phase WU  
 r50047[1] = 3: Overvoltage in field phase  
 r50047[2] = Incorrect voltage value as a % of p50078[0] or p50078[1]

**Remedy:**

- Check monitoring limit for armature ( $p50078[0] * (1 + p50352/100\%)$ ).
- Check monitoring limit for field ( $p50078[1] * (1 + p50352/100\%)$ ).
- Check monitoring time (p50362).

See also: p50078 (Supply voltage rated value), p50352 (Line overvoltage threshold), p50362 (Line monitoring overvoltage delay time)

Reaction upon N: NONE  
 Acknowl. upon N: NONE  
 Reaction upon A: NONE  
 Acknowl. upon A: NONE

---

<b>F60008 (N, A)</b>	<b>Line frequency less than minimum line frequency</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL
<b>Reaction:</b>	OFF2 (NONE)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	The line frequency has undershot the set threshold for monitoring of the minimum line frequency for more than 40 ms. Fault value (r0949, decimal interpretation): 1: Armature supply frequency less than minimum line frequency 2: Field supply frequency less than minimum line frequency Note: r50047[1]: Incorrect frequency value in Hz
<b>Remedy:</b>	Check the threshold for monitoring the minimum line frequency (p50363). See also: p50363 (Line frequency minimum threshold)
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE

---

<b>F60009 (N, A)</b>	<b>Line frequency greater than maximum line frequency</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL
<b>Reaction:</b>	OFF2 (NONE)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	The line frequency has overshoot the set threshold for monitoring of the maximum line frequency for more than 40 ms. Fault value (r0949, decimal interpretation): 1: Armature supply frequency greater than maximum line frequency 2: Field supply frequency greater than maximum line frequency Note: r50047[1]: Incorrect frequency value in Hz
<b>Remedy:</b>	Check the threshold for monitoring the maximum line frequency (p50364). See also: p50364 (Line frequency maximum threshold)
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE

---

<b>F60010 (N, A)</b>	<b>Armature circuit uneven current distribution</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL
<b>Reaction:</b>	OFF2 (NONE)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	An uneven current distribution through the thyristors has been identified in the armature circuit. Significantly less current flows in one thyristor than in the others. Remarks: - This monitoring is only effective if the average current value across all thyristors is greater than 20 % of r50072[1]. - The current in a thyristor is significantly lower, if, for a period of one second, the average value is less than 35 % of the average value across all thyristors. Possible causes: - A fuse has blown. - A thyristor is not fired (defective thyristor, defective pulse transformer, defective firing electronics). Fault value (r0949, decimal interpretation): Number of the thyristor that is conducting the significantly lower current. Note: r50047[1]: Average current value through all armature thyristors. r50047[2]: Average current value through the thyristor with the excessively low current, in torque direction I. r50047[3]: Average current value through the thyristor with the excessively low current, in torque direction II. The current values as a % are referred to r50072[1].

**Remedy:**

- Check the fuses in the power unit.
- If required, perform a thyristor diagnostics routine (p50830).

See also: p50830 (Thyristor diagnostics mode)

Reaction upon N: NONE  
 Acknowl. upon N: NONE  
 Reaction upon A: NONE  
 Acknowl. upon A: NONE

---

**F60012 (N, A) P2P-IF: Telegram monitoring time expired**

**Message value:** -

**Drive object:** DC\_CTRL

**Reaction:** OFF2 (NONE, OFF1, OFF3)

**Acknowledge:** IMMEDIATELY

**Cause:** The telegram monitoring time for communication via the peer-to-peer interface (P2P-IF) has expired. No further valid telegrams were received during the monitoring time (p50797).  
 Possible causes:

- Break in connecting cable
- Electromagnetic interference on the connecting cable
- Telegram monitoring time set too short (p50797)

**Remedy:**

- Check connecting cable and cable connection.
- Check that the connecting cable has been routed in compliance with EMC.
- Increase the telegram monitoring time if necessary (p50797).

See also: p50089 (Sequence control voltage at power unit wait time), p50790 (P2P IF operating mode), p50797 (P2P IF telegram monitoring time)

Reaction upon N: NONE  
 Acknowl. upon N: NONE  
 Reaction upon A: NONE  
 Acknowl. upon A: NONE

---

**F60014 (N, A) Parallel interface telegram monitoring time expired**

**Message value:** -

**Drive object:** DC\_CTRL

**Reaction:** OFF2 (NONE, OFF1, OFF3)

**Acknowledge:** IMMEDIATELY

**Cause:** The telegram monitoring time for communication via the parallel interface (Par-IF) has expired. No further valid telegrams were received during the monitoring time (p51807).  
 Possible causes:

- Break in connecting cable
- Electromagnetic interference on the connecting cable
- Telegram monitoring time set too short (p51807)

**Remedy:**

- Check connecting cable and cable connection.
- Check that the connecting cable has been routed in compliance with EMC.
- Increase the telegram monitoring time if necessary (p51807).

See also: p51807 (Parallel interface telegram monitoring failure time), p51808 (Parallel interface signal source for F60014)

Reaction upon N: NONE  
 Acknowl. upon N: NONE  
 Reaction upon A: NONE  
 Acknowl. upon A: NONE

---

**A60018 (F, N) Digital output overloaded**

**Message value:** Fault cause: %1 bin

**Drive object:** DC\_CTRL

**Reaction:** NONE

**Acknowledge:** NONE

**Cause:** At least one digital output is overloaded or has short-circuited.

Alarm value (r2124, interpret binary):

Bit 0 = 1: CUD digital output 0 (X177.19) is overloaded

Bit 1 = 1: CUD digital output 1 (X177.20) is overloaded

Bit 2 = 1: CUD digital output 2 (X177.21) is overloaded

Bit 3 = 1: CUD digital output 3 (X177.22) is overloaded

Bit 4 = 1: CUD digital output 4 (X177.15) is overloaded

Bit 5 = 1: CUD digital output 5 (X177.16) is overloaded

Bit 6 = 1: CUD digital output 6 (X177.17) is overloaded

Bit 7 = 1: CUD digital output 7 (X177.18) is overloaded

Note:

The fault value is equal to the inverted value of parameter r53021. Information about short-circuit monitoring for the individual digital outputs for further interconnection is available here.

**Remedy:** Check the overloaded digital outputs and rectify the overload or short circuit.

Reaction upon F: NONE (OFF1, OFF2, OFF3)

Acknowled. upon F: IMMEDIATELY

Reaction upon N: NONE

Acknowled. upon N: NONE

---

### **F60025 (N, A)    Brush length too short**

**Message value:** -

**Drive object:** DC\_CTRL

**Reaction:** OFF2 (NONE, OFF1, OFF3)

**Acknowledge:** IMMEDIATELY

**Cause:** A motor brush length which is too short has been reported via a binector input (p50486) for a period exceeding a permanently set delay time.

Note:

This message is also reported via binector output r53120.0.

**Remedy:** - Check binector input p50486 and trace the generation of the signal back to the sensor.

- Check and if necessary update the motor's brush length.

See also: p50486 (Motor interface signal source for brush length)

Reaction upon N: NONE

Acknowled. upon N: NONE

Reaction upon A: NONE

Acknowled. upon A: NONE

---

### **F60026 (N, A)    Poor bearing condition**

**Message value:** -

**Drive object:** DC\_CTRL

**Reaction:** OFF2 (NONE, OFF1, OFF3)

**Acknowledge:** IMMEDIATELY

**Cause:** A defective motor bearing has been reported via a binector input (p50487) for a period exceeding a permanently set delay time.

Note:

This message is also reported via binector output r53120.1.

**Remedy:** - Check binector input p50487 and trace the generation of the signal back to the sensor.

- Check and if necessary restore the motor's bearing condition.

See also: p50487 (Motor interface signal source for bearing condition)

Reaction upon N: NONE

Acknowled. upon N: NONE

Reaction upon A: NONE

Acknowled. upon A: NONE

---

**F60027 (N, A) Motor fan fault**

**Message value:** -

**Drive object:** DC\_CTRL

**Reaction:** OFF2 (NONE, OFF1, OFF3)

**Acknowledge:** IMMEDIATELY

**Cause:** A defective motor fan has been reported via a binector input (p50488) for a period exceeding a permanently set delay time.  
**Note:**  
 This message is also reported via binector output r53120.2.

**Remedy:** - Check binector input p50488 and trace the generation of the signal back to the sensor.  
 - Check and if necessary replace the motor's fan.  
 See also: p50488 (Motor interface signal source for motor fan)

Reaction upon N: NONE

Acknowl. upon N: NONE

Reaction upon A: NONE

Acknowl. upon A: NONE

---

**F60028 (N, A) Motor temperature too high**

**Message value:** -

**Drive object:** DC\_CTRL

**Reaction:** OFF2 (NONE, OFF1, OFF3)

**Acknowledge:** IMMEDIATELY

**Cause:** A motor temperature which is too high has been reported via a binector input (p50489) for a period exceeding a permanently set delay time.  
 The motor temperature is too high.  
 Possible causes:  
 - Motor is overloaded  
 - Ambient temperature of the motor is too high  
 - Wire break or sensor not connected  
**Note:**  
 This message is also reported via binector output r53120.3.

**Remedy:** - Check binector input p50489 and trace the generation of the signal back to the sensor.  
 - Reduce the motor load if necessary.  
 - Check the ambient temperature and reduce if necessary.  
 - Check the wiring and the sensor connection.  
 See also: p50489 (Motor interface signal source for motor temperature)

Reaction upon N: NONE

Acknowl. upon N: NONE

Reaction upon A: NONE

Acknowl. upon A: NONE

---

**F60029 (N, A) Motor temperature fault**

**Message value:** -

**Drive object:** DC\_CTRL

**Reaction:** OFF2 (NONE, OFF1, OFF3)

**Acknowledge:** IMMEDIATELY

**Cause:** The motor temperature is higher than the threshold set in p50491 to trigger this fault.  
 Possible causes:  
 - Motor is overloaded  
 - Ambient temperature is too high  
**Note:**  
 r50047[1]: Motor temperature (in °C) for temperature sensor with continuous characteristic.  
 KTY84 (p50490 = 1) or  
 PT100 (p50490 = 6) or  
 NTC thermistor K227 (p50490 = 7) or  
 PT1000 (p50490 = 8)  
 Otherwise the value = 0.  
 See also: p50492 (Motor interface fault threshold for temperature monitoring)

**Remedy:**

- Check the threshold for triggering the fault (p50492).
- Reduce the motor load if necessary.
- Check the ambient temperature and reduce if necessary.

Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

**F60031 (N, A) Excessive setpoint/actual value deviation**

**Message value:** -  
**Drive object:** DC\_CTRL  
**Reaction:** OFF2 (NONE, OFF1, OFF3)  
**Acknowledge:** IMMEDIATELY  
**Cause:** The absolute value of the set/act deviation of the speed controller has exceeded the set threshold.  
Note:  
r50047[1]: n\_set (connector input p50590)  
r50047[2]: n\_act (connector input p50591)  
See also: p50388 (Messages for setpoint/actual value deviation 1 threshold), p50590 (Messages for set/act val dev 1 signal source for speed setpoint), p50591 (Messages for set/act val dev 1 signal source for speed act val)

**Remedy:**

- Optimize the speed controller (p50051).
- Check torque limiting (p50169).

Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

**A60032 (F, N) Motor temperature alarm**

**Message value:** -  
**Drive object:** DC\_CTRL  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The motor temperature is higher than the threshold set in p50491 to trigger this alarm.  
Possible causes:  
- Motor is overloaded  
- Ambient temperature is too high  
Note:  
r50047[1]: Motor temperature (in °C) for temperature sensor with continuous characteristic.  
KTY84 (p50490 = 1) or  
PT100 (p50490 = 6) or  
NTC thermistor K227 (p50490 = 7) or  
PT1000 (p50490 = 8)  
Otherwise the value = 0.  
See also: p50491 (Motor interface alarm threshold for temperature monitoring)

**Remedy:**

- Check the threshold for triggering the alarm (p50491).
- Reduce the motor load if necessary.
- Check the ambient temperature and reduce if necessary.

Reaction upon F: NONE (OFF1, OFF2, OFF3)  
Acknowl. upon F: IMMEDIATELY  
Reaction upon N: NONE  
Acknowl. upon N: NONE

<b>F60035 (N, A)</b>	<b>Motor blocked</b>
<b>Message value:</b>	-
<b>Drive object:</b>	DC_CTRL
<b>Reaction:</b>	OFF2 (NONE, OFF1, OFF3)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>The fault is triggered if the following conditions prevail for longer than the time set in p50355:</p> <ul style="list-style-type: none"> <li>- The positive or negative armature current or torque limit has been reached</li> <li>- Armature current r52109 &gt; 1.0%</li> <li>- Speed actual value r52166 &lt; p50356</li> </ul> <p>Note:</p> <p>r50047[1]: Stall protection monitoring time p50355  r50047[2]: Speed threshold p50356  r50047[3]: Armature current r52109  r50047[4]: Speed actual value r52166  r50047[5]: Torque limit r53150  r50047[6]: Armature current limits r53151  See also: p50355 (Stall protection monitoring time)</p>
<b>Remedy:</b>	<ul style="list-style-type: none"> <li>- Reduce the motor load.</li> <li>- Increase the current or torque limit.</li> <li>- Check and if necessary increase the monitoring threshold.</li> </ul> <p>See also: r52109 (Armature current actual value averaged over 6 cycles), r52166 (Speed controller actual value selection absolute value), r53150 (Speed limiting controller/torque limiting state), r53151 (Current limitation state)</p>
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE
<b>F60036 (N, A)</b>	<b>Armature circuit/field circuit interrupted</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL
<b>Reaction:</b>	OFF2 (NONE, OFF1, OFF3)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>The firing angle is at the rectifier stability limit for more than 500 ms and the current is less than 1% of the rated DC current.</p> <p>Fault value (r0949, decimal interpretation):</p> <p>1: Armature circuit  2: Field circuit</p>
<b>Remedy:</b>	<ul style="list-style-type: none"> <li>- Armature circuit or field circuit interrupted.</li> <li>- Rectifier stability limit Alpha-G incorrectly set (p50150, p50250).</li> <li>- Drive operates at the Alpha-G limit (e.g. due to a line undervoltage condition).</li> <li>- EMF too high, because the maximum speed has been set too high.</li> <li>- EMF too high, because field weakening was not activated.</li> <li>- EMF too high, because the field current was set too high.</li> <li>- EMF too high, because the CEMF crossover voltage was set too high (transition between normal and field weakening operation).</li> </ul> <p>See also: r52116 (Armature current actual value internal absolute value), r52266 (Field current actual value internal absolute value), r53190 (Armature auto-reversing stage state), r53191 (Field auto-reversing stage state)</p>
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE



---

**A60037 (F, N) I2t monitoring alarm excessive motor temperature rise**

**Message value:** -  
**Drive object:** DC\_CTRL  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The I2t calculation shows that the motor's temperature rise is excessive.  
The alarm is triggered if the calculated motor temperature rise in r52309 > 100%.  
Note:  
r50047[1]: Temperature rise r52309  
r50047[2]: Motor rated armature current p50100  
r50047[3]: Continuous current factor r50113  
r50047[4]: Device rated current r50072[1]  
r50047[5]: Current armature current r52109  
r50047[6]: Motor thermal time constant p50114  
See also: p50114 (Motor thermal time constant), r52309 (Calculated motor temperature rise)  
**Remedy:** - Check the ambient temperature and reduce if necessary.  
- Reduce the motor load.  
See also: r52109 (Armature current actual value averaged over 6 cycles)  
Reaction upon F: NONE (OFF1, OFF2, OFF3)  
Acknowl. upon F: IMMEDIATELY  
Reaction upon N: NONE  
Acknowl. upon N: NONE

---

**F60038 (N, A) Overspeed threshold overshoot**

**Message value:** -  
**Drive object:** DC\_CTRL  
**Reaction:** OFF2 (NONE, OFF1, OFF3)  
**Acknowledge:** IMMEDIATELY  
**Cause:** The speed actual value has overshoot the threshold for the positive or negative maximum speed.  
Note:  
Possible cause of the fault, if p50083 = 3 (EMF as speed actual value):  
- Interrupted armature circuit (fuse blown, contactor in the DC link has not closed)  
In this particular case, the converter output voltage is not equal to the motor armature voltage, which is the reason why an incorrect speed actual value is determined.  
Note:  
r50047[1]: Maximum speed for positive direction of rotation (p50380)  
r50047[2]: Maximum speed for negative direction of rotation (p50381)  
r50047[3]: n\_act (connector input p50595)  
**Remedy:** - Reduce the speed.  
- Check the threshold for positive or negative direction of rotation and adjust if necessary (p50380, p50381).  
See also: p50380 (Messages for overspeed threshold positive direction of rotation), p50381 (Messages for overspeed threshold negative direction of rotation)  
Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

**A60039 (F, N) I2t monitoring alarm excessive power unit temperature rise**

**Message value:** -  
**Drive object:** DC\_CTRL  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The temperature rise of the thyristors is more than 110% of the maximum permissible value.  
**Remedy:** - Check the ambient temperature and reduce if necessary.  
- Check the motor load and reduce if necessary.  
Reaction upon F: NONE (OFF1, OFF2, OFF3)  
Acknowl. upon F: IMMEDIATELY

Reaction upon N: NONE

Acknowled. upon N: NONE

---

**F60041 (N, A) Ramp-function generator parameter set cannot be selected**

**Message value:** -

**Drive object:** DC\_CTRL

**Reaction:** OFF2 (NONE, OFF1, OFF3)

**Acknowledge:** IMMEDIATELY

**Cause:** Ramp-function generator parameter sets 2 and 3 were selected simultaneously for more than 0.5 s via binector input p50637/p50638.  
The ramp-function generator parameter set is not changed over. The most recently selected ramp-function generator parameter set is retained.

**Remedy:** - Check the selection of ramp-function generator parameter sets 2 and 3 and bar simultaneous selection.  
- Select the required ramp-function generator parameter set (p50637, p50638).  
See also: p50637 (RFG parameter set 2 selection signal source), p50638 (RFG parameter set 3 selection signal source)

Reaction upon N: NONE

Acknowled. upon N: NONE

Reaction upon A: NONE

Acknowled. upon A: NONE

---

**F60042 (N, A) Defective tachometer monitoring error**

**Message value:** %1

**Drive object:** DC\_CTRL

**Reaction:** OFF2 (NONE)

**Acknowledge:** IMMEDIATELY

**Cause:** The ratio "Speed actual value/EMF actual value" (r52179/r52287) was less than +10 % for more than approx. 40 ms.  
This ratio is then only checked if the EMF actual value is > p50357.  
- Cable break affecting tachometer or incremental encoder TTL/HTL  
- Tachometer or incremental encoder TTL/HTL cable connected incorrectly  
- Incremental encoder TTL/HTL power supply has failed  
- Tachometer or incremental encoder TTL/HTL faulty  
- Parameters for incremental encoder TTL/HTL set incorrectly (p0400).  
- During operation with field reversal, the field polarity is not being reversed by the external hardware  
- Polarity for speed actual value set incorrectly (p50743)  
- Data for armature circuit set incorrectly (p50110 and p50111)  
- If p50083 = 3 (EMF as speed actual value): Interrupted armature circuit (e.g. fuse blown).

Fault value (r0949, decimal interpretation):

1: Cable break affecting tachometer or incremental encoder TTL/HTL

2: Tachometer or incremental encoder TTL/HTL polarity incorrect

Note:

r50047[1]: Speed actual value (r52179)

r50047[2]: EMF actual value (r52287)

See also: p50357 (Tachometer interruption monitoring threshold)

**Remedy:** - Check the incremental encoder TTL/HTL's wiring, connections, and function.  
- Check the power supply for the incremental encoder TTL/HTL.  
- Check the parameters for the incremental encoder TTL/HTL.  
- Check the polarity for the speed actual value (p50743).  
- Perform an optimization run for the current controller in the armature circuit (p50051 = 25).  
- Check the fuses in the armature circuit.

Reaction upon N: NONE

Acknowled. upon N: NONE

Reaction upon A: NONE

Acknowled. upon A: NONE

<hr/>	
<b>F60043</b>	<b>EMF for braking operation too high</b>
<b>Message value:</b>	-
<b>Drive object:</b>	DC_CTRL
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>The EMF actual value is too high for braking operation. This fault is triggered if a firing angle greater than 165 ° would be required in the new torque direction immediately after a torque direction change (precisely because the EMF is so high). What this actually means is that the fault is triggered if the following 5 conditions are met for a requested torque direction change (MI or MII is to be selected):</p> <ul style="list-style-type: none"><li>- p50272 = 0 (fault parameterized and not alarm + field weakening)</li><li>- An additional torque-free interval which might have been parameterized (p50160 &gt; 0) has expired.</li><li>- The parallel drive is ready for the new torque direction to be selected.</li><li>- The absolute value of the armature current requested in the new torque direction (r52118, filtered with p50190) is &gt; 1% of r50072[1].</li><li>- The calculated firing angle (r52101) for the armature current requested in the new torque direction is &gt; 165 ° or &gt; p50151 if p50192 = 1.</li></ul> <p>Possible fault causes:</p> <ul style="list-style-type: none"><li>- "Speed-dependent field weakening" (p50081 = 0) has not been parameterized, although field weakening operation would be necessary for the required maximum speed.</li></ul> <p>Note:</p> <p>With a firing angle Alpha G = 30 ° (rectifier stability limit p50150) and low armature currents, EMF values up to the peak value of the phase-to-phase line voltage can be reached when motoring.</p> <ul style="list-style-type: none"><li>- Setpoint EMF for field weakening operation too high (parameter p50101 set too high)</li><li>- Line voltage dip</li><li>- EMF controller or field current controller not optimized; this can lead to excessive EMF when the drive accelerates.</li></ul> <p>Note:</p> <p>r50047[1]: Calculated firing angle (armature) prior to limiting (r52101) r50047[2]: EMF actual value currently measured (r52287) r50047[3]: Armature current controller setpoint (r52118)</p>
<b>Remedy:</b>	<ul style="list-style-type: none"><li>- Reduce the speed.</li><li>- Activate the "Speed-dependent field weakening" function (p50081 = 1).</li></ul>
<hr/>	
<b>F60044 (N, A)</b>	<b>Parallel interface node failure</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL
<b>Reaction:</b>	OFF2 (NONE, OFF1, OFF3)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>A fault involving the parallel connection of power units has occurred. Fault value (r0949, decimal interpretation):</p> <ol style="list-style-type: none"><li>1: There is a fault on one of the slaves.</li><li>2: One of the slaves is not in the Operation state (e.g. because its enable signal is at "0")</li><li>3: There are fewer power units connected in parallel that are active than set using p51802.</li><li>4: There are fewer devices that are active than set using p51815.</li><li>50: The switchover to power unit topology 2 is not possible, as this SINAMICS DCM is not equipped with option S50.</li><li>51: The switchover to power unit topology 2 is not permissible for "n+m" operation.</li><li>52: The parallel switching master in power unit topology 2 is not the same as in power unit topology 1.</li><li>53: The feedback indicating the active power unit topology does not match the selected power unit topology.</li></ol>
<b>Remedy:</b>	<ul style="list-style-type: none"><li>- Check the slave with fault.</li><li>- Check the enable signal of the slaves</li><li>- Check the setting for the minimum number of devices (p51802, p51815).</li><li>- Check the parameterization of the switchover of the power unit topology.</li></ul> <p>See also: p51802 (Parallel interface number of power units)</p>
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE

---

**F60045 (N, A) Standstill field not permitted in operation**

**Message value:** -

**Drive object:** DC\_CTRL

**Reaction:** OFF2 (NONE)

**Acknowledge:** IMMEDIATELY

**Cause:** The standstill field was activated while the drive was operational.  
The binector input p50692 to activate the standstill field must not have a 1 signal in operation.  
See also: p50692 (CI-loop field curr ctrl sig source for inject of standst field)

**Remedy:** If required, set binary input p50692 - used to activate the standstill field - to a 0 signal.

Reaction upon N: NONE

Acknowl. upon N: NONE

Reaction upon A: NONE

Acknowl. upon A: NONE

---

**F60046 (N, A) Wire break at "Main setpoint" analog input**

**Message value:** -

**Drive object:** DC\_CTRL

**Reaction:** OFF2 (NONE, OFF1, OFF3)

**Acknowledge:** IMMEDIATELY

**Cause:** A wire break has been detected at the CUD's "Main setpoint" analog input (X177.25/26).  
This fault is triggered if p50700 = 2 (unipolar monitoring of current input (+4 mA to +20 mA)) is set and an input current of less than 2 mA is flowing.  
Possible fault causes:  
- Wire break or contact problem on supply line  
- Parameter p50700 set incorrectly  
Note:  
This fault is also indicated via binector input r53030.0:  
See also: p50700 (CUD analog input 0 type)

**Remedy:** - Check the wiring of the input terminals (X177.25/26) (cable break, contacts, etc).  
- Check the parameter assignment for the "Main setpoint" analog input (p50700).

Reaction upon N: NONE

Acknowl. upon N: NONE

Reaction upon A: NONE

Acknowl. upon A: NONE

---

**F60047 (N, A) Wire break at analog input 1**

**Message value:** -

**Drive object:** DC\_CTRL

**Reaction:** OFF2 (NONE, OFF1, OFF3)

**Acknowledge:** IMMEDIATELY

**Cause:** A wire break has been detected at the CUD's analog input 1 (X177.27/28).  
This fault is triggered if p50700 = 2 (unipolar monitoring of current input (+4 mA to +20 mA)) is set and an input current of less than 2 mA is flowing.  
Possible fault causes:  
- Wire break or contact problem on supply line  
- Parameter p50710 set incorrectly  
Note:  
This fault is also indicated via binector output r53030.1.  
See also: p50710 (CUD analog input 1 type)

**Remedy:** - Check the wiring of the input terminals (X177.27/28) (cable break, contacts, etc).  
- Check the parameter assignment for analog input 1 (p50710).

Reaction upon N: NONE

Acknowl. upon N: NONE

Reaction upon A: NONE

Acknowl. upon A: NONE

<b>F60050 (N, A)</b>	<b>Optimization run aborted due to internal cause</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL
<b>Reaction:</b>	OFF2 (NONE)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>An optimization run which had been started has been interrupted due to an internal cause.</p> <p>Fault value (r0949, decimal interpretation):</p> <p>General, not assigned to a specific optimization run:</p> <p>100: Internal software error</p> <p>Field current controller optimization run:</p> <p>101: Alpha G limit reached when determining the Rf</p> <p>102: Field current oscillation &gt; 20 % when determining the Rf</p> <p>103: Calculated field circuit resistance too high (&gt; 4,000 ohms)</p> <p>104: Unable to ascertain field circuit inductance</p> <p>105: Calculated field circuit inductance too high (&gt; 1,000 H)</p> <p>106: Field current &gt; 100% at start of optimization</p> <p>107: Rf determination failed (Rf &lt;= 0)</p> <p>108: Internal software error</p> <p>Armature current controller optimization run:</p> <p>201: Alpha G limit reached when determining the Ra</p> <p>202: Armature current oscillation &gt; 20 % when determining the Ra</p> <p>203: Calculated armature circuit resistance too high (&gt; 4,000 ohms)</p> <p>205: Unable to determine armature circuit inductance.</p> <p>206: Calculated armature circuit inductance too high (&gt; 1,000 H)</p> <p>207: Armature current increased to &gt; 120 % of r50072[1], although the firing angle was not able to be shifted any further.</p> <p>Speed controller optimization run:</p> <p>301: Unable to ascertain moment of inertia due to it being very small</p> <p>302: Measurement of speed increase was not possible.</p> <p>303: No change in speed when armature current is increased.</p> <p>304: Speed remains at zero, although armature current is flowing.</p> <p>EMF controller/Field characteristics optimization run:</p> <p>401: Maximum permissible EMF setpoint is too small</p> <p>402: Motor nominal field current is not being reached within 30 seconds</p> <p>403: EMF (80 %) is not reached within set acceleration time (r50315[0]).</p> <p>404: Incorrect direction of rotation</p> <p>405: Negative field current setpoint limiting active</p> <p>406: Field characteristic not falling uniformly</p> <p>407: Torque limiting active</p> <p>408: Armature current limiting active</p> <p>409: Speed during measurement dropped by more than 12.5%</p> <p>Field current controller friction compensation:</p> <p>501: Speed not within the required tolerance bandwidth.</p> <p>Optimization run for mechanical systems that can oscillate (torsional optimization):</p> <p>601: speed according to p50565 is not reached within a specific time.</p> <p>602: speed actual value is negative, although a positive setpoint is being input.</p> <p>Converter Commutation Protector (CCP) optimization run:</p> <p>701: p50790 (P2P/CCP operating mode) not set to communication with SIMOREG CCP.</p> <p>702: Communication not established between SINAMICS DCM and SIMOREG CCP.</p> <p>703: p51570 order number (MLFB) of the SIMOREG CCP is unknown.</p> <p>704: Supply voltage of SINAMICS DCM and SIMOREG CCP do not match (p50078[0] and r51571).</p> <p>705: This SINAMICS DCM is not intended for operation with SIMOREG CCP.</p> <p>706: Armature circuit inductance is zero (p50111 = 0).</p> <p>707: Calculated pre-charging voltage greater than the maximum achievable value for p51578.</p> <p>708: Calculated chopper energy too high.</p> <p>Note for fault value = 102:</p> <ul style="list-style-type: none"><li>- r50047[1]: Field current actual value (1 = 100 %)</li><li>- r50047[2]: Field current lower limit (1 = 100 %)</li><li>- r50047[3]: Field current upper limit (1 = 100 %)</li></ul> <p>Note for fault value = 103:</p> <ul style="list-style-type: none"><li>- r50047[1]: Calculated field circuit resistance in Ohm</li></ul>

List of faults and alarms

---

- Note for fault value = 104:
- r50047[1]: Number of valid measuring cycles
  - r50047[2]: Number of required measuring cycles
- Note for fault value = 105:
- r50047[1]: Calculated field circuit inductance in H
- Note for fault value = 106:
- r50047[1]: Field current actual value (1 = 100 %)
- Note for fault value = 107:
- r50047[1]: Calculated field circuit resistance in Ohm
- Note for fault value = 202:
- r50047[1]: Armature current actual value (1 = 100 %)
  - r50047[2]: Armature current lower limit (1 = 100 %)
  - r50047[3]: Armature current upper limit (1 = 100 %)
- Note for fault value = 203:
- r50047[1]: Calculated armature circuit resistance in Ohm
- Note for fault value = 205:
- r50047[1]: Number of required measuring cycles
  - r50047[2]: Number of valid measuring cycles
  - r50047[3]: Measurement run
- Note for fault value = 206:
- r50047[1]: Calculate armature circuit inductance in H
- Note for fault value = 301:
- r50047[1]: Number of measuring points (0 to 4 are possible, at least 2 are required)
- Note for fault value = 401:
- r50047[1]: Nominal EMF (max. permissible EMF setpoint) (1 = 100 %)
  - r50047[1]: Ideal nominal rectifier no-load output voltage (1 = 100 %)
- Note for fault value = 402:
- r50047[1]: 1 = Timeout determining nominal speed, 2 = Timeout recording field characteristic
- Note for fault value = 403:
- r50047[1]: EMF setpoint (1 = 100 %)
  - r50047[2]: EMF actual value (1 = 100 %)
  - r50047[3]: Ramp-up monitoring time in s
- Note for fault value = 404:
- r50047[1]: Speed actual value (1 = 100 %)
- Note for fault value = 405:
- r50047[1]: Index in meas. table
  - r50047[2]: Field current setpoint (1 = 100 %)
- Note for fault value = 406:
- r50047[1]: Field current setpoint (1 = 100 %)
  - r50047[2]: Flux previous measuring point (1 = 100 %)
  - r50047[3]: Flux actual measuring point (1 = 100 %)
- Note for fault value = 407:
- r50047[1]: Index in meas. table
  - r50047[2]: Field current setpoint (1 = 100 %)
- Note for fault value = 408:
- r50047[1]: Index in meas. table
  - r50047[2]: Field current setpoint (1 = 100 %)
- Note for fault value = 409:
- r50047[1]: Index in meas. table
  - r50047[2]: Field current setpoint (1 = 100 %)
- Note for fault value = 501:
- r50047[1]: Speed setpoint (1 = 100 %)
  - r50047[2]: Speed actual value (1 = 100 %)
  - r50047[3]: Speed, lower limit (1 = 100 %)
  - r50047[4]: Speed, upper limit (1 = 100 %)
  - r50047[5]: 0 = No limit active, 1 = Current limit active, 2 = Torque limit active
- Note for fault value = 601:
- r50047[1]: speed setpoint (1 = 100 %) according to p50565
  - r50047[2]: Speed actual value (1 = 100 %)
  - r50047[3]: permissible time in s, until the speed setpoint is reached
- Note for fault value = 602:
- r50047[1]: Speed actual value (1 = 100 %)
- Note for fault value = 701:
- r50047[1]: P2P/CCP operating mode

Note for fault value = 703:  
- r50047[1]: determined index for order number (MLFB)  
Note for fault value = 704:  
- r50047[1]: Rated supply voltage [V]  
- r50047[2]: CCP rated supply voltage [V]  
- r50047[3]: Line voltage tolerance DCM (1 = 100 %)  
- r50047[4]: Line voltage tolerance CCP (1 = 100 %)  
Note for fault value = 707:  
- r50047[1]: Calculated pre-charging voltage [V]  
- r50047[2]: Possible maximum value of the pre-charging voltage [V]  
Note for fault value = 708:  
- r50047[1]: Calculated chopper energy in the armature circuit [J]  
- r50047[2]: CCP chopper energy [J]

**Remedy:**

For fault value = 101:  
Check field circuit for interruption (e.g. due to blown fuse).  
For fault value = 201:  
Check armature circuit for interruption (e.g. due to blown fuse).  
For fault value = 207:  
Temporarily reduce the rated motor current (p50100) so that the rated motor current is significantly less than the device rated current (e.g. p50100 = 50 % of r50072[1]).  
For fault value = 401:  
Check the setting of p50078[0], p50100, p50101 and p50110.  
For fault value = 402:  
Check the optimization of the field circuit.  
For fault value = 403:  
Check the optimization of the speed controller.  
Check the setting of the acceleration times.  
Check the setting of the current and torque limits.  
For fault value = 404:  
Check the polarity of speed actual value sensing (incremental encoder TTL/HTL, analog tachometer).  
For fault value = 405:  
Check the minimum motor excitation current (p50103).  
For fault value = 407:  
Check the torque limiting settings.  
For fault value = 408:  
Check the armature current limiting settings.  
For fault value = 409:  
Reduce the mechanical load.  
For fault value = 701:  
Check the setting of p50790 (value = 6).  
For fault value = 704:  
Check the setting of p50078[0].  
For fault value = 706:  
Check the optimization of the armature circuit.

Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

**F60051 (N, A) Optimization run limit value violated**

**Message value:** %1  
**Drive object:** DC\_CTRL  
**Reaction:** OFF2 (NONE)  
**Acknowledge:** IMMEDIATELY  
**Cause:** During the optimization run, an attempt was made to set a parameter to a value outside its valid range of values.  
The parameter value was set to the appropriate limit value.  
The optimization run was completed in full.  
Recommendation:  
Check the parameter values set!  
Fault value (r0949, decimal interpretation):  
Parameter number of the parameter causing the error.

	Note:
	r50047[1]: Incorrect value
	r50047[2]: Limited value
	r50047[3]: Lower limit value
	r50047[4]: Upper limit value
<b>Remedy:</b>	You might have to set the parameter value manually.
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE

---

## **F60052 (N, A) Optimization run aborted due to external cause**

<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL
<b>Reaction:</b>	OFF2 (NONE)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>An optimization run which had been started has been interrupted due to an external cause.</p> <p>Fault value (r0949, decimal interpretation):</p> <p>101: ON command not set within 30 seconds</p> <p>102: Following the ON command, operating state o0.x or o1.5 was not achieved within 1 minute.</p> <p>103: Impermissible parameter setting for this optimization run</p> <p>104: Internal software error</p> <p>105: Internal software error</p> <p>106: Internal software error</p> <p>108: Operating state o0.x or o1.5 exited during the optimization run</p> <p>109: Internal software error</p> <p>110: Internal software error</p> <p>111: Internal software error</p> <p>112: Data set changeover (DDS) during an optimization run</p> <p>113: Data set changeover (CDS) during an optimization run</p> <p>114: Enable for the positive direction of rotation missing.</p> <p>Note for fault value = 103:</p> <ul style="list-style-type: none"> <li>- r50047[1]: 1 = Sequence control optimization run, 2 = Field optimization run, 3 = EMF optimization run</li> <li>- If r50047[1] = 1, r50047[2 to 3] are not relevant</li> <li>- r50047[2]: Parameter number</li> <li>- r50047[3]: Parameter value</li> </ul> <p>Note for fault value = 104:</p> <ul style="list-style-type: none"> <li>- r50047[1]: Parameter number (parameter number = 0 indicates a general fault is pending)</li> </ul> <p>Note for fault value = 105:</p> <ul style="list-style-type: none"> <li>- r50047[1]: 1 = General fault, 2 = Read parameter, 3 = Write parameter</li> <li>- If r50047[1] = 1, r50047[2 to 3] are not relevant</li> <li>- If r50047[1] = 2, r50047[2]: Parameter number</li> <li>- If r50047[1] = 3, r50047[2]: Parameter number, r50047[3]: Parameter value</li> </ul> <p>Note for fault value = 106:</p> <ul style="list-style-type: none"> <li>- r50047[1]: 1 = Sequence control optimization run, 2 = Optimization run</li> <li>- r50047[2]: OA return status word</li> </ul> <p>Note for fault value = 107:</p> <ul style="list-style-type: none"> <li>- r50047[1]: Parameter number</li> <li>- r50047[2]: OA return status word</li> </ul> <p>Note for fault value = 108:</p> <ul style="list-style-type: none"> <li>- r50047[1]: New operating state</li> </ul> <p>Note for fault value = 109:</p> <ul style="list-style-type: none"> <li>- r50047[1]: 1 = General fault, 2 = Read parameter, 3 = Write parameter, 4 = Set optimization parameter</li> <li>- If r50047[1] = 1, r50047[2 to 3] are not relevant</li> <li>- If r50047[1] = 2, r50047[2] is: Parameter number, r50047[2]: OA return status word, r50047[3]: List index</li> <li>- If r50047[1] = 3, r50047[2]: Parameter number, r50047[3]: Parameter value, r50047[4]: OA return status word</li> <li>- If r50047[1] = 4, r50047[2]: Parameter number</li> </ul> <p>Note for fault value = 110:</p> <ul style="list-style-type: none"> <li>- r50047[1]: Parameter number</li> <li>- r50047[2]: OA return status word</li> </ul>



Note for fault value = 111:  
- r50047[1]: Parameter number  
- r50047[2]: OA return status word  
Note for fault value = 112:  
- r50047[1]: Parameter number  
- r50047[2]: Old DDS (0 to 3)  
- r50047[3]: New DDS (0 to 3)  
Note for fault value = 113:  
- r50047[1]: Parameter number  
- r50047[2]: Old CDS (0 to 1)  
- r50047[3]: New CDS (0 to 1)  
Note for fault value = 114:  
- r50047[1]: Operating state  
- r50047[2]: Value of the signal selected with p50672  
**Remedy:** Interpret the fault value and rectify the fault correspondingly.  
For fault value = 103:  
Check the parameter entered in r50047[2].

Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

**F60055 Field characteristic not valid**

**Message value:** %1  
**Drive object:** DC\_CTRL  
**Reaction:** OFF2  
**Acknowledge:** IMMEDIATELY  
**Cause:** Field weakening in conjunction with the optimization run for field weakening has not yet been performed.  
Fault value (r0949, decimal interpretation):  
1: Closed-loop torque control selected (p50170 = 1) but valid field characteristic not yet recorded  
2: Speed-dependent field weakening selected (p50081 = 1) but valid field characteristic not yet recorded (p50117 = 0)  
**Remedy:** Record field characteristic.  
See also: p50081 (Field weakening activation), p50117 (Field characteristic status), p50170 (Selection of control type for closed-loop current/torque control)

---

**F60056 Important parameter not set**

**Message value:** %1  
**Drive object:** DC\_CTRL  
**Reaction:** OFF2  
**Acknowledge:** IMMEDIATELY  
**Cause:** Settings required for operation have not yet been made or connected components have not yet been commissioned.  
Fault value (r0949, decimal interpretation):  
1: Actual value channel for speed controller not selected (p50083)  
2: Rated armature current of the motor not set (p50100).  
3: Rated field current of the motor not set (p50102).  
Note:  
Only necessary if p50082 > 0.  
4: Rated DC current for the external field device not set (p51838).  
Note:  
Only necessary if p50082 >= 21.  
5: Device commissioning not performed/completed (p0009 not equal to 0).  
6: Drive commissioning not performed/completed (p0010 not equal to 0).  
7: An internal field (p50082 = 1 to 4) has been selected for a device without a field power unit (option L10)  
8: Field characteristic (p50120 ... p50139) not rising uniformly.  
9: Reference speed (p2000) not set (factory setting value must be modified)!  
10: Control Module: Connection of measurement cables for line voltage not set (p51821)  
11: Control Module: Rated armature DC current not set (p51822).  
**Remedy:** Make the setting as appropriate for the fault value displayed.

<b>F60057 (N, A)</b>	<b>Armature current sensing fault</b>
<b>Message value:</b>	-
<b>Drive object:</b>	DC_CTRL
<b>Reaction:</b>	OFF2 (NONE)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>The message is triggered if there are opposing current and torque directions. Monitoring is active as soon as the current values overshoot the device rated current by 20%.</p> <p>Note:</p> <ul style="list-style-type: none"> <li>r50047[1]: Torque direction</li> <li>r50047[2]: Current scan value</li> <li>r50047[3]: Selected current sensing</li> <li>r50047[3] = 1: Current transformer phase UV</li> <li>r50047[3] = 2: Current transformer phase UW</li> <li>r50047[3] = 3: Current transformer phase VW</li> <li>r50047[3] = 4: External V-circuit</li> <li>r50047[3] = 5: External current sensing (shunt)</li> <li>r50047[3] = 6: Current sensing via analog input</li> </ul> <p>See also: p51824 (Current transformer configuration), p51852 (Current actual value sensing analog input configuration)</p>
<b>Remedy:</b>	Check current transformer/shunt.
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE
<b>F60058</b>	<b>Parameter settings not consistent</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>Inconsistent values have been set in parameters depending on each other.</p> <p>Fault value (r0949, decimal interpretation):</p> <ul style="list-style-type: none"> <li>0: Field weakening active (p50081 = 1) is not permissible when the EMF is used as speed setpoint (p50083 = 3).</li> <li>1: Thyristor blocking voltage calculation active (p50166 = 1) for line frequencies &gt; 65 Hz (p50364) is not permissible.</li> <li>2: Setting of p51799 does not match the setting of p51800, p51802 and p51803.</li> <li>3: For a line frequency &gt; 65 Hz, p51800 must be &lt; 10.</li> <li>4: Setting of p50075 does not match the setting of p51799 (dynamic overload capability not permissible for single-phase operation).</li> <li>5: Single-phase operation (p51799 = 1) not permissible for this device type.</li> <li>6: Thyristor blocking voltage calculation (p50166 = 1) not possible for this device.</li> <li>7: If p50083[D] = 2, p0400[0] = 0 is not permissible and if p50083[D] = 5, p0400[1] = 0 is not permissible.</li> <li>8: For p50830 &gt; 0, p51800 &gt; 1 is not permissible (thyristor diagnostics is only permissible for a single drive).</li> <li>10: Line frequency &gt; 120 Hz is not permissible for this power unit (p50364).</li> <li>11: For a 12-pulse parallel connection, p50153 = 2 is not permissible.</li> </ul>
<b>Remedy:</b>	Make the setting as appropriate for the fault value displayed.
<b>F60061</b>	<b>Thyristor test unsuccessful</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>With the thyristor test activated (p50830), a fault was detected for at least one thyristor.</p> <p>Fault value (r0949, decimal interpretation):</p> <ul style="list-style-type: none"> <li>1: Thyristor defective (X11 and/or X24)</li> <li>2: Thyristor defective (X12 and/or X25)</li> <li>3: Thyristor defective (X13 and/or X26)</li> <li>4: Thyristor defective (X14 and/or X21)</li> <li>5: Thyristor defective (X15 and/or X22)</li> </ul>

6: Thyristor defective (X16 and/or X23)  
8: Ground fault in the armature circuit  
11: Thyristor cannot be fired (X11)  
12: Thyristor cannot be fired (X12)  
13: Thyristor cannot be fired (X13)  
14: Thyristor cannot be fired (X14)  
15: Thyristor cannot be fired (X15)  
16: Thyristor cannot be fired (X16)  
17: Two or more thyristors from X11 ... X16 cannot be fired  
21: Thyristor cannot be fired (X21)  
22: Thyristor cannot be fired (X22)  
23: Thyristor cannot be fired (X23)  
24: Thyristor cannot be fired (X24)  
25: Thyristor cannot be fired (X25)  
26: Thyristor cannot be fired (X26)  
27: Two or more thyristors from X21 ... X26 cannot be fired  
31: Thyristor cannot block (X11 or X21)  
32: Thyristor cannot block (X12 or X22)  
33: Thyristor cannot block (X13 or X23)  
34: Thyristor cannot block (X14 or X24)  
35: Thyristor cannot block (X15 or X25)  
36: Thyristor cannot block (X16 or X26)  
41: Thyristor cannot be fired (X11 or X16)  
42: Thyristor cannot be fired (X13 or X14)  
45: Thyristor cannot be fired (X21 or X26)  
46: Thyristor cannot be fired (X13 or X24)  
99: Defective thyristor cannot be identified

**Note 1:**

If "Thyristor defective" or "Thyristor cannot block" is signaled, then the corresponding thyristor module should be replaced.

Possible reasons why thyristors could be destroyed:

- Interrupted snubber circuit.
- Current controller and precontrol not optimized (excessively high current peaks).
- Cooling not guaranteed (e.g. a fan is not running, ambient temperature too high, incorrect fan direction of rotation (incorrect rotating field), air flow too low, very dirty heat sink).
- Excessively high voltage peaks in the line supply.
- External short-circuit or ground fault present (check the armature circuit).

**Note 2:**

If "Thyristor cannot be fired" is signaled, then this is generally caused by a fault in the firing circuit and not by a defective thyristor.

Possible causes:

- Firing pulse cable to the thyristor involved interrupted.
- Connector X11 or X21 incorrectly inserted.
- Flat cable X108 either not correctly inserted or interrupted.
- Defective electronics module or gating module.
- Gate cable in the thyristor module internally interrupted.

**Note 3:**

For a Control Module, this fault can also be initiated by other fault causes.

- Incorrect assignment of the firing pulses to the thyristors.
- Incorrect current actual value sensing connection.
- Incorrect parameterization of the current actual value sensing (p51822, p51823, p51824).
- Incorrect parameterization of the power unit type (p51825).

**Remedy:** Interpret the fault value and information and replace the appropriate thyristor.

---

**F60062 (N, A)      Communication error to the voltage sensing**

**Message value:** %1

**Drive object:** DC\_CTRL

**Reaction:** OFF2 (NONE, OFF1, OFF3)

**Acknowledge:** IMMEDIATELY

**Cause:** Communication to one of the two voltage sensing devices is faulted or interrupted.

Fault value (r0949, decimal interpretation):

1: Armature voltage sensing

2: Field voltage sensing

Note:

r50047[1]: Counter CRC error, armature

r50047[2]: Counter, communication error, armature

r50047[3]: Counter, CRC error, field

r50047[4]: Counter, communication error, field

**Remedy:** Carry out a POWER ON (power off/on) for all components.

Reaction upon N: NONE

Acknowled. upon N: NONE

Reaction upon A: NONE

Acknowled. upon A: NONE

## **F60063 (N, A) Incorrect compensation values for analog inputs/outputs**

**Message value:** %1

**Drive object:** DC\_CTRL

**Reaction:** OFF2 (NONE)

**Acknowledge:** IMMEDIATELY

**Cause:** The factory-set compensation values on the electronics module for the analog inputs/outputs are implausible.

Fault value (r0949, decimal interpretation):

1: Analog input 0 (X177.25/26), voltage input, offset incorrect value

2: Analog input 0 (X177.25/26), voltage input, +10 V incorrect value

3: Analog input 0 (X177.25/26), voltage input, -10 V incorrect value

4: Analog input 0 (X177.25/26), voltage input, reference value incorrect

5: Analog input 0 (X177.25/26), current input, offset incorrect value

6: Analog input 0 (X177.25/26), current input, +20 mA incorrect value

7: Analog input 0 (X177.25/26), current input, -20 mA incorrect value

8: Analog input 0 (X177.25/26), current input, reference value incorrect

9: Analog input 1 (X177.27/28), voltage input, offset incorrect value

10: Analog input 1 (X177.27/28), voltage input, +10 V incorrect value

11: Analog input 1 (X177.27/28), voltage input, -10 V incorrect value

12: Analog input 1 (X177.27/28), voltage input, reference value incorrect

13: Analog input 1 (X177.27/28), current input, offset incorrect value

14: Analog input 1 (X177.27/28), current input, +20 mA incorrect value

15: Analog input 1 (X177.27/28), current input, -20 mA incorrect value

16: Analog input 1 (X177.27/28), current input, reference value incorrect

17: Analog input 2 (X177.29/30), voltage input, offset incorrect value

18: Analog input 2 (X177.29/30), voltage input, +10 V incorrect value

19: Analog input 2 (X177.29/30), voltage input, -10 V incorrect value

20: Analog input 2 (X177.29/30), voltage input, reference value incorrect

21: Analog input 3 (X177.1/2), voltage input, offset incorrect value

22: Analog input 3 (X177.1/2), voltage input, +10 V incorrect value

23: Analog input 3 (X177.1/2), voltage input, -10 V incorrect value

24: Analog input 3 (X177.1/2), voltage input, reference value incorrect

25: Analog input 4 (X177.3/4), voltage input, offset incorrect value

26: Analog input 4 (X177.3/4), voltage input, +10 V incorrect value

27: Analog input 4 (X177.3/4), voltage input, -10 V incorrect value

28: Analog input 4 (X177.3/4), voltage input, reference value incorrect

29: Analog input 5 (X177.5/6), voltage input, offset incorrect value

30: Analog input 5 (X177.5/6), voltage input, +10 V incorrect value

31: Analog input 5 (X177.5/6), voltage input, -10 V incorrect value

32: Analog input 5 (X177.5/6), voltage input, reference value incorrect

33: Analog input 6 (X177.7/8), voltage input, offset incorrect value

34: Analog input 6 (X177.7/8), voltage input, +10 V incorrect value

35: Analog input 6 (X177.7/8), voltage input, -10 V incorrect value

36: Analog input 6 (X177.7/8), voltage input, reference value incorrect

37: Analog input XT1.103/104, voltage input, offset incorrect value

38: Analog input XT1.103/104, voltage input, +25 V incorrect value

39: Analog input XT1.103/104, voltage input, -25 V incorrect value

40: Analog input XT1.103/104, voltage input, reference value incorrect

41: Analog input XT1.103/104, voltage input, offset incorrect value  
 42: Analog input XT1.103/104, voltage input, +80 V incorrect value  
 43: Analog input XT1.103/104, voltage input, -80 V incorrect value  
 44: Analog input XT1.103/104, voltage input, reference value incorrect  
 45: Analog input XT1.103/104, voltage input, offset incorrect value  
 46: Analog input XT1.103/104, voltage input, +270 V incorrect value  
 47: Analog input XT1.103/104, voltage input, -270 V incorrect value  
 48: Analog input XT1.103/104, voltage input, reference value incorrect  
 49: Analog output 0 (X177.49/50), offset incorrect value  
 50: Analog output 0 (X177.49/50), -10 V incorrect value  
 51: Analog output 0 (X177.49/50), +10 V incorrect value  
 52: Analog output 0 (X177.49/50), reference value incorrect  
 53: Analog output 1 (X177.51/52), offset incorrect value  
 54: Analog output 1 (X177.51/52), -10 V incorrect value  
 55: Analog output 1 (X177.51/52), +10 V incorrect value  
 56: Analog output 1 (X177.51/52), reference value incorrect

Note:

r50047[1]: Incorrect compensation value

**Remedy:** Replace the electronics module with the incorrect compensation values.

Reaction upon N: NONE

Acknowl. upon N: NONE

Reaction upon A: NONE

Acknowl. upon A: NONE

---

#### **F60064 (N, A) Error communicating with second processor TMS320**

**Message value:** -

**Drive object:** DC\_CTRL

**Reaction:** OFF2 (NONE)

**Acknowledge:** IMMEDIATELY

**Cause:** Communication with the second processor (TMS320) has failed.

Note:

r50047[1]: Communication counter in send direction

r50047[2]: Communication counter in receive direction

**Remedy:** Carry out a POWER ON (power off/on) for all components.

Reaction upon N: NONE

Acknowl. upon N: NONE

Reaction upon A: NONE

Acknowl. upon A: NONE

---

#### **F60065 (N, A) Software update on second processor (TMS320) failed**

**Message value:** %1

**Drive object:** DC\_CTRL

**Reaction:** OFF2 (NONE)

**Acknowledge:** IMMEDIATELY

**Cause:** The updating of the software for the second processor (TMS320) has failed.

Fault value (r0949, decimal interpretation):

This value indicates the state in which the fault occurred.

2: Wait for the TMS320 bootloader to be ready.

3: Check the version of the TMS320 bootloader.

4: Check the version of the TMS320 application software.

5: Wait for the TMS320 to exit the bootloader.

6: Wait for the TMS320 to load its Flash API.

7: Wait for the TMS320 to delete its Flash EPROM.

8: Send a section of code 8 KB in size to the TMS320.

9: Wait for the TMS320 to request a new 8 KB section of code.

10: Wait until the TMS320 application software has been started.

11: Wait until the TMS320 is ready for a new command.

100: Bootloader version not compatible.

101: TMS version not compatible.

Note:

r50047[1]: Error bits. Indicate in which of the following states errors occurred.

Bit 0 = 1: Initialization

Bit 1 = 1: TMS320 status

Bit 2 = 1: Bootloader version

Bit 3 = 1: TMS320 version

Bit 4 = 1: TMS320 start

Bit 5 = 1: Load Flash interface

Bit 6 = 1: Delete Flash

Bit 7 = 1: Write Flash

Bit 8 = 1: Request code

Bit 9 = 1: TMS320 start

Bit 10 = 1: Read message

**Remedy:** Carry out a POWER ON (power off/on) for all components.

Reaction upon N: NONE

Acknowl. upon N: NONE

Reaction upon A: NONE

Acknowl. upon A: NONE

---

### F60066 (N, A) Error communicating with sensors

**Message value:** %1

**Drive object:** DC\_CTRL

**Reaction:** OFF2 (NONE, OFF1, OFF3)

**Acknowledge:** IMMEDIATELY

**Cause:** An error occurred when polling the fan speeds and temperature sensors.

Fault value (r0949, decimal interpretation):

1: Data not received

2: Fan monitoring or temperature sensors not switched over

**Remedy:** Carry out a POWER ON (power off/on) for all components.

Reaction upon N: NONE

Acknowl. upon N: NONE

Reaction upon A: NONE

Acknowl. upon A: NONE

---

### F60067 (N, A) Fault temperature too high

**Message value:** %1

**Drive object:** DC\_CTRL

**Reaction:** OFF2 (NONE, OFF1, OFF3)

**Acknowledge:** IMMEDIATELY

**Cause:** The temperature at one of the temperature sensors has exceeded the highest permissible temperature to initiate this fault.

Fault value (r0949, decimal interpretation):

1: Overtemperature at sensor 1 (sensor an XT5).

2: Overtemperature at sensor 2 (sensor an XT6).

3: Overtemperature at sensor 3 (sensor an XT7).

4: Overtemperature at the sensor control module (A7105, A7106, A7107, A7108, A7109).

Note:

r50047[1]: Temperature sensor 1

r50047[2]: Temperature sensor 2

r50047[3]: Temperature sensor 3

r50047[4]: Gating module temperature

r50047[5]: CUD module temperature

**Remedy:** - Check the ambient temperature and reduce if necessary.

- Reduce the load.

Reaction upon N: NONE

Acknowl. upon N: NONE

Reaction upon A: NONE

Acknowl. upon A: NONE

---

**F60068 (N, A)    Incorrect compensation values for power unit**

**Message value:** %1  
**Drive object:** DC\_CTRL  
**Reaction:** OFF2 (NONE)  
**Acknowledge:** IMMEDIATELY  
**Cause:** The compensation values for the power unit are missing or incorrect.  
Fault value (r0949, decimal interpretation):  
1x: Power unit for armature  
2x: Power unit for field  
x = 1: Unable to read compensation data  
x = 2: Unknown compensation data format  
x = 3: Incorrect compensation data CRC  
x = 4: The measuring points contained in the compensation data do not rise uniformly.  
x = 5: No compensation values can be calculated from the compensation data.  
x = 6: The signal offset calculated from the compensation data is impermissibly high.  
**Remedy:** Carry out a POWER ON (power off/on) for all components.  
Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

**F60069 (N, A)    Invalid order number (MLFB)**

**Message value:** %1  
**Drive object:** DC\_CTRL  
**Reaction:** OFF2 (NONE)  
**Acknowledge:** IMMEDIATELY  
**Cause:** The data read from the power unit (serial number, MLFB, accessory options) is invalid.  
Fault value (r0949, decimal interpretation):  
1: The serial number is invalid or missing.  
2: The order number (MLFB) is invalid or missing.  
3: The accessory options are invalid.  
4: Incorrect serial number CRC  
5: Incorrect MLFB CRC  
6: Incorrect accessory options CRC  
7: The MLFB read out is not known to the software.  
8: Unable to read data.  
9: MLFB cannot be changed in current operating state.  
Note for fault value = 1, 4:  
r50047[1]: 1st digit of serial number  
r50047[2]: 2nd digit of serial number  
...  
r50047[30]: 30th digit of serial number  
Note for fault value = 2, 5, 7:  
r50047[1]: 1st digit of MLFB  
r50047[2]: 2nd digit of MLFB  
...  
r50047[30]: 30th digit of MLFB  
Note for fault value = 3, 6:  
r50047[1]: 1st digit of accessory options  
r50047[2]: 2nd digit of accessory options  
...  
r50047[30]: 30th digit of accessory options  
Note for fault value = 9:  
r50047[1]: Operating state  
**Remedy:** Send your SINAMICS DC MASTER to the manufacturer's plant or an authorized repair center.  
Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

<b>A60080 (F, N)</b>	<b>Alarm temperature too high</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>The temperature at one of the temperature sensors has exceeded the highest permissible temperature to initiate this alarm.</p> <p>Alarm value (r2124, interpret decimal):</p> <p>1: Overtemperature at sensor 1 (sensor an XT5).</p> <p>2: Overtemperature at sensor 2 (sensor an XT6).</p> <p>3: Overtemperature at sensor 3 (sensor an XT7).</p> <p>4: Overtemperature at the sensor control module (A7105, A7106, A7107, A7108, A7109).</p> <p>Note:</p> <p>r50047[1]: Temperature sensor 1</p> <p>r50047[2]: Temperature sensor 2</p> <p>r50047[3]: Temperature sensor 3</p> <p>r50047[4]: Gating module temperature</p> <p>r50047[5]: CUD module temperature</p>
<b>Remedy:</b>	<p>- Check the ambient temperature and reduce if necessary.</p> <p>- Reduce the load.</p>
Reaction upon F:	NONE (OFF1, OFF2, OFF3)
Acknowl. upon F:	IMMEDIATELY
Reaction upon N:	NONE
Acknowl. upon N:	NONE
<b>A60081 (F, N)</b>	<b>Alarm module temperature exceeded</b>
<b>Message value:</b>	-
<b>Drive object:</b>	DC_CTRL
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>The temperature on the Control Unit DC MASTER (CUD) has exceeded the alarm value (temperature above 90 °C).</p> <p>Note:</p> <p>r50047[1]: Module temperature (in °C)</p> <p>r50047[2]: Reference voltage -10 V (in volts)</p> <p>r50047[3]: Reference voltage +10 V (in volts)</p> <p>r50047[4]: Temperature sensor 1 (in °C)</p>
<b>Remedy:</b>	Check the ambient temperature and reduce if necessary.
Reaction upon F:	NONE (OFF1, OFF2, OFF3)
Acknowl. upon F:	IMMEDIATELY
Reaction upon N:	NONE
Acknowl. upon N:	NONE
<b>A60082 (F, N)</b>	<b>Alarm derating factor K1 limit value fallen below</b>
<b>Message value:</b>	-
<b>Drive object:</b>	DC_CTRL
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>For a drive device equipped with option L99, derating (reduced power) is calculated depending on the air intake temperature.</p> <p>The calculated derating factor K1 has fallen below the set limit value (p50066).</p> <p>Note:</p> <p>r50047[1]: air intake temperature in °C (sensor at XT6)</p> <p>r50047[2]: derating factor K1</p> <p>See also: p50066 (Power unit I2t monitoring derating factor K1 limit value)</p>
<b>Remedy:</b>	Check the air intake temperature and reduce if necessary.
Reaction upon F:	NONE (OFF1, OFF2, OFF3)
Acknowl. upon F:	IMMEDIATELY



Reaction upon N: NONE  
Acknowl. upon N: NONE

---

**F60090 (N, A)    Fault module temperature exceeded**

**Message value:** -  
**Drive object:** DC\_CTRL  
**Reaction:** OFF2 (NONE, OFF1, OFF3)  
**Acknowledge:** IMMEDIATELY  
**Cause:** The temperature on the Control Unit DC MASTER (CUD) has exceeded the fault value (temperature above 95 °C).  
Note:  
r50047[1]: Module temperature (in °C)  
r50047[2]: Supply voltage -10 V (in volts)  
r50047[3]: Supply voltage +10 V (in volts)  
r50047[4]: Temperature sensor 1 (in °C)  
**Remedy:** Check the ambient temperature and reduce if necessary.  
Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

**F60091 (N, A)    Reference voltage P10 outside tolerance**

**Message value:** -  
**Drive object:** DC\_CTRL  
**Reaction:** OFF2 (NONE)  
**Acknowledge:** IMMEDIATELY  
**Cause:** The reference voltage P10 (+10 V) at terminal X177.31 lies outside the tolerance (deviation greater than +/-5%).  
Note:  
r50047[1]: Reference voltage +10 V (in volts)  
r50047[2]: Reference voltage -10 V (in volts)  
r50047[3]: Module temperature (in °C)  
**Remedy:** Check the power supply.  
Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

**F60092 (N, A)    Reference voltage N10 outside tolerance**

**Message value:** -  
**Drive object:** DC\_CTRL  
**Reaction:** OFF2 (NONE)  
**Acknowledge:** IMMEDIATELY  
**Cause:** The reference voltage N10 (-10 V) at terminal X177.32 lies outside the tolerance (deviation greater than +/-5%).  
Note:  
r50047[1]: Reference voltage -10 V (in volts)  
r50047[2]: Reference voltage +10 V (in volts)  
r50047[3]: Module temperature (in °C)  
**Remedy:** Check the power supply.  
Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

**F60093 (N, A) Power supply P5 overloaded**

**Message value:** -  
**Drive object:** DC\_CTRL  
**Reaction:** OFF2 (NONE)  
**Acknowledge:** IMMEDIATELY  
**Cause:** Power supply P5 (+5 V) at connector X179.1 is overloaded.  
**Note:**  
r50047[1]: Reference voltage +10 V (in volts)  
r50047[2]: Reference voltage -10 V (in volts)  
r50047[3]: Module temperature (in °C)  
**Remedy:** Identify the reason for the overload and rectify the situation.  
**Reaction upon N:** NONE  
**Acknowl. upon N:** NONE  
**Reaction upon A:** NONE  
**Acknowl. upon A:** NONE

---

**F60094 (N, A) Power supply P15 overloaded**

**Message value:** -  
**Drive object:** DC\_CTRL  
**Reaction:** OFF2 (NONE)  
**Acknowledge:** IMMEDIATELY  
**Cause:** Power supply P15 (+15 V) at terminal X177.41 is overloaded.  
**Note:**  
r50047[1]: Reference voltage +10 V (in volts)  
r50047[2]: Reference voltage -10 V (in volts)  
r50047[3]: Module temperature (in °C)  
**Remedy:** Identify the reason for the overload and rectify the situation.  
**Reaction upon N:** NONE  
**Acknowl. upon N:** NONE  
**Reaction upon A:** NONE  
**Acknowl. upon A:** NONE

---

**F60095 (N, A) Power supply P24 overloaded**

**Message value:** -  
**Drive object:** DC\_CTRL  
**Reaction:** OFF2 (NONE)  
**Acknowledge:** IMMEDIATELY  
**Cause:** Power supply P24 (+24 V) at terminal X177.9 or X177.10 is overloaded.  
**Note:**  
r50047[1]: Reference voltage +10 V (in volts)  
r50047[2]: Reference voltage -10 V (in volts)  
r50047[3]: Module temperature (in °C)  
**Remedy:** Identify the reason for the overload (e.g. digital outputs) and rectify the situation.  
**Reaction upon N:** NONE  
**Acknowl. upon N:** NONE  
**Reaction upon A:** NONE  
**Acknowl. upon A:** NONE

---

**F60096 (N, A) Temperature sensor faulty**

**Message value:** %1  
**Drive object:** DC\_CTRL  
**Reaction:** OFF2 (NONE, OFF1, OFF3)  
**Acknowledge:** IMMEDIATELY  
**Cause:** A cable break or a short circuit has been detected on at least one temperature sensor.

Fault value (r0949, decimal interpretation):

1: A cable break has occurred.

2: A short circuit has occurred.

Note:

r50047[1] = 1: Temperature sensor 1

r50047[1] = 2: Temperature sensor 2

r50047[1] = 3: Temperature sensor 3

r50047[1] = 4: Temperature sensor gating module

r50047[1] = 5: Temperature sensor CUD module

r50047[1] = 6: Motor temperature sensor

r50047[2]: Value of the analog-to-digital converter

**Remedy:** Evaluate the fault and, if the temperature sensor is faulty, run a wiring and performance check.

Reaction upon N: NONE

Acknowl. upon N: NONE

Reaction upon A: NONE

Acknowl. upon A: NONE

---

### **F60097 (N, A) Power supply faulty**

**Message value:** -

**Drive object:** DC\_CTRL

**Reaction:** OFF2 (NONE)

**Acknowledge:** IMMEDIATELY

**Cause:** The power supply is not working correctly.

Note 1:

r50047[1]: Reference voltage +10 V (in volts)

r50047[2]: Reference voltage -10 V (in volts)

r50047[3]: Module temperature (in °C)

Note 2:

For SINAMICS DCM with 2 CUD, the following applies:

After carrying out a reset (p0972 > 0 or p0976 = 200) at a CUD, then this fault is output at the other. In this case, the fault has no significance and can be acknowledged.

**Remedy:** Check the power supply.

Reaction upon N: NONE

Acknowl. upon N: NONE

Reaction upon A: NONE

Acknowl. upon A: NONE

---

### **A60098 (F, N) System utilization high**

**Message value:** -

**Drive object:** DC\_CTRL

**Reaction:** NONE

**Acknowledge:** NONE

**Cause:** The average computing time utilization (r9976[1]) for the system is greater than 95 %.

**Remedy:** Reduce computing time utilization by.

The following options are available to do this:

- check the number of cyclically calculated blocks (DCC), and if required reduce.

- assign DCC blocks to runtime groups with a longer sampling time.

- check the number of cyclically calculated function blocks (FBLOCKS), and if required reduce.

- assign function blocks to runtime groups with a longer sampling time.

- remove DRIVE-CLiQ components that are not required.

- deactivate control blocks that are not required (p50899). This must be especially taken into account for a CUD right.

Reaction upon F: NONE (OFF1, OFF2, OFF3)

Acknowl. upon F: IMMEDIATELY

Reaction upon N: NONE

Acknowl. upon N: NONE

---

### F60099 (N, A) System utilization too high

**Message value:** -

**Drive object:** DC\_CTRL

**Reaction:** OFF2 (NONE, OFF1, OFF3)

**Acknowledge:** IMMEDIATELY

**Cause:** The average computing time utilization (r9976[1]) for the system is greater than 100 %.

**Note:**  
r50047[1]: Averaged computing time utilization (in %)  
r50047[2]: Maximum computing time utilization (in %)

**Remedy:** Reduce computing time utilization by.  
The following options are available to do this:

- check the number of cyclically calculated blocks (DCC), and if required reduce.
- assign DCC blocks to runtime groups with a longer sampling time.
- check the number of cyclically calculated function blocks (FBLOCKS), and if required reduce.
- assign function blocks to runtime groups with a longer sampling time.
- remove DRIVE-CLiQ components that are not required.
- deactivate control blocks that are not required (p50899). This must be especially taken into account for a CUD right.

Reaction upon N: NONE

Acknowled. upon N: NONE

Reaction upon A: NONE

Acknowled. upon A: NONE

---

### F60104 (N, A) Armature circuit line voltage not OK

**Message value:** %1

**Drive object:** DC\_CTRL

**Reaction:** OFF2 (NONE)

**Acknowledge:** IMMEDIATELY

**Cause:** On power-up, the time set in p50089 represents the maximum wait time for voltage at the power connections and for field current in operating states o5 and o4 combined.  
On power-up, the time set in p50095 represents the maximum wait time for "Line contactor feedback" in operating state o3.3 (if activated, see p50691).  
This fault is triggered if the above times elapse in one of these operating states.

- Thresholds for the line monitoring incorrectly set (p50078, p50351, p50352, p50353, p50363, p50364).
- Armature voltage not OK (phase failure, undervoltage/overvoltage, underfrequency/overfrequency).
- Line contactor not picking up
- Fuse blown on three-phase side of armature circuit
- Fuse blown in power unit
- Interruption affecting thyristor firing pulse cable (auxiliary cathodes at connections X12, X14, X16 are used for voltage transmission).

**Fault value (r0949, decimal interpretation):**  
2: Wait time set in p50089 has expired in operating state o4.0.  
3: Fuse blown on three-phase side of armature circuit  
6: Wait time set in p50095 has expired in operating state o3.3.

**Note for fault value = 2:**  
- r50047[1]: line state (r53145)

Bit 0 = 1: Armature supply line, overvoltage  
Bit 1 = 1: Armature supply line, undervoltage  
Bit 2 = 1: Armature supply line, overfrequency  
Bit 3 = 1: Armature supply line, underfrequency  
Bit 4 = 1: Armature supply line, phase failure  
Bit 5 = 1: Field supply line, overvoltage  
Bit 6 = 1: Field supply line, undervoltage  
Bit 7 = 1: Field supply line, overfrequency  
Bit 8 = 1: Field supply line, underfrequency  
Bit 9 = 1: Field supply line, phase failure  
Bit 10 = 1: Armature supply line OK  
Bit 11 = 1: Field supply line OK  
Bit 12 = 1: clockwise phase sequence  
Bit 13 = 1: Line symmetrical

See also: p50089 (Sequence control voltage at power unit wait time), p50095 (Sequence control DC circuit contactor wait time), p50691 (Sequence control line contactor feedback)

**Remedy:**

- Check the thresholds for the line monitoring (p50078, p50351, p50352, p50353, p50363, p50364).
- Check line voltage and line contactor.
- Check fuses for armature circuit.
- Check thyristor firing pulse cable (X12, X14, X16).

See also: p50089 (Sequence control voltage at power unit wait time), p50353 (Line monitoring phase failure threshold)

Reaction upon N: NONE

Acknowl. upon N: NONE

Reaction upon A: NONE

Acknowl. upon A: NONE

---

**F60105 (N, A)    Field current monitoring fault in field circuit**

**Message value:**    %1

**Drive object:**    DC\_CTRL

**Reaction:**    OFF2 (NONE)

**Acknowledge:**    IMMEDIATELY

**Cause:**    Field current monitoring has detected erroneous behavior.

- Field phase failed
- Line contactor not picking up
- Fuse blown in field circuit
- Field current controller and/or field current controller pre-control not optimized or optimization is very poor.

Fault value (r0949, decimal interpretation):

- 1: The field current actual value was smaller than the percentage of the field current setpoint set in p50396.
- 2: The field line voltage was not available within the time set in p50089.
- 3: The field current was not available within the time set in p50089.
- 4: The external field current monitoring has responded (BI: p50265 = 1/0 signal).

Note for fault value = 1:

r50047[1]: Setpoint at field current controller input (r52268)

r50047[2]: Actual value at field current controller input (r52265)

r50047[3]: External monitoring (p50265)

r50047[4]: Operating mode (p50082)

r50047[5]: Threshold for monitoring (p50396)

See also: r50073 (Device rated direct current field), p50082 (Field power unit operating mode), p50396 (Field current monitoring setpoint factor), p50397 (Field current monitoring fault delay time), r52265 (CI-loop field curr ctrl current controller actual value), r52268 (Closed-loop field current control current controller setpoint)

**Remedy:**

- Check field phases.
- Check line contactor.
- Check fuses in field current circuit.
- Perform an optimization run for the field current controller (p50051 = 24).
- Check the threshold and time for field current monitoring (p50396, p50397).

See also: p50051 (Optimization run selection)

Reaction upon N: NONE

Acknowl. upon N: NONE

Reaction upon A: NONE

Acknowl. upon A: NONE

---

**F60106 (N, A)    Short-circuit voltage Uk too high**

**Message value:**    %1

**Drive object:**    DC\_CTRL

**Reaction:**    OFF2 (NONE, OFF1, OFF3)

**Acknowledge:**    IMMEDIATELY

**Cause:**    The per unit short-circuit voltage of the line supply is greater than 10 %.

Permissible values are between 2 and 10 %.

See also: r50073 (Device rated direct current field), p50082 (Field power unit operating mode), p50396 (Field current monitoring setpoint factor), p50397 (Field current monitoring fault delay time), r52265 (CI-loop field curr ctrl current controller actual value), r52268 (Closed-loop field current control current controller setpoint)

**Remedy:** Check the dimensioning of the commutating reactors or the line transformer.  
See also: p50051 (Optimization run selection)

Reaction upon N: NONE

Acknowl. upon N: NONE

Reaction upon A: NONE

Acknowl. upon A: NONE

---

**F60137 (N, A) I2t monitoring fault excessive motor temperature rise**

**Message value:** -

**Drive object:** DC\_CTRL

**Reaction:** OFF2 (NONE, OFF1, OFF3)

**Acknowledge:** IMMEDIATELY

**Cause:** The I2t calculation shows that the motor's temperature rise is excessive.  
The fault is triggered if the calculated motor temperature rise in r52309 > 110%.  
Note:  
r50047[1]: Temperature rise r52309  
r50047[2]: Motor rated armature current p50100  
r50047[3]: Continuous current factor r50113  
r50047[4]: Device rated current r50072[1]  
r50047[5]: Current armature current r52109  
r50047[6]: Motor thermal time constant p50114  
See also: p50114 (Motor thermal time constant), r52309 (Calculated motor temperature rise)

**Remedy:** - Check the ambient temperature and reduce if necessary.  
- Reduce the motor load.  
See also: r52109 (Armature current actual value averaged over 6 cycles)

Reaction upon N: NONE

Acknowl. upon N: NONE

Reaction upon A: NONE

Acknowl. upon A: NONE

---

**F60139 (N, A) I2t monitoring fault excessive power unit temperature rise**

**Message value:** -

**Drive object:** DC\_CTRL

**Reaction:** OFF2 (NONE, OFF1, OFF3)

**Acknowledge:** IMMEDIATELY

**Cause:** The temperature rise of the thyristors is more than 110% of the maximum permissible value.

**Remedy:** - Check the ambient temperature and reduce if necessary.  
- Check the motor load and reduce if necessary.

Reaction upon N: NONE

Acknowl. upon N: NONE

Reaction upon A: NONE

Acknowl. upon A: NONE

---

**A60143 (F, N) Reduction of the field current setpoint for an excessively high EMF during braking active**

**Message value:** -

**Drive object:** DC\_CTRL

**Reaction:** NONE

**Acknowledge:** NONE

**Cause:** Reduction of the field current setpoint for an excessively high EMF during braking is active.  
See also: p50272 (Field current reduction activation)

**Remedy:** Not necessary.  
The alarm automatically disappears after braking has expired.

Reaction upon F: NONE (OFF2)

Acknowl. upon F: IMMEDIATELY

Reaction upon N: NONE  
Acknowl. upon N: NONE

---

**A60165 (F, N) Fan end of service life has been reached or exceeded**

**Message value:** -  
**Drive object:** DC\_CTRL  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** At least one device fan has reached the end of its service life - or has exceeded it.  
**Remedy:** Replace the device fan and reset the operating hours.  
See also: r50960 (Device fan operating hours display), p50961 (Device fan service life), p50962 (Device fan reset operating hours)

Reaction upon F: NONE (OFF1, OFF2, OFF3)  
Acknowl. upon F: IMMEDIATELY  
Reaction upon N: NONE  
Acknowl. upon N: NONE

---

**A60166 (F, N) Alarm fan speed too slow**

**Message value:** -  
**Drive object:** DC\_CTRL  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The fan speed is too slow. The fan is probably blocked or faulty.  
Note:  
r50047[1]: Speed fan 1 (in revolutions/s)  
r50047[2]: Speed fan 2 (in revolutions/s)  
r50047[3]: Speed fan 3 (in revolutions/s)  
r50047[4]: Speed fan 4 (in revolutions/s)  
**Remedy:** Check the fan and replace if necessary.

Reaction upon F: NONE (OFF1, OFF2, OFF3)  
Acknowl. upon F: IMMEDIATELY  
Reaction upon N: NONE  
Acknowl. upon N: NONE

---

**F60167 (N, A) Fault fan speed too slow**

**Message value:** -  
**Drive object:** DC\_CTRL  
**Reaction:** OFF2 (NONE, OFF1, OFF3)  
**Acknowledge:** IMMEDIATELY  
**Cause:** a) The fan speed is too slow. The fan is probably blocked or faulty.  
b) The AC fan was switched off in operation or before the fan run on time p50096 expired by an external fan control.  
Note 1:  
r50047[1]: Speed fan 1 (in revolutions/s)  
r50047[2]: Speed fan 2 (in revolutions/s)  
r50047[3]: Speed fan 3 (in revolutions/s)  
r50047[4]: Speed fan 4 (in revolutions/s)  
Note 2:  
Fault message F60167 can only be acknowledged after the fan run on time p50096 has expired!  
**Remedy:** a) Check the fan and replace if necessary.  
b) Use the fan control inside the device ! See function block diagram 8047 or 8049.

Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

<b>A60168 (F, N)</b>	<b>Memory card not plugged in</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL
<b>Reaction:</b>	NONE
<b>Acknowledge:</b>	NONE
<b>Cause:</b>	<p>The data recorded with the recorder function could not be saved on the memory card.</p> <p>Possible causes:</p> <ul style="list-style-type: none"> <li>- Memory card not plugged in</li> <li>- Memory card defective</li> </ul> <p>Note:</p> <p>If the save function is performed without errors, the data is saved on the memory card under "USER\SIN-AMICS\DATA\LOG\Tack.csv".</p> <p>Fault value (r0949, decimal interpretation):</p> <ul style="list-style-type: none"> <li>1: Unable to create or open the file</li> <li>2: Unable to write to the file</li> <li>3: Unable to write all data to the file</li> </ul> <p>See also: p51700 (Signal source for connector recorder function), p51701 (Signal source for binector recorder function), p51702 (Recorder function channel selection), p51703 (Recorder function recording interval), p51704 (Recorder function save interval), p51705 (Start/stop recorder function)</p>
<b>Remedy:</b>	Plug in a functional memory card (SecureDigital card, SD card).
Reaction upon F:	NONE (OFF1, OFF2, OFF3)
Acknowl. upon F:	IMMEDIATELY
Reaction upon N:	NONE
Acknowl. upon N:	NONE
<b>F60203 (N, A)</b>	<b>External fault triggered</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL
<b>Reaction:</b>	OFF2 (NONE, OFF1, OFF3)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>An external fault has been triggered via terminal 124/125 on the Control Module.</p> <p>Fault value (r0949, decimal interpretation):</p> <p>Input signal which triggered the fault.</p> <p>Note:</p> <p>r50047[1]: External fault mode (p51833)</p> <p>See also: p51833 (External fault mode)</p>
<b>Remedy:</b>	Eliminate the causes of this fault.
Reaction upon N:	NONE
Acknowl. upon N:	NONE
Reaction upon A:	NONE
Acknowl. upon A:	NONE
<b>F60204 (N, A)</b>	<b>Fuse monitoring has responded</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL
<b>Reaction:</b>	OFF2 (NONE)
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>Fuse monitoring on the Control Module has detected at least one blown fuse.</p> <p>Fault value (r0949, decimal interpretation):</p> <ul style="list-style-type: none"> <li>1: Monitoring of slot X23B (p51831[0]) has responded.</li> <li>2: Monitoring of slot X23C (p51831[1]) has responded.</li> <li>3: Monitoring of slot X23D (p51831[2]) has responded.</li> <li>4: Monitoring of slot X23E (p51831[3]) has responded.</li> <li>5: Monitoring of slot X23F (p51831[4]) has responded.</li> </ul> <p>Note:</p> <p>r50047[1]: Fuse number (XS1, XS2 to XS6)</p> <p>See also: p51831 (Fuse monitoring activation)</p>



**Remedy:**           - Analyze the blown fuse.  
                      - Replace or close fuses as necessary.

Reaction upon N:   NONE  
Acknowl. upon N:   NONE  
Reaction upon A:   NONE  
Acknowl. upon A:   NONE

---

**A60266 (F, N)   Alarm fan not OK**

**Message value:**   %1  
**Drive object:**    DC\_CTRL  
**Reaction:**        NONE  
**Acknowledge:**    NONE  
**Cause:**           Fan monitoring on the Control Module has detected a faulty fan and outputs this alarm at the end of the delay time (p51835[2]).  
                      The fan might be blocked or faulty.  
                      Alarm value (r2124, interpret decimal):  
                      Input signal which triggered this alarm.  
                      Note:  
                      Fan monitoring is connected via terminal 122/123 and set via p51832.  
                      r50047[1]: Fan monitoring mode (p51832)

**Remedy:**           - Check wiring of "Fan OK" message via input terminal 124/125.  
                      - Check the setting of the mode for fan monitoring (p51832).  
                      - Check the fan and replace if necessary.  
                      See also: p51832 (Fan monitoring configuration), p51835 (Delay times for device fan monitoring)

Reaction upon F:   NONE (OFF1, OFF2, OFF3)  
Acknowl. upon F:   IMMEDIATELY  
Reaction upon N:   NONE  
Acknowl. upon N:   NONE

---

**F60267 (N, A)   CM: Fan not OK**

**Message value:**   %1  
**Drive object:**    DC\_CTRL  
**Reaction:**        OFF2 (NONE, OFF1, OFF3)  
**Acknowledge:**    IMMEDIATELY  
**Cause:**           Fan monitoring on the Control Module (CM) has detected a faulty fan and outputs this fault after the delay time has expired (p51835[1]).  
                      The fan might be blocked or faulty.  
                      Fault value (r0949, decimal interpretation):  
                      Input signal which triggered this alarm.  
                      Note:  
                      Fan monitoring is connected via terminal 122/123 and set via p51832.  
                      r50047[1]: CM fan monitoring mode (p51832)

**Remedy:**           - Check wiring of "Fan OK" message via input terminal 124/125.  
                      - Check the setting of the mode for fan monitoring (p51832).  
                      - Check the fan and replace if necessary.  
                      See also: p51832 (Fan monitoring configuration), p51835 (Delay times for device fan monitoring)

Reaction upon N:   NONE  
Acknowl. upon N:   NONE  
Reaction upon A:   NONE  
Acknowl. upon A:   NONE

<b>F60300</b>	<b>Commutation failure</b>
<b>Message value:</b>	%1
<b>Drive object:</b>	DC_CTRL
<b>Reaction:</b>	OFF2
<b>Acknowledge:</b>	IMMEDIATELY
<b>Cause:</b>	<p>Commutation failure or overcurrent has occurred or a test command was entered via p51583.</p> <p>Possible causes of the commutation failure:</p> <ul style="list-style-type: none"> <li>- Line voltage dip during regenerative operation.</li> <li>- Armature current control loop not optimized.</li> </ul> <p>Fault value (r0949, decimal interpretation):</p> <p>1:</p> <p>Commutation was not successful because the thyristor being turned off did not accept the blocking voltage (only for p50166 = 1).</p> <p>r50047[0]: Decision criterion (= 1)</p> <p>r50047[1]: Thyristor state (= r53146)</p> <p>r50047[2]: Fired thyristor pairs</p> <p>Bit 0 = 1: Thyristor 1 in MI was fired</p> <p>...</p> <p>Bit 5 = 1: Thyristor 6 in MI was fired</p> <p>Bit 8 = 1: Thyristor 1 in MII was fired</p> <p>...</p> <p>Bit 13 = 1: Thyristor 6 in MII was fired</p> <p>r50047[3]: Actual armature firing angle [in degrees]</p> <p>r50047[4]: Actual EMF in [in %]</p> <p>2:</p> <p>The current did not flow through the correct thyristor or the current cusp made a kink upwards.</p> <p>r50047[0]: Decision criterion (= 2)</p> <p>r50047[1]: Subcriterion</p> <p>For subcriterion = 1, the following applies:</p> <p>The current did not flow through the correct thyristors.</p> <p>r50047[2]: Actual Ia sample value [in A]</p> <p>r50047[3]: Actual Ia sample value CT 1 [in A]</p> <p>r50047[4]: Actual Ia sample value CT 2 [in A]</p> <p>r50047[5]: Actual Ia sample value + 20% of In [in A]</p> <p>r50047[6]: Number of Ia sample values since the last firing pulse</p> <p>For subcriterion = 2, the following applies:</p> <p>The current cusp has an upwards kink</p> <p>r50047[2]: Actual Delta Ia [in A]</p> <p>r50047[3]: Lowest Delta-Ia up until now since the last firing pulse [in A]</p> <p>r50047[4]: Actual Ia sample value [in A]</p> <p>r50047[5]: First Delta-Ia after the last firing pulse [in A]</p> <p>r50047[6]: Actual armature firing angle [in degrees]</p> <p>r50047[7]: Number of Ia sample values since the last firing pulse</p> <p>3:</p> <p>The magnitude of the current cusp was greater than 290% of the actual rated device armature DC current (r50072[1]).</p> <p>r50047[0]: Decision criterion (= 3)</p> <p>r50047[1]: Number of Delta-Ua, that Ua may still be away from the EMF</p> <p>r50047[2]: Previous voltage CD [in V]</p> <p>r50047[3]: Actual voltage CD [in V]</p> <p>r50047[4]: Actual Delta Ua [in V]</p> <p>r50047[5]: Actual armature firing angle [in degrees]</p> <p>r50047[6]: Actual EMF in [in V]</p> <p>r50047[7]: Actual Ia sample value [in A]</p> <p>4:</p> <p>A SINAMICS DCM connected in parallel has detected a commutation failure or overcurrent.</p> <p>r50047[0]: Decision criterion (= 4)</p>

5:  
Test command was entered via p51583.  
r50047[0]: Decision criterion (= 5)  
r50047[1]: Actual voltage CD [in V]  
r50047[2]: Actual armature firing angle [in degrees]  
r50047[3]: Actual EMF in [in V]  
r50047[4]: Actual I<sub>a</sub> sample value [in A]  
r50047[5]: Actual torque direction (0, 1 or 2)  
**Remedy:** Acknowledge the fault and switch off /switch on the drive

---

**F60320 (N, A) CCP not functional**

**Message value:** %1  
**Drive object:** DC\_CTRL  
**Reaction:** OFF2 (NONE, OFF1, OFF3)  
**Acknowledge:** IMMEDIATELY  
**Cause:** The SIMOREG CCP is not functional.  
Possible fault causes:  
- Hardware defect in the charge circuit of the turn-off capacitors.  
- Fuse failure in the armature circuit, line side or motor side.  
- Fuse failure in the pre-charging circuit for the chopper capacitors.  
- Chopper resistors still cooling down (this is necessary)  
Fault value (r0949, decimal interpretation):  
1: No voltage at the U, V, W connections of the SIMOREG CCP.  
2: The voltage at C-D at the SIMOREG CCP does not match the voltage C-D at the SINAMICS DCM.  
3: The turn-off capacitors of the SIMOREG CCP have not reached the setpoint voltage.  
4: No connection between SINAMICS DCM (X165\_2, fast pulse inhibit interface) and SIMOREG CCP (X165).  
5: No connection between SINAMICS DCM (X177) and SIMOREG CCP (X172) via the serial interface.  
6: No connection between several SIMOREG CCPs (X29\_PAR or X30\_PAR, turn-off pulse interface).  
7: SIMOREG CCP data invalid or not available (r51570, r51571, r51572).  
11: The I<sub>2t</sub> value (r51575) of the voltage limiting chopper 1 is too high (> 100 %).  
12: The I<sub>2t</sub> value (r51576) of the voltage limiting chopper 2 is too high (> 100 %).  
20: The chopper capacitors were not able to be pre-charged within the time set in p50089.  
Note:  
r50047[0]: Fault value  
r50047[1]: CCP state (extended status word + r51574)  
r50047[2]: Armature voltage  
**Remedy:** Interpret the fault value and rectify the fault correspondingly.  
Reaction upon N: NONE  
Acknowl. upon N: NONE  
Reaction upon A: NONE  
Acknowl. upon A: NONE

---

**A60321 (F, N) CCP not functional**

**Message value:** %1  
**Drive object:** DC\_CTRL  
**Reaction:** NONE  
**Acknowledge:** NONE  
**Cause:** The SIMOREG CCP is not functional.  
Possible fault causes:  
- Hardware defect in the charge circuit of the turn-off capacitors.  
- Fuse failure in the armature circuit, line side or motor side.  
- Fuse failure in the pre-charging circuit for the chopper capacitors.  
- Chopper resistors still cooling down (this is necessary)

Alarm value (r2124, interpret decimal):

- 1: No voltage at the U, V, W connections of the SIMOREG CCP.
- 2: The voltage at C-D at the SIMOREG CCP does not match the voltage C-D at the SINAMICS DCM.
- 3: The turn-off capacitors of the SIMOREG CCP have not reached the setpoint voltage.
- 4: No connection between SINAMICS DCM (X165\_2, fast pulse inhibit interface) and SIMOREG CCP (X165).
- 5: No connection between SINAMICS DCM (X177) and SIMOREG CCP (X172) via the serial interface.
- 6: No connection between several SIMOREG CCPs (X29\_PAR or X30\_PAR, turn-off pulse interface).
- 7: SIMOREG CCP data invalid or not available (r51570, r51571, r51572).
- 11: The I2t value (r51575) of the voltage limiting chopper 1 is too high (> 100 %).
- 12: The I2t value (r51576) of the voltage limiting chopper 2 is too high (> 100 %).
- 20: The chopper capacitors were not able to be pre-charged within the time set in p50089.

Note:

r50047[0]: Alarm value

r50047[1]: CCP state (extended status word + r51574)

r50047[2]: Armature voltage

**Remedy:**

Interpret the fault value and rectify the fault correspondingly.

Reaction upon F: NONE

Acknowl. upon F: IMMEDIATELY

Reaction upon N: NONE

Acknowl. upon N: NONE

# Appendix

# A

## Content

A.1	ASCII table (excerpt)	A-1142
-----	-----------------------	--------

## A.1 ASCII table (excerpt)

The following table includes the decimal and hexadecimal notation of selected ASCII characters.

Table A-1 ASCII table (excerpt)

Character	Decimal	Hexadecimal	Character	Decimal	Hexadecimal
Space characters	32	20	G	71	47
*	42	2A	H	72	48
+	43	2B	I	73	49
-	45	2D	J	74	4A
0	48	30	K	75	4B
1	49	31	L	76	4C
2	50	32	M	77	4D
3	51	33	N	78	4E
4	52	34	O	79	4F
5	53	35	P	80	50
6	54	36	Q	81	51
7	55	37	R	82	52
8	56	38	S	83	53
9	57	39	T	84	54
A	65	41	U	85	55
B	66	42	V	86	56
C	67	43	W	87	57
D	68	44	X	88	58
E	69	45	Y	89	59
F	70	46	Z	90	5A

# List of abbreviations

# B

---

## Note:

The following list of abbreviations includes all abbreviations and their meanings used in the entire SINAMICS drive range.

---

Abbreviation	Source of the abbreviation	Meaning
<b>A</b>		
A ...	Alarm	Alarm
AC	Alternating Current	Alternating Current
ADC	Analog Digital Converter	Analog-Digital converter
AI	Analog Input	Analog Input
AIM	Active Interface Module	Active Interface Module
ALM	Active Line Module	Active Line Module
AO	Analog Output	Analog output
AOP	Advanced Operator Panel	Advanced Operator Panel
APC	Advanced Positioning Control	Advanced Positioning Control
AR	Automatic Restart	Automatic restart
ASC	Armature Short Circuit	Armature Short Circuit
ASCII	American Standard Code for Information Interchange	American Standard Code for Information Interchange
ASM	Induction motor	Induction motor
<b>B</b>		
BB	Operating condition	Operating condition
BERO	-	Contact-free proximity switch
BI	Binector Input	Binector input
BIA	Berufsgenossenschaftliches Institut für Arbeitssicherheit	Germany's Institute for Occupational Safety and Health
BICO	Binector Connector Technology	Binector connector technology
BLM	Basic Line Module	Basic Line Module
BO	Binector Output	Binector output
BOP	Basic Operator Panel	Basic Operator Panel
<b>C</b>		
C	Capacitance	Capacitance
C...	-	Safety message
CAN	Controller Area Network	Serial bus system

<b>Abbreviation</b>	<b>Source of the abbreviation</b>	<b>Meaning</b>
CBC	Communication Board CAN	Communication Board CAN
CD	Compact Disk	Compact Disk
CDS	Command Data Set	Command Data Set
CompactFlash card	CompactFlash card	CompactFlash memory card
CI	Connector Input	Connector input
CLC	Clearance Control	Clearance control
CNC	Computer Numerical Control	Computer-supported numerical control
CO	Connector Output	Connector output
CO/BO	Connector Output/Binector Output	Connector output/binector output
COB ID	CAN object identification	CAN object identification
CoL	Certificate of License	Certificate of License
COM	Common contact of a changeover relay	Center contact of a changeover contact
COMM	Commissioning	Commissioning
CP	Communication Processor	Communication processor
CPU	Central Processing Unit	Central processing unit
CRC	Cyclic Redundancy Check	Cyclic redundancy check
CSM	Control Supply Module	Control Supply Module
CU	Control Unit	Control Unit
CUA	Control Unit Adapter	Control Unit Adapter
CUD	Control Unit DC MASTER	Control Unit DC MASTER
<b>D</b>		
DAC	Digital Analog Converter	Digital-Analog converter
DC	Direct Current	Direct Current
DCB	Drive Control Block	Drive Control Block
DCBRK	DC Brake	DC braking
DCC	Drive Control Chart	Drive Control Chart
DCN	Direct Current Negative	Direct current negative
DCP	Direct Current Positive	Direct current positive
DDS	Drive Data Set	Drive Data Set
DI	Digital Input	Digital input
DI/DO	Digital Input/Digital Output	Digital input/digital output bidirectional
DMC	DRIVE-CLiQ Hub Module Cabinet	DRIVE-CLiQ Hub Module Cabinet
DME	DRIVE-CLiQ Hub Module External	DRIVE-CLiQ Hub Module External
DMM	Double Motor Module	Double Motor Module
DO	Digital Output	Digital output
DO	Drive Object	Drive object
DP	Distributed Peripherals	Distributed I/O
DPRAM	Dual Ported Random Access Memory	Memory with dual access
DQ	DRIVE-CLiQ	DRIVE-CLiQ
DRAM	Dynamic Random Access Memory	Dynamic memory



<b>Abbreviation</b>	<b>Source of the abbreviation</b>	<b>Meaning</b>
DRIVE-CLiQ	Drive Component Link with IQ	Drive Component Link with IQ
DSC	Dynamic Servo Control	Dynamic Servo Control
DTC	Digital Time Clock	Timer
<b>E</b>		
EASC	External Armature Short Circuit	External armature short-circuit
EDS	Encoder Data Set	Encoder data set
ESD	Electrostatic sensitive devices	Electrostatic sensitive devices
ELCB	Earth Leakage Circuit Breaker	Residual current operated circuit breaker
ELP	Earth Leakage Protection	Ground-fault monitoring
EMC	Electromagnetic Compatibility	Electromagnetic compatibility
EMF	Electromotive force	Electromotive force
EMF	Electromotive force	Electromotive force
EMC	Electromagnetic compatibility	Electromagnetic compatibility
EN	European standard	European standard
EnDat	Encoder Data Interface	Encoder interface
EP	Enable Pulses	Pulse enable
EPOS	Basic positioner	Basic positioner
ES	Engineering System	Engineering System
ESB	Equivalent circuit diagram	Equivalent circuit diagram
ESD	Electrostatic Sensitive Devices	Electrostatic sensitive devices
ESM	Essential service mode	Essential service mode
ESR	Extended Stop and Retract	Extended stop and retract.
<b>F</b>		
F...	Fault	Fault
FAQ	Frequently Asked Questions	Frequently asked questions
FBLOCKS	Free blocks	Free function blocks
FCC	Function Control Chart	Function Control Chart
FCC	Flux Current Control	Flux current control
FD	Function Diagram	Function diagram
F-DI	Failsafe Digital Input	Fail-safe digital input
F-DO	Failsafe Digital Output	Failsafe digital output
FEM	Separately excited synchronous motor	Separately excited synchronous motor
FEPRM	Flash EPROM	Non-volatile read/write memory
FG	Function Generator	Function generator
RCCB	-	Fault current
FOC	Fiber-Optic Cable	Fiber-optic cables
FP	Function diagram	Function diagram
FPGA	Field Programmable Gate Array	Field Programmable Gate Array
FW	Firmware	Firmware

Abbreviation	Source of the abbreviation	Meaning
<b>G</b>		
GB	Gigabyte	Gigabyte
GC	Global Control	Global Control Telegram (broadcast telegram)
GND	Ground	Reference potential for all signal and operating voltages, usually defined as 0 V (also referred to as G)
GSD	Generic station description file	Generic station description file: Describes the characteristics of a PROFIBUS slave
GSV	Gate supply voltage	Gate supply voltage
GUID	Globally Unique Identifier	Globally Unique Identifier
<b>H</b>		
HF	High Frequency	High frequency
HFD	High-frequency reactor	High-frequency reactor
HLA	Hydraulic Linear Actuator	Hydraulic linear drive
RFG	Ramp-function generator	Ramp-function generator
HMI	Human Machine Interface	Human machine interface
HTL	High-Threshold Logic	Logic with high interference threshold
Hardware	Hardware	Hardware
<b>I</b>		
i. V.	Under development	Under development: This feature is not currently available.
I/O	Input/Output	Input/output
I2C	Inter-Integrated Circuit	Internal serial data bus
IASC	Internal Armature Short Circuit	Internal armature short-circuit
COMM	Commissioning	Commissioning
ID	Identifier	Identification
IE	Industrial Ethernet	Industrial Ethernet
IEC	International Electrotechnical Commission	International Electrotechnical Commission
IF	Interface	Interface
IGBT	Insulated Gate Bipolar Transistor	Bipolar transistor with insulated control electrode
IGCT	Integrated Gate-Controlled Thyristor	Semiconductor power switch with integrated control electrode
IL	Pulse cancelation	Pulse cancelation
IP	Internet Protocol	Internet Protocol
IPO	Interpolator	Interpolator
IT	Isolé Terré	Non-grounded three-phase line supply
IVP	Internal Voltage Protection	Internal voltage protection
<b>J</b>		
JOG	Jogging	Jog

Abbreviation	Source of the abbreviation	Meaning
<b>K</b>		
CDC	Crosswise data comparison	Crosswise data comparison
KHP	Know-how protection	Know-how protection
KIP	Kinetic buffering	Kinetic buffering
Kp	-	Proportional gain
KTY	-	Special temperature sensor
<b>L</b>		
L	-	Symbol for inductance
LED	Light Emitting Diode	Light emitting diode
LIN	Linear motor	Linear motor
LR	Position controller	Position controller
LSB	Least Significant Bit	Least significant bit
LSC	Line-side converter	Line-side converter
LSS	Line Side Switch	Line side switch
LU	Length Unit	Length unit
FOC	Fiber-optic cables	Fiber-optic cables
<b>M</b>		
M	-	Symbol for torque
M	Ground	Reference potential for all signal and operating voltages, usually defined as 0 V (also referred to as GND)
MB	Megabyte	Megabyte
MCC	Motion Control Chart	Motion Control Chart
MDI	Manual Data Input	Manual data input
MDS	Motor Data Set	Motor data set
MLFB	Machine-readable product code	Machine-readable product code
MMC	Man-Machine Communication	Man-machine communication
MMC	Micro Memory Card	Micro memory card
MSB	Most Significant Bit	Most significant bit
MSC	Motor-Side Converter	Motor-side converter
MSCY_C1	Master Slave Cycle Class 1	Cyclic communication between master (Class 1) and slave
MSR	Motor-side converter	Motor-side converter
MT	Probe	Probe
<b>N</b>		
N. C.	Not Connected	Not connected
N...	No Report	No message or internal message
NAMUR	Normenarbeitsgemeinschaft für Mess- und Regeltechnik in der chemischen Industrie	Standardization association for measurement and control in the chemical industry
NC	Normally Closed (contact)	NC contact
NC	Numerical Control	Numerical Control

<b>Abbreviation</b>	<b>Source of the abbreviation</b>	<b>Meaning</b>
NEMA	National Electrical Manufacturers Association	Standardization body in the US
ZM	Zero mark	Zero mark
NO	Normally Open (contact)	NO contact
NSR	Line-side converter	Line-side converter
NVRAM	Non-Volatile Random Access Memory	Non-volatile read/write memory
<b>O</b>		
OA	Open Architecture	Software component (technology package) which provides additional functions for the SINAMICS drive system
OAIF	Open Architecture Interface	Version of the SINAMICS firmware from which the OA-application can be used
OASP	Open Architecture Support Package	Expands the STARTER commissioning tool by the corresponding OA-application
OC	Operating Condition	Operating condition
OEM	Original Equipment Manufacturer	Original equipment manufacturer
OLP	Optical Link Plug	Fiber optic bus connector
OMI	Option Module Interface	Option Module Interface
<b>P</b>		
p...	-	Adjustable parameters
P1	Processor 1	Processor 1
P2	Processor 2	Processor 2
PB	PROFIBUS	PROFIBUS
PcCtrl	PC Control	Master control
PD	PROFIdrive	PROFIdrive
PDS	Power unit Data Set	Power unit data set
PE	Protective Earth	Protective earth (ground)
PELV	Protective Extra-Low Voltage	Safety extra-low voltage
PEM	Permanent-magnet synchronous motor	Permanent-magnet synchronous motor
PG	Programming device	Programming device
PI	Proportional integral	Proportional integral
PID	Proportional integral differential	Proportional integral differential
PLC	Programmable Logic Controller	Programmable logic controller
PLL	Phase-locked loop	Phase-locked loop
PN	PROFINET	PROFINET
PNO	PROFIBUS user organization	PROFIBUS user organization
PPI	Point-to-Point Interface	Point-to-point interface
PRBS	Pseudo Random Binary Signal	White noise
PROFIBUS	Process Field Bus	Serial data bus
PS	Power Supply	Power supply
PSA	Power stack adapter	Power stack adapter
PTC	Positive Temperature Coefficient	Positive temperature coefficient

<b>Abbreviation</b>	<b>Source of the abbreviation</b>	<b>Meaning</b>
PTP	Point-To-Point	Point-to-point
PWM	Pulse Width Modulation	Pulse width modulation
PZD	Process data	Process data
<b>Q</b>		
<b>R</b>		
r ...	-	Display parameters (read-only)
RAM	Random Access Memory	Random access memory (read-write)
RCCB	Residual Current Circuit Breaker	Residual current operated circuit breaker
RCD	Residual Current Device	Residual current operated circuit breaker
RCM	Residual Current Monitor	Residual current monitor
RFG	Ramp-Function Generator	Ramp-function generator
RJ45	Registered Jack 45	Designation for an 8-pin socket system for data transmission with shielded or non-shielded multi-wire copper cables
RKA	Cooling unit	Cooling unit
RLM	Renewable Line Module	Renewable Line Module
RO	Read Only	Read only
RPDO	Receive Process Data Object	Receive Process Data Object
RS232	Recommended Standard 232	Interface standard for cable-connected serial data transmission between a sender and receiver (also known as EIA232)
RS485	Recommended Standard 485	Interface standard for a cable-connected differential, parallel, and/or serial bus system (data transmission between a number of senders and receivers, also known as EIA485)
RTC	Real Time Clock	Realtime clock
SVA	Space vector approximation	Space vector approximation
<b>S</b>		
S1	-	Continuous duty
S3	-	Intermittent operation
SAM	Safe Acceleration Monitor	Safe acceleration monitoring
SBC	Safe Brake Control	Safe brake control
SBH	Safe operating stop	Safe operating stop
SBR	Safe Brake Ramp	Safe brake ramp monitoring
SBT	Safe Brake Test	Safe brake test
SCA	Safe Cam	Safe cam
SD Card	Secure Digital Card	Secure digital memory card
SDI	Safe Direction	Safe direction of motion
SE	Safe software limit switch	Safe software limit switch
SG	Safely-limited speed	Safely-limited speed
SGA	Safety-related output	Safety-related output

<b>Abbreviation</b>	<b>Source of the abbreviation</b>	<b>Meaning</b>
SGE	Safety-related input	Safety-related input
SH	Safe standstill	Safe standstill
SI	Safety Integrated	Safety Integrated
SIL	Safety Integrity Level	Safety Integrity Level
SLM	Smart Line Module	Smart Line Module
SLP	Safely-Limited Position	Safely-limited position
SLS	Safely-Limited Speed	Safely-limited speed
SLVC	Sensorless Vector Control	Vector control without encoder
SM	Sensor Module	Sensor Module
SMC	Sensor Module Cabinet	Sensor Module Cabinet
SME	Sensor Module External	Sensor Module External
SMI	SINAMICS Sensor Module Integrated	SINAMICS Sensor Module Integrated
SMM	Single Motor Module	Single Motor Module
SN	Safe software cam	Safe software cam
SOS	Safe Operating Stop	Safe operating stop
SP	Service pack	Service pack
SP	Safe Position	Safe Position
SPC	Setpoint Channel	Setpoint channel
SPI	Serial Peripheral Interface	Serial interface for connecting peripherals
PLC	Programmable logic controller	Programmable logic controller
SS1	Safe Stop 1	Safe Stop 1 (monitored for time and ramp)
SS2	Safe Stop 2	Safe Stop 2
SSI	Synchronous Serial Interface	Synchronous serial interface
SSM	Safe Speed Monitor	Safe feedback from speed monitoring device
SSP	SINAMICS Support Package	SINAMICS Support Package
STO	Safe Torque Off	Safe torque off
STW	Control word	Control word
<b>T</b>		
TB	Terminal Board	Terminal Board
TIA	Totally Integrated Automation	Totally Integrated Automation
TM	Terminal Module	Terminal Module
TN	Terre Neutre	Grounded three-phase line supply
Tn	-	Integral time
TPDO	Transmit Process Data Object	Transmit Process Data Object
TT	Terre Terre	Grounded three-phase line supply
TTL	Transistor-Transistor Logic	Transistor-transistor logic
Tv	-	Rate time
<b>U</b>		
UL	Underwriters Laboratories Inc.	Underwriters Laboratories Inc.
UPS	Uninterruptible Power Supply	Uninterruptible power supply

<b>Abbreviation</b>	<b>Source of the abbreviation</b>	<b>Meaning</b>
UPS	Uninterruptible power supply	Uninterruptible power supply
UTC	Universal Time Coordinated	Universal time coordinated
<b>V</b>		
VC	Vector Control	Vector control
Vdc	-	DC link voltage
VdcN	-	Partial DC link voltage, negative
VdcP	-	Partial DC link voltage, positive
VDE	Verband Deutscher Elektrotechniker	Association of German Electrical Engineers
VDI	Verein Deutscher Ingenieure	Association of German Engineers
VPM	Voltage Protection Module	Voltage Protection Module
Vpp	Volt peak to peak	Volt peak to peak
VSM	Voltage sensing module	Voltage sensing module
<b>W</b>		
AR	Automatic restart	Automatic restart
MT	Machine tool	Machine tool
<b>X</b>		
XML	Extensible Markup Language	Standard language for web publishing and document management
<b>Y</b>		
<b>Z</b>		
ZK	DC link	DC link
ZM	Zero Mark	Zero mark
ZSW	Status word	Status word





# Index

# C

## Numbers

- 1020
  - Explanation of the symbols (Part 1), 2-667
- 1021
  - Explanation of the symbols (Part 2), 2-668
- 1022
  - Explanation of the symbols (Part 3), 2-669
- 1030
  - Handling BICO technology, 2-670
- 1520
  - PROFIdrive, 2-672
- 1580
  - Encoder evaluations (position, speed), 2-673
- 1720
  - Closed-loop control, 2-674
- 1721
  - Activation/deactivation of closed-loop control functions, 2-675
- 1722
  - CUD left, CUD right, 2-676
- 1781
  - Terminal Module 15 for SINAMICS (TM15DI/DO), 2-677
- 1840
  - Terminal Module 31 (TM31), 2-678
- 2050
  - Digital inputs (DI 0 ... DI 3), 2-680
- 2055
  - Digital outputs (DO 0 ... DO 3), 2-681
- 2060
  - Digital inputs/outputs, bidirectional (DI/DO 4 to DI/DO 5), 2-682
- 2065
  - Digital inputs/outputs, bidirectional (DI/DO 6 to DI/DO 7), 2-683
- 2070
  - E stop (emergency stop), relay output main contactor, 2-684
- 2075
  - Analog inputs (AI 0 and XT1.103/104), 2-685
- 2080
  - Analog inputs (AI 1 ... AI 2), 2-686
- 2085
  - Analog inputs (AI 3 ... AI 4), 2-687
- 2090
  - Analog inputs (AI 5 ... AI 6), 2-688
- 2095
  - Analog outputs (AO 0 ... AO 1), 2-689
- 2410
  - PROFIBUS (PB) / PROFINET (PN) / USS, addresses and diagnostics, 2-691
- 2420
  - Telegrams and process data (PZD), 2-692
- 2425
  - STW1\_BM control word metal industry interconnection, 2-693
- 2426
  - STW2\_BM control word metal industry interconnection, 2-694
- 2428
  - ZSW1\_BM status word metal industry interconnection, 2-695
- 2429
  - ZSW2\_BM status word metal industry interconnection, 2-696
- 2440
  - PZD receive signals interconnection, 2-697
- 2442
  - STW1 control word interconnection, 2-698
- 2444
  - STW2 control word interconnection, 2-699
- 2450
  - PZD send signals interconnection, 2-700
- 2452
  - ZSW1 status word interconnection, 2-701
- 2454
  - ZSW2 status word interconnection, 2-702
- 2460
  - IF1 receive telegram, free interconnection via BICO (p0922 = 999), 2-703
- 2470
  - IF1 send telegram, free interconnection via BICO (p0922 = 999), 2-704

- 2472
  - IF1 status words, free interconnection, 2-705
- 2481
  - IF1 receive telegram, free interconnection via BICO (p0922 = 999), 2-706
- 2483
  - IF1 send telegram, free interconnection via BICO (p0922 = 999), 2-707
- 2485
  - IF2 receive telegram, free interconnection via BICO (p0922 = 999), 2-708
- 2487
  - IF2 send telegram, free interconnection via BICO (p0922 = 999), 2-709
- 2489
  - IF2 status words, free interconnection, 2-710
- 2495
  - CU\_STW1 control word 1 Control Unit interconnection, 2-711
- 2496
  - CU\_ZSW1 status word 1, Control Unit interconnection, 2-712
- 2497
  - A\_DIGITAL interconnection, 2-713
- 2498
  - E\_DIGITAL interconnection, 2-714
- 2534
  - Status word monitoring functions 1, 2-716
- 2537
  - Status word monitoring functions 3, 2-717
- 2546
  - Control word, faults/alarms, 2-718
- 2548
  - Status word faults/alarms 1 and 2, 2-719
- 2580
  - Control word sequential control, 2-720
- 2585
  - Status word sequence control, 2-721
- 2650
  - Sequencer (Part 1), 2-723
- 2651
  - Sequencer (Part 2), 2-724
- 2655
  - Missing enable signals, logic operations, 2-725
- 2660
  - Optimization runs, 2-726
- 2750
  - Brake control, 2-728
- 3100
  - Fixed values, 2-730
- 3105
  - 4-stage joystick switch, 2-731
- 3110
  - Motorized potentiometer, 2-732
- 3113
  - AOP30 display and control unit, 2-733
- 3115
  - Fixed setpoint, 2-734
- 3120
  - Oscillation/square-wave generator, 2-735
- 3125
  - Jog setpoint, 2-736
- 3130
  - Creep setpoint, 2-737
- 3135
  - Setpoint processing, 2-738
- 3150
  - Ramp-function generator (Part 1), 2-739
- 3151
  - Ramp-function generator (Part 2), 2-740
- 3152
  - Ramp-function generator (Part 3), 2-741
- 3155
  - Limitation after ramp-function generator, 2-742
- 4704
  - Position sensing, encoders 1 ... 2, 2-744
- 4710
  - Speed actual value sensing, motor encoder (encoder 1), 2-745
- 4711
  - Speed actual value sensing, encoder 2, 2-746
- 4720
  - Encoder interface, receive signals, encoders 1... 2, 2-747
- 4730
  - Encoder interface, send signals, encoders 1... 2, 2-748
- 4735
  - Reference mark search, encoders 1 ... 2, 2-749
- 4750
  - Absolute value for incremental encoder, 2-750
- 6800
  - Speed controller start pulse, 2-752
- 6805
  - Speed controller (Part 1), 2-753
- 6810
  - Speed controller (Part 2), 2-754
- 6812
  - Speed controller (Part 3), 2-755

- 6815
  - Speed controller (Part 4), 2-756
- 6820
  - Friction/moment of inertia compensation, 2-757
- 6825
  - Torque limiting (Part 1), 2-758
- 6830
  - Torque limiting (Part 2), 2-759
- 6835
  - Speed limiting controller, 2-760
- 6840
  - Current limitation (Part 1), 2-761
- 6845
  - Current limitation (Part 2), 2-762
- 6850
  - Armature current actual value sensing (Part 1), 2-763
- 6851
  - Armature current actual value sensing (Part 2), 2-764
- 6852
  - EMF actual value selection for armature current precontrol, 2-765
- 6853
  - Armature current controller adaptation, 2-766
- 6854
  - Armature circuit model parameters, 2-767
- 6855
  - Armature current control, 2-768
- 6858
  - Gating unit characteristic, linearization, 2-769
- 6860
  - Auto-reversing stage, armature gating unit, 2-770
- 6862
  - Limitations, state, 2-771
- 6865
  - Simulation mode/thyristor check/commutation monitoring, 2-772
- 6895
  - Line-dependent EMF reduction, 2-773
- 6900
  - EMF closed-loop control, 2-775
- 6902
  - Actual value acquisition, armature voltage/EMF, 2-776
- 6905
  - Field current setpoint limitation, 2-777
- 6908
  - Field current controller adaptation, 2-778
- 6910
  - Field current closed-loop control, 2-779
- 6912
  - Field current actual value sensing, 2-780
- 6915
  - Field gating unit, 2-781
- 6920
  - Field reversal, 2-782
- 6950
  - Line analysis, armature, 2-784
- 6952
  - Line analysis, field, 2-785
- 6954
  - Line monitoring, 2-786
- 6956
  - Fuse monitoring (DC converter), 2-787
- 6957
  - Fuse monitoring (Control Module), 2-788
- 6960
  - Power unit, properties, 2-789
- 6965
  - Adaptation to external power unit (Control Module), 2-790
- 6970
  - Converter Commutation Protector (CCP), 2-791
- 7958
  - Closed-loop control ( $r0108 = 1$ ), 2-793
- 8020
  - Messages (Part 1), 2-795
- 8025
  - Messages (Part 2), 2-796
- 8030
  - Motor interface (Part 1, X177.53/54/55), 2-797
- 8035
  - Motor interface (Part 2), 2-798
- 8038
  - I2t monitoring motor, 2-799
- 8040
  - Speed-dependent current limitation, 2-800
- 8042
  - I2t monitoring power unit, 2-801
- 8044
  - Field current monitoring, 2-802
- 8045
  - Device fan operating hours counter, 2-803
- 8046
  - Monitoring stall protection/tachometer breakage, 2-804
- 8047
  - Device fan (DC converter), 2-805

- 8048
    - Internal device monitoring functions, 2-806
  - 8049
    - Device fan (Control Module), 2-807
  - 8050
    - Trend recorder function, 2-808
  - 8052
    - Diagnostic memory, 2-809
  - 8054
    - Internal diagnostics, 2-810
  - 8060
    - Fault buffer, 2-812
  - 8065
    - Alarm buffer, 2-813
  - 8070
    - Fault/alarm trigger word (r2129), 2-814
  - 8075
    - Fault/alarm configuration, 2-815
  - 8560
    - Command data sets (CDS) , 2-817
  - 8565
    - Drive data sets (DDS) , 2-818
  - 8570
    - Encoder data sets (EDS) , 2-819
  - 9300
    - Peer-to-peer interface, 2-821
  - 9350
    - Paralleling interface (Part 1), 2-822
  - 9352
    - Paralleling interface (Part 2), 2-823
  - 9355
    - Paralleling interface (Part 3), 2-824
  - 9360
    - Switchover of the power unit topology, 2-825
  - 9400
    - Digital inputs/outputs, bidirectional (DI/DO 0 ... DI/DO 7), 2-827
  - 9401
    - Digital inputs/outputs, bidirectional (DI/DO 8 ... DI/DO 15), 2-828
  - 9402
    - Digital inputs/outputs, bidirectional (DI/DO 16 ... DI/DO 23), 2-829
  - 9550
    - Digital inputs, isolated (DI 0 ... DI 3), 2-831
  - 9552
    - Digital inputs, isolated (DI 4 ... DI 7), 2-832
  - 9556
    - Digital relay outputs, isolated (DO 0 ... DO 1), 2-833
  - 9560
    - Digital inputs/outputs, bidirectional (DI/DO 8 ... DI/DO 9), 2-834
  - 9562
    - Digital inputs/outputs, bidirectional (DI/DO 10 ... DI/DO 11), 2-835
  - 9566
    - Analog input 0 (AI 0), 2-836
  - 9568
    - Analog input 1 (AI 1), 2-837
  - 9572
    - Analog outputs (AO 0 ... AO 1), 2-838
  - 9576
    - Temperature evaluation KTY/PTC, 2-839
  - 9577
    - Sensor monitoring KTY/PTC, 2-840
  - 9625
    - TM150 Temperature evaluation structure (channels 0 ... 11), 2-842
  - 9626
    - TM150 Temperature evaluation 1x2, 3, 4-wire (channels 0 ... 5), 2-843
  - 9627
    - TM150 Temperature evaluation 2x2-wire (channels 0 ... 11), 2-844
  - 9912
    - BOP20 control word interconnection, 2-846
- A**
- Access level (parameter), 1-15
  - Acknowledgment
    - Adjustable, 3-854
    - Default, 3-854
    - IMMEDIATELY, 3-850
    - POWER ON, 3-850
    - PULSE INHIBIT, 3-850
  - Active (parameter, C1(x), C2(x), U, T), 1-14
  - Address
    - Technical Support, Preface-6
  - Adjustable parameters, 1-11
  - Advanced Operator Panel 30 (AOP30), 2-733

**Alarm**

- Cause, 3-854
- Display, 3-848
- Drive object, 3-853
- Explanation of list, 3-852
- Fault location, 3-853
- General information, 3-848
- How to distinguish an alarm from a fault, 3-848
- List of all alarms, 3-857
- Message value, 3-853
- Name, 3-853
- Number, 3-852
- Number range, 3-857
- Remedy, 3-854

Alarm value, 3-854

Armature current controller, 2-751

ASCII table, A-1142

Axxxx, 3-852

**B**

Basic Operator Panel 20 (BOP20), 2-845

BI, Binector Input, 1-12

BICO technology, 2-670

Binector

- Input (BI), 1-12

- Output (BO), 1-12

Bit array (parameter), 1-20

BO, Binector Output, 1-12

Brake control, 2-728

Brake control function diagrams

- Brake control, 2-728

**C**

C1(x) - Status commissioning device, 1-14

C2(x) - Status commissioning drive, 1-14

Calculated (parameter), 1-15

Can be changed (parameter, C1(x), C2(x), U, T), 1-14

CDS (Command Data Set), 1-17

CI, Connector Input, 1-12

Closed-loop control functions, 2-675

CO, Connector Output, 1-12

CO/BO, Connector/Binector Output, 1-12

Connector

- Input (CI), 1-12

- Output (CO), 1-12

**CUD**

- Input/output terminals, 2-679

- left, 2-676

- right, 2-676

Current limitation, 2-751

Cxxxxx, 3-852

**D**

Data set, 1-17

- Command Data Set, 1-17

- Command Data Set, CDS, 1-17

- Drive data set, 1-17

- Drive data set, DDS, 1-17

- Encoder data set, 1-17

- Encoder Data Set, EDS, 1-17

Data type (parameter, signal source), 1-16

DDS (Drive Data Set), 1-17

Dependency (parameter), 1-20

Description (parameter), 1-19

Device fan

- Control Module, 2-807

- DC converter, 2-805

Diagnostics

- Diagnostic memory, 2-809

- Internal diagnostics, 2-810

- Trend recorder function, 2-808

Directory

- ASCII table, A-1142

- Complete table of contents, Contents-7

- List of abbreviations, B-1143

- Table of contents, function diagrams, 2-660

Display

- Alarms, 3-848

- Faults, 3-848

Display parameters, 1-11

DO, Drive Object, 1-12

Drive object, 1-12

**E**

E Stop (Emergency Stop), 2-684

EDS (Encoder Data Set), 1-17

EMF closed-loop control, 2-774

Encoder evaluation, 2-743

Expert list, 1-19

Explanations

- about function diagrams, 2-666

- about the list of parameters, 1-10

- List of faults and alarms, 3-852

**F**

Factory setting, 1-18

**Fault**

- Acknowledgment, 3-850, 3-854
- Cause, 3-854
- Display, 3-848
- Drive object, 3-853
- Explanation of list, 3-852
- Fault location, 3-853
- Fault reaction, 3-849, 3-853
- General information, 3-848
- How to distinguish a fault from an alarm, 3-848
- List of all faults, 3-857
- Message value, 3-853
- Name, 3-853
- Number, 3-852
- Number range, 3-857
- Remedy, 3-854
- Save at switch off, 3-851

**Fault buffer**

- Save at switch off, 3-851

Fault value, 3-854

Field current controller, 2-774

Fixed setpoint, 2-734

Fixed values, 2-668, 2-730

Friction/moment of inertia compensation, 2-751

Function (parameter), 1-19

Function diagrams, armature circuit closed-loop control

- Armature circuit model parameters, 2-767
- Armature current actual value sensing, 2-763, 2-764
- Armature current control, 2-768
- Armature current controller adaptation, 2-766
- Auto-reversing stage, armature gating unit, 2-770
- Current limitation, 2-761, 2-762
- EMF actual value selection for armature current precontrol, 2-765
- Friction/moment of inertia compensation, 2-757
- Gating unit characteristic, linearization, 2-769
- Limitations, state, 2-771
- Line-dependent EMF reduction, 2-773
- Simulation mode/thyristor check/commutation monitoring, 2-772
- Speed controller, 2-753, 2-754, 2-755, 2-756

Speed controller start pulse, 2-752

Speed limiting controller, 2-760

Torque limiting, 2-758, 2-759

Function diagrams, Basic Operator Panel 20 (BOP20)

Control word interconnection, 2-846

Function diagrams, communication between devices

- Paralleling interface (Part 1), 2-822
- Paralleling interface (Part 2), 2-823
- Paralleling interface (Part 3), 2-824
- Peer-to-peer interface, 2-821
- Switchover of the power unit topology, 2-825

Function diagrams, CUD input/output terminals

- Analog inputs (AI 0 and XT1.103/104), 2-685
- Analog inputs (AI 1 ... AI 2), 2-686
- Analog inputs (AI 3 ... AI 4), 2-687
- Analog inputs (AI 5 ... AI 6), 2-688
- Analog outputs (AO 0 ... AO 1), 2-689
- Digital inputs (DI 0 ... DI 3), 2-680
- Digital inputs/outputs, bidirectional (DI/DO 4 to DI/DO 5), 2-682
- Digital inputs/outputs, bidirectional (DI/DO 6 to DI/DO 7), 2-683
- Digital outputs (DO 0 ... DO 3), 2-681
- E stop (emergency stop), relay output main contactor, 2-684

Function diagrams, data sets

- Command data sets (CDS) , 2-817
- Drive data sets (DDS) , 2-818
- Encoder data sets (EDS) , 2-819

Function diagrams, encoder evaluation

- Absolute value for incremental encoder, 2-750
- Encoder interface, receive signals, encoders 1... 2, 2-747
- Encoder interface, send signals, encoders 1... 2, 2-748
- Position sensing, encoders 1 ... 2, 2-744
- Reference mark search, encoders 1 ... 2, 2-749
- Speed actual value sensing, encoder 2, 2-746
- Speed actual value sensing, motor encoder (encoder 1), 2-745

Function diagrams, explanations

- Explanation of the symbols (Part 1), 2-667
- Explanation of the symbols (Part 2), 2-668
- Explanation of the symbols (Part 3), 2-669
- Handling BICO technology, 2-670

- Function diagrams, faults and alarms
  - Alarm buffer, 2-813
  - Fault buffer, 2-812
  - Fault/alarm configuration, 2-815
  - Fault/alarm trigger word (r2129), 2-814
- Function diagrams, field circuit closed-loop control
  - Actual value acquisition, armature voltage/EMF, 2-776
  - EMF closed-loop control, 2-775
  - Field current actual value sensing, 2-780
  - Field current closed-loop control, 2-779
  - Field current controller adaptation, 2-778
  - Field current setpoint limitation, 2-777
  - Field gating unit, 2-781
  - Field reversal, 2-782
- Function diagrams, internal control/status words
  - Control word sequential control, 2-720
  - Control word, faults/alarms, 2-718
  - Status word faults/alarms 1 and 2, 2-719
  - Status word monitoring functions 1, 2-716
  - Status word monitoring functions 3, 2-717
  - Status word sequence control, 2-721
- Function diagrams, overviews
  - Activation/deactivation of closed-loop control functions, 2-675
  - Closed-loop control, 2-674
  - CUD left, CUD right, 2-676
  - Encoder evaluations (position, speed), 2-673
  - PROFIdrive, 2-672
  - Terminal Module 15 for SINAMICS (TM15DI/DO), 2-677
  - Terminal Module 31 (TM31), 2-678
- Function diagrams, power unit
  - Adaptation to external power unit (Control Module), 2-790
  - Converter Commutation Protector (CCP), 2-791
  - Fuse monitoring (Control Module), 2-788
  - Fuse monitoring (DC converter), 2-787
  - Line analysis, armature, 2-784
  - Line analysis, field, 2-785
  - Line monitoring, 2-786
  - Power unit, properties, 2-789
- Function diagrams, PROFIdrive
  - A\_DIGITAL interconnection, 2-713
  - CU\_STW1 control word 1 Control Unit interconnection, 2-711
  - CU\_ZSW1 status word 1, Control Unit interconnection, 2-712
  - E\_DIGITAL interconnection, 2-714
  - IF1 receive telegram, free interconnection via BICO (p0922 = 999), 2-703, 2-706
  - IF1 send telegram, free interconnection via BICO (p0922 = 999), 2-704, 2-707
  - IF1 status words, free interconnection, 2-705
  - IF2 receive telegram, free interconnection via BICO (p0922 = 999), 2-708
  - IF2 send telegram, free interconnection via BICO (p0922 = 999), 2-709
  - IF2 status words, free interconnection, 2-710
  - PROFIBUS (PB) / PROFINET (PN) / USS, addresses and diagnostics, 2-691
  - PZD receive signals interconnection, 2-697
  - PZD send signals interconnection, 2-700
  - STW1 control word interconnection, 2-698
  - STW1\_BM control word metal industry interconnection, 2-693
  - STW2 control word interconnection, 2-699
  - STW2\_BM control word metal industry interconnection, 2-694
  - Telegrams and process data (PZD), 2-692
  - ZSW1 status word interconnection, 2-701
  - ZSW1\_BM status word metal industry interconnection, 2-695
  - ZSW2 status word interconnection, 2-702
  - ZSW2\_BM status word metal industry interconnection, 2-696
- Function diagrams, sequence control
  - Missing enable signals, logic operations, 2-725
  - Optimization runs, 2-726
  - Sequencer (Part 1), 2-723
  - Sequencer (Part 2), 2-724

Function diagrams, setpoint channel  
  4-stage joystick switch, 2-731  
  AOP30 display and control unit, 2-733  
  Creep setpoint, 2-737  
  Fixed setpoint, 2-734  
  Fixed values, 2-730  
  Jog setpoint, 2-736  
  Limitation after ramp-function generator, 2-742  
  Motorized potentiometer, 2-732  
  Oscillation/square-wave generator, 2-735  
  Ramp-function generator (Part 1), 2-739  
  Ramp-function generator (Part 2), 2-740  
  Ramp-function generator (Part 3), 2-741  
  Setpoint processing, 2-738  
Function diagrams, signals and monitoring functions  
  Device fan (Control Module), 2-807  
  Device fan (DC converter), 2-805  
  Device fan operating hours counter, 2-803  
  Diagnostic memory, 2-809  
  Field current monitoring, 2-802  
  I<sup>2</sup>t monitoring motor, 2-799  
  I<sup>2</sup>t monitoring power unit, 2-801  
  Internal device monitoring functions, 2-806  
  Internal diagnostics, 2-810  
  Messages (Part 1), 2-795  
  Messages (Part 2), 2-796  
  Motor interface (Part 1, X177.53/54/55), 2-797  
  Motor interface (Part 2), 2-798  
  Speed-dependent current limitation, 2-800  
  Stall protection/tachometer breakage, 2-804  
  Trend recorder function, 2-808  
Function diagrams, technology controller  
  Closed-loop control (r0108 = 1), 2-793  
Function diagrams, Terminal Module 15 for SINAMICS (TM15DI/DO)  
  Digital inputs/outputs, bidirectional (DI/DO 0 ... DI/DO 7), 2-827  
  Digital inputs/outputs, bidirectional (DI/DO 16 ... DI/DO 23), 2-829  
  Digital inputs/outputs, bidirectional (DI/DO 8 ... DI/DO 15), 2-828

Function diagrams, Terminal Module 150 (TM150)  
  Temperature evaluation 1x2, 3, 4-wire (channels 0 ... 5), 2-843  
  Temperature evaluation 2x2-wire (channels 0 ... 11), 2-844  
  Temperature evaluation structure (channels 0 ... 11), 2-842  
Function diagrams, Terminal Module 31 (TM31)  
  Analog input 0 (AI 0), 2-836  
  Analog input 1 (AI 1), 2-837  
  Analog outputs (AO 0 ... AO 1), 2-838  
  Digital inputs, isolated (DI 0 ... DI 3), 2-831  
  Digital inputs, isolated (DI 4 ... DI 7), 2-832  
  Digital inputs/outputs, bidirectional (DI/DO 10 ... DI/DO 11), 2-835  
  Digital inputs/outputs, bidirectional (DI/DO 8 ... DI/DO 9), 2-834  
  Digital relay outputs, isolated (DO 0 ... DO 1), 2-833  
  Sensor monitoring KTY/PTC, 2-840  
  Temperature evaluation KTY/PTC, 2-839  
Function Module, 1-12  
Fuse monitoring, 2-783  
Fxxxx, 3-852

## G

General information  
  about function diagrams, 2-666  
  About parameters, 1-10  
  on faults and alarms, 3-848

## H

Hotline, Preface-6

## I

I<sup>2</sup>t monitoring  
  Motor, 2-799  
  Power unit, 2-801  
Index  
  Factory setting, 1-20  
  Parameters, 1-11, 1-20  
Input/output terminals  
  CUD, 2-679  
  TM15DI/DO, 2-826  
  TM31, 2-830  
Instructions  
  Hotline, Preface-6  
  Product information, Preface-6  
  Technical Support, Preface-6



**J**

Joystick switch, 2-731

**L**

Line analysis, 2-783

Line contactor, 2-684

Line monitoring, 2-783

Linked parameters, 1-11

List

Abbreviations, B-1143

ASCII table, A-1142

Faults and alarms, 3-857

Message ranges, 3-857

Parameter ranges, 1-22

Parameters for command data sets, 1-645

Parameters for drive data sets, 1-647

Parameters for encoder data sets, 1-653

Parameters for write protection and know-how protection, 1-655

Parameters, all, 1-25

List of abbreviations, B-1143

Logic operations, 2-725

**M**

Message value, 3-853

Messages

Part 1, 2-795

Part 2, 2-796

Missing enable signals, 2-725

Motor interface

Part 1, 2-797

Part 2, 2-798

Motorized potentiometer, 2-732

**N**

Name

Alarm, 3-853

Fault, 3-853

Parameters, 1-12

Normalizing, 1-19

Not for motor type, 1-18

Number

Alarm, 3-852

Fault, 3-852

Parameters, 1-11

Number range

Alarms, 3-857

Faults, 3-857

Parameters, 1-22

**O**

Object, 1-12

Objective of this manual, Preface-5

OFF1, 3-849

OFF2, 3-849

OFF3, 3-849

Optimization runs, 2-726

**P**

P group (parameter), 1-18

Parameters

Access level, 1-15

Calculated, 1-15

Can be changed, 1-14

Data type, 1-16

Description, 1-19

Dynamic index, 1-17

Expert list, 1-19

Full name, 1-12

Function, 1-19

Index, 1-11, 1-20

Linked parameters, 1-11

List of all parameters, 1-25

List of parameters for command data sets, 1-645

List of parameters for drive data sets, 1-647

List of parameters for encoder data sets, 1-653

Name, 1-12

Normalizing, 1-19

Not for motor type, 1-18

Number, 1-11

Number range, 1-22

P group, 1-18

Safety notices, 1-21

Short name, 1-12

Unit, 1-18

Unit group, 1-18

Unit selection, 1-18

Values, 1-19

Password for access level 4, 1-15

Power unit, properties, 2-789

Product information, Preface-6

PROFIdrive, 2-690

pxxxx, 1-11

**R**

Ramp-function generator

Part 1, 2-739

Part 2, 2-740

Part 3, 2-741

Reaction to faults, 3-849

Resetting faults, 3-854

rxxxx, 1-11

## **S**

- Safety notices (parameter), 1-21
- Search tools for manual, Preface-5
- Sequence control, 2-722
- Sequencer
  - Part 1, 2-723
  - Part 2, 2-724
- Setpoint processing, 2-738
- Signal path for function diagrams, 2-667
- Speed controller, 2-751
- Support, Preface-6
- Support Request, Preface-6
- Symbols
  - Explanation, Part 1, 2-667
  - Explanation, Part 2, 2-668
  - Explanation, Part 3, 2-669

## **T**

- T - Ready state, 1-14
- Target group for this manual, Preface-5
- Technical Support, Preface-6
- Technology controller, 2-793
- Telegrams and process data, 2-692

- Temperature evaluation
  - Terminal Module 150 (TM150), 2-841
- Terminal Module
  - TM150, 2-841
  - TM15DI/DO, 2-677, 2-826
  - TM31, 2-678, 2-830
- Torque limiting, 2-751
- Trend recorder function, 2-808

## **U**

- U - Operation state, 1-14
- Unit (parameter), 1-18

## **V**

- Values (parameter), 1-19
- Version
  - List of all parameters, 1-25
  - List of faults and alarms, 3-857
  - List of parameters for commanddata sets, 1-645
  - List of parameters for drivedata sets, 1-647
  - List of parameters for encoderdata sets, 1-653



Siemens AG  
Industry Sector  
P.O. Box 48 48  
90026 NUREMBERG  
GERMANY

Subject to change  
6RX1800-0ED76  
© Siemens AG 2009-2013

DC Converters  
SINAMICS DCM



[www.siemens.com/automation](http://www.siemens.com/automation)